Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360772

Luminaire Tested: **GSS-SB4B-735-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360772
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB4B-735-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 4SQUARE 148W 70CRI 3500K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(104) 3500K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	21671.3 lumens
Efficiency:	N/A
Efficacy:	146.4 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 1' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B4 - U0 - G4


Input Watts (W):	148
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	13.6%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360772
CATALOG NUMBER: GSS-SB4B-735-U-T1

Iso-Footcandle Lines of Horizontal Illumination

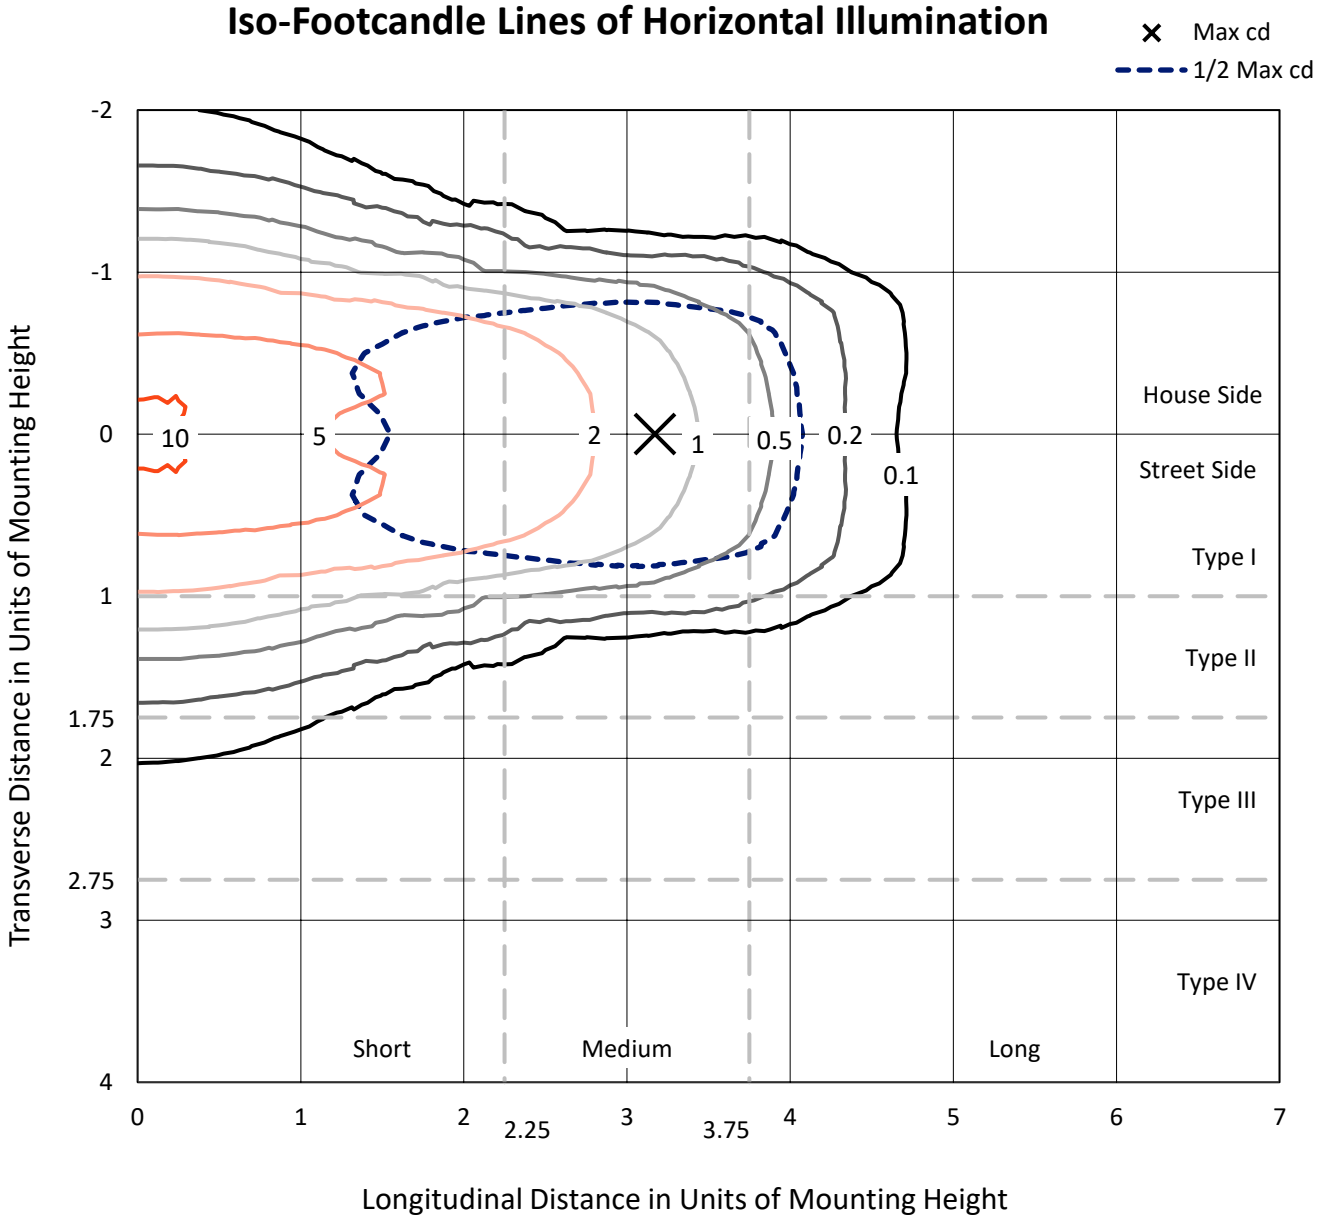


Based on 20 foot mounting height. Maximum calculated value = 10.7 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360772
CATALOG NUMBER: GSS-SB4B-735-U-T1

Luminous Intensity Polar Plot

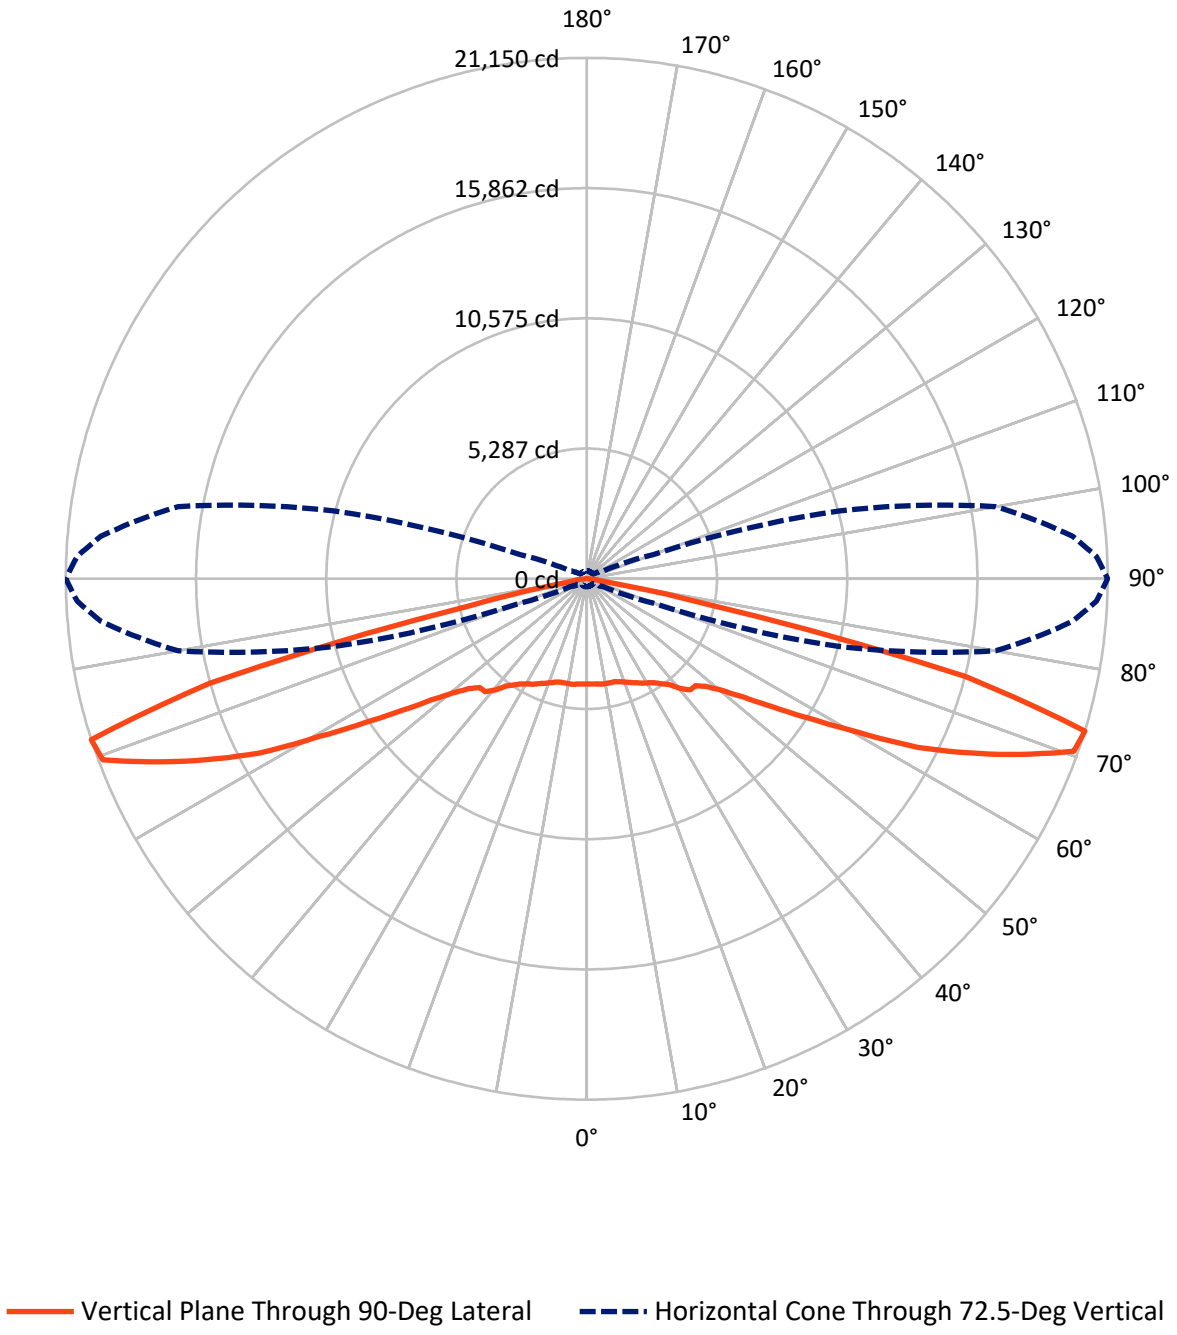

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360772
CATALOG NUMBER: GSS-SB4B-735-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	10835.6	0.0	10835.6
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	10835.6	0.0	10835.6
	% Fixture	50.0	0.0	50.0
Total	Lumens	21671.3	0.0	21671.3
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	413.3	1.9
10°-20°	1259.6	5.8
20°-30°	2105.3	9.7
30°-40°	2903.4	13.4
40°-50°	3559.2	16.4
50°-60°	4170.9	19.2
60°-70°	4631.7	21.4
70°-80°	2518.7	11.6
80°-90°	109.1	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	21671.3	100.0
0°-180°	21671.3	100.0

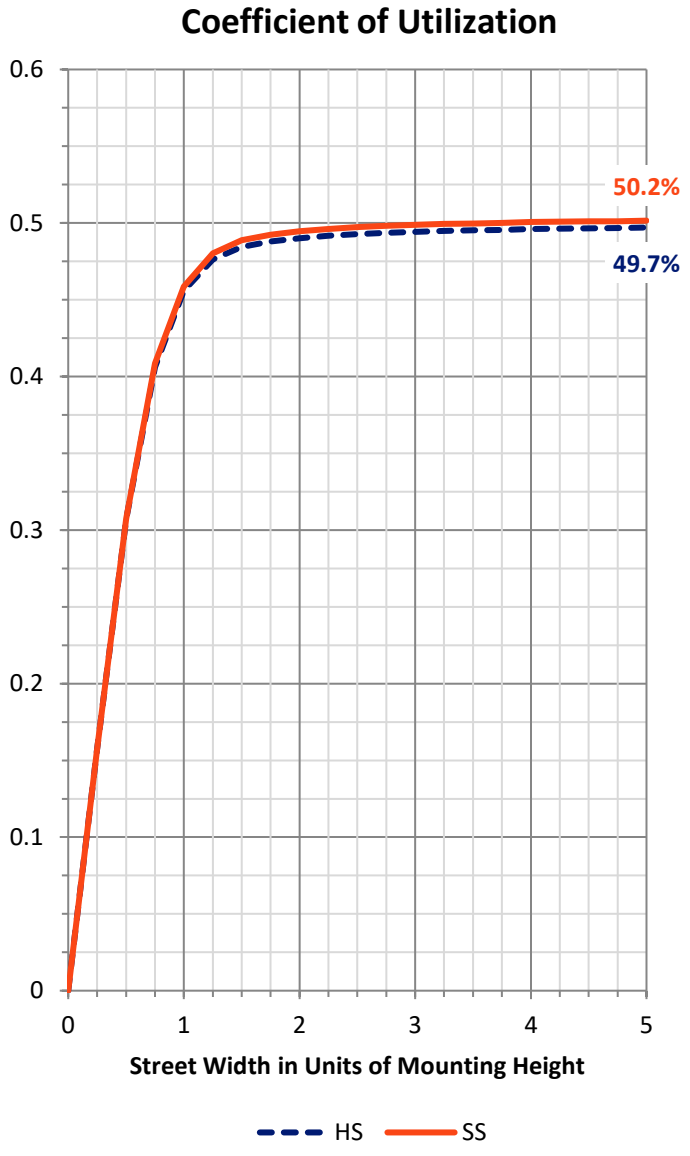

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360772
CATALOG NUMBER: GSS-SB4B-735-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	1889.1	8.7			
FM	(30°-60°)	5316.7	24.5			
FH	(60°-80°)	3575.2	16.5			G2/5000
FVH	(80°-90°)	54.6	0.3			G1/100
BL	(0°-30°)	1889.1	8.7	B3/2500		
BM	(30°-60°)	5316.7	24.5	B4/8500		
BH	(60°-80°)	3575.2	16.5	B4/5000		G4/5000
BVH	(80°-90°)	54.6	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B4-U0-G4
Type I Short

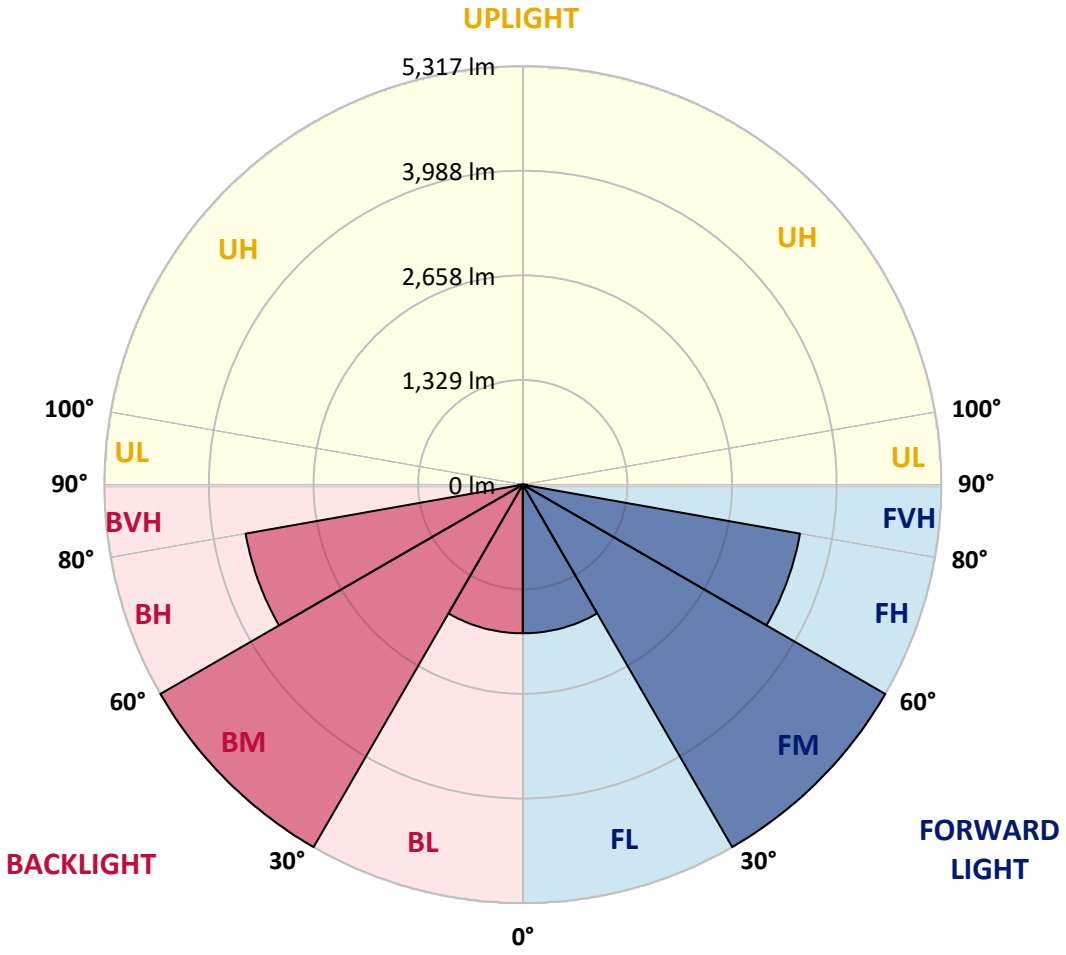

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360772
CATALOG NUMBER: GSS-SB4B-735-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	4269.8	4269.8	4269.8	4269.8	4269.8	4269.8	4269.8	4269.8	4269.8	4269.8	4269.8
2.5°	4274.5	4274.5	4260.3	4279.3	4269.8	4274.5	4279.3	4274.5	4269.8	4274.5	4279.3
5°	4298.2	4288.8	4298.2	4307.7	4293.5	4303.0	4298.2	4274.5	4288.8	4288.8	4288.8
7.5°	4340.9	4350.4	4340.9	4364.7	4350.4	4378.9	4350.4	4331.5	4326.7	4322.0	4322.0
10°	4359.9	4359.9	4355.2	4397.9	4407.4	4435.8	4416.9	4388.4	4374.2	4355.2	4336.2
12.5°	4307.7	4317.2	4340.9	4421.6	4459.6	4516.5	4502.3	4445.3	4402.6	4388.4	4359.9
15°	4250.8	4260.3	4307.7	4407.4	4497.5	4582.9	4578.2	4507.0	4454.8	4416.9	4374.2
17.5°	4160.7	4174.9	4241.3	4393.1	4554.4	4649.3	4677.8	4606.6	4549.7	4488.0	4431.1
20°	4008.9	4008.9	4127.5	4322.0	4544.9	4758.4	4834.3	4777.4	4711.0	4611.4	4535.5
22.5°	3838.1	3847.6	3966.2	4222.3	4540.2	4853.3	5000.4	4938.7	4872.3	4763.2	4649.3
25°	3667.3	3667.3	3800.1	4089.5	4478.5	4919.7	5194.9	5161.7	5028.9	4929.2	4782.2
27.5°	3510.7	3510.7	3653.0	3956.7	4374.2	4938.7	5389.4	5389.4	5242.3	5095.3	4934.0
30°	3325.7	3373.1	3534.4	3852.3	4279.3	4905.5	5531.7	5621.9	5489.0	5299.3	5062.1
32.5°	3169.1	3202.3	3368.4	3705.2	4141.7	4867.6	5693.0	5916.0	5778.4	5517.5	5251.8
35°	2984.1	2979.4	3169.1	3501.2	3947.2	4782.2	5821.1	6267.1	6134.3	5854.3	5493.8
37.5°	2742.2	2742.2	2936.7	3259.3	3762.2	4635.1	5925.5	6656.1	6556.5	6238.6	5854.3
40°	2481.2	2509.7	2680.5	3007.8	3539.2	4459.6	5925.5	6974.0	7026.2	6698.8	6300.3
42.5°	2291.5	2300.9	2457.5	2765.9	3292.5	4231.8	5849.6	7249.1	7405.7	7130.5	6613.4
45°	2092.2	2115.9	2248.8	2533.4	3036.3	3961.4	5716.8	7557.5	7809.0	7619.2	6940.8
47.5°	1850.2	1874.0	2025.8	2315.2	2794.3	3667.3	5493.8	7880.1	8406.7	8269.1	7524.3
50°	1570.3	1589.3	1731.6	2040.0	2523.9	3330.4	5213.9	8122.1	9004.5	9142.1	8406.7
52.5°	1228.7	1243.0	1394.8	1693.7	2201.3	3007.8	4820.1	8269.1	9607.0	10090.9	9588.0
55°	882.4	906.1	1039.0	1285.7	1774.3	2576.1	4350.4	8345.1	10266.5	11215.3	11054.0
57.5°	635.7	645.2	735.4	925.1	1318.9	2068.5	3747.9	8217.0	10859.5	12557.9	12894.7
60°	526.6	526.6	540.8	631.0	901.4	1461.2	3026.8	7742.5	11367.1	13914.8	14953.7
62.5°	483.9	483.9	493.4	507.6	593.0	948.8	2163.4	6779.5	11424.0	15219.4	17212.0
65°	441.2	441.2	450.7	460.2	479.2	616.7	1304.7	4962.4	10309.2	15233.6	18426.5
67.5°	403.3	403.3	408.0	412.7	422.2	450.7	716.4	3007.8	8250.2	14830.4	18891.4
70°	365.3	365.3	365.3	360.6	374.8	379.5	474.4	1527.6	5517.5	13392.9	18668.4
72.5°	*322.6*	*322.6*	*317.9*	*308.4*	*313.1*	*313.1*	*351.1*	*749.6*	*2865.5*	*10646.0*	*16856.2*
75°	275.2	279.9	260.9	251.4	246.7	251.4	279.9	427.0	1280.9	6456.9	12595.9
77.5°	232.5	242.0	213.5	194.5	189.8	189.8	218.2	265.7	550.3	2343.6	5645.6
80°	175.5	180.3	156.6	137.6	137.6	132.8	161.3	194.5	260.9	697.4	1266.7
82.5°	99.6	99.6	90.1	80.7	75.9	80.7	109.1	132.8	161.3	246.7	346.3
85°	23.7	23.7	28.5	33.2	33.2	42.7	61.7	71.2	85.4	99.6	132.8
87.5°	4.7	4.7	4.7	9.5	14.2	14.2	23.7	33.2	42.7	52.2	56.9
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360772
CATALOG NUMBER: GSS-SB4B-735-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	4269.8	4269.8	*4269.8*
2.5°	4279.3	4284.0	*4279.3*
5°	4307.7	4298.2	*4284.0*
7.5°	4312.5	4317.2	*4322.0*
10°	4331.5	4350.4	*4322.0*
12.5°	4350.4	4336.2	*4326.7*
15°	4364.7	4359.9	*4331.5*
17.5°	4416.9	4397.9	*4393.1*
20°	4497.5	4492.8	*4478.5*
22.5°	4592.4	4582.9	*4578.2*
25°	4730.0	4696.8	*4677.8*
27.5°	4843.8	4815.4	*4805.9*
30°	4957.7	4900.8	*4900.8*
32.5°	5057.3	5043.1	*5033.6*
35°	5294.5	5223.4	*5232.9*
37.5°	5583.9	5512.8	*5451.1*
40°	5991.9	5897.0	*5859.1*
42.5°	6252.9	6158.0	*6167.5*
45°	6399.9	6233.9	*6191.2*
47.5°	6798.4	6589.7	*6532.8*
50°	7443.7	7187.5	*7116.3*
52.5°	8487.4	8074.6	*7979.8*
55°	9796.8	9289.2	*9194.3*
57.5°	11590.1	10916.4	*10712.4*
60°	13772.4	12937.4	*12629.1*
62.5°	16396.0	15366.5	*15072.3*
65°	18369.6	17510.9	*17055.4*
67.5°	19949.4	19242.5	*19024.3*
70°	20888.7	20921.9	*20978.9*
72.5°	*19802.3*	*20713.2*	*21149.7*
75°	14512.5	15219.4	*15897.8*
77.5°	5607.7	5057.3	*4896.0*
80°	906.1	849.2	*877.7*
82.5°	408.0	431.7	*455.4*
85°	265.7	308.4	*327.4*
87.5°	61.7	61.7	*61.7*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-5

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-735-U-5WQ

Data in this report applies to families of products including GSS-SB1A-735-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-735-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 3500K CCT 26 LEDS

Spectral Parameters

CCT (K):	3369
CIE u':	0.2386
CIE v':	0.5156
Duv:	0.0013
CIE x:	0.4143
CIE y:	0.3980
CIE z:	0.1877
Peak Wavelength (nm):	590
Dominant Wavelength (nm):	580
Purity:	43.80166
Rf:	71.4
Rg:	96

CRI (Ra):	70.1
R1:	66.6
R2:	77.6
R3:	88.5
R4:	69.5
R5:	66.4
R6:	69.6
R7:	77.5
R8:	44.9
R9:	-40.2
R10:	49.1
R11:	66.3
R12:	45.7
R13:	68.0
R14:	93.4
R15:	57.6

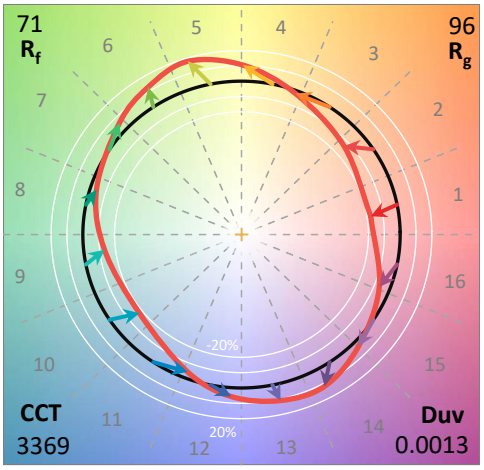

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-5

CIE 1931 Chromaticity Diagram

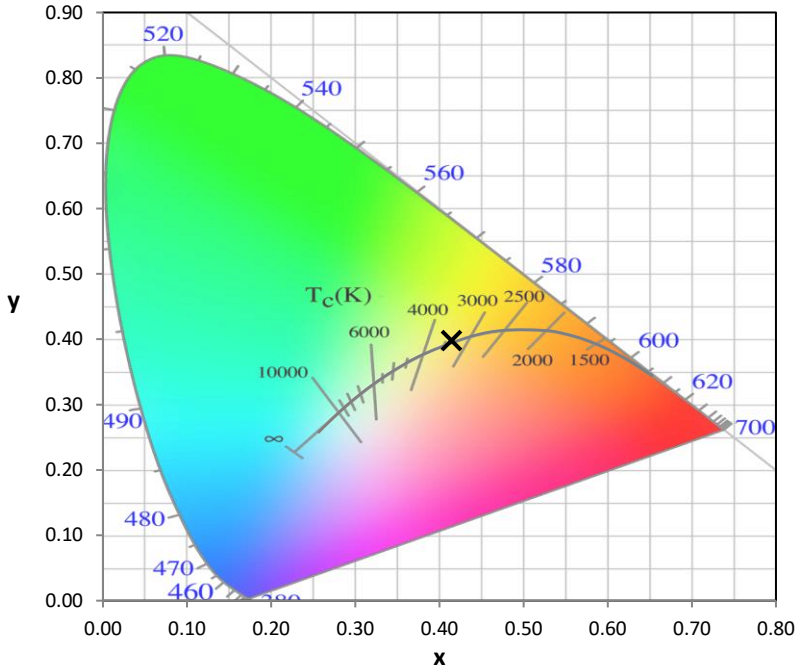

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

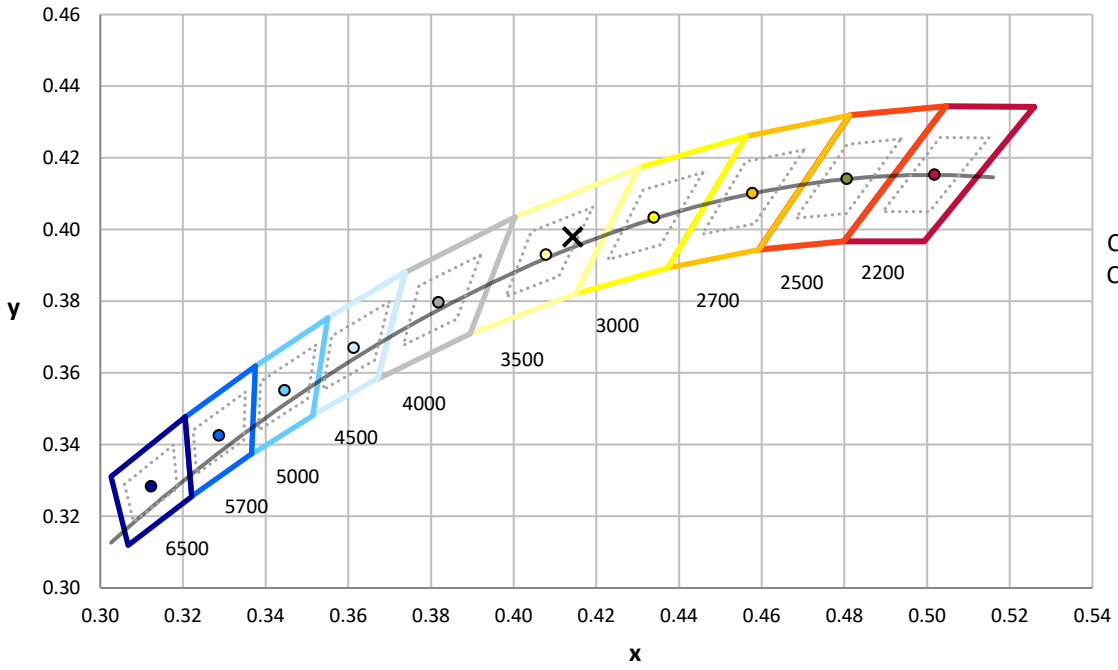


CCT = 3369K
CIE x = 0.4143
CIE y = 0.3980
Duv = 0.0013

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-5

Photopic Flux vs. Wavelength

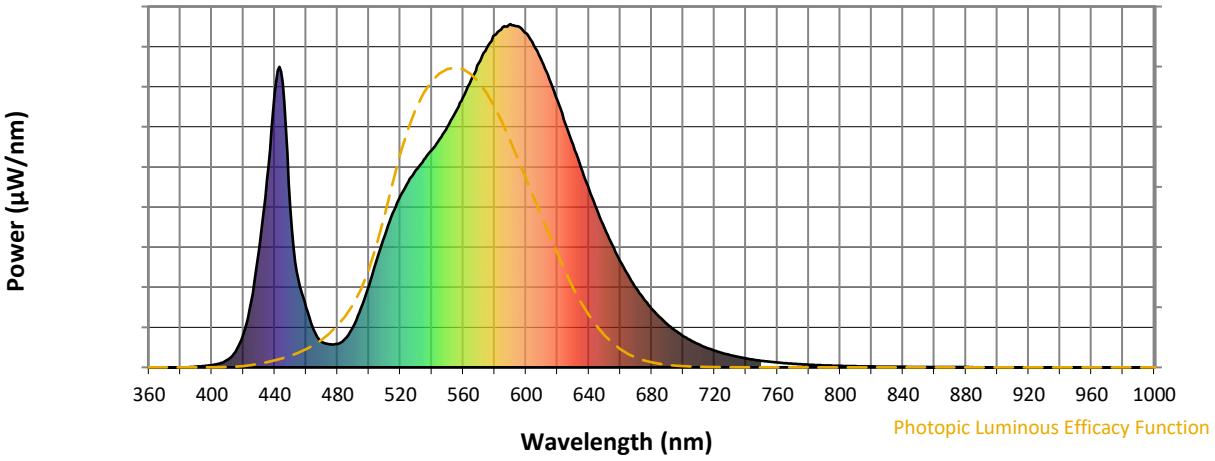


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Scotopic Flux vs. Wavelength

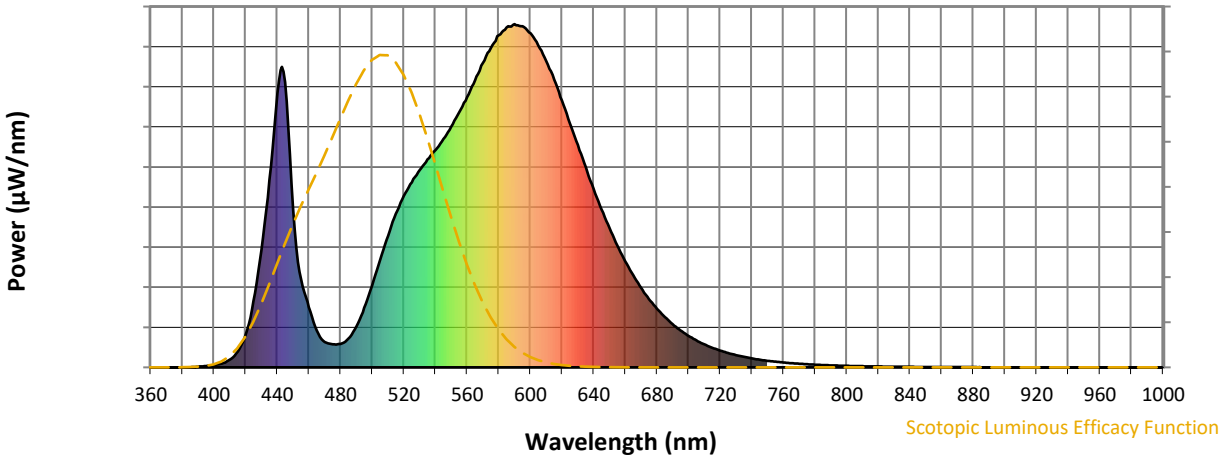


Scotopic Lumens: NR **S/P: 1.29**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Melanopic Flux vs. Wavelength

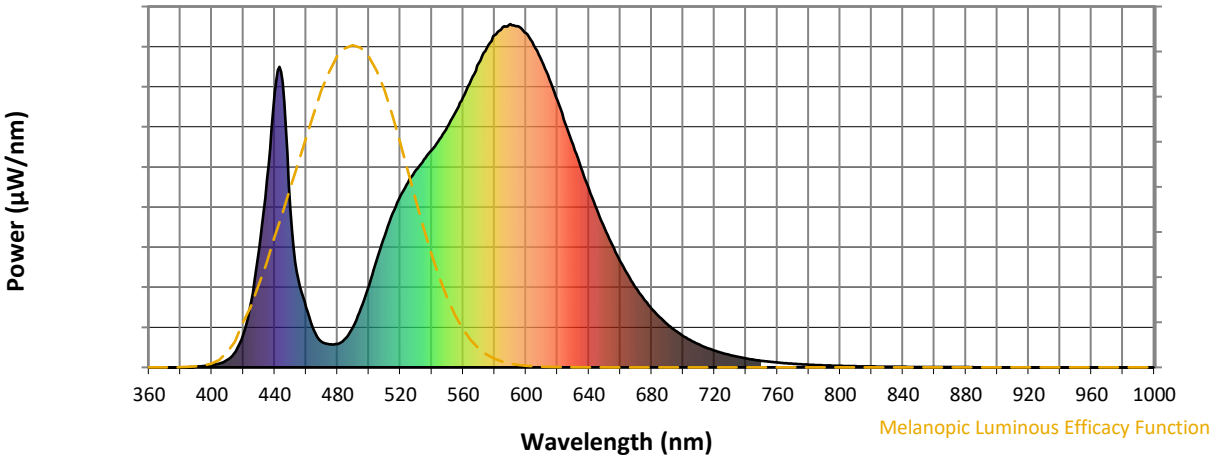

Melanopic Lumens: NR **M/P: 2.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			


REPORT NUMBER: SP1-2407-184-5

TM-30-18


Summary


R_f = 71.4
R_g = 96
CIE R_a = 70.1
R_9 = -40.2


Spectral Power Distribution Comparison

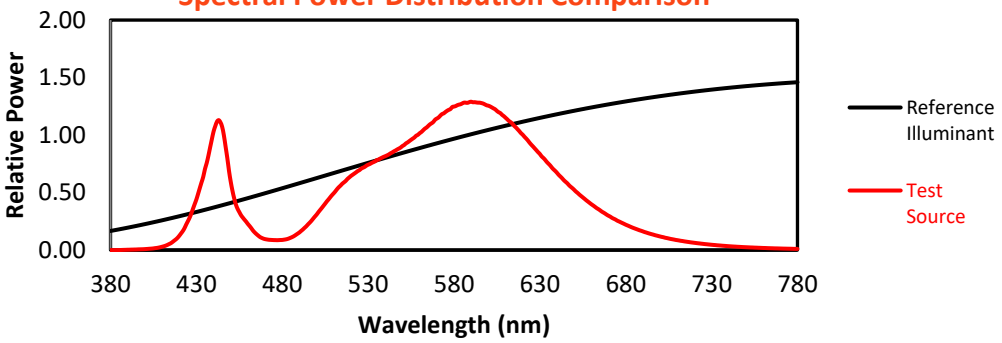


Color Vector Graphics

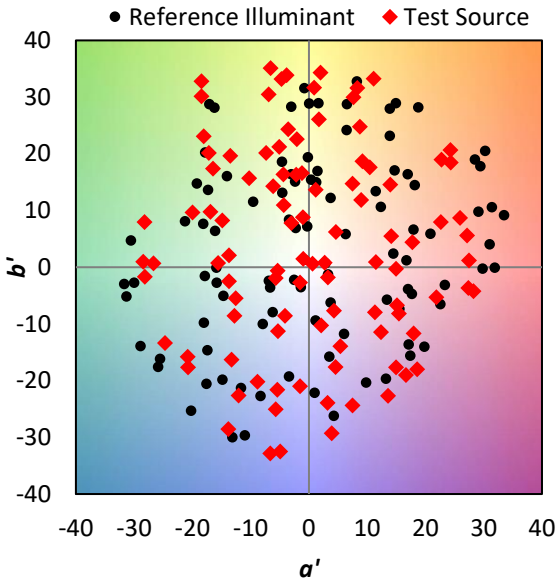

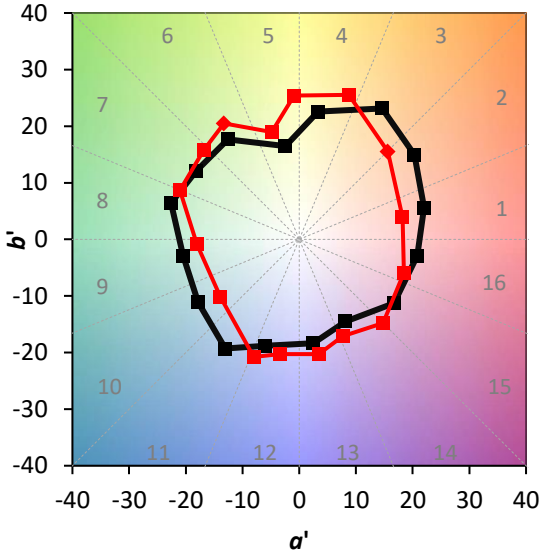

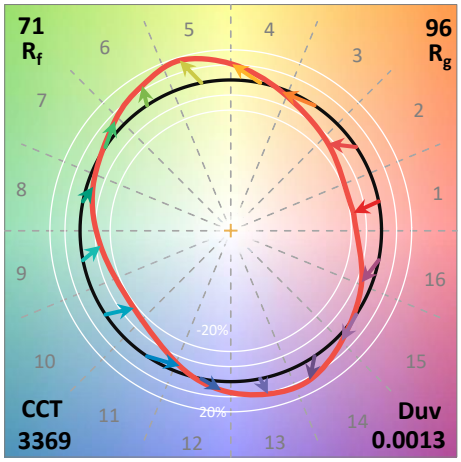

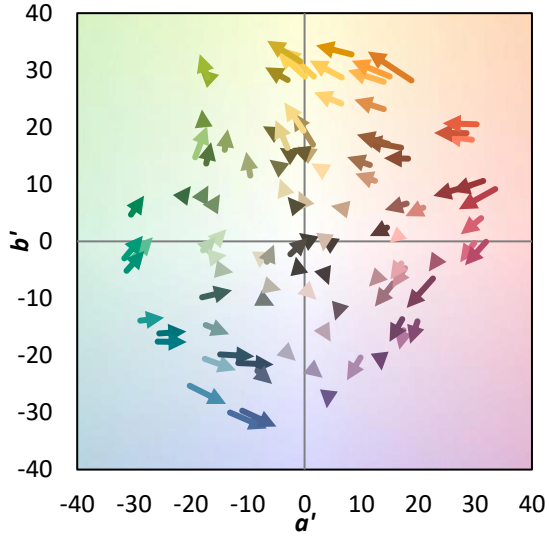


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 57	CES51 = 84	CES76 = 50
CES02 = 62	CES27 = 80	CES52 = 86	CES77 = 74
CES03 = 31	CES28 = 81	CES53 = 72	CES78 = 54
CES04 = 70	CES29 = 50	CES54 = 79	CES79 = 81
CES05 = 48	CES30 = 55	CES55 = 78	CES80 = 79
CES06 = 51	CES31 = 56	CES56 = 67	CES81 = 74
CES07 = 40	CES32 = 54	CES57 = 65	CES82 = 91
CES08 = 39	CES33 = 60	CES58 = 68	CES83 = 86
CES09 = 29	CES34 = 69	CES59 = 85	CES84 = 89
CES10 = 75	CES35 = 83	CES60 = 91	CES85 = 83
CES11 = 58	CES36 = 88	CES61 = 85	CES86 = 66
CES12 = 64	CES37 = 78	CES62 = 78	CES87 = 77
CES13 = 43	CES38 = 64	CES63 = 71	CES88 = 75
CES14 = 74	CES39 = 92	CES64 = 70	CES89 = 68
CES15 = 71	CES40 = 86	CES65 = 64	CES90 = 72
CES16 = 47	CES41 = 81	CES66 = 65	CES91 = 95
CES17 = 50	CES42 = 79	CES67 = 63	CES92 = 62
CES18 = 56	CES43 = 71	CES68 = 69	CES93 = 78
CES19 = 72	CES44 = 98	CES69 = 80	CES94 = 51
CES20 = 65	CES45 = 80	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 75	CES71 = 58	CES96 = 76
CES22 = 79	CES47 = 71	CES72 = 85	CES97 = 82
CES23 = 92	CES48 = 61	CES73 = 51	CES98 = 72
CES24 = 91	CES49 = 74	CES74 = 94	CES99 = 60
CES25 = 72	CES50 = 83	CES75 = 57	

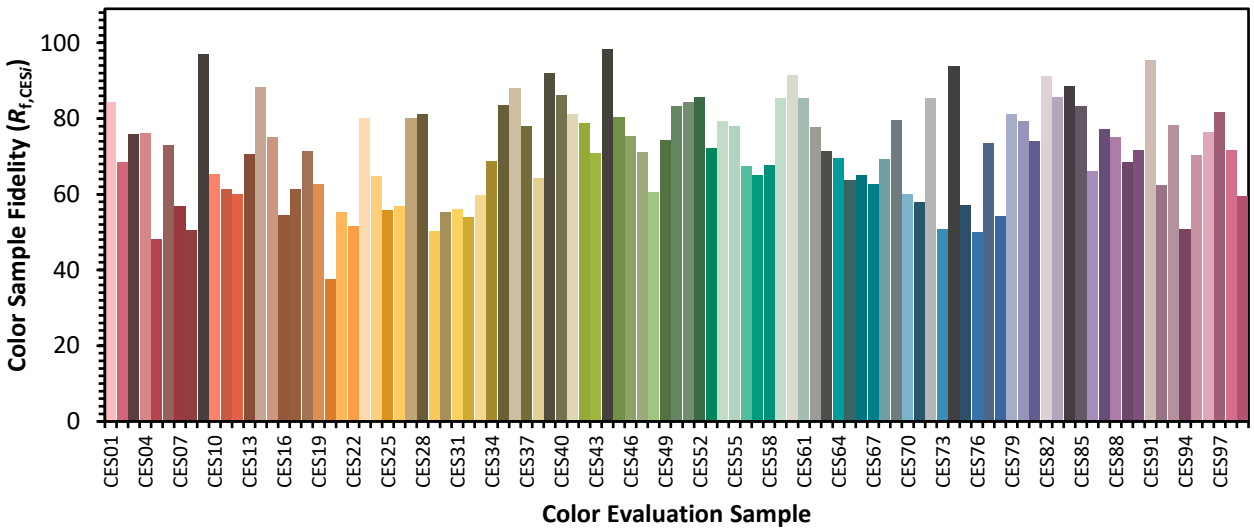



REPORT NUMBER: SP1-2407-184-5

TM-30-18

Color Rendition by Hue-Angle Bin

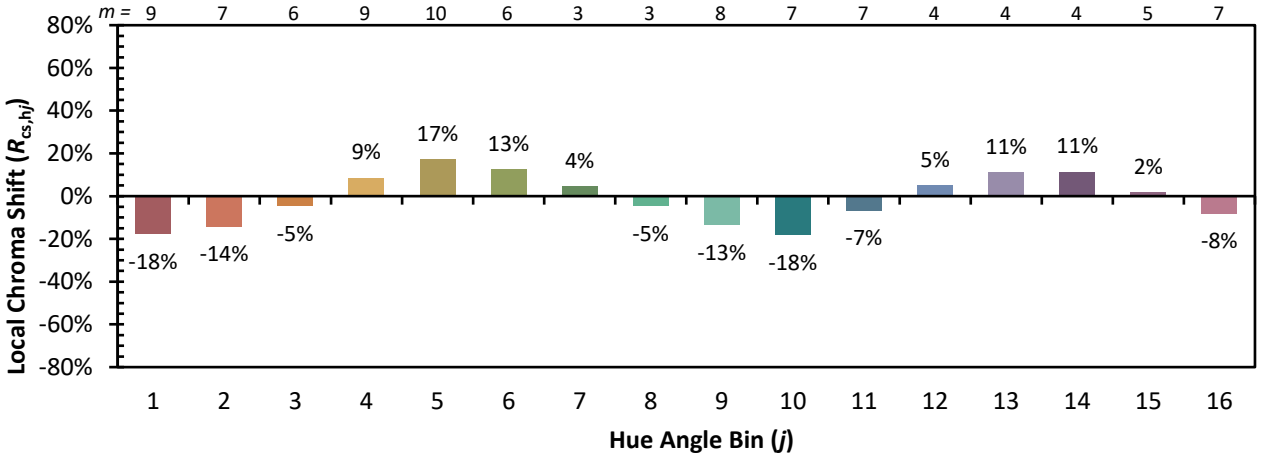

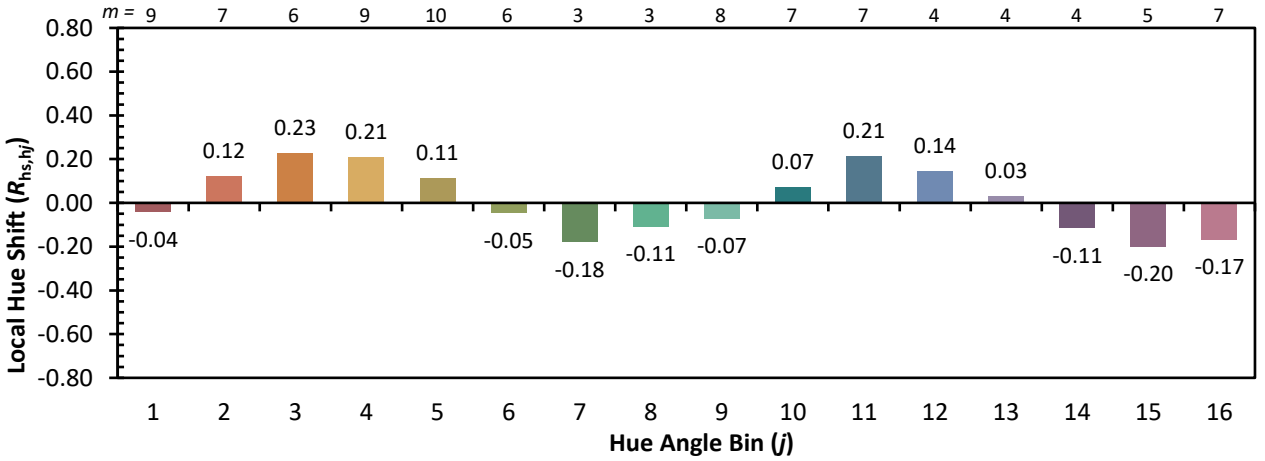


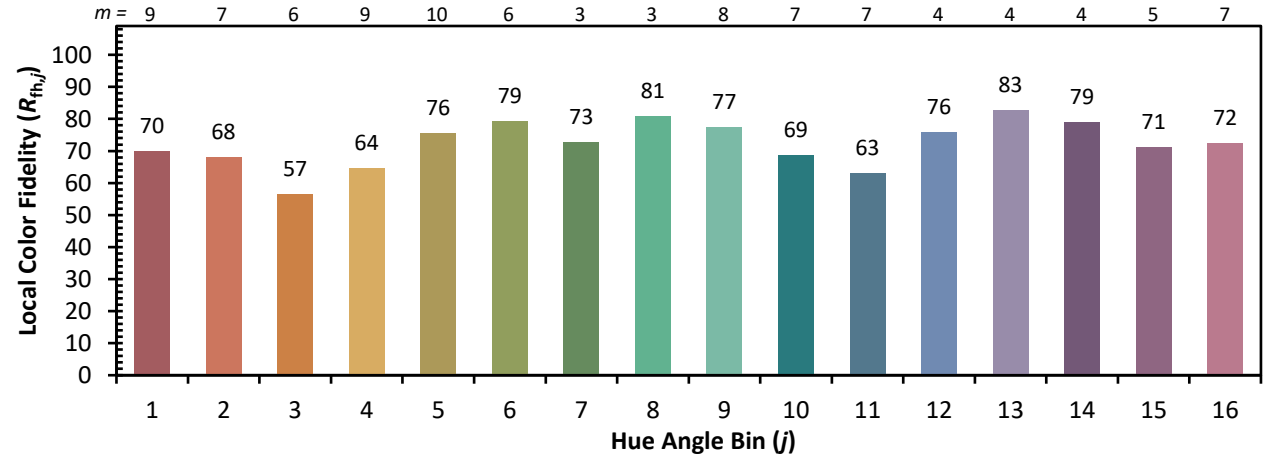


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Measure Comparisons

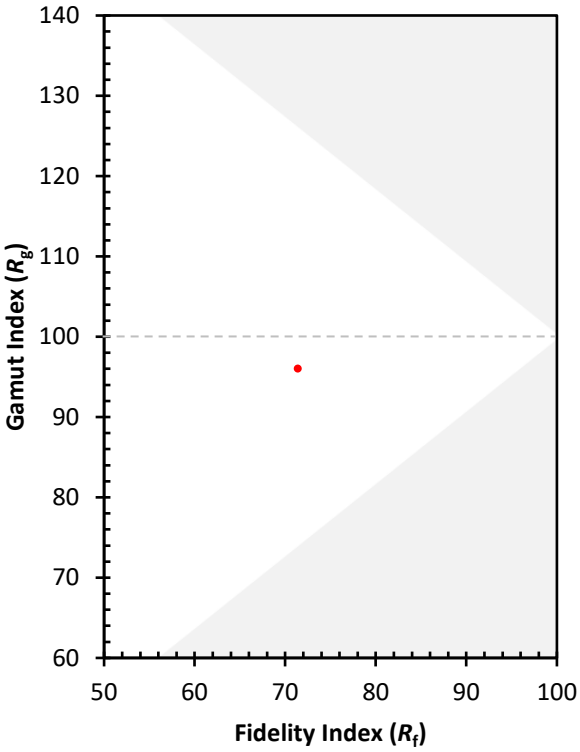

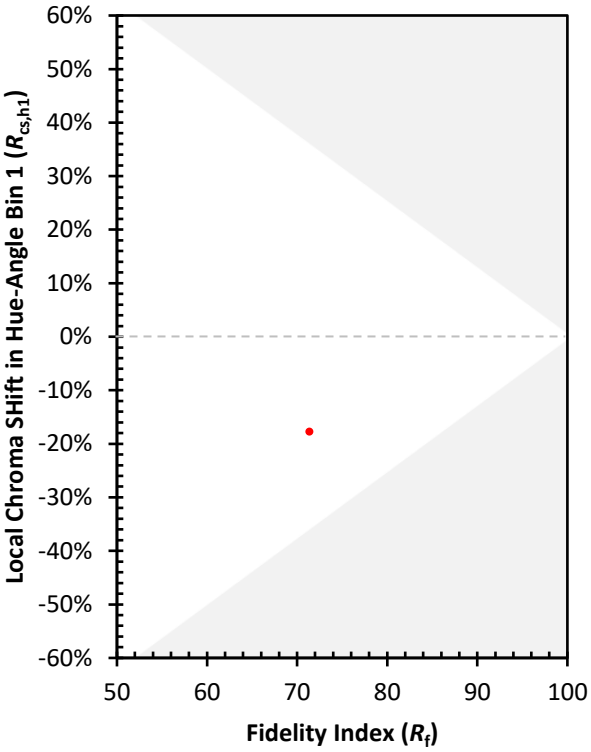

(END OF REPORT)