Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360776

Luminaire Tested: **GSS-SB5B-735-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360776
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB5B-735-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 5SQUARE 184W 70CRI 3500K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(130) 3500K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	27073.6 lumens
Efficiency:	N/A
Efficacy:	147.1 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 1' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B4 - U0 - G4


Input Watts (W):	184
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	11.1%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360776
CATALOG NUMBER: GSS-SB5B-735-U-T1

Iso-Footcandle Lines of Horizontal Illumination

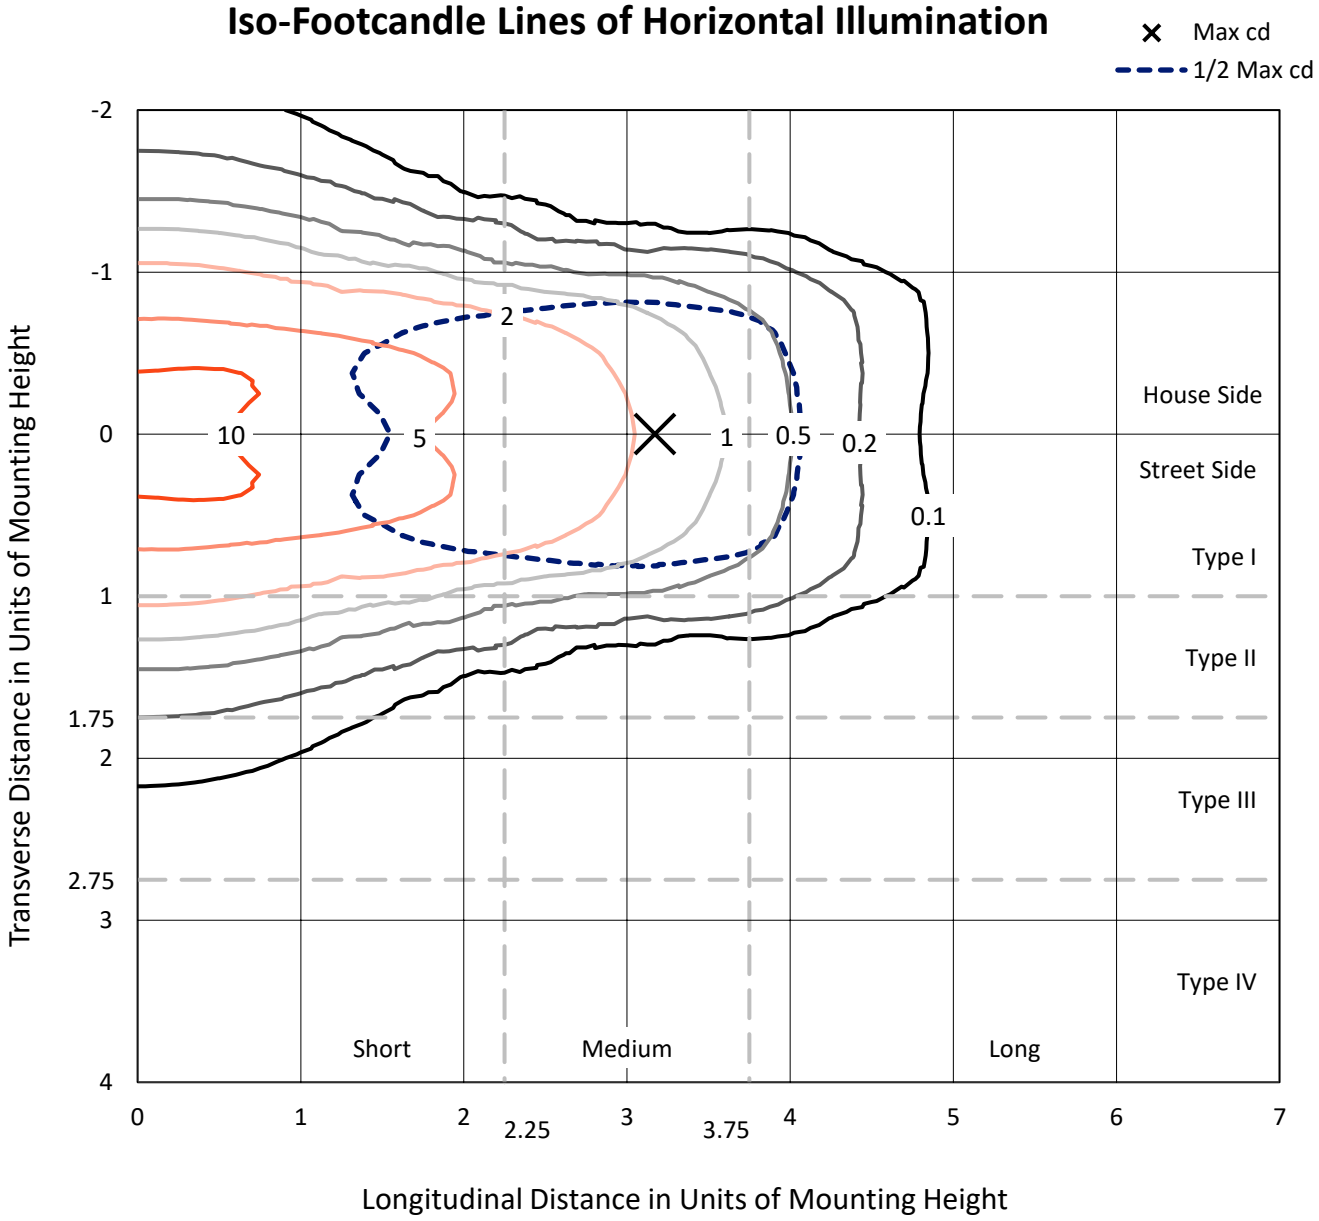


Based on 20 foot mounting height. Maximum calculated value = 13.3 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360776
CATALOG NUMBER: GSS-SB5B-735-U-T1

Luminous Intensity Polar Plot

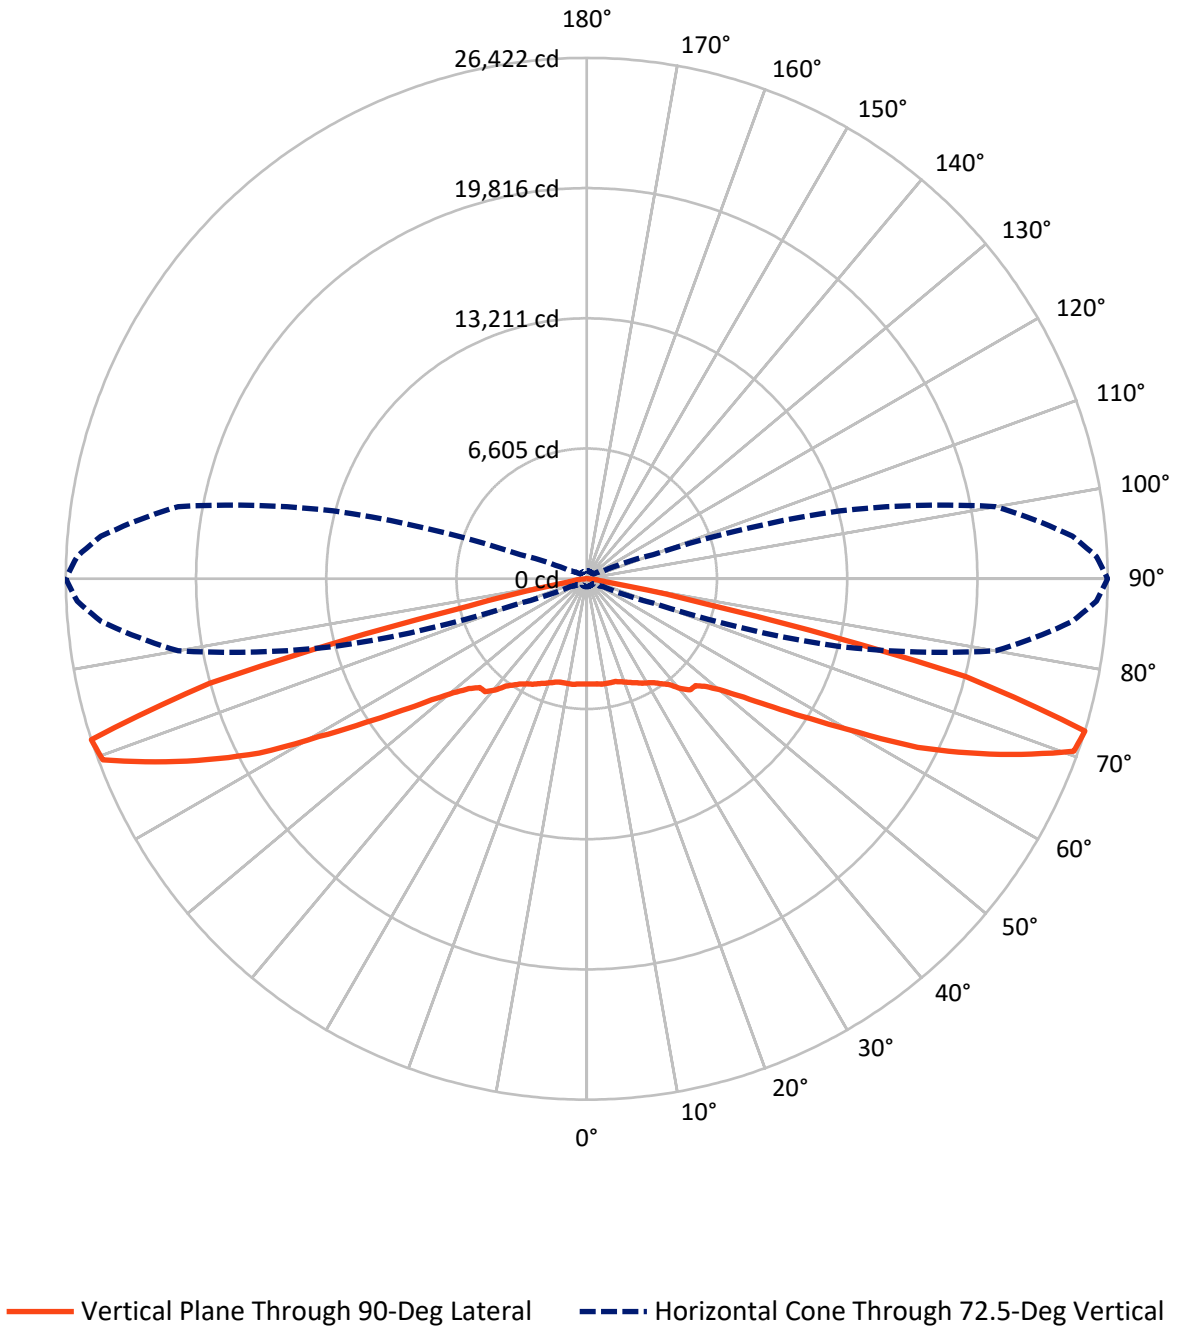

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360776
CATALOG NUMBER: GSS-SB5B-735-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	13536.8	0.0	13536.8
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	13536.8	0.0	13536.8
	% Fixture	50.0	0.0	50.0
Total	Lumens	27073.6	0.0	27073.6
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	516.3	1.9
10°-20°	1573.6	5.8
20°-30°	2630.2	9.7
30°-40°	3627.2	13.4
40°-50°	4446.5	16.4
50°-60°	5210.6	19.2
60°-70°	5786.3	21.4
70°-80°	3146.6	11.6
80°-90°	136.4	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	27073.6	100.0
0°-180°	27073.6	100.0

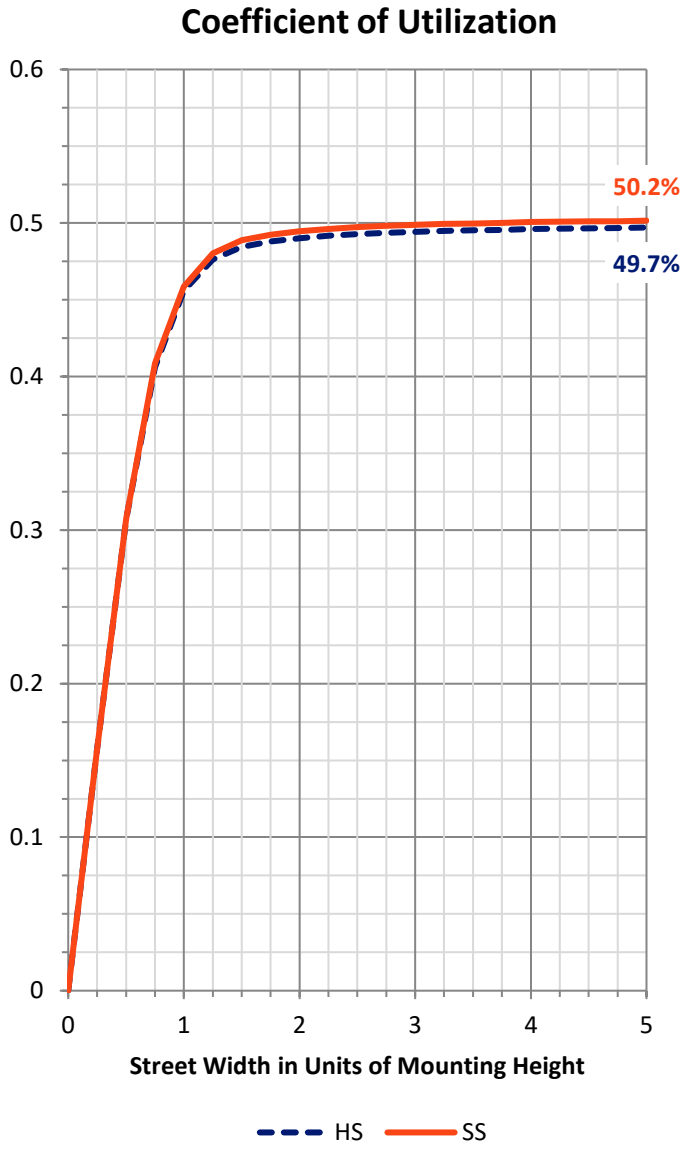

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360776
CATALOG NUMBER: GSS-SB5B-735-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	2360.1	8.7			
FM	(30°-60°)	6642.1	24.5			
FH	(60°-80°)	4466.5	16.5			G2/5000
FVH	(80°-90°)	68.2	0.3			G1/100
BL	(0°-30°)	2360.1	8.7	B3/2500		
BM	(30°-60°)	6642.1	24.5	B4/8500		
BH	(60°-80°)	4466.5	16.5	B4/5000		G4/5000
BVH	(80°-90°)	68.2	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B4-U0-G4
Type I Short

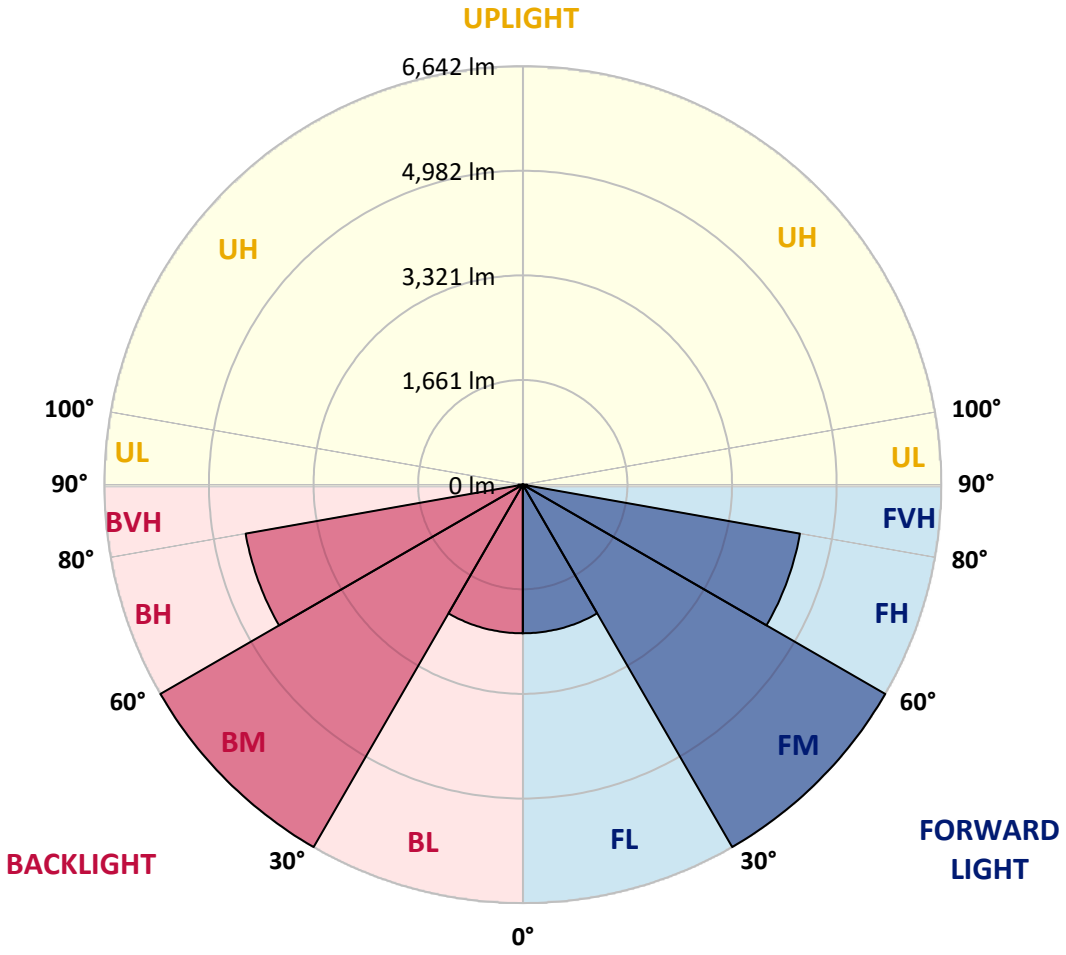

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360776
CATALOG NUMBER: GSS-SB5B-735-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	5334.2	5334.2	5334.2	5334.2	5334.2	5334.2	5334.2	5334.2	5334.2	5334.2	5334.2
2.5°	5340.1	5340.1	5322.3	5346.0	5334.2	5340.1	5346.0	5340.1	5334.2	5340.1	5346.0
5°	5369.7	5357.9	5369.7	5381.6	5363.8	5375.7	5369.7	5340.1	5357.9	5357.9	5357.9
7.5°	5423.1	5434.9	5423.1	5452.7	5434.9	5470.5	5434.9	5411.2	5405.3	5399.4	5399.4
10°	5446.8	5446.8	5440.9	5494.2	5506.0	5541.6	5517.9	5482.3	5464.6	5440.9	5417.1
12.5°	5381.6	5393.4	5423.1	5523.8	5571.2	5642.4	5624.6	5553.5	5500.1	5482.3	5446.8
15°	5310.5	5322.3	5381.6	5506.0	5618.7	5725.3	5719.4	5630.5	5565.3	5517.9	5464.6
17.5°	5197.9	5215.6	5298.6	5488.3	5689.8	5808.3	5843.9	5755.0	5683.9	5606.8	5535.7
20°	5008.2	5008.2	5156.4	5399.4	5677.9	5944.6	6039.5	5968.3	5885.4	5760.9	5666.1
22.5°	4794.8	4806.7	4954.9	5274.9	5672.0	6063.2	6246.9	6169.9	6086.9	5950.6	5808.3
25°	4581.5	4581.5	4747.4	5108.9	5595.0	6146.1	6489.9	6448.4	6282.5	6158.0	5974.3
27.5°	4385.9	4385.9	4563.7	4943.0	5464.6	6169.9	6732.9	6732.9	6549.2	6365.4	6163.9
30°	4154.7	4214.0	4415.5	4812.6	5346.0	6128.4	6910.7	7023.3	6857.4	6620.3	6324.0
32.5°	3959.1	4000.6	4208.1	4628.9	5174.1	6081.0	7112.2	7390.8	7218.9	6892.9	6561.0
35°	3728.0	3722.1	3959.1	4374.0	4931.1	5974.3	7272.3	7829.4	7663.4	7313.7	6863.3
37.5°	3425.7	3425.7	3668.7	4071.7	4700.0	5790.5	7402.6	8315.4	8190.9	7793.8	7313.7
40°	3099.7	3135.3	3348.7	3757.6	4421.4	5571.2	7402.6	8712.5	8777.7	8368.7	7870.9
42.5°	2862.7	2874.5	3070.1	3455.4	4113.2	5286.8	7307.8	9056.2	9251.8	8908.1	8262.0
45°	2613.7	2643.4	2809.3	3164.9	3793.2	4948.9	7141.9	9441.5	9755.6	9518.5	8671.0
47.5°	2311.5	2341.1	2530.8	2892.3	3490.9	4581.5	6863.3	9844.5	10502.4	10330.5	9400.0
50°	1961.8	1985.5	2163.3	2548.5	3153.1	4160.7	6513.6	10146.8	11249.2	11421.1	10502.4
52.5°	1535.1	1552.8	1742.5	2115.9	2750.1	3757.6	6021.7	10330.5	12001.9	12606.4	11978.2
55°	1102.4	1132.0	1298.0	1606.2	2216.6	3218.3	5434.9	10425.3	12825.7	14011.1	13809.6
57.5°	794.2	806.1	918.7	1155.7	1647.7	2584.1	4682.2	10265.3	13566.6	15688.4	16109.2
60°	657.9	657.9	675.7	788.3	1126.1	1825.5	3781.3	9672.6	14200.7	17383.5	18681.4
62.5°	604.5	604.5	616.4	634.2	740.9	1185.4	2702.6	8469.5	14271.9	19013.4	21502.6
65°	551.2	551.2	563.1	574.9	598.6	770.5	1629.9	6199.5	12879.1	19031.1	23019.9
67.5°	503.8	503.8	509.7	515.6	527.5	563.1	895.0	3757.6	10306.8	18527.3	23600.7
70°	456.4	456.4	456.4	450.4	468.2	474.1	592.7	1908.4	6892.9	16731.5	23322.2
72.5°	*403.0*	*403.0*	*397.1*	*385.2*	*391.2*	*391.2*	*438.6*	*936.4*	*3579.8*	*13299.9*	*21058.1*
75°	343.8	349.7	326.0	314.1	308.2	314.1	349.7	533.4	1600.3	8066.4	15735.8
77.5°	290.4	302.3	266.7	243.0	237.1	237.1	272.6	331.9	687.5	2927.9	7053.0
80°	219.3	225.2	195.6	171.9	171.9	166.0	201.5	243.0	326.0	871.2	1582.5
82.5°	124.5	124.5	112.6	100.8	94.8	100.8	136.3	166.0	201.5	308.2	432.7
85°	29.6	29.6	35.6	41.5	41.5	53.3	77.0	88.9	106.7	124.5	166.0
87.5°	5.9	5.9	5.9	11.9	17.8	17.8	29.6	41.5	53.3	65.2	71.1
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360776
CATALOG NUMBER: GSS-SB5B-735-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	5334.2	5334.2	*5334.2*
2.5°	5346.0	5352.0	*5346.0*
5°	5381.6	5369.7	*5352.0*
7.5°	5387.5	5393.4	*5399.4*
10°	5411.2	5434.9	*5399.4*
12.5°	5434.9	5417.1	*5405.3*
15°	5452.7	5446.8	*5411.2*
17.5°	5517.9	5494.2	*5488.3*
20°	5618.7	5612.7	*5595.0*
22.5°	5737.2	5725.3	*5719.4*
25°	5909.1	5867.6	*5843.9*
27.5°	6051.3	6015.8	*6003.9*
30°	6193.6	6122.4	*6122.4*
32.5°	6318.0	6300.2	*6288.4*
35°	6614.4	6525.5	*6537.3*
37.5°	6975.9	6887.0	*6810.0*
40°	7485.6	7367.1	*7319.7*
42.5°	7811.6	7693.1	*7704.9*
45°	7995.3	7787.9	*7734.5*
47.5°	8493.2	8232.4	*8161.3*
50°	9299.2	8979.2	*8890.3*
52.5°	10603.1	10087.5	*9969.0*
55°	12239.0	11604.8	*11486.2*
57.5°	14479.3	13637.7	*13382.8*
60°	17205.7	16162.5	*15777.3*
62.5°	20483.2	19197.1	*18829.6*
65°	22948.8	21876.0	*21307.0*
67.5°	24922.4	24039.3	*23766.7*
70°	26095.9	26137.4	*26208.6*
72.5°	*24738.7*	*25876.6*	*26421.9*
75°	18130.3	19013.4	*19860.9*
77.5°	7005.5	6318.0	*6116.5*
80°	1132.0	1060.9	*1096.5*
82.5°	509.7	539.3	*569.0*
85°	331.9	385.2	*409.0*
87.5°	77.0	77.0	*77.0*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-5

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-735-U-5WQ

Data in this report applies to families of products including GSS-SB1A-735-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-735-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 3500K CCT 26 LEDS

Spectral Parameters

CCT (K):	3369
CIE u':	0.2386
CIE v':	0.5156
Duv:	0.0013
CIE x:	0.4143
CIE y:	0.3980
CIE z:	0.1877
Peak Wavelength (nm):	590
Dominant Wavelength (nm):	580
Purity:	43.80166
Rf:	71.4
Rg:	96

CRI (Ra):	70.1
R1:	66.6
R2:	77.6
R3:	88.5
R4:	69.5
R5:	66.4
R6:	69.6
R7:	77.5
R8:	44.9
R9:	-40.2
R10:	49.1
R11:	66.3
R12:	45.7
R13:	68.0
R14:	93.4
R15:	57.6

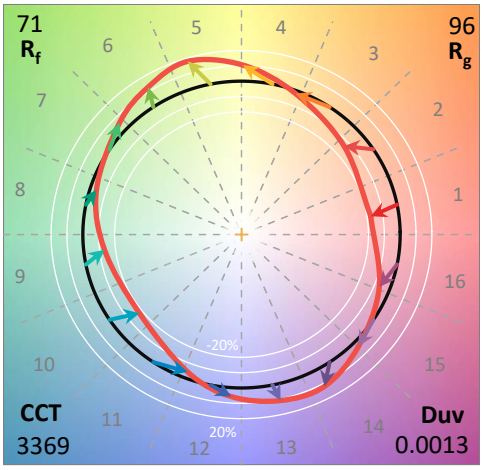

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-5

CIE 1931 Chromaticity Diagram

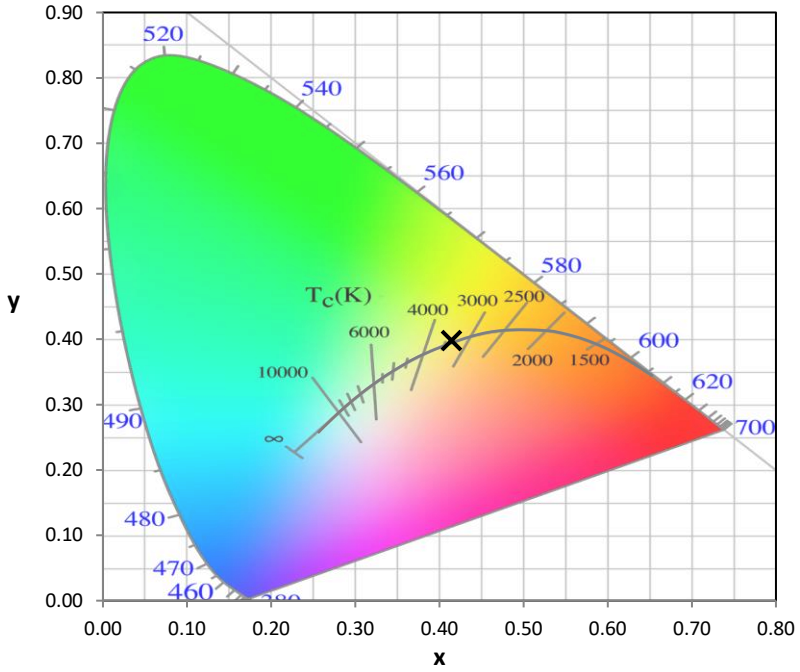

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

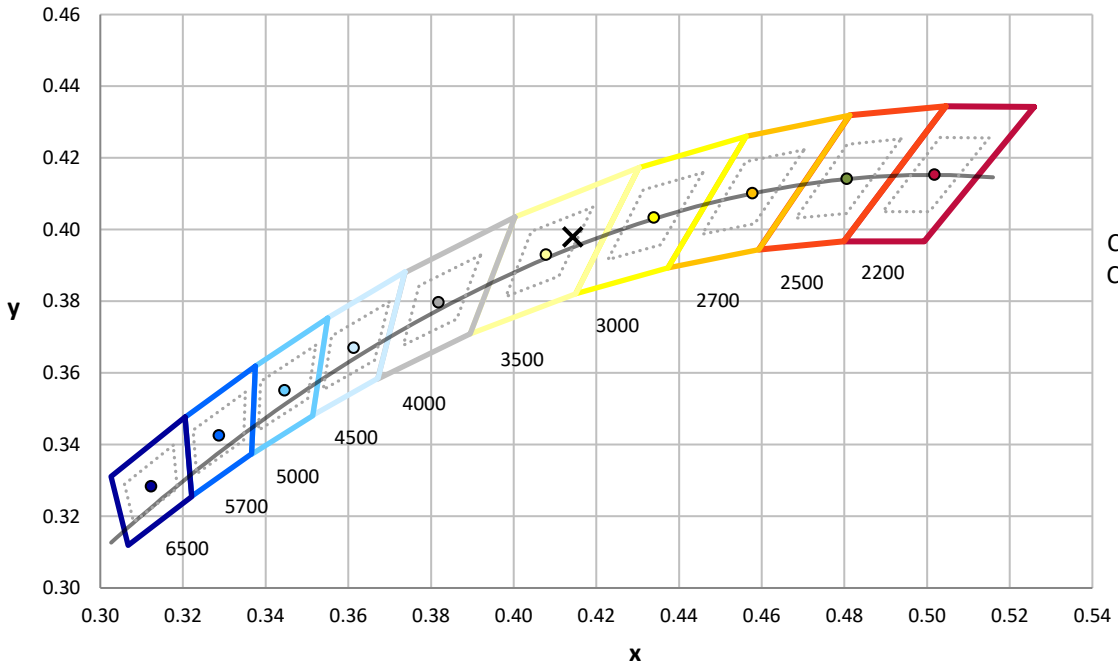


CCT = 3369K
CIE x = 0.4143
CIE y = 0.3980
Duv = 0.0013

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-5

Photopic Flux vs. Wavelength

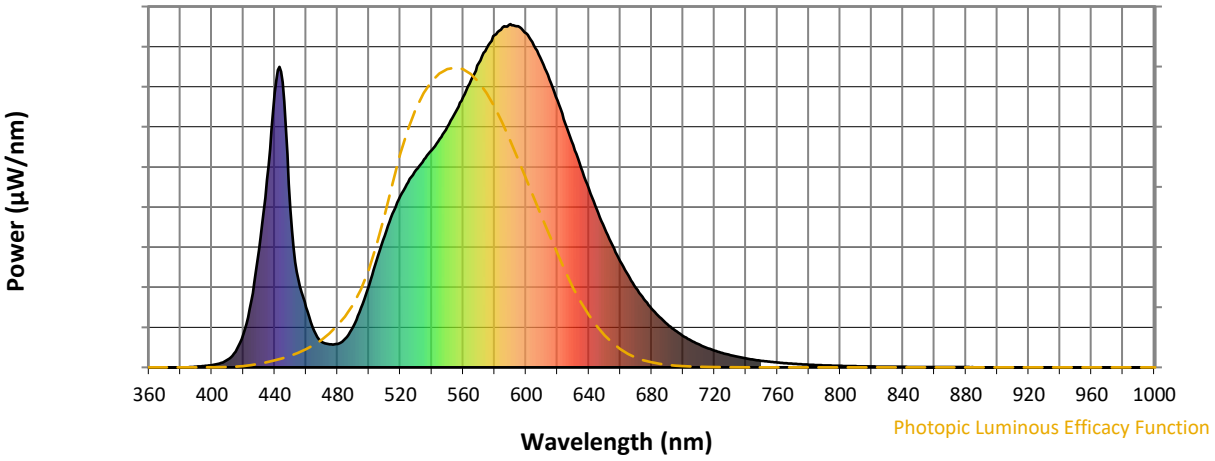


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Scotopic Flux vs. Wavelength

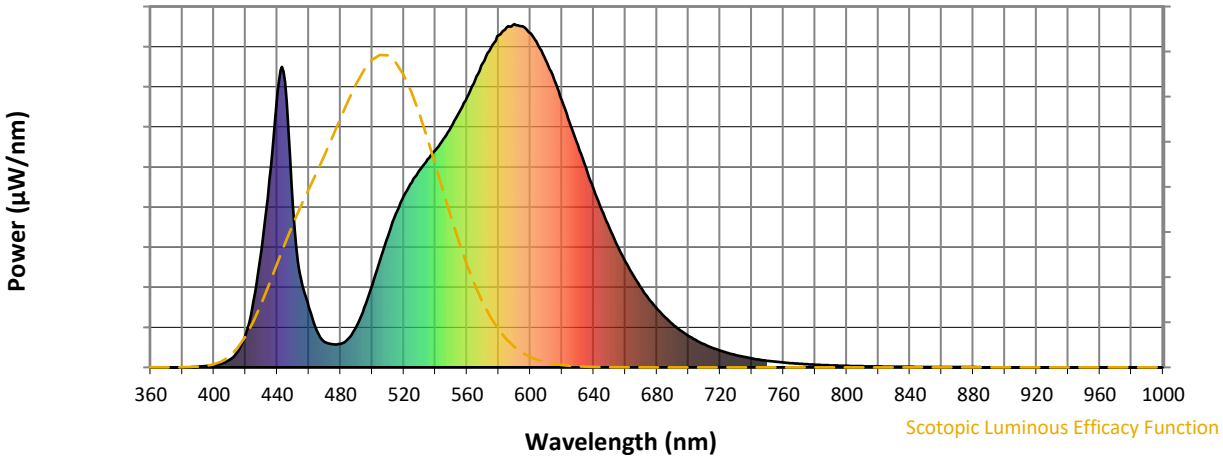


Scotopic Lumens: NR **S/P: 1.29**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Melanopic Flux vs. Wavelength

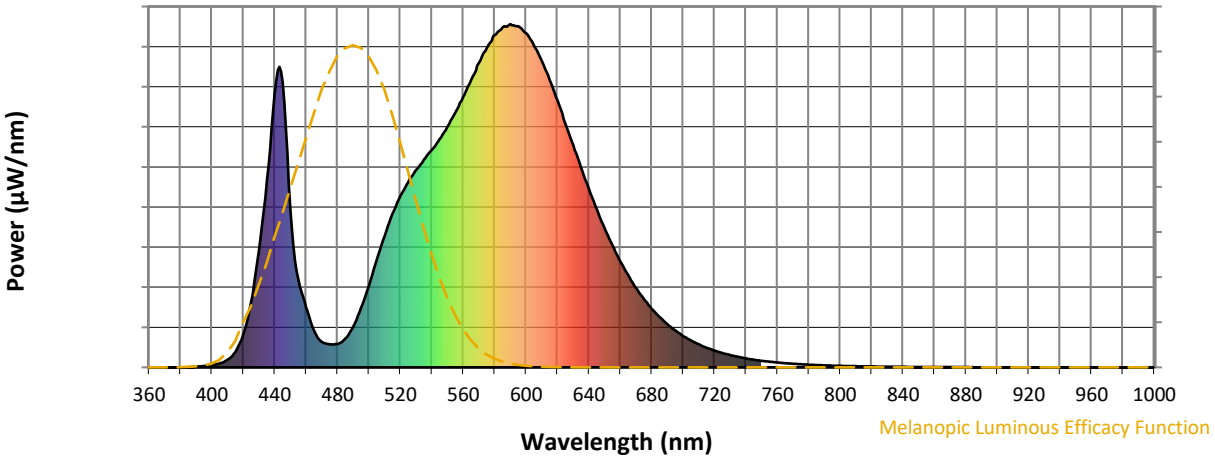

Melanopic Lumens: NR **M/P: 2.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			


REPORT NUMBER: SP1-2407-184-5

TM-30-18


Summary


R_f = 71.4
R_g = 96
CIE R_a = 70.1
R_9 = -40.2


Spectral Power Distribution Comparison

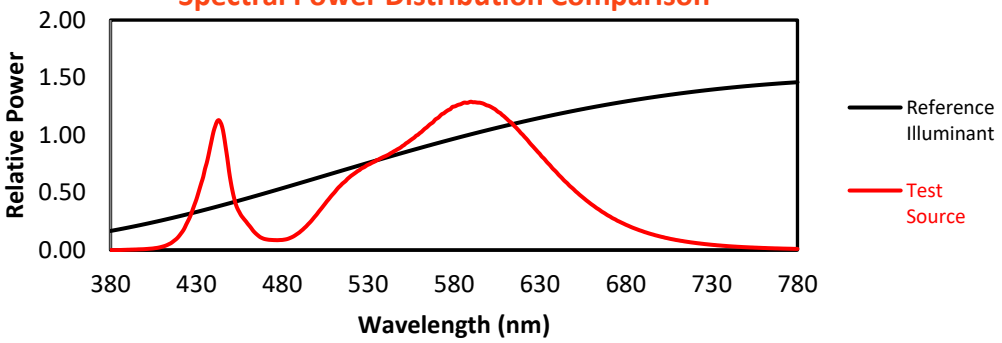


Color Vector Graphics

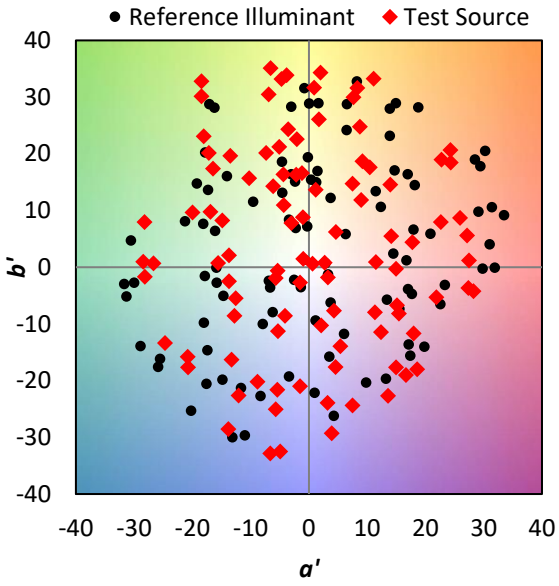

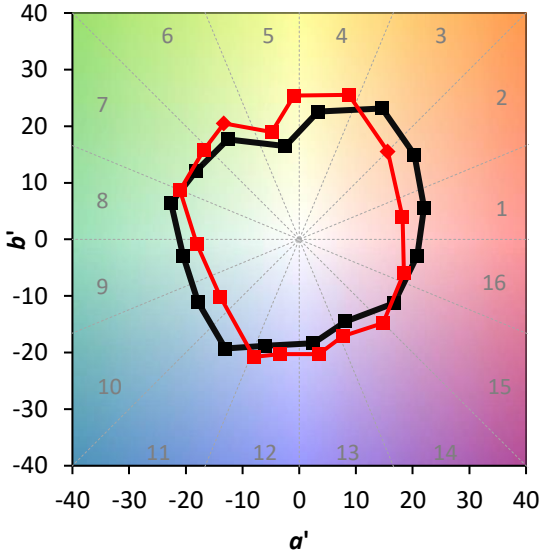

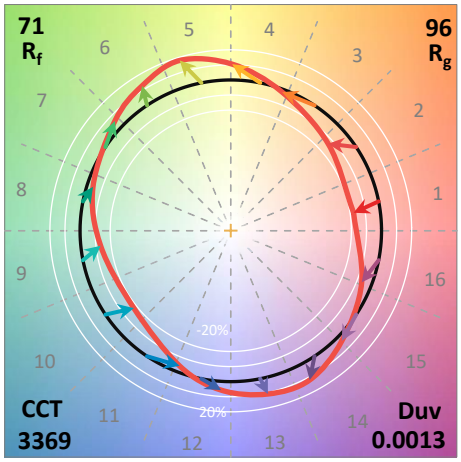

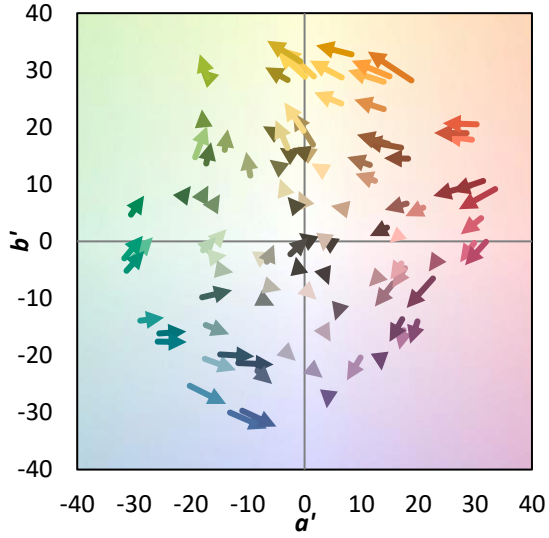


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 57	CES51 = 84	CES76 = 50
CES02 = 62	CES27 = 80	CES52 = 86	CES77 = 74
CES03 = 31	CES28 = 81	CES53 = 72	CES78 = 54
CES04 = 70	CES29 = 50	CES54 = 79	CES79 = 81
CES05 = 48	CES30 = 55	CES55 = 78	CES80 = 79
CES06 = 51	CES31 = 56	CES56 = 67	CES81 = 74
CES07 = 40	CES32 = 54	CES57 = 65	CES82 = 91
CES08 = 39	CES33 = 60	CES58 = 68	CES83 = 86
CES09 = 29	CES34 = 69	CES59 = 85	CES84 = 89
CES10 = 75	CES35 = 83	CES60 = 91	CES85 = 83
CES11 = 58	CES36 = 88	CES61 = 85	CES86 = 66
CES12 = 64	CES37 = 78	CES62 = 78	CES87 = 77
CES13 = 43	CES38 = 64	CES63 = 71	CES88 = 75
CES14 = 74	CES39 = 92	CES64 = 70	CES89 = 68
CES15 = 71	CES40 = 86	CES65 = 64	CES90 = 72
CES16 = 47	CES41 = 81	CES66 = 65	CES91 = 95
CES17 = 50	CES42 = 79	CES67 = 63	CES92 = 62
CES18 = 56	CES43 = 71	CES68 = 69	CES93 = 78
CES19 = 72	CES44 = 98	CES69 = 80	CES94 = 51
CES20 = 65	CES45 = 80	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 75	CES71 = 58	CES96 = 76
CES22 = 79	CES47 = 71	CES72 = 85	CES97 = 82
CES23 = 92	CES48 = 61	CES73 = 51	CES98 = 72
CES24 = 91	CES49 = 74	CES74 = 94	CES99 = 60
CES25 = 72	CES50 = 83	CES75 = 57	

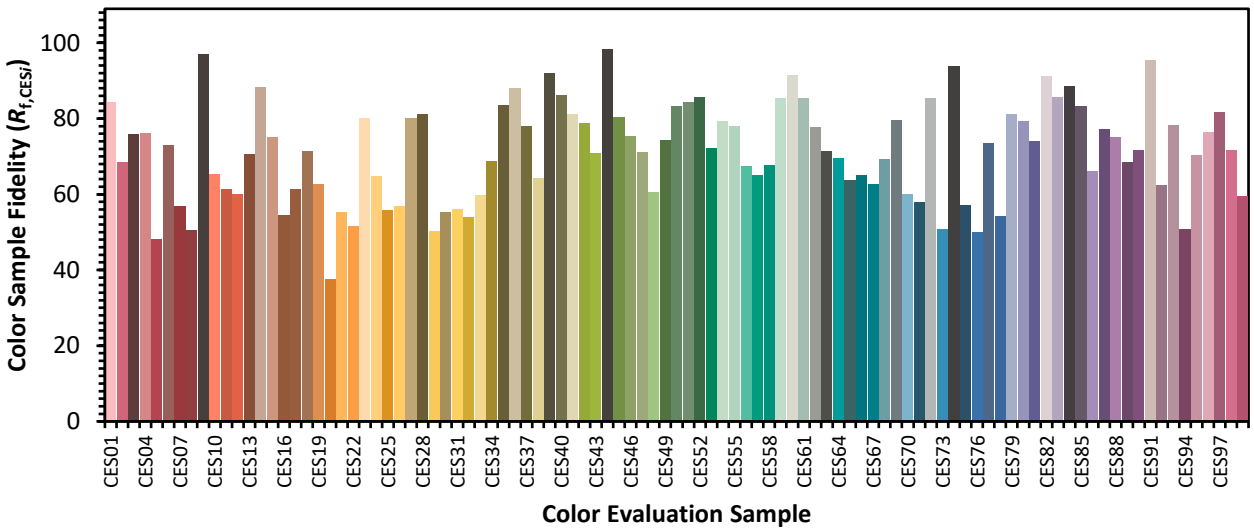



REPORT NUMBER: SP1-2407-184-5

TM-30-18

Color Rendition by Hue-Angle Bin

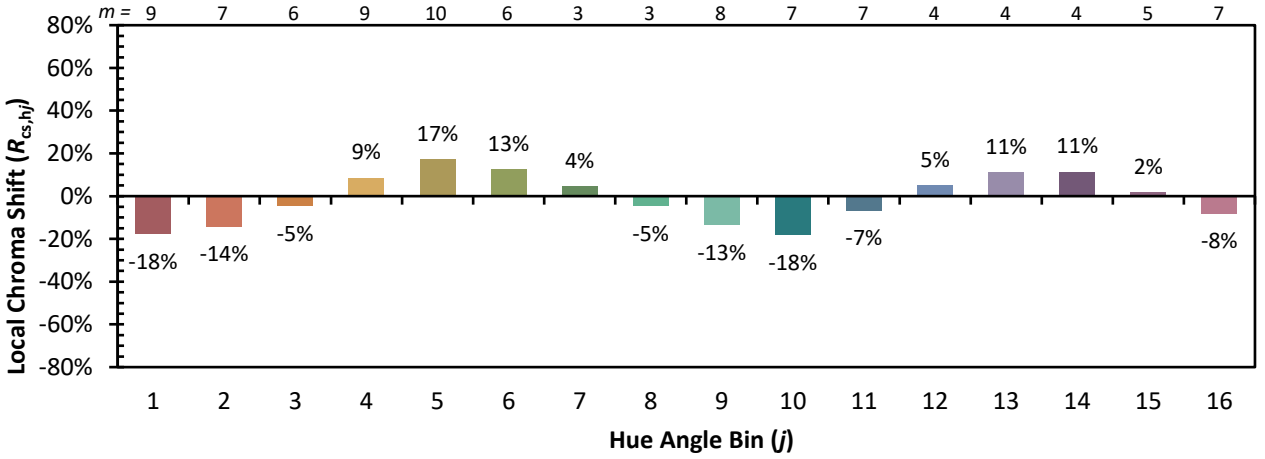

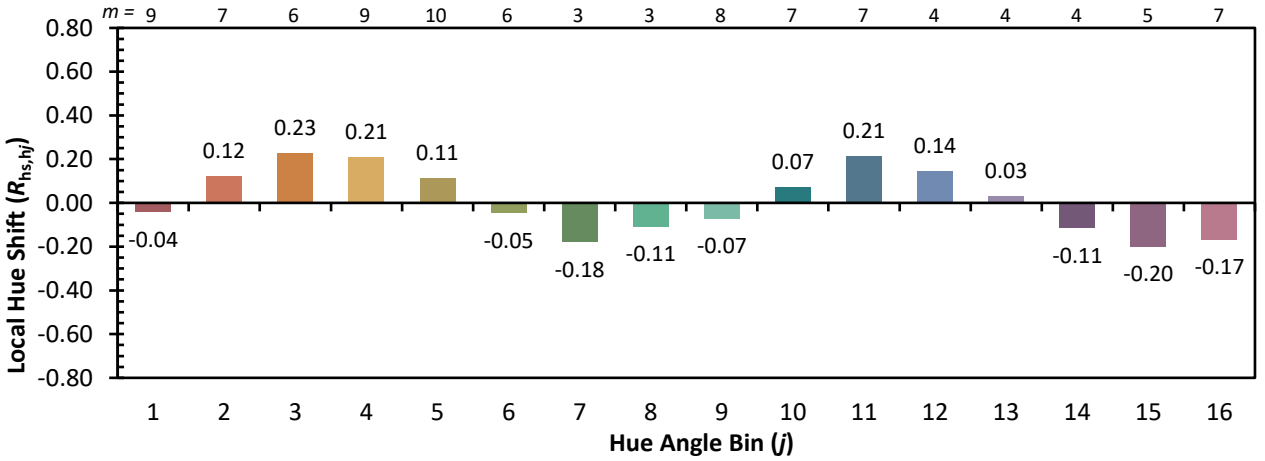


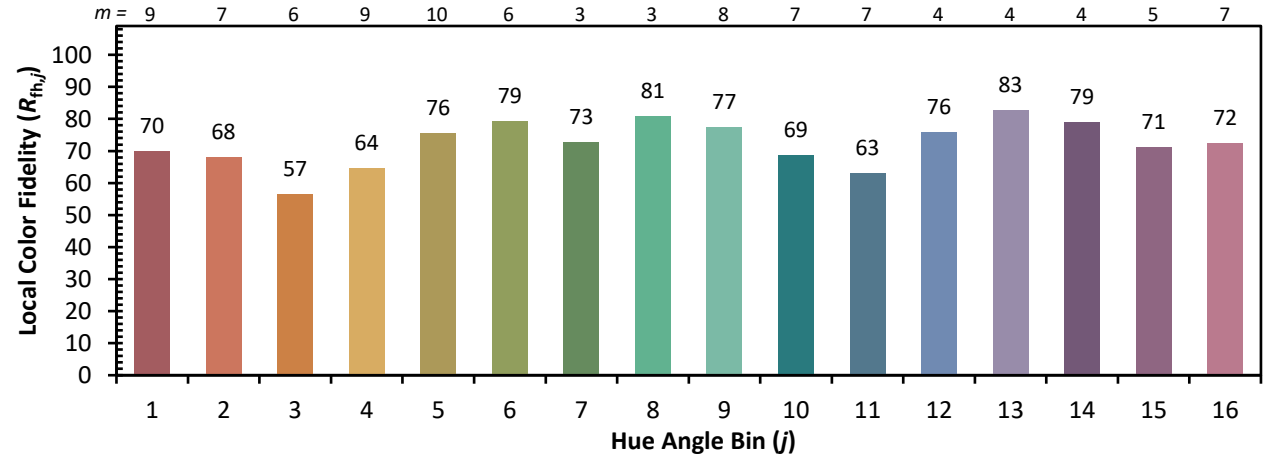


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Measure Comparisons

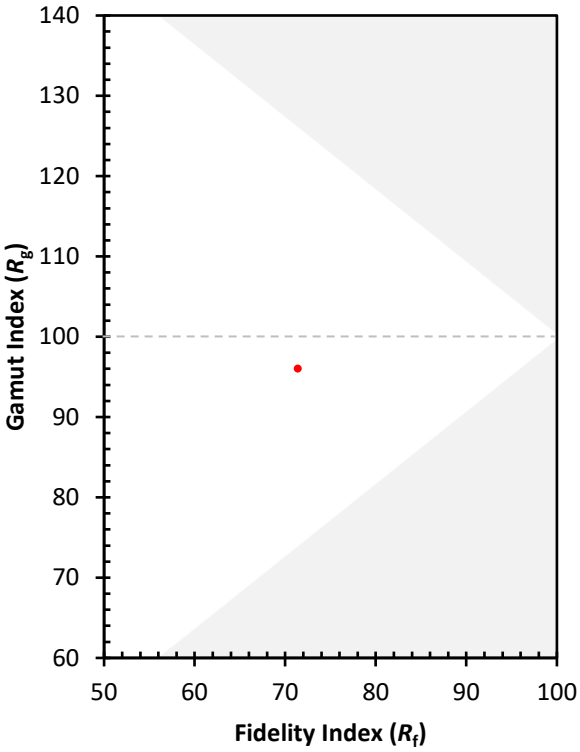

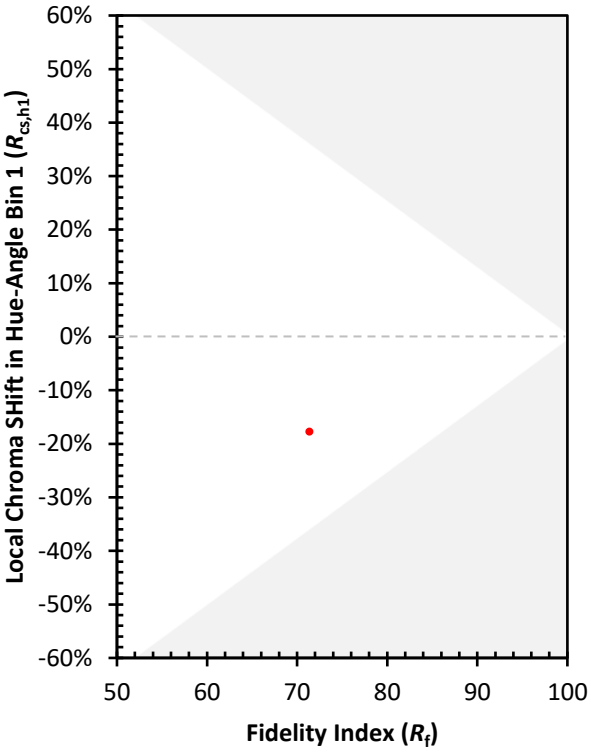

(END OF REPORT)