Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360780

Luminaire Tested: **GSS-SB6B-735-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360780
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB6B-735-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 6SQUARE 219W 70CRI 3500K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(156) 3500K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	32505.1 lumens
Efficiency:	N/A
Efficacy:	148.4 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 1' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B5 - U0 - G5


Input Watts (W):	219
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	8.7%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360780
CATALOG NUMBER: GSS-SB6B-735-U-T1

Iso-Footcandle Lines of Horizontal Illumination

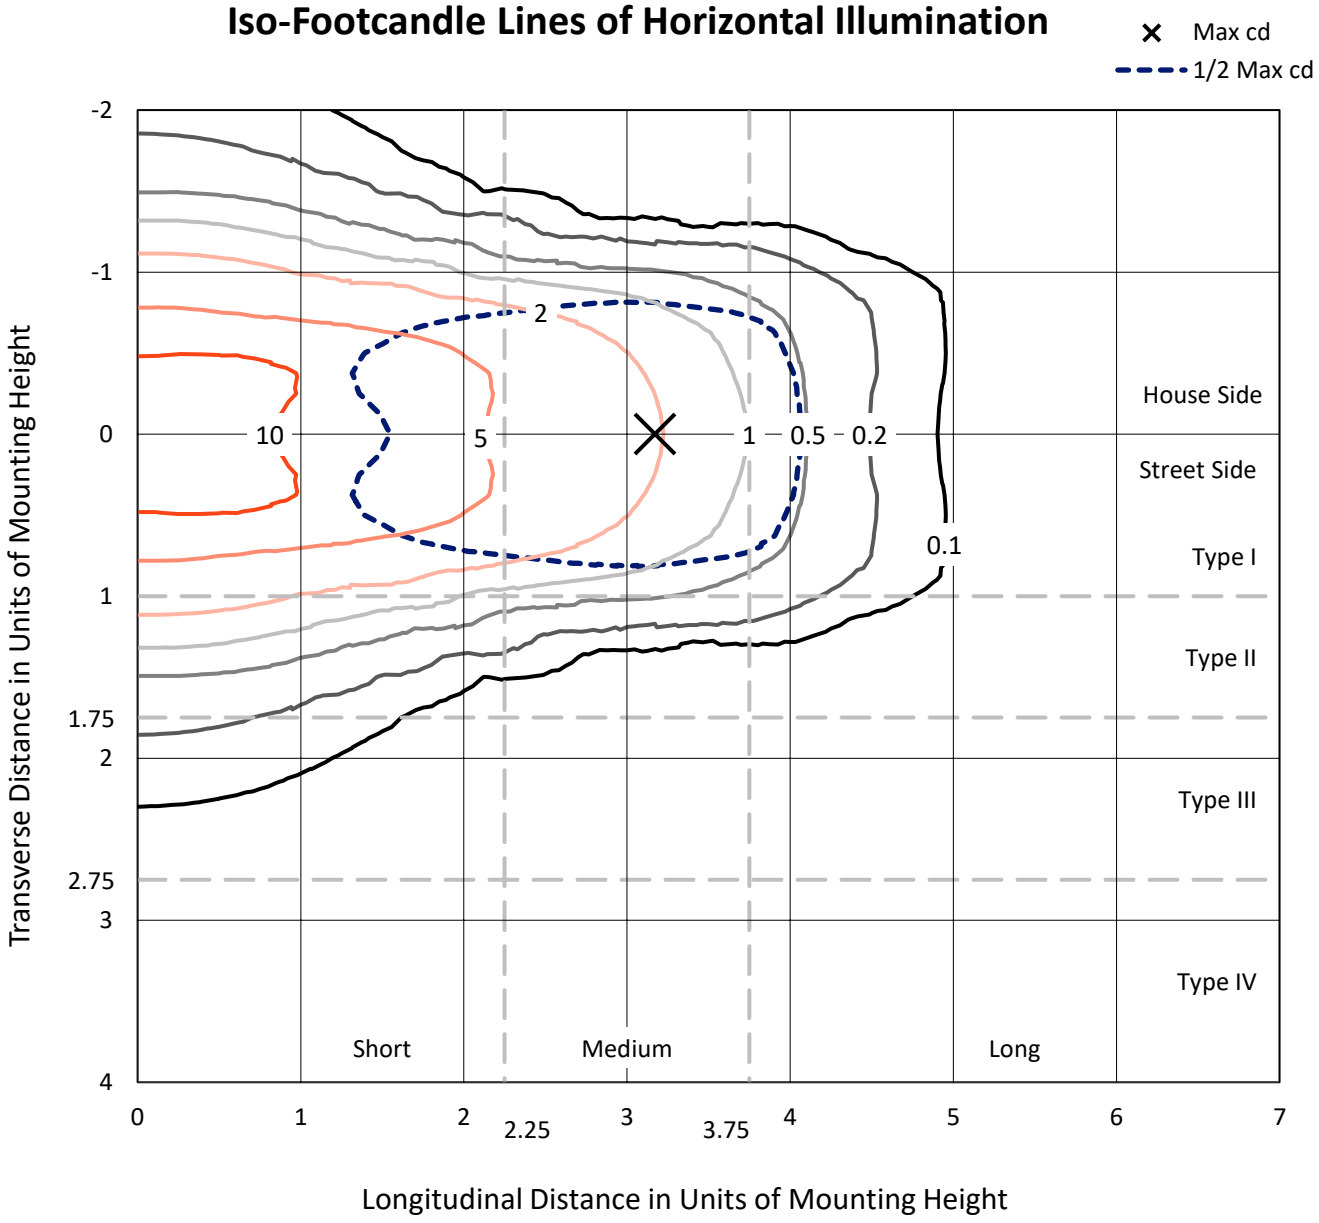


Based on 20 foot mounting height. Maximum calculated value = 16 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360780
CATALOG NUMBER: GSS-SB6B-735-U-T1

Luminous Intensity Polar Plot

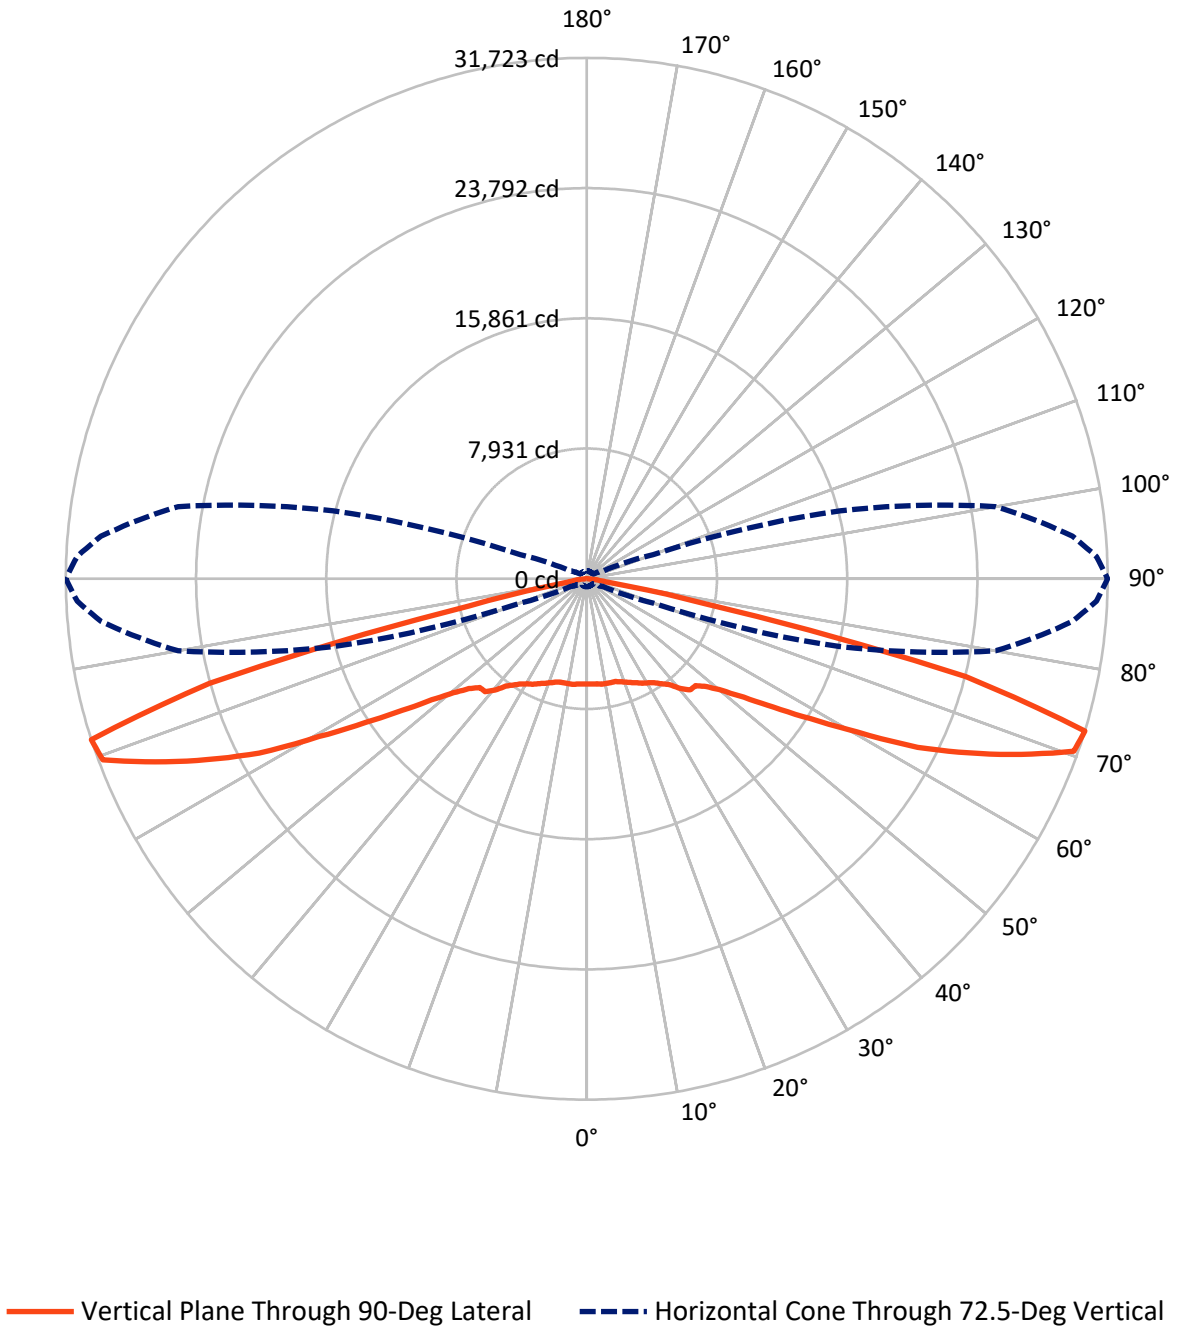

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360780
CATALOG NUMBER: GSS-SB6B-735-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	16252.5	0.0	16252.5
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	16252.5	0.0	16252.5
	% Fixture	50.0	0.0	50.0
Total	Lumens	32505.1	0.0	32505.1
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	619.9	1.9
10°-20°	1889.3	5.8
20°-30°	3157.8	9.7
30°-40°	4354.9	13.4
40°-50°	5338.5	16.4
50°-60°	6256.0	19.2
60°-70°	6947.1	21.4
70°-80°	3777.9	11.6
80°-90°	163.7	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	32505.1	100.0
0°-180°	32505.1	100.0

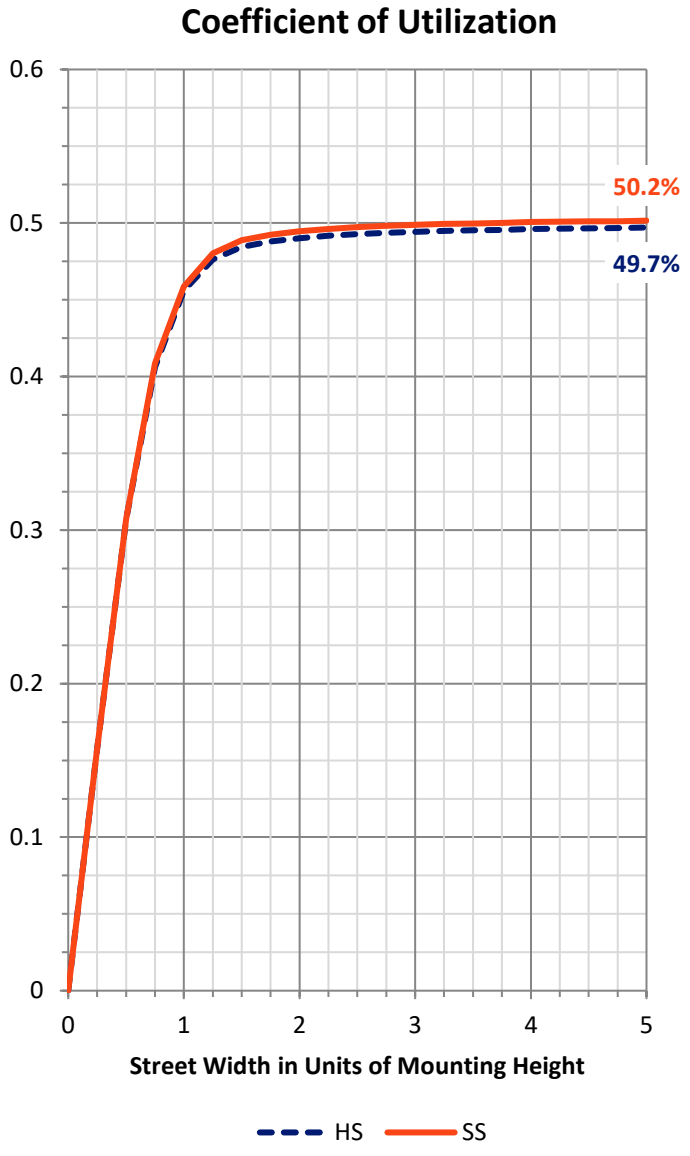

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360780
CATALOG NUMBER: GSS-SB6B-735-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	2833.5	8.7			
FM	(30°-60°)	7974.7	24.5			
FH	(60°-80°)	5362.5	16.5			G3/7500
FVH	(80°-90°)	81.9	0.3			G1/100
BL	(0°-30°)	2833.5	8.7	B4/5000		
BM	(30°-60°)	7974.7	24.5	B4/8500		
BH	(60°-80°)	5362.5	16.5	B5		G5
BVH	(80°-90°)	81.9	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B5-U0-G5
Type I Short

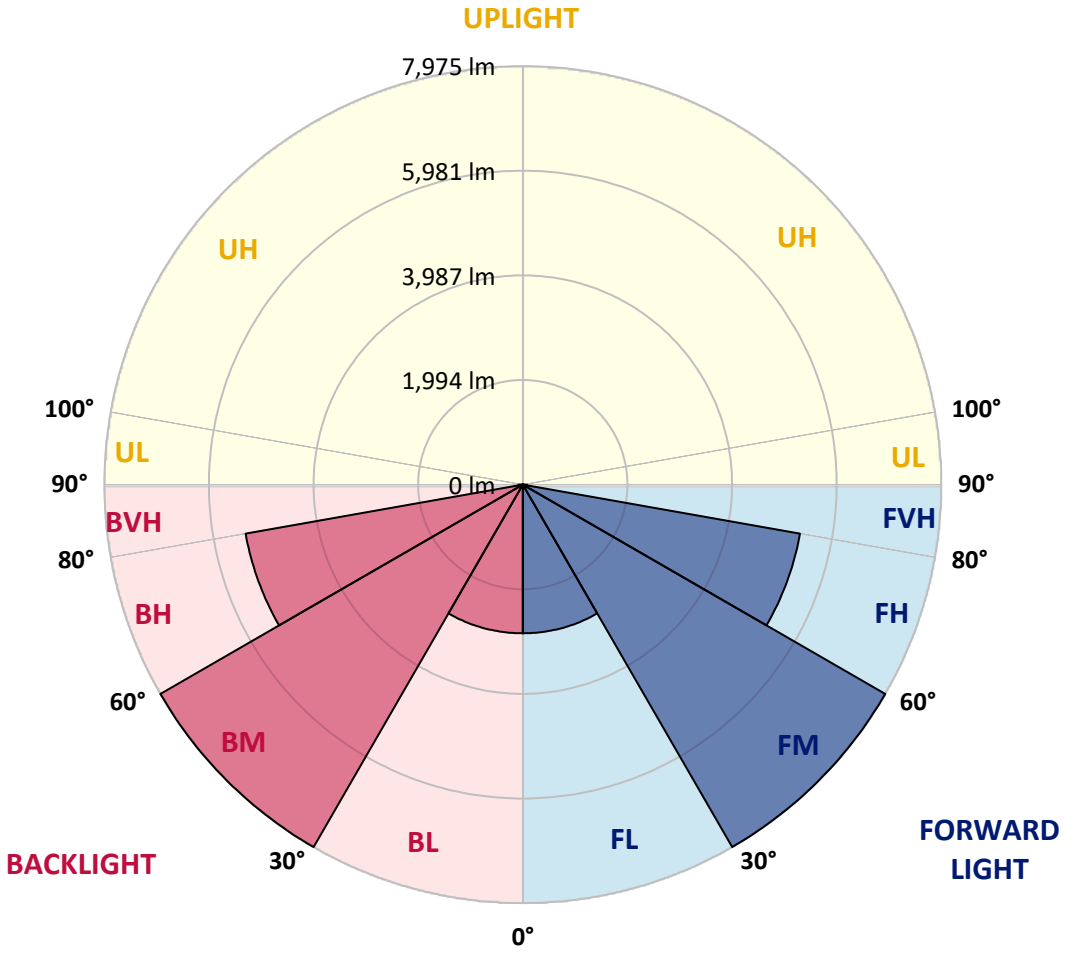

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360780
CATALOG NUMBER: GSS-SB6B-735-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	6404.3	6404.3	6404.3	6404.3	6404.3	6404.3	6404.3	6404.3	6404.3	6404.3	6404.3
2.5°	6411.4	6411.4	6390.1	6418.5	6404.3	6411.4	6418.5	6411.4	6404.3	6411.4	6418.5
5°	6447.0	6432.8	6447.0	6461.2	6439.9	6454.1	6447.0	6411.4	6432.8	6432.8	6432.8
7.5°	6511.0	6525.3	6511.0	6546.6	6525.3	6568.0	6525.3	6496.8	6489.7	6482.6	6482.6
10°	6539.5	6539.5	6532.4	6596.4	6610.7	6653.4	6624.9	6582.2	6560.9	6532.4	6503.9
12.5°	6461.2	6475.5	6511.0	6632.0	6688.9	6774.3	6753.0	6667.6	6603.6	6582.2	6539.5
15°	6375.8	6390.1	6461.2	6610.7	6745.9	6874.0	6866.8	6760.1	6681.8	6624.9	6560.9
17.5°	6240.6	6262.0	6361.6	6589.3	6831.3	6973.6	7016.3	6909.5	6824.1	6731.6	6646.2
20°	6012.9	6012.9	6190.8	6482.6	6817.0	7137.2	7251.1	7165.7	7066.1	6916.6	6802.8
22.5°	5756.8	5771.0	5948.9	6333.1	6809.9	7279.6	7500.2	7407.6	7308.0	7144.4	6973.6
25°	5500.6	5500.6	5699.8	6133.9	6717.4	7379.2	7791.9	7742.1	7542.8	7393.4	7172.8
27.5°	5265.8	5265.8	5479.2	5934.7	6560.9	7407.6	8083.7	8083.7	7863.1	7642.5	7400.5
30°	4988.2	5059.4	5301.3	5778.1	6418.5	7357.8	8297.1	8432.3	8233.1	7948.5	7592.7
32.5°	4753.4	4803.2	5052.3	5557.5	6212.2	7300.9	8539.1	8873.5	8667.2	8275.8	7877.3
35°	4475.9	4468.8	4753.4	5251.5	5920.4	7172.8	8731.2	9400.1	9200.9	8781.0	8240.2
37.5°	4113.0	4113.0	4404.7	4888.6	5642.9	6952.2	8887.8	9983.6	9834.2	9357.4	8781.0
40°	3721.6	3764.3	4020.5	4511.5	5308.5	6688.9	8887.8	10460.4	10538.6	10047.6	9449.9
42.5°	3437.0	3451.2	3686.0	4148.6	4938.4	6347.4	8773.9	10873.1	11107.9	10695.2	9919.6
45°	3138.1	3173.7	3372.9	3799.9	4554.2	5941.8	8574.7	11335.6	11712.8	11428.1	10410.6
47.5°	2775.2	2810.8	3038.5	3472.6	4191.3	5500.6	8240.2	11819.5	12609.4	12403.0	11285.8
50°	2355.4	2383.8	2597.3	3059.8	3785.7	4995.4	7820.4	12182.4	13506.0	13712.3	12609.4
52.5°	1843.0	1864.4	2092.1	2540.4	3301.8	4511.5	7229.7	12403.0	14409.7	15135.5	14381.2
55°	1323.6	1359.1	1558.4	1928.4	2661.3	3863.9	6525.3	12516.9	15398.8	16822.0	16580.0
57.5°	953.5	967.8	1103.0	1387.6	1978.2	3102.5	5621.6	12324.7	16288.3	18835.8	19341.0
60°	789.9	789.9	811.2	946.4	1352.0	2191.7	4539.9	11613.1	17049.7	20870.9	22429.3
62.5°	725.8	725.8	740.1	761.4	889.5	1423.2	3244.8	10168.6	17135.1	22827.8	25816.5
65°	661.8	661.8	676.0	690.2	718.7	925.1	1956.9	7443.2	15462.8	22849.1	27638.1
67.5°	604.9	604.9	612.0	619.1	633.3	676.0	1074.5	4511.5	12374.5	22244.3	28335.5
70°	547.9	547.9	547.9	540.8	562.2	569.3	711.6	2291.3	8275.8	20088.2	28001.0
72.5°	*483.9*	*483.9*	*476.8*	*462.5*	*469.6*	*469.6*	*526.6*	*1124.3*	*4298.0*	*15968.1*	*25282.8*
75°	412.7	419.8	391.4	377.1	370.0	377.1	419.8	640.4	1921.3	9684.7	18892.7
77.5°	348.7	362.9	320.2	291.8	284.6	284.6	327.3	398.5	825.4	3515.3	8467.9
80°	263.3	270.4	234.8	206.4	206.4	199.2	241.9	291.8	391.4	1046.0	1899.9
82.5°	149.4	149.4	135.2	121.0	113.9	121.0	163.7	199.2	241.9	370.0	519.5
85°	35.6	35.6	42.7	49.8	49.8	64.0	92.5	106.7	128.1	149.4	199.2
87.5°	7.1	7.1	7.1	14.2	21.3	21.3	35.6	49.8	64.0	78.3	85.4
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360780
CATALOG NUMBER: GSS-SB6B-735-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	6404.3	6404.3	*6404.3*
2.5°	6418.5	6425.7	*6418.5*
5°	6461.2	6447.0	*6425.7*
7.5°	6468.3	6475.5	*6482.6*
10°	6496.8	6525.3	*6482.6*
12.5°	6525.3	6503.9	*6489.7*
15°	6546.6	6539.5	*6496.8*
17.5°	6624.9	6596.4	*6589.3*
20°	6745.9	6738.8	*6717.4*
22.5°	6888.2	6874.0	*6866.8*
25°	7094.5	7044.7	*7016.3*
27.5°	7265.3	7222.6	*7208.4*
30°	7436.1	7350.7	*7350.7*
32.5°	7585.5	7564.2	*7550.0*
35°	7941.3	7834.6	*7848.8*
37.5°	8375.4	8268.7	*8176.2*
40°	8987.4	8845.1	*8788.1*
42.5°	9378.7	9236.4	*9250.7*
45°	9599.3	9350.3	*9286.2*
47.5°	10197.1	9884.0	*9798.6*
50°	11164.8	10780.6	*10673.8*
52.5°	12730.3	12111.3	*11968.9*
55°	14694.3	13932.9	*13790.6*
57.5°	17384.1	16373.7	*16067.7*
60°	20657.4	19405.0	*18942.5*
62.5°	24592.5	23048.4	*22607.2*
65°	27552.7	26264.8	*25581.6*
67.5°	29922.3	28862.1	*28534.7*
70°	31331.3	31381.1	*31466.5*
72.5°	*29701.7*	*31068.0*	*31722.7*
75°	21767.5	22827.8	*23845.4*
77.5°	8411.0	7585.5	*7343.6*
80°	1359.1	1273.7	*1316.4*
82.5°	612.0	647.5	*683.1*
85°	398.5	462.5	*491.0*
87.5°	92.5	92.5	*92.5*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-5

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-735-U-5WQ

Data in this report applies to families of products including GSS-SB1A-735-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-735-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 3500K CCT 26 LEDS

Spectral Parameters

CCT (K):	3369
CIE u':	0.2386
CIE v':	0.5156
Duv:	0.0013
CIE x:	0.4143
CIE y:	0.3980
CIE z:	0.1877
Peak Wavelength (nm):	590
Dominant Wavelength (nm):	580
Purity:	43.80166
Rf:	71.4
Rg:	96

CRI (Ra):	70.1
R1:	66.6
R2:	77.6
R3:	88.5
R4:	69.5
R5:	66.4
R6:	69.6
R7:	77.5
R8:	44.9
R9:	-40.2
R10:	49.1
R11:	66.3
R12:	45.7
R13:	68.0
R14:	93.4
R15:	57.6

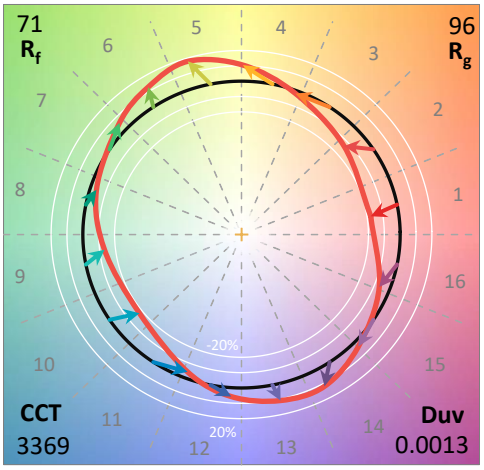

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-5

CIE 1931 Chromaticity Diagram

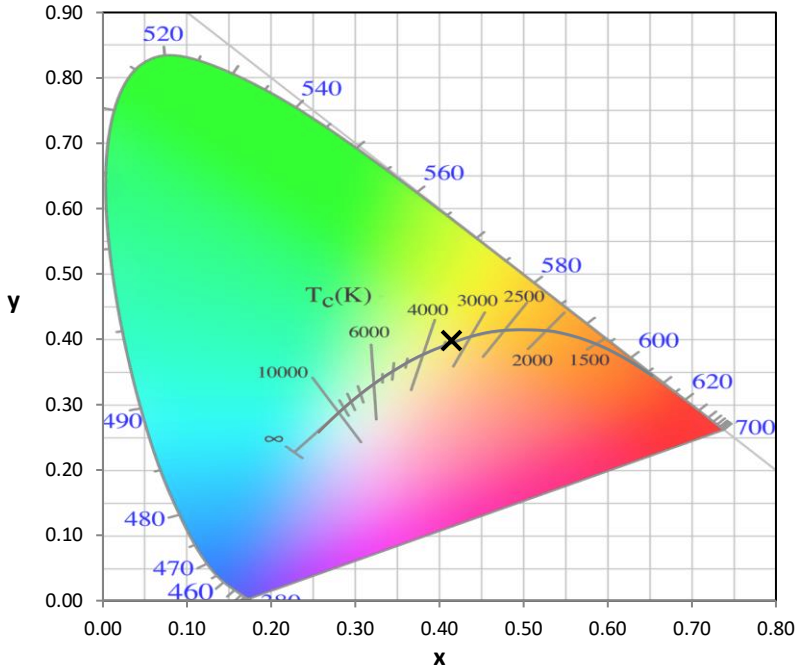

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

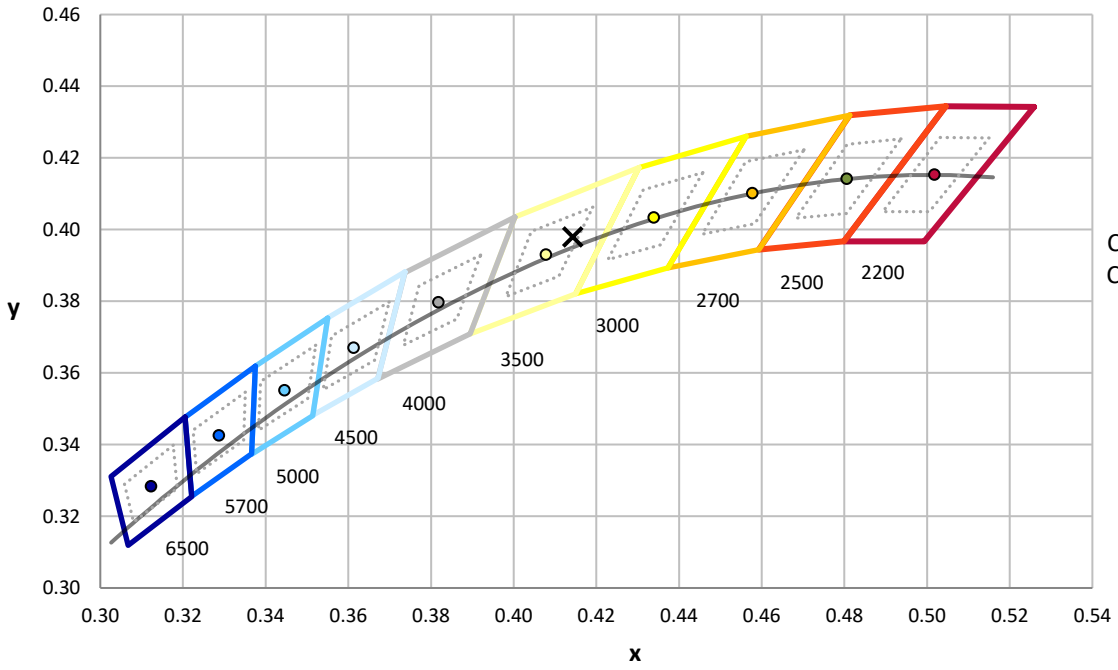


CCT = 3369K
CIE x = 0.4143
CIE y = 0.3980
Duv = 0.0013

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-5

Photopic Flux vs. Wavelength

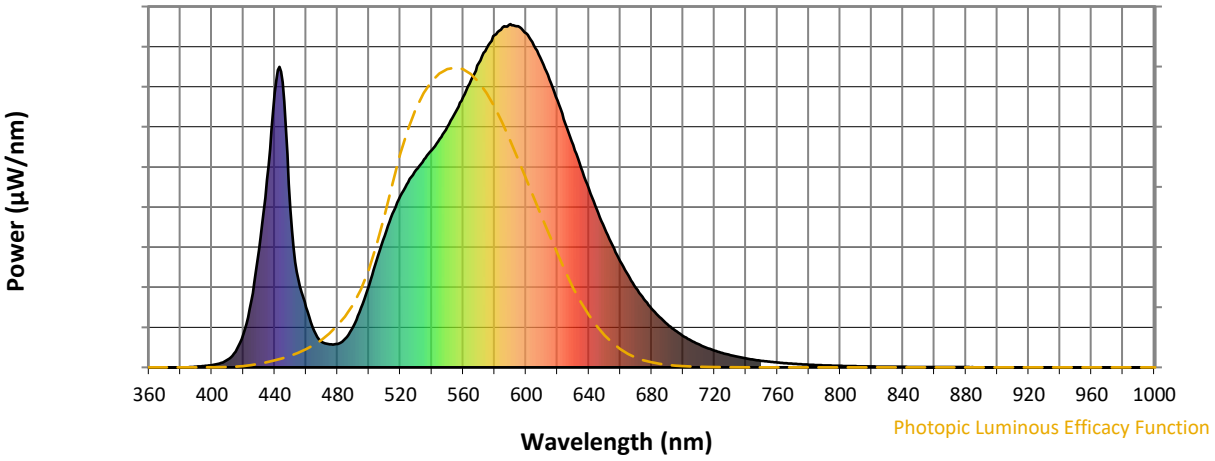


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Scotopic Flux vs. Wavelength

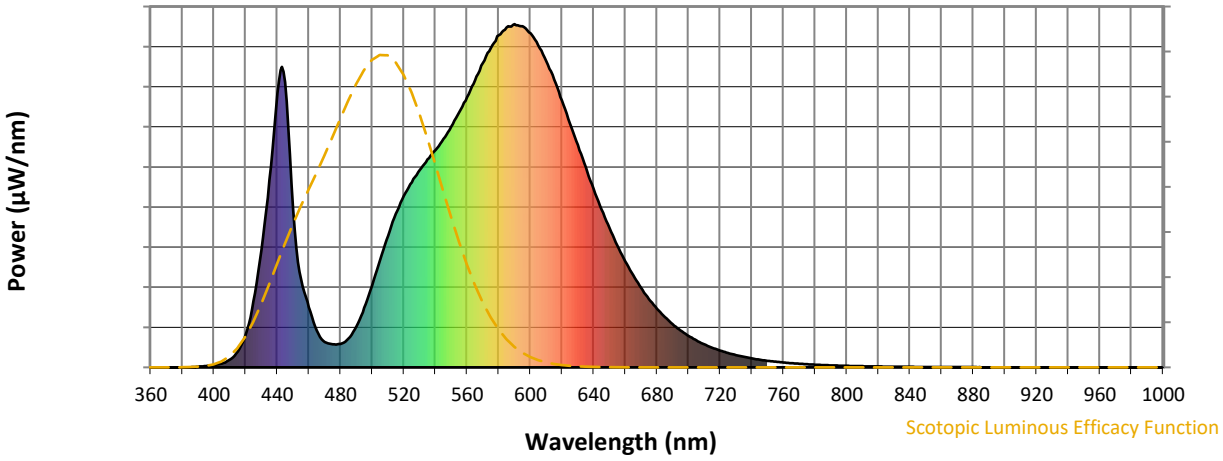


Scotopic Lumens: NR **S/P: 1.29**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Melanopic Flux vs. Wavelength

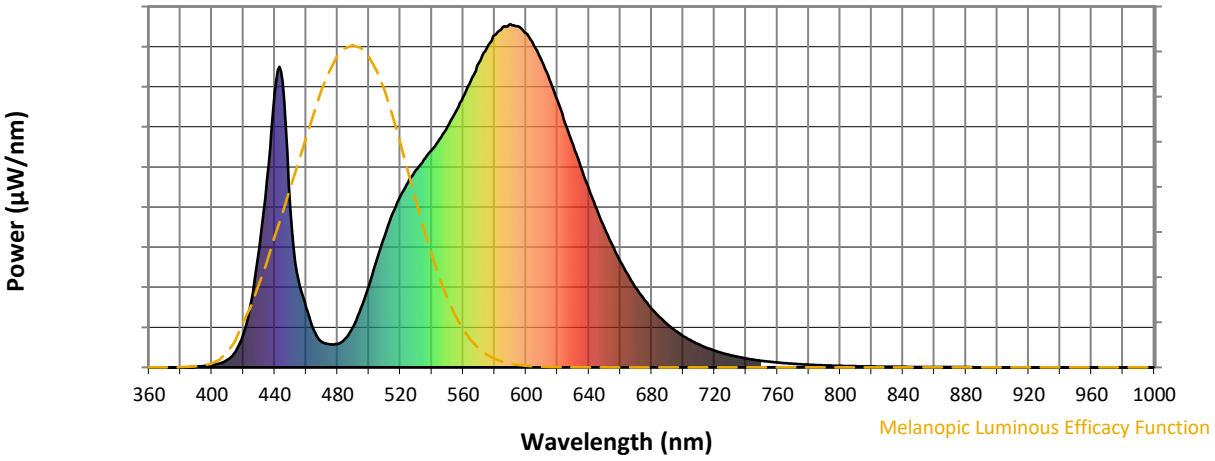

Melanopic Lumens: NR **M/P: 2.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			


REPORT NUMBER: SP1-2407-184-5

TM-30-18


Summary


R_f = 71.4
R_g = 96
CIE R_a = 70.1
R_9 = -40.2


Spectral Power Distribution Comparison

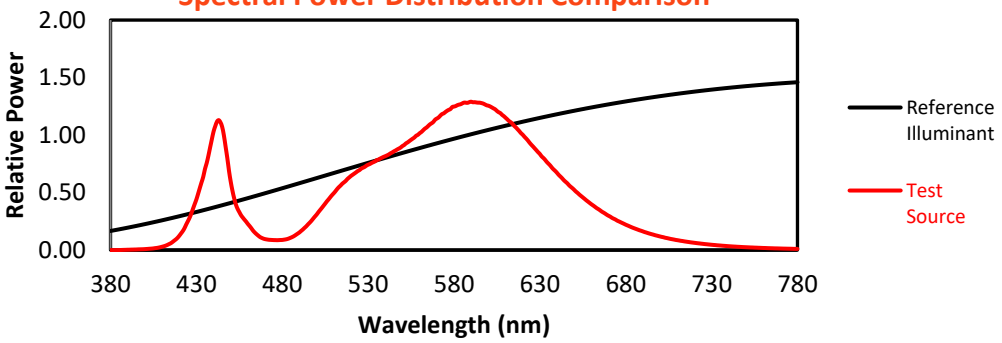


Color Vector Graphics

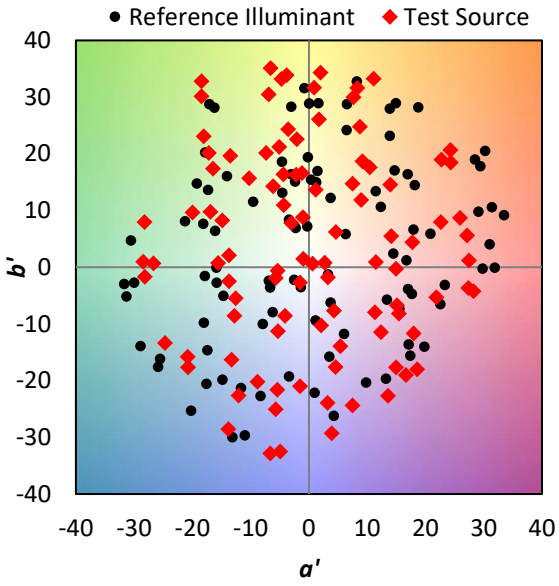

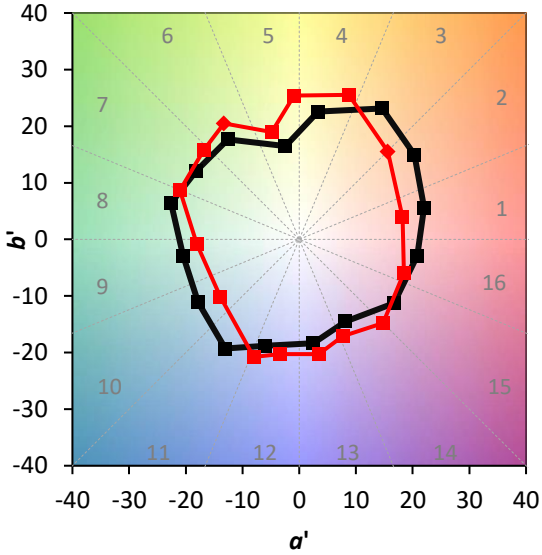

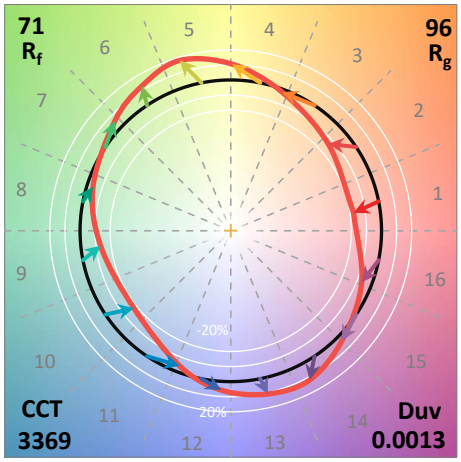

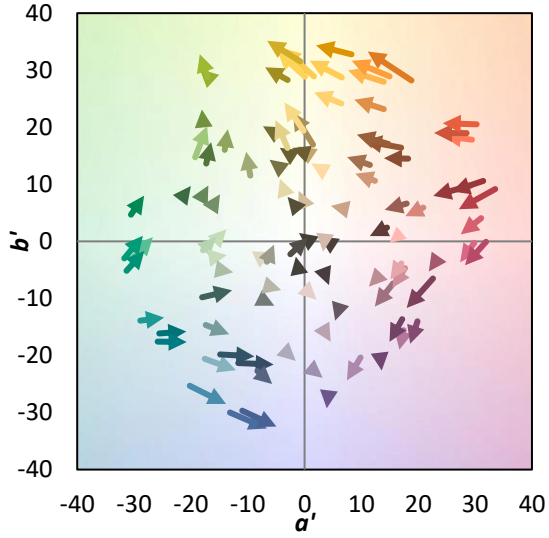


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 57	CES51 = 84	CES76 = 50
CES02 = 62	CES27 = 80	CES52 = 86	CES77 = 74
CES03 = 31	CES28 = 81	CES53 = 72	CES78 = 54
CES04 = 70	CES29 = 50	CES54 = 79	CES79 = 81
CES05 = 48	CES30 = 55	CES55 = 78	CES80 = 79
CES06 = 51	CES31 = 56	CES56 = 67	CES81 = 74
CES07 = 40	CES32 = 54	CES57 = 65	CES82 = 91
CES08 = 39	CES33 = 60	CES58 = 68	CES83 = 86
CES09 = 29	CES34 = 69	CES59 = 85	CES84 = 89
CES10 = 75	CES35 = 83	CES60 = 91	CES85 = 83
CES11 = 58	CES36 = 88	CES61 = 85	CES86 = 66
CES12 = 64	CES37 = 78	CES62 = 78	CES87 = 77
CES13 = 43	CES38 = 64	CES63 = 71	CES88 = 75
CES14 = 74	CES39 = 92	CES64 = 70	CES89 = 68
CES15 = 71	CES40 = 86	CES65 = 64	CES90 = 72
CES16 = 47	CES41 = 81	CES66 = 65	CES91 = 95
CES17 = 50	CES42 = 79	CES67 = 63	CES92 = 62
CES18 = 56	CES43 = 71	CES68 = 69	CES93 = 78
CES19 = 72	CES44 = 98	CES69 = 80	CES94 = 51
CES20 = 65	CES45 = 80	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 75	CES71 = 58	CES96 = 76
CES22 = 79	CES47 = 71	CES72 = 85	CES97 = 82
CES23 = 92	CES48 = 61	CES73 = 51	CES98 = 72
CES24 = 91	CES49 = 74	CES74 = 94	CES99 = 60
CES25 = 72	CES50 = 83	CES75 = 57	

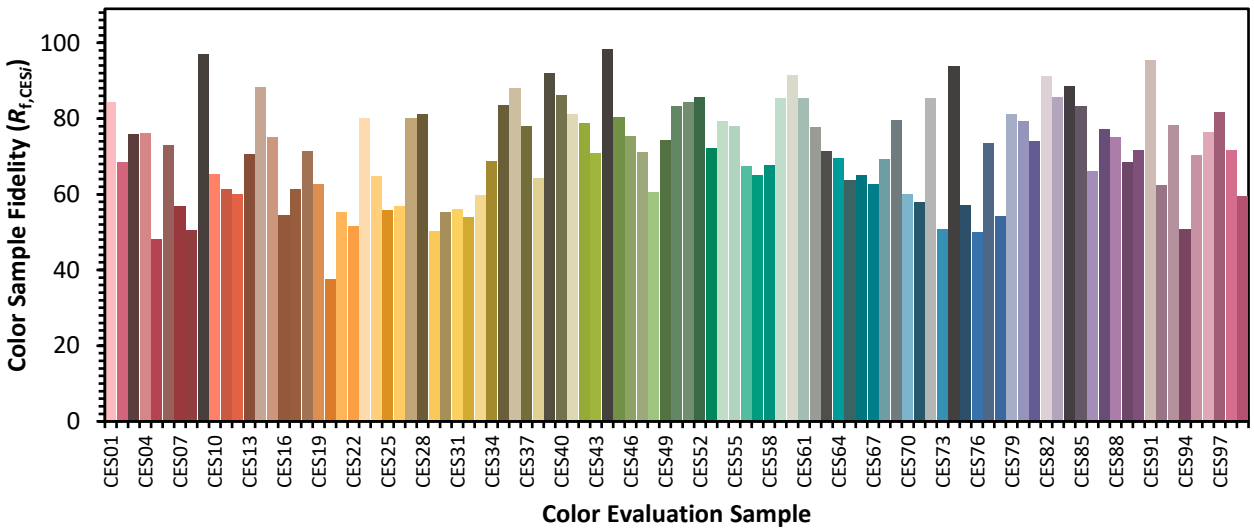



REPORT NUMBER: SP1-2407-184-5

TM-30-18

Color Rendition by Hue-Angle Bin

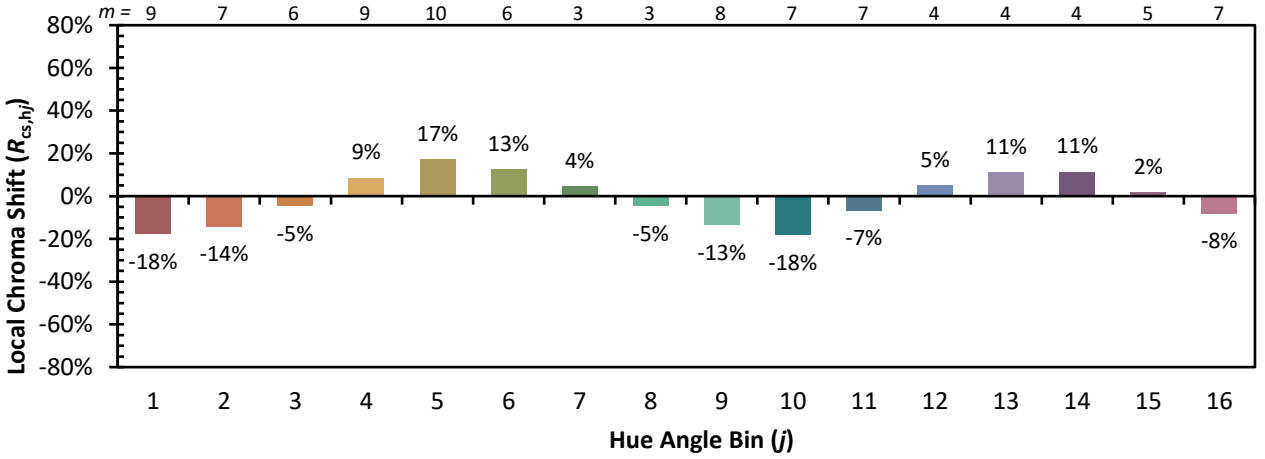

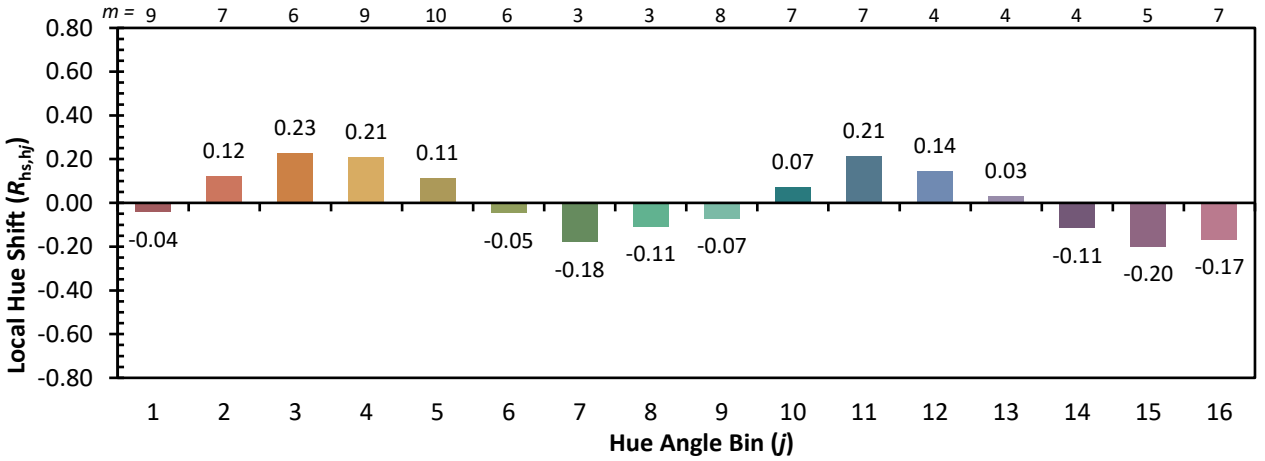


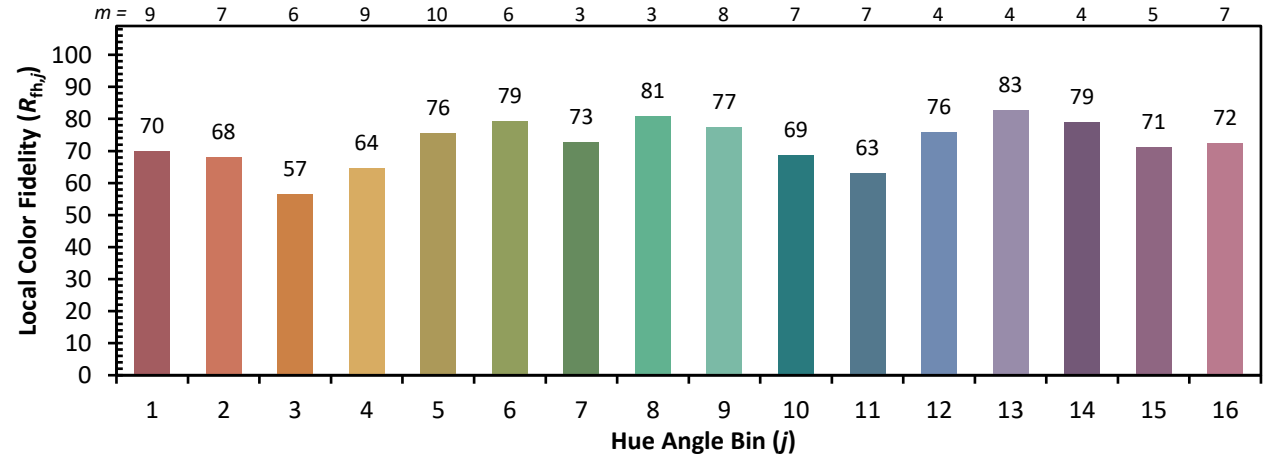


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Measure Comparisons

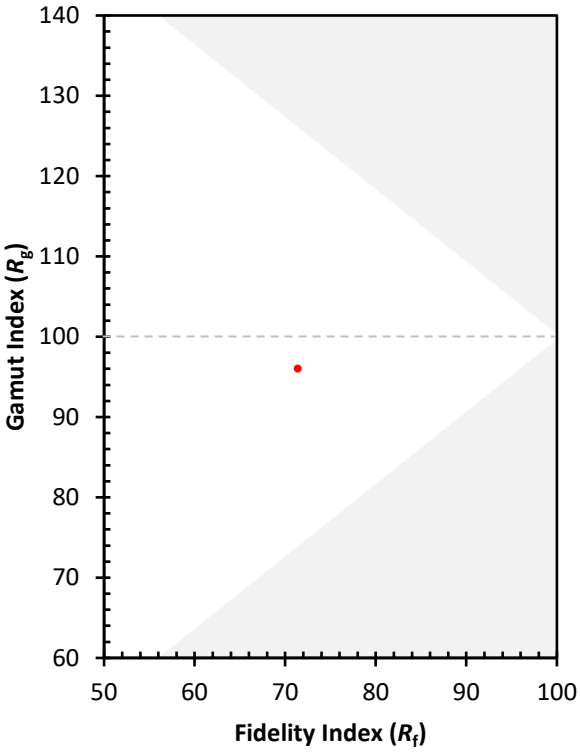

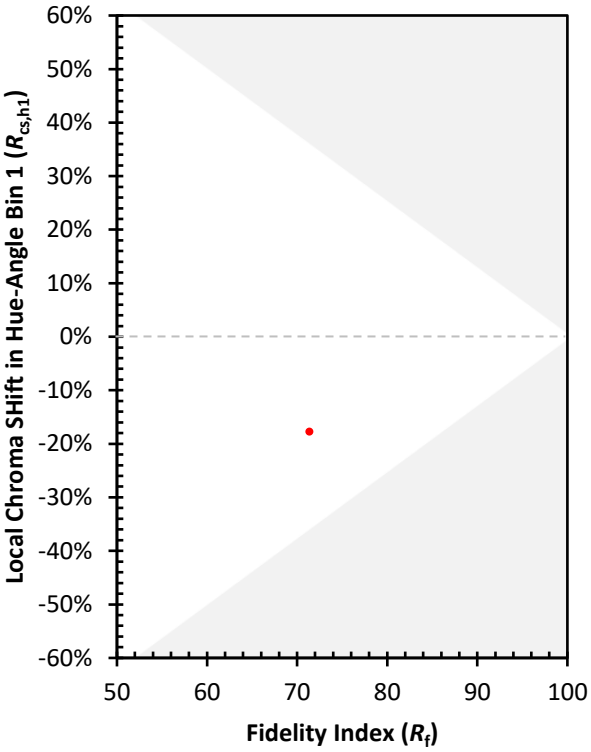

(END OF REPORT)