Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360769

Luminaire Tested: **GSS-SB3C-735-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360769
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB3C-735-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 3SQUARE 150W 70CRI 3500K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(78) 3500K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	20556.6 lumens
Efficiency:	N/A
Efficacy:	137.0 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 0.5' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B4 - U0 - G4


Input Watts (W):	150
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	6.3%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360769
CATALOG NUMBER: GSS-SB3C-735-U-T1

Iso-Footcandle Lines of Horizontal Illumination

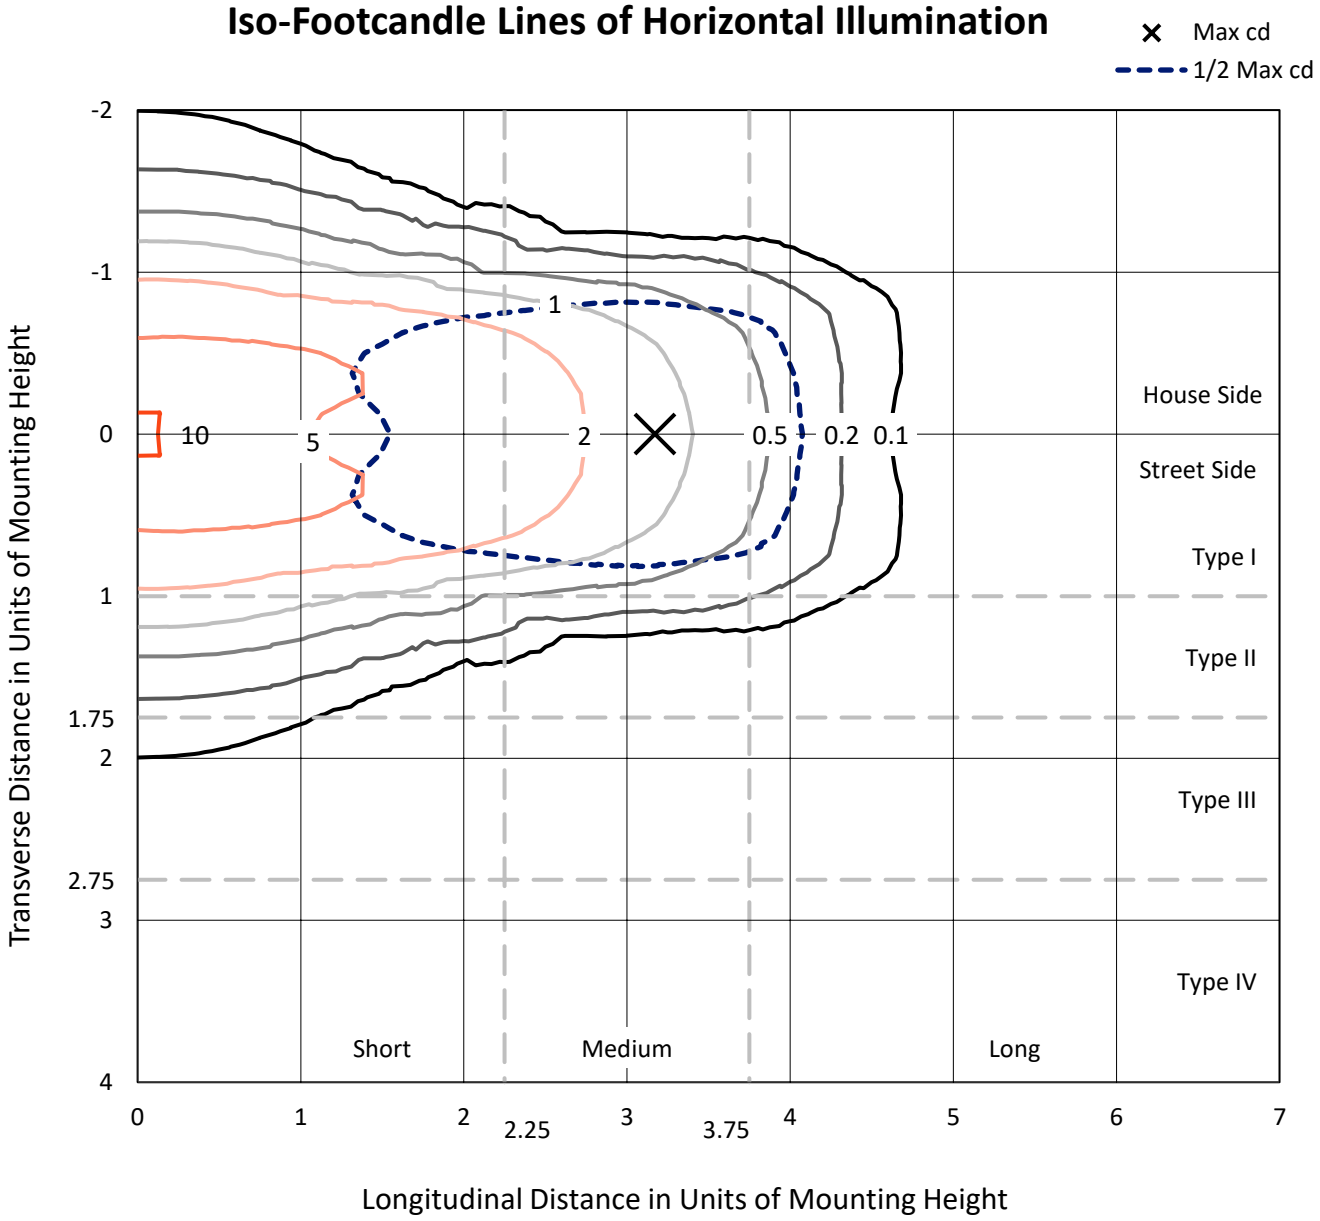


Based on 20 foot mounting height. Maximum calculated value = 10.1 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360769
CATALOG NUMBER: GSS-SB3C-735-U-T1

Luminous Intensity Polar Plot

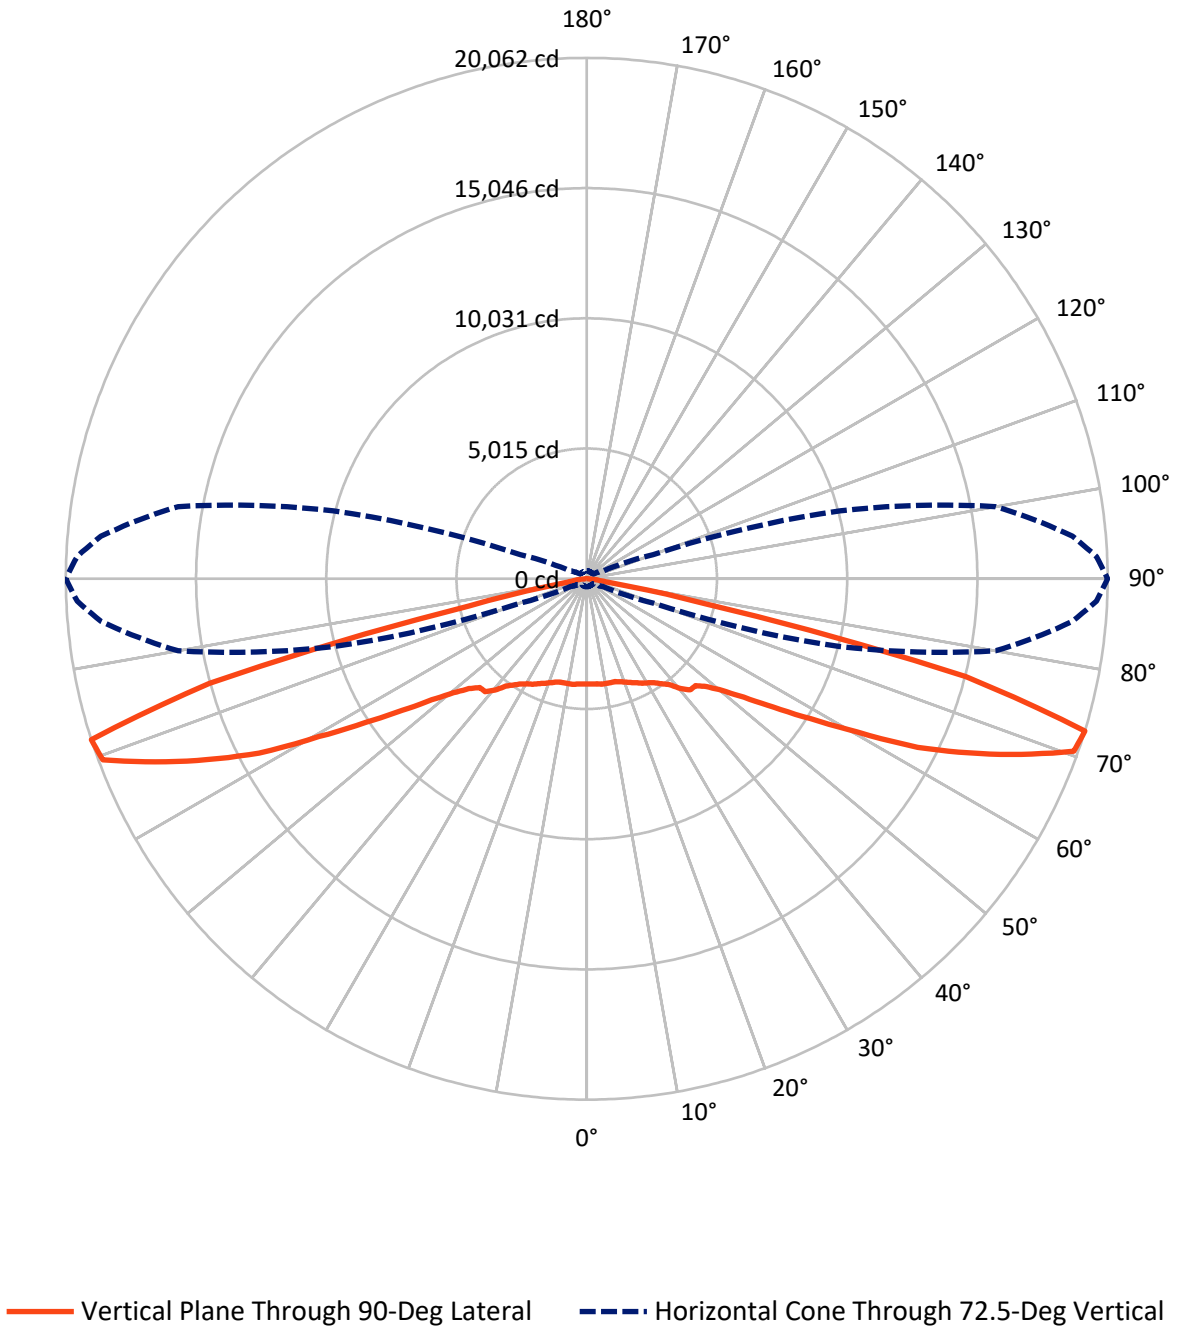

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360769
CATALOG NUMBER: GSS-SB3C-735-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	10278.3	0.0	10278.3
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	10278.3	0.0	10278.3
	% Fixture	50.0	0.0	50.0
Total	Lumens	20556.6	0.0	20556.6
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	392.0	1.9
10°-20°	1194.8	5.8
20°-30°	1997.1	9.7
30°-40°	2754.1	13.4
40°-50°	3376.1	16.4
50°-60°	3956.3	19.2
60°-70°	4393.4	21.4
70°-80°	2389.2	11.6
80°-90°	103.5	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	20556.6	100.0
0°-180°	20556.6	100.0

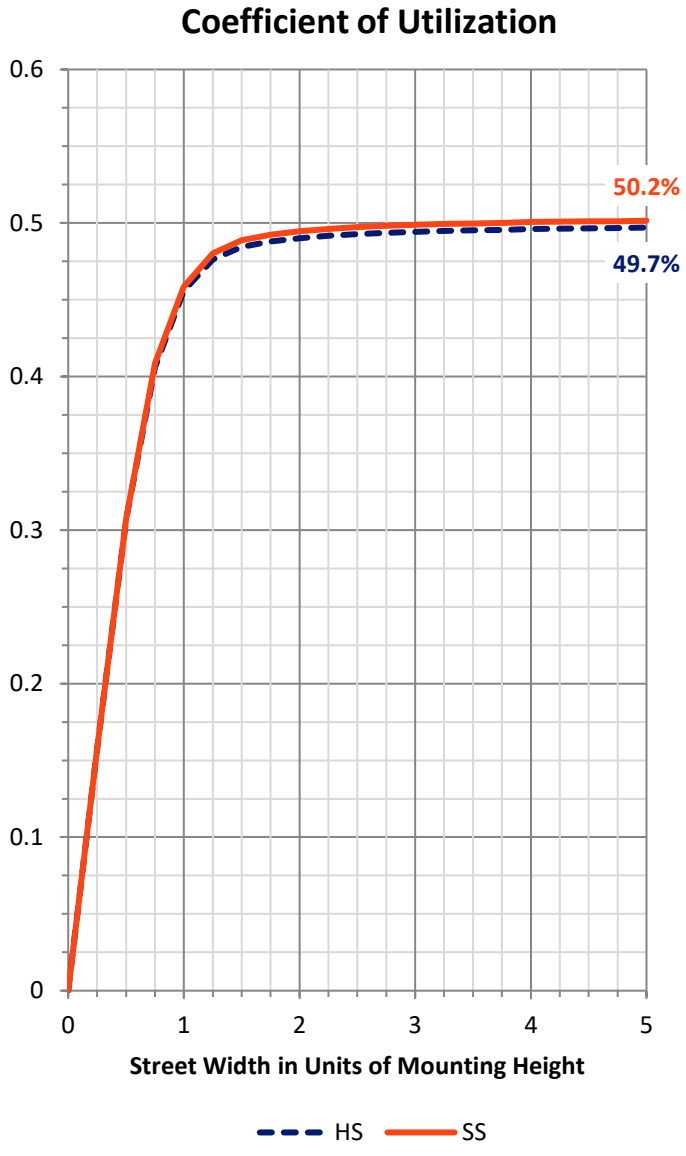

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360769
CATALOG NUMBER: GSS-SB3C-735-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	1792.0	8.7			
FM	(30°-60°)	5043.3	24.5			
FH	(60°-80°)	3391.3	16.5			G2/5000
FVH	(80°-90°)	51.8	0.3			G1/100
BL	(0°-30°)	1792.0	8.7	B3/2500		
BM	(30°-60°)	5043.3	24.5	B4/8500		
BH	(60°-80°)	3391.3	16.5	B4/5000		G4/5000
BVH	(80°-90°)	51.8	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B4-U0-G4
Type I Short

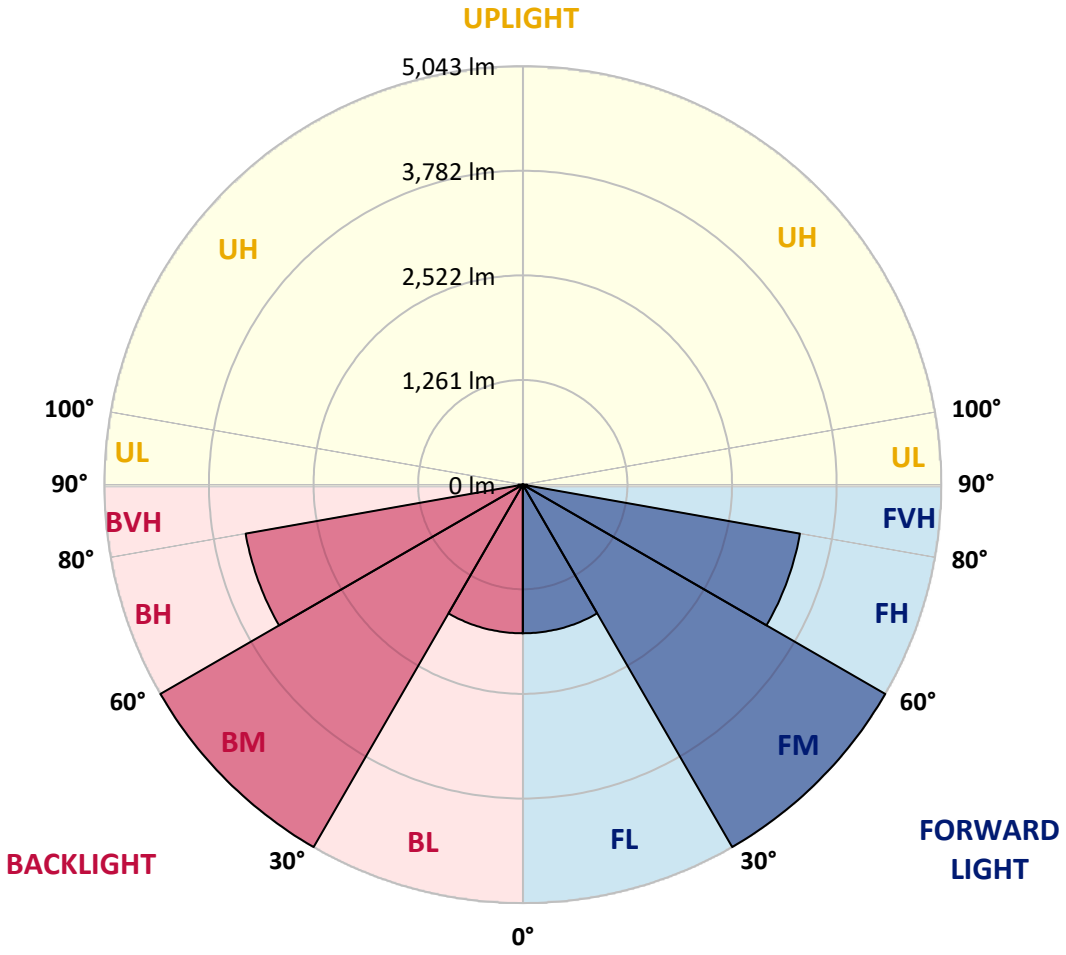

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360769
CATALOG NUMBER: GSS-SB3C-735-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	4050.2	4050.2	4050.2	4050.2	4050.2	4050.2	4050.2	4050.2	4050.2	4050.2	4050.2
2.5°	4054.7	4054.7	4041.2	4059.2	4050.2	4054.7	4059.2	4054.7	4050.2	4054.7	4059.2
5°	4077.2	4068.2	4077.2	4086.2	4072.7	4081.7	4077.2	4054.7	4068.2	4068.2	4068.2
7.5°	4117.7	4126.7	4117.7	4140.2	4126.7	4153.7	4126.7	4108.7	4104.2	4099.7	4099.7
10°	4135.7	4135.7	4131.2	4171.7	4180.7	4207.7	4189.7	4162.7	4149.2	4131.2	4113.2
12.5°	4086.2	4095.2	4117.7	4194.2	4230.2	4284.2	4270.7	4216.7	4176.2	4162.7	4135.7
15°	4032.2	4041.2	4086.2	4180.7	4266.2	4347.2	4342.7	4275.2	4225.7	4189.7	4149.2
17.5°	3946.7	3960.2	4023.2	4167.2	4320.2	4410.2	4437.2	4369.7	4315.7	4257.2	4203.2
20°	3802.6	3802.6	3915.1	4099.7	4311.2	4513.7	4585.7	4531.7	4468.7	4374.2	4302.2
22.5°	3640.6	3649.6	3762.1	4005.2	4306.7	4603.7	4743.2	4684.7	4621.7	4518.2	4410.2
25°	3478.6	3478.6	3604.6	3879.1	4248.2	4666.7	4927.7	4896.2	4770.2	4675.7	4536.2
27.5°	3330.1	3330.1	3465.1	3753.1	4149.2	4684.7	5112.2	5112.2	4972.7	4833.2	4680.2
30°	3154.6	3199.6	3352.6	3654.1	4059.2	4653.2	5247.2	5332.7	5206.7	5026.7	4801.7
32.5°	3006.1	3037.6	3195.1	3514.6	3928.7	4617.2	5400.2	5611.7	5481.2	5233.7	4981.7
35°	2830.6	2826.1	3006.1	3321.1	3744.1	4536.2	5521.7	5944.7	5818.7	5553.2	5211.2
37.5°	2601.1	2601.1	2785.6	3091.6	3568.6	4396.7	5620.7	6313.7	6219.2	5917.7	5553.2
40°	2353.6	2380.6	2542.6	2853.1	3357.1	4230.2	5620.7	6615.3	6664.8	6354.2	5976.2
42.5°	2173.6	2182.6	2331.1	2623.6	3123.1	4014.2	5548.7	6876.3	7024.8	6763.8	6273.2
45°	1984.6	2007.1	2133.1	2403.1	2880.1	3757.6	5422.7	7168.8	7407.3	7227.3	6583.8
47.5°	1755.1	1777.6	1921.6	2196.1	2650.6	3478.6	5211.2	7474.8	7974.3	7843.8	7137.3
50°	1489.6	1507.6	1642.6	1935.1	2394.1	3159.1	4945.7	7704.3	8541.3	8671.8	7974.3
52.5°	1165.5	1179.0	1323.1	1606.6	2088.1	2853.1	4572.2	7843.8	9112.8	9571.9	9094.8
55°	837.0	859.5	985.5	1219.5	1683.1	2443.6	4126.7	7915.8	9738.4	10638.4	10485.4
57.5°	603.0	612.0	697.5	877.5	1251.0	1962.1	3555.1	7794.3	10300.9	11912.0	12231.5
60°	499.5	499.5	513.0	598.5	855.0	1386.1	2871.1	7344.3	10782.4	13199.0	14184.5
62.5°	459.0	459.0	468.0	481.5	562.5	900.0	2052.1	6430.7	10836.4	14436.6	16326.6
65°	418.5	418.5	427.5	436.5	454.5	585.0	1237.5	4707.2	9778.9	14450.1	17478.7
67.5°	382.5	382.5	387.0	391.5	400.5	427.5	679.5	2853.1	7825.8	14067.5	17919.7
70°	346.5	346.5	346.5	342.0	355.5	360.0	450.0	1449.1	5233.7	12704.0	17708.2
72.5°	*306.0*	*306.0*	*301.5*	*292.5*	*297.0*	*297.0*	*333.0*	*711.0*	*2718.1*	*10098.4*	*15989.1*
75°	261.0	265.5	247.5	238.5	234.0	238.5	265.5	405.0	1215.0	6124.7	11948.0
77.5°	220.5	229.5	202.5	184.5	180.0	180.0	207.0	252.0	522.0	2223.1	5355.2
80°	166.5	171.0	148.5	130.5	130.5	126.0	153.0	184.5	247.5	661.5	1201.5
82.5°	94.5	94.5	85.5	76.5	72.0	76.5	103.5	126.0	153.0	234.0	328.5
85°	22.5	22.5	27.0	31.5	31.5	40.5	58.5	67.5	81.0	94.5	126.0
87.5°	4.5	4.5	4.5	9.0	13.5	13.5	22.5	31.5	40.5	49.5	54.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360769
CATALOG NUMBER: GSS-SB3C-735-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	4050.2	4050.2	*4050.2*
2.5°	4059.2	4063.7	*4059.2*
5°	4086.2	4077.2	*4063.7*
7.5°	4090.7	4095.2	*4099.7*
10°	4108.7	4126.7	*4099.7*
12.5°	4126.7	4113.2	*4104.2*
15°	4140.2	4135.7	*4108.7*
17.5°	4189.7	4171.7	*4167.2*
20°	4266.2	4261.7	*4248.2*
22.5°	4356.2	4347.2	*4342.7*
25°	4486.7	4455.2	*4437.2*
27.5°	4594.7	4567.7	*4558.7*
30°	4702.7	4648.7	*4648.7*
32.5°	4797.2	4783.7	*4774.7*
35°	5022.2	4954.7	*4963.7*
37.5°	5296.7	5229.2	*5170.7*
40°	5683.7	5593.7	*5557.7*
42.5°	5931.2	5841.2	*5850.2*
45°	6070.7	5913.2	*5872.7*
47.5°	6448.7	6250.7	*6196.7*
50°	7060.8	6817.8	*6750.3*
52.5°	8050.8	7659.3	*7569.3*
55°	9292.9	8811.3	*8721.3*
57.5°	10993.9	10354.9	*10161.4*
60°	13064.0	12272.0	*11979.5*
62.5°	15552.6	14576.1	*14297.0*
65°	17424.7	16610.1	*16178.1*
67.5°	18923.2	18252.7	*18045.7*
70°	19814.3	19845.8	*19899.8*
72.5°	*18783.7*	*19647.8*	*20061.8*
75°	13766.0	14436.6	*15080.1*
77.5°	5319.2	4797.2	*4644.2*
80°	859.5	805.5	*832.5*
82.5°	387.0	409.5	*432.0*
85°	252.0	292.5	*310.5*
87.5°	58.5	58.5	*58.5*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-5

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-735-U-5WQ

Data in this report applies to families of products including GSS-SB1A-735-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-735-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 3500K CCT 26 LEDS

Spectral Parameters

CCT (K):	3369
CIE u':	0.2386
CIE v':	0.5156
Duv:	0.0013
CIE x:	0.4143
CIE y:	0.3980
CIE z:	0.1877
Peak Wavelength (nm):	590
Dominant Wavelength (nm):	580
Purity:	43.80166
Rf:	71.4
Rg:	96

CRI (Ra):	70.1
R1:	66.6
R2:	77.6
R3:	88.5
R4:	69.5
R5:	66.4
R6:	69.6
R7:	77.5
R8:	44.9
R9:	-40.2
R10:	49.1
R11:	66.3
R12:	45.7
R13:	68.0
R14:	93.4
R15:	57.6

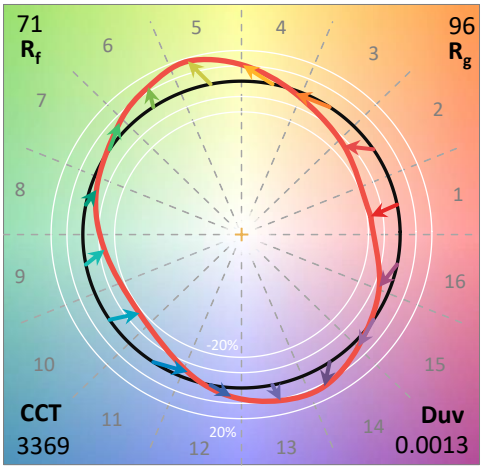

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-5

CIE 1931 Chromaticity Diagram

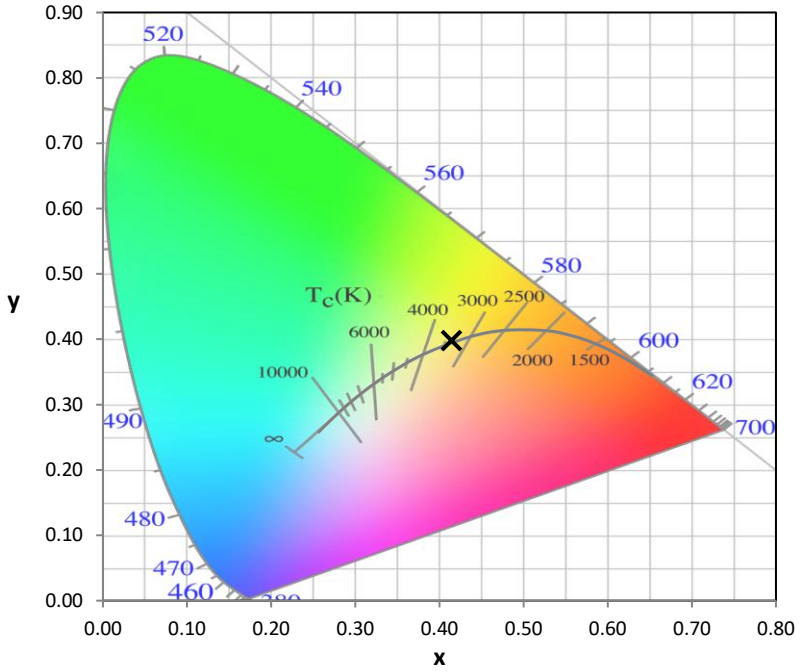

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

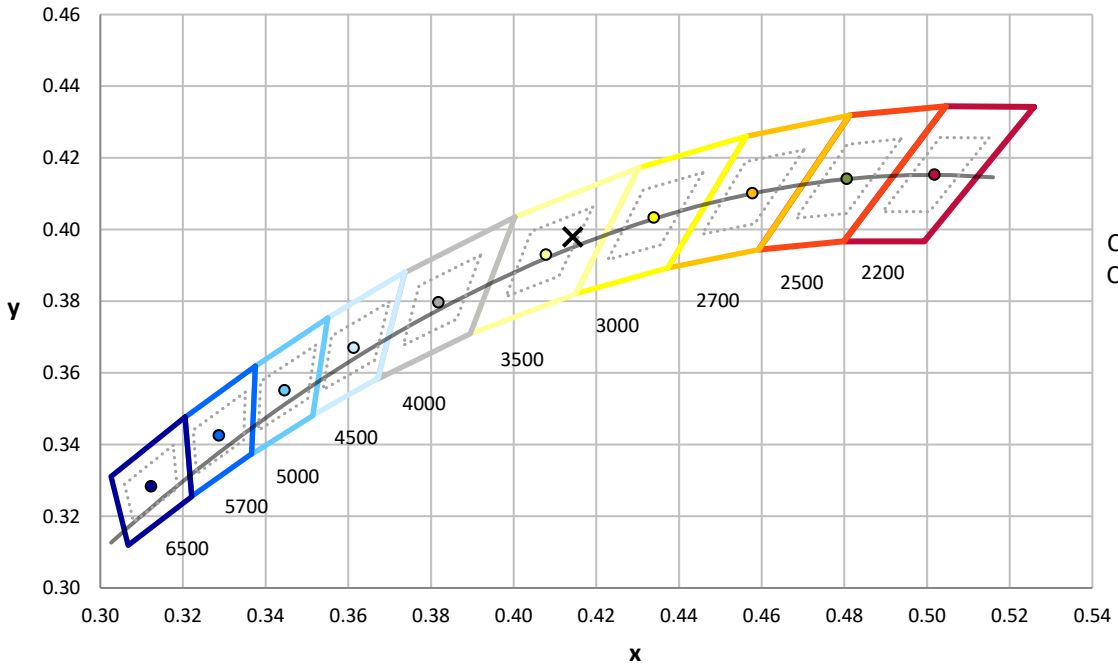


CCT = 3369K
CIE x = 0.4143
CIE y = 0.3980
Duv = 0.0013

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-5

Photopic Flux vs. Wavelength

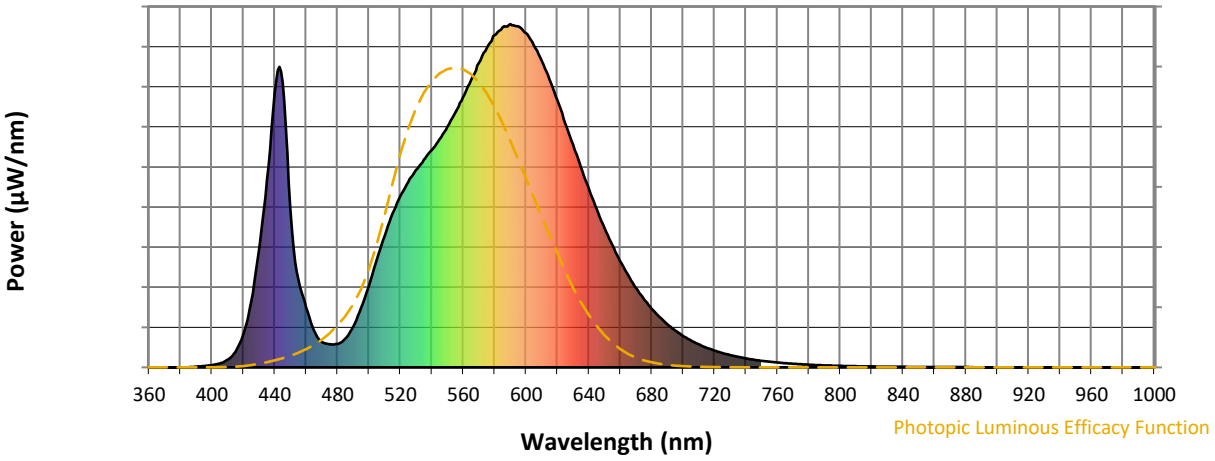


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Scotopic Flux vs. Wavelength

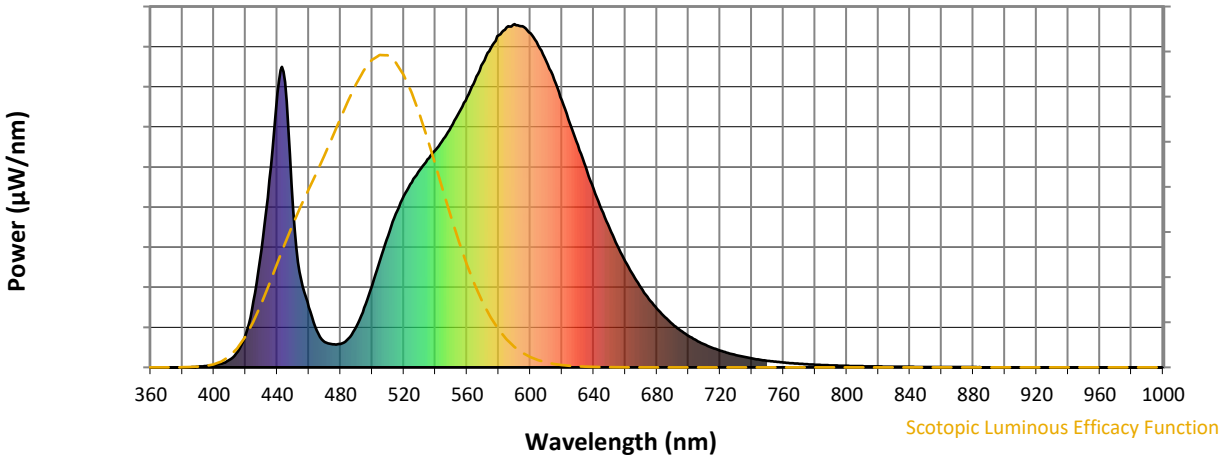


Scotopic Lumens: NR **S/P: 1.29**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Melanopic Flux vs. Wavelength

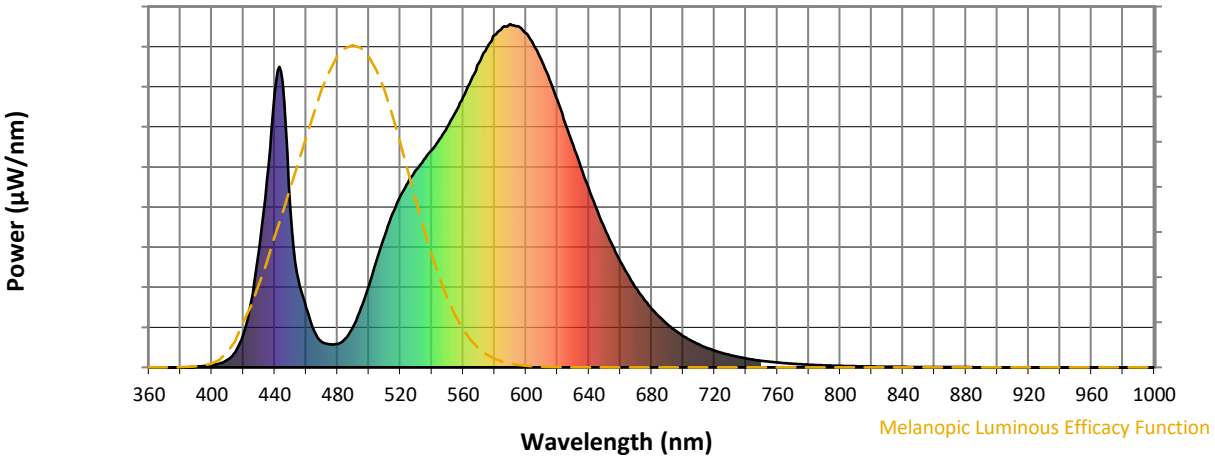

Melanopic Lumens: NR **M/P: 2.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			


REPORT NUMBER: SP1-2407-184-5

TM-30-18


Summary


R_f = 71.4
R_g = 96
CIE R_a = 70.1
R_9 = -40.2


Spectral Power Distribution Comparison

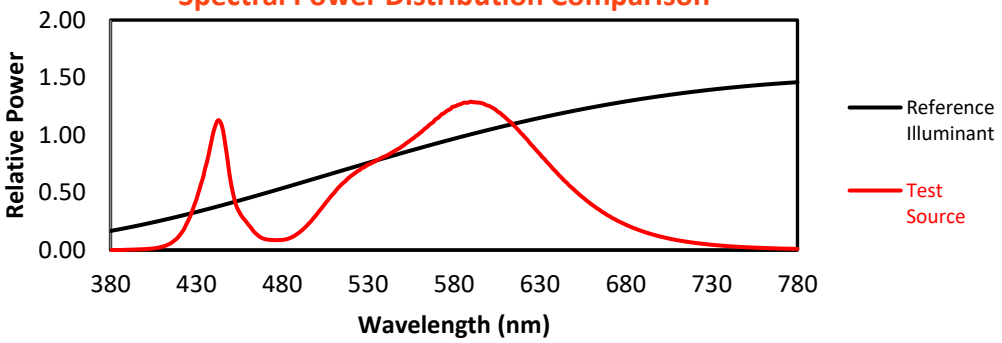


Color Vector Graphics

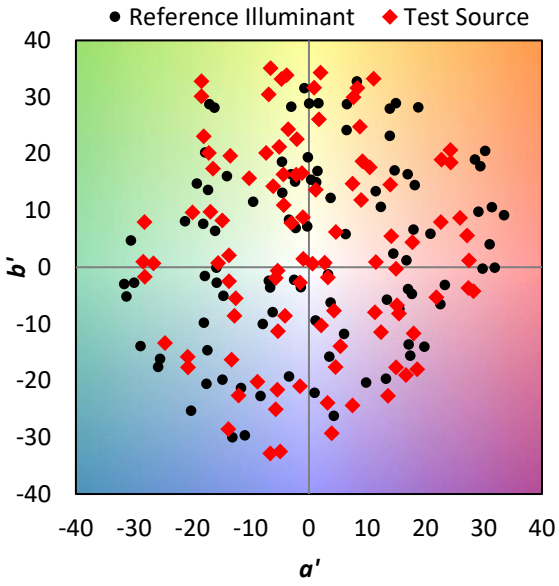

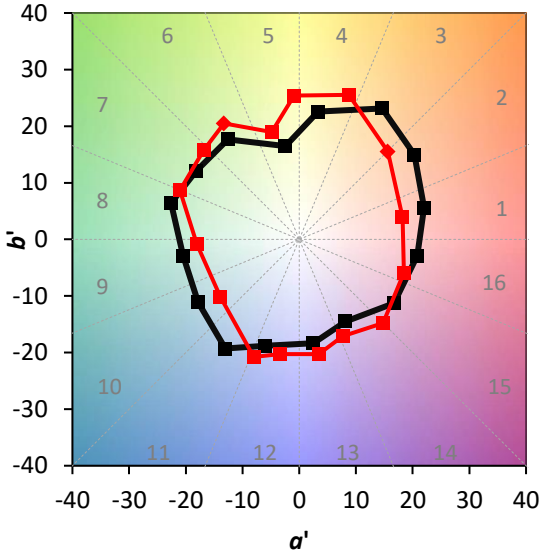

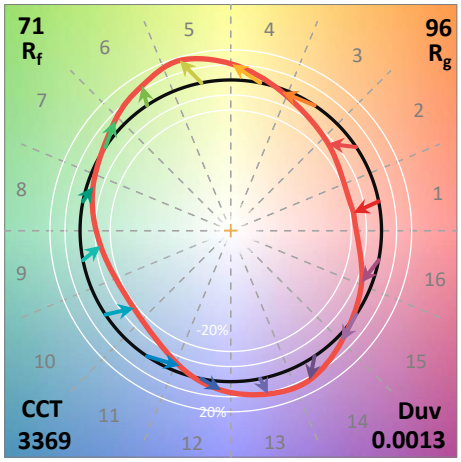

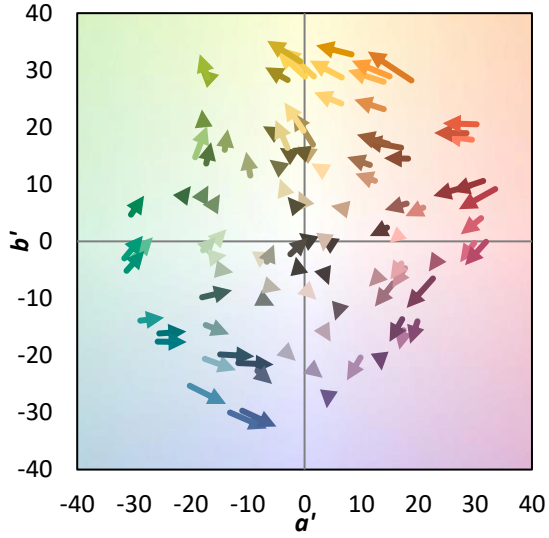


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 57	CES51 = 84	CES76 = 50
CES02 = 62	CES27 = 80	CES52 = 86	CES77 = 74
CES03 = 31	CES28 = 81	CES53 = 72	CES78 = 54
CES04 = 70	CES29 = 50	CES54 = 79	CES79 = 81
CES05 = 48	CES30 = 55	CES55 = 78	CES80 = 79
CES06 = 51	CES31 = 56	CES56 = 67	CES81 = 74
CES07 = 40	CES32 = 54	CES57 = 65	CES82 = 91
CES08 = 39	CES33 = 60	CES58 = 68	CES83 = 86
CES09 = 29	CES34 = 69	CES59 = 85	CES84 = 89
CES10 = 75	CES35 = 83	CES60 = 91	CES85 = 83
CES11 = 58	CES36 = 88	CES61 = 85	CES86 = 66
CES12 = 64	CES37 = 78	CES62 = 78	CES87 = 77
CES13 = 43	CES38 = 64	CES63 = 71	CES88 = 75
CES14 = 74	CES39 = 92	CES64 = 70	CES89 = 68
CES15 = 71	CES40 = 86	CES65 = 64	CES90 = 72
CES16 = 47	CES41 = 81	CES66 = 65	CES91 = 95
CES17 = 50	CES42 = 79	CES67 = 63	CES92 = 62
CES18 = 56	CES43 = 71	CES68 = 69	CES93 = 78
CES19 = 72	CES44 = 98	CES69 = 80	CES94 = 51
CES20 = 65	CES45 = 80	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 75	CES71 = 58	CES96 = 76
CES22 = 79	CES47 = 71	CES72 = 85	CES97 = 82
CES23 = 92	CES48 = 61	CES73 = 51	CES98 = 72
CES24 = 91	CES49 = 74	CES74 = 94	CES99 = 60
CES25 = 72	CES50 = 83	CES75 = 57	

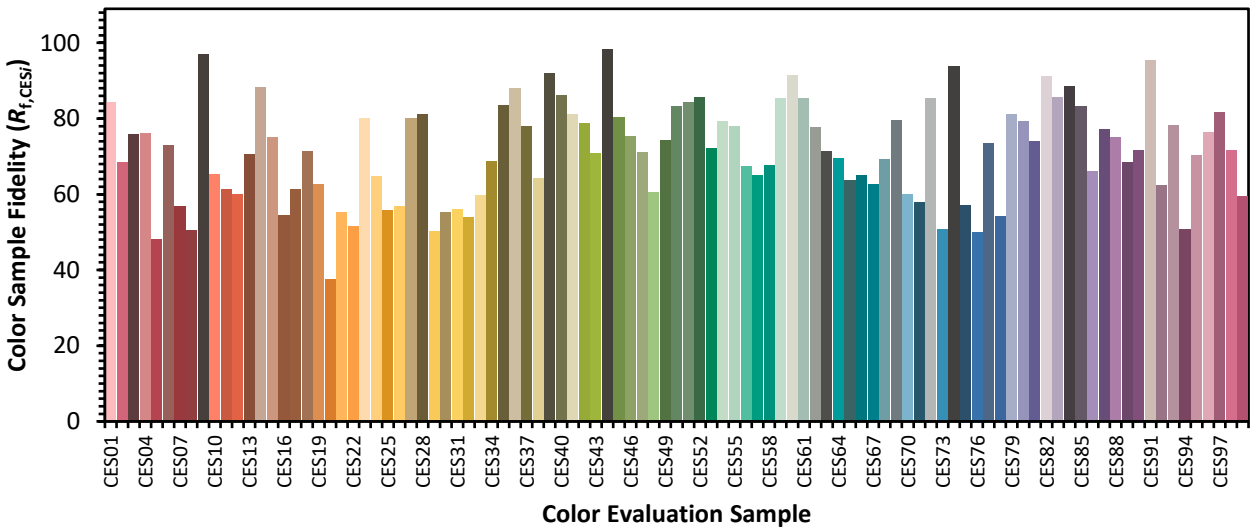



REPORT NUMBER: SP1-2407-184-5

TM-30-18

Color Rendition by Hue-Angle Bin

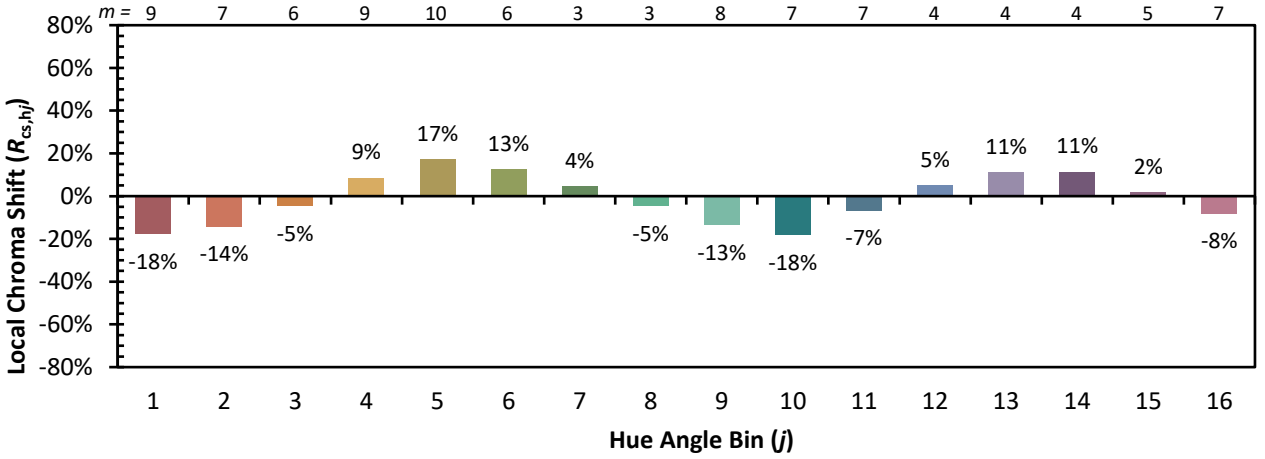

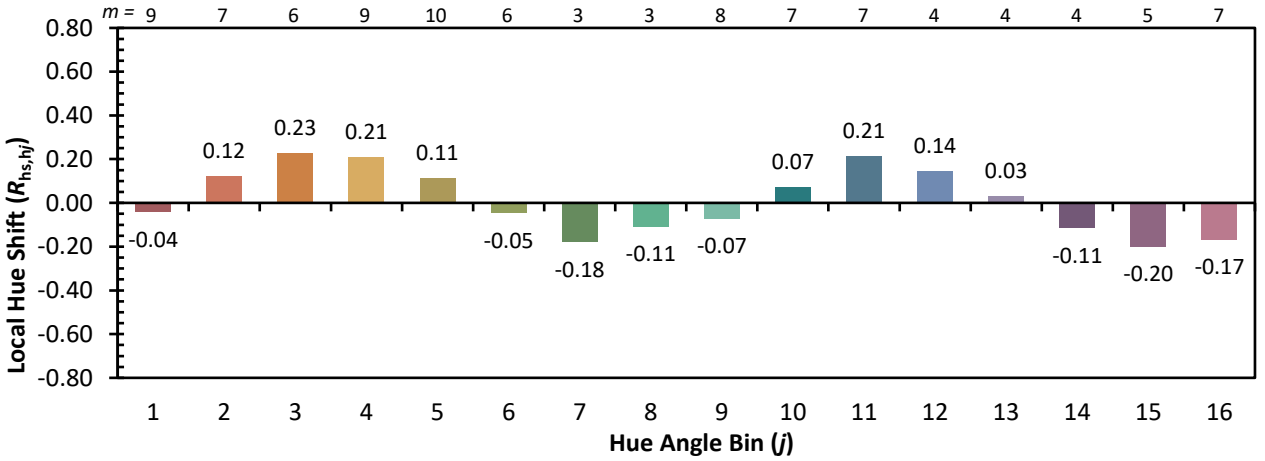


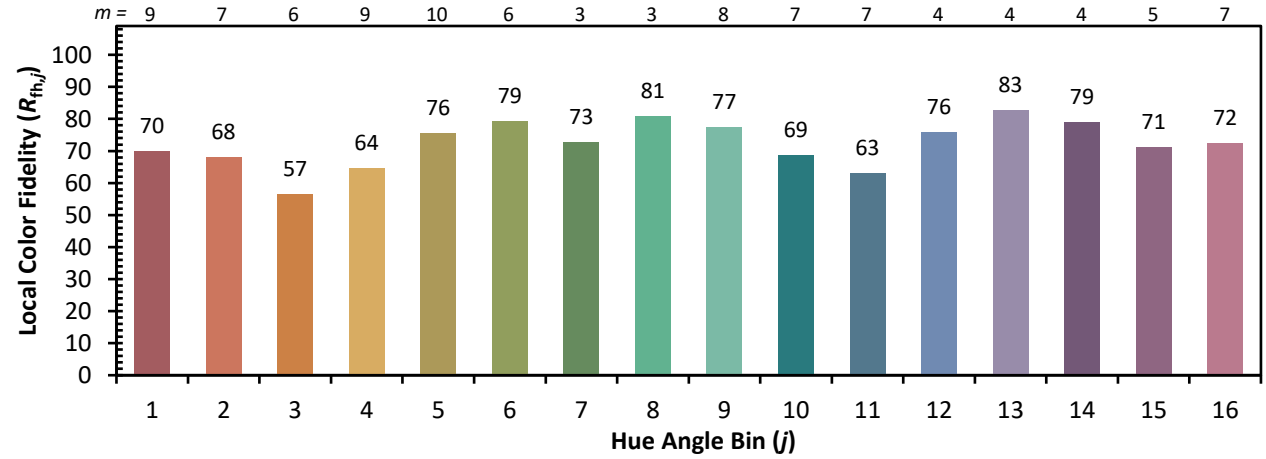


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Measure Comparisons

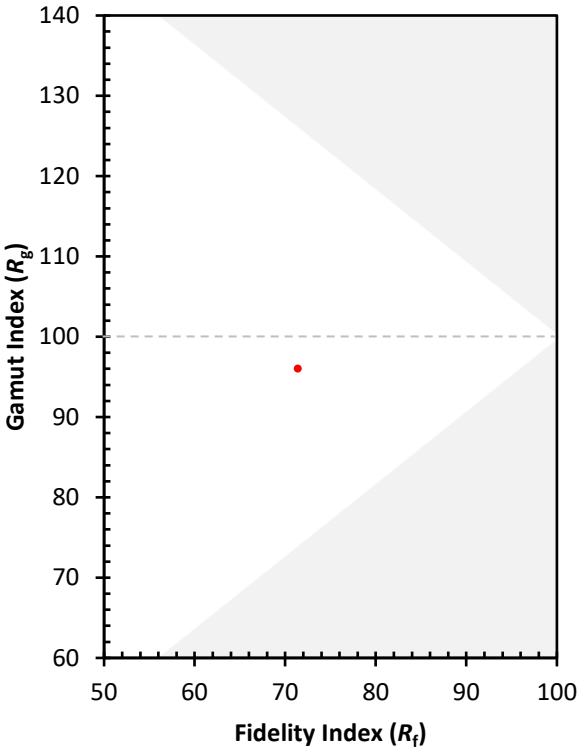

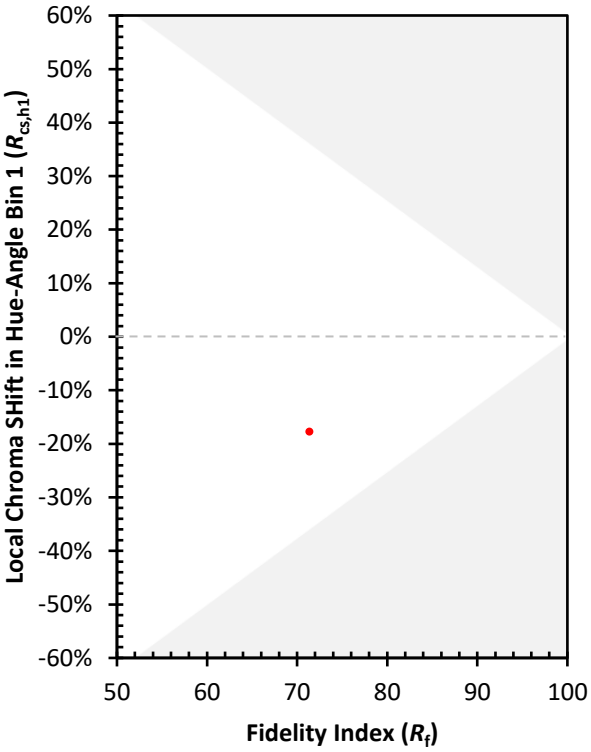

(END OF REPORT)