Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1358853

Luminaire Tested: **GSS-SB4C-735-U-SL4-HSS**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1358853
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB4C-735-U-SL4-HSS
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 4SQUARE 204W 70CRI 3500K FIXTURE w/ TYPE IV SPILL CONTROL DISTRIBUTION OPTIC AND HOUSE SIDE SHIELD
Light Source:	(104) 3500K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	18429.9 lumens
Efficiency:	N/A
Efficacy:	90.3 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 1' x H: 0')
IES Classification:	Type IV - Short
BUG Rating:	B2 - U0 - G3


Input Watts (W):	204
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	9.5%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358853
CATALOG NUMBER: GSS-SB4C-735-U-SL4-HSS

Iso-Footcandle Lines of Horizontal Illumination

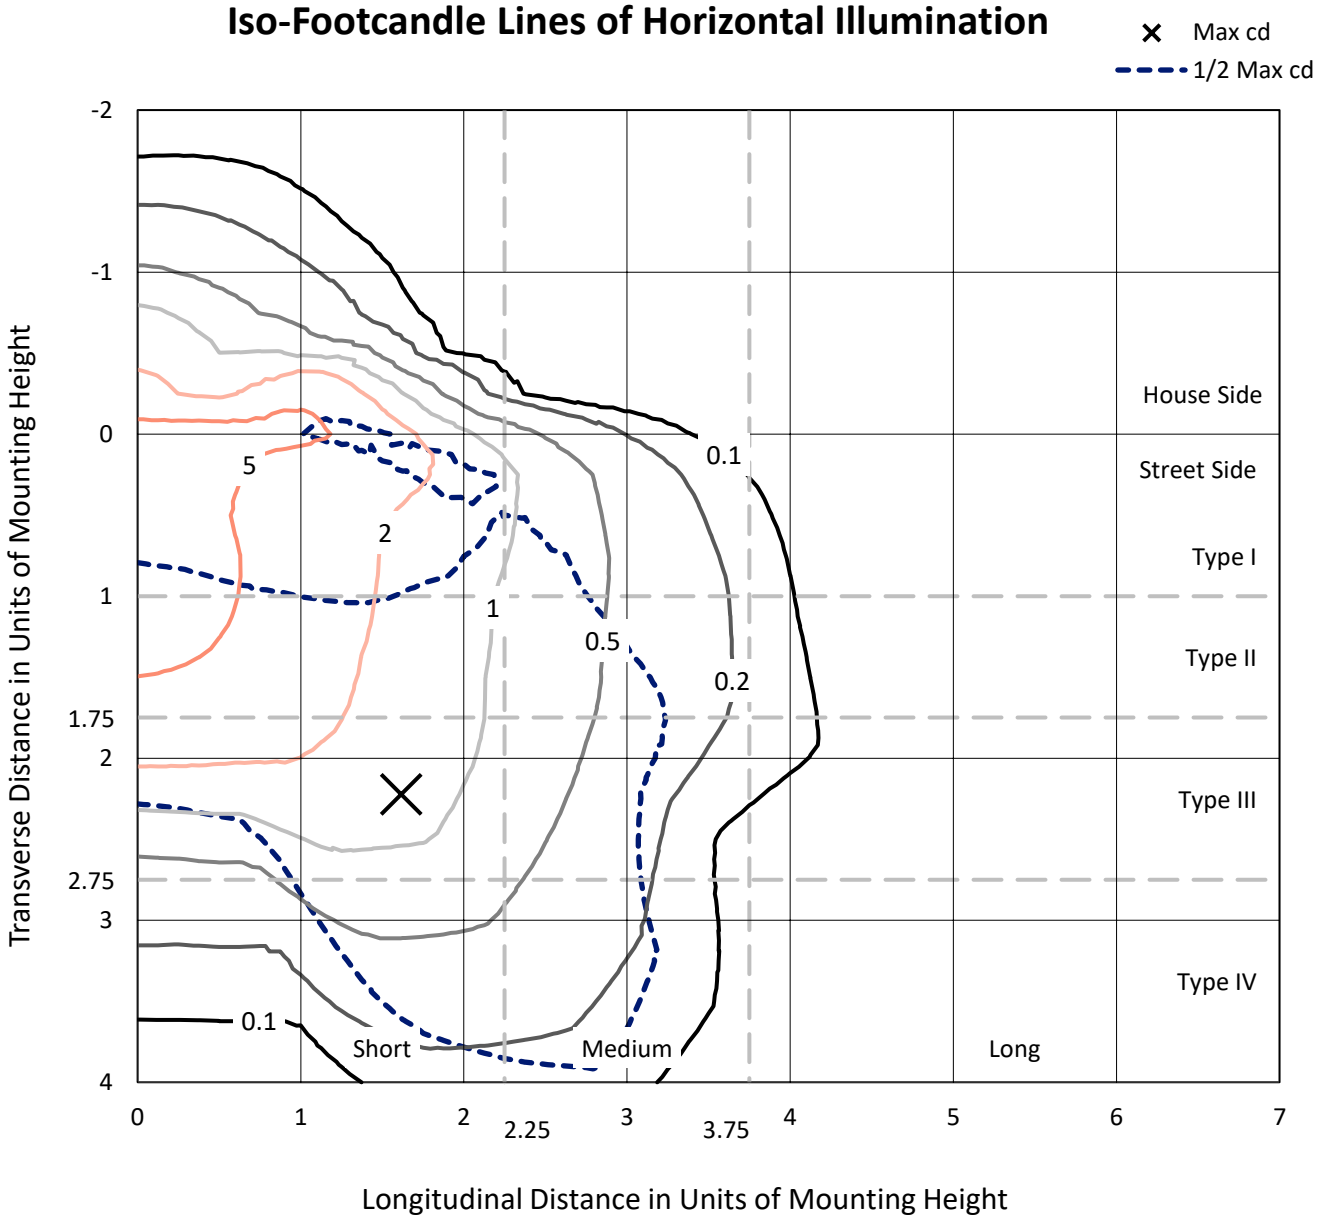


Based on 20 foot mounting height. Maximum calculated value = 8.2 fc
Type IV - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358853
CATALOG NUMBER: GSS-SB4C-735-U-SL4-HSS

Luminous Intensity Polar Plot

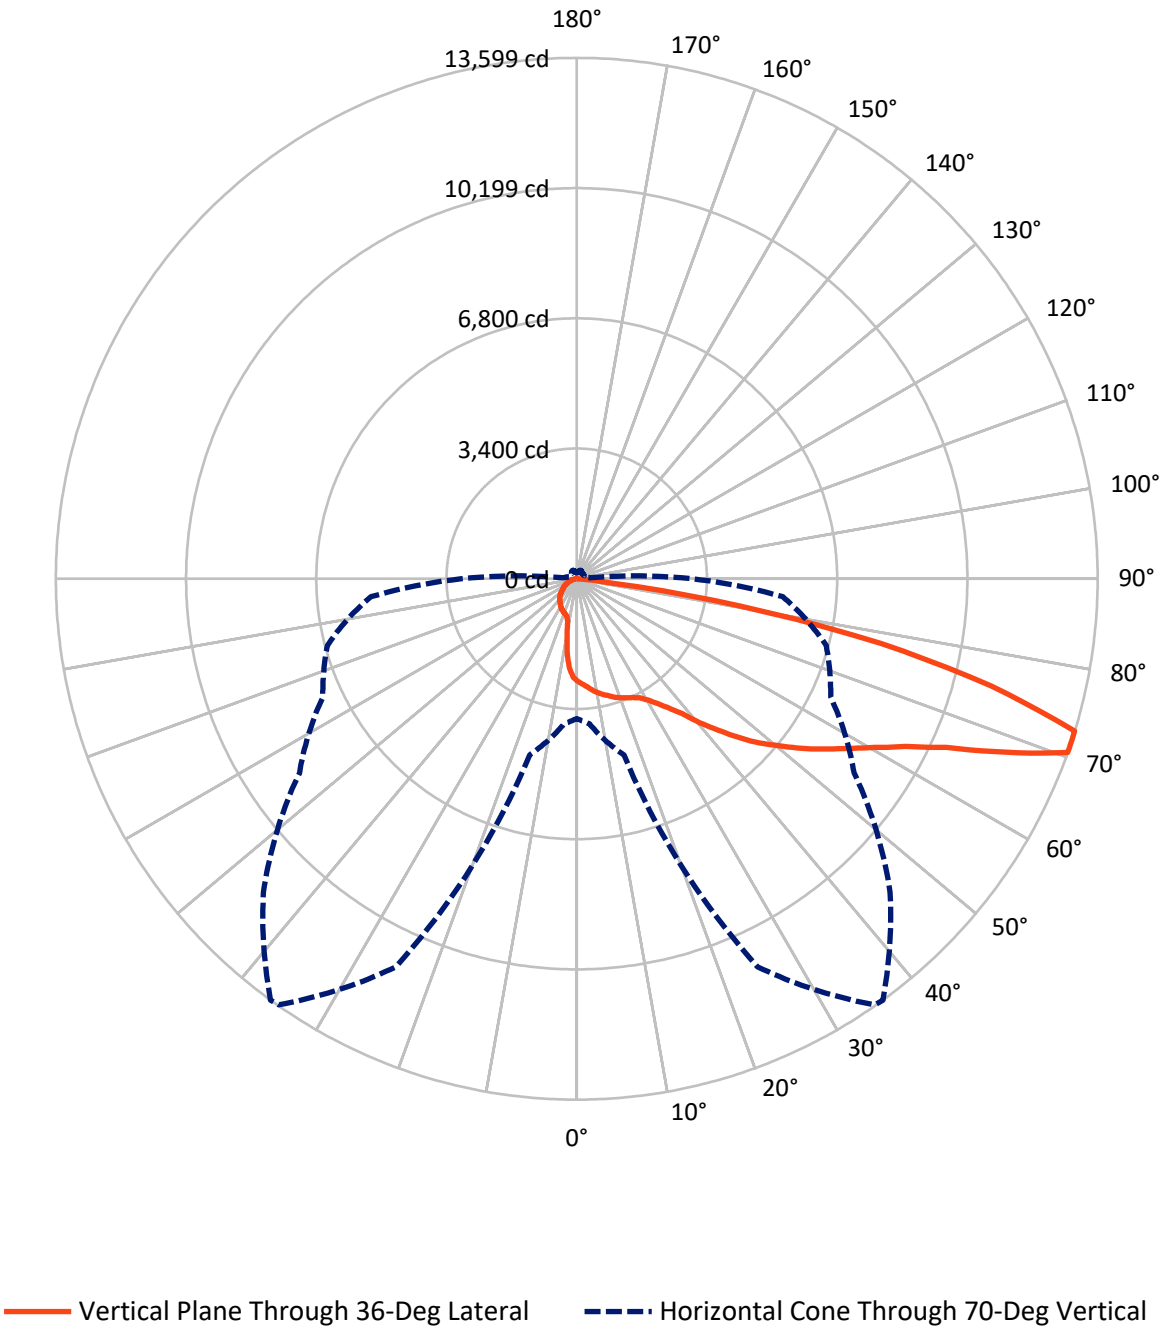

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1358853
CATALOG NUMBER: GSS-SB4C-735-U-SL4-HSS

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	2720.6	0.0	2720.6
	% Fixture	14.8	0.0	14.8
Street Side	Lumens	15709.3	0.0	15709.3
	% Fixture	85.2	0.0	85.2
Total	Lumens	18429.9	0.0	18429.9
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	243.6	1.3
10°-20°	675.3	3.7
20°-30°	1138.3	6.2
30°-40°	1818.1	9.9
40°-50°	2971.3	16.1
50°-60°	4009.0	21.8
60°-70°	4452.4	24.2
70°-80°	2947.7	16.0
80°-90°	174.2	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	18429.9	100.0
0°-180°	18429.9	100.0

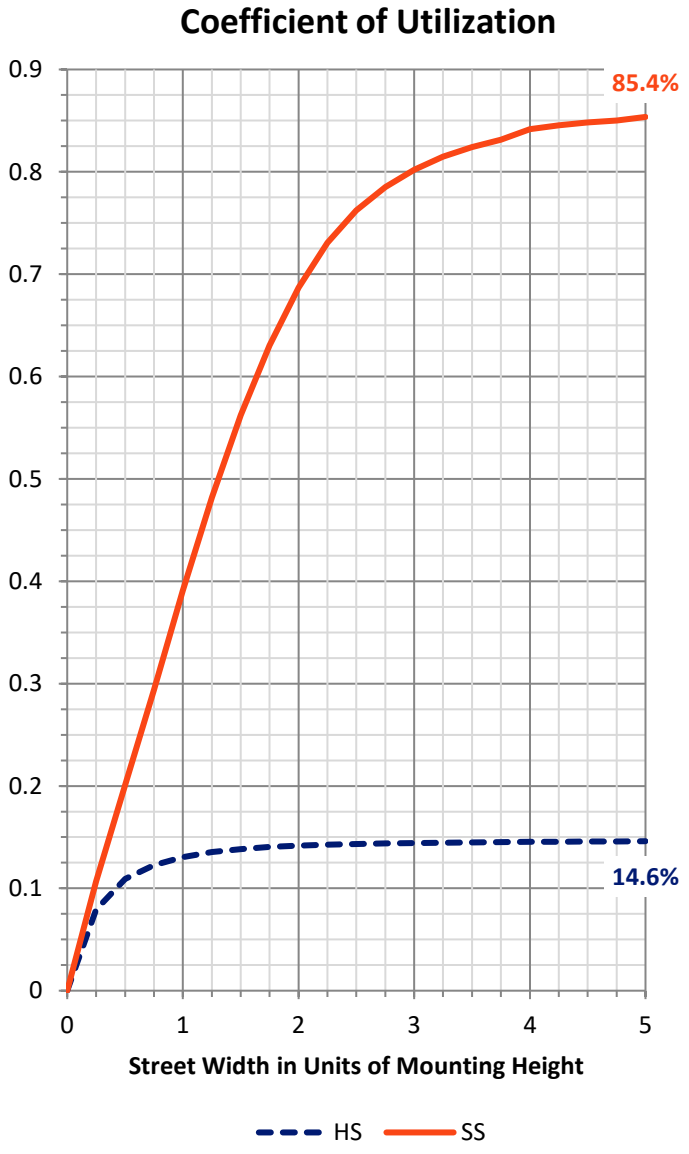

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1358853
CATALOG NUMBER: GSS-SB4C-735-U-SL4-HSS

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	1409.5	7.6			
FM	(30°-60°)	7091.8	38.5			
FH	(60°-80°)	7056.1	38.3			G3/7500
FVH	(80°-90°)	151.9	0.8			G2/225
BL	(0°-30°)	647.8	3.5	B2/1000		
BM	(30°-60°)	1706.6	9.3	B2/2500		
BH	(60°-80°)	344.0	1.9	B1/500		G1/500
BVH	(80°-90°)	22.3	0.1			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B2-U0-G3
Type IV Short

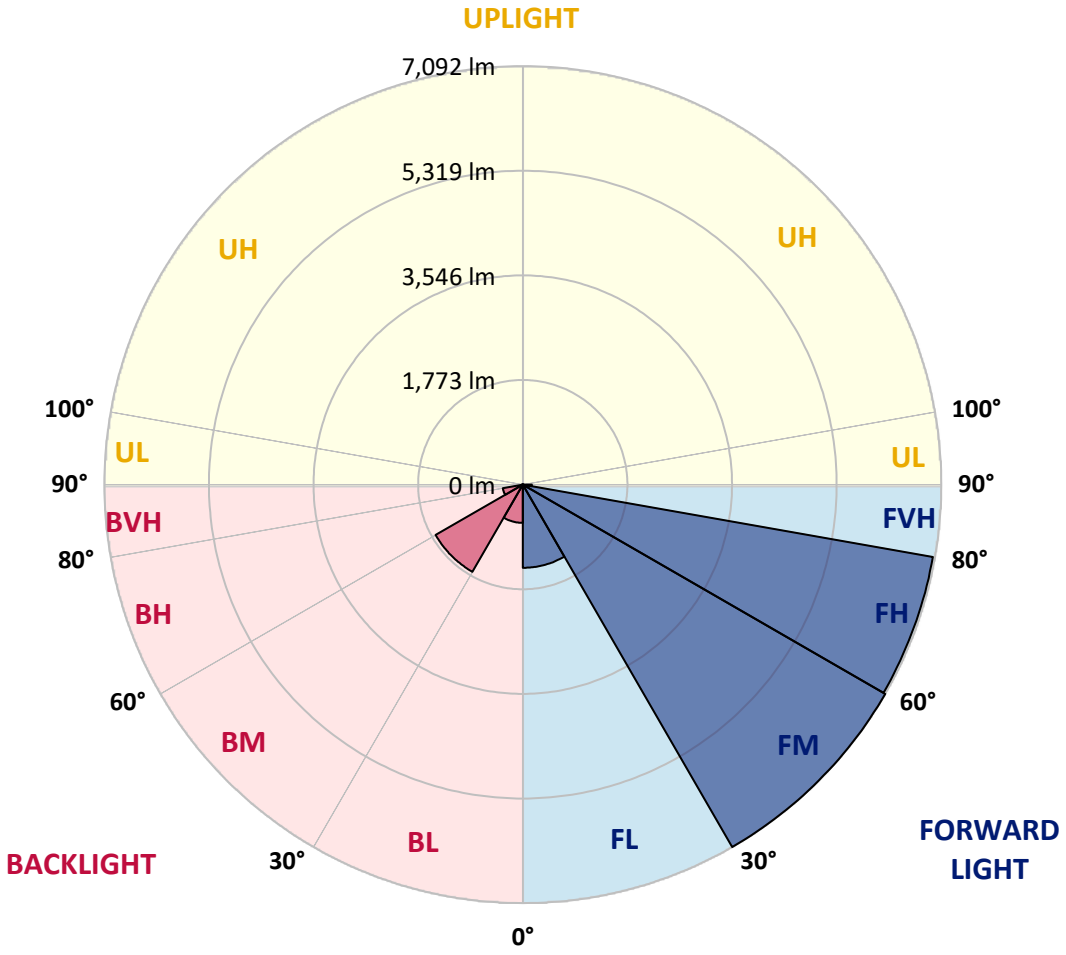

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358853
CATALOG NUMBER: GSS-SB4C-735-U-SL4-HSS

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	36°	45°	55°	65°	75°	85°
0°	2673.3	2673.3	2673.3	2673.3	2673.3	*2673.3*	2673.3	2673.3	2673.3	2673.3	2673.3
2.5°	2767.6	2742.5	2755.0	2761.3	2742.5	*2748.7*	2736.2	2729.9	2704.7	2723.6	2698.4
5°	2868.3	2862.0	2855.7	2855.7	2836.8	*2830.5*	2811.6	2799.1	2773.9	2755.0	2723.6
7.5°	2987.8	2950.0	2943.7	2956.3	2918.6	*2937.4*	2918.6	2899.7	2855.7	2805.4	2755.0
10°	3082.1	3063.2	3038.1	3031.8	3038.1	*3025.5*	3006.6	2987.8	2962.6	2899.7	2843.1
12.5°	3189.0	3176.5	3151.3	3138.7	3094.7	*3101.0*	3101.0	3075.8	3038.1	3000.3	2937.4
15°	3308.6	3258.2	3245.7	3214.2	3189.0	*3170.2*	3176.5	3182.8	3138.7	3101.0	3038.1
17.5°	3365.2	3352.6	3321.1	3283.4	3283.4	*3258.2*	3251.9	3251.9	3233.1	3220.5	3145.0
20°	3453.2	3440.7	3384.0	3352.6	3321.1	*3314.8*	3333.7	3333.7	3302.3	3296.0	3283.4
22.5°	3585.3	3547.6	3472.1	3421.8	3384.0	*3377.8*	3402.9	3396.6	3396.6	3402.9	3428.1
25°	3711.1	3667.1	3585.3	3503.6	3421.8	*3434.4*	3465.8	3472.1	3446.9	3484.7	3579.0
27.5°	3899.8	3893.5	3767.7	3604.2	3528.7	*3522.4*	3535.0	3522.4	3497.3	3541.3	3717.4
30°	4396.7	4340.1	4132.6	3830.6	3660.8	*3673.4*	3654.5	3579.0	3516.1	3566.5	3849.5
32.5°	4881.1	4749.0	4535.1	4189.2	3874.7	*3881.0*	3748.9	3604.2	3535.0	3591.6	3981.6
35°	5585.6	5447.2	5126.4	4522.5	4201.7	*4145.1*	3874.7	3698.5	3572.7	3635.6	4132.6
37.5°	6579.4	6378.1	5944.1	5183.0	4491.1	*4465.9*	4094.8	3780.3	3604.2	3629.4	4333.8
40°	7346.8	7151.8	6799.5	5881.2	4988.0	*4937.7*	4440.8	3937.6	3610.5	3660.8	4522.5
42.5°	8013.5	7912.9	7441.1	6497.6	5503.8	*5396.9*	4774.1	4132.6	3742.6	3742.6	4837.0
45°	8906.7	8718.0	8183.3	7076.3	6019.6	*5900.1*	5214.4	4440.8	3906.1	3836.9	5164.1
47.5°	9692.9	9535.7	8913.0	7623.5	6510.2	*6409.5*	5635.9	4774.1	4113.7	4006.8	5547.8
50°	10554.7	10391.1	9674.1	8277.7	6994.5	*6849.9*	6101.3	5082.4	4365.3	4270.9	6007.0
52.5°	11152.2	11013.9	10296.8	8869.0	7460.0	*7359.3*	6478.7	5396.9	4660.9	4566.6	6447.3
55°	11548.5	11328.4	10630.2	9384.7	7975.8	*7850.0*	6818.4	5749.1	4994.3	4962.8	6824.7
57.5°	11737.2	11517.1	10925.8	9837.6	8485.3	*8346.9*	7239.8	6132.8	5428.3	5453.5	7227.3
60°	11636.6	11473.0	11039.0	10265.3	9051.4	*8938.1*	7642.4	6573.1	5874.9	5981.8	7416.0
62.5°	10894.3	10932.1	11051.6	10900.6	9774.7	*9636.3*	8227.4	7132.9	6485.0	6503.9	7397.1
65°	8428.7	8585.9	9957.1	11636.6	10787.4	*10605.0*	9032.5	7837.4	6900.2	6686.3	6906.5
67.5°	5359.1	5692.5	7202.1	12045.4	12202.7	*12089.5*	10095.5	8416.1	7000.8	6956.8	6459.9
70°	*3648.2*	*3799.2*	*4761.6*	*11177.4*	*13580.2*	*13599.1*	*11567.4*	*8837.5*	*7315.3*	*6742.9*	*5396.9*
72.5°	2868.3	2880.8	3365.2	10070.4	13523.6	*13592.8*	11460.4	9277.8	7095.2	6007.0	4113.7
75°	1924.8	1975.1	2295.9	8214.8	11234.0	*11177.4*	9359.6	7126.6	6472.4	4749.0	2667.0
77.5°	540.9	559.8	956.1	5233.3	7875.1	*8114.1*	6793.2	2446.8	4503.7	2176.4	1006.4
80°	163.5	176.1	390.0	1503.3	3767.7	*4315.0*	3535.0	735.9	1088.2	515.8	201.3
82.5°	69.2	75.5	232.7	346.0	861.7	*930.9*	830.3	195.0	339.7	163.5	69.2
85°	25.2	31.5	75.5	81.8	132.1	*119.5*	94.4	62.9	88.1	75.5	37.7
87.5°	0.0	6.3	6.3	12.6	18.9	*18.9*	25.2	25.2	25.2	25.2	25.2
90°	0.0	0.0	0.0	0.0	0.0	*0.0*	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358853
CATALOG NUMBER: GSS-SB4C-735-U-SL4-HSS

CANDELA DISTRIBUTION (continued):

	90°	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
0°	2673.3	2673.3	2673.3	2673.3	2673.3	2673.3	2673.3	2673.3	2673.3	2673.3	2673.3
2.5°	2679.6	2673.3	2648.1	2616.7	2597.8	2591.5	2572.6	2534.9	2547.5	2553.8	2522.3
5°	2704.7	2660.7	2610.4	2547.5	2478.3	2421.7	2346.2	2289.6	2251.8	2245.5	2239.3
7.5°	2729.9	2692.1	2604.1	2465.7	2327.3	2182.6	1987.7	1849.3	1748.6	1698.3	1717.2
10°	2811.6	2748.7	2597.8	2383.9	2088.3	1773.8	1490.7	1327.2	1232.8	1188.8	1169.9
12.5°	2893.4	2805.4	2597.8	2239.3	1736.1	1339.8	1113.3	1063.0	1063.0	1075.6	1069.3
15°	3000.3	2899.7	2616.7	2019.1	1377.5	1050.4	1012.7	1019.0	1037.9	1050.4	1050.4
17.5°	3119.9	3044.4	2616.7	1742.3	1075.6	975.0	981.2	1000.1	1019.0	1025.3	1031.6
20°	3289.7	3182.8	2534.9	1421.5	943.5	943.5	956.1	968.7	993.8	1006.4	1012.7
22.5°	3446.9	3327.4	2383.9	1132.2	905.8	912.1	937.2	949.8	975.0	987.5	981.2
25°	3641.9	3528.7	2220.4	918.3	868.0	880.6	899.5	918.3	956.1	968.7	968.7
27.5°	3855.8	3755.2	2094.6	899.5	830.3	849.2	880.6	905.8	937.2	949.8	949.8
30°	4088.5	3987.9	2019.1	968.7	811.4	805.1	842.9	861.7	899.5	930.9	937.2
32.5°	4333.8	4176.6	1993.9	1107.0	824.0	773.7	805.1	830.3	880.6	918.3	918.3
35°	4686.1	4459.6	1993.9	1258.0	874.3	742.2	767.4	798.8	855.4	893.2	893.2
37.5°	5120.1	4906.2	2188.9	1364.9	918.3	717.1	729.6	761.1	805.1	855.4	861.7
40°	5635.9	5535.2	2704.7	1434.1	943.5	691.9	704.5	717.1	742.2	792.5	805.1
42.5°	6189.4	6082.5	3440.7	1503.3	930.9	673.0	666.7	666.7	679.3	710.8	717.1
45°	6724.1	6573.1	4101.1	1478.2	874.3	635.3	622.7	603.8	603.8	629.0	629.0
47.5°	7195.8	6925.3	4421.9	1308.3	805.1	597.6	572.4	540.9	540.9	553.5	553.5
50°	7497.7	6912.8	4220.6	1037.9	704.5	559.8	522.1	496.9	490.6	496.9	490.6
52.5°	7541.8	6472.4	3472.1	805.1	610.1	515.8	471.8	459.2	452.9	452.9	452.9
55°	7246.1	5661.0	2440.5	616.4	534.7	465.5	434.0	427.7	421.4	415.1	408.9
57.5°	6736.6	4484.8	1490.7	496.9	484.3	421.4	402.6	396.3	383.7	364.8	358.5
60°	6057.3	3302.3	786.3	421.4	421.4	371.1	371.1	371.1	339.7	314.5	301.9
62.5°	5302.5	2226.7	440.3	358.5	352.2	333.4	339.7	333.4	301.9	257.9	251.6
65°	4459.6	1264.3	295.6	295.6	301.9	289.3	301.9	295.6	251.6	207.6	195.0
67.5°	3849.5	660.5	232.7	251.6	251.6	239.0	257.9	264.2	226.4	182.4	169.8
70°	*3012.9*	*333.4*	*188.7*	*207.6*	*207.6*	*188.7*	*226.4*	*245.3*	*207.6*	*157.3*	*151.0*
72.5°	2126.0	207.6	157.3	163.5	157.3	144.7	195.0	220.2	182.4	132.1	125.8
75°	1295.7	138.4	119.5	132.1	113.2	113.2	169.8	195.0	157.3	106.9	100.6
77.5°	603.8	100.6	88.1	94.4	81.8	88.1	138.4	151.0	113.2	88.1	81.8
80°	151.0	69.2	69.2	62.9	62.9	69.2	100.6	94.4	81.8	75.5	69.2
82.5°	62.9	50.3	44.0	44.0	44.0	50.3	62.9	62.9	69.2	62.9	62.9
85°	31.5	31.5	31.5	31.5	37.7	37.7	50.3	56.6	56.6	56.6	50.3
87.5°	18.9	18.9	18.9	18.9	18.9	25.2	31.5	37.7	44.0	25.2	18.9
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-5

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-735-U-5WQ

Data in this report applies to families of products including GSS-SB1A-735-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-735-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 3500K CCT 26 LEDS

Spectral Parameters

CCT (K):	3369
CIE u':	0.2386
CIE v':	0.5156
Duv:	0.0013
CIE x:	0.4143
CIE y:	0.3980
CIE z:	0.1877
Peak Wavelength (nm):	590
Dominant Wavelength (nm):	580
Purity:	43.80166
Rf:	71.4
Rg:	96

CRI (Ra):	70.1
R1:	66.6
R2:	77.6
R3:	88.5
R4:	69.5
R5:	66.4
R6:	69.6
R7:	77.5
R8:	44.9
R9:	-40.2
R10:	49.1
R11:	66.3
R12:	45.7
R13:	68.0
R14:	93.4
R15:	57.6

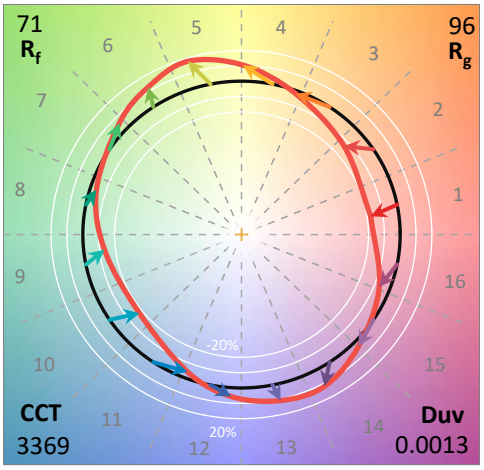

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-5

CIE 1931 Chromaticity Diagram

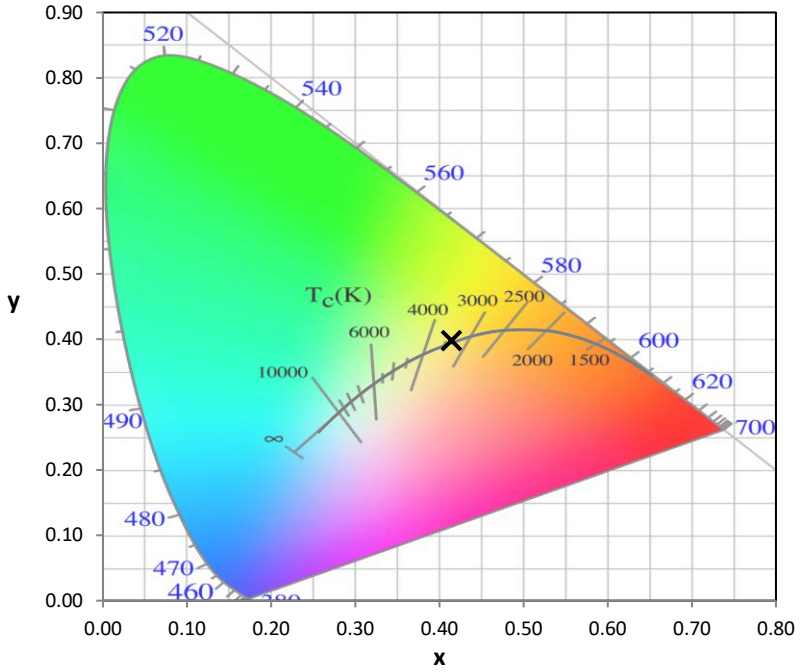

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

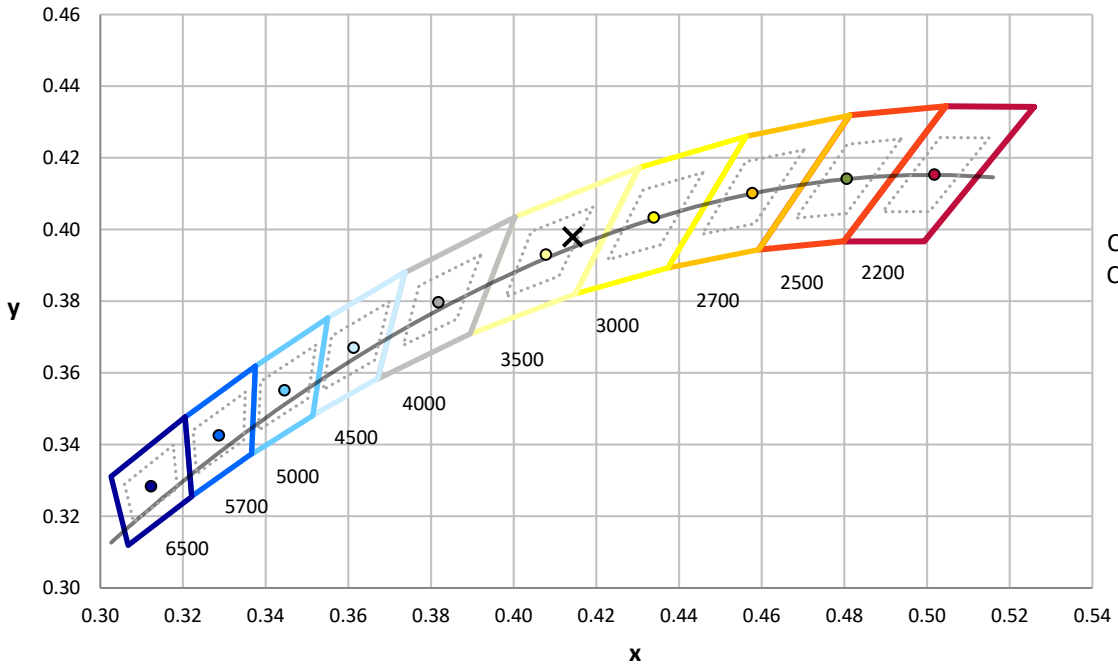


CCT = 3369K
CIE x = 0.4143
CIE y = 0.3980
Duv = 0.0013

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-5

Photopic Flux vs. Wavelength

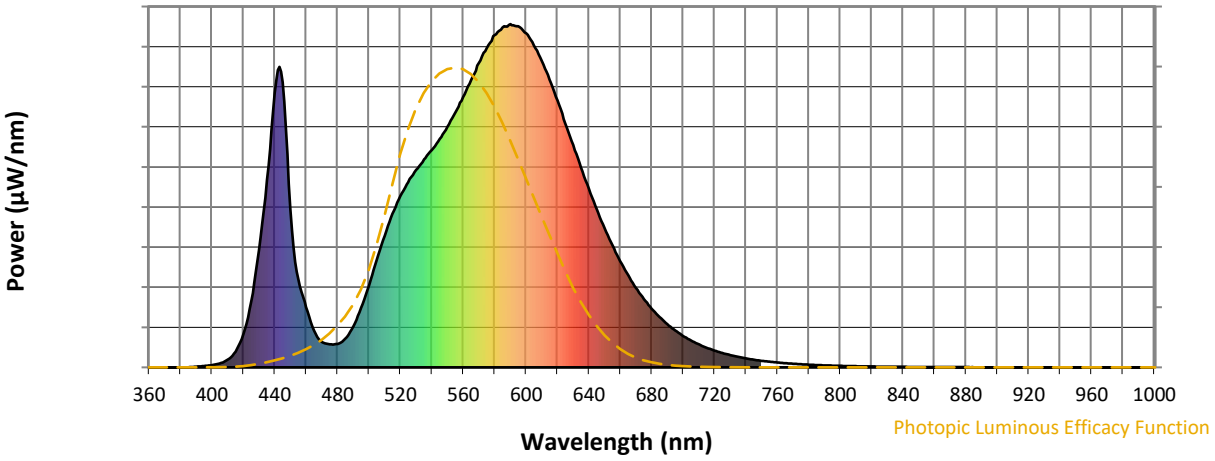


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Scotopic Flux vs. Wavelength

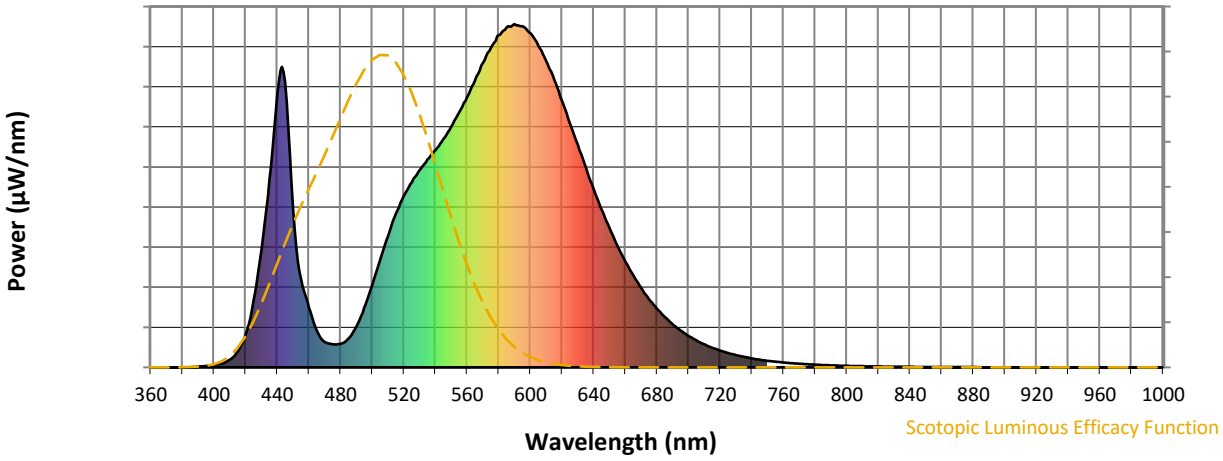


Scotopic Lumens: NR **S/P: 1.29**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Melanopic Flux vs. Wavelength

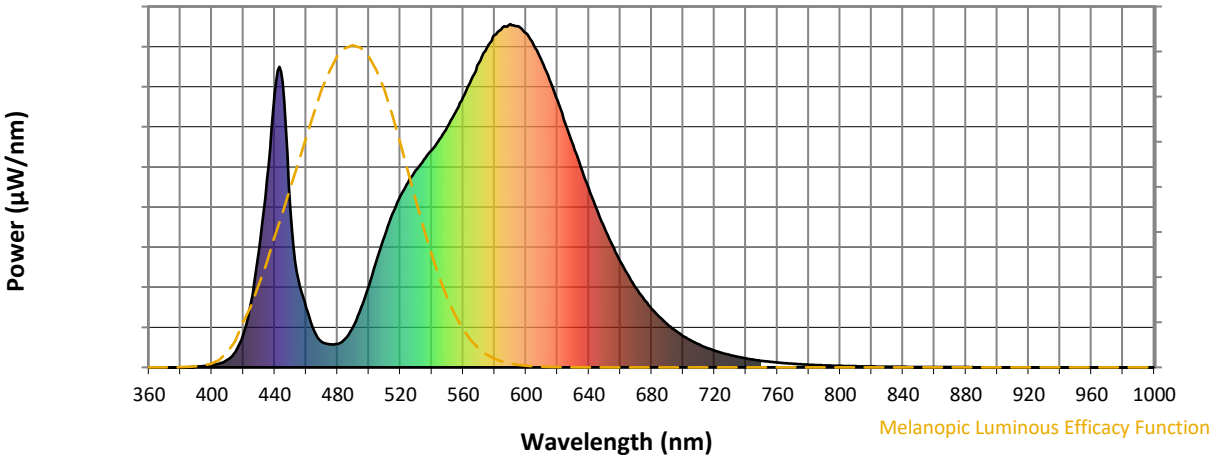

Melanopic Lumens: NR **M/P: 2.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			


REPORT NUMBER: SP1-2407-184-5

TM-30-18


Summary


R_f = 71.4
R_g = 96
CIE R_a = 70.1
R_9 = -40.2


Spectral Power Distribution Comparison

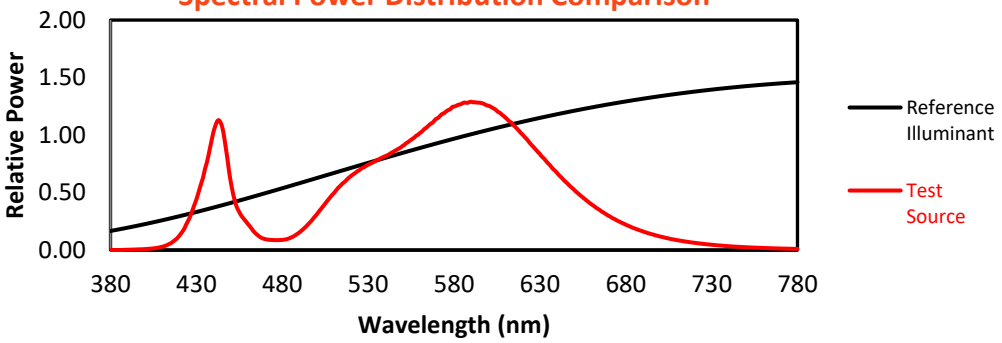


Color Vector Graphics

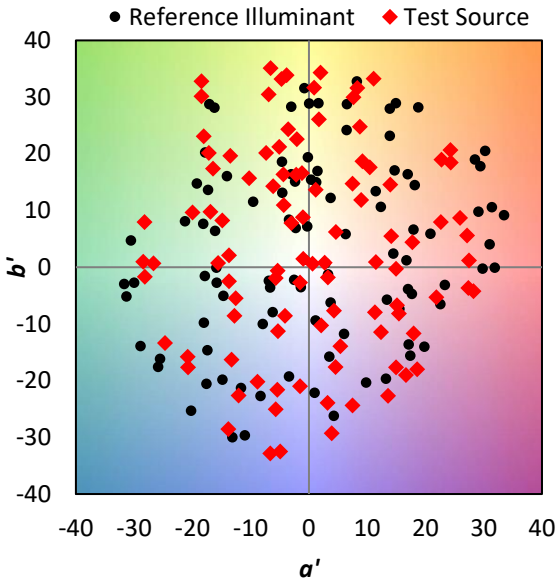

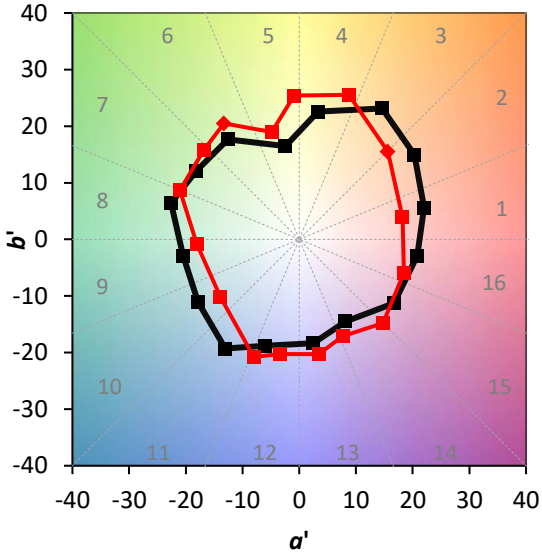

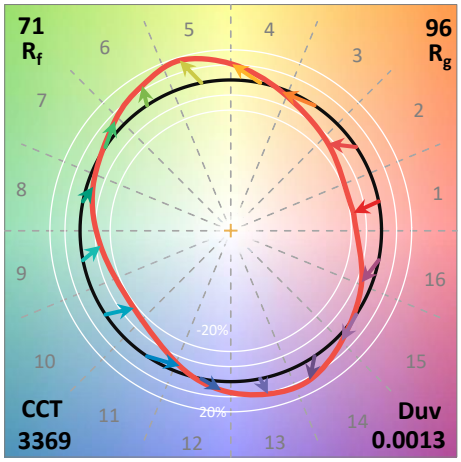

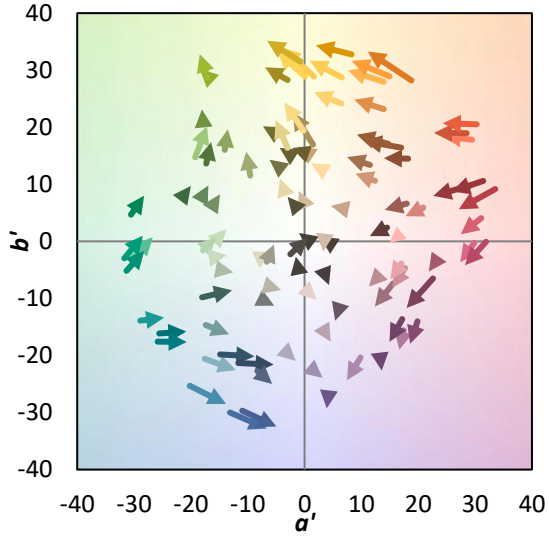


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 57	CES51 = 84	CES76 = 50
CES02 = 62	CES27 = 80	CES52 = 86	CES77 = 74
CES03 = 31	CES28 = 81	CES53 = 72	CES78 = 54
CES04 = 70	CES29 = 50	CES54 = 79	CES79 = 81
CES05 = 48	CES30 = 55	CES55 = 78	CES80 = 79
CES06 = 51	CES31 = 56	CES56 = 67	CES81 = 74
CES07 = 40	CES32 = 54	CES57 = 65	CES82 = 91
CES08 = 39	CES33 = 60	CES58 = 68	CES83 = 86
CES09 = 29	CES34 = 69	CES59 = 85	CES84 = 89
CES10 = 75	CES35 = 83	CES60 = 91	CES85 = 83
CES11 = 58	CES36 = 88	CES61 = 85	CES86 = 66
CES12 = 64	CES37 = 78	CES62 = 78	CES87 = 77
CES13 = 43	CES38 = 64	CES63 = 71	CES88 = 75
CES14 = 74	CES39 = 92	CES64 = 70	CES89 = 68
CES15 = 71	CES40 = 86	CES65 = 64	CES90 = 72
CES16 = 47	CES41 = 81	CES66 = 65	CES91 = 95
CES17 = 50	CES42 = 79	CES67 = 63	CES92 = 62
CES18 = 56	CES43 = 71	CES68 = 69	CES93 = 78
CES19 = 72	CES44 = 98	CES69 = 80	CES94 = 51
CES20 = 65	CES45 = 80	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 75	CES71 = 58	CES96 = 76
CES22 = 79	CES47 = 71	CES72 = 85	CES97 = 82
CES23 = 92	CES48 = 61	CES73 = 51	CES98 = 72
CES24 = 91	CES49 = 74	CES74 = 94	CES99 = 60
CES25 = 72	CES50 = 83	CES75 = 57	

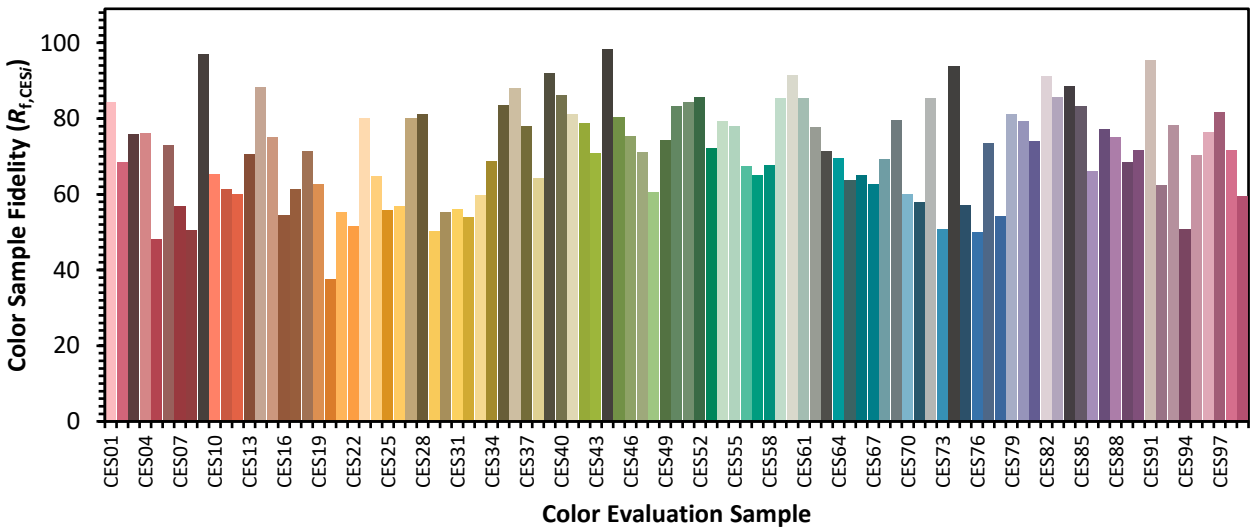



REPORT NUMBER: SP1-2407-184-5

TM-30-18

Color Rendition by Hue-Angle Bin

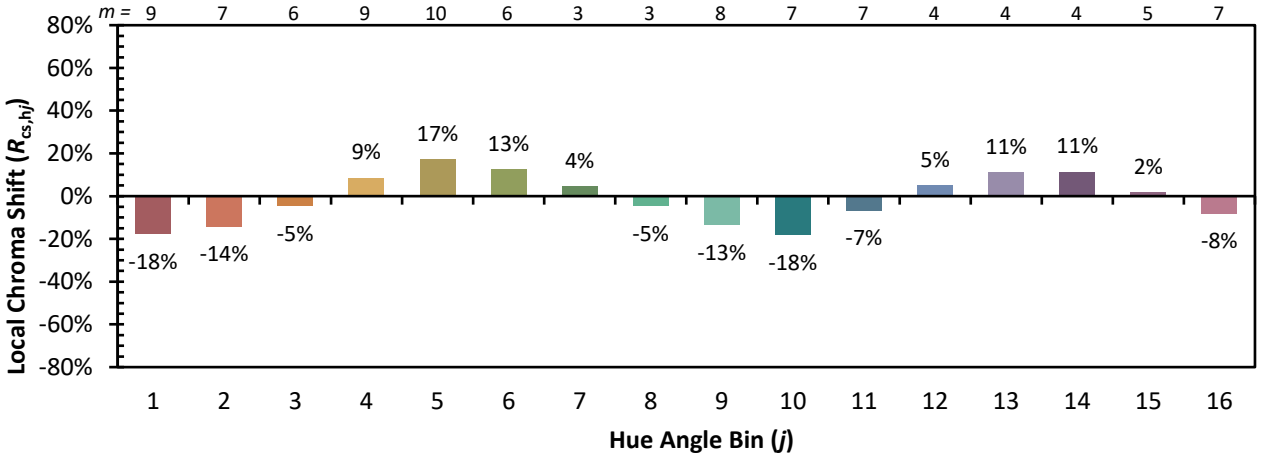

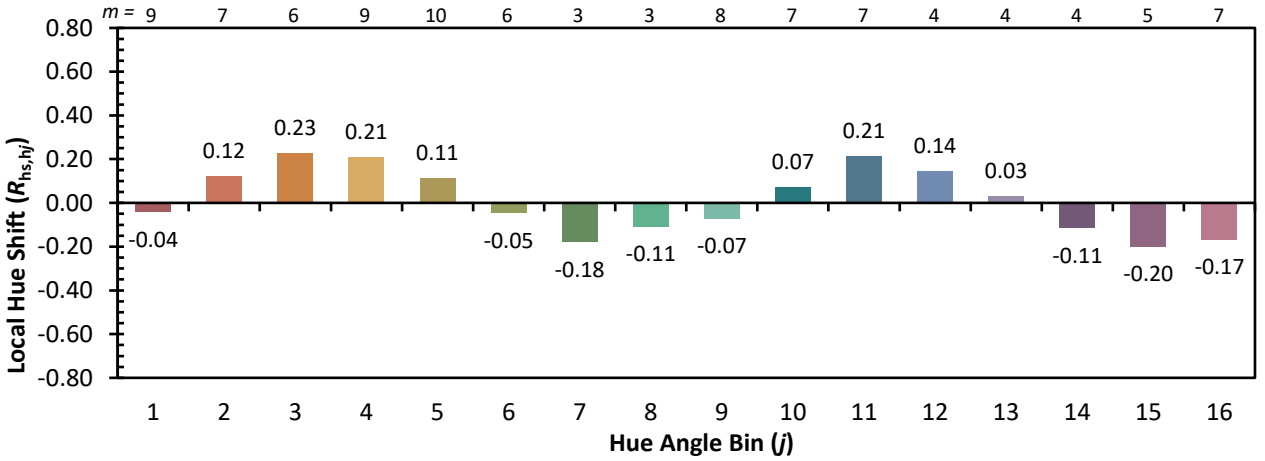


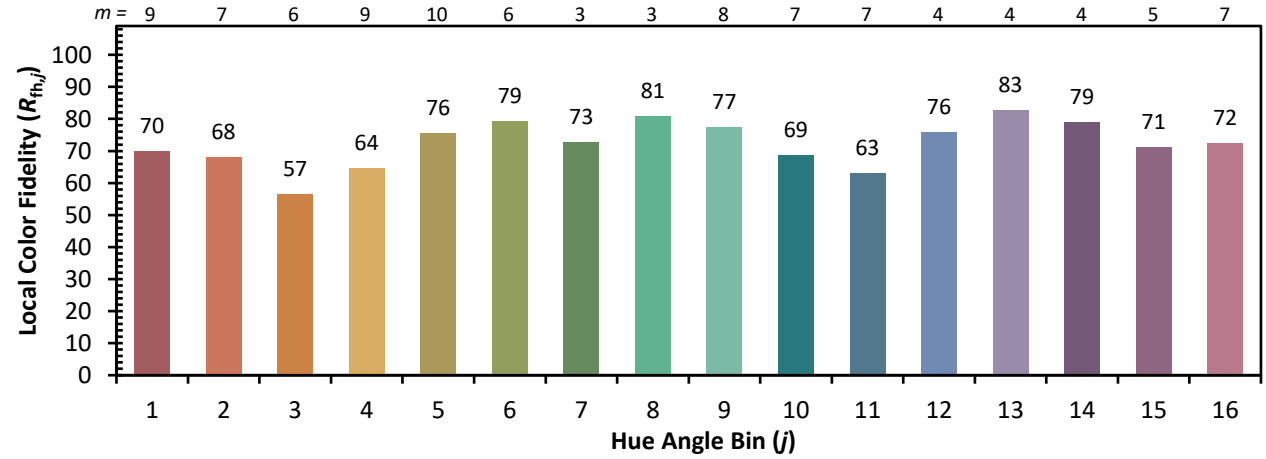


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Measure Comparisons

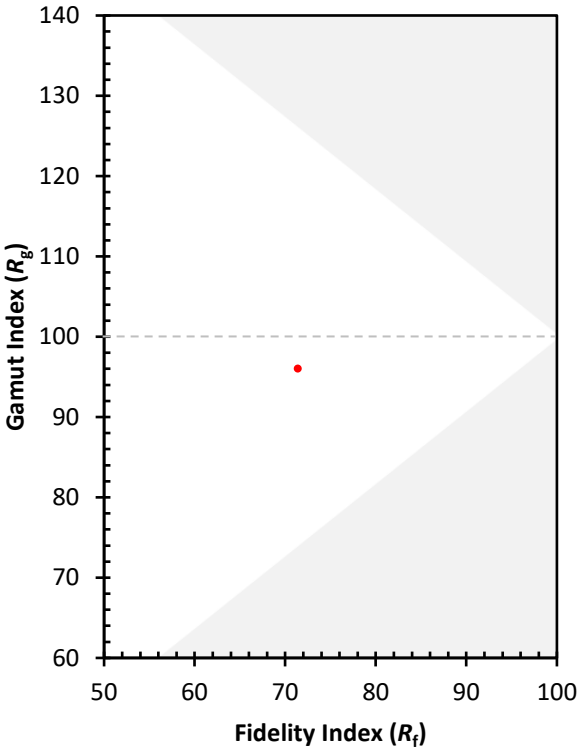

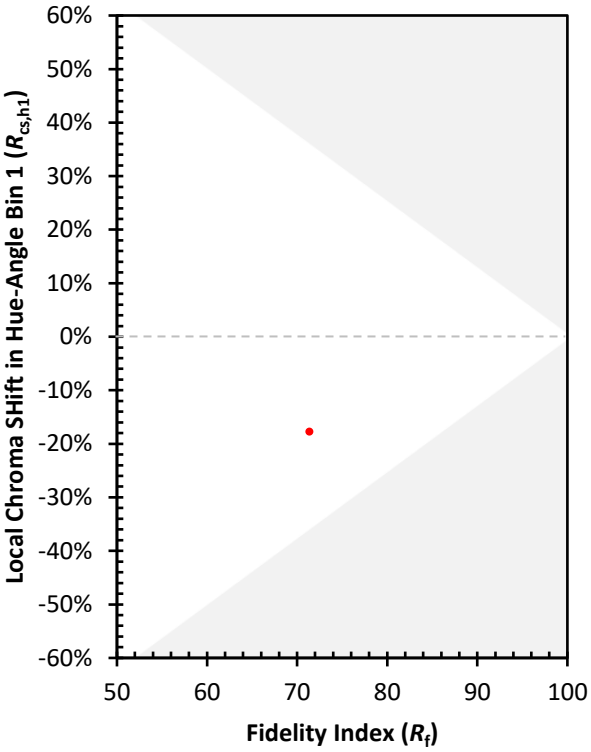

(END OF REPORT)