Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360777

Luminaire Tested: **GSS-SB5C-735-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360777
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB5C-735-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 5SQUARE 252W 70CRI 3500K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(130) 3500K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	35703.3 lumens
Efficiency:	N/A
Efficacy:	141.7 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 1' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B5 - U0 - G5


Input Watts (W):	252
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	7.9%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360777
CATALOG NUMBER: GSS-SB5C-735-U-T1

Iso-Footcandle Lines of Horizontal Illumination

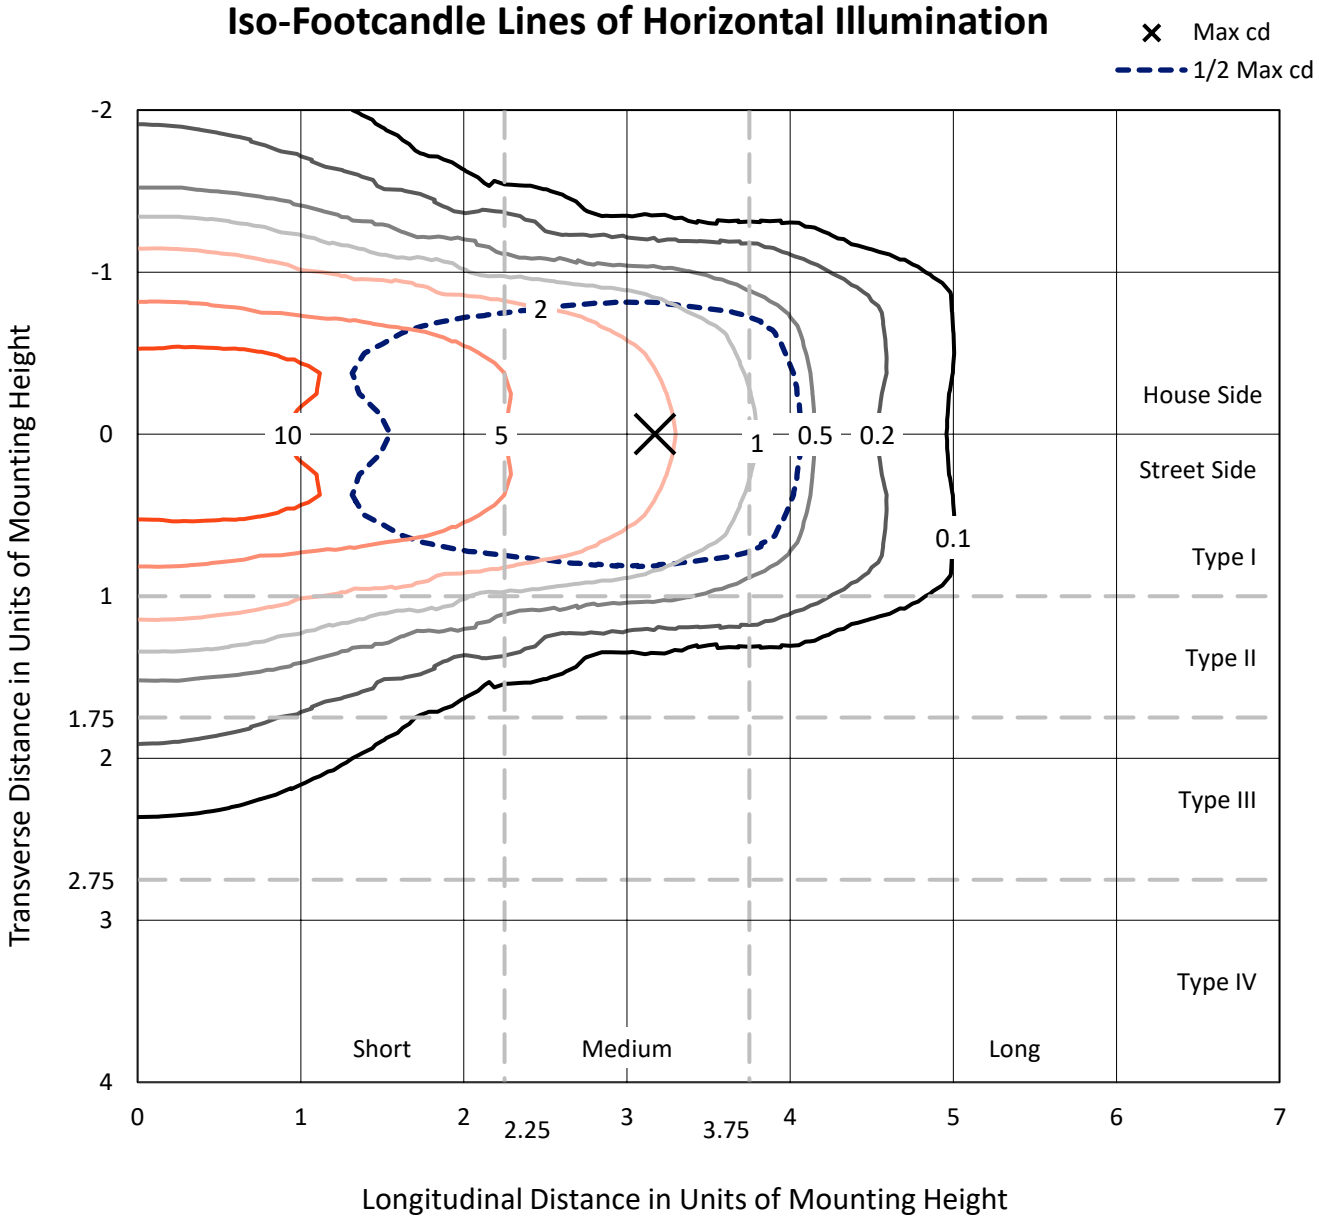


Based on 20 foot mounting height. Maximum calculated value = 17.6 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360777
CATALOG NUMBER: GSS-SB5C-735-U-T1

Luminous Intensity Polar Plot

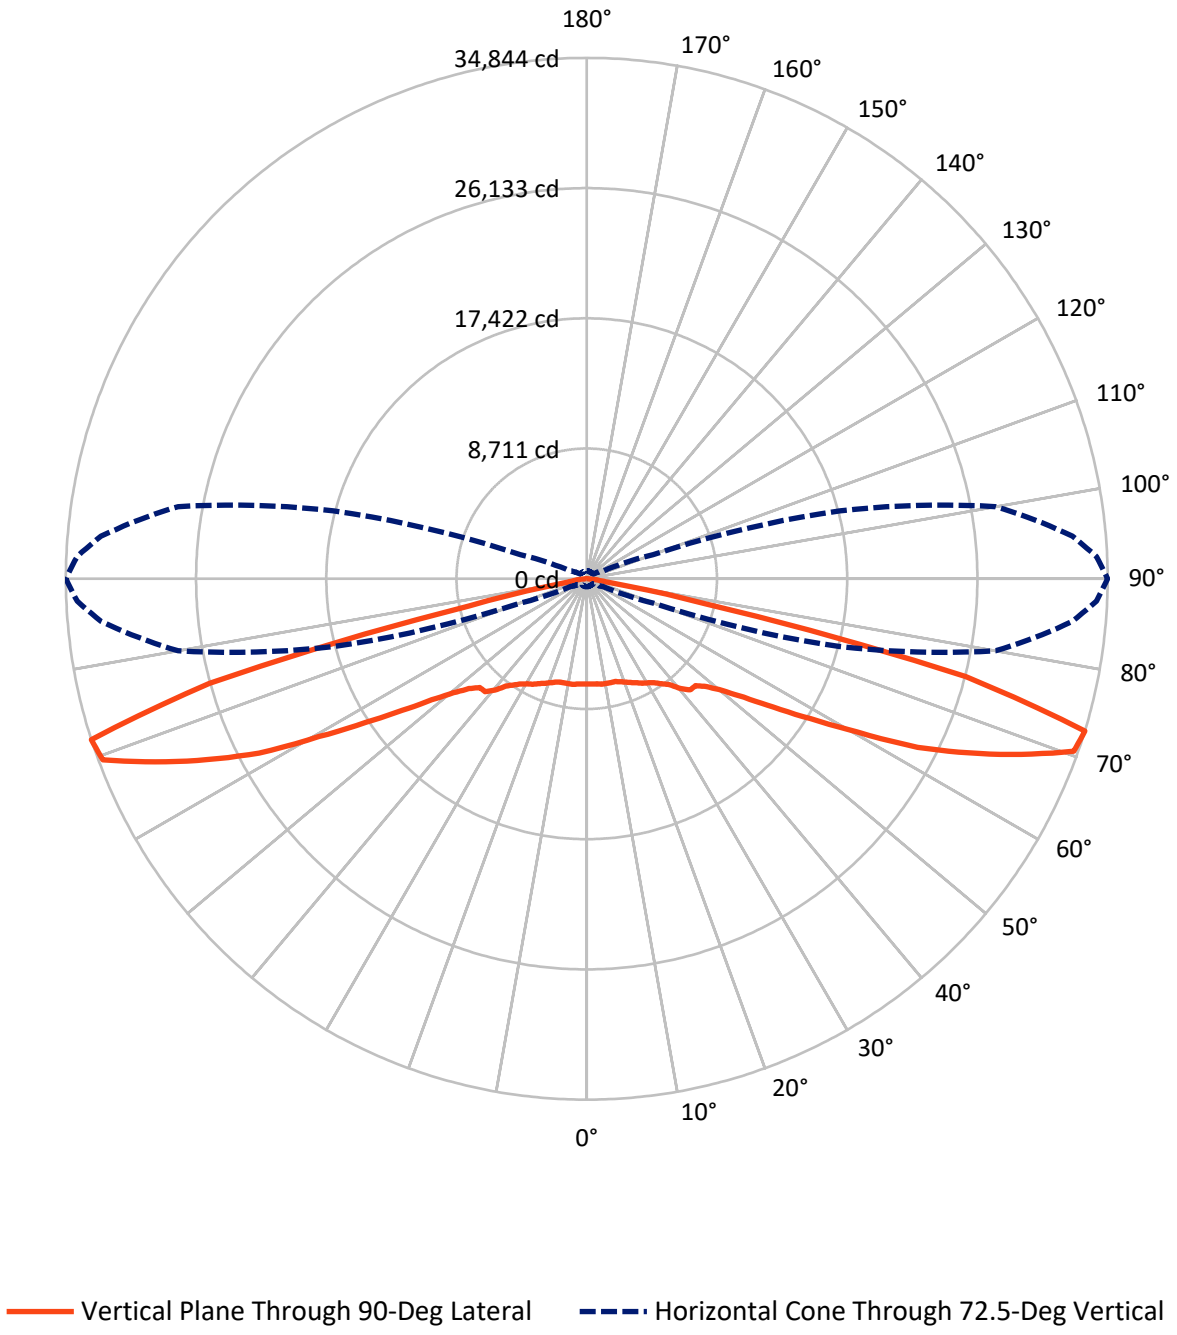

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360777
CATALOG NUMBER: GSS-SB5C-735-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	17851.7	0.0	17851.7
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	17851.7	0.0	17851.7
	% Fixture	50.0	0.0	50.0
Total	Lumens	35703.3	0.0	35703.3
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	680.9	1.9
10°-20°	2075.2	5.8
20°-30°	3468.5	9.7
30°-40°	4783.3	13.4
40°-50°	5863.8	16.4
50°-60°	6871.5	19.2
60°-70°	7630.7	21.4
70°-80°	4149.6	11.6
80°-90°	179.8	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	35703.3	100.0
0°-180°	35703.3	100.0

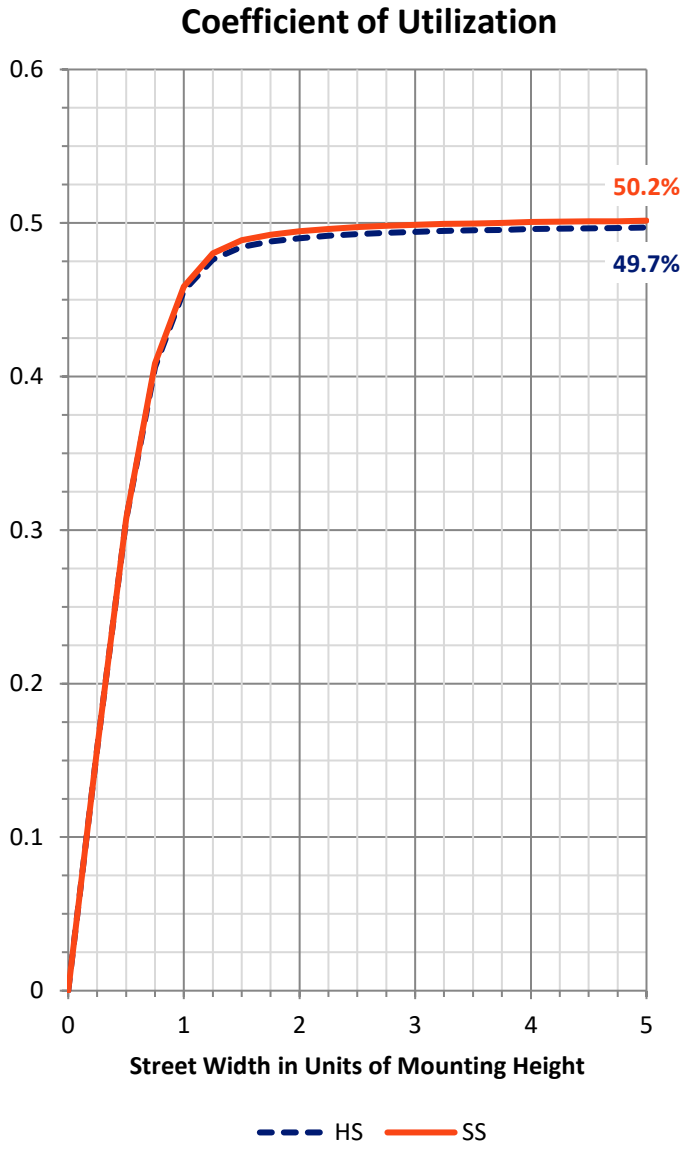

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360777
CATALOG NUMBER: GSS-SB5C-735-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	3112.3	8.7			
FM	(30°-60°)	8759.3	24.5			
FH	(60°-80°)	5890.1	16.5			G3/7500
FVH	(80°-90°)	89.9	0.3			G1/100
BL	(0°-30°)	3112.3	8.7	B4/5000		
BM	(30°-60°)	8759.3	24.5	B5		
BH	(60°-80°)	5890.1	16.5	B5		G5
BVH	(80°-90°)	89.9	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B5-U0-G5
Type I Short

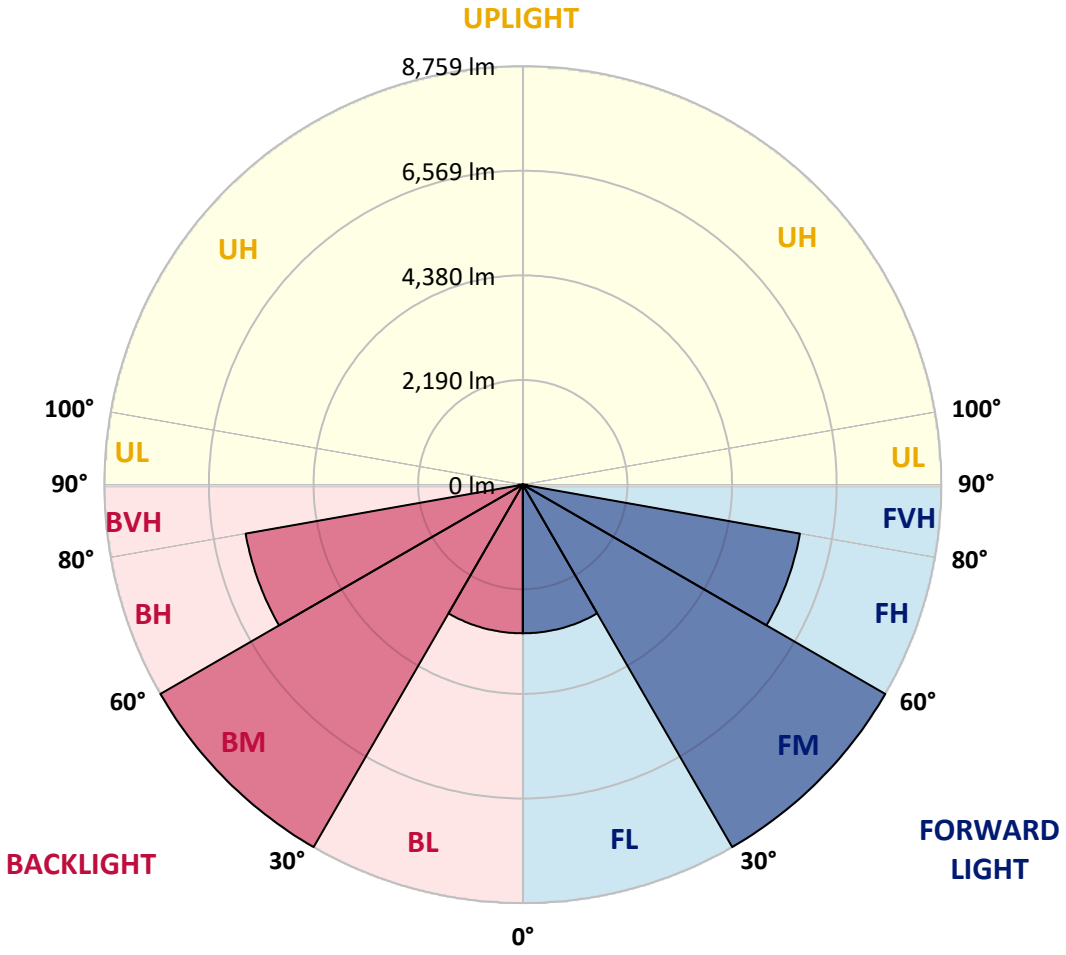

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360777
CATALOG NUMBER: GSS-SB5C-735-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	7034.4	7034.4	7034.4	7034.4	7034.4	7034.4	7034.4	7034.4	7034.4	7034.4	7034.4
2.5°	7042.3	7042.3	7018.8	7050.1	7034.4	7042.3	7050.1	7042.3	7034.4	7042.3	7050.1
5°	7081.3	7065.7	7081.3	7097.0	7073.5	7089.2	7081.3	7042.3	7065.7	7065.7	7065.7
7.5°	7151.7	7167.3	7151.7	7190.8	7167.3	7214.2	7167.3	7136.0	7128.2	7120.4	7120.4
10°	7182.9	7182.9	7175.1	7245.5	7261.1	7308.0	7276.7	7229.8	7206.4	7175.1	7143.9
12.5°	7097.0	7112.6	7151.7	7284.6	7347.1	7440.9	7417.4	7323.6	7253.3	7229.8	7182.9
15°	7003.2	7018.8	7097.0	7261.1	7409.6	7550.3	7542.5	7425.2	7339.3	7276.7	7206.4
17.5°	6854.7	6878.1	6987.5	7237.7	7503.4	7659.7	7706.6	7589.4	7495.6	7394.0	7300.2
20°	6604.6	6604.6	6800.0	7120.4	7487.8	7839.5	7964.6	7870.8	7761.3	7597.2	7472.1
22.5°	6323.2	6338.8	6534.2	6956.3	7480.0	7995.8	8238.1	8136.5	8027.1	7847.3	7659.7
25°	6041.8	6041.8	6260.7	6737.4	7378.3	8105.2	8558.6	8503.9	8285.0	8120.9	7878.6
27.5°	5783.9	5783.9	6018.4	6518.6	7206.4	8136.5	8879.0	8879.0	8636.7	8394.4	8128.7
30°	5479.0	5557.2	5823.0	6346.6	7050.1	8081.8	9113.5	9262.0	9043.2	8730.5	8339.7
32.5°	5221.1	5275.8	5549.4	6104.3	6823.4	8019.3	9379.3	9746.6	9519.9	9090.1	8652.4
35°	4916.3	4908.5	5221.1	5768.2	6502.9	7878.6	9590.3	10325.0	10106.1	9645.0	9051.0
37.5°	4517.7	4517.7	4838.1	5369.6	6198.1	7636.3	9762.2	10965.9	10801.8	10278.1	9645.0
40°	4087.8	4134.7	4416.1	4955.4	5830.8	7347.1	9762.2	11489.6	11575.6	11036.3	10379.7
42.5°	3775.1	3790.8	4048.7	4556.8	5424.3	6971.9	9637.2	11942.9	12200.8	11747.5	10895.6
45°	3446.9	3486.0	3704.8	4173.8	5002.3	6526.4	9418.3	12451.0	12865.2	12552.6	11434.9
47.5°	3048.3	3087.3	3337.5	3814.2	4603.7	6041.8	9051.0	12982.5	13850.0	13623.4	12396.2
50°	2587.1	2618.4	2852.9	3360.9	4158.1	5486.9	8589.8	13381.1	14834.9	15061.5	13850.0
52.5°	2024.4	2047.8	2297.9	2790.3	3626.6	4955.4	7941.1	13623.4	15827.5	16624.7	15796.2
55°	1453.8	1492.9	1711.7	2118.1	2923.2	4244.1	7167.3	13748.4	16913.9	18477.1	18211.4
57.5°	1047.4	1063.0	1211.5	1524.1	2172.9	3407.8	6174.7	13537.4	17890.9	20689.1	21244.0
60°	867.6	867.6	891.0	1039.5	1485.0	2407.3	4986.6	12755.8	18727.2	22924.5	24636.2
62.5°	797.2	797.2	812.9	836.3	977.0	1563.2	3564.1	11169.1	18821.0	25073.9	28356.6
65°	726.9	726.9	742.5	758.2	789.4	1016.1	2149.4	8175.6	16984.3	25097.3	30357.5
67.5°	664.4	664.4	672.2	680.0	695.6	742.5	1180.2	4955.4	13592.1	24433.0	31123.5
70°	601.8	601.8	601.8	594.0	617.5	625.3	781.6	2516.8	9090.1	22064.7	30756.1
72.5°	*531.5*	*531.5*	*523.7*	*508.0*	*515.9*	*515.9*	*578.4*	*1234.9*	*4720.9*	*17539.2*	*27770.4*
75°	453.3	461.1	429.9	414.3	406.4	414.3	461.1	703.4	2110.3	10637.6	20751.6
77.5°	383.0	398.6	351.7	320.5	312.6	312.6	359.5	437.7	906.7	3861.1	9301.1
80°	289.2	297.0	257.9	226.7	226.7	218.8	265.7	320.5	429.9	1149.0	2086.9
82.5°	164.1	164.1	148.5	132.9	125.1	132.9	179.8	218.8	265.7	406.4	570.6
85°	39.1	39.1	46.9	54.7	54.7	70.3	101.6	117.2	140.7	164.1	218.8
87.5°	7.8	7.8	7.8	15.6	23.4	23.4	39.1	54.7	70.3	86.0	93.8
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360777
CATALOG NUMBER: GSS-SB5C-735-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	7034.4	7034.4	*7034.4*
2.5°	7050.1	7057.9	*7050.1*
5°	7097.0	7081.3	*7057.9*
7.5°	7104.8	7112.6	*7120.4*
10°	7136.0	7167.3	*7120.4*
12.5°	7167.3	7143.9	*7128.2*
15°	7190.8	7182.9	*7136.0*
17.5°	7276.7	7245.5	*7237.7*
20°	7409.6	7401.8	*7378.3*
22.5°	7565.9	7550.3	*7542.5*
25°	7792.6	7737.9	*7706.6*
27.5°	7980.2	7933.3	*7917.7*
30°	8167.8	8074.0	*8074.0*
32.5°	8331.9	8308.5	*8292.8*
35°	8722.7	8605.5	*8621.1*
37.5°	9199.5	9082.2	*8980.6*
40°	9871.7	9715.3	*9652.8*
42.5°	10301.5	10145.2	*10160.9*
45°	10543.8	10270.3	*10199.9*
47.5°	11200.4	10856.5	*10762.7*
50°	12263.4	11841.3	*11724.1*
52.5°	13982.9	13302.9	*13146.6*
55°	16140.1	15303.8	*15147.5*
57.5°	19094.6	17984.7	*17648.6*
60°	22690.0	21314.4	*20806.3*
62.5°	27012.3	25316.2	*24831.6*
65°	30263.7	28849.0	*28098.7*
67.5°	32866.5	31701.9	*31342.3*
70°	34414.0	34468.8	*34562.6*
72.5°	*32624.2*	*34124.9*	*34843.9*
75°	23909.3	25073.9	*26191.6*
77.5°	9238.6	8331.9	*8066.2*
80°	1492.9	1399.1	*1446.0*
82.5°	672.2	711.3	*750.3*
85°	437.7	508.0	*539.3*
87.5°	101.6	101.6	*101.6*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-5

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-735-U-5WQ

Data in this report applies to families of products including GSS-SB1A-735-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-735-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 3500K CCT 26 LEDS

Spectral Parameters

CCT (K):	3369
CIE u':	0.2386
CIE v':	0.5156
Duv:	0.0013
CIE x:	0.4143
CIE y:	0.3980
CIE z:	0.1877
Peak Wavelength (nm):	590
Dominant Wavelength (nm):	580
Purity:	43.80166
Rf:	71.4
Rg:	96

CRI (Ra):	70.1
R1:	66.6
R2:	77.6
R3:	88.5
R4:	69.5
R5:	66.4
R6:	69.6
R7:	77.5
R8:	44.9
R9:	-40.2
R10:	49.1
R11:	66.3
R12:	45.7
R13:	68.0
R14:	93.4
R15:	57.6

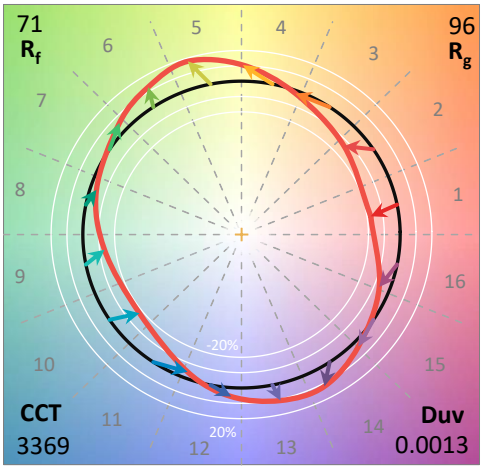

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-5

CIE 1931 Chromaticity Diagram

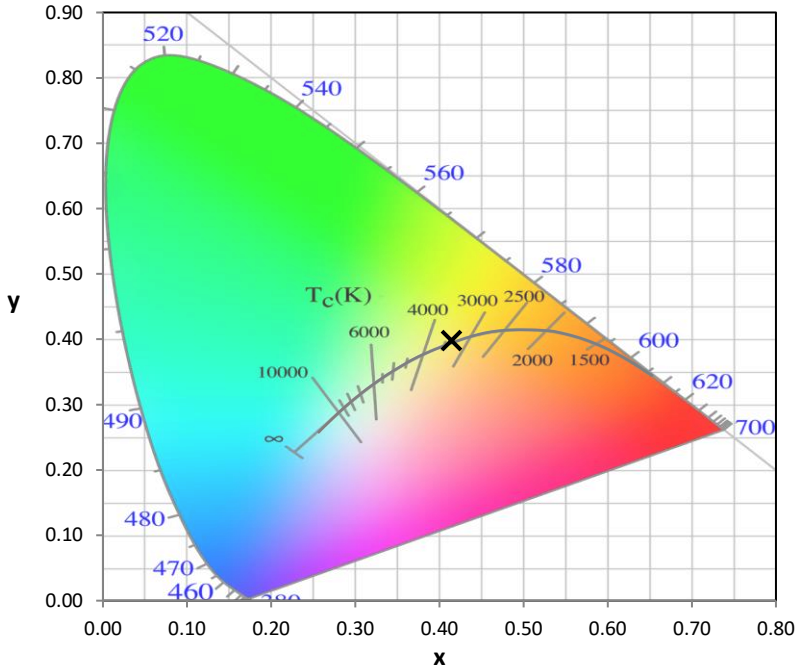

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

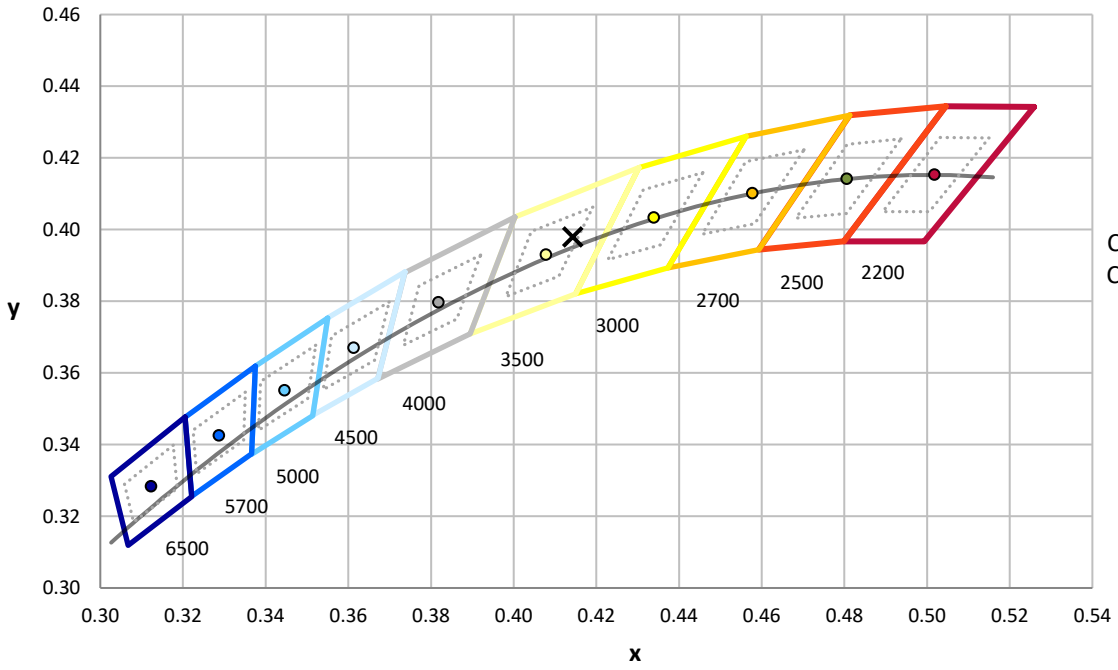


CCT = 3369K
CIE x = 0.4143
CIE y = 0.3980
Duv = 0.0013

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-5

Photopic Flux vs. Wavelength

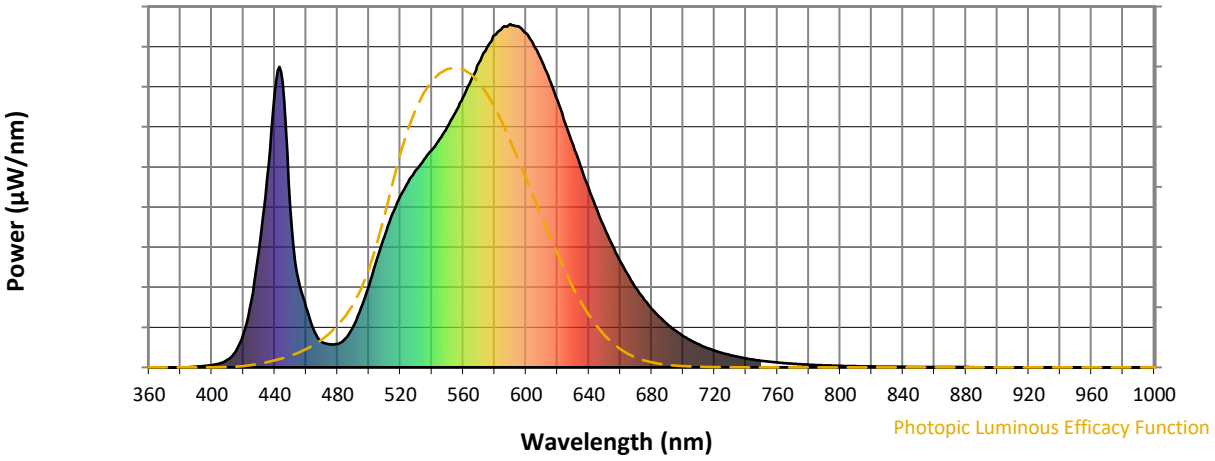


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Scotopic Flux vs. Wavelength

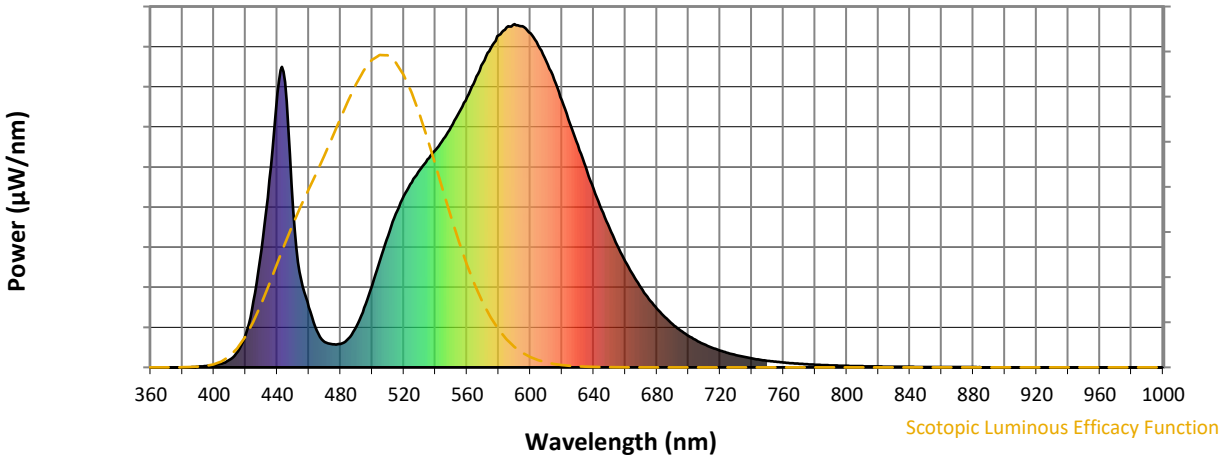


Scotopic Lumens: NR **S/P: 1.29**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Melanopic Flux vs. Wavelength

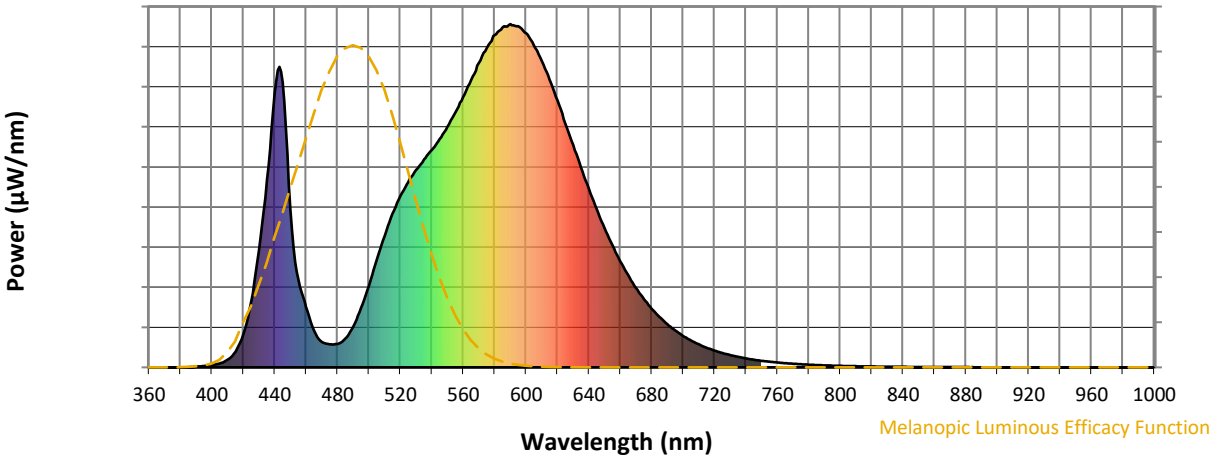

Melanopic Lumens: NR **M/P: 2.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			


REPORT NUMBER: SP1-2407-184-5

TM-30-18


Summary


R_f = 71.4
R_g = 96
CIE R_a = 70.1
R_9 = -40.2


Spectral Power Distribution Comparison

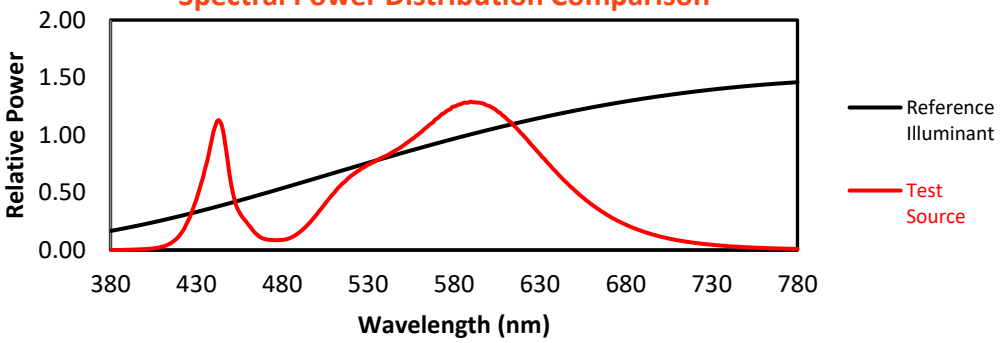


Color Vector Graphics

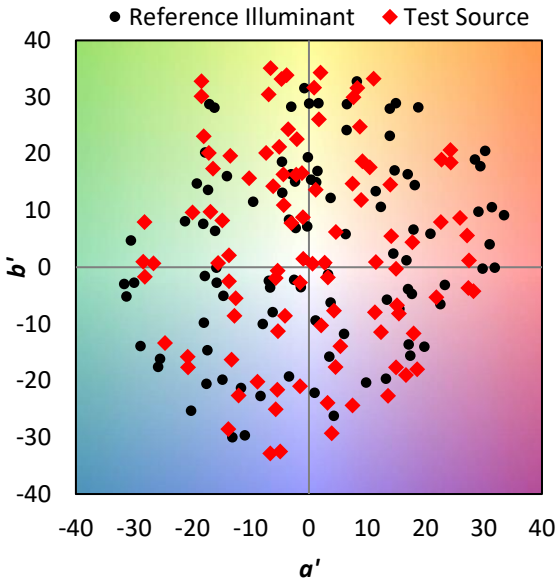

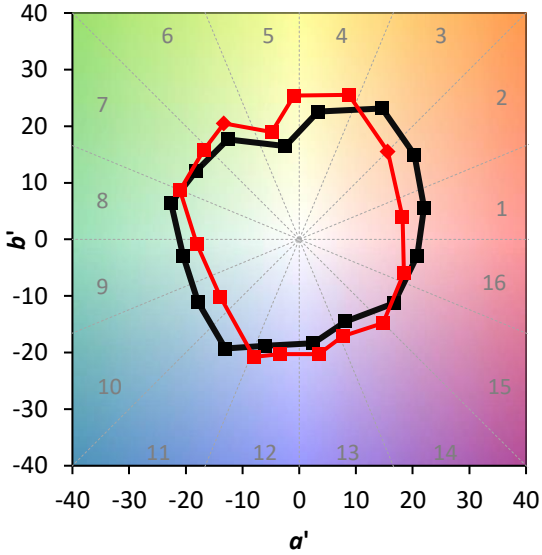

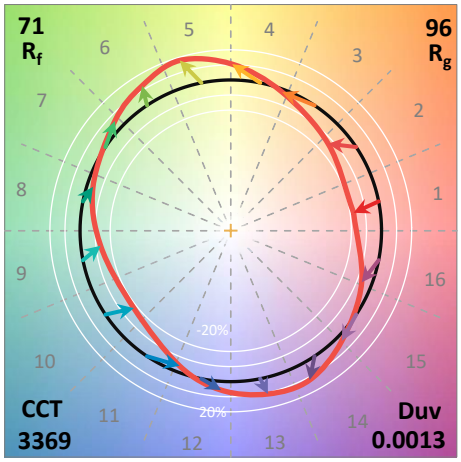

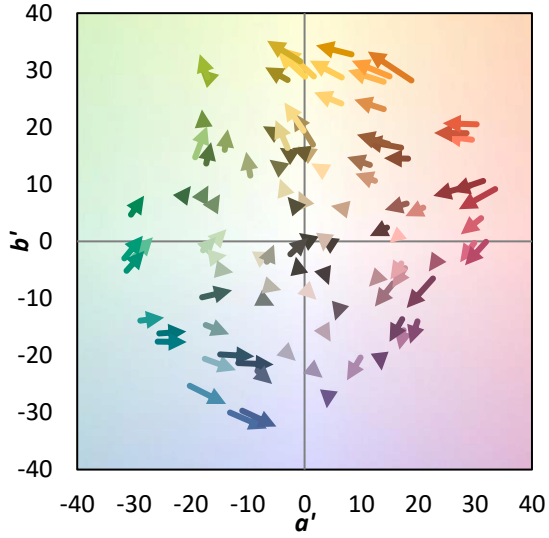


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 57	CES51 = 84	CES76 = 50
CES02 = 62	CES27 = 80	CES52 = 86	CES77 = 74
CES03 = 31	CES28 = 81	CES53 = 72	CES78 = 54
CES04 = 70	CES29 = 50	CES54 = 79	CES79 = 81
CES05 = 48	CES30 = 55	CES55 = 78	CES80 = 79
CES06 = 51	CES31 = 56	CES56 = 67	CES81 = 74
CES07 = 40	CES32 = 54	CES57 = 65	CES82 = 91
CES08 = 39	CES33 = 60	CES58 = 68	CES83 = 86
CES09 = 29	CES34 = 69	CES59 = 85	CES84 = 89
CES10 = 75	CES35 = 83	CES60 = 91	CES85 = 83
CES11 = 58	CES36 = 88	CES61 = 85	CES86 = 66
CES12 = 64	CES37 = 78	CES62 = 78	CES87 = 77
CES13 = 43	CES38 = 64	CES63 = 71	CES88 = 75
CES14 = 74	CES39 = 92	CES64 = 70	CES89 = 68
CES15 = 71	CES40 = 86	CES65 = 64	CES90 = 72
CES16 = 47	CES41 = 81	CES66 = 65	CES91 = 95
CES17 = 50	CES42 = 79	CES67 = 63	CES92 = 62
CES18 = 56	CES43 = 71	CES68 = 69	CES93 = 78
CES19 = 72	CES44 = 98	CES69 = 80	CES94 = 51
CES20 = 65	CES45 = 80	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 75	CES71 = 58	CES96 = 76
CES22 = 79	CES47 = 71	CES72 = 85	CES97 = 82
CES23 = 92	CES48 = 61	CES73 = 51	CES98 = 72
CES24 = 91	CES49 = 74	CES74 = 94	CES99 = 60
CES25 = 72	CES50 = 83	CES75 = 57	

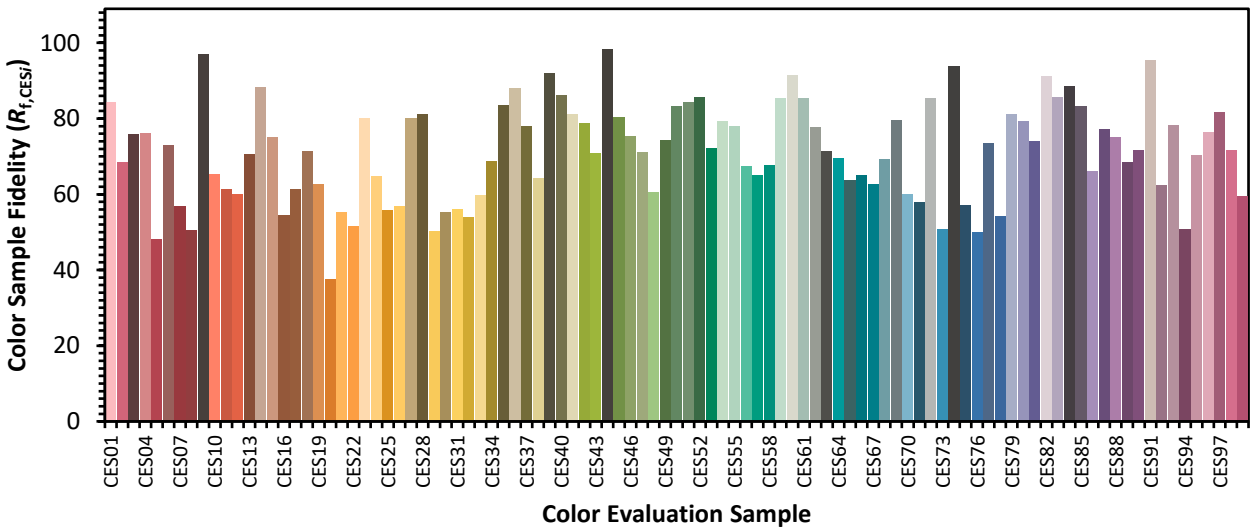



REPORT NUMBER: SP1-2407-184-5

TM-30-18

Color Rendition by Hue-Angle Bin

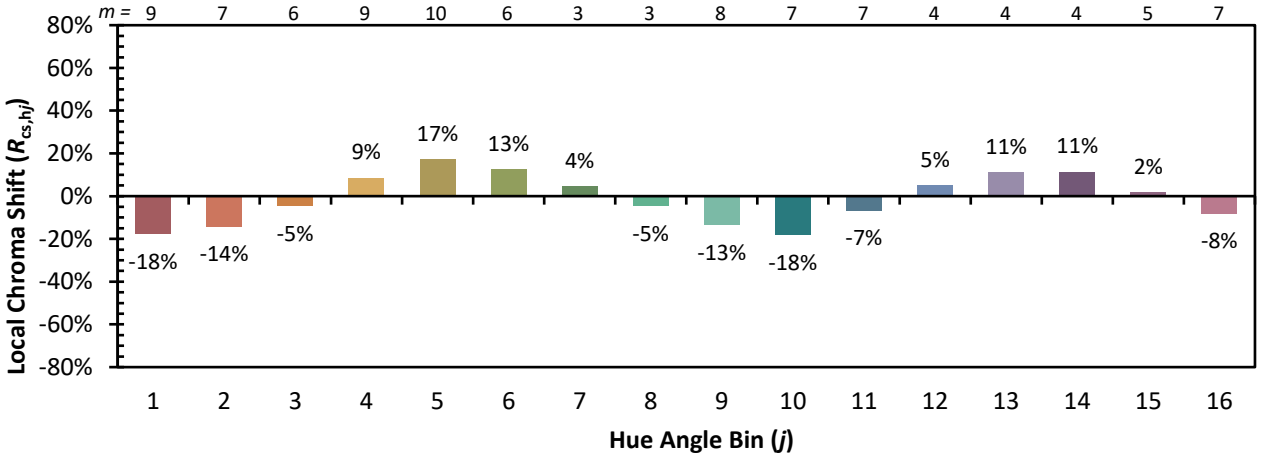

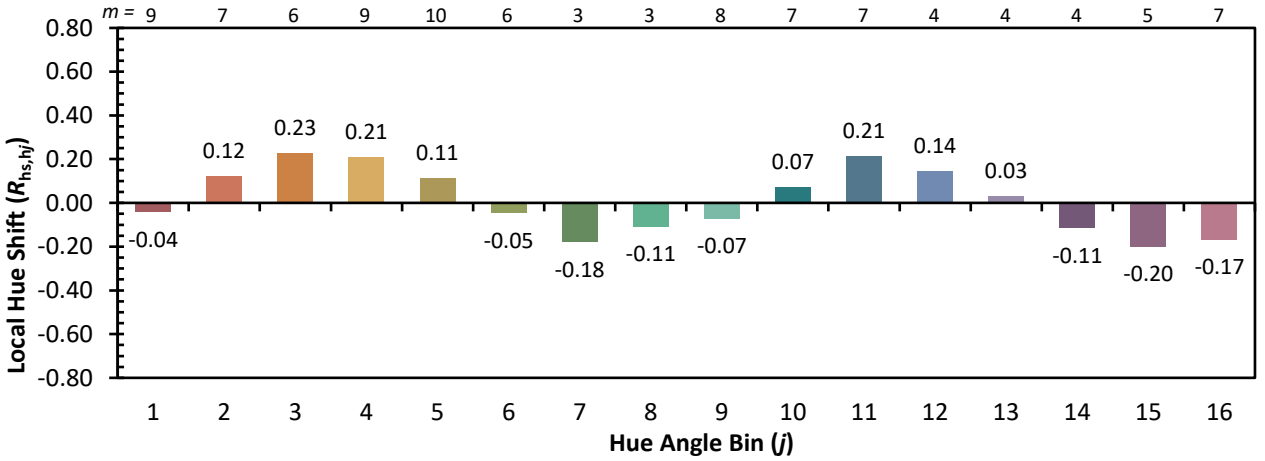


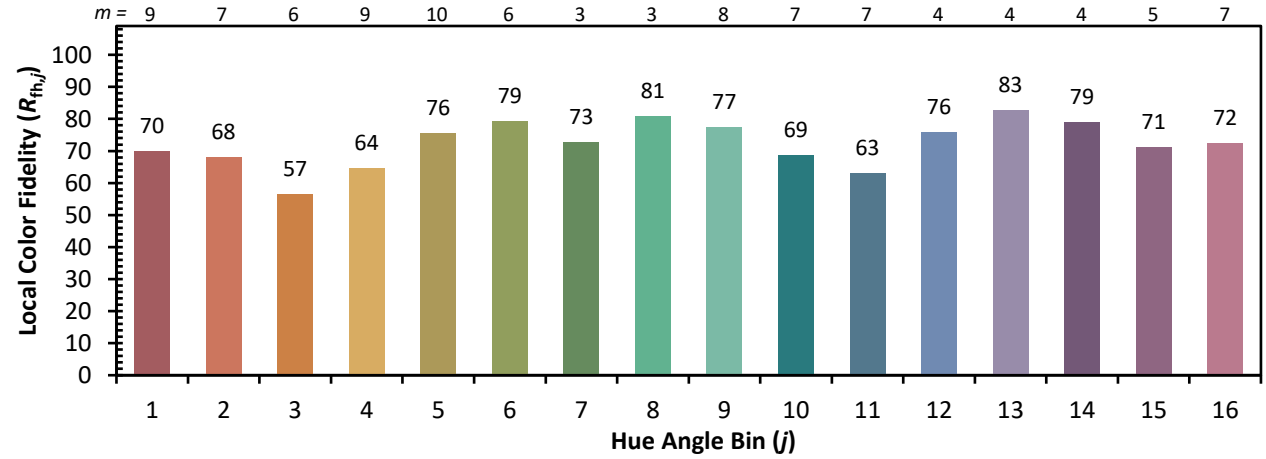


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Measure Comparisons

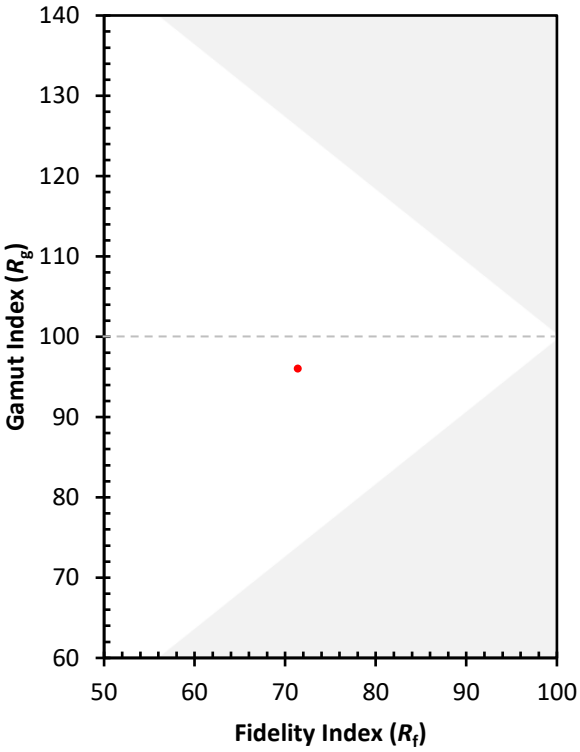

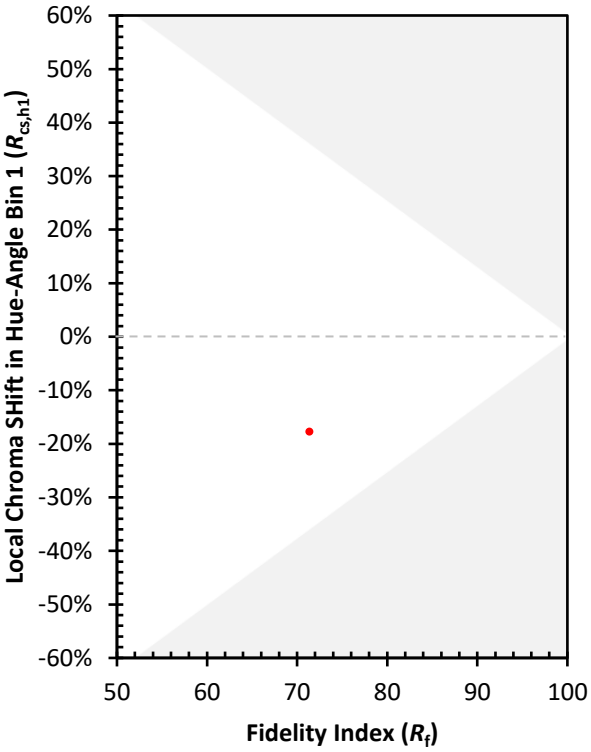

(END OF REPORT)