Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360781

Luminaire Tested: **GSS-SB6C-735-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360781
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB6C-735-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 6SQUARE 300W 70CRI 3500K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(156) 3500K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	42865.3 lumens
Efficiency:	N/A
Efficacy:	142.9 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 1' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B5 - U0 - G5


Input Watts (W):	300
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	6.3%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360781
CATALOG NUMBER: GSS-SB6C-735-U-T1

Iso-Footcandle Lines of Horizontal Illumination

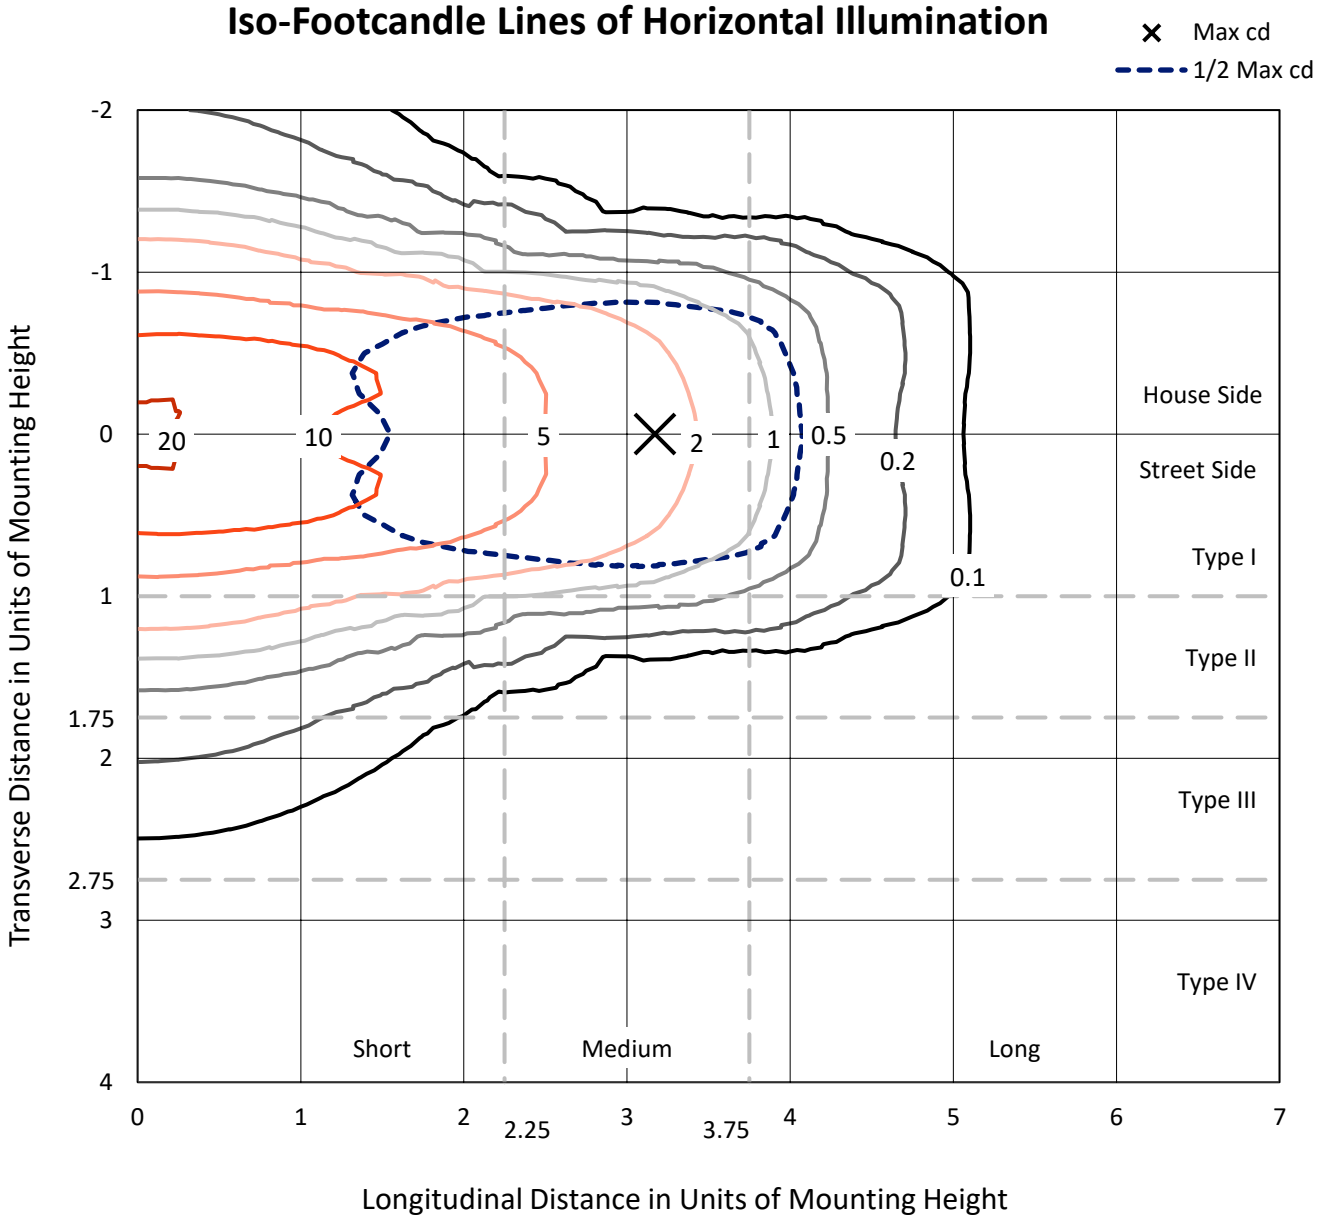


Based on 20 foot mounting height. Maximum calculated value = 21.1 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360781
CATALOG NUMBER: GSS-SB6C-735-U-T1

Luminous Intensity Polar Plot

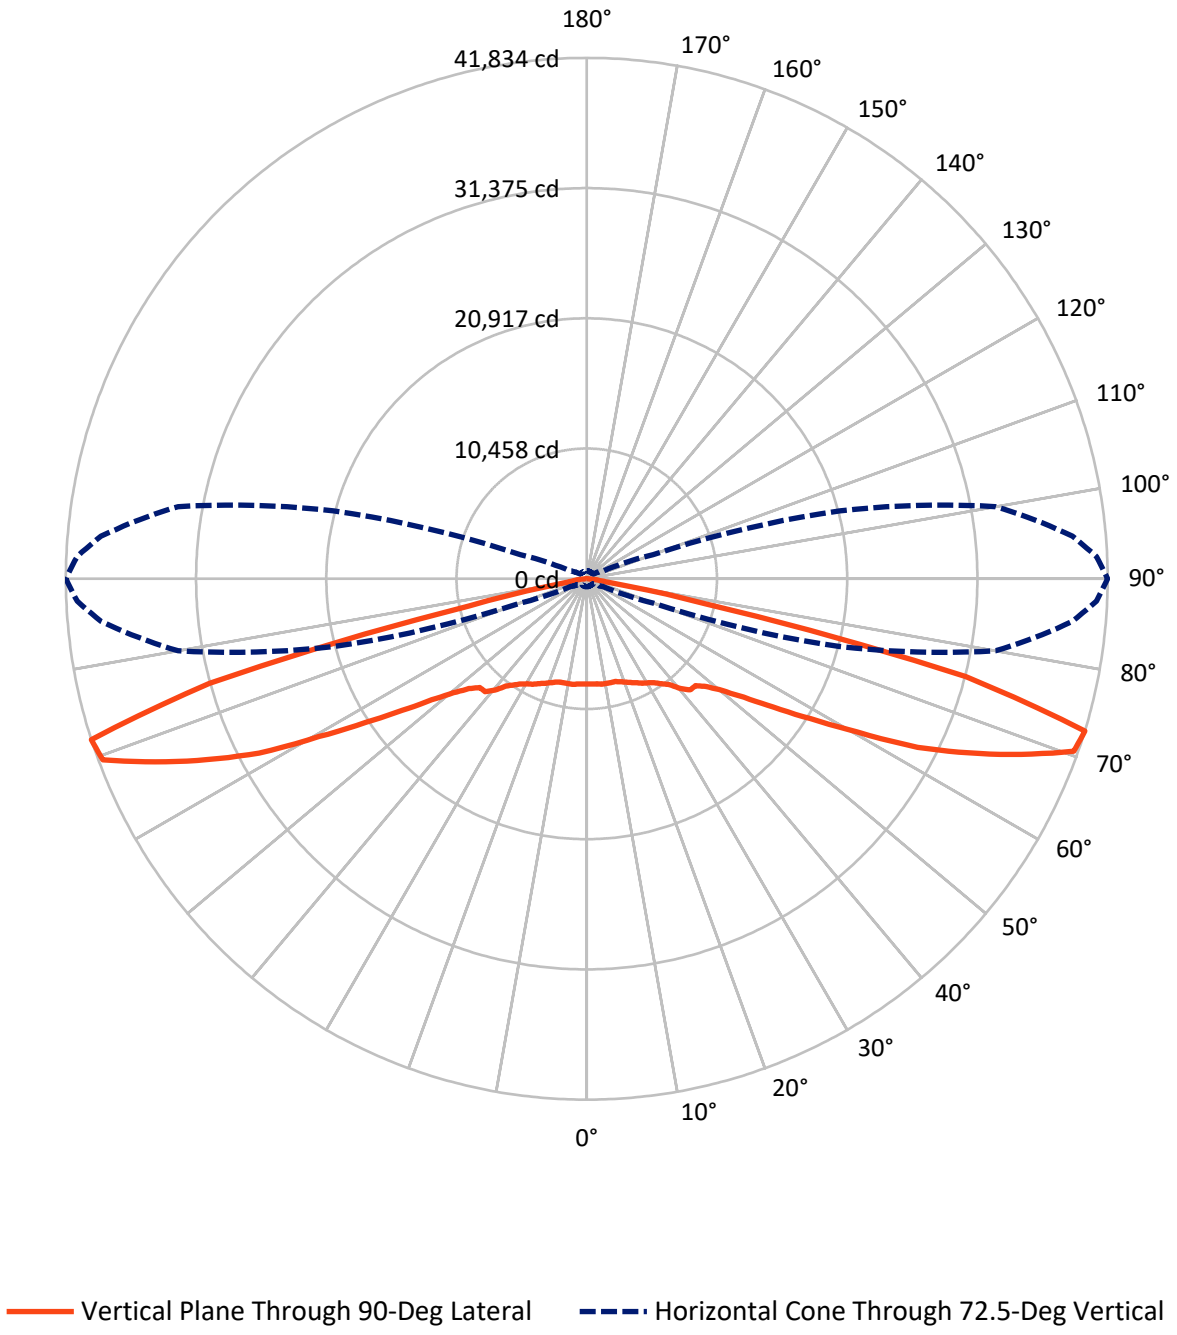

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360781
CATALOG NUMBER: GSS-SB6C-735-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	21432.6	0.0	21432.6
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	21432.6	0.0	21432.6
	% Fixture	50.0	0.0	50.0
Total	Lumens	42865.3	0.0	42865.3
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	817.5	1.9
10°-20°	2491.5	5.8
20°-30°	4164.3	9.7
30°-40°	5742.9	13.4
40°-50°	7040.0	16.4
50°-60°	8249.9	19.2
60°-70°	9161.4	21.4
70°-80°	4982.0	11.6
80°-90°	215.9	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	42865.3	100.0
0°-180°	42865.3	100.0

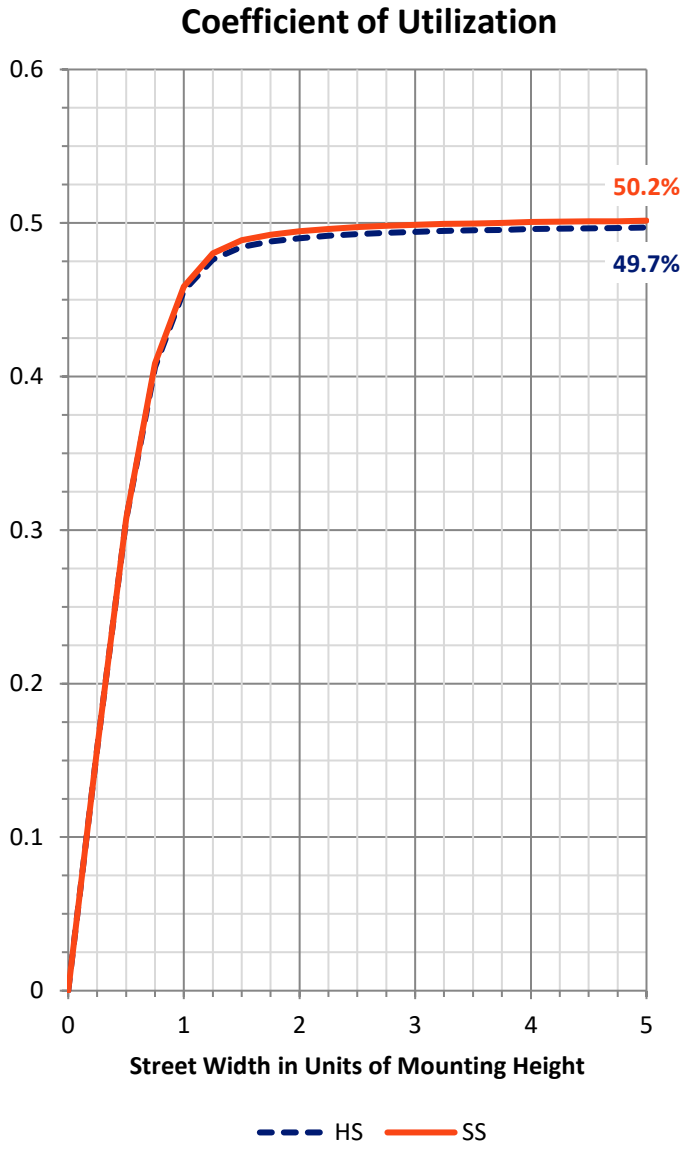

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360781
CATALOG NUMBER: GSS-SB6C-735-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	3736.6	8.7			
FM	(30°-60°)	10516.4	24.5			
FH	(60°-80°)	7071.7	16.5			G3/7500
FVH	(80°-90°)	107.9	0.3			G2/225
BL	(0°-30°)	3736.6	8.7	B4/5000		
BM	(30°-60°)	10516.4	24.5	B5		
BH	(60°-80°)	7071.7	16.5	B5		G5
BVH	(80°-90°)	107.9	0.3			G2/225
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B5-U0-G5
Type I Short

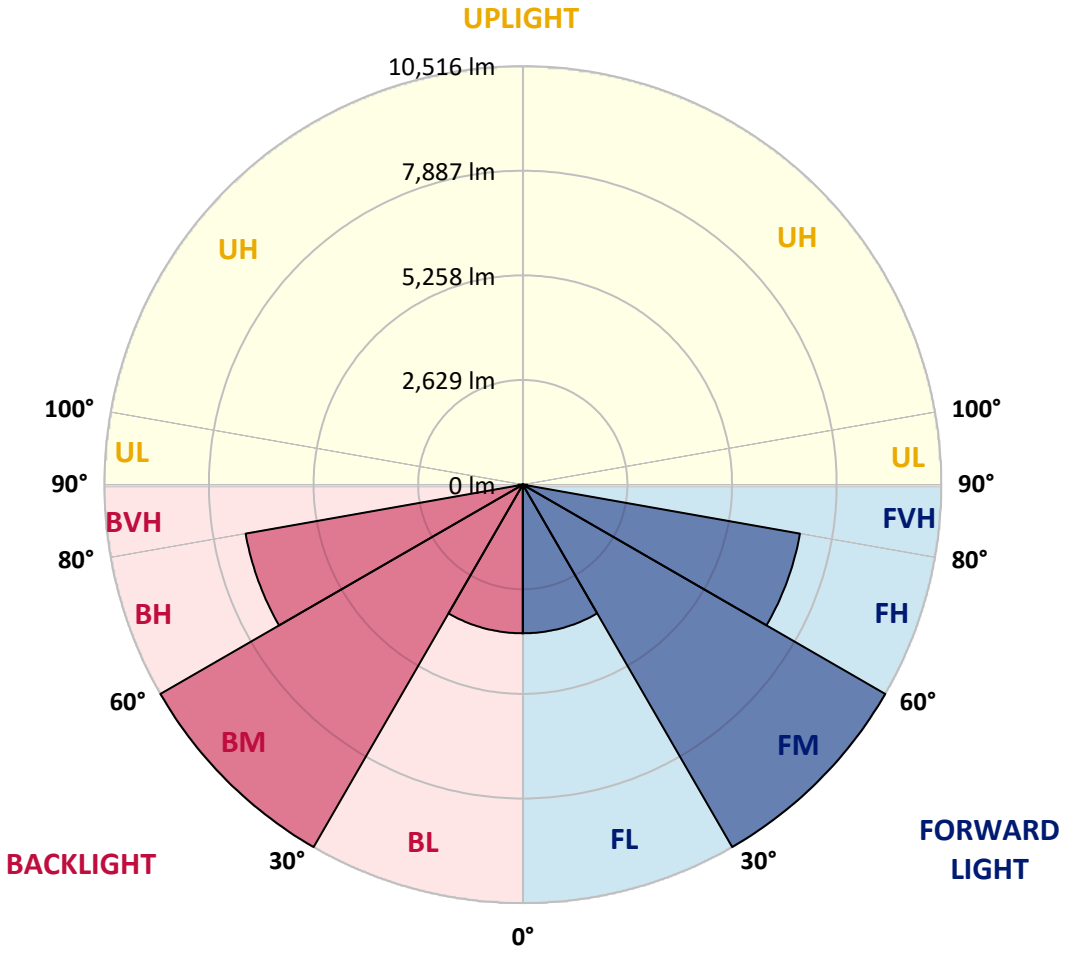

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360781
CATALOG NUMBER: GSS-SB6C-735-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	8445.5	8445.5	8445.5	8445.5	8445.5	8445.5	8445.5	8445.5	8445.5	8445.5	8445.5
2.5°	8454.9	8454.9	8426.8	8464.3	8445.5	8454.9	8464.3	8454.9	8445.5	8454.9	8464.3
5°	8501.8	8483.1	8501.8	8520.6	8492.4	8511.2	8501.8	8454.9	8483.1	8483.1	8483.1
7.5°	8586.3	8605.0	8586.3	8633.2	8605.0	8661.4	8605.0	8567.5	8558.1	8548.7	8548.7
10°	8623.8	8623.8	8614.4	8698.9	8717.7	8774.0	8736.4	8680.1	8652.0	8614.4	8576.9
12.5°	8520.6	8539.4	8586.3	8745.8	8820.9	8933.5	8905.3	8792.7	8708.3	8680.1	8623.8
15°	8408.0	8426.8	8520.6	8717.7	8895.9	9064.9	9055.5	8914.7	8811.5	8736.4	8652.0
17.5°	8229.7	8257.8	8389.2	8689.5	9008.6	9196.2	9252.5	9111.8	8999.2	8877.2	8764.6
20°	7929.4	7929.4	8164.0	8548.7	8989.8	9412.1	9562.2	9449.6	9318.2	9121.2	8971.0
22.5°	7591.6	7610.4	7845.0	8351.7	8980.4	9599.7	9890.6	9768.7	9637.3	9421.4	9196.2
25°	7253.8	7253.8	7516.5	8088.9	8858.4	9731.1	10275.4	10209.7	9946.9	9749.9	9459.0
27.5°	6944.1	6944.1	7225.6	7826.2	8652.0	9768.7	10660.1	10660.1	10369.2	10078.3	9759.3
30°	6578.1	6672.0	6991.0	7619.7	8464.3	9703.0	10941.6	11119.9	10857.2	10481.8	10012.6
32.5°	6268.5	6334.1	6662.6	7328.8	8192.2	9627.9	11260.7	11701.7	11429.6	10913.5	10388.0
35°	5902.5	5893.1	6268.5	6925.3	7807.4	9459.0	11514.1	12396.1	12133.4	11579.7	10866.6
37.5°	5423.9	5423.9	5808.6	6446.7	7441.4	9168.1	11720.5	13165.6	12968.6	12339.8	11579.7
40°	4907.8	4964.1	5301.9	5949.4	7000.4	8820.9	11720.5	13794.4	13897.6	13250.1	12461.8
42.5°	4532.4	4551.2	4860.9	5470.8	6512.4	8370.5	11570.4	14338.6	14648.3	14104.0	13081.2
45°	4138.3	4185.2	4448.0	5011.0	6005.7	7835.6	11307.6	14948.6	15445.9	15070.6	13728.7
47.5°	3659.7	3706.6	4006.9	4579.3	5527.1	7253.8	10866.6	15586.7	16628.3	16356.2	14882.9
50°	3106.1	3143.6	3425.1	4035.1	4992.2	6587.5	10312.9	16065.3	17810.7	18082.8	16628.3
52.5°	2430.4	2458.6	2758.9	3350.1	4354.1	5949.4	9534.1	16356.2	19002.4	19959.6	18964.9
55°	1745.4	1792.3	2055.1	2543.0	3509.6	5095.5	8605.0	16506.3	20306.8	22183.6	21864.5
57.5°	1257.4	1276.2	1454.5	1829.9	2608.7	4091.4	7413.3	16252.9	21479.8	24839.2	25505.5
60°	1041.6	1041.6	1069.8	1248.1	1782.9	2890.2	5986.9	15314.5	22483.9	27523.0	29578.1
62.5°	957.2	957.2	975.9	1004.1	1173.0	1876.8	4279.1	13409.6	22596.5	30103.6	34044.8
65°	872.7	872.7	891.5	910.2	947.8	1219.9	2580.6	9815.6	20391.2	30131.7	36447.1
67.5°	797.6	797.6	807.0	816.4	835.2	891.5	1417.0	5949.4	16318.6	29334.1	37366.7
70°	722.6	722.6	722.6	713.2	741.3	750.7	938.4	3021.6	10913.5	26490.8	36925.7
72.5°	*638.1*	*638.1*	*628.7*	*610.0*	*619.3*	*619.3*	*694.4*	*1482.7*	*5667.9*	*21057.5*	*33341.0*
75°	544.3	553.7	516.1	497.3	488.0	497.3	553.7	844.6	2533.7	12771.5	24914.3
77.5°	459.8	478.6	422.3	384.7	375.4	375.4	431.7	525.5	1088.5	4635.7	11166.9
80°	347.2	356.6	309.7	272.1	272.1	262.7	319.1	384.7	516.1	1379.4	2505.5
82.5°	197.1	197.1	178.3	159.5	150.1	159.5	215.8	262.7	319.1	488.0	685.0
85°	46.9	46.9	56.3	65.7	65.7	84.5	122.0	140.8	168.9	197.1	262.7
87.5°	9.4	9.4	9.4	18.8	28.2	28.2	46.9	65.7	84.5	103.2	112.6
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360781
CATALOG NUMBER: GSS-SB6C-735-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	8445.5	8445.5	*8445.5*
2.5°	8464.3	8473.7	*8464.3*
5°	8520.6	8501.8	*8473.7*
7.5°	8530.0	8539.4	*8548.7*
10°	8567.5	8605.0	*8548.7*
12.5°	8605.0	8576.9	*8558.1*
15°	8633.2	8623.8	*8567.5*
17.5°	8736.4	8698.9	*8689.5*
20°	8895.9	8886.6	*8858.4*
22.5°	9083.6	9064.9	*9055.5*
25°	9355.8	9290.1	*9252.5*
27.5°	9581.0	9524.7	*9505.9*
30°	9806.2	9693.6	*9693.6*
32.5°	10003.3	9975.1	*9956.3*
35°	10472.4	10331.7	*10350.5*
37.5°	11044.9	10904.1	*10782.1*
40°	11851.9	11664.2	*11589.1*
42.5°	12368.0	12180.3	*12199.1*
45°	12658.9	12330.5	*12246.0*
47.5°	13447.1	13034.3	*12921.6*
50°	14723.4	14216.6	*14075.9*
52.5°	16787.8	15971.4	*15783.7*
55°	19377.8	18373.7	*18186.0*
57.5°	22924.9	21592.4	*21188.9*
60°	27241.5	25589.9	*24980.0*
62.5°	32430.8	30394.5	*29812.7*
65°	36334.5	34636.0	*33735.2*
67.5°	39459.4	38061.1	*37629.5*
70°	41317.4	41383.1	*41495.7*
72.5°	*39168.5*	*40970.2*	*41833.5*
75°	28705.4	30103.6	*31445.5*
77.5°	11091.8	10003.3	*9684.2*
80°	1792.3	1679.7	*1736.0*
82.5°	807.0	853.9	*900.9*
85°	525.5	610.0	*647.5*
87.5°	122.0	122.0	*122.0*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-5

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-735-U-5WQ

Data in this report applies to families of products including GSS-SB1A-735-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-735-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 3500K CCT 26 LEDS

Spectral Parameters

CCT (K):	3369
CIE u':	0.2386
CIE v':	0.5156
Duv:	0.0013
CIE x:	0.4143
CIE y:	0.3980
CIE z:	0.1877
Peak Wavelength (nm):	590
Dominant Wavelength (nm):	580
Purity:	43.80166
Rf:	71.4
Rg:	96

CRI (Ra):	70.1
R1:	66.6
R2:	77.6
R3:	88.5
R4:	69.5
R5:	66.4
R6:	69.6
R7:	77.5
R8:	44.9
R9:	-40.2
R10:	49.1
R11:	66.3
R12:	45.7
R13:	68.0
R14:	93.4
R15:	57.6

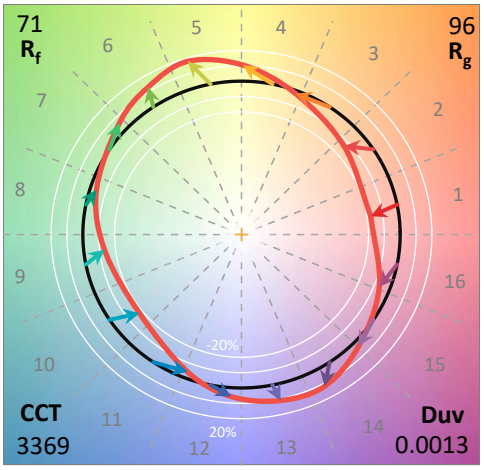

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-5

CIE 1931 Chromaticity Diagram

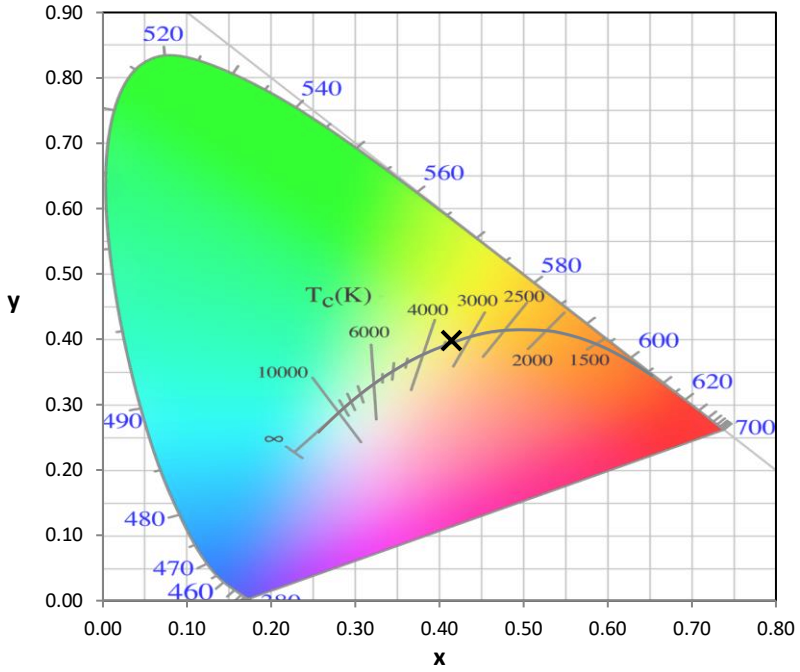

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

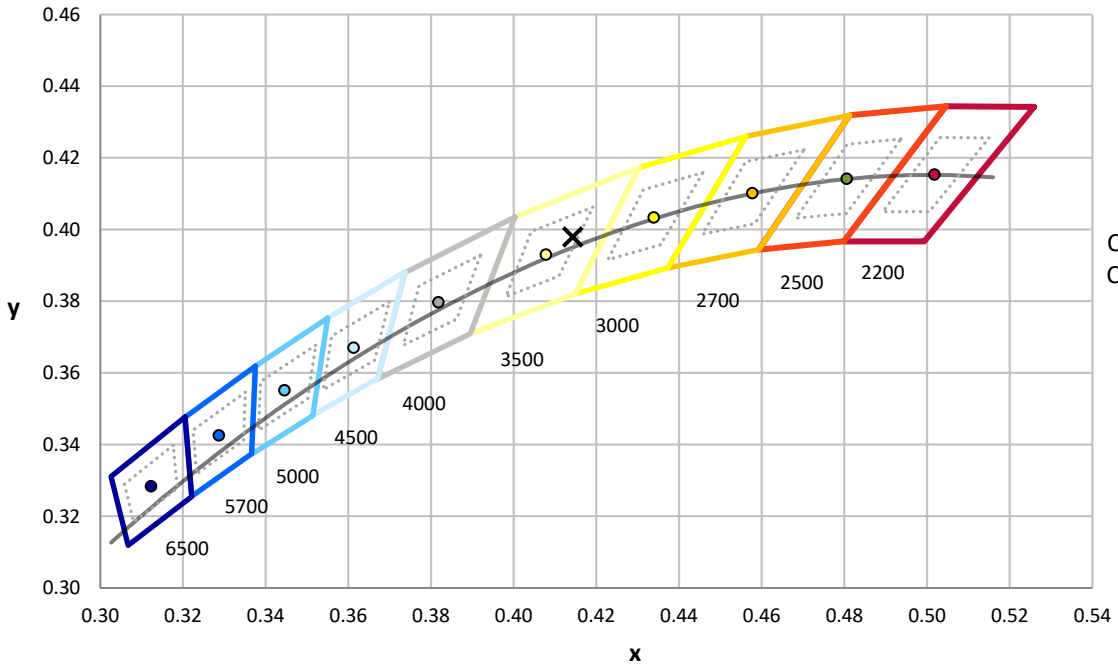


CCT = 3369K
CIE x = 0.4143
CIE y = 0.3980
Duv = 0.0013

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-5

Photopic Flux vs. Wavelength

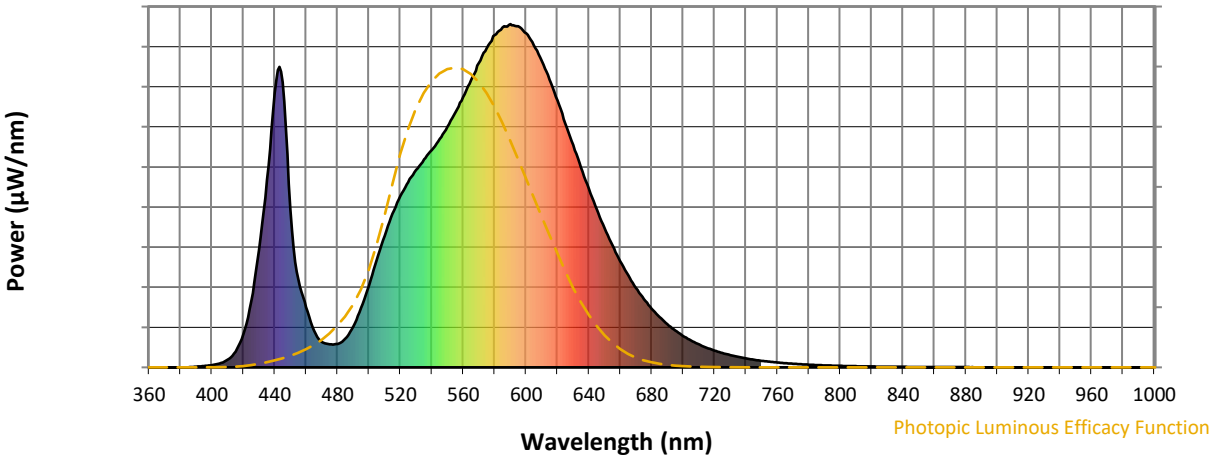


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Scotopic Flux vs. Wavelength

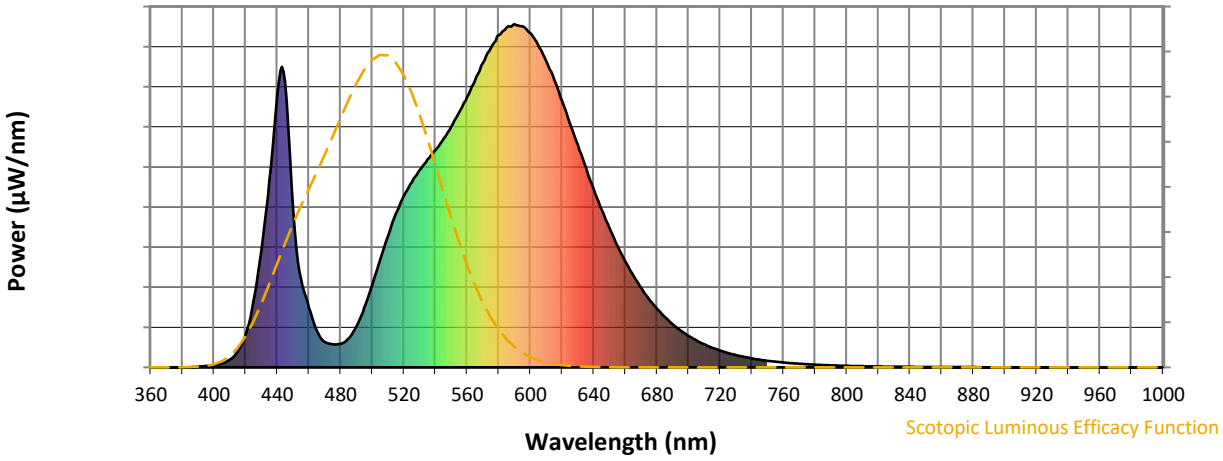


Scotopic Lumens: NR **S/P: 1.29**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Melanopic Flux vs. Wavelength

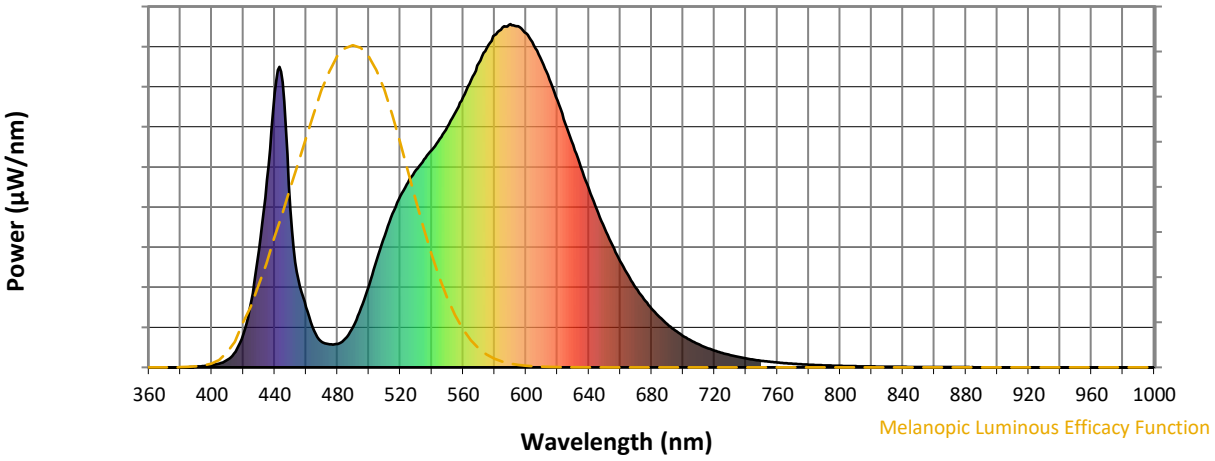

Melanopic Lumens: NR **M/P: 2.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			


REPORT NUMBER: SP1-2407-184-5

TM-30-18


Summary


R_f = 71.4
R_g = 96
CIE R_a = 70.1
R_9 = -40.2


Spectral Power Distribution Comparison

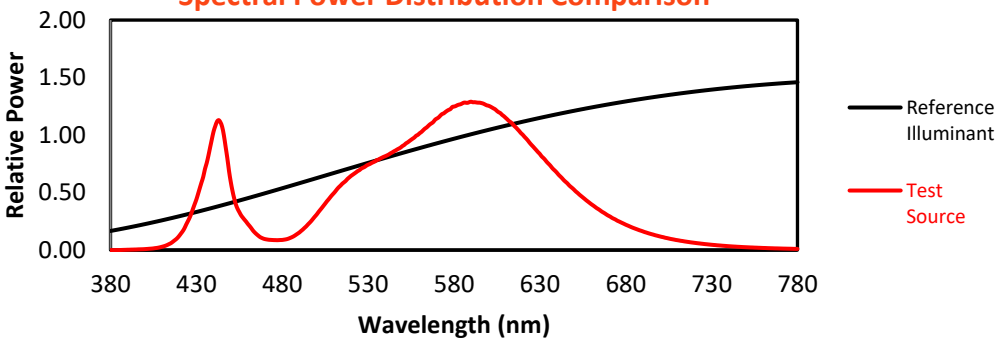


Color Vector Graphics

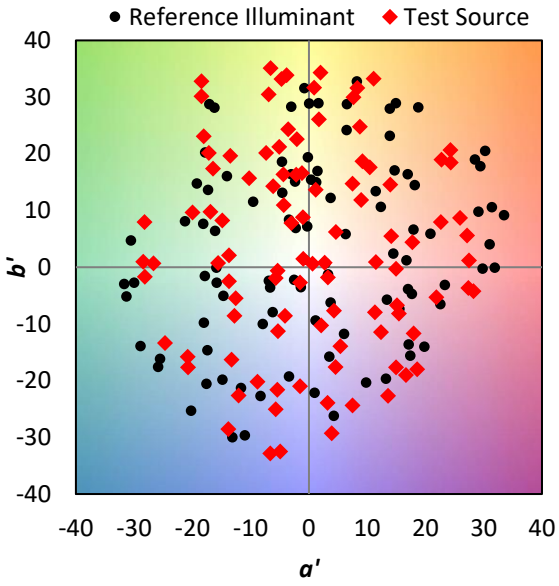

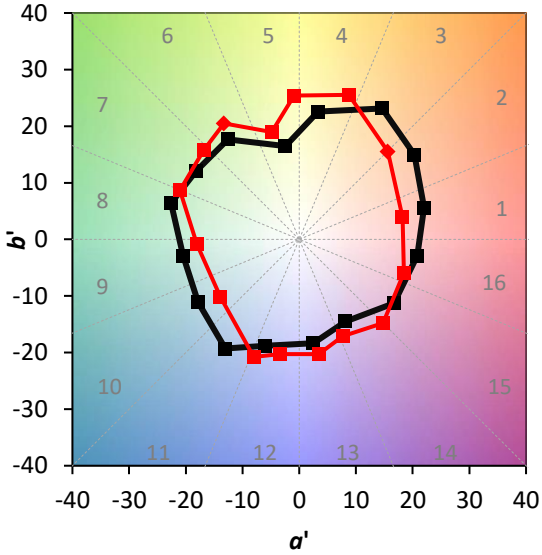

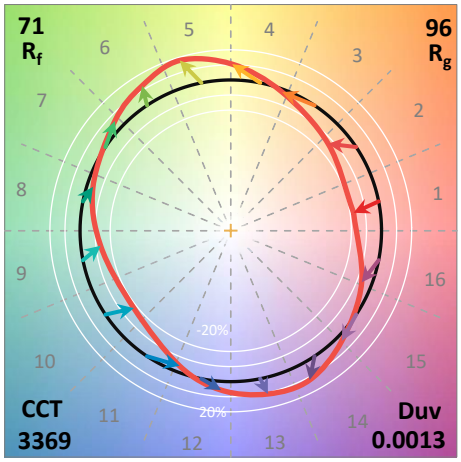

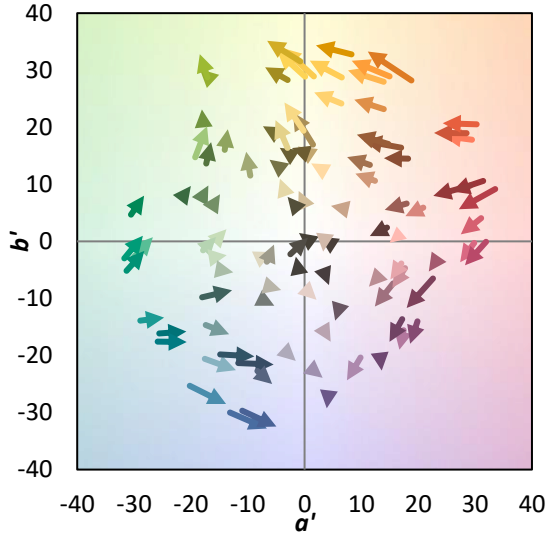


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 57	CES51 = 84	CES76 = 50
CES02 = 62	CES27 = 80	CES52 = 86	CES77 = 74
CES03 = 31	CES28 = 81	CES53 = 72	CES78 = 54
CES04 = 70	CES29 = 50	CES54 = 79	CES79 = 81
CES05 = 48	CES30 = 55	CES55 = 78	CES80 = 79
CES06 = 51	CES31 = 56	CES56 = 67	CES81 = 74
CES07 = 40	CES32 = 54	CES57 = 65	CES82 = 91
CES08 = 39	CES33 = 60	CES58 = 68	CES83 = 86
CES09 = 29	CES34 = 69	CES59 = 85	CES84 = 89
CES10 = 75	CES35 = 83	CES60 = 91	CES85 = 83
CES11 = 58	CES36 = 88	CES61 = 85	CES86 = 66
CES12 = 64	CES37 = 78	CES62 = 78	CES87 = 77
CES13 = 43	CES38 = 64	CES63 = 71	CES88 = 75
CES14 = 74	CES39 = 92	CES64 = 70	CES89 = 68
CES15 = 71	CES40 = 86	CES65 = 64	CES90 = 72
CES16 = 47	CES41 = 81	CES66 = 65	CES91 = 95
CES17 = 50	CES42 = 79	CES67 = 63	CES92 = 62
CES18 = 56	CES43 = 71	CES68 = 69	CES93 = 78
CES19 = 72	CES44 = 98	CES69 = 80	CES94 = 51
CES20 = 65	CES45 = 80	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 75	CES71 = 58	CES96 = 76
CES22 = 79	CES47 = 71	CES72 = 85	CES97 = 82
CES23 = 92	CES48 = 61	CES73 = 51	CES98 = 72
CES24 = 91	CES49 = 74	CES74 = 94	CES99 = 60
CES25 = 72	CES50 = 83	CES75 = 57	

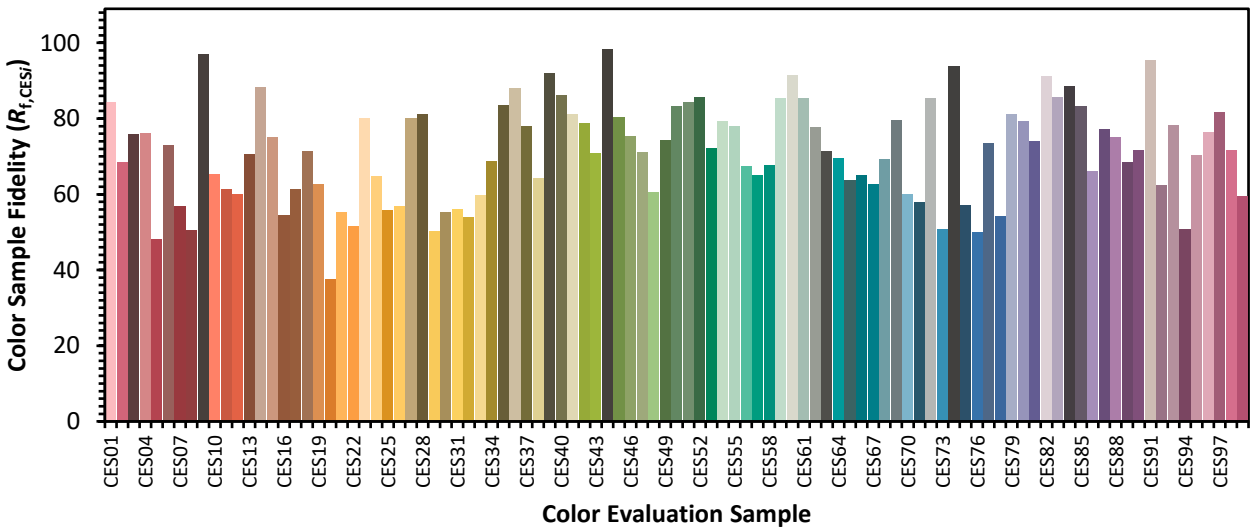



REPORT NUMBER: SP1-2407-184-5

TM-30-18

Color Rendition by Hue-Angle Bin

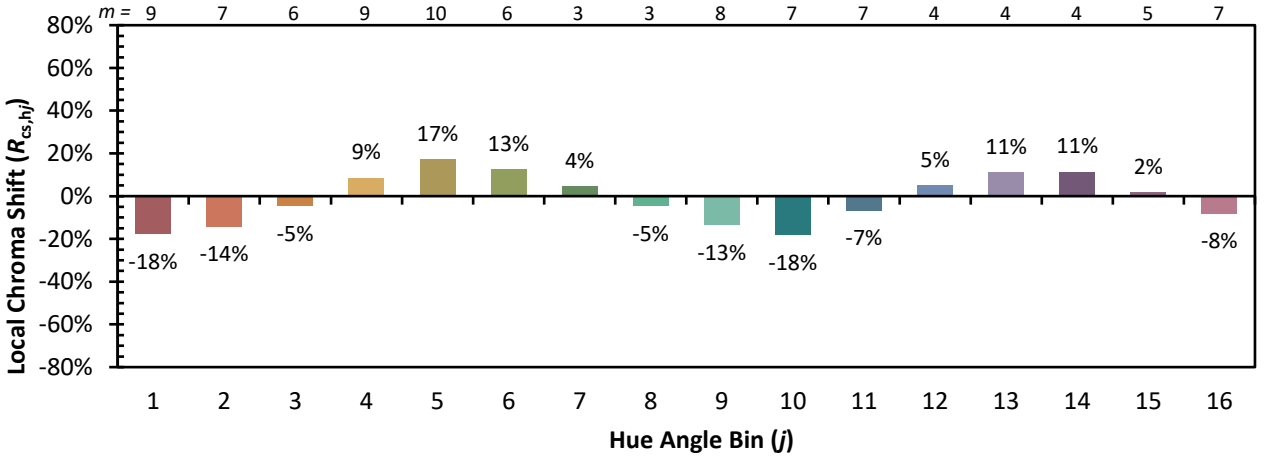

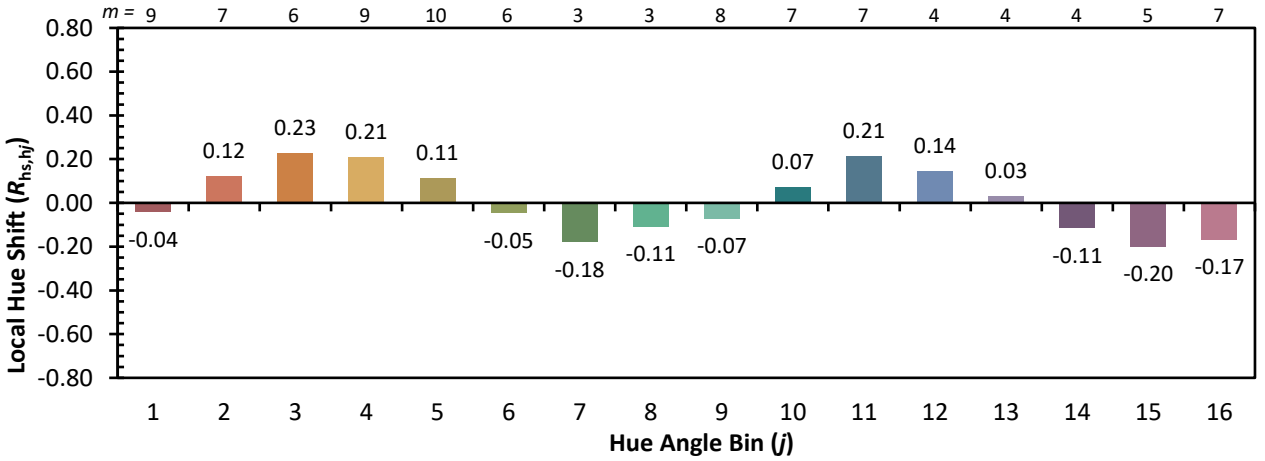


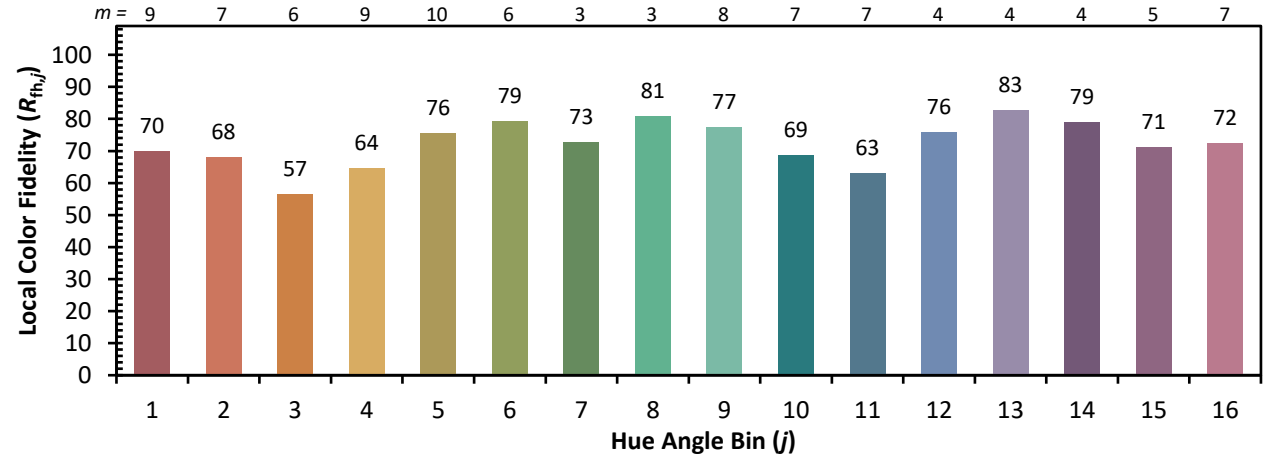


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Measure Comparisons

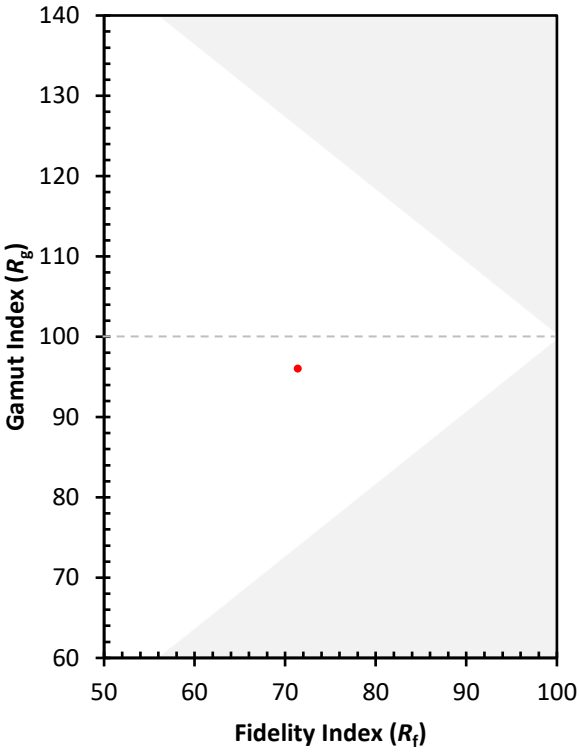

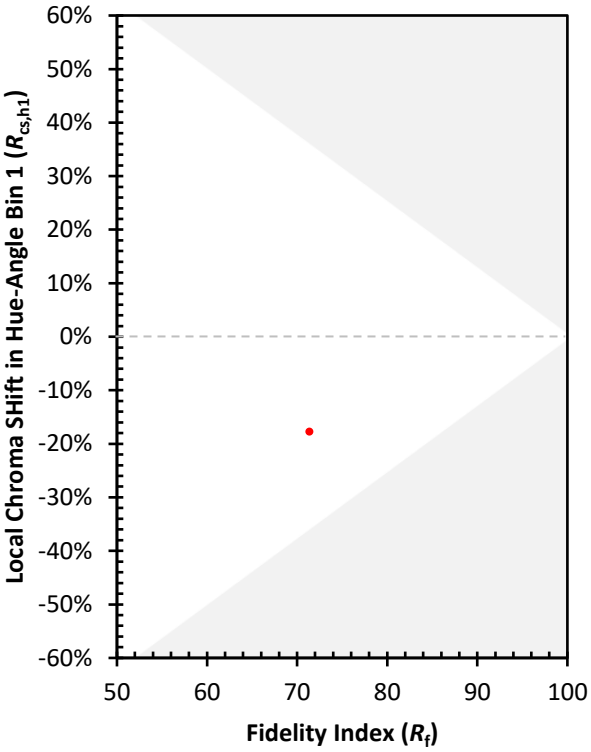

(END OF REPORT)