Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1359629

Luminaire Tested: **GSS-SB6C-735-U-T2-HSS**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1359629
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB6C-735-U-T2-HSS
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 6SQUARE 300W 70CRI 3500K FIXTURE w/ TYPE II DISTRIBUTION OPTIC AND HOUSE SIDE SHIELD
Light Source:	(156) 3500K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	33663.9 lumens
Efficiency:	N/A
Efficacy:	112.2 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 1' x H: 0')
IES Classification:	Type II - Medium
BUG Rating:	B2 - U0 - G4


Input Watts (W):	300
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	6.3%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1359629
CATALOG NUMBER: GSS-SB6C-735-U-T2-HSS

Iso-Footcandle Lines of Horizontal Illumination

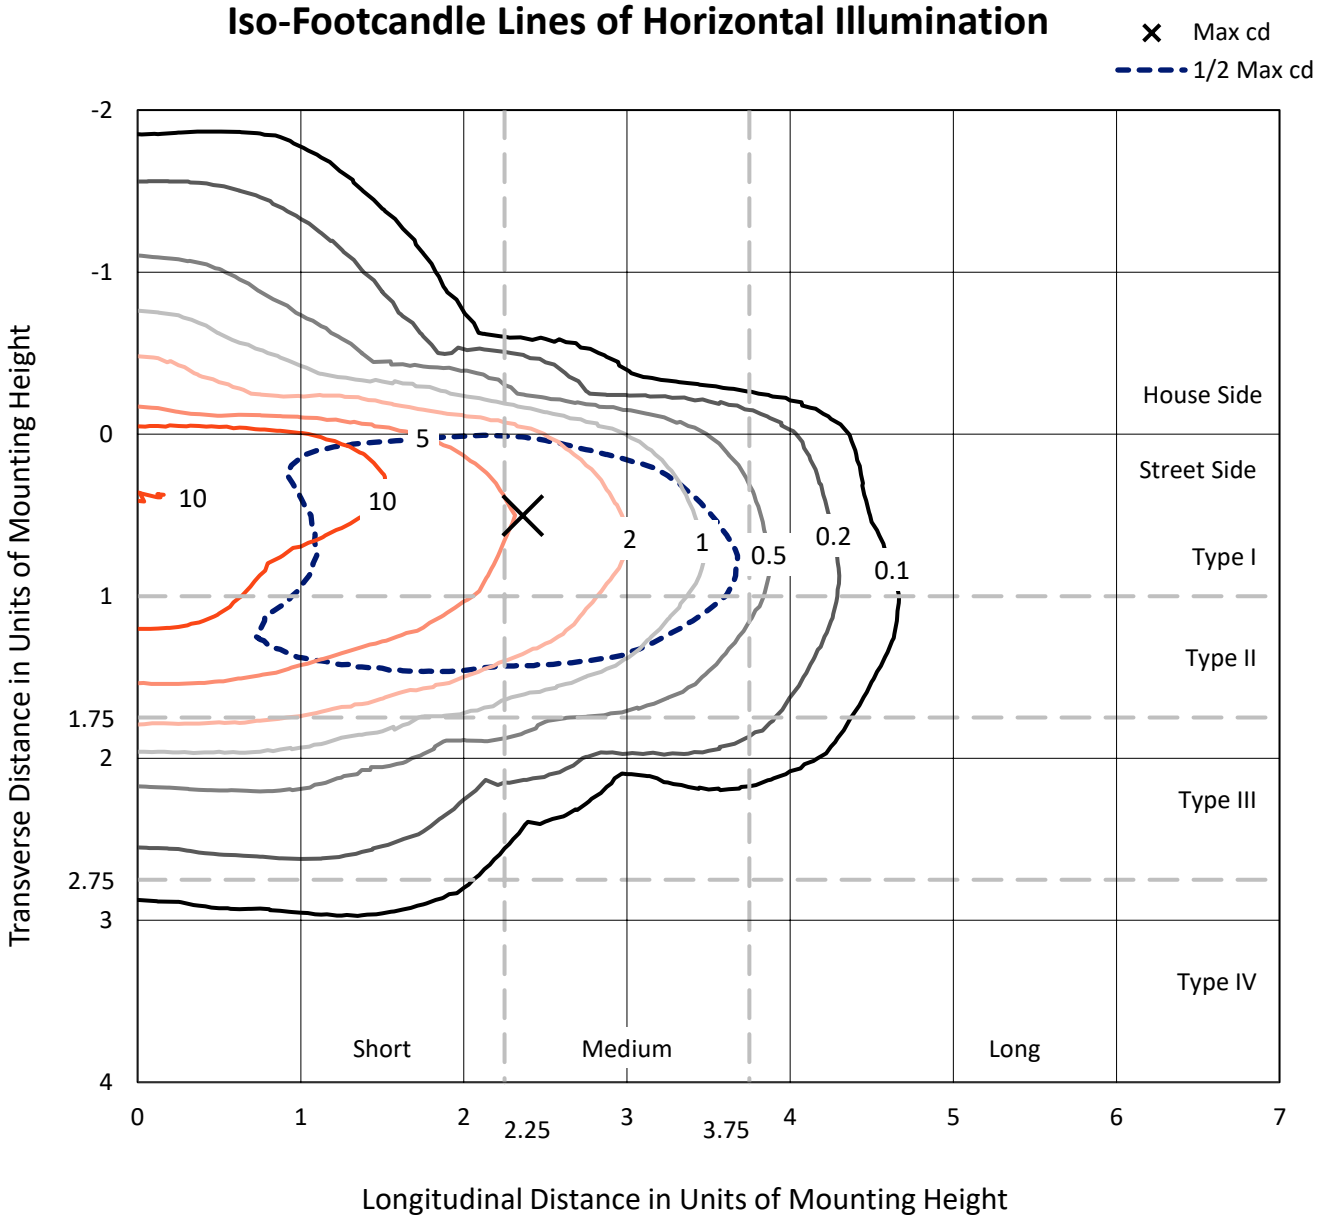


Based on 20 foot mounting height. Maximum calculated value = 17 fc
Type II - Medium - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1359629
CATALOG NUMBER: GSS-SB6C-735-U-T2-HSS

Luminous Intensity Polar Plot

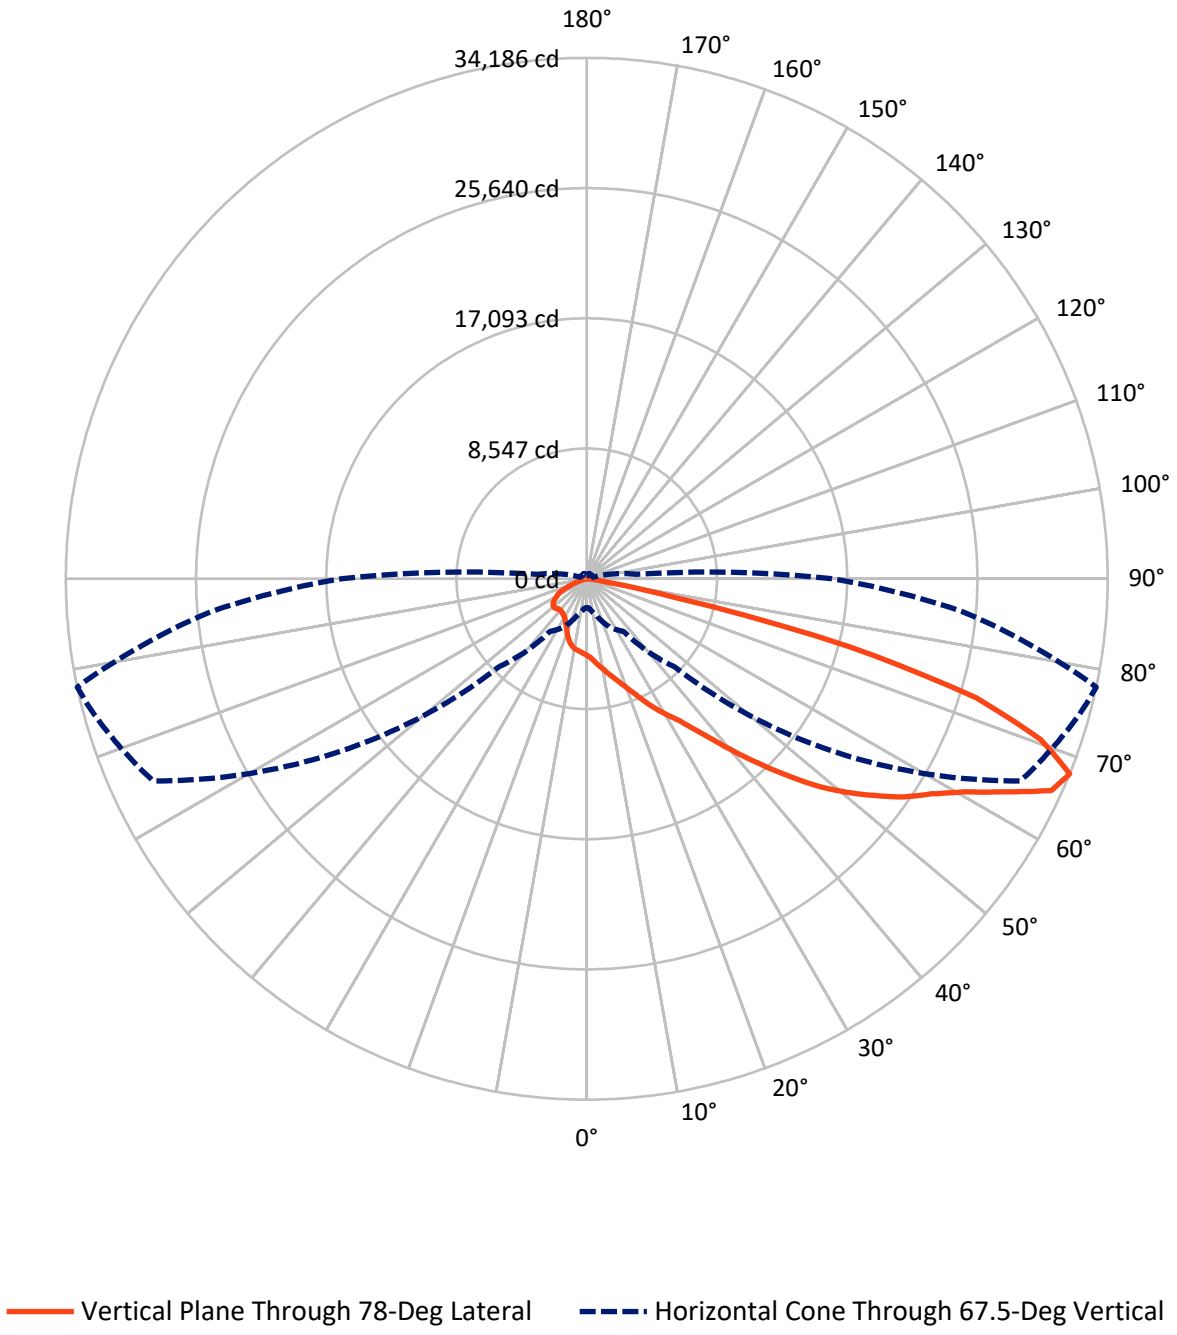

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1359629
CATALOG NUMBER: GSS-SB6C-735-U-T2-HSS

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	3612.5	0.0	3612.5
	% Fixture	10.7	0.0	10.7
Street Side	Lumens	30051.4	0.0	30051.4
	% Fixture	89.3	0.0	89.3
Total	Lumens	33663.9	0.0	33663.9
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	454.1	1.3
10°-20°	1236.1	3.7
20°-30°	2033.8	6.0
30°-40°	3552.3	10.6
40°-50°	6044.0	18.0
50°-60°	8717.3	25.9
60°-70°	8413.8	25.0
70°-80°	3090.7	9.2
80°-90°	121.8	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	33663.9	100.0
0°-180°	33663.9	100.0

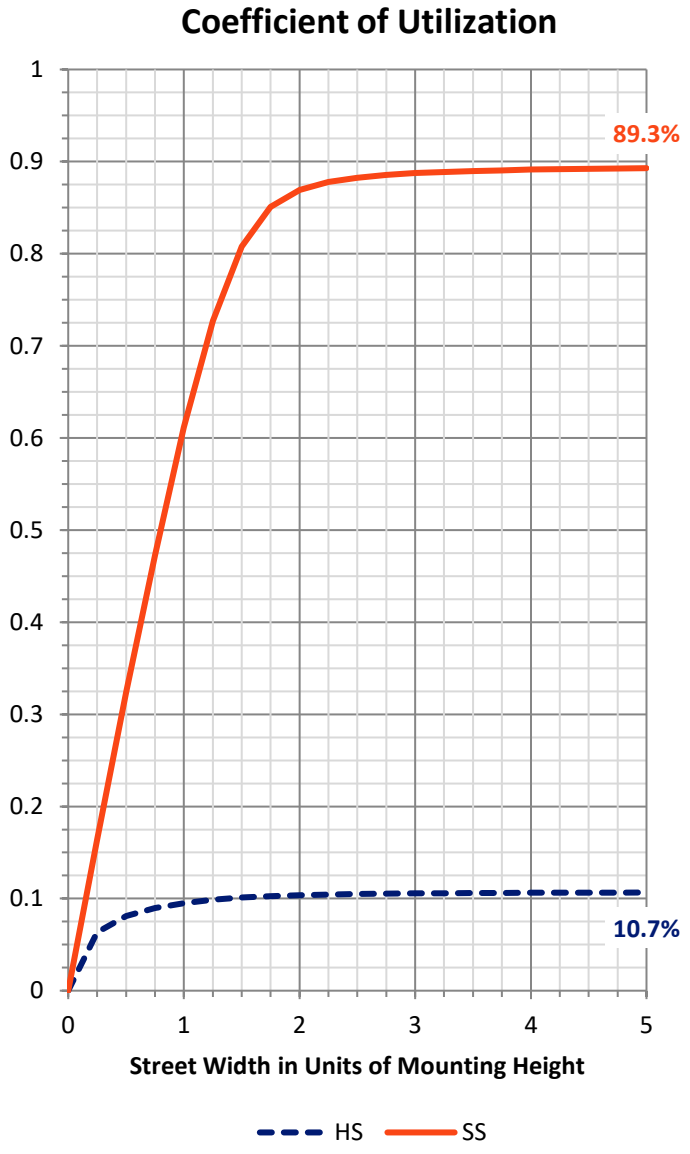

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1359629
CATALOG NUMBER: GSS-SB6C-735-U-T2-HSS

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	2773.8	8.2			
FM	(30°-60°)	16492.9	49.0			
FH	(60°-80°)	10685.7	31.7			G4/12000
FVH	(80°-90°)	98.9	0.3			G1/100
BL	(0°-30°)	950.2	2.8	B2/1000		
BM	(30°-60°)	1820.6	5.4	B2/2500		
BH	(60°-80°)	818.9	2.4	B2/1000		G2/1000
BVH	(80°-90°)	22.9	0.1			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B2-U0-G4
Type II Medium

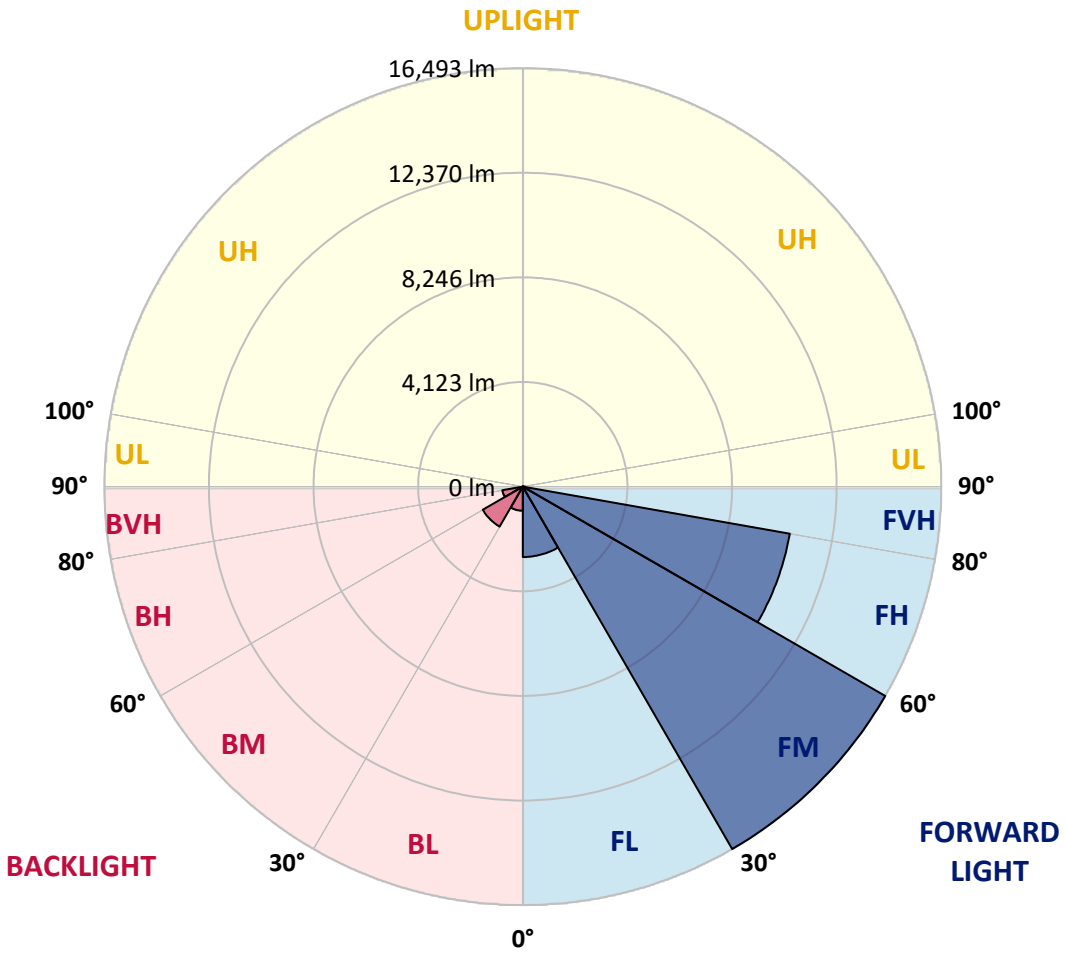

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1359629
CATALOG NUMBER: GSS-SB6C-735-U-T2-HSS

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	78°	85°
0°	5038.7	5038.7	5038.7	5038.7	5038.7	5038.7	5038.7	5038.7	5038.7	*5038.7*	5038.7
2.5°	5576.6	5567.1	5586.0	5548.3	5557.7	5510.5	5406.7	5340.7	5255.7	*5199.1*	5133.1
5°	5982.3	5991.7	5972.9	5982.3	5954.0	5887.9	5831.3	5661.5	5520.0	*5463.3*	5321.8
7.5°	6114.4	6133.3	6133.3	6180.5	6208.8	6237.1	6189.9	6010.6	5821.9	*5746.4*	5510.5
10°	6114.4	6114.4	6180.5	6246.5	6378.6	6473.0	6463.5	6397.5	6161.6	*6048.4*	5784.2
12.5°	5944.6	5935.1	6020.1	6208.8	6388.0	6605.1	6765.5	6708.9	6491.8	*6406.9*	6020.1
15°	5472.8	5482.2	5642.6	5925.7	6284.3	6652.2	6925.9	7048.6	6897.6	*6765.5*	6378.6
17.5°	4850.0	4887.8	5076.5	5472.8	6010.6	6605.1	7124.0	7416.6	7322.2	*7199.5*	6727.7
20°	4623.5	4633.0	4736.8	5019.9	5633.2	6425.8	7180.7	7812.9	7888.3	*7690.2*	7105.2
22.5°	4972.7	5010.4	4972.7	4991.5	5378.4	6208.8	7237.3	8162.0	8435.6	*8246.9*	7558.1
25°	5614.3	5576.6	5472.8	5387.9	5453.9	6048.4	7265.6	8605.5	9124.4	*8964.0*	8152.5
27.5°	6340.9	6255.9	6171.0	5972.9	5840.8	6142.7	7359.9	8869.7	9766.1	*9643.4*	8690.4
30°	7463.7	7444.9	7190.1	6737.2	6406.9	6510.7	7510.9	9143.3	10502.1	*10351.1*	9237.7
32.5°	8784.7	8737.6	8407.3	7794.0	7209.0	7029.7	7812.9	9407.5	11323.0	*11058.8*	9945.3
35°	10105.8	10096.3	9898.2	9001.8	8209.2	7737.4	8350.7	9813.2	12276.0	*12087.3*	10709.7
37.5°	11162.6	11228.6	11351.3	10152.9	9388.6	8671.5	9067.8	10464.3	13474.3	*13342.2*	11672.1
40°	12040.1	12153.3	12313.7	11304.1	10483.2	9794.4	10039.7	11530.6	14918.0	*14899.2*	12823.3
42.5°	12795.0	12974.2	12842.1	12266.6	11511.7	10936.1	11106.0	12757.2	16484.4	*16569.3*	14144.3
45°	13681.9	13795.2	13804.6	13200.7	12502.5	12106.2	12389.2	14153.7	18296.0	*18399.8*	15550.2
47.5°	14653.8	14616.1	14682.1	14238.6	13606.4	13247.9	13757.4	15635.1	19947.3	*20315.3*	16984.5
50°	15427.6	15559.7	15663.5	15418.1	14833.1	14521.7	15106.7	17163.7	21579.7	*22004.3*	18343.2
52.5°	15512.5	15588.0	16116.4	16352.3	16324.0	15823.9	16503.2	18588.6	22976.2	*23636.7*	19447.2
55°	14285.8	14814.2	15682.3	16493.8	17560.1	17645.0	17833.7	19947.3	24202.9	*25278.5*	20390.8
57.5°	11738.2	12134.5	13653.6	15588.0	17635.5	19400.0	20136.0	21419.3	25457.8	*26637.3*	21485.4
60°	7992.1	7831.7	9605.7	13342.2	16503.2	20088.9	23231.0	23985.8	26797.7	*28382.9*	22664.8
62.5°	4340.5	4453.7	5548.3	8596.0	13181.8	19107.5	25882.4	28505.6	29213.3	*30789.1*	24033.0
65°	2783.6	2887.4	3566.7	4897.2	7718.5	14918.0	25372.9	32374.3	32317.7	*33506.6*	25118.1
67.5°	*1906.0*	*1953.2*	*2500.5*	*3472.4*	*4217.8*	*8218.6*	*19730.3*	*31402.4*	*33619.8*	*34186.0*	*24759.6*
70°	1283.3	1330.4	1773.9	2566.5	3028.9	3604.5	11757.0	25910.7	31242.0	*31600.5*	21910.0
72.5°	811.5	858.7	1075.7	1717.3	2283.5	2038.1	5397.3	18069.6	25995.7	*26722.2*	18739.5
75°	462.4	490.7	669.9	1188.9	1443.7	1339.9	1453.1	11313.5	17456.3	*17767.6*	12474.1
77.5°	235.9	254.8	424.6	764.3	924.7	745.4	773.7	4925.5	6095.5	*5869.1*	3425.2
80°	113.2	132.1	264.2	462.4	603.9	424.6	452.9	1113.4	1462.6	*1245.5*	802.0
82.5°	56.6	56.6	169.8	188.7	330.3	254.8	198.2	386.9	547.3	*556.7*	368.0
85°	37.7	28.3	47.2	66.1	75.5	103.8	113.2	160.4	179.3	*188.7*	141.5
87.5°	0.0	0.0	9.4	9.4	18.9	28.3	47.2	66.1	66.1	*75.5*	66.1
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	*0.0*	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1359629
CATALOG NUMBER: GSS-SB6C-735-U-T2-HSS

CANDELA DISTRIBUTION (continued):

	90°	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
0°	5038.7	5038.7	5038.7	5038.7	5038.7	5038.7	5038.7	5038.7	5038.7	5038.7	5038.7
2.5°	5095.3	5067.0	4887.8	4736.8	4604.7	4510.3	4387.7	4359.3	4283.9	4236.7	4246.1
5°	5180.3	5048.2	4717.9	4434.8	4123.5	3812.1	3538.4	3444.1	3255.4	3189.3	3208.2
7.5°	5284.1	5123.6	4585.8	4029.1	3491.3	3094.9	2708.1	2472.2	2283.5	2208.0	2198.5
10°	5482.2	5208.6	4425.4	3623.4	2877.9	2340.1	2000.4	1868.3	1802.2	1783.4	1783.4
12.5°	5689.8	5302.9	4208.4	3132.7	2274.0	1858.9	1726.8	1689.0	1670.1	1660.7	1660.7
15°	5897.4	5369.0	3897.0	2538.2	1849.4	1679.6	1623.0	1604.1	1575.8	1566.3	1585.2
17.5°	6189.9	5416.2	3538.4	2075.9	1660.7	1575.8	1519.2	1500.3	1472.0	1462.6	1472.0
20°	6444.7	5491.6	3123.3	1773.9	1547.5	1481.4	1405.9	1368.2	1358.8	1349.3	1349.3
22.5°	6746.6	5576.6	2642.0	1604.1	1453.1	1358.8	1273.8	1245.5	1226.7	1226.7	1226.7
25°	7171.2	5642.6	2255.2	1528.6	1349.3	1236.1	1151.2	1122.9	1113.4	1104.0	1113.4
27.5°	7529.8	5642.6	2000.4	1481.4	1264.4	1132.3	1056.8	1037.9	1019.1	1000.2	1009.6
30°	7869.5	5520.0	1811.7	1443.7	1207.8	1047.4	990.8	953.0	934.1	905.8	905.8
32.5°	8256.3	5406.7	1736.2	1405.9	1151.2	981.3	924.7	896.4	877.5	849.2	849.2
35°	8671.5	5208.6	1726.8	1377.6	1094.6	934.1	877.5	858.7	830.4	811.5	811.5
37.5°	9256.5	5085.9	1707.9	1339.9	1047.4	887.0	830.4	820.9	802.0	783.2	792.6
40°	10039.7	5076.5	1670.1	1311.6	1009.6	839.8	792.6	773.7	773.7	754.9	754.9
42.5°	10794.6	5114.2	1670.1	1255.0	971.9	792.6	754.9	745.4	726.6	698.3	698.3
45°	11719.3	5255.7	1689.0	1198.3	934.1	764.3	726.6	707.7	688.8	669.9	669.9
47.5°	12577.9	5435.0	1707.9	1141.7	896.4	736.0	707.7	698.3	669.9	651.1	660.5
50°	13304.5	5652.1	1660.7	1085.1	839.8	726.6	688.8	679.4	641.6	632.2	641.6
52.5°	13955.6	5784.2	1519.2	1028.5	783.2	707.7	669.9	660.5	622.8	613.3	603.9
55°	14455.7	5831.3	1358.8	943.6	736.0	679.4	641.6	622.8	594.5	575.6	566.1
57.5°	14946.3	5642.6	1151.2	830.4	679.4	632.2	603.9	585.0	547.3	509.5	500.1
60°	15512.5	5406.7	962.5	688.8	613.3	585.0	556.7	537.8	490.7	424.6	424.6
62.5°	16173.0	5293.5	764.3	566.1	537.8	509.5	509.5	490.7	415.2	349.1	339.7
65°	16663.6	4614.1	585.0	471.8	462.4	434.0	443.5	434.0	349.1	264.2	254.8
67.5°	*16078.6*	*3302.5*	*452.9*	*396.3*	*386.9*	*349.1*	*377.4*	*368.0*	*301.9*	*226.5*	*207.6*
70°	13729.1	2151.4	368.0	330.3	311.4	264.2	311.4	320.8	254.8	179.3	169.8
72.5°	11681.5	1377.6	292.5	264.2	217.0	188.7	245.3	273.6	207.6	141.5	132.1
75°	8086.5	868.1	217.0	198.2	151.0	132.1	198.2	217.0	169.8	94.4	94.4
77.5°	2670.3	434.0	160.4	132.1	103.8	94.4	151.0	160.4	113.2	66.1	56.6
80°	509.5	207.6	113.2	84.9	75.5	56.6	94.4	84.9	47.2	37.7	37.7
82.5°	245.3	122.7	84.9	66.1	37.7	37.7	28.3	37.7	37.7	28.3	28.3
85°	113.2	75.5	56.6	37.7	28.3	18.9	18.9	28.3	28.3	28.3	18.9
87.5°	66.1	56.6	37.7	28.3	18.9	18.9	18.9	18.9	18.9	18.9	9.4
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-5

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-735-U-5WQ

Data in this report applies to families of products including GSS-SB1A-735-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-735-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 3500K CCT 26 LEDS

Spectral Parameters

CCT (K):	3369
CIE u':	0.2386
CIE v':	0.5156
Duv:	0.0013
CIE x:	0.4143
CIE y:	0.3980
CIE z:	0.1877
Peak Wavelength (nm):	590
Dominant Wavelength (nm):	580
Purity:	43.80166
Rf:	71.4
Rg:	96

CRI (Ra):	70.1
R1:	66.6
R2:	77.6
R3:	88.5
R4:	69.5
R5:	66.4
R6:	69.6
R7:	77.5
R8:	44.9
R9:	-40.2
R10:	49.1
R11:	66.3
R12:	45.7
R13:	68.0
R14:	93.4
R15:	57.6

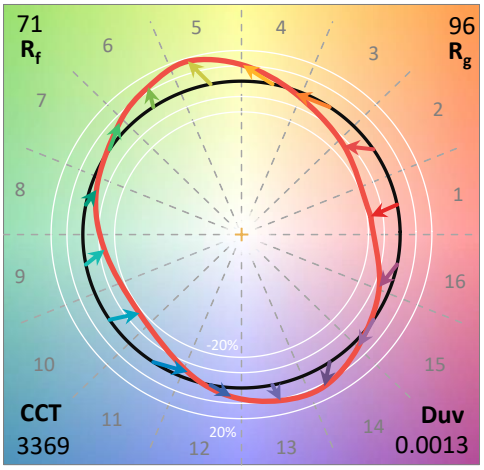

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-5

CIE 1931 Chromaticity Diagram

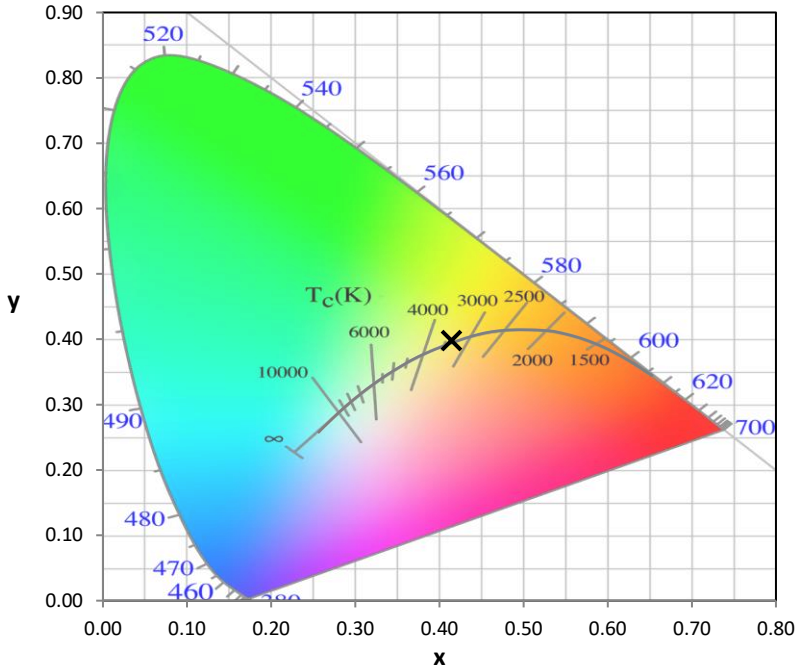

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

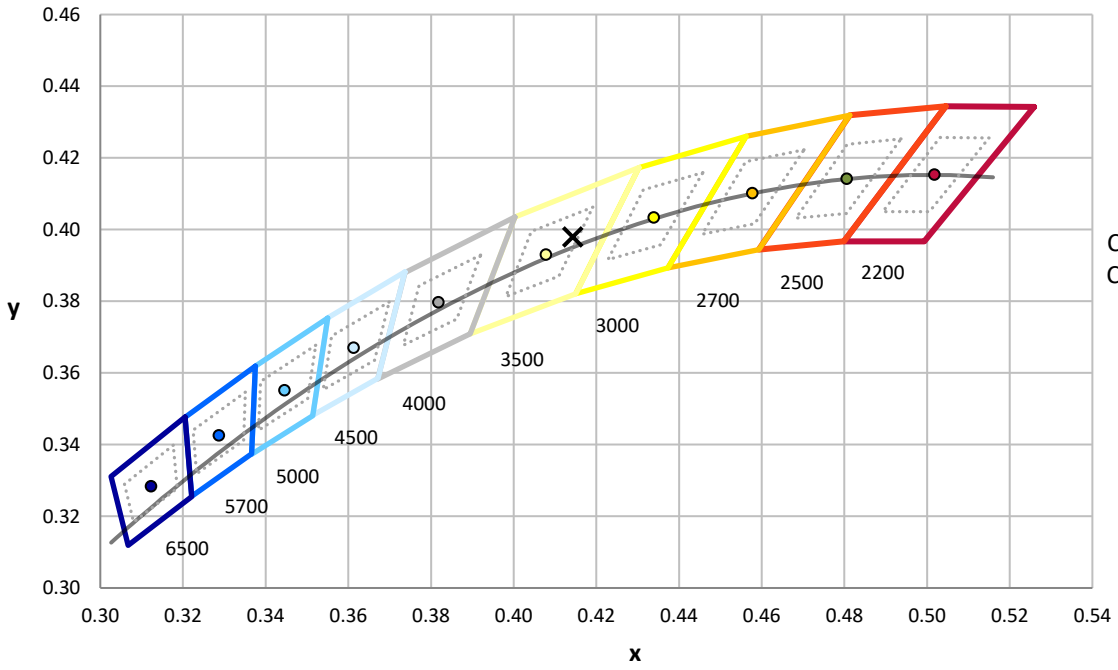


CCT = 3369K
CIE x = 0.4143
CIE y = 0.3980
Duv = 0.0013

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-5

Photopic Flux vs. Wavelength

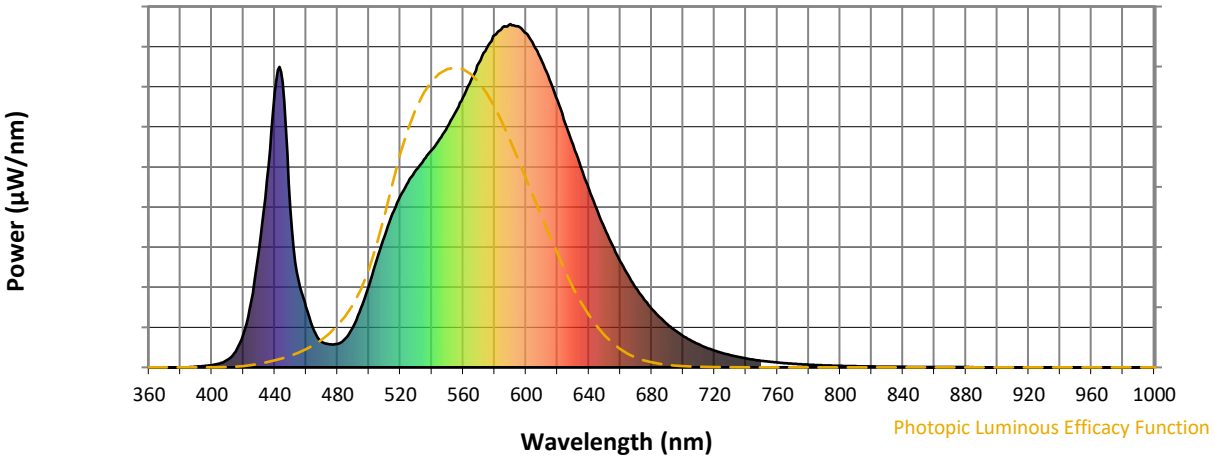


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Scotopic Flux vs. Wavelength

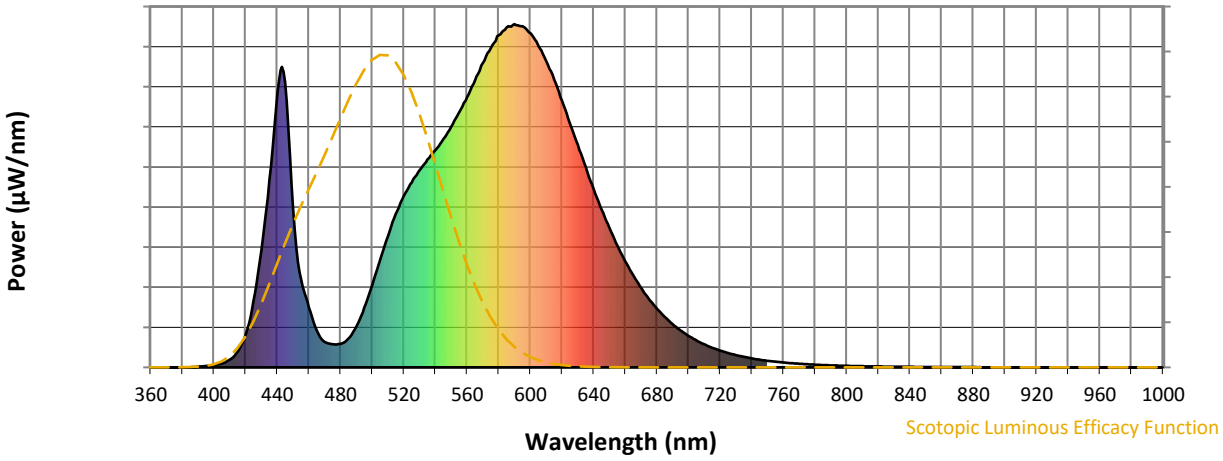


Scotopic Lumens: NR **S/P: 1.29**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Melanopic Flux vs. Wavelength

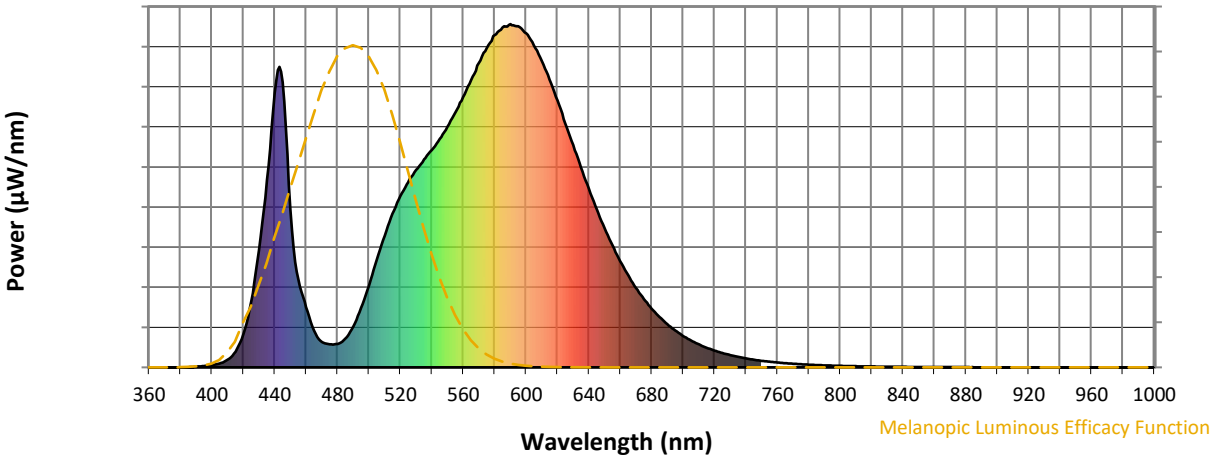

Melanopic Lumens: NR **M/P: 2.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			


REPORT NUMBER: SP1-2407-184-5

TM-30-18


Summary


R_f = 71.4
R_g = 96
CIE R_a = 70.1
R_9 = -40.2


Spectral Power Distribution Comparison

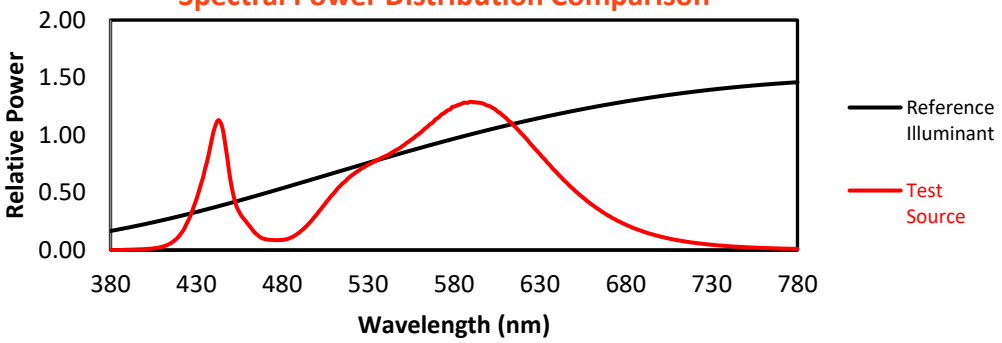


Color Vector Graphics

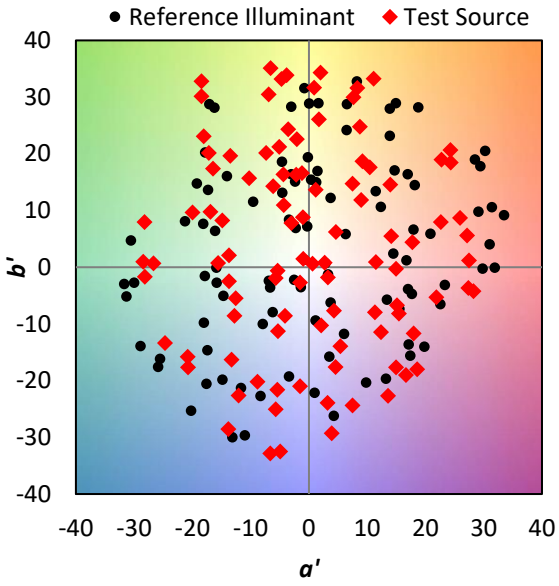

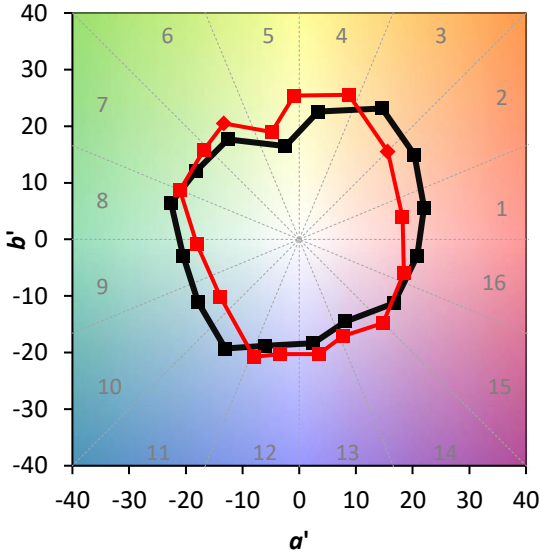

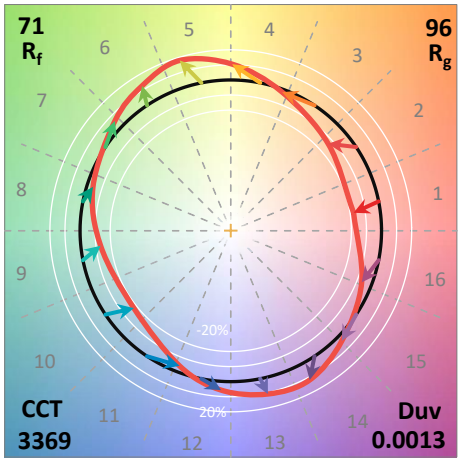

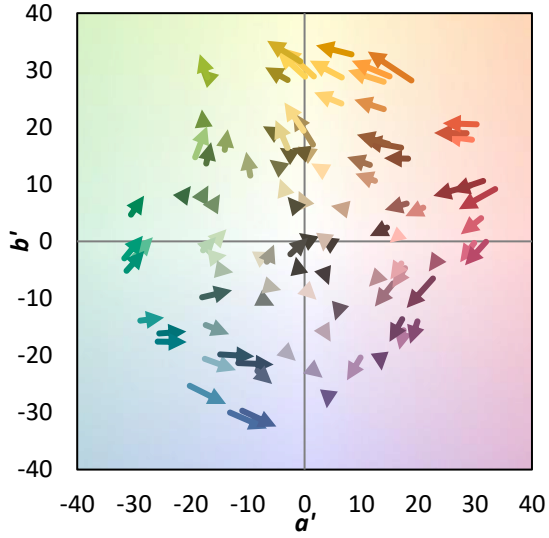


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 57	CES51 = 84	CES76 = 50
CES02 = 62	CES27 = 80	CES52 = 86	CES77 = 74
CES03 = 31	CES28 = 81	CES53 = 72	CES78 = 54
CES04 = 70	CES29 = 50	CES54 = 79	CES79 = 81
CES05 = 48	CES30 = 55	CES55 = 78	CES80 = 79
CES06 = 51	CES31 = 56	CES56 = 67	CES81 = 74
CES07 = 40	CES32 = 54	CES57 = 65	CES82 = 91
CES08 = 39	CES33 = 60	CES58 = 68	CES83 = 86
CES09 = 29	CES34 = 69	CES59 = 85	CES84 = 89
CES10 = 75	CES35 = 83	CES60 = 91	CES85 = 83
CES11 = 58	CES36 = 88	CES61 = 85	CES86 = 66
CES12 = 64	CES37 = 78	CES62 = 78	CES87 = 77
CES13 = 43	CES38 = 64	CES63 = 71	CES88 = 75
CES14 = 74	CES39 = 92	CES64 = 70	CES89 = 68
CES15 = 71	CES40 = 86	CES65 = 64	CES90 = 72
CES16 = 47	CES41 = 81	CES66 = 65	CES91 = 95
CES17 = 50	CES42 = 79	CES67 = 63	CES92 = 62
CES18 = 56	CES43 = 71	CES68 = 69	CES93 = 78
CES19 = 72	CES44 = 98	CES69 = 80	CES94 = 51
CES20 = 65	CES45 = 80	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 75	CES71 = 58	CES96 = 76
CES22 = 79	CES47 = 71	CES72 = 85	CES97 = 82
CES23 = 92	CES48 = 61	CES73 = 51	CES98 = 72
CES24 = 91	CES49 = 74	CES74 = 94	CES99 = 60
CES25 = 72	CES50 = 83	CES75 = 57	

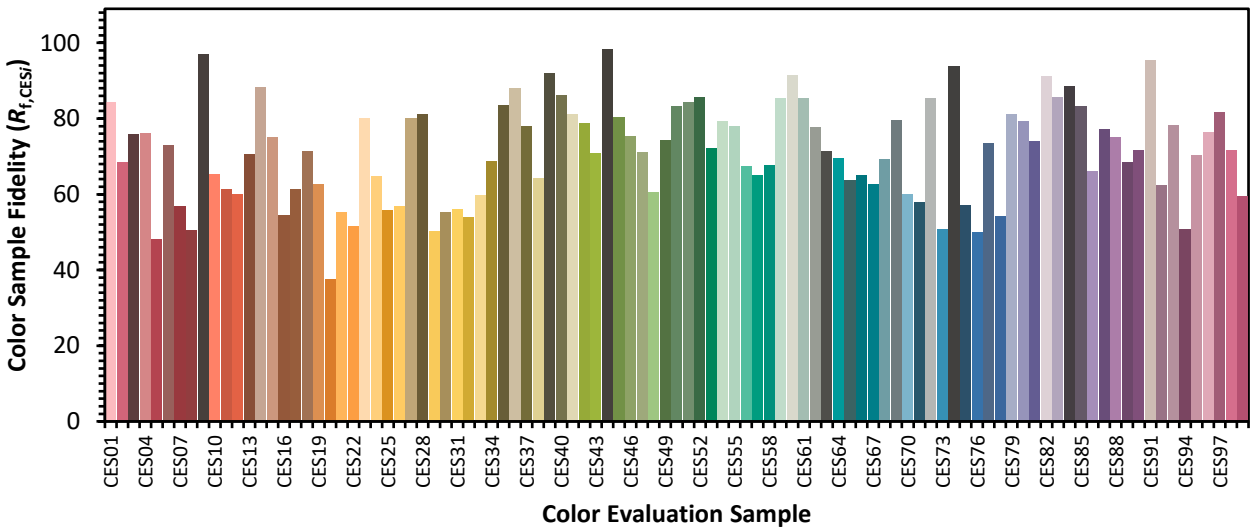



REPORT NUMBER: SP1-2407-184-5

TM-30-18

Color Rendition by Hue-Angle Bin

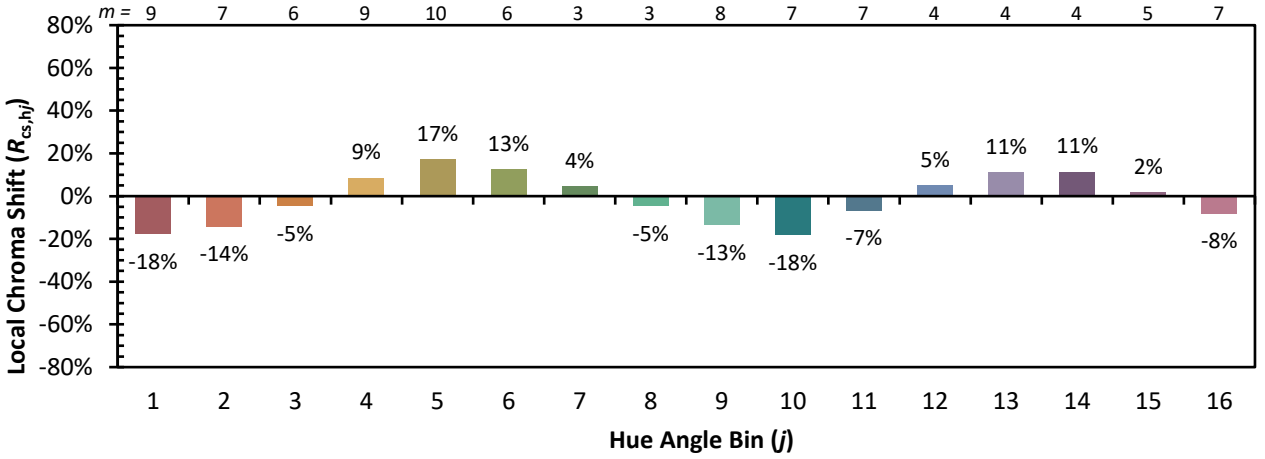

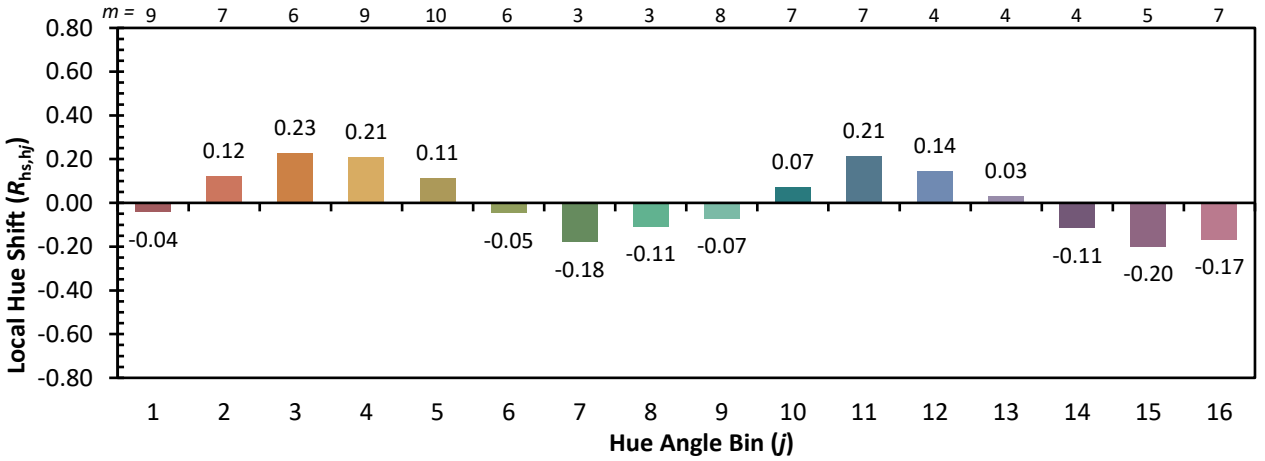


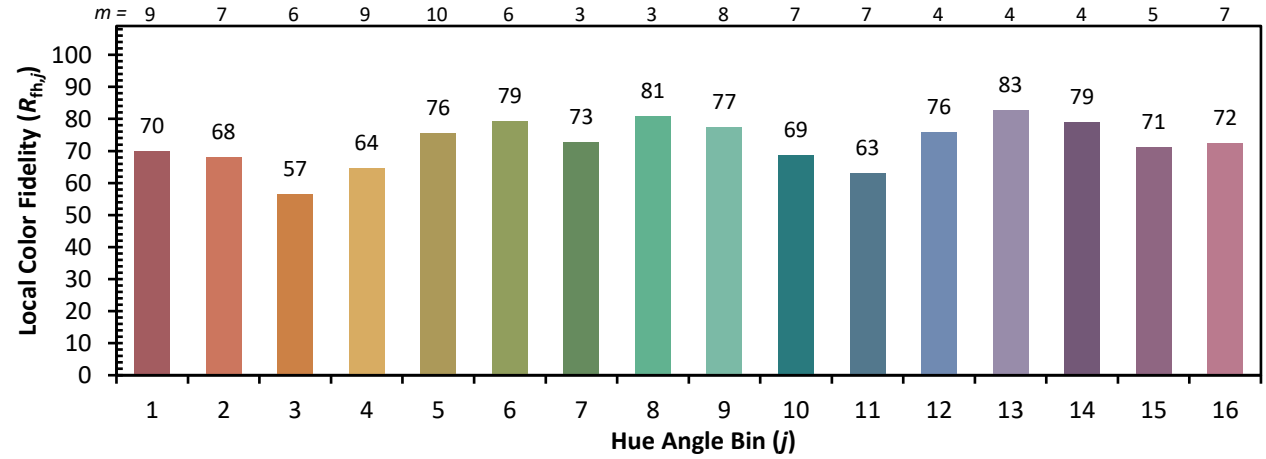


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Measure Comparisons

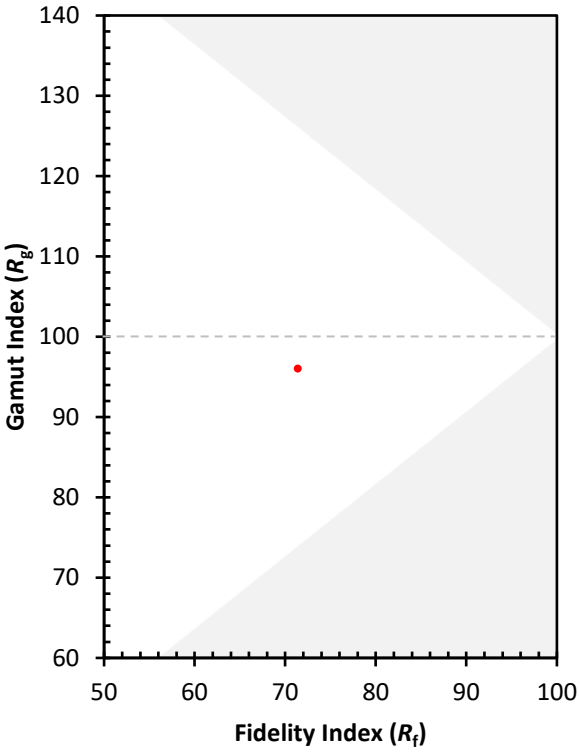

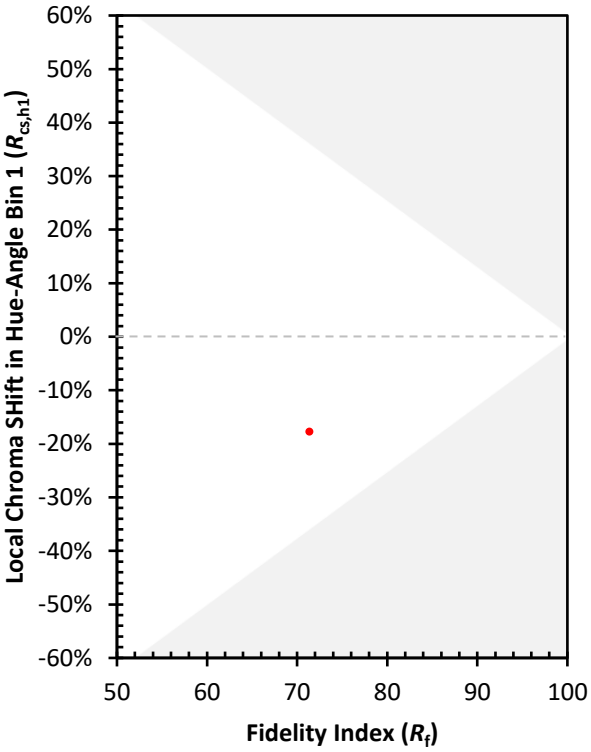

(END OF REPORT)