Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360013

Luminaire Tested: **GSS-SB6C-735-U-T3**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360013
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB6C-735-U-T3
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 6SQUARE 300W 70CRI 3500K FIXTURE w/ TYPE III DISTRIBUTION OPTIC
Light Source:	(156) 3500K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	42376.2 lumens
Efficiency:	N/A
Efficacy:	141.3 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 1' x H: 0')
IES Classification:	Type III - Short
BUG Rating:	B4 - U0 - G5


Input Watts (W):	300
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	6.3%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360013
CATALOG NUMBER: GSS-SB6C-735-U-T3

Iso-Footcandle Lines of Horizontal Illumination

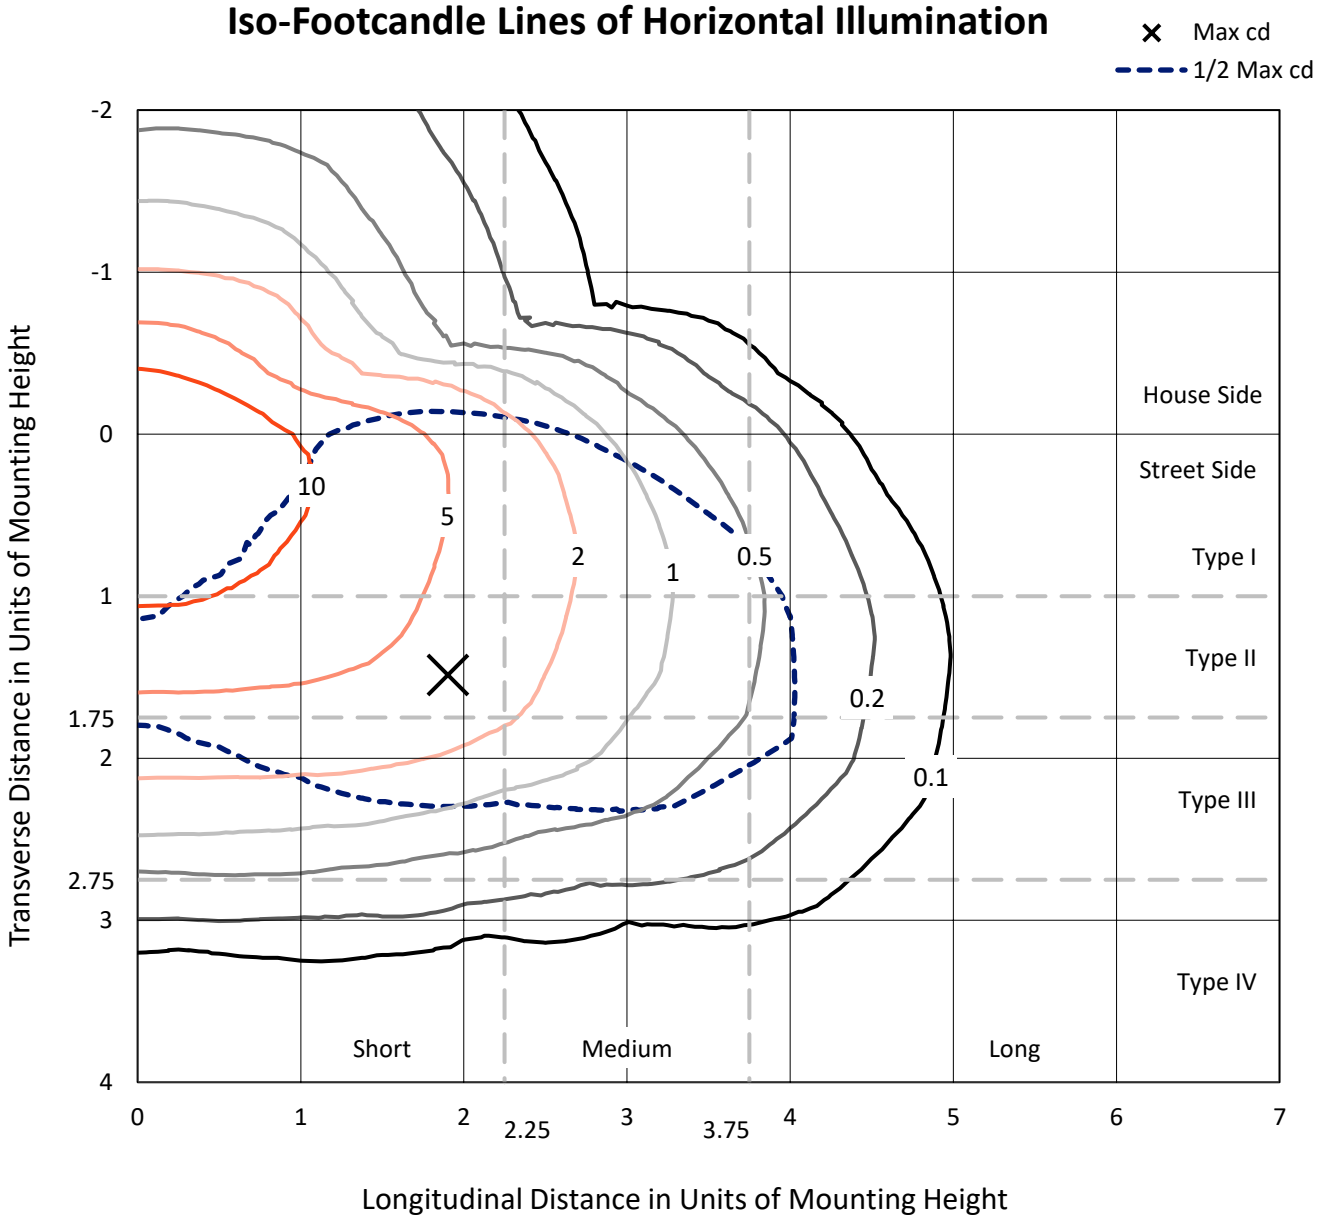


Based on 20 foot mounting height. Maximum calculated value = 18.6 fc
Type III - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360013
CATALOG NUMBER: GSS-SB6C-735-U-T3

Luminous Intensity Polar Plot

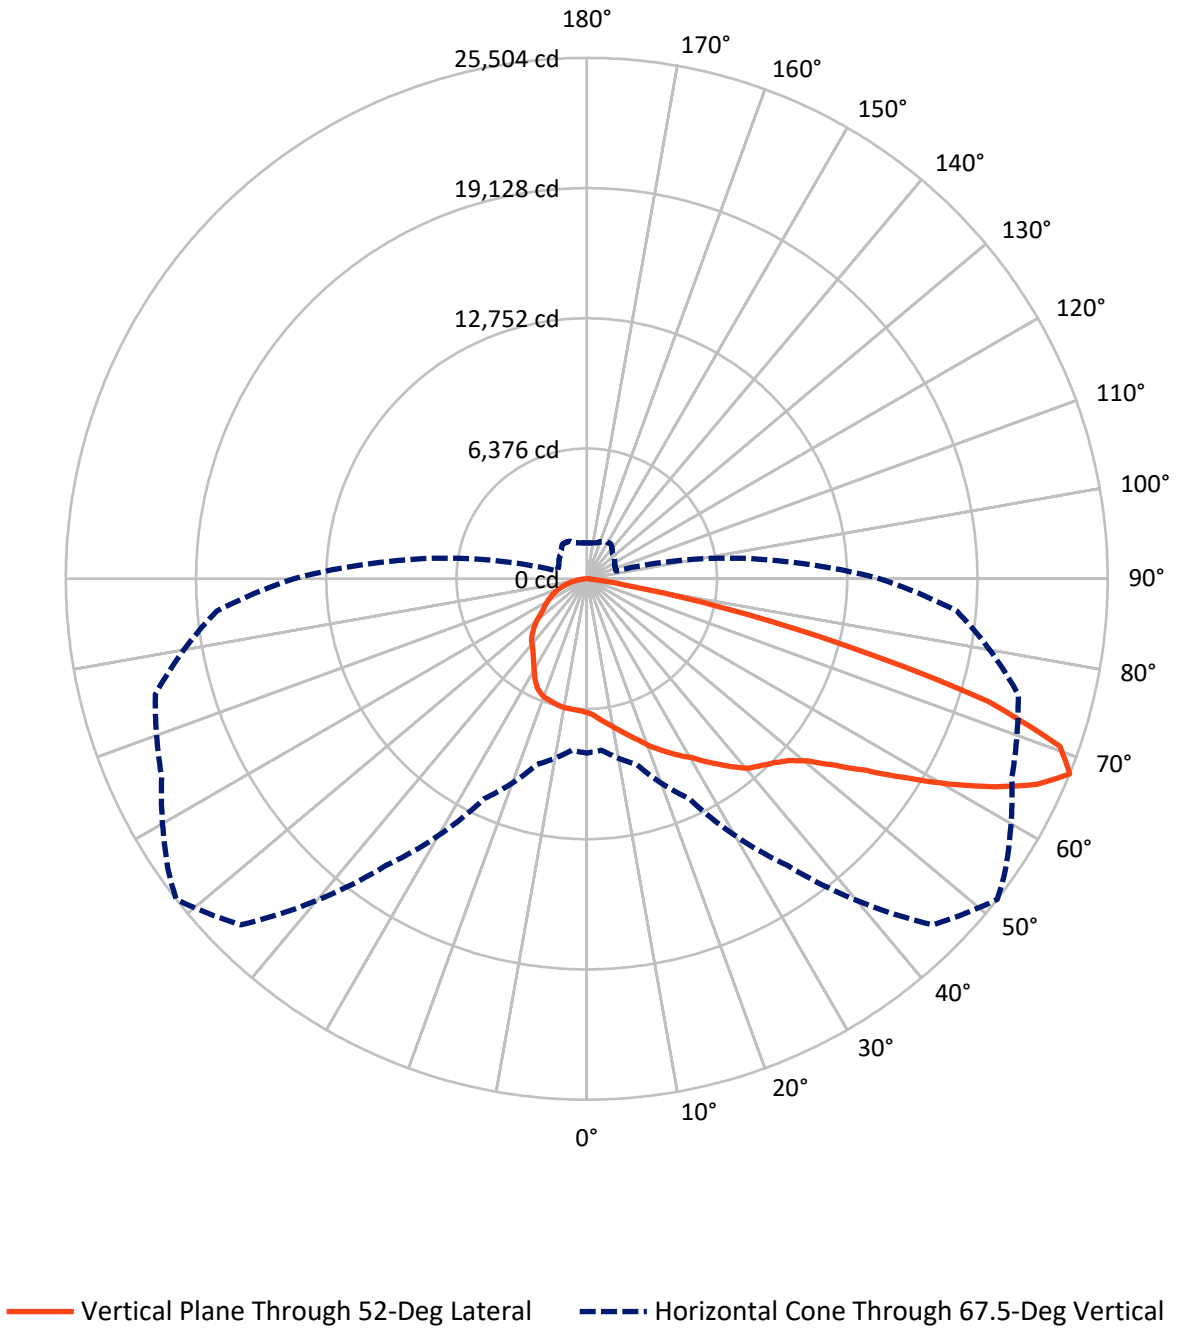

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360013
CATALOG NUMBER: GSS-SB6C-735-U-T3

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	10025.5	0.0	10025.5
	% Fixture	23.7	0.0	23.7
Street Side	Lumens	32350.7	0.0	32350.7
	% Fixture	76.3	0.0	76.3
Total	Lumens	42376.2	0.0	42376.2
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	643.0	1.5
10°-20°	2028.2	4.8
20°-30°	3467.6	8.2
30°-40°	5030.3	11.9
40°-50°	6534.3	15.4
50°-60°	8853.6	20.9
60°-70°	10327.6	24.4
70°-80°	5091.9	12.0
80°-90°	399.7	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	42376.2	100.0
0°-180°	42376.2	100.0

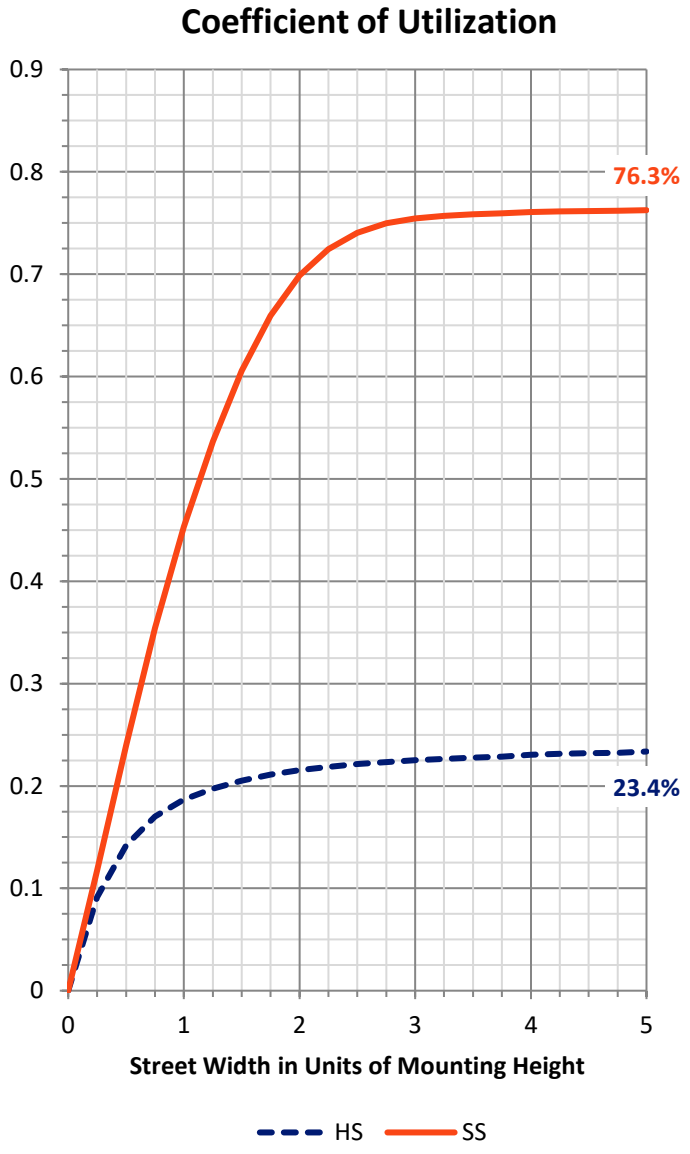

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360013
CATALOG NUMBER: GSS-SB6C-735-U-T3

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	3615.1	8.5			
FM	(30°-60°)	15477.1	36.5			
FH	(60°-80°)	13048.7	30.8			G5
FVH	(80°-90°)	209.8	0.5			G2/225
BL	(0°-30°)	2523.6	6.0	B4/5000		
BM	(30°-60°)	4941.2	11.7	B3/5000		
BH	(60°-80°)	2370.8	5.6	B3/2500		G3/2500
BVH	(80°-90°)	189.9	0.4			G2/225
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B4-U0-G5
Type III Short

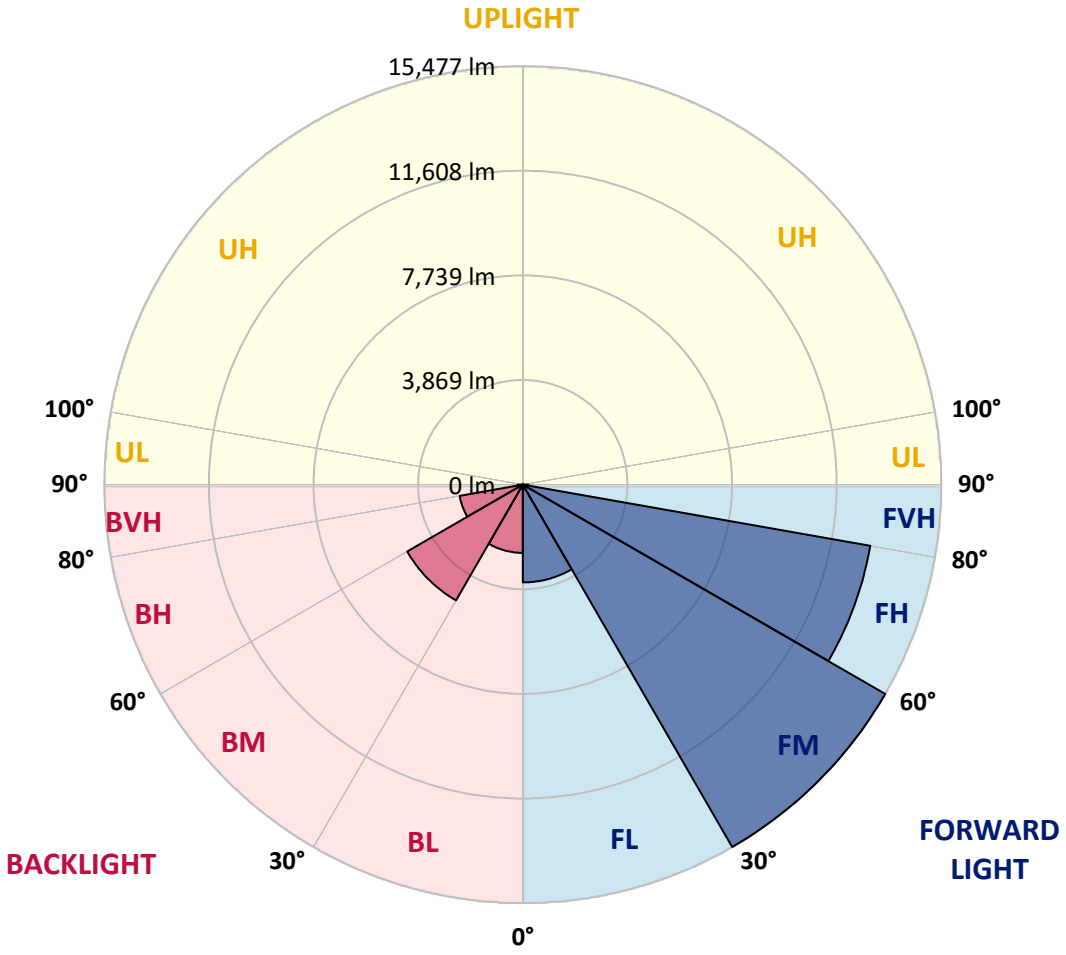

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360013
CATALOG NUMBER: GSS-SB6C-735-U-T3

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	52°	55°	65°	75°	85°
0°	6557.7	6557.7	6557.7	6557.7	6557.7	6557.7	6557.7	6557.7	6557.7	6557.7	6557.7
2.5°	6755.9	6746.4	6737.0	6699.3	6699.3	6708.7	6689.8	6699.3	6689.8	6642.7	6604.9
5°	7133.3	7048.4	7029.5	7010.6	7029.5	6972.9	6925.7	6897.4	6793.6	6765.3	6652.1
7.5°	7293.7	7303.1	7293.7	7256.0	7227.7	7227.7	7152.2	7114.4	7048.4	6935.2	6746.4
10°	7520.2	7510.7	7482.4	7501.3	7557.9	7463.6	7406.9	7378.6	7265.4	7105.0	6925.7
12.5°	7925.9	7859.8	7841.0	7812.7	7803.2	7746.6	7680.6	7690.0	7557.9	7312.6	7123.9
15°	8275.0	8199.5	8284.4	8227.8	8152.3	8067.4	8001.4	7944.8	7793.8	7567.3	7331.5
17.5°	8605.3	8567.5	8605.3	8605.3	8595.8	8454.3	8322.2	8275.0	8095.7	7841.0	7529.6
20°	8860.0	8860.0	8926.1	8926.1	8897.8	8812.8	8727.9	8671.3	8416.5	8086.3	7727.7
22.5°	9190.3	9039.3	9180.8	9190.3	9199.7	9133.6	9077.0	9001.6	8737.4	8341.1	7888.2
25°	9501.6	9379.0	9463.9	9407.3	9445.0	9473.3	9445.0	9416.7	9124.2	8671.3	8124.0
27.5°	9992.3	9869.6	9926.2	9794.1	9794.1	9765.8	9813.0	9850.8	9529.9	8992.1	8331.6
30°	10728.3	10586.7	10539.6	10379.1	10218.7	10152.7	10171.6	10237.6	10020.6	9303.5	8539.2
32.5°	11360.4	11285.0	11247.2	11115.1	10917.0	10615.0	10662.2	10662.2	10435.8	9529.9	8643.0
35°	11879.4	11860.5	11870.0	11690.7	11653.0	11162.3	11162.3	11143.4	10728.3	9831.9	8916.6
37.5°	12219.1	12115.3	12162.5	12228.5	12105.9	11775.6	11690.7	11643.5	11134.0	10152.7	9275.2
40°	12143.6	12068.1	12247.4	12370.1	12275.7	12209.7	12200.2	12105.9	11539.7	10558.4	9803.6
42.5°	12134.2	12068.1	12285.1	12417.2	12370.1	12473.8	12502.2	12568.2	12058.7	11200.0	10558.4
45°	12171.9	12143.6	12502.2	12672.0	12558.8	12700.3	12860.7	12917.3	12719.2	11983.2	11502.0
47.5°	12483.3	12445.5	12860.7	13058.9	13153.2	13398.5	13294.7	13389.1	13502.3	13096.6	12587.1
50°	12785.2	12823.0	13379.7	13568.4	14030.7	14370.4	14011.8	14162.8	14540.2	14389.3	14040.2
52.5°	13266.4	13275.9	13823.1	14294.9	15181.9	15502.7	15153.6	15172.4	15681.9	15965.0	15502.7
55°	13389.1	13492.9	14228.9	15210.2	16484.0	16710.4	16550.0	16484.0	17087.9	17474.7	16974.6
57.5°	13379.7	13323.1	14238.3	15597.0	17474.7	18276.7	18371.1	18191.8	18701.3	18861.7	18588.1
60°	13030.5	13143.8	14143.9	15870.7	18399.4	20182.7	20409.2	20173.3	20418.6	20465.8	19701.5
62.5°	11964.3	12002.1	13370.2	15880.1	19125.9	21767.9	22437.8	22173.6	21947.2	21362.2	19946.8
65°	10228.2	10162.1	11473.7	14568.5	19258.0	23296.5	24258.9	24258.9	22786.9	21664.1	19427.9
67.5°	8529.8	8426.0	9407.3	11879.4	17144.5	23966.4	25504.4	25004.3	22966.2	21871.7	18191.8
70°	4113.9	4406.4	5906.7	8407.1	13106.0	20239.3	24579.7	24768.4	22824.7	21220.6	15795.2
72.5°	1472.0	1405.9	2123.0	3604.4	7256.0	13209.8	20579.0	22239.7	21834.0	19352.4	12936.2
75°	679.4	688.8	886.9	1254.9	2349.5	6444.5	13087.2	15314.0	18701.3	16087.7	9680.9
77.5°	528.4	528.4	603.9	717.1	971.9	2085.3	6689.8	8595.8	12087.0	9964.0	4614.0
80°	386.9	396.3	405.7	471.8	594.4	783.2	1990.9	2981.6	4406.4	3198.7	1500.3
82.5°	273.6	273.6	264.2	264.2	320.8	349.1	537.8	754.8	1292.7	877.5	396.3
85°	113.2	132.1	113.2	113.2	113.2	141.5	169.8	198.1	283.1	245.3	169.8
87.5°	18.9	18.9	18.9	28.3	37.7	47.2	56.6	66.0	75.5	75.5	75.5
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360013
CATALOG NUMBER: GSS-SB6C-735-U-T3

CANDELA DISTRIBUTION (continued):

	90°	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
0°	6557.7	6557.7	6557.7	6557.7	6557.7	6557.7	6557.7	6557.7	6557.7	6557.7	6557.7
2.5°	6586.0	6586.0	6557.7	6510.6	6491.7	6463.4	6453.9	6444.5	6425.6	6463.4	6444.5
5°	6623.8	6586.0	6548.3	6472.8	6463.4	6416.2	6369.0	6359.6	6331.3	6359.6	6359.6
7.5°	6708.7	6652.1	6567.2	6491.7	6425.6	6416.2	6331.3	6255.8	6255.8	6265.2	6255.8
10°	6859.7	6793.6	6708.7	6567.2	6444.5	6331.3	6189.7	6095.4	6104.8	6104.8	6086.0
12.5°	7057.8	6963.5	6812.5	6604.9	6416.2	6236.9	6067.1	6038.8	6029.3	6048.2	5991.6
15°	7208.8	7123.9	6878.5	6642.7	6350.2	6170.9	5991.6	5925.5	5935.0	5916.1	5868.9
17.5°	7397.5	7265.4	6963.5	6614.3	6274.7	6104.8	5897.2	5755.7	5680.2	5689.7	5680.2
20°	7576.8	7388.1	7029.5	6614.3	6255.8	5953.9	5689.7	5500.9	5340.5	5312.2	5302.8
22.5°	7708.9	7520.2	7105.0	6623.8	6142.6	5784.0	5397.2	5151.8	4915.9	4878.2	4868.8
25°	7897.6	7652.3	7189.9	6557.7	5991.6	5500.9	5019.7	4746.1	4538.5	4500.8	4500.8
27.5°	8058.0	7793.8	7303.1	6491.7	5746.3	5114.1	4661.2	4387.5	4255.5	4189.4	4189.4
30°	8227.8	7935.3	7397.5	6293.5	5416.0	4727.2	4378.1	4198.8	4047.9	3981.8	3953.5
32.5°	8416.5	8171.2	7416.4	6095.4	5085.8	4472.5	4180.0	4029.0	3868.6	3774.2	3764.8
35°	8652.4	8473.2	7350.3	5802.9	4755.5	4274.3	3991.3	3821.4	3661.0	3566.7	3585.5
37.5°	9029.9	8822.3	7152.2	5387.7	4481.9	4151.7	3840.3	3595.0	3406.2	3255.3	3264.7
40°	9586.6	9246.9	6859.7	4887.6	4283.8	4010.1	3661.0	3377.9	3104.3	2877.9	2877.9
42.5°	10218.7	9624.3	6501.1	4425.3	4132.8	3830.8	3472.3	3113.7	2726.9	2491.0	2481.6
45°	10926.4	9954.5	6086.0	4047.9	3887.5	3613.8	3227.0	2717.4	2462.7	2340.0	2330.6
47.5°	11870.0	10313.1	5595.3	3717.6	3604.4	3396.8	2859.0	2491.0	2340.0	2245.7	2236.2
50°	12756.9	10700.0	5189.6	3396.8	3302.5	3142.1	2604.2	2396.6	2274.0	2198.5	2179.6
52.5°	13785.4	11096.3	4736.7	3085.4	2962.8	2745.8	2547.6	2349.5	2236.2	2179.6	2160.7
55°	14804.4	11653.0	4236.6	2802.4	2660.8	2566.5	2491.0	2321.2	2207.9	2170.2	2141.9
57.5°	15965.0	12190.8	3623.3	2500.4	2443.8	2434.4	2481.6	2311.7	2217.4	2151.3	2113.6
60°	16568.9	12426.7	2981.6	2226.8	2236.2	2292.8	2443.8	2311.7	2160.7	2047.5	2000.3
62.5°	16361.3	11945.5	2358.9	1953.2	2038.1	2141.9	2377.8	2226.8	2038.1	1953.2	1896.6
65°	15531.0	11124.6	1839.9	1717.3	1858.8	1953.2	2217.4	2104.1	1915.4	1830.5	1821.1
67.5°	*14332.7*	*9699.8*	*1490.8*	*1509.7*	*1651.2*	*1773.9*	*2075.8*	*2028.7*	*1811.6*	*1755.0*	*1755.0*
70°	12049.2	7793.8	1226.6	1321.0	1443.6	1575.7	1972.0	1906.0	1679.5	1651.2	1651.2
72.5°	9416.7	5500.9	1047.4	1160.6	1198.3	1387.0	1830.5	1764.5	1632.4	1698.4	1707.8
75°	6642.7	3349.6	896.4	981.3	1019.0	1141.7	1698.4	1726.7	1604.1	1821.1	1858.8
77.5°	3019.4	1472.0	698.2	773.7	820.9	971.9	1462.5	1604.1	1387.0	1387.0	1311.5
80°	1056.8	622.7	556.7	556.7	594.4	754.8	1217.2	1321.0	1113.4	981.3	943.6
82.5°	386.9	339.7	415.2	415.2	377.4	462.3	811.5	877.5	802.0	698.2	688.8
85°	151.0	160.4	254.8	254.8	188.7	226.5	452.9	471.8	452.9	396.3	396.3
87.5°	66.0	66.0	75.5	75.5	66.0	56.6	84.9	84.9	56.6	37.7	18.9
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-5

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-735-U-5WQ

Data in this report applies to families of products including GSS-SB1A-735-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-735-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 3500K CCT 26 LEDS

Spectral Parameters

CCT (K):	3369
CIE u':	0.2386
CIE v':	0.5156
Duv:	0.0013
CIE x:	0.4143
CIE y:	0.3980
CIE z:	0.1877
Peak Wavelength (nm):	590
Dominant Wavelength (nm):	580
Purity:	43.80166
Rf:	71.4
Rg:	96

CRI (Ra):	70.1
R1:	66.6
R2:	77.6
R3:	88.5
R4:	69.5
R5:	66.4
R6:	69.6
R7:	77.5
R8:	44.9
R9:	-40.2
R10:	49.1
R11:	66.3
R12:	45.7
R13:	68.0
R14:	93.4
R15:	57.6

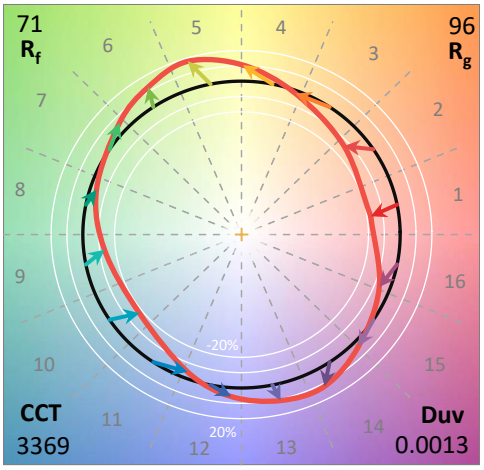

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-5

CIE 1931 Chromaticity Diagram

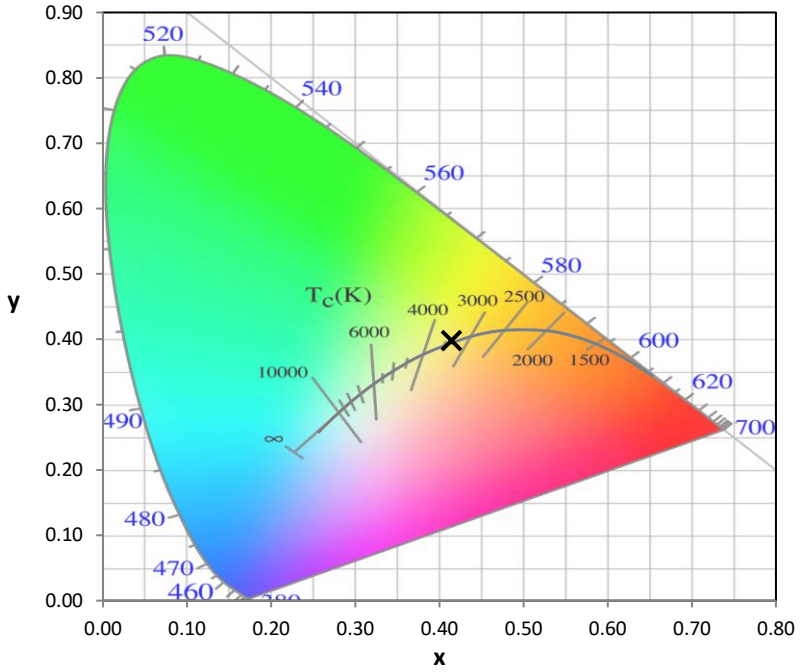

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

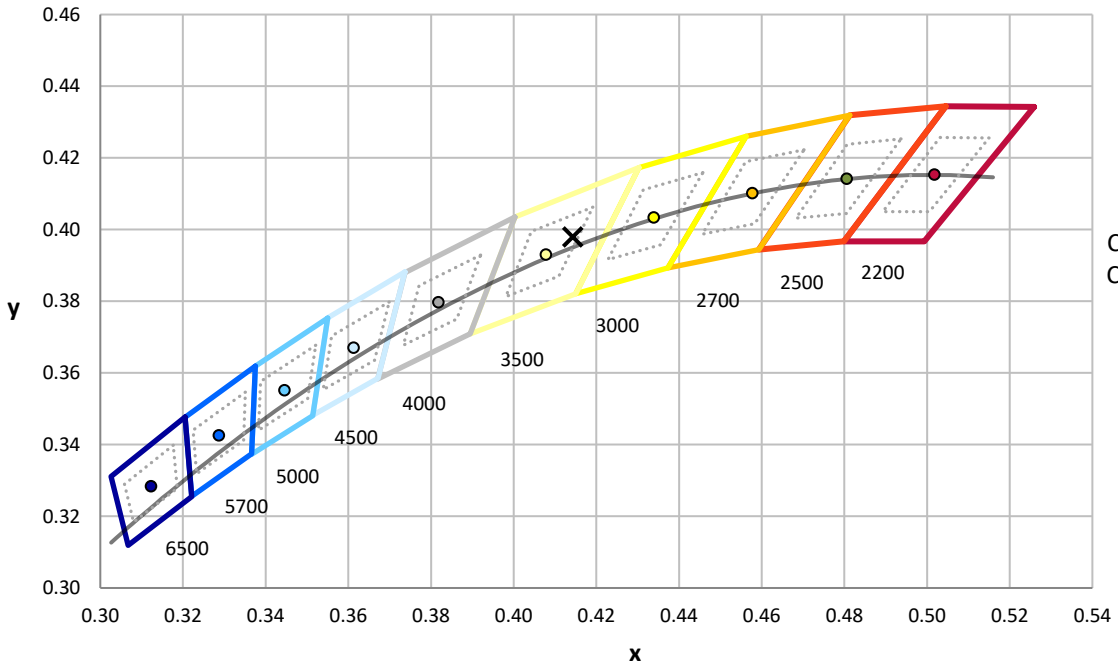


CCT = 3369K
CIE x = 0.4143
CIE y = 0.3980
Duv = 0.0013

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-5

Photopic Flux vs. Wavelength

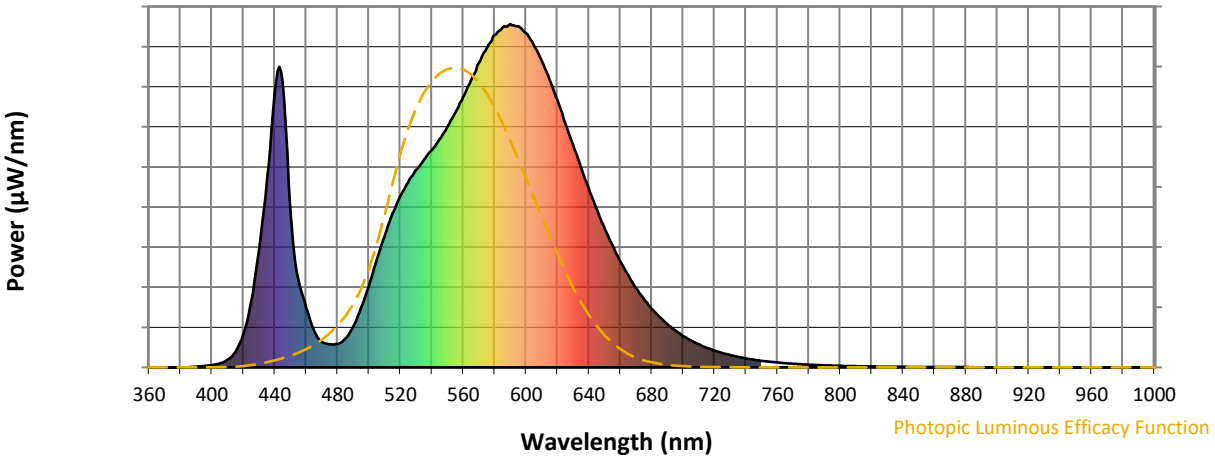


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Scotopic Flux vs. Wavelength

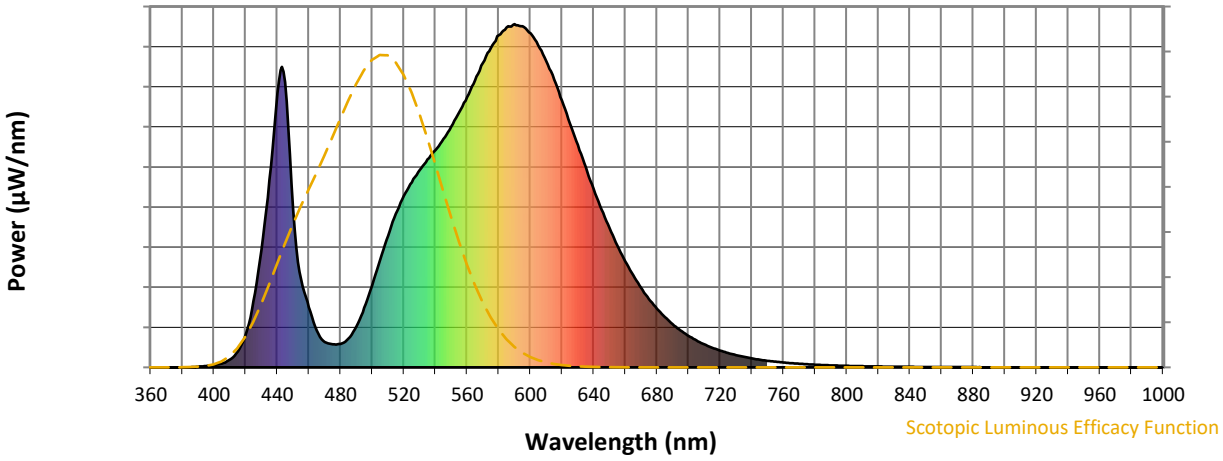


Scotopic Lumens: NR **S/P: 1.29**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Melanopic Flux vs. Wavelength

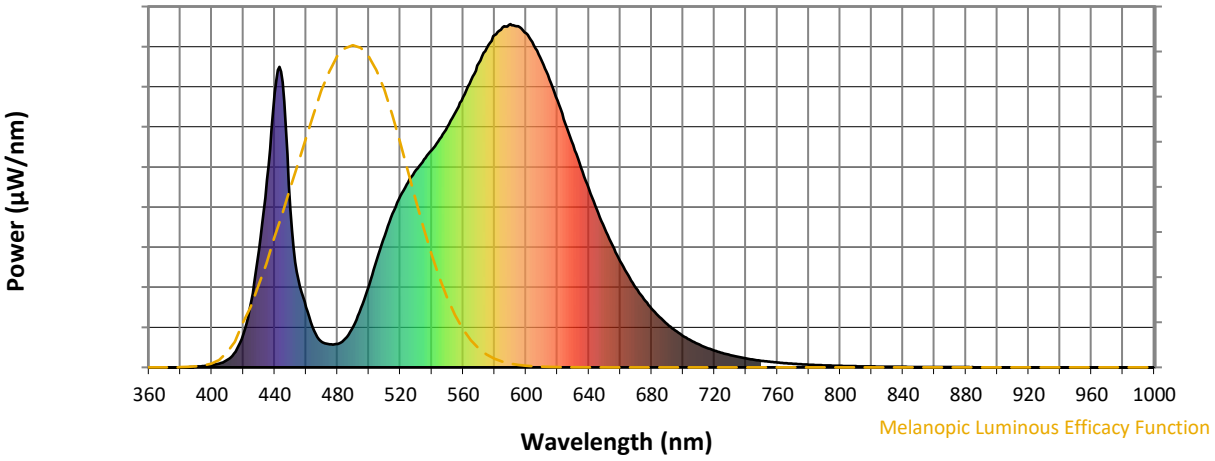

Melanopic Lumens: NR **M/P: 2.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			


REPORT NUMBER: SP1-2407-184-5

TM-30-18


Summary


R_f = 71.4
R_g = 96
CIE R_a = 70.1
R_9 = -40.2


Spectral Power Distribution Comparison

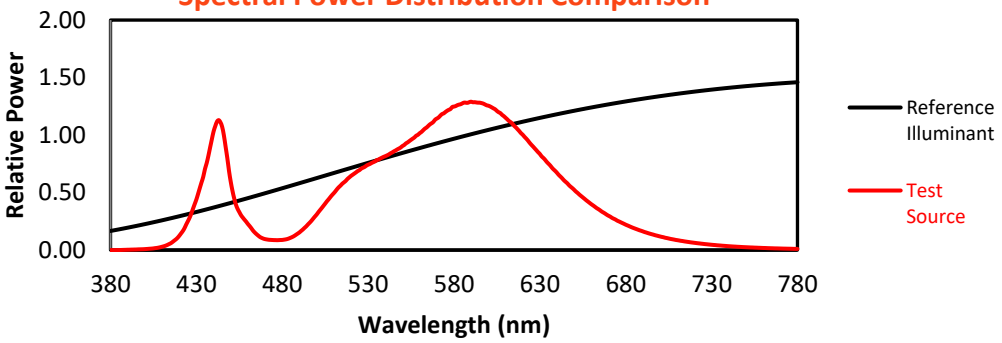


Color Vector Graphics

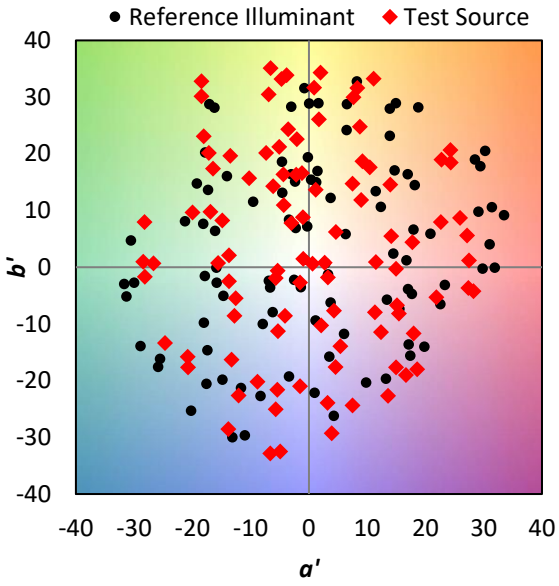

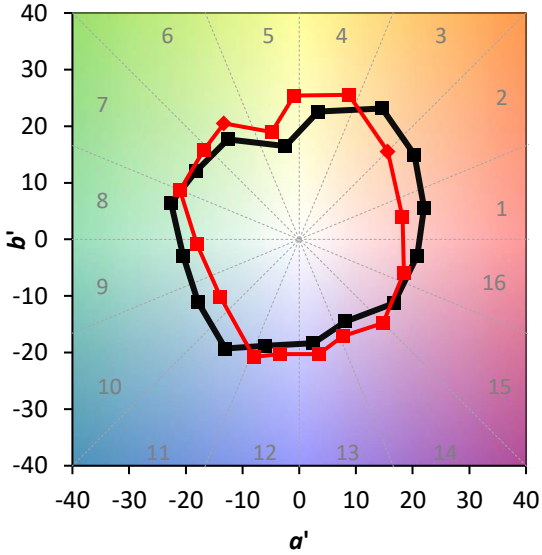

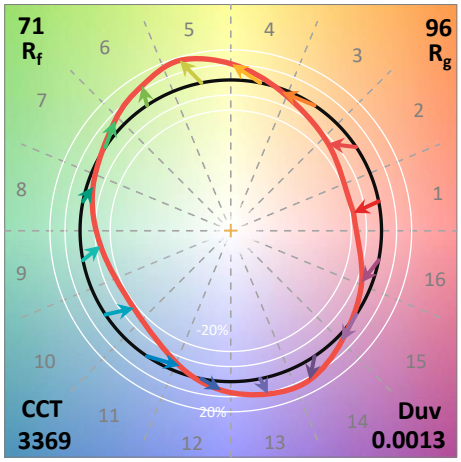

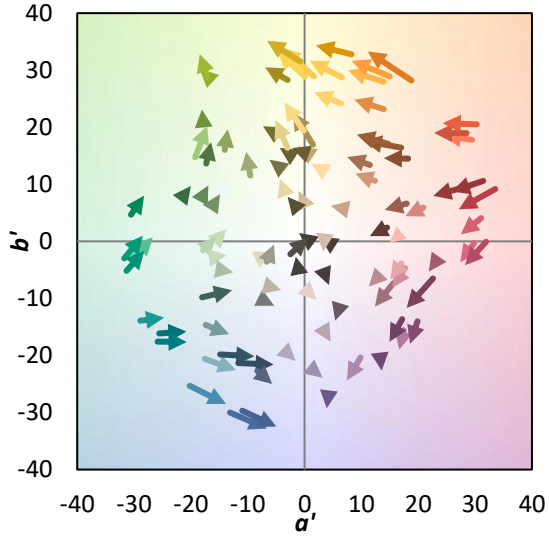


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 57	CES51 = 84	CES76 = 50
CES02 = 62	CES27 = 80	CES52 = 86	CES77 = 74
CES03 = 31	CES28 = 81	CES53 = 72	CES78 = 54
CES04 = 70	CES29 = 50	CES54 = 79	CES79 = 81
CES05 = 48	CES30 = 55	CES55 = 78	CES80 = 79
CES06 = 51	CES31 = 56	CES56 = 67	CES81 = 74
CES07 = 40	CES32 = 54	CES57 = 65	CES82 = 91
CES08 = 39	CES33 = 60	CES58 = 68	CES83 = 86
CES09 = 29	CES34 = 69	CES59 = 85	CES84 = 89
CES10 = 75	CES35 = 83	CES60 = 91	CES85 = 83
CES11 = 58	CES36 = 88	CES61 = 85	CES86 = 66
CES12 = 64	CES37 = 78	CES62 = 78	CES87 = 77
CES13 = 43	CES38 = 64	CES63 = 71	CES88 = 75
CES14 = 74	CES39 = 92	CES64 = 70	CES89 = 68
CES15 = 71	CES40 = 86	CES65 = 64	CES90 = 72
CES16 = 47	CES41 = 81	CES66 = 65	CES91 = 95
CES17 = 50	CES42 = 79	CES67 = 63	CES92 = 62
CES18 = 56	CES43 = 71	CES68 = 69	CES93 = 78
CES19 = 72	CES44 = 98	CES69 = 80	CES94 = 51
CES20 = 65	CES45 = 80	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 75	CES71 = 58	CES96 = 76
CES22 = 79	CES47 = 71	CES72 = 85	CES97 = 82
CES23 = 92	CES48 = 61	CES73 = 51	CES98 = 72
CES24 = 91	CES49 = 74	CES74 = 94	CES99 = 60
CES25 = 72	CES50 = 83	CES75 = 57	

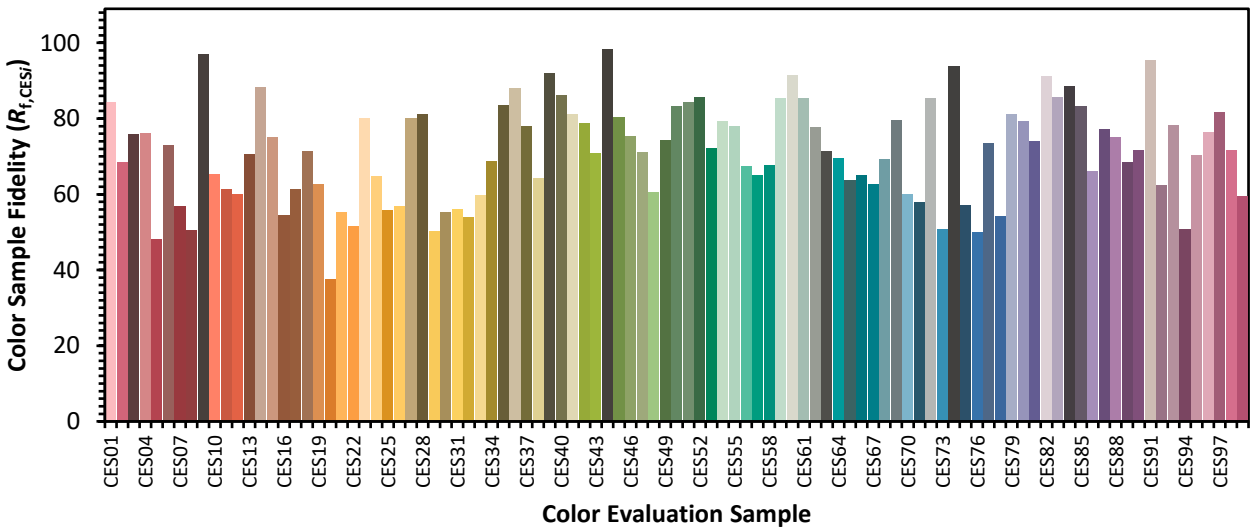



REPORT NUMBER: SP1-2407-184-5

TM-30-18

Color Rendition by Hue-Angle Bin

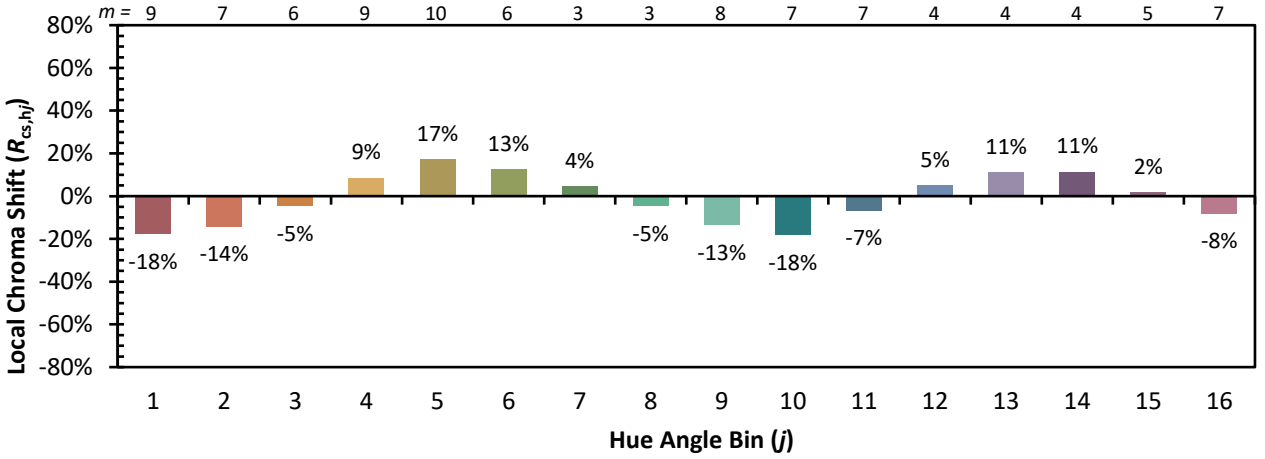

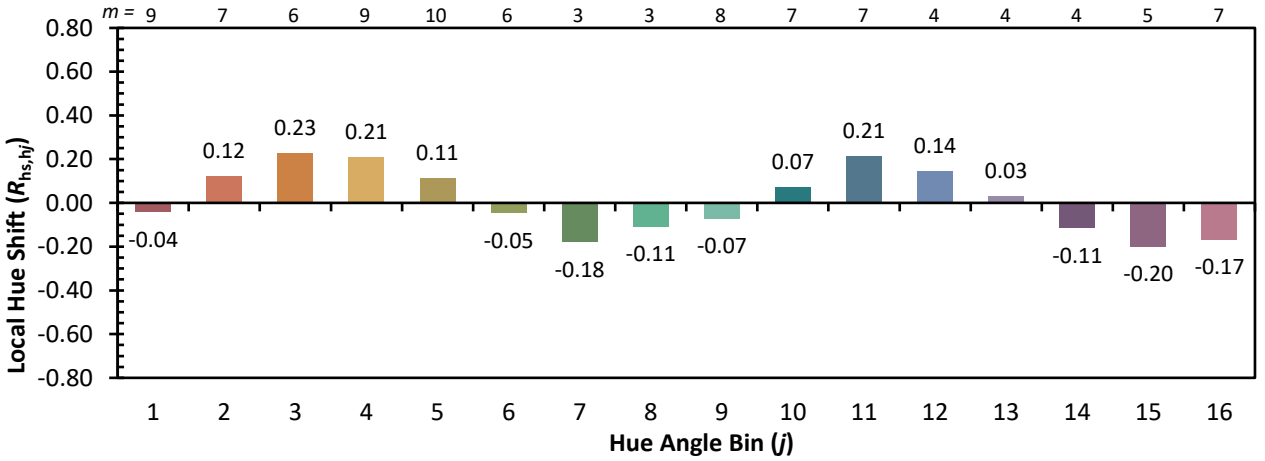


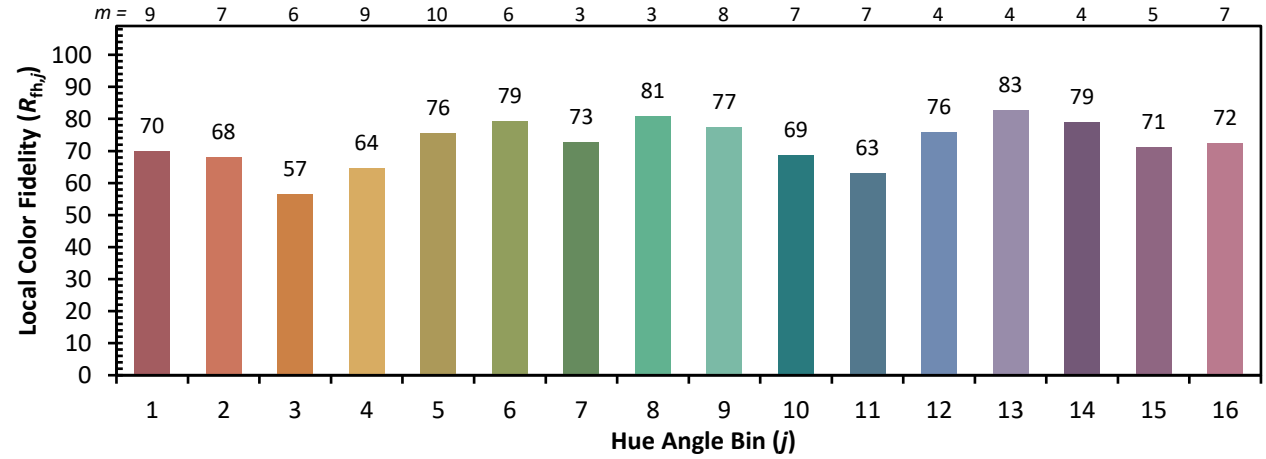


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Measure Comparisons

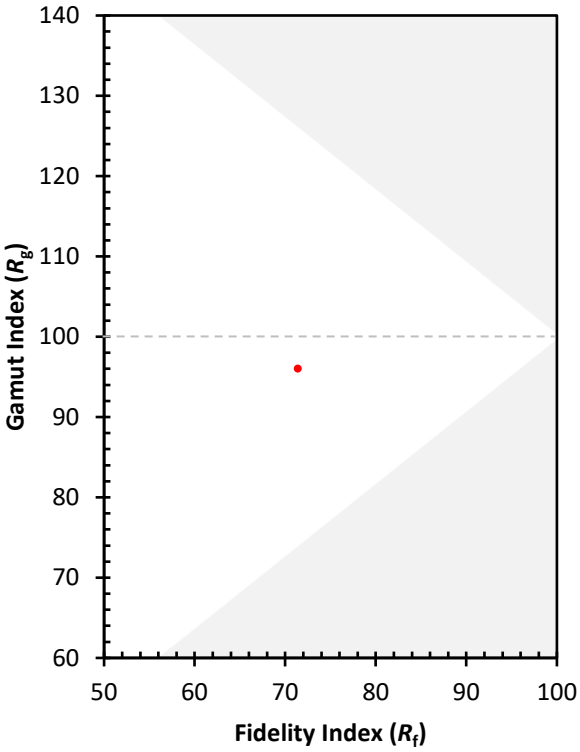

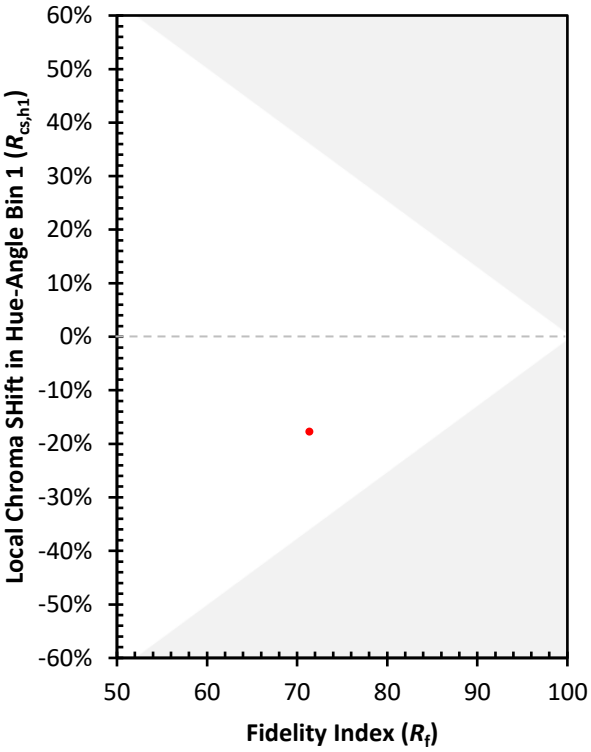

(END OF REPORT)