Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360770

Luminaire Tested: **GSS-SB3D-735-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360770
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB3D-735-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 3SQUARE 219W 70CRI 3500K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(78) 3500K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	28254.2 lumens
Efficiency:	N/A
Efficacy:	129.0 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 0.5' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B4 - U0 - G4


Input Watts (W):	219
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	2.5%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360770
CATALOG NUMBER: GSS-SB3D-735-U-T1

Iso-Footcandle Lines of Horizontal Illumination

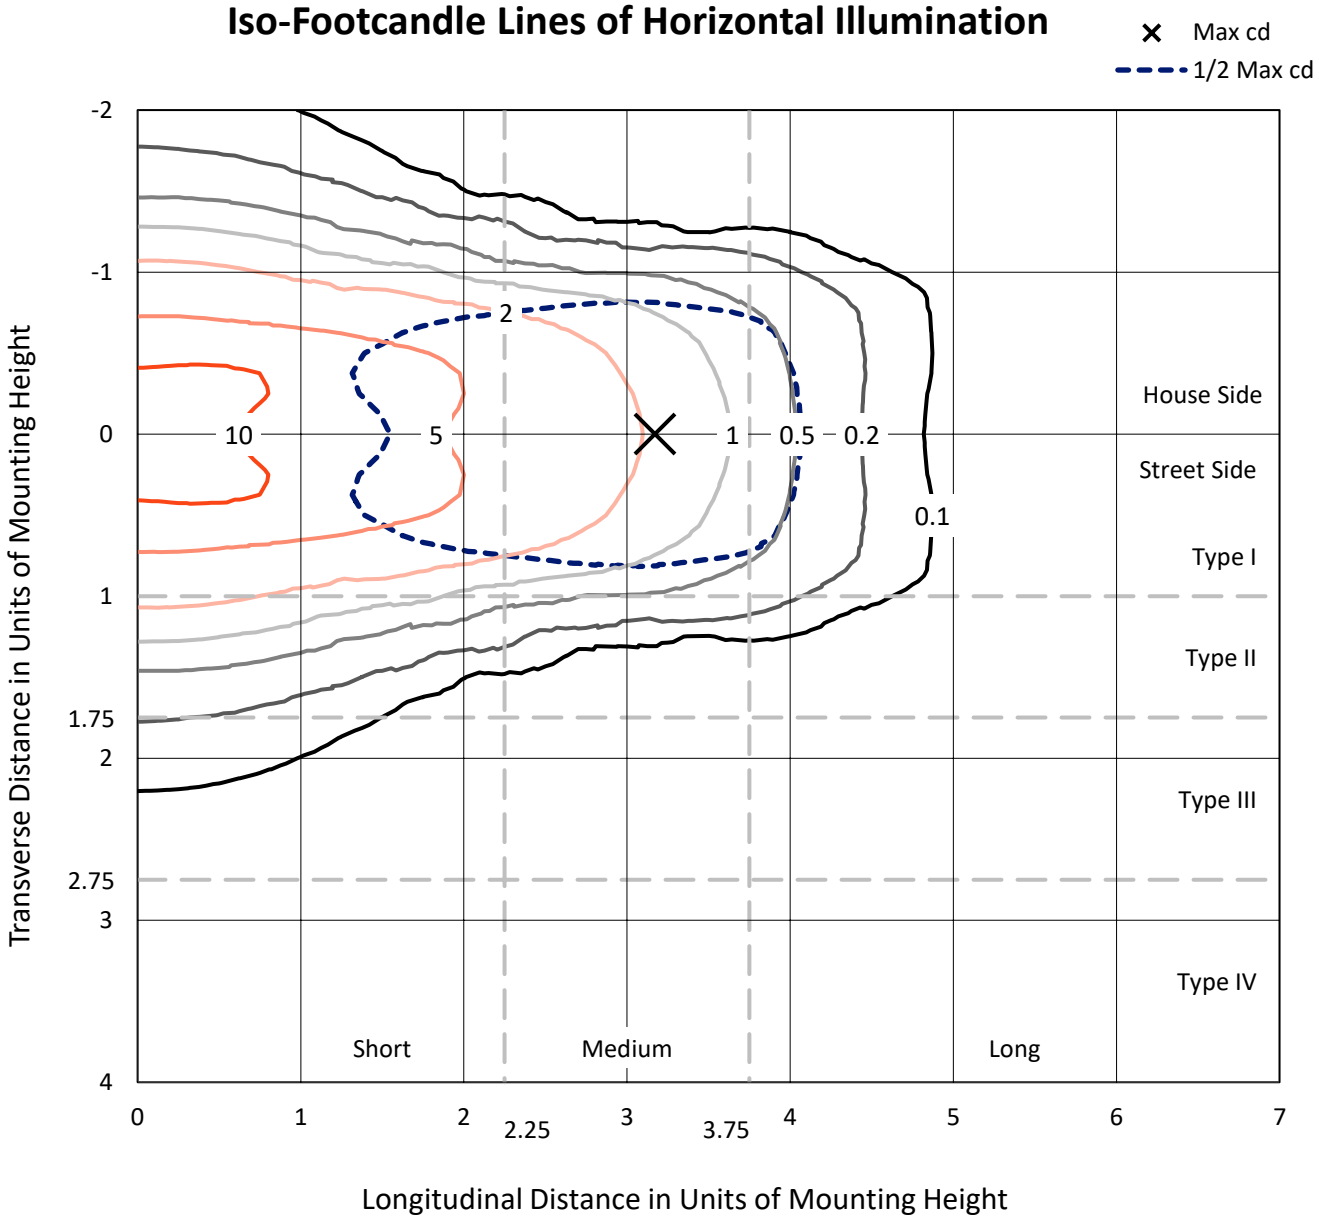


Based on 20 foot mounting height. Maximum calculated value = 13.9 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360770
CATALOG NUMBER: GSS-SB3D-735-U-T1

Luminous Intensity Polar Plot

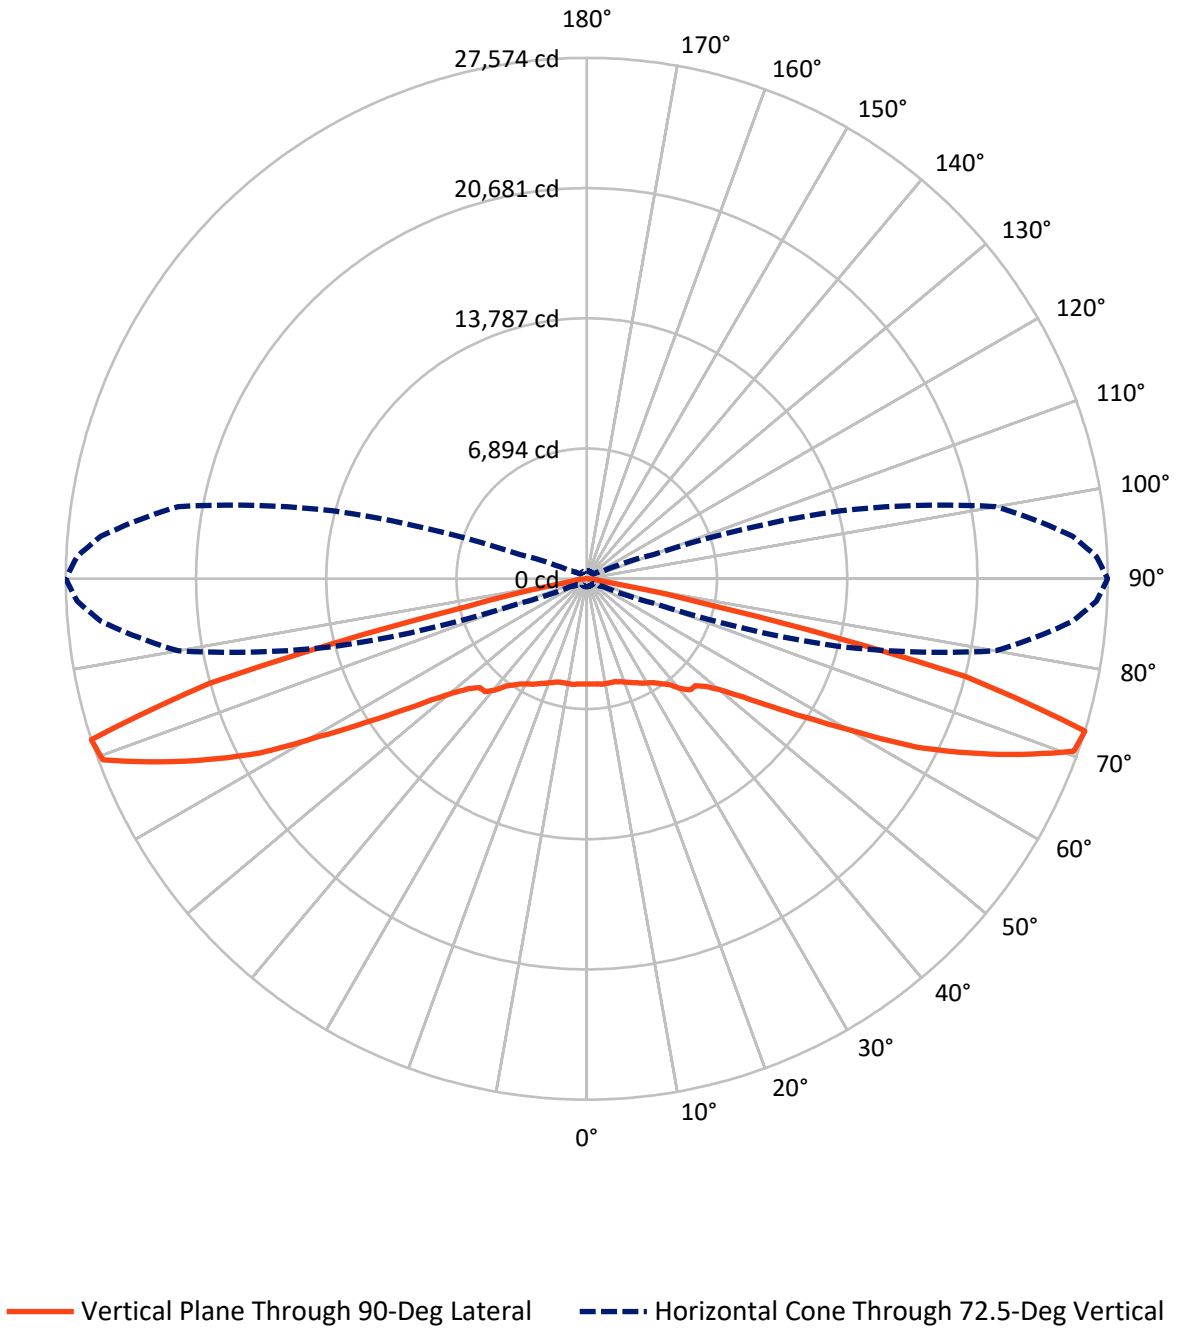

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360770
CATALOG NUMBER: GSS-SB3D-735-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	14127.1	0.0	14127.1
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	14127.1	0.0	14127.1
	% Fixture	50.0	0.0	50.0
Total	Lumens	28254.2	0.0	28254.2
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	538.8	1.9
10°-20°	1642.2	5.8
20°-30°	2744.9	9.7
30°-40°	3785.4	13.4
40°-50°	4640.4	16.4
50°-60°	5437.8	19.2
60°-70°	6038.6	21.4
70°-80°	3283.8	11.6
80°-90°	142.3	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	28254.2	100.0
0°-180°	28254.2	100.0

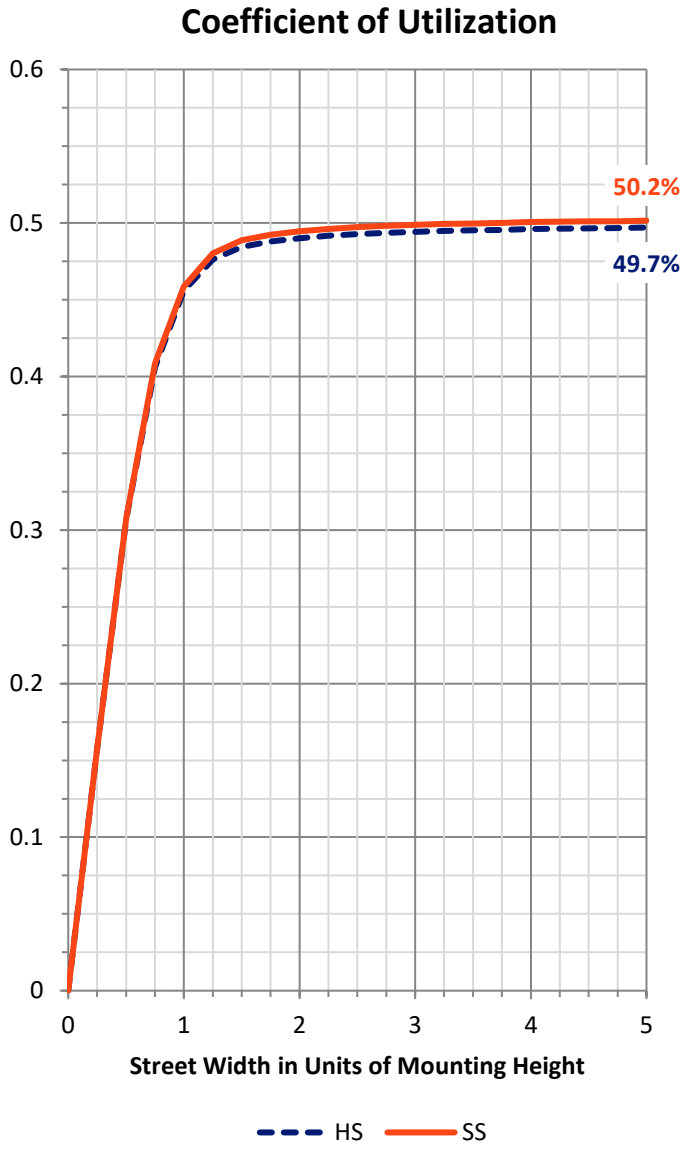

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360770
CATALOG NUMBER: GSS-SB3D-735-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	2463.0	8.7			
FM	(30°-60°)	6931.8	24.5			
FH	(60°-80°)	4661.2	16.5			G2/5000
FVH	(80°-90°)	71.2	0.3			G1/100
BL	(0°-30°)	2463.0	8.7	B3/2500		
BM	(30°-60°)	6931.8	24.5	B4/8500		
BH	(60°-80°)	4661.2	16.5	B4/5000		G4/5000
BVH	(80°-90°)	71.2	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B4-U0-G4
Type I Short

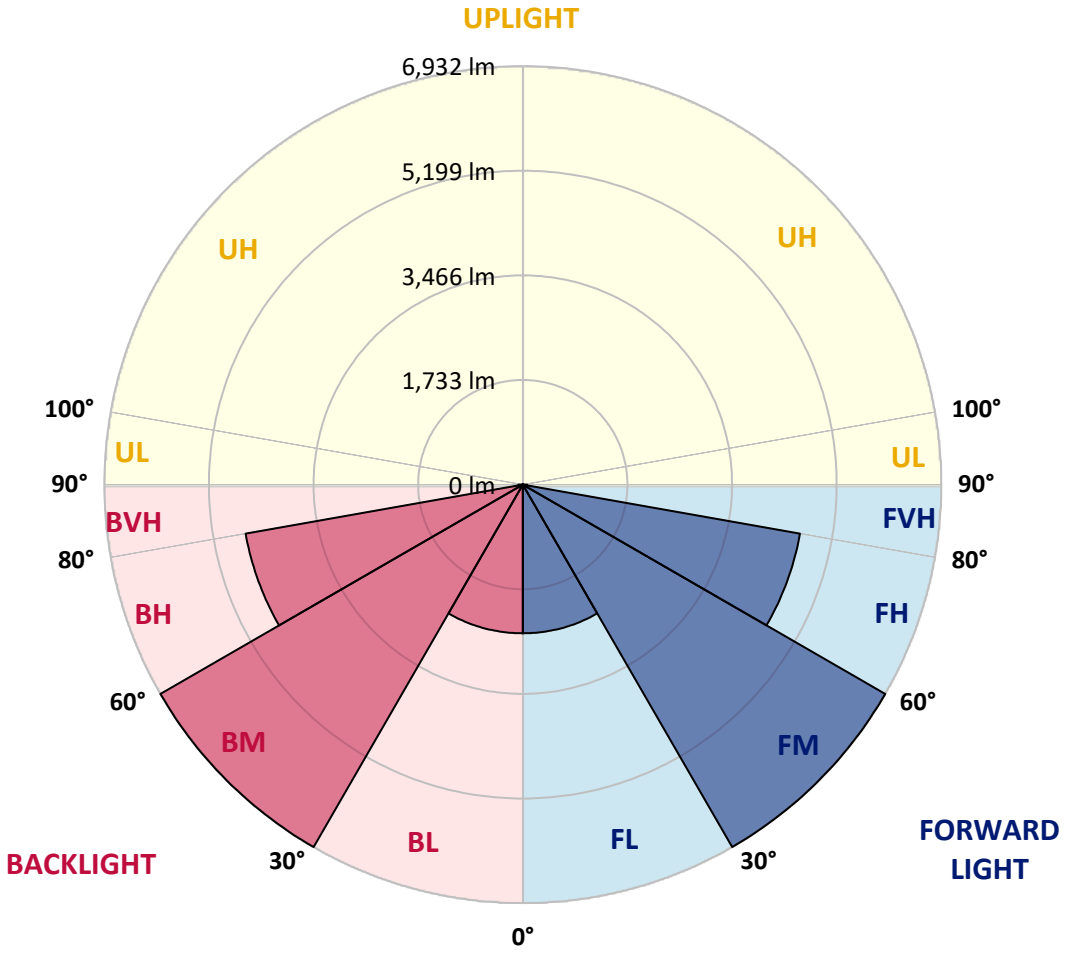

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360770
CATALOG NUMBER: GSS-SB3D-735-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	5566.8	5566.8	5566.8	5566.8	5566.8	5566.8	5566.8	5566.8	5566.8	5566.8	5566.8
2.5°	5573.0	5573.0	5554.4	5579.2	5566.8	5573.0	5579.2	5573.0	5566.8	5573.0	5579.2
5°	5603.9	5591.5	5603.9	5616.3	5597.7	5610.1	5603.9	5573.0	5591.5	5591.5	5591.5
7.5°	5659.6	5671.9	5659.6	5690.5	5671.9	5709.0	5671.9	5647.2	5641.0	5634.8	5634.8
10°	5684.3	5684.3	5678.1	5733.8	5746.2	5783.3	5758.5	5721.4	5702.9	5678.1	5653.4
12.5°	5616.3	5628.6	5659.6	5764.7	5814.2	5888.4	5869.9	5795.6	5740.0	5721.4	5684.3
15°	5542.0	5554.4	5616.3	5746.2	5863.7	5975.0	5968.8	5876.0	5808.0	5758.5	5702.9
17.5°	5424.5	5443.1	5529.7	5727.6	5937.9	6061.6	6098.7	6005.9	5931.7	5851.3	5777.1
20°	5226.6	5226.6	5381.2	5634.8	5925.5	6203.9	6302.8	6228.6	6142.0	6012.1	5913.2
22.5°	5003.9	5016.3	5170.9	5504.9	5919.3	6327.6	6519.3	6438.9	6352.3	6210.1	6061.6
25°	4781.2	4781.2	4954.4	5331.7	5838.9	6414.2	6772.9	6729.6	6556.4	6426.5	6234.8
27.5°	4577.1	4577.1	4762.7	5158.6	5702.9	6438.9	7026.5	7026.5	6834.8	6643.0	6432.7
30°	4335.9	4397.8	4608.1	5022.5	5579.2	6395.6	7212.1	7329.6	7156.4	6909.0	6599.7
32.5°	4131.8	4175.1	4391.6	4830.7	5399.8	6346.1	7422.4	7713.1	7533.7	7193.5	6847.1
35°	3890.6	3884.4	4131.8	4564.8	5146.2	6234.8	7589.4	8170.8	7997.6	7632.7	7162.6
37.5°	3575.1	3575.1	3828.7	4249.3	4905.0	6043.1	7725.5	8678.0	8548.1	8133.7	7632.7
40°	3234.9	3272.0	3494.7	3921.5	4614.2	5814.2	7725.5	9092.4	9160.5	8733.7	8214.1
42.5°	2987.5	2999.9	3204.0	3606.0	4292.6	5517.3	7626.5	9451.2	9655.3	9296.5	8622.3
45°	2727.7	2758.7	2931.8	3303.0	3958.6	5164.7	7453.3	9853.2	10181.0	9933.6	9049.1
47.5°	2412.3	2443.2	2641.1	3018.4	3643.2	4781.2	7162.6	10273.8	10960.4	10781.0	9809.9
50°	2047.3	2072.1	2257.6	2659.7	3290.6	4342.1	6797.7	10589.3	11739.7	11919.1	10960.4
52.5°	1602.0	1620.6	1818.5	2208.2	2870.0	3921.5	6284.3	10781.0	12525.3	13156.2	12500.5
55°	1150.5	1181.4	1354.6	1676.2	2313.3	3358.6	5671.9	10880.0	13385.0	14622.1	14411.8
57.5°	828.8	841.2	958.7	1206.1	1719.5	2696.8	4886.4	10713.0	14158.2	16372.5	16811.7
60°	686.6	686.6	705.1	822.6	1175.2	1905.1	3946.2	10094.4	14820.0	18141.5	19496.1
62.5°	630.9	630.9	643.3	661.8	773.2	1237.1	2820.5	8838.8	14894.2	19842.5	22440.3
65°	575.2	575.2	587.6	600.0	624.7	804.1	1701.0	6469.8	13440.7	19861.0	24023.8
67.5°	525.8	525.8	531.9	538.1	550.5	587.6	934.0	3921.5	10756.3	19335.3	24629.9
70°	476.3	476.3	476.3	470.1	488.6	494.8	618.5	1991.7	7193.5	17461.1	24339.2
72.5°	*420.6*	*420.6*	*414.4*	*402.0*	*408.2*	*408.2*	*457.7*	*977.3*	*3735.9*	*13879.8*	*21976.4*
75°	358.7	364.9	340.2	327.8	321.6	327.8	364.9	556.7	1670.0	8418.2	16422.0
77.5°	303.1	315.5	278.3	253.6	247.4	247.4	284.5	346.4	717.5	3055.5	7360.5
80°	228.9	235.0	204.1	179.4	179.4	173.2	210.3	253.6	340.2	909.2	1651.5
82.5°	129.9	129.9	117.5	105.2	99.0	105.2	142.3	173.2	210.3	321.6	451.5
85°	30.9	30.9	37.1	43.3	43.3	55.7	80.4	92.8	111.3	129.9	173.2
87.5°	6.2	6.2	6.2	12.4	18.6	18.6	30.9	43.3	55.7	68.0	74.2
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360770
CATALOG NUMBER: GSS-SB3D-735-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	5566.8	5566.8	*5566.8*
2.5°	5579.2	5585.3	*5579.2*
5°	5616.3	5603.9	*5585.3*
7.5°	5622.5	5628.6	*5634.8*
10°	5647.2	5671.9	*5634.8*
12.5°	5671.9	5653.4	*5641.0*
15°	5690.5	5684.3	*5647.2*
17.5°	5758.5	5733.8	*5727.6*
20°	5863.7	5857.5	*5838.9*
22.5°	5987.4	5975.0	*5968.8*
25°	6166.8	6123.5	*6098.7*
27.5°	6315.2	6278.1	*6265.7*
30°	6463.7	6389.4	*6389.4*
32.5°	6593.5	6575.0	*6562.6*
35°	6902.8	6810.0	*6822.4*
37.5°	7280.1	7187.3	*7106.9*
40°	7812.1	7688.3	*7638.9*
42.5°	8152.2	8028.5	*8040.9*
45°	8344.0	8127.5	*8071.8*
47.5°	8863.6	8591.4	*8517.2*
50°	9704.8	9370.8	*9278.0*
52.5°	11065.5	10527.4	*10403.7*
55°	12772.7	12110.8	*11987.1*
57.5°	15110.7	14232.4	*13966.4*
60°	17956.0	16867.4	*16465.3*
62.5°	21376.4	20034.2	*19650.7*
65°	23949.5	22830.0	*22236.2*
67.5°	26009.3	25087.6	*24803.1*
70°	27233.9	27277.2	*27351.5*
72.5°	*25817.5*	*27005.1*	*27574.1*
75°	18920.9	19842.5	*20727.0*
77.5°	7311.0	6593.5	*6383.2*
80°	1181.4	1107.2	*1144.3*
82.5°	531.9	562.9	*593.8*
85°	346.4	402.0	*426.8*
87.5°	80.4	80.4	*80.4*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-5

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-735-U-5WQ

Data in this report applies to families of products including GSS-SB1A-735-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-735-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 3500K CCT 26 LEDS

Spectral Parameters

CCT (K):	3369
CIE u':	0.2386
CIE v':	0.5156
Duv:	0.0013
CIE x:	0.4143
CIE y:	0.3980
CIE z:	0.1877
Peak Wavelength (nm):	590
Dominant Wavelength (nm):	580
Purity:	43.80166
Rf:	71.4
Rg:	96

CRI (Ra):	70.1
R1:	66.6
R2:	77.6
R3:	88.5
R4:	69.5
R5:	66.4
R6:	69.6
R7:	77.5
R8:	44.9
R9:	-40.2
R10:	49.1
R11:	66.3
R12:	45.7
R13:	68.0
R14:	93.4
R15:	57.6

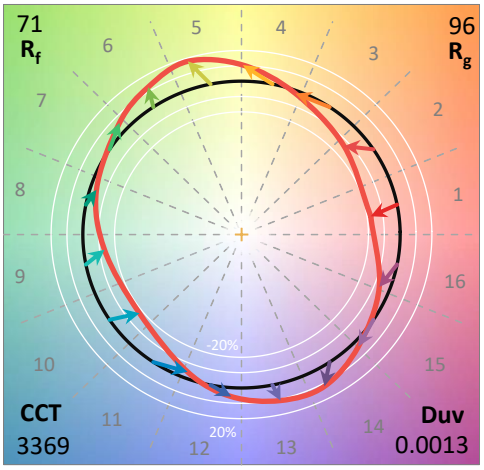

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-5

CIE 1931 Chromaticity Diagram

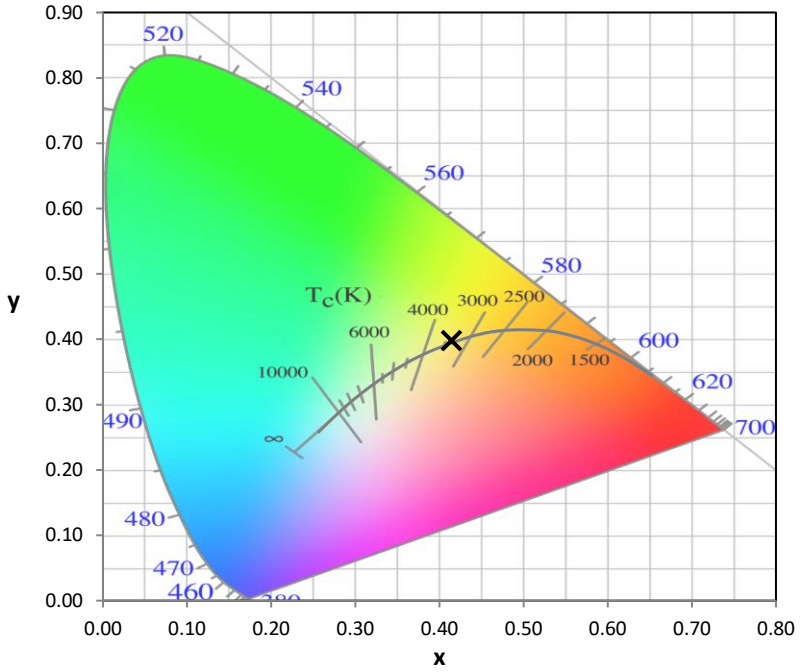

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

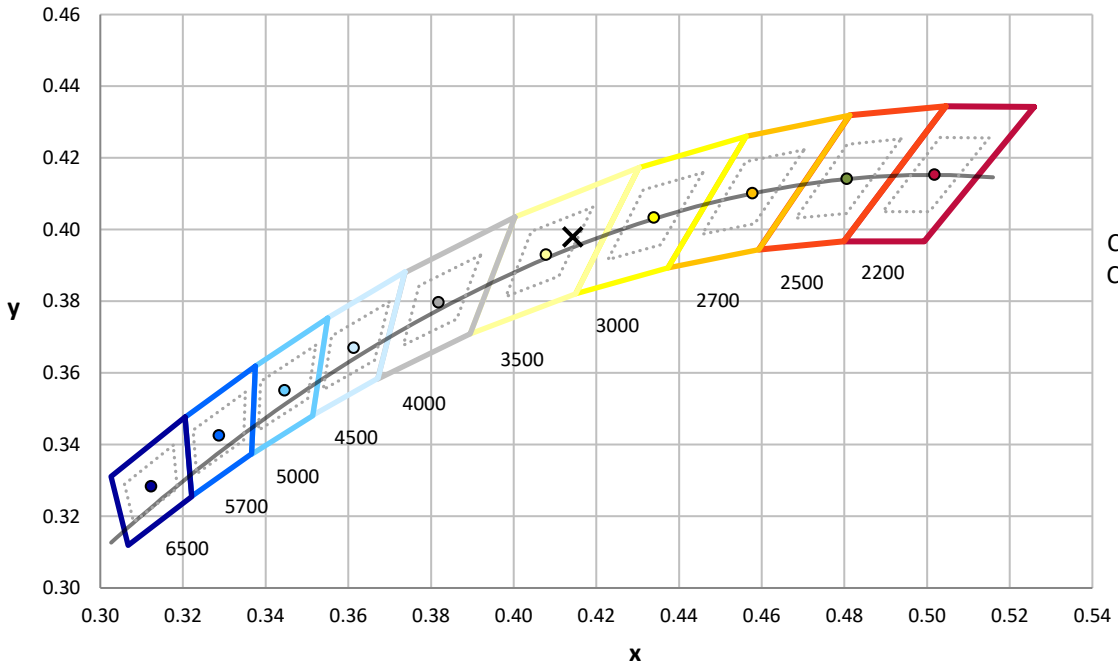


CCT = 3369K
CIE x = 0.4143
CIE y = 0.3980
Duv = 0.0013

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-5

Photopic Flux vs. Wavelength

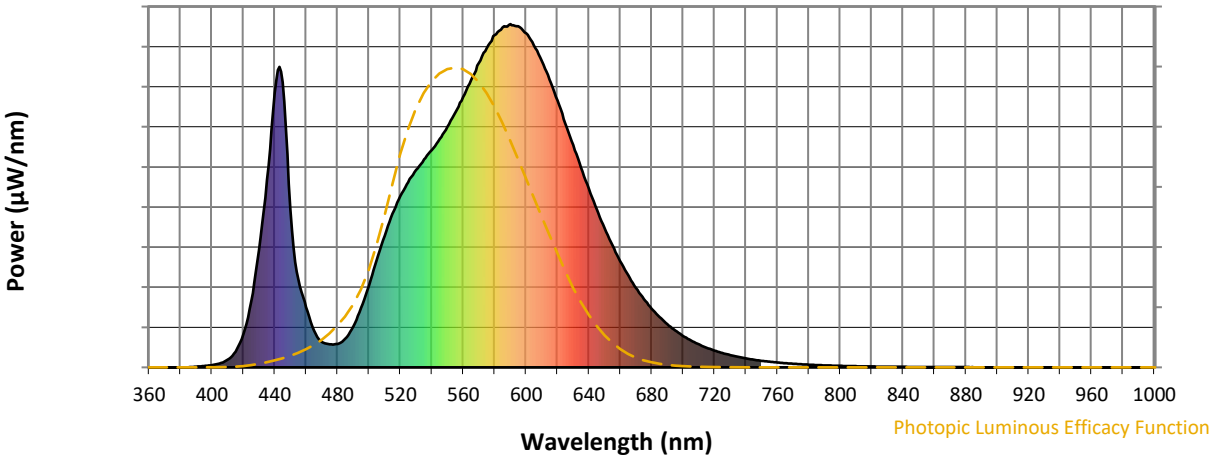


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Scotopic Flux vs. Wavelength

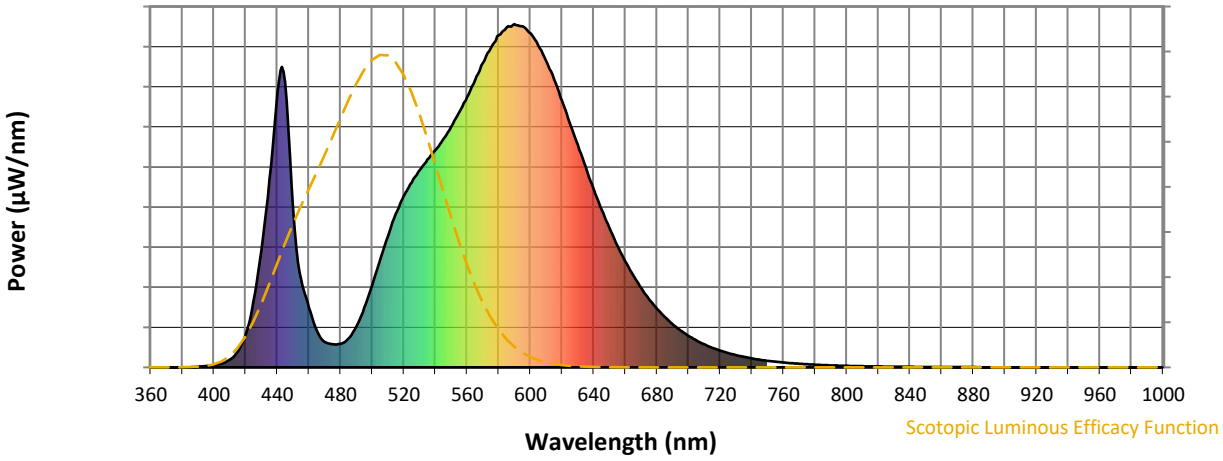


Scotopic Lumens: NR **S/P: 1.29**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Melanopic Flux vs. Wavelength

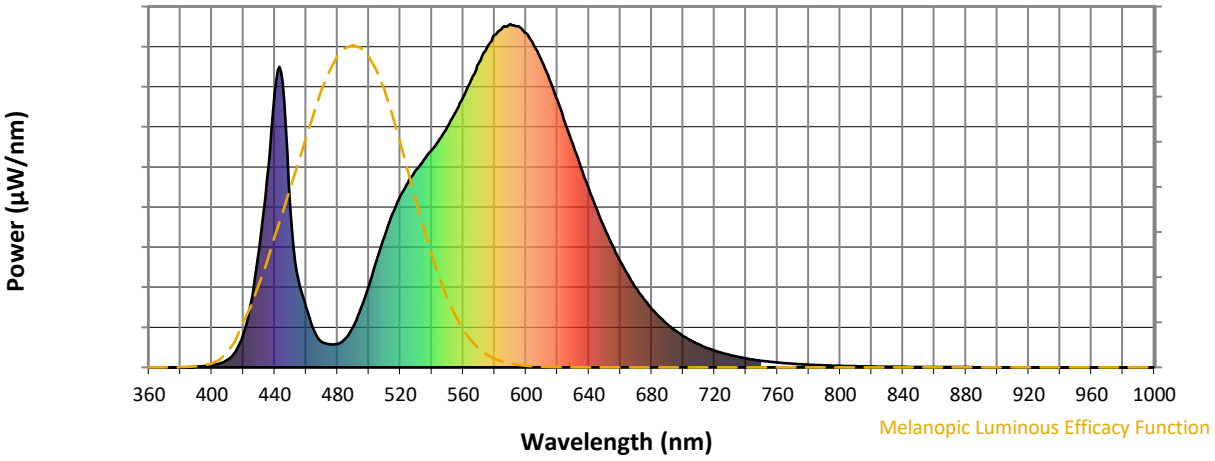

Melanopic Lumens: NR **M/P: 2.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			


REPORT NUMBER: SP1-2407-184-5

TM-30-18


Summary


R_f = 71.4
R_g = 96
CIE R_a = 70.1
R_9 = -40.2


Spectral Power Distribution Comparison

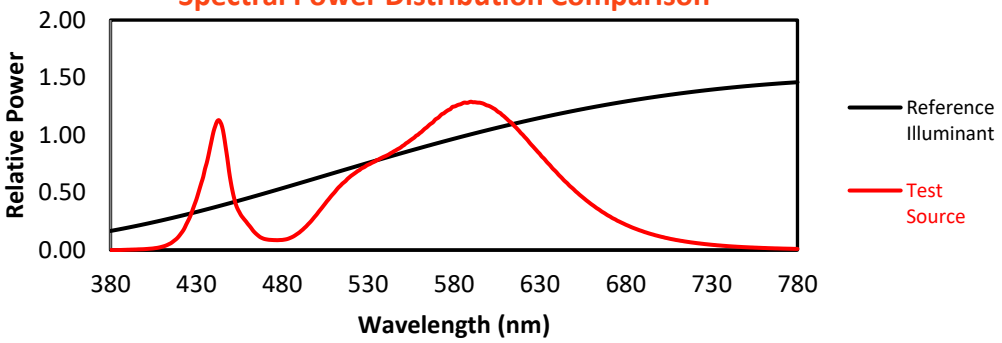


Color Vector Graphics

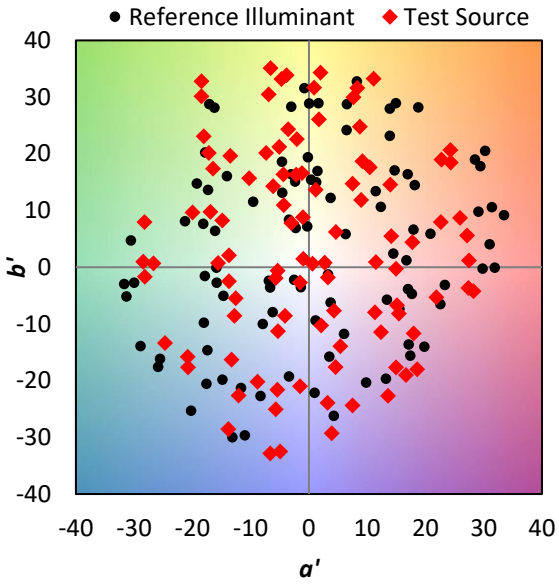

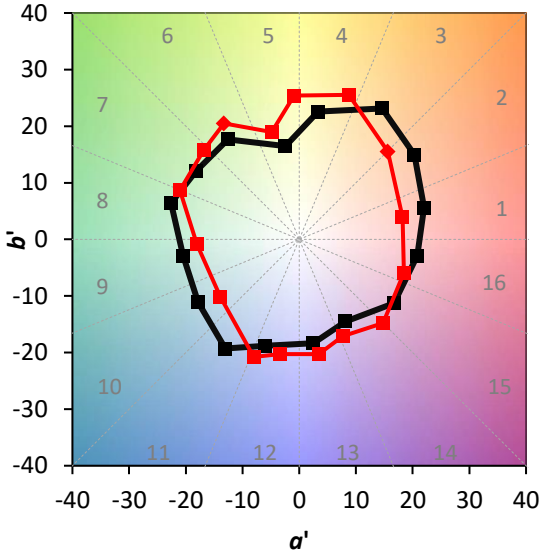

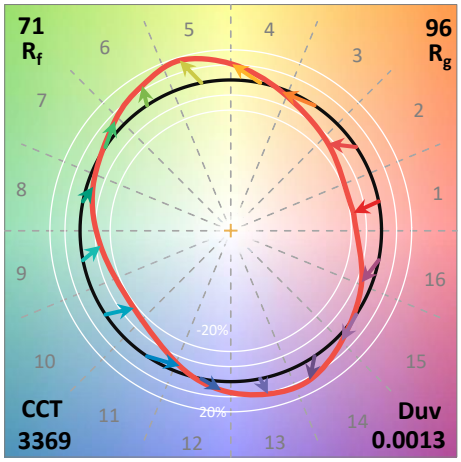

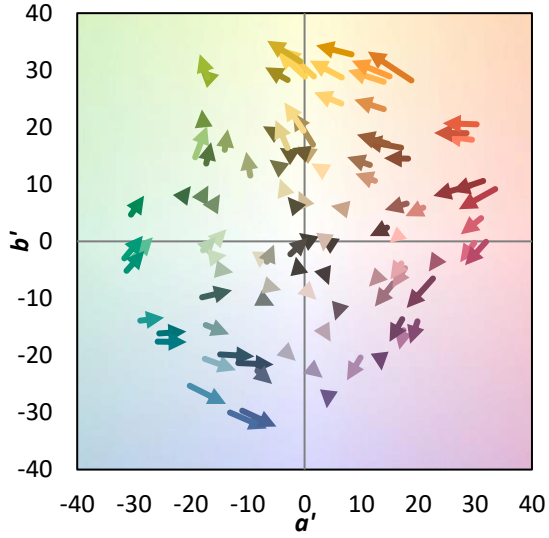


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 57	CES51 = 84	CES76 = 50
CES02 = 62	CES27 = 80	CES52 = 86	CES77 = 74
CES03 = 31	CES28 = 81	CES53 = 72	CES78 = 54
CES04 = 70	CES29 = 50	CES54 = 79	CES79 = 81
CES05 = 48	CES30 = 55	CES55 = 78	CES80 = 79
CES06 = 51	CES31 = 56	CES56 = 67	CES81 = 74
CES07 = 40	CES32 = 54	CES57 = 65	CES82 = 91
CES08 = 39	CES33 = 60	CES58 = 68	CES83 = 86
CES09 = 29	CES34 = 69	CES59 = 85	CES84 = 89
CES10 = 75	CES35 = 83	CES60 = 91	CES85 = 83
CES11 = 58	CES36 = 88	CES61 = 85	CES86 = 66
CES12 = 64	CES37 = 78	CES62 = 78	CES87 = 77
CES13 = 43	CES38 = 64	CES63 = 71	CES88 = 75
CES14 = 74	CES39 = 92	CES64 = 70	CES89 = 68
CES15 = 71	CES40 = 86	CES65 = 64	CES90 = 72
CES16 = 47	CES41 = 81	CES66 = 65	CES91 = 95
CES17 = 50	CES42 = 79	CES67 = 63	CES92 = 62
CES18 = 56	CES43 = 71	CES68 = 69	CES93 = 78
CES19 = 72	CES44 = 98	CES69 = 80	CES94 = 51
CES20 = 65	CES45 = 80	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 75	CES71 = 58	CES96 = 76
CES22 = 79	CES47 = 71	CES72 = 85	CES97 = 82
CES23 = 92	CES48 = 61	CES73 = 51	CES98 = 72
CES24 = 91	CES49 = 74	CES74 = 94	CES99 = 60
CES25 = 72	CES50 = 83	CES75 = 57	

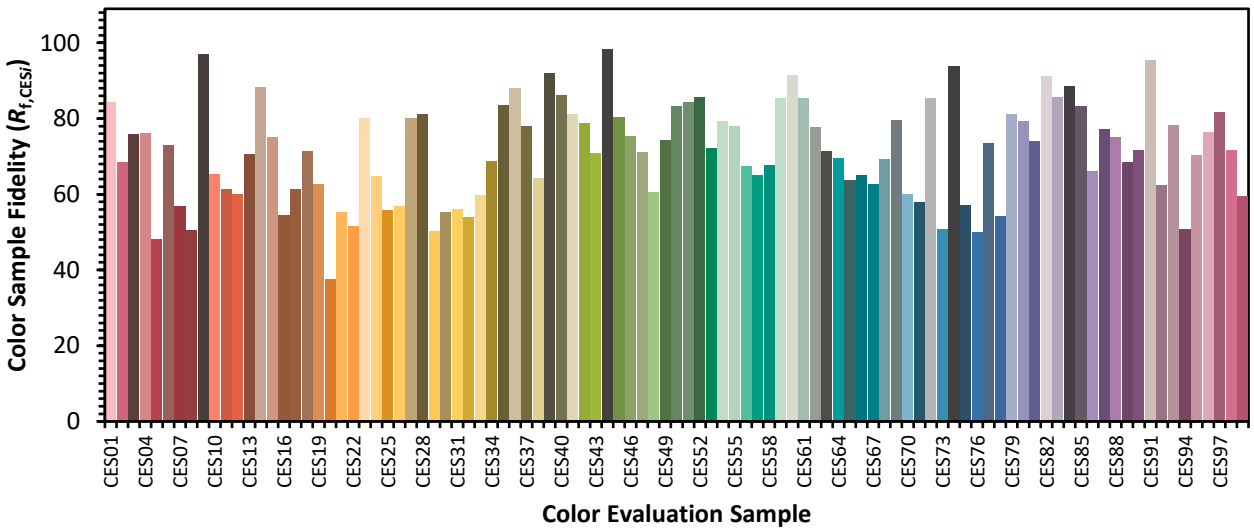



REPORT NUMBER: SP1-2407-184-5

TM-30-18

Color Rendition by Hue-Angle Bin

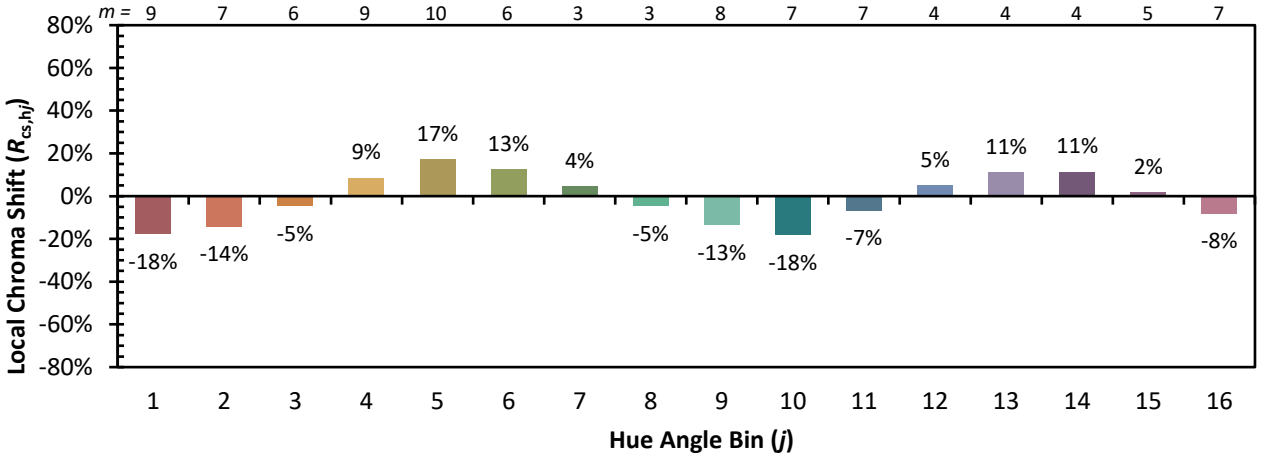

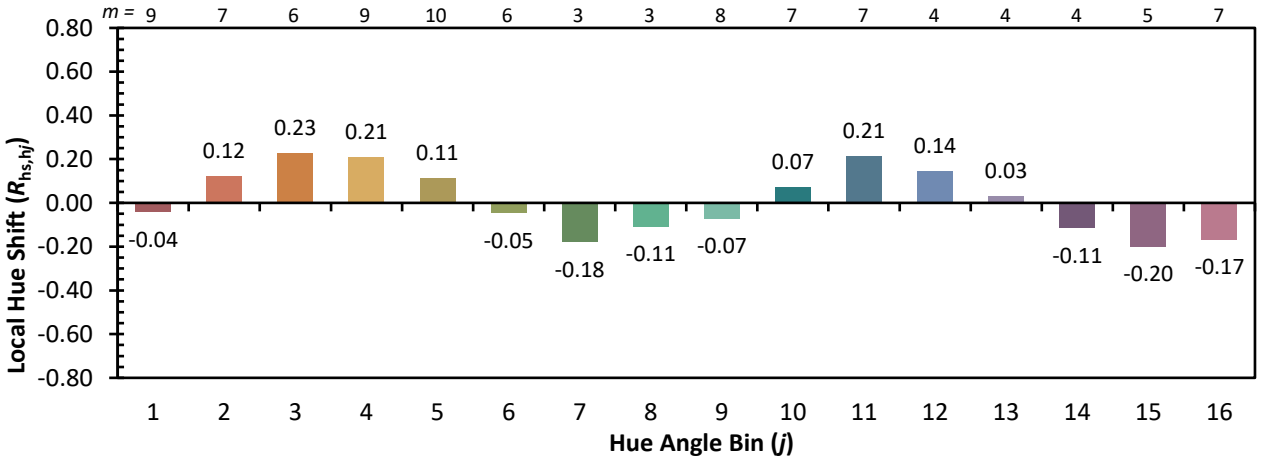


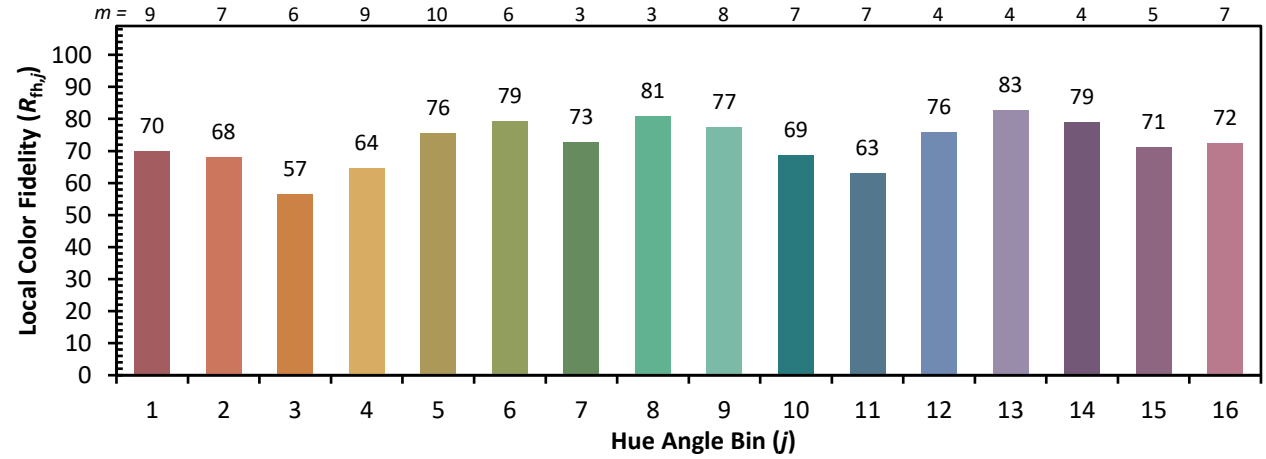


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Measure Comparisons

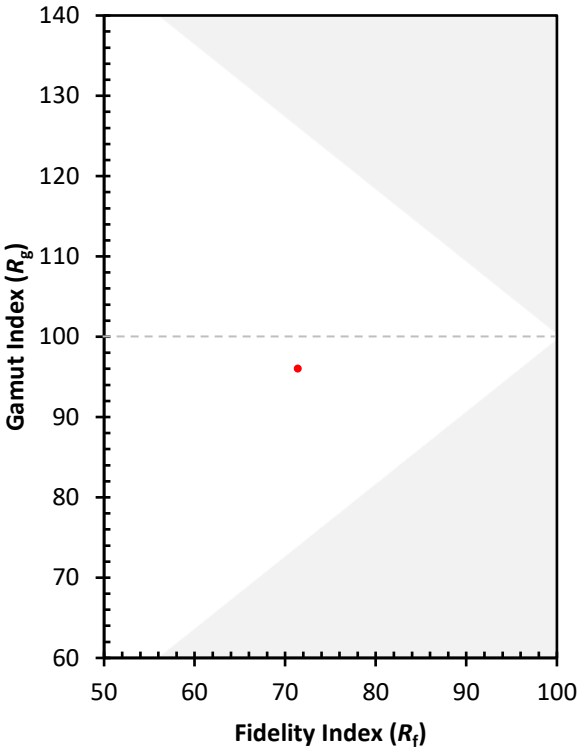

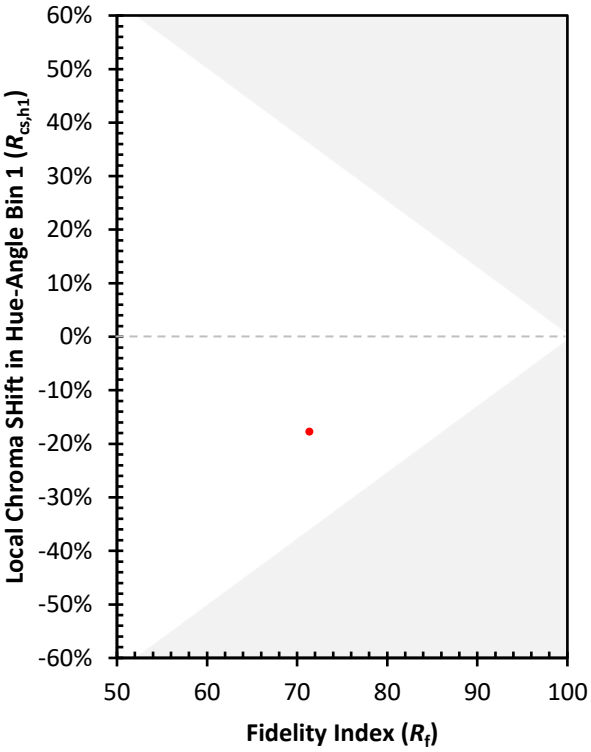

(END OF REPORT)