Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360787

Luminaire Tested: **GSS-SB2A-750-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360787
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB2A-750-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 2SQUARE 58W 70CRI 5000K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(52) 5000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	8691.6 lumens
Efficiency:	N/A
Efficacy:	149.9 lumens/watt
Luminous Opening:	Rectangular (W 1' x L: 0.5' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B3 - U0 - G3


Input Watts (W):	58
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	9.0%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360787
CATALOG NUMBER: GSS-SB2A-750-U-T1

Iso-Footcandle Lines of Horizontal Illumination

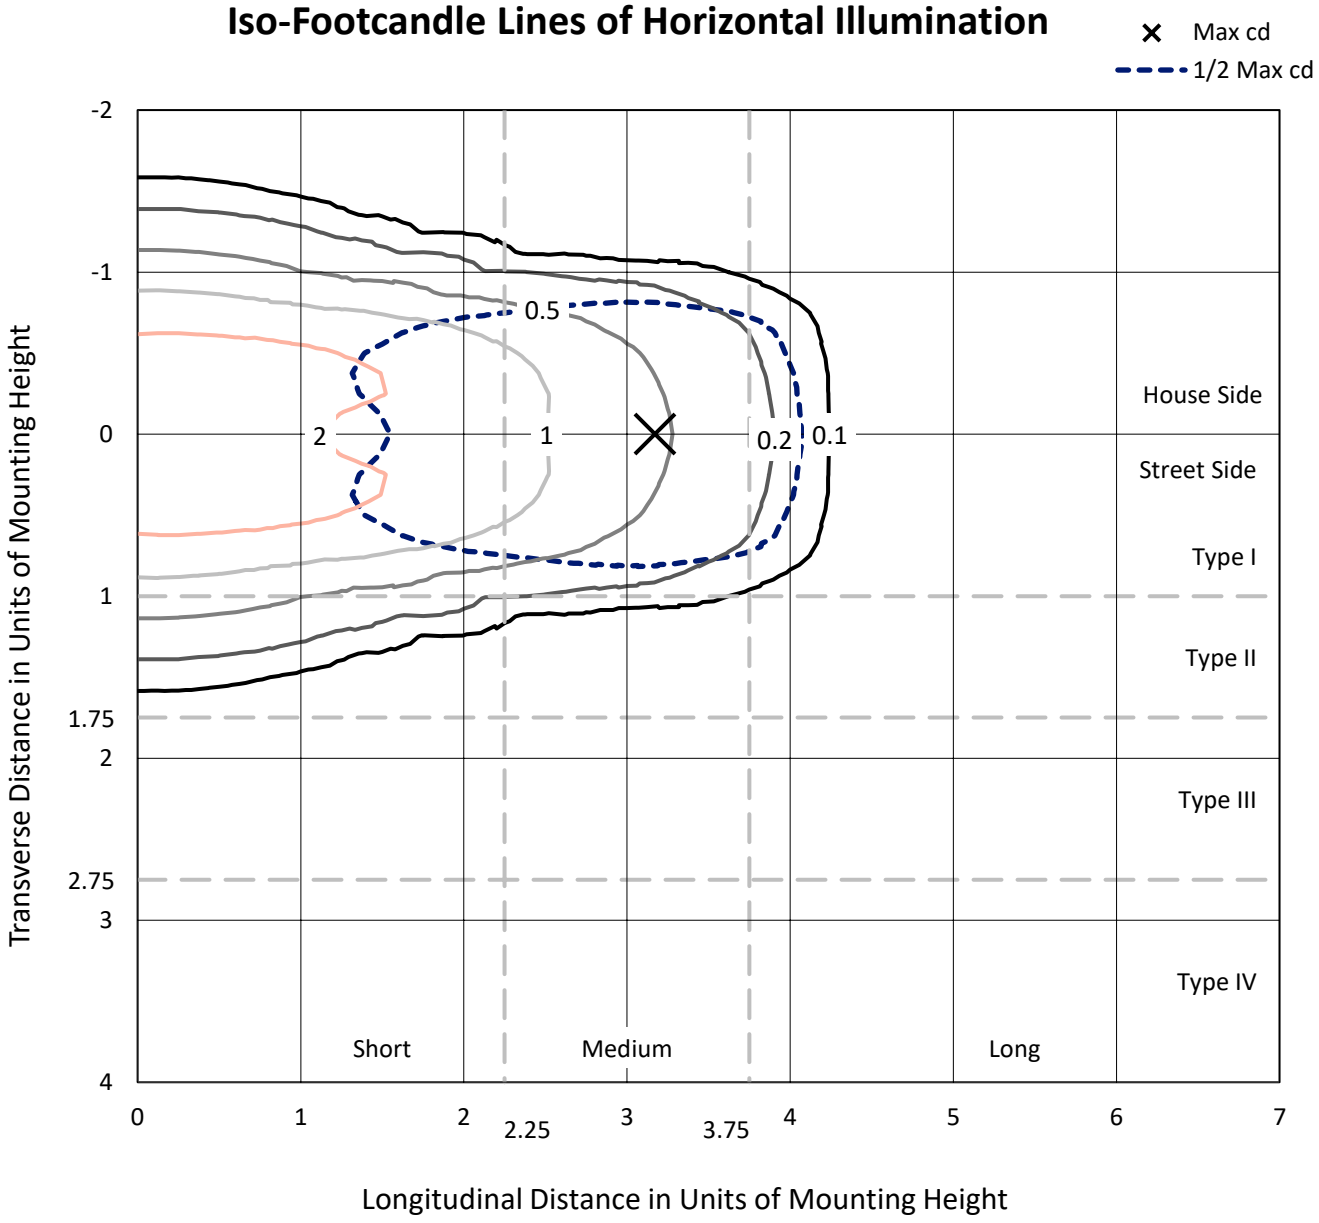


Based on 20 foot mounting height. Maximum calculated value = 4.3 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360787
CATALOG NUMBER: GSS-SB2A-750-U-T1

Luminous Intensity Polar Plot

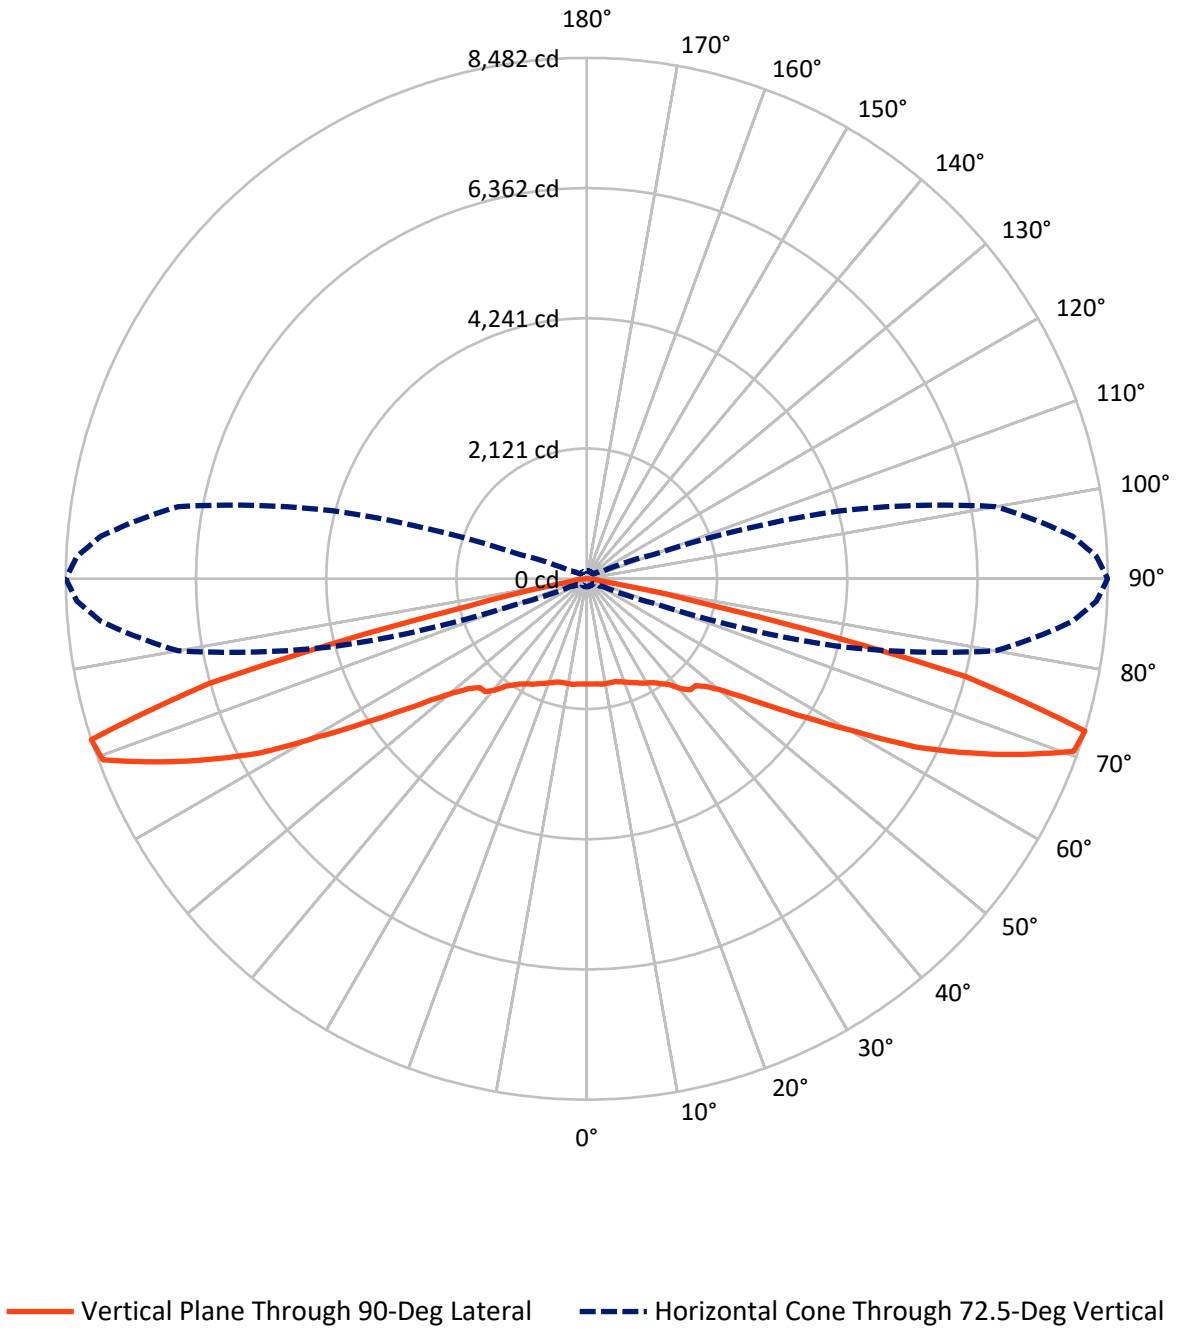

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360787
CATALOG NUMBER: GSS-SB2A-750-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	4345.8	0.0	4345.8
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	4345.8	0.0	4345.8
	% Fixture	50.0	0.0	50.0
Total	Lumens	8691.6	0.0	8691.6
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	165.8	1.9
10°-20°	505.2	5.8
20°-30°	844.4	9.7
30°-40°	1164.5	13.4
40°-50°	1427.5	16.4
50°-60°	1672.8	19.2
60°-70°	1857.6	21.4
70°-80°	1010.2	11.6
80°-90°	43.8	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	8691.6	100.0
0°-180°	8691.6	100.0

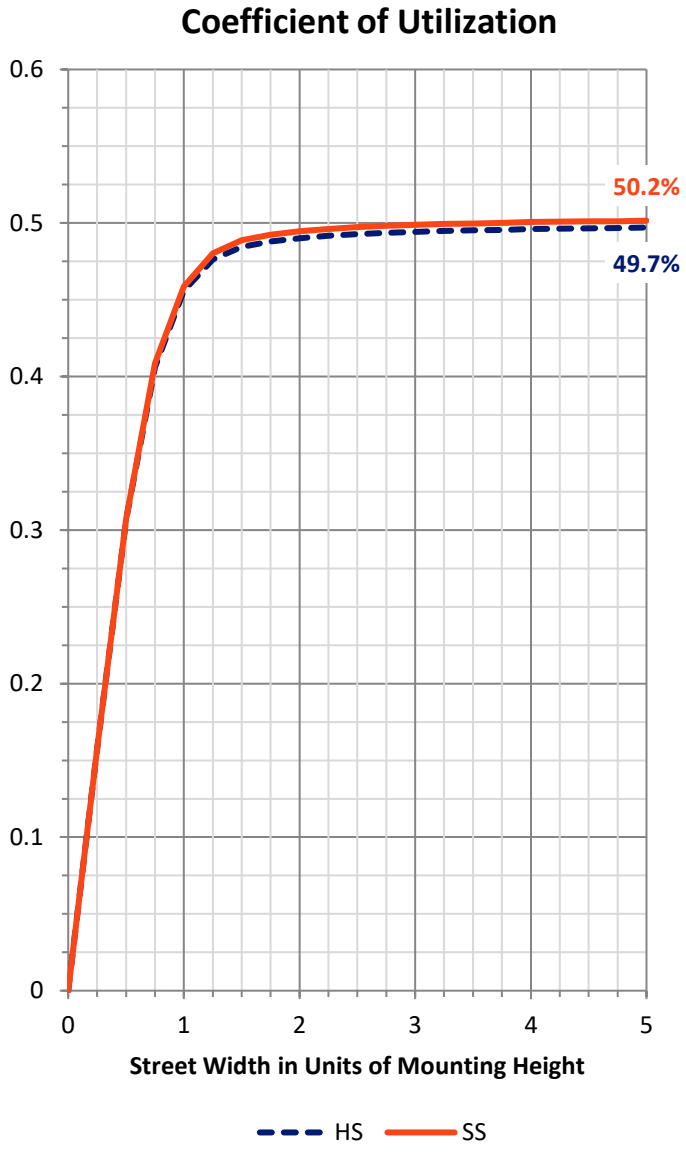

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360787
CATALOG NUMBER: GSS-SB2A-750-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	757.7	8.7			
FM	(30°-60°)	2132.4	24.5			
FH	(60°-80°)	1433.9	16.5			G1/1800
FVH	(80°-90°)	21.9	0.3			G1/100
BL	(0°-30°)	757.7	8.7	B2/1000		
BM	(30°-60°)	2132.4	24.5	B2/2500		
BH	(60°-80°)	1433.9	16.5	B3/2500		G3/2500
BVH	(80°-90°)	21.9	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B3-U0-G3
Type I Short

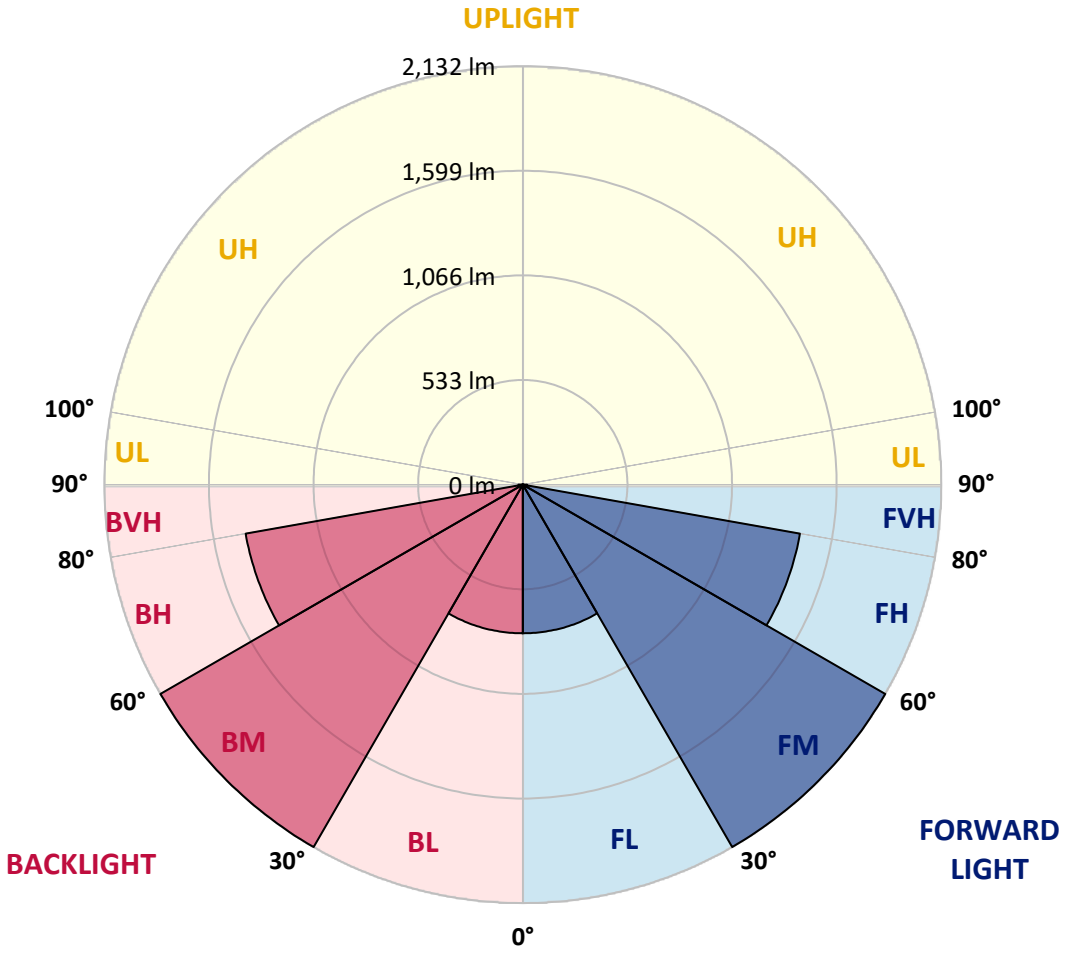

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360787
CATALOG NUMBER: GSS-SB2A-750-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	1712.5	1712.5	1712.5	1712.5	1712.5	1712.5	1712.5	1712.5	1712.5	1712.5	1712.5
2.5°	1714.4	1714.4	1708.7	1716.3	1712.5	1714.4	1716.3	1714.4	1712.5	1714.4	1716.3
5°	1723.9	1720.1	1723.9	1727.7	1722.0	1725.8	1723.9	1714.4	1720.1	1720.1	1720.1
7.5°	1741.0	1744.8	1741.0	1750.5	1744.8	1756.2	1744.8	1737.2	1735.3	1733.4	1733.4
10°	1748.6	1748.6	1746.7	1763.8	1767.6	1779.1	1771.5	1760.0	1754.3	1746.7	1739.1
12.5°	1727.7	1731.5	1741.0	1773.4	1788.6	1811.4	1805.7	1782.9	1765.7	1760.0	1748.6
15°	1704.9	1708.7	1727.7	1767.6	1803.8	1838.0	1836.1	1807.6	1786.7	1771.5	1754.3
17.5°	1668.7	1674.4	1701.1	1761.9	1826.6	1864.7	1876.1	1847.6	1824.7	1800.0	1777.2
20°	1607.8	1607.8	1655.4	1733.4	1822.8	1908.4	1938.9	1916.1	1889.4	1849.5	1819.0
22.5°	1539.3	1543.1	1590.7	1693.4	1820.9	1946.5	2005.5	1980.8	1954.1	1910.4	1864.7
25°	1470.8	1470.8	1524.1	1640.2	1796.2	1973.1	2083.5	2070.2	2016.9	1976.9	1918.0
27.5°	1408.0	1408.0	1465.1	1586.9	1754.3	1980.8	2161.5	2161.5	2102.5	2043.5	1978.9
30°	1333.8	1352.8	1417.5	1545.0	1716.3	1967.4	2218.6	2254.7	2201.5	2125.4	2030.2
32.5°	1271.0	1284.4	1350.9	1486.0	1661.1	1952.2	2283.3	2372.7	2317.5	2212.9	2106.3
35°	1196.8	1194.9	1271.0	1404.2	1583.1	1918.0	2334.7	2513.5	2460.2	2348.0	2203.4
37.5°	1099.8	1099.8	1177.8	1307.2	1508.9	1859.0	2376.5	2669.5	2629.6	2502.1	2348.0
40°	995.1	1006.6	1075.0	1206.3	1419.4	1788.6	2376.5	2797.0	2818.0	2686.7	2526.8
42.5°	919.0	922.8	985.6	1109.3	1320.5	1697.2	2346.1	2907.4	2970.2	2859.8	2652.4
45°	839.1	848.6	901.9	1016.1	1217.8	1588.8	2292.8	3031.1	3131.9	3055.8	2783.7
47.5°	742.1	751.6	812.5	928.5	1120.7	1470.8	2203.4	3160.5	3371.7	3316.5	3017.7
50°	629.8	637.4	694.5	818.2	1012.3	1335.7	2091.1	3257.5	3611.4	3666.6	3371.7
52.5°	492.8	498.5	559.4	679.3	882.9	1206.3	1933.2	3316.5	3853.1	4047.1	3845.4
55°	353.9	363.4	416.7	515.6	711.6	1033.2	1744.8	3346.9	4117.5	4498.1	4433.4
57.5°	255.0	258.8	294.9	371.0	529.0	829.6	1503.2	3295.5	4355.4	5036.6	5171.7
60°	211.2	211.2	216.9	253.1	361.5	586.0	1213.9	3105.3	4559.0	5580.7	5997.4
62.5°	194.1	194.1	197.9	203.6	237.8	380.5	867.6	2719.0	4581.8	6104.0	6903.1
65°	177.0	177.0	180.8	184.6	192.2	247.4	523.3	1990.3	4134.7	6109.7	7390.2
67.5°	161.7	161.7	163.6	165.5	169.3	180.8	287.3	1206.3	3308.9	5948.0	7576.7
70°	146.5	146.5	146.5	144.6	150.3	152.2	190.3	612.7	2212.9	5371.4	7487.3
72.5°	*129.4*	*129.4*	*127.5*	*123.7*	*125.6*	*125.6*	*140.8*	*300.6*	*1149.3*	*4269.8*	*6760.4*
75°	110.4	112.3	104.7	100.8	98.9	100.8	112.3	171.2	513.7	2589.6	5051.8
77.5°	93.2	97.0	85.6	78.0	76.1	76.1	87.5	106.6	220.7	940.0	2264.3
80°	70.4	72.3	62.8	55.2	55.2	53.3	64.7	78.0	104.7	279.7	508.0
82.5°	40.0	40.0	36.2	32.3	30.4	32.3	43.8	53.3	64.7	98.9	138.9
85°	9.5	9.5	11.4	13.3	13.3	17.1	24.7	28.5	34.2	40.0	53.3
87.5°	1.9	1.9	1.9	3.8	5.7	5.7	9.5	13.3	17.1	20.9	22.8
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360787
CATALOG NUMBER: GSS-SB2A-750-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	1712.5	1712.5	*1712.5*
2.5°	1716.3	1718.2	*1716.3*
5°	1727.7	1723.9	*1718.2*
7.5°	1729.6	1731.5	*1733.4*
10°	1737.2	1744.8	*1733.4*
12.5°	1744.8	1739.1	*1735.3*
15°	1750.5	1748.6	*1737.2*
17.5°	1771.5	1763.8	*1761.9*
20°	1803.8	1801.9	*1796.2*
22.5°	1841.9	1838.0	*1836.1*
25°	1897.0	1883.7	*1876.1*
27.5°	1942.7	1931.3	*1927.5*
30°	1988.4	1965.5	*1965.5*
32.5°	2028.3	2022.6	*2018.8*
35°	2123.5	2094.9	*2098.7*
37.5°	2239.5	2211.0	*2186.2*
40°	2403.2	2365.1	*2349.9*
42.5°	2507.8	2469.8	*2473.6*
45°	2566.8	2500.2	*2483.1*
47.5°	2726.6	2642.9	*2620.1*
50°	2985.4	2882.7	*2854.1*
52.5°	3404.0	3238.5	*3200.4*
55°	3929.2	3725.6	*3687.5*
57.5°	4648.4	4378.2	*4296.4*
60°	5523.7	5188.8	*5065.1*
62.5°	6575.9	6163.0	*6045.0*
65°	7367.4	7023.0	*6840.4*
67.5°	8001.0	7717.5	*7630.0*
70°	8377.8	8391.1	*8413.9*
72.5°	*7942.0*	*8307.4*	*8482.4*
75°	5820.5	6104.0	*6376.1*
77.5°	2249.0	2028.3	*1963.6*
80°	363.4	340.6	*352.0*
82.5°	163.6	173.1	*182.7*
85°	106.6	123.7	*131.3*
87.5°	24.7	24.7	*24.7*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-6

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-750-U-5WQ

Data in this report applies to families of products including GSS-SB1A-750-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-750-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 5000K CCT 26 LEDS

Spectral Parameters

CCT (K):	4896
CIE u':	0.2101
CIE v':	0.4901
Duv:	0.0035
CIE x:	0.3489
CIE y:	0.3618
CIE z:	0.2893
Peak Wavelength (nm):	443
Dominant Wavelength (nm):	570
Purity:	13.25435
Rf:	70.7
Rg:	96.8

CRI (Ra):	70.2
R1:	68.1
R2:	73.9
R3:	79.4
R4:	72.1
R5:	69.2
R6:	65.7
R7:	78.1
R8:	55.3
R9:	-35.1
R10:	39.3
R11:	71.1
R12:	43.8
R13:	68.1
R14:	88.4
R15:	59.7

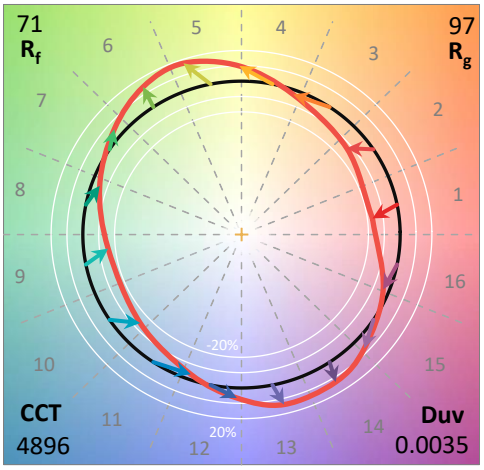

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-6

CIE 1931 Chromaticity Diagram

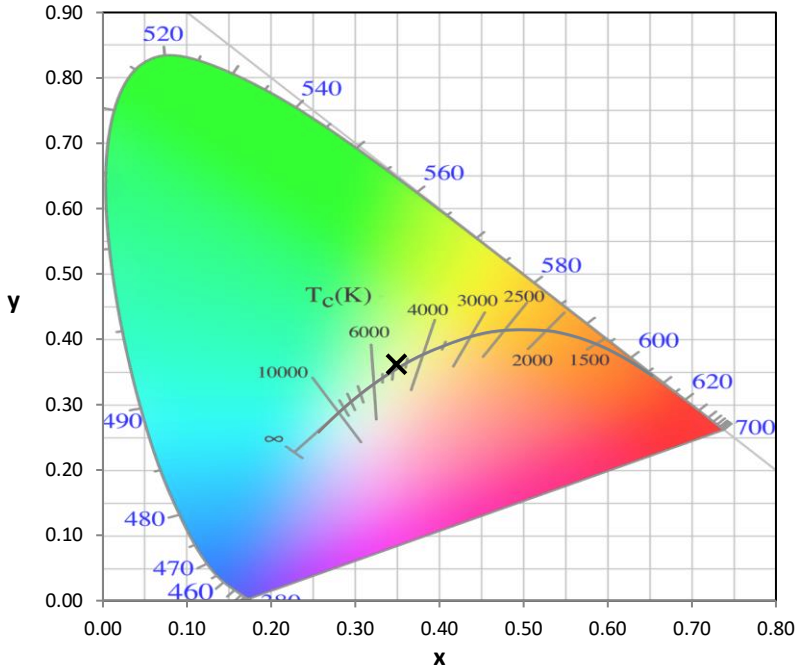

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

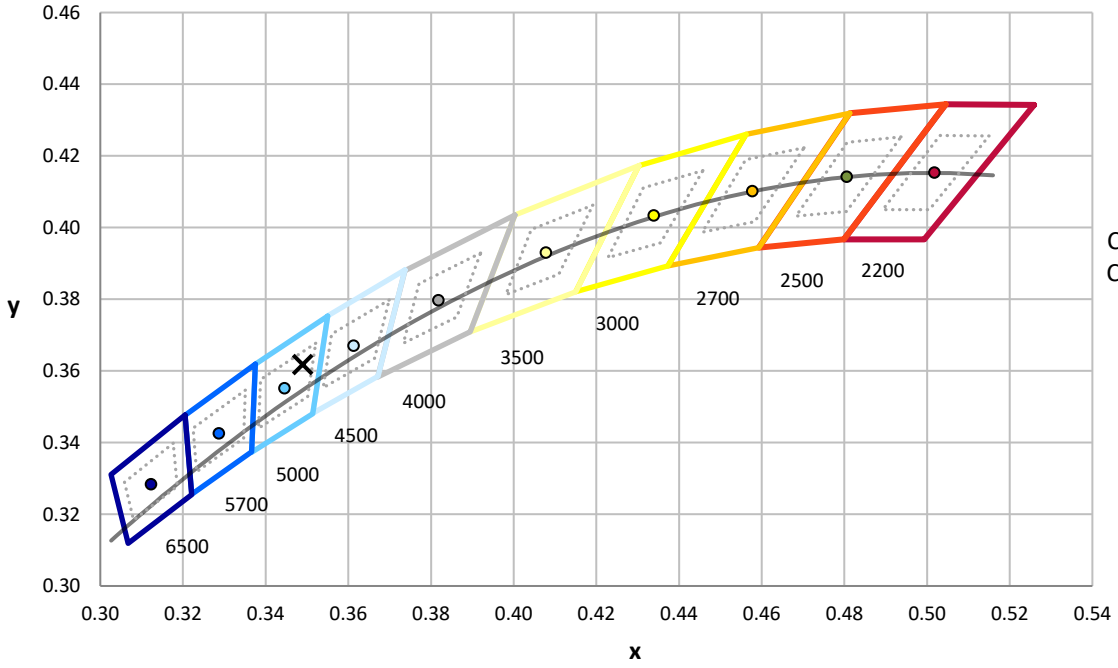


CCT = 4896K
CIE x = 0.3489
CIE y = 0.3618
Duv = 0.0035

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-6

Photopic Flux vs. Wavelength

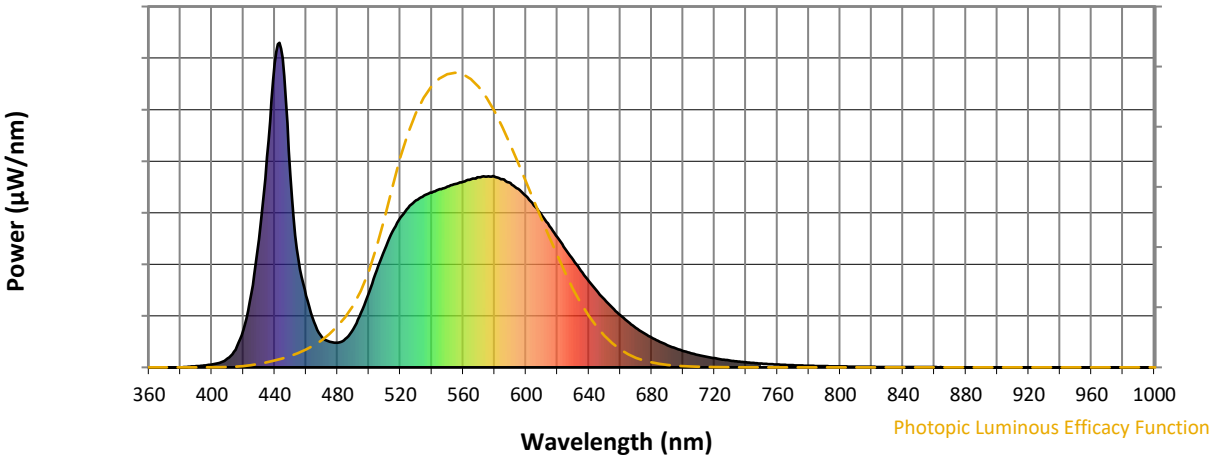


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Scotopic Flux vs. Wavelength

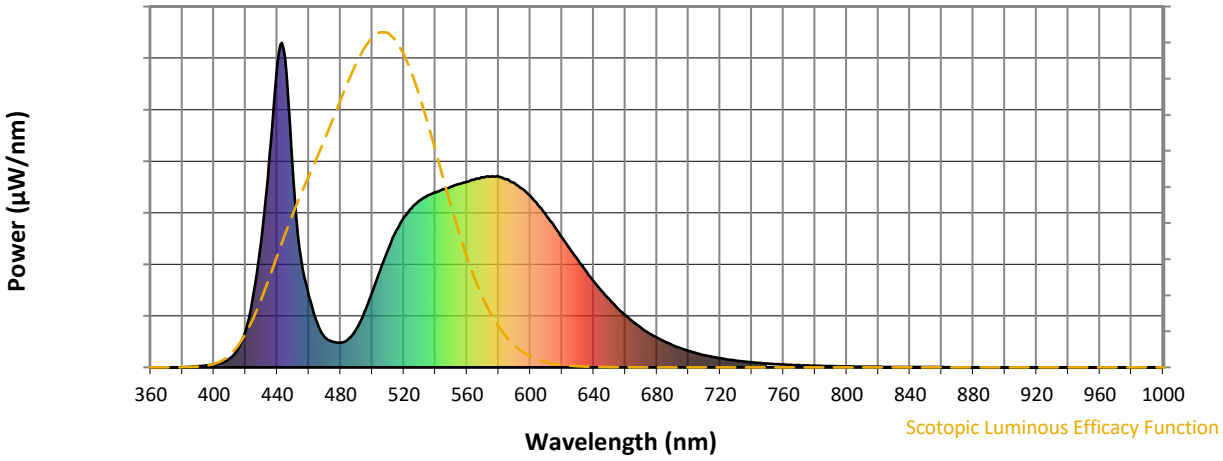


Scotopic Lumens: NR **S/P: 1.7**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Melanopic Flux vs. Wavelength

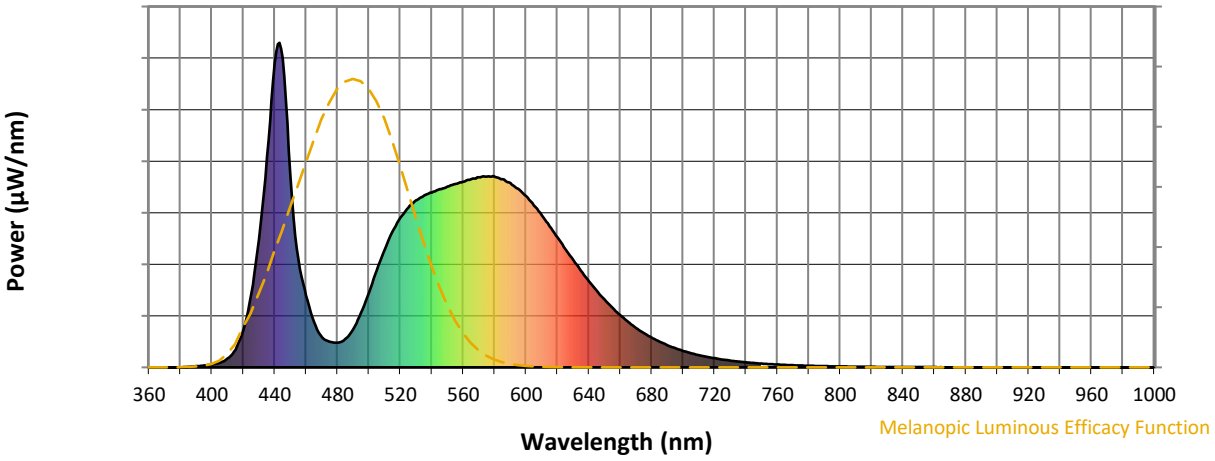

Melanopic Lumens: NR **M/P: 3.37**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			


REPORT NUMBER: SP1-2407-184-6

TM-30-18


Summary


R_f = 70.7
R_g = 96.8
CIE R_a = 70.2
R_9 = -35.1


Spectral Power Distribution Comparison

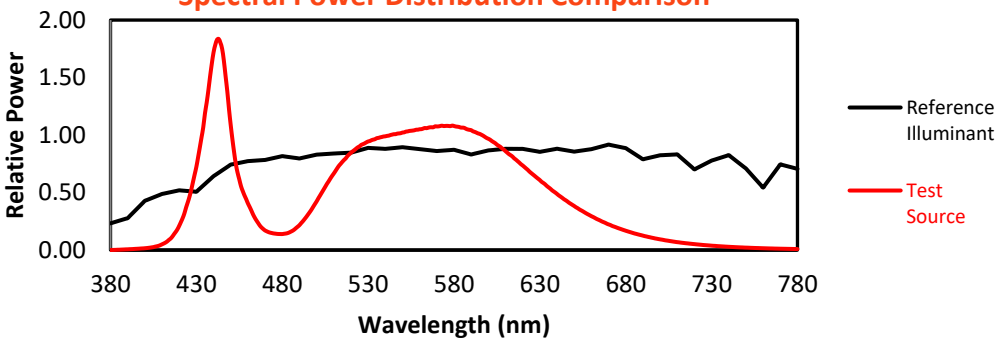


Color Vector Graphics

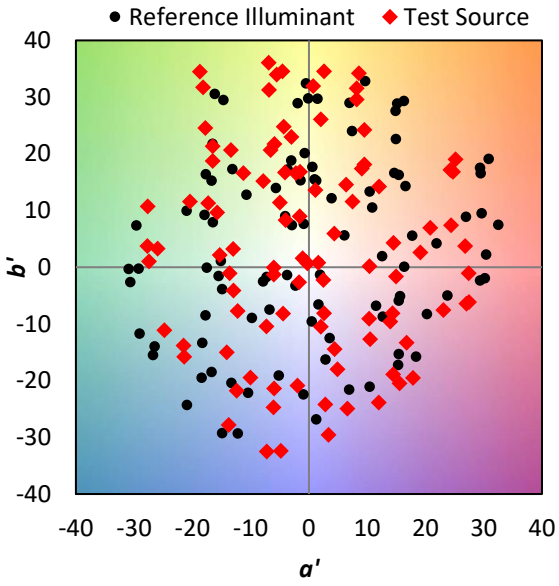

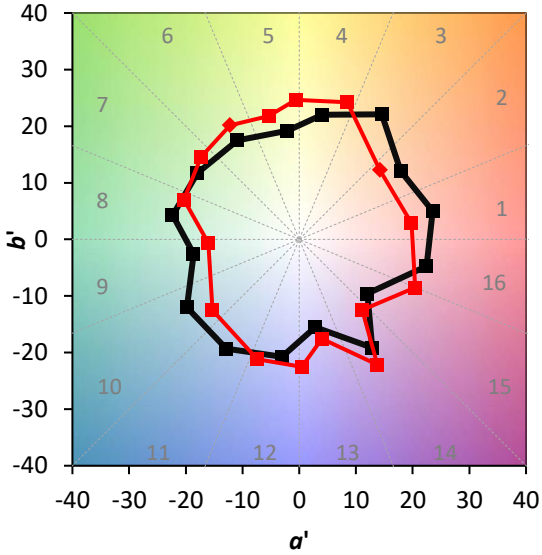

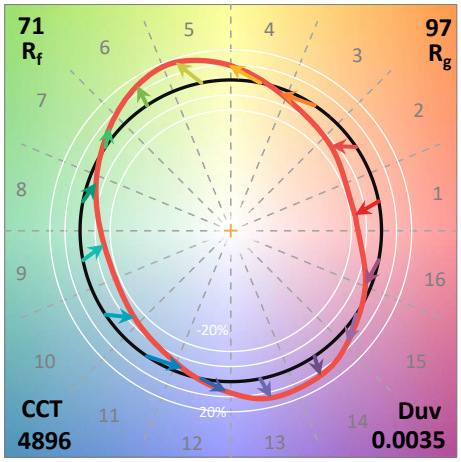

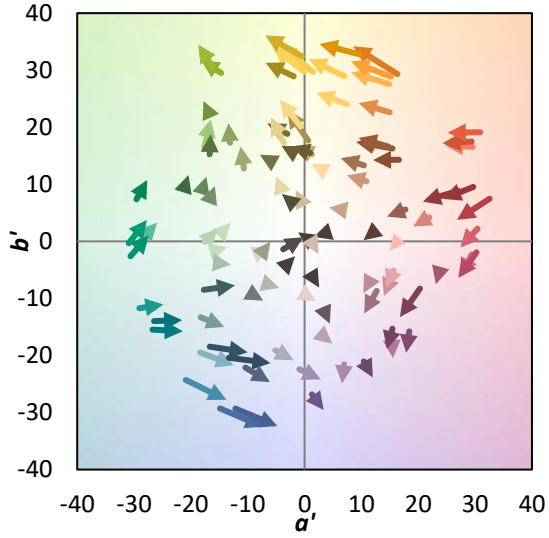


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 53	CES51 = 87	CES76 = 42
CES02 = 59	CES27 = 78	CES52 = 88	CES77 = 64
CES03 = 30	CES28 = 76	CES53 = 74	CES78 = 45
CES04 = 69	CES29 = 48	CES54 = 80	CES79 = 74
CES05 = 46	CES30 = 56	CES55 = 79	CES80 = 71
CES06 = 50	CES31 = 54	CES56 = 68	CES81 = 72
CES07 = 39	CES32 = 50	CES57 = 65	CES82 = 88
CES08 = 38	CES33 = 60	CES58 = 67	CES83 = 82
CES09 = 29	CES34 = 62	CES59 = 87	CES84 = 87
CES10 = 72	CES35 = 79	CES60 = 91	CES85 = 84
CES11 = 56	CES36 = 90	CES61 = 87	CES86 = 74
CES12 = 61	CES37 = 72	CES62 = 79	CES87 = 75
CES13 = 41	CES38 = 66	CES63 = 72	CES88 = 76
CES14 = 74	CES39 = 91	CES64 = 70	CES89 = 74
CES15 = 70	CES40 = 83	CES65 = 63	CES90 = 73
CES16 = 46	CES41 = 83	CES66 = 64	CES91 = 92
CES17 = 49	CES42 = 70	CES67 = 62	CES92 = 67
CES18 = 55	CES43 = 68	CES68 = 69	CES93 = 81
CES19 = 71	CES44 = 98	CES69 = 80	CES94 = 56
CES20 = 64	CES45 = 78	CES70 = 56	CES95 = 71
CES21 = 85	CES46 = 77	CES71 = 53	CES96 = 77
CES22 = 77	CES47 = 73	CES72 = 84	CES97 = 82
CES23 = 91	CES48 = 65	CES73 = 46	CES98 = 71
CES24 = 90	CES49 = 76	CES74 = 94	CES99 = 59
CES25 = 71	CES50 = 85	CES75 = 49	

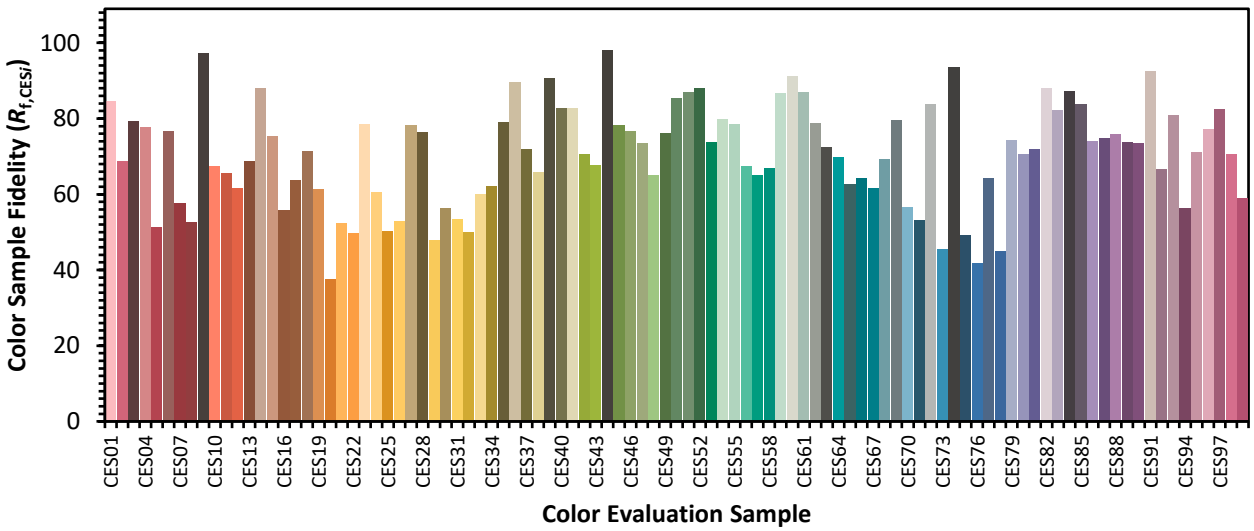



REPORT NUMBER: SP1-2407-184-6

TM-30-18

Color Rendition by Hue-Angle Bin

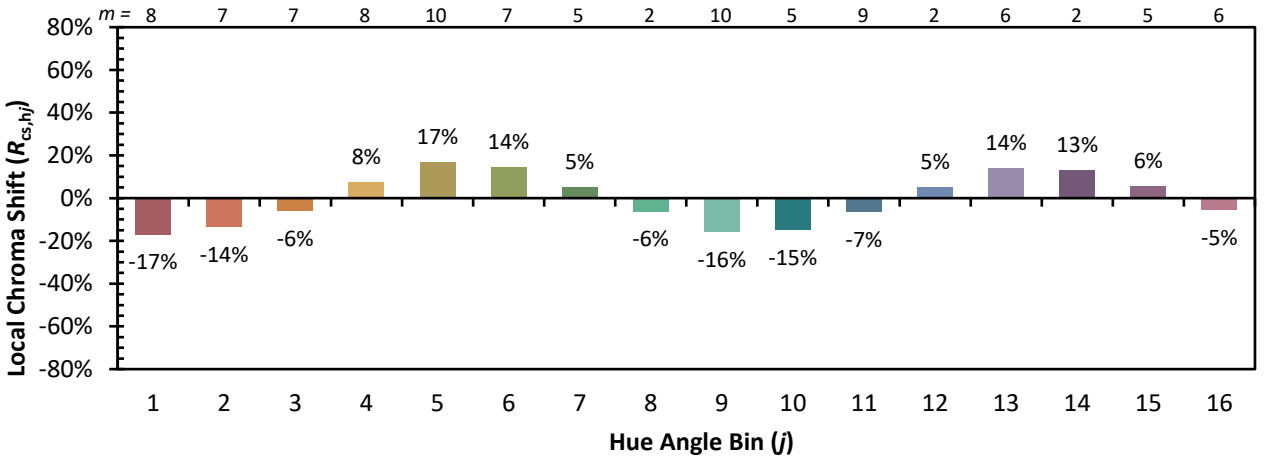

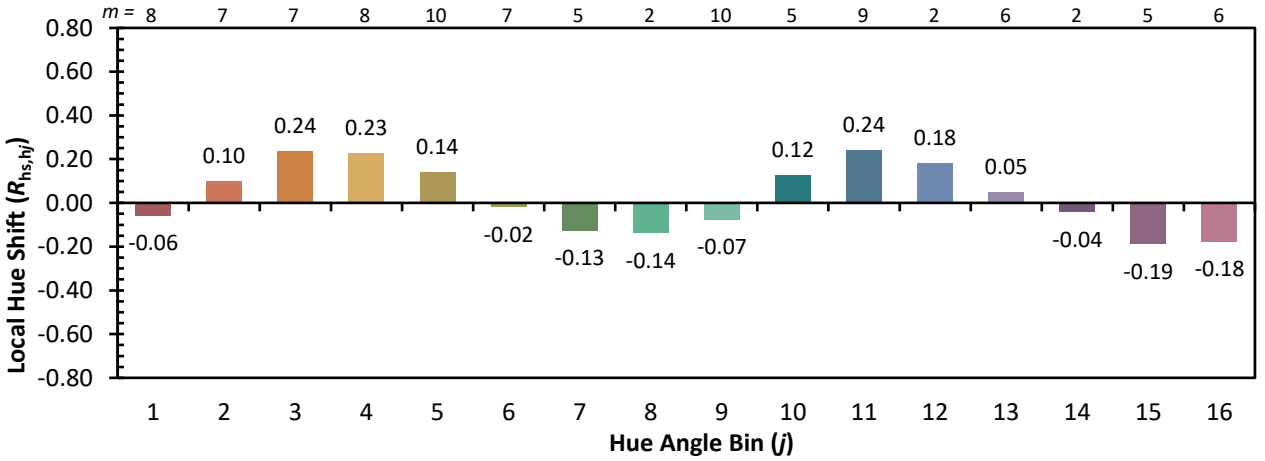


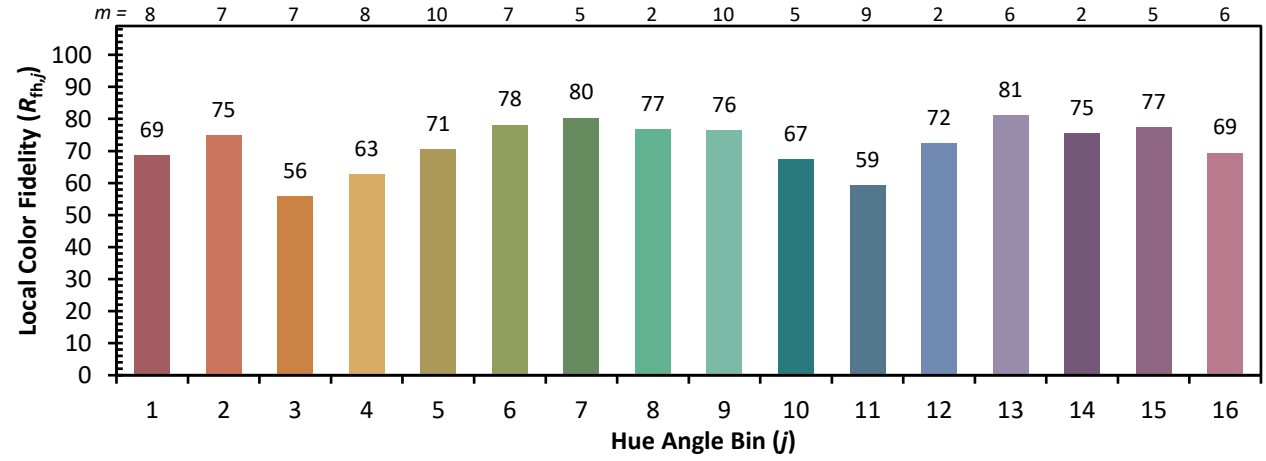


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Measure Comparisons

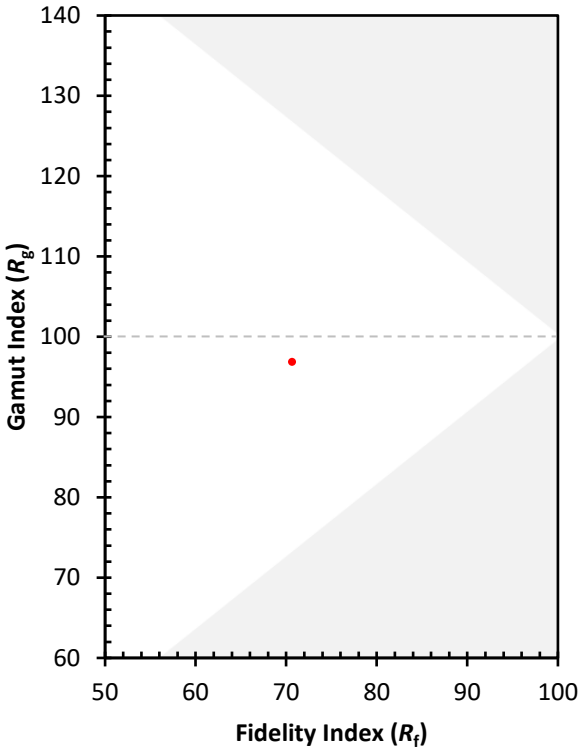

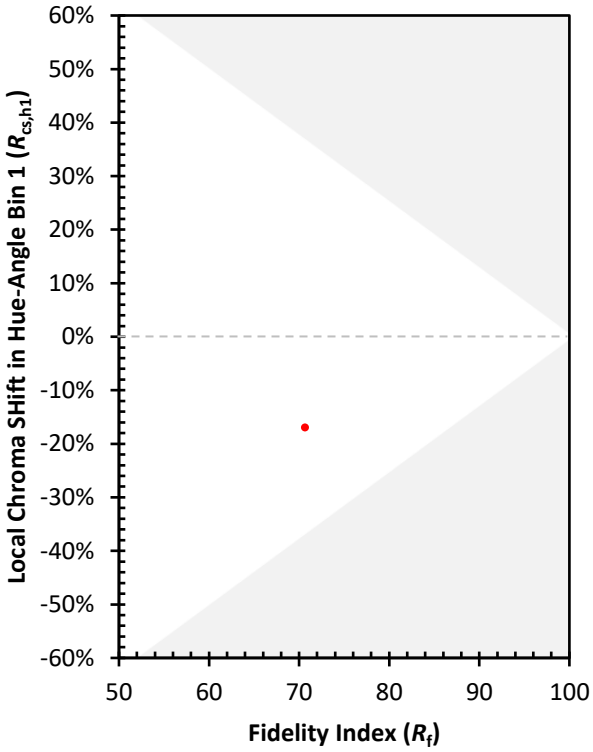

(END OF REPORT)