Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360791

Luminaire Tested: **GSS-SB3A-750-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360791
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB3A-750-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 3SQUARE 85W 70CRI 5000K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(78) 5000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	13093.2 lumens
Efficiency:	N/A
Efficacy:	154.0 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 0.5' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B3 - U0 - G3


Input Watts (W):	85
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	11.0%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360791
CATALOG NUMBER: GSS-SB3A-750-U-T1

Iso-Footcandle Lines of Horizontal Illumination

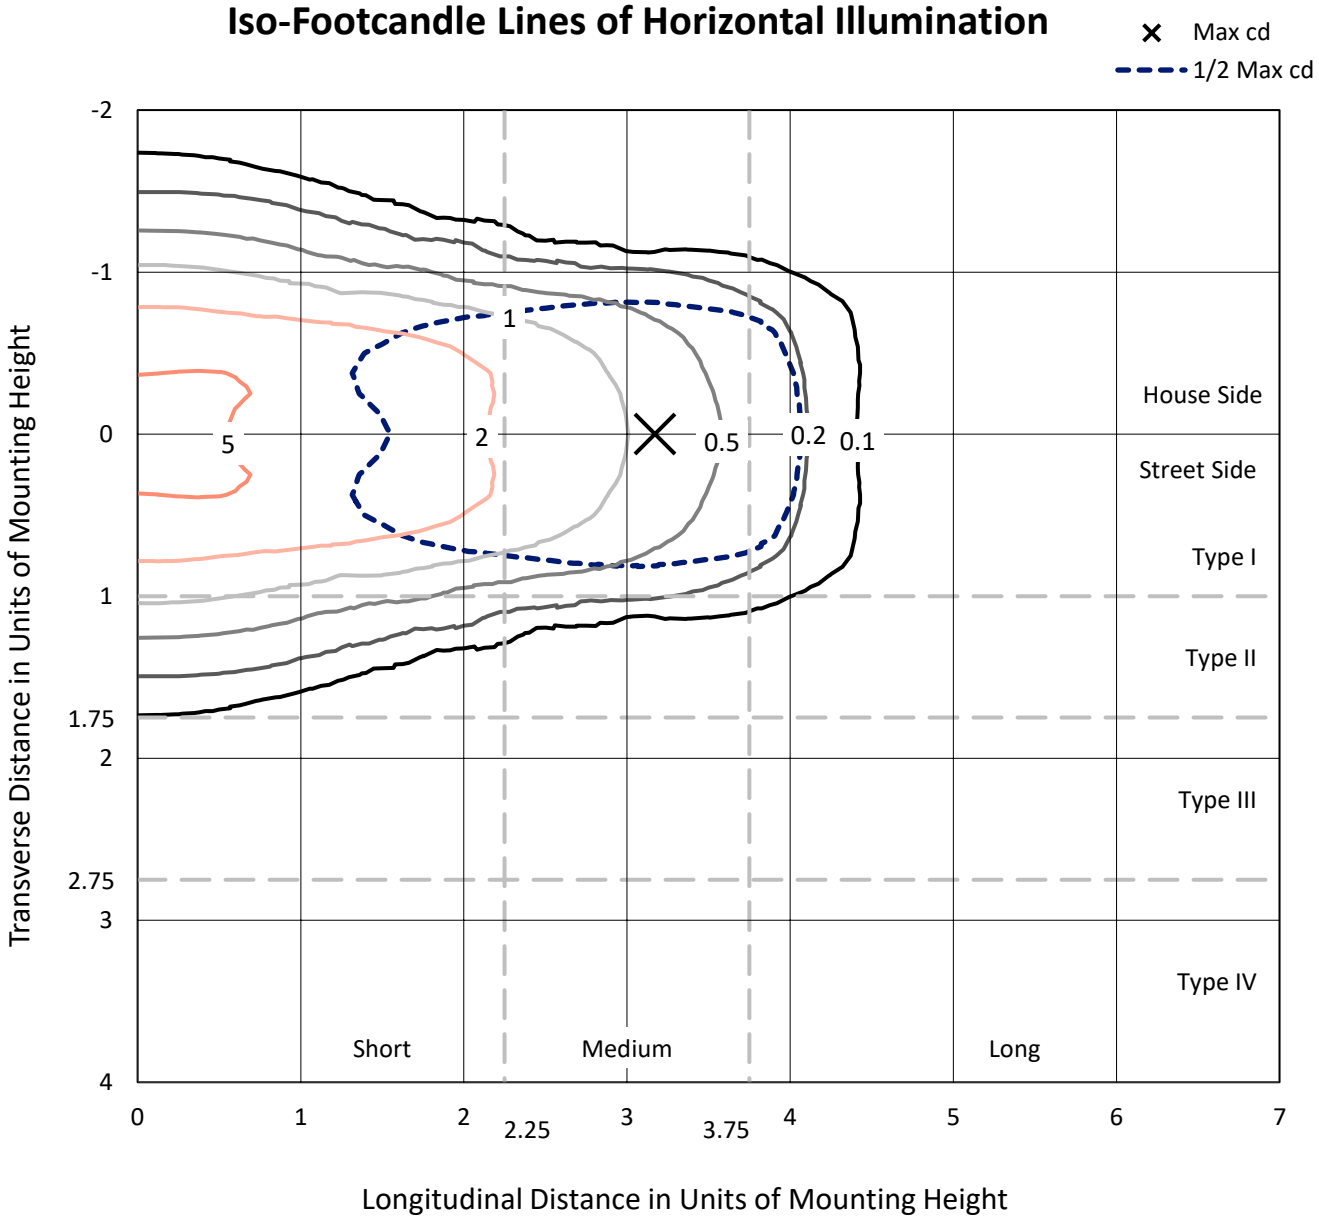


Based on 20 foot mounting height. Maximum calculated value = 6.4 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360791
CATALOG NUMBER: GSS-SB3A-750-U-T1

Luminous Intensity Polar Plot

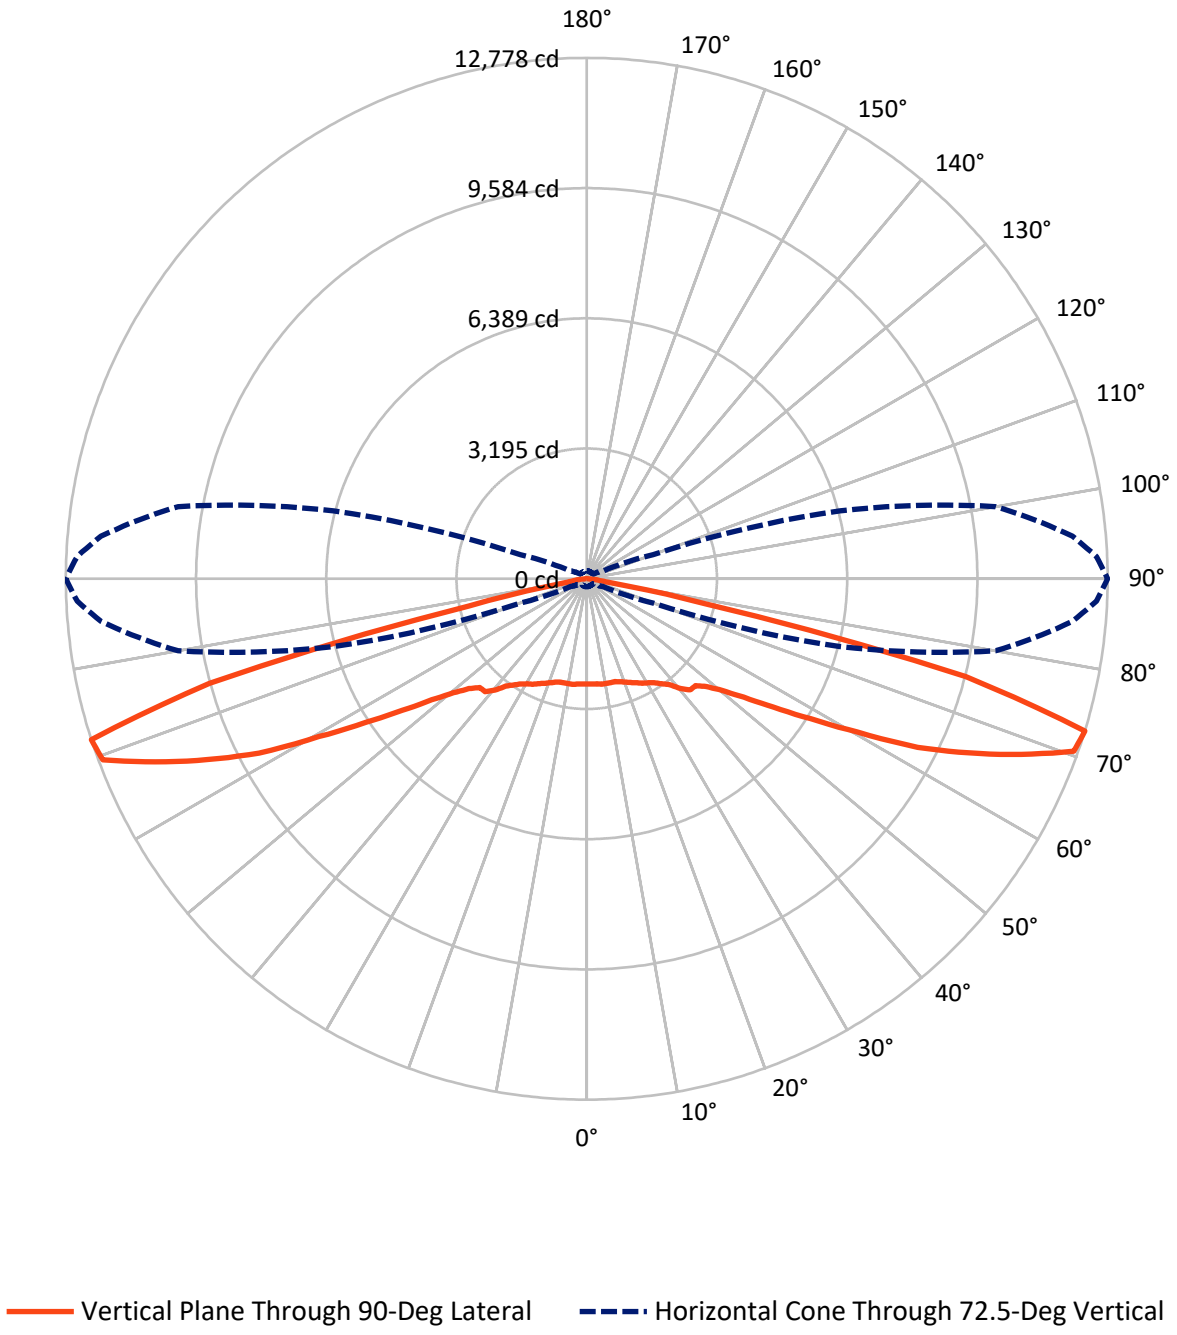

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360791
CATALOG NUMBER: GSS-SB3A-750-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	6546.6	0.0	6546.6
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	6546.6	0.0	6546.6
	% Fixture	50.0	0.0	50.0
Total	Lumens	13093.2	0.0	13093.2
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	249.7	1.9
10°-20°	761.0	5.8
20°-30°	1272.0	9.7
30°-40°	1754.2	13.4
40°-50°	2150.4	16.4
50°-60°	2519.9	19.2
60°-70°	2798.3	21.4
70°-80°	1521.7	11.6
80°-90°	66.0	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	13093.2	100.0
0°-180°	13093.2	100.0

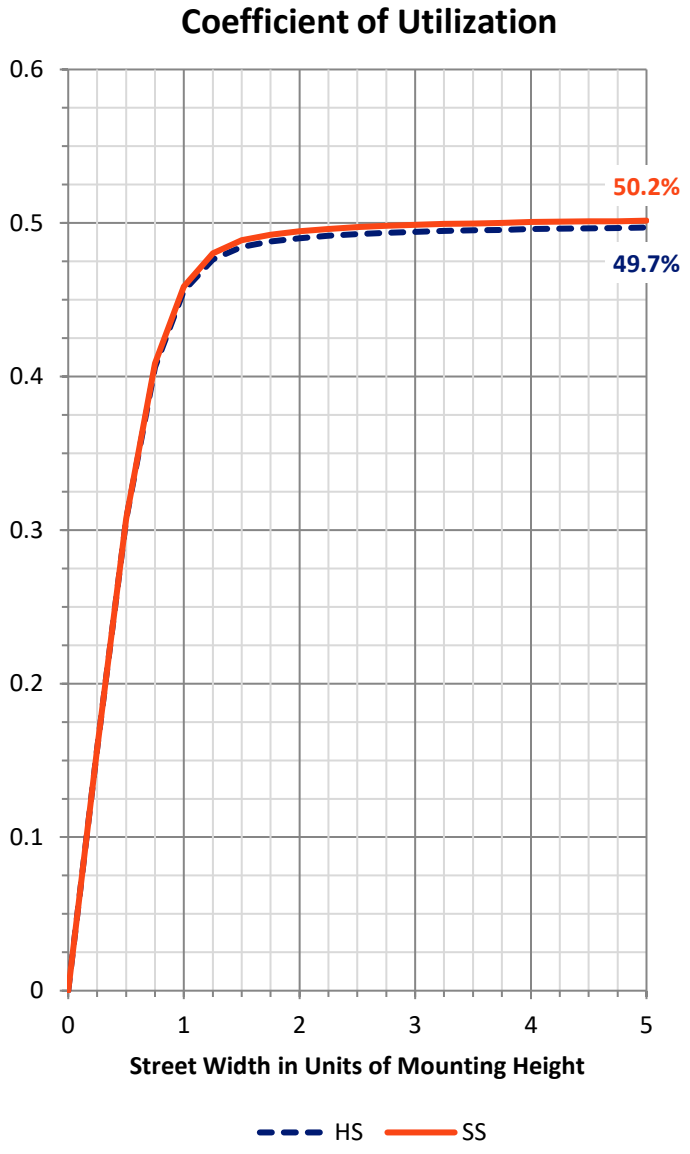

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360791
CATALOG NUMBER: GSS-SB3A-750-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	1141.4	8.7			
FM	(30°-60°)	3212.2	24.5			
FH	(60°-80°)	2160.0	16.5			G2/5000
FVH	(80°-90°)	33.0	0.3			G1/100
BL	(0°-30°)	1141.4	8.7	B3/2500		
BM	(30°-60°)	3212.2	24.5	B3/5000		
BH	(60°-80°)	2160.0	16.5	B3/2500		G3/2500
BVH	(80°-90°)	33.0	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B3-U0-G3
Type I Short

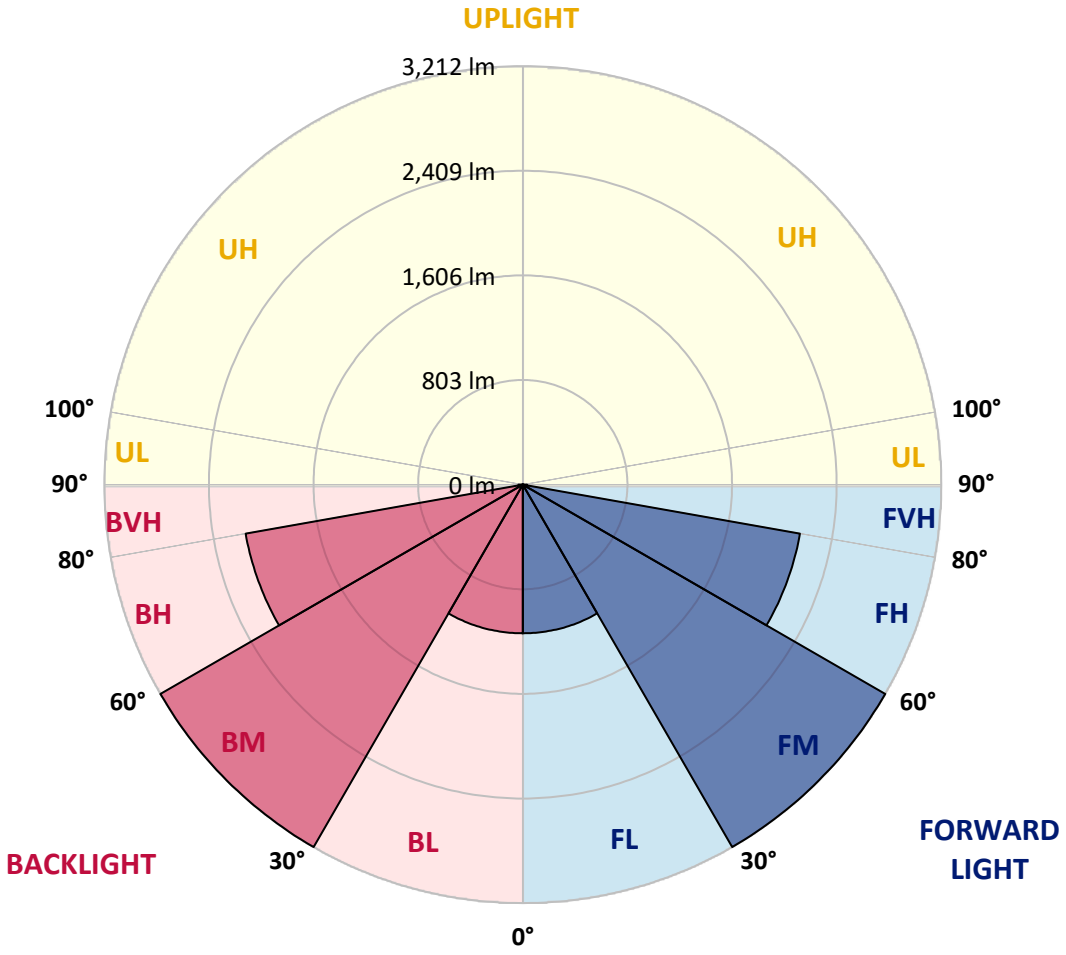

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360791
CATALOG NUMBER: GSS-SB3A-750-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	2579.7	2579.7	2579.7	2579.7	2579.7	2579.7	2579.7	2579.7	2579.7	2579.7	2579.7
2.5°	2582.6	2582.6	2574.0	2585.4	2579.7	2582.6	2585.4	2582.6	2579.7	2582.6	2585.4
5°	2596.9	2591.2	2596.9	2602.6	2594.0	2599.8	2596.9	2582.6	2591.2	2591.2	2591.2
7.5°	2622.7	2628.4	2622.7	2637.0	2628.4	2645.6	2628.4	2617.0	2614.1	2611.2	2611.2
10°	2634.2	2634.2	2631.3	2657.1	2662.8	2680.0	2668.5	2651.4	2642.8	2631.3	2619.8
12.5°	2602.6	2608.4	2622.7	2671.4	2694.3	2728.7	2720.1	2685.7	2660.0	2651.4	2634.2
15°	2568.2	2574.0	2602.6	2662.8	2717.3	2768.9	2766.0	2723.0	2691.5	2668.5	2642.8
17.5°	2513.8	2522.4	2562.5	2654.2	2751.7	2809.0	2826.2	2783.2	2748.8	2711.5	2677.1
20°	2422.0	2422.0	2493.7	2611.2	2745.9	2874.9	2920.8	2886.4	2846.3	2786.1	2740.2
22.5°	2318.9	2324.6	2396.2	2551.0	2743.1	2932.3	3021.1	2983.8	2943.7	2877.8	2809.0
25°	2215.7	2215.7	2295.9	2470.8	2705.8	2972.4	3138.6	3118.6	3038.3	2978.1	2889.3
27.5°	2121.1	2121.1	2207.1	2390.5	2642.8	2983.8	3256.1	3256.1	3167.3	3078.4	2981.0
30°	2009.3	2038.0	2135.4	2327.5	2585.4	2963.8	3342.1	3396.6	3316.3	3201.7	3058.4
32.5°	1914.7	1934.8	2035.1	2238.6	2502.3	2940.8	3439.6	3574.3	3491.2	3333.5	3173.0
35°	1802.9	1800.1	1914.7	2115.3	2384.8	2889.3	3517.0	3786.4	3706.2	3537.0	3319.2
37.5°	1656.7	1656.7	1774.3	1969.2	2273.0	2800.4	3580.0	4021.5	3961.3	3769.2	3537.0
40°	1499.1	1516.3	1619.5	1817.3	2138.3	2694.3	3580.0	4213.5	4245.0	4047.3	3806.5
42.5°	1384.4	1390.2	1484.8	1671.1	1989.2	2556.8	3534.2	4379.7	4474.3	4308.1	3995.7
45°	1264.0	1278.4	1358.6	1530.6	1834.4	2393.4	3453.9	4566.1	4718.0	4603.3	4193.4
47.5°	1117.9	1132.2	1223.9	1398.8	1688.3	2215.7	3319.2	4761.0	5079.1	4996.0	4546.0
50°	948.8	960.2	1046.2	1232.5	1524.9	2012.2	3150.1	4907.1	5440.3	5523.4	5079.1
52.5°	742.4	751.0	842.7	1023.3	1330.0	1817.3	2912.2	4996.0	5804.3	6096.7	5792.8
55°	533.1	547.5	627.7	776.8	1072.0	1556.4	2628.4	5041.9	6202.7	6776.0	6678.5
57.5°	384.1	389.8	444.3	558.9	796.8	1249.7	2264.4	4964.5	6561.0	7587.2	7790.7
60°	318.2	318.2	326.8	381.2	544.6	882.8	1828.7	4677.8	6867.7	8406.9	9034.7
62.5°	292.4	292.4	298.1	306.7	358.3	573.3	1307.0	4096.0	6902.1	9195.2	10399.0
65°	266.6	266.6	272.3	278.0	289.5	372.6	788.2	2998.2	6228.5	9203.8	11132.8
67.5°	243.6	243.6	246.5	249.4	255.1	272.3	432.8	1817.3	4984.5	8960.1	11413.7
70°	220.7	220.7	220.7	217.8	226.4	229.3	286.6	923.0	3333.5	8091.6	11279.0
72.5°	*194.9*	*194.9*	*192.0*	*186.3*	*189.2*	*189.2*	*212.1*	*452.9*	*1731.3*	*6432.0*	*10184.1*
75°	166.2	169.1	157.6	151.9	149.0	151.9	169.1	258.0	773.9	3901.1	7610.1
77.5°	140.4	146.2	129.0	117.5	114.7	114.7	131.9	160.5	332.5	1416.0	3410.9
80°	106.1	108.9	94.6	83.1	83.1	80.3	97.5	117.5	157.6	421.3	765.3
82.5°	60.2	60.2	54.5	48.7	45.9	48.7	65.9	80.3	97.5	149.0	209.2
85°	14.3	14.3	17.2	20.1	20.1	25.8	37.3	43.0	51.6	60.2	80.3
87.5°	2.9	2.9	2.9	5.7	8.6	8.6	14.3	20.1	25.8	31.5	34.4
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360791
CATALOG NUMBER: GSS-SB3A-750-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	2579.7	2579.7	*2579.7*
2.5°	2585.4	2588.3	*2585.4*
5°	2602.6	2596.9	*2588.3*
7.5°	2605.5	2608.4	*2611.2*
10°	2617.0	2628.4	*2611.2*
12.5°	2628.4	2619.8	*2614.1*
15°	2637.0	2634.2	*2617.0*
17.5°	2668.5	2657.1	*2654.2*
20°	2717.3	2714.4	*2705.8*
22.5°	2774.6	2768.9	*2766.0*
25°	2857.7	2837.7	*2826.2*
27.5°	2926.5	2909.3	*2903.6*
30°	2995.3	2960.9	*2960.9*
32.5°	3055.5	3046.9	*3041.2*
35°	3198.8	3155.8	*3161.6*
37.5°	3373.7	3330.7	*3293.4*
40°	3620.2	3562.8	*3539.9*
42.5°	3777.8	3720.5	*3726.2*
45°	3866.7	3766.4	*3740.6*
47.5°	4107.4	3981.3	*3946.9*
50°	4497.3	4342.5	*4299.5*
52.5°	5127.9	4878.5	*4821.2*
55°	5919.0	5612.3	*5554.9*
57.5°	7002.4	6595.4	*6472.2*
60°	8320.9	7816.5	*7630.2*
62.5°	9906.0	9284.0	*9106.3*
65°	11098.4	10579.6	*10304.4*
67.5°	12052.9	11625.8	*11494.0*
70°	12620.4	12640.5	*12674.9*
72.5°	*11964.0*	*12514.4*	*12778.1*
75°	8768.1	9195.2	*9605.1*
77.5°	3388.0	3055.5	*2958.0*
80°	547.5	513.1	*530.3*
82.5°	246.5	260.8	*275.2*
85°	160.5	186.3	*197.8*
87.5°	37.3	37.3	*37.3*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-6

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-750-U-5WQ

Data in this report applies to families of products including GSS-SB1A-750-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-750-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 5000K CCT 26 LEDS

Spectral Parameters

CCT (K):	4896
CIE u':	0.2101
CIE v':	0.4901
Duv:	0.0035
CIE x:	0.3489
CIE y:	0.3618
CIE z:	0.2893
Peak Wavelength (nm):	443
Dominant Wavelength (nm):	570
Purity:	13.25435
Rf:	70.7
Rg:	96.8

CRI (Ra):	70.2
R1:	68.1
R2:	73.9
R3:	79.4
R4:	72.1
R5:	69.2
R6:	65.7
R7:	78.1
R8:	55.3
R9:	-35.1
R10:	39.3
R11:	71.1
R12:	43.8
R13:	68.1
R14:	88.4
R15:	59.7

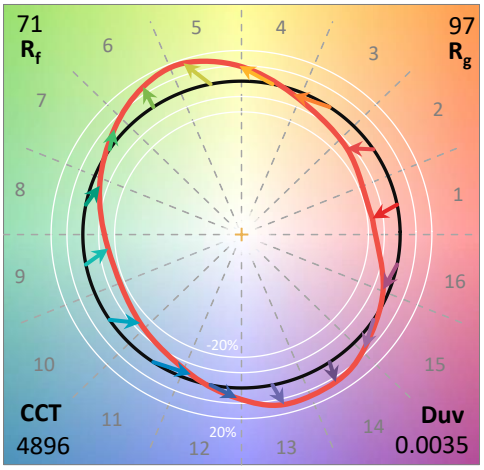

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-6

CIE 1931 Chromaticity Diagram

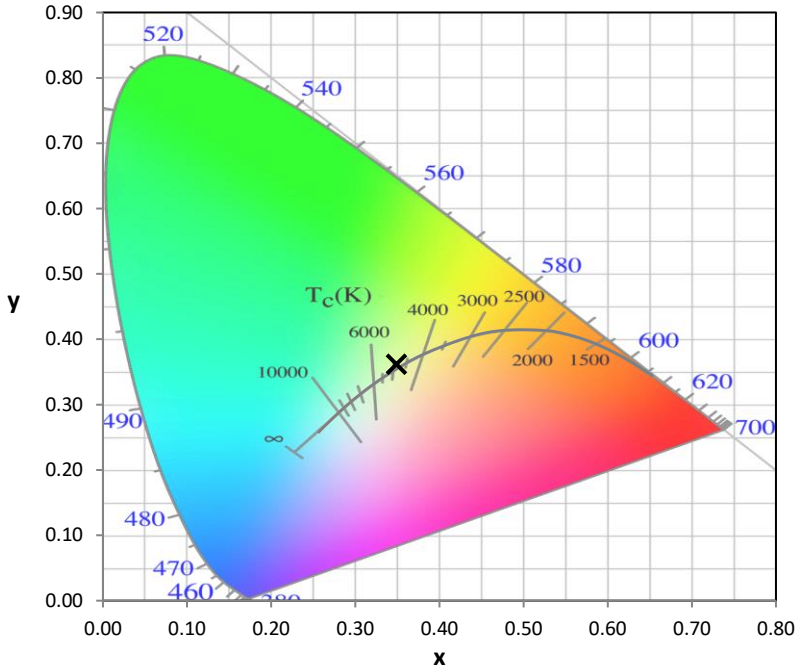

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

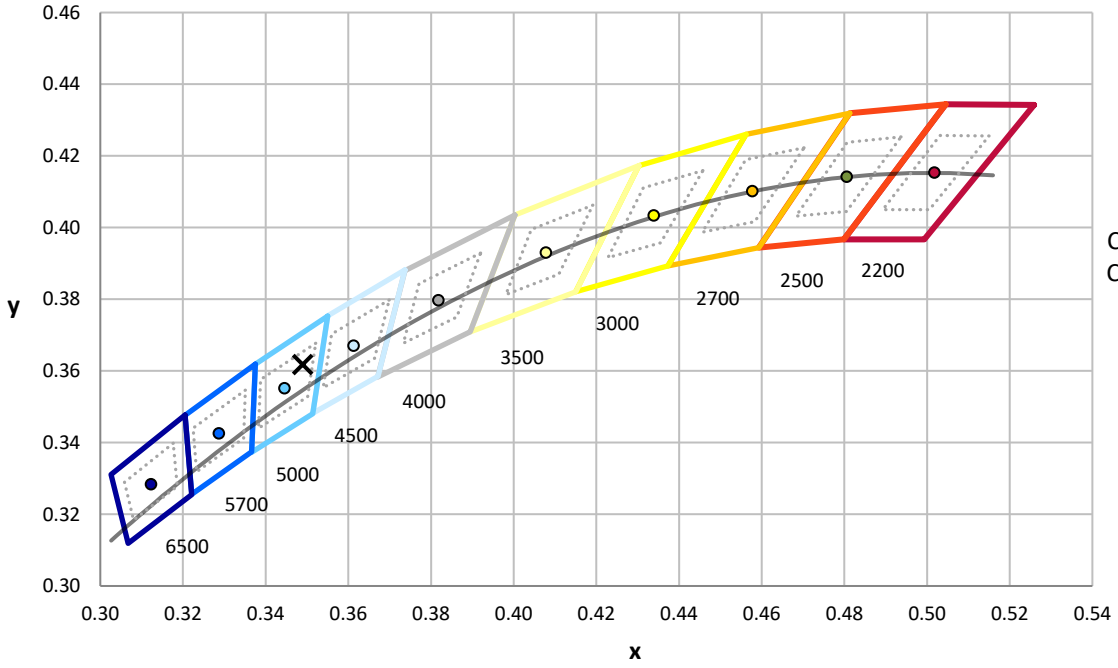


CCT = 4896K
CIE x = 0.3489
CIE y = 0.3618
Duv = 0.0035

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-6

Photopic Flux vs. Wavelength

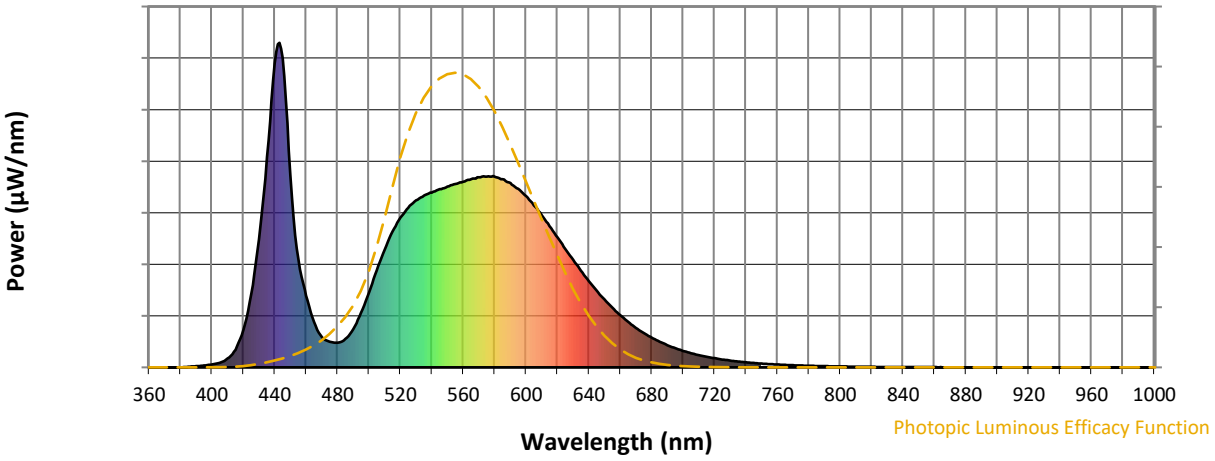


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Scotopic Flux vs. Wavelength

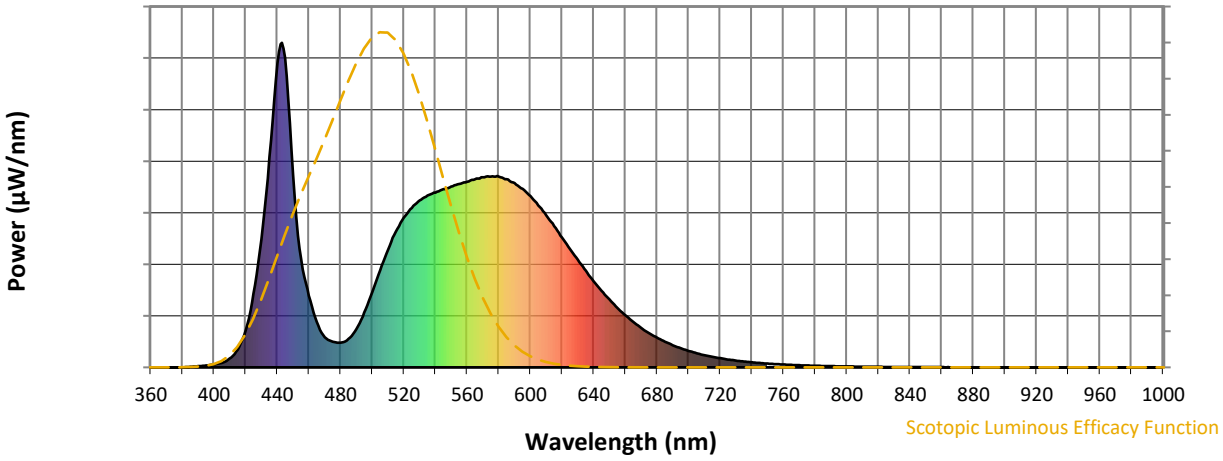


Scotopic Lumens: NR **S/P: 1.7**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Melanopic Flux vs. Wavelength

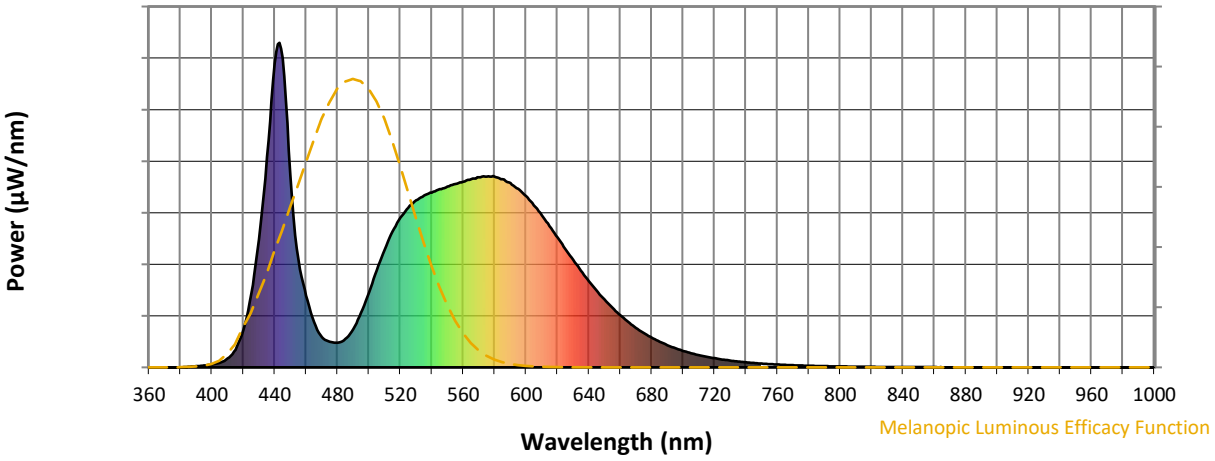

Melanopic Lumens: NR **M/P: 3.37**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			


REPORT NUMBER: SP1-2407-184-6

TM-30-18


Summary


R_f = 70.7
R_g = 96.8
CIE R_a = 70.2
R_9 = -35.1


Spectral Power Distribution Comparison

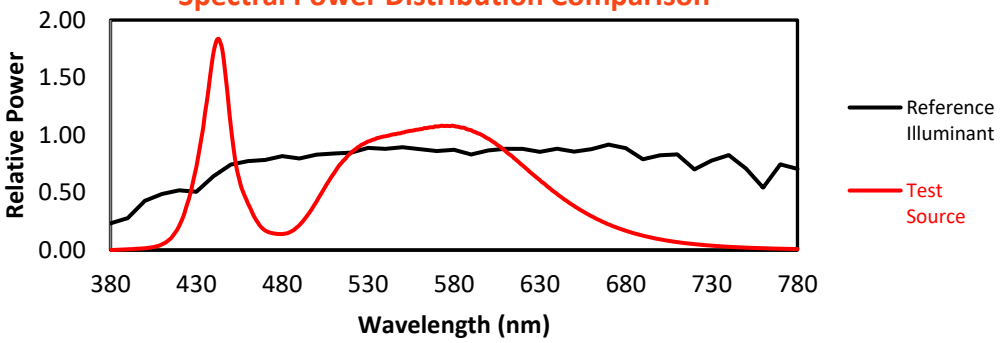


Color Vector Graphics

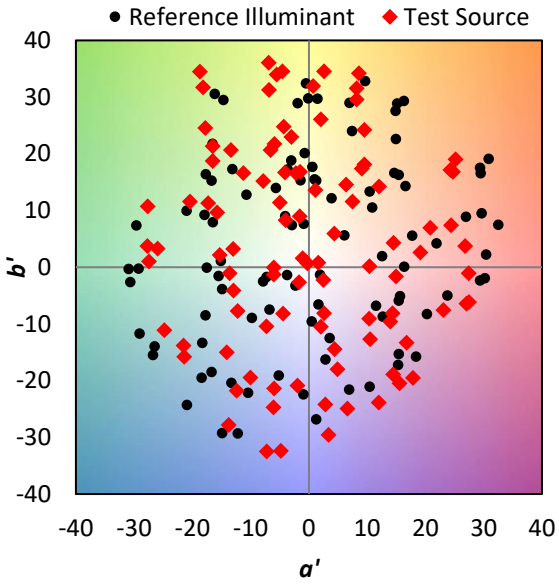

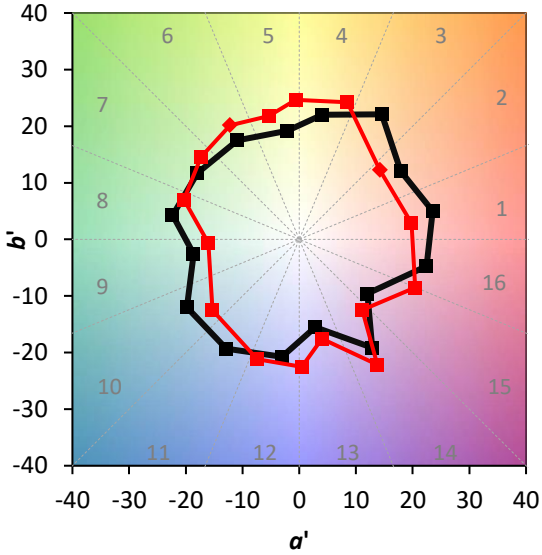

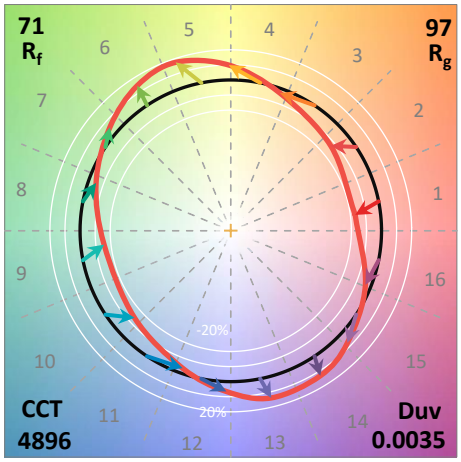

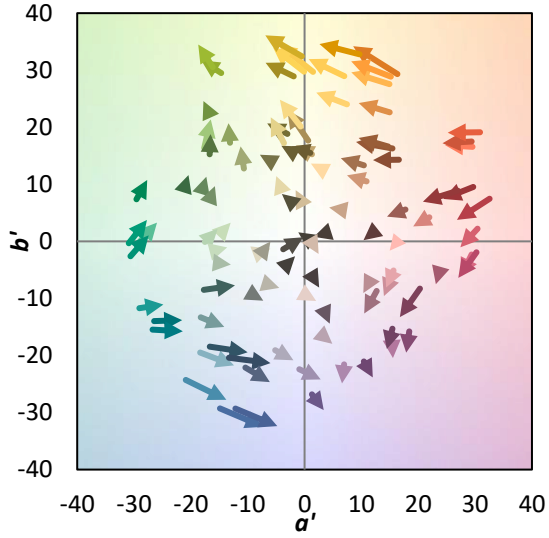


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 53	CES51 = 87	CES76 = 42
CES02 = 59	CES27 = 78	CES52 = 88	CES77 = 64
CES03 = 30	CES28 = 76	CES53 = 74	CES78 = 45
CES04 = 69	CES29 = 48	CES54 = 80	CES79 = 74
CES05 = 46	CES30 = 56	CES55 = 79	CES80 = 71
CES06 = 50	CES31 = 54	CES56 = 68	CES81 = 72
CES07 = 39	CES32 = 50	CES57 = 65	CES82 = 88
CES08 = 38	CES33 = 60	CES58 = 67	CES83 = 82
CES09 = 29	CES34 = 62	CES59 = 87	CES84 = 87
CES10 = 72	CES35 = 79	CES60 = 91	CES85 = 84
CES11 = 56	CES36 = 90	CES61 = 87	CES86 = 74
CES12 = 61	CES37 = 72	CES62 = 79	CES87 = 75
CES13 = 41	CES38 = 66	CES63 = 72	CES88 = 76
CES14 = 74	CES39 = 91	CES64 = 70	CES89 = 74
CES15 = 70	CES40 = 83	CES65 = 63	CES90 = 73
CES16 = 46	CES41 = 83	CES66 = 64	CES91 = 92
CES17 = 49	CES42 = 70	CES67 = 62	CES92 = 67
CES18 = 55	CES43 = 68	CES68 = 69	CES93 = 81
CES19 = 71	CES44 = 98	CES69 = 80	CES94 = 56
CES20 = 64	CES45 = 78	CES70 = 56	CES95 = 71
CES21 = 85	CES46 = 77	CES71 = 53	CES96 = 77
CES22 = 77	CES47 = 73	CES72 = 84	CES97 = 82
CES23 = 91	CES48 = 65	CES73 = 46	CES98 = 71
CES24 = 90	CES49 = 76	CES74 = 94	CES99 = 59
CES25 = 71	CES50 = 85	CES75 = 49	

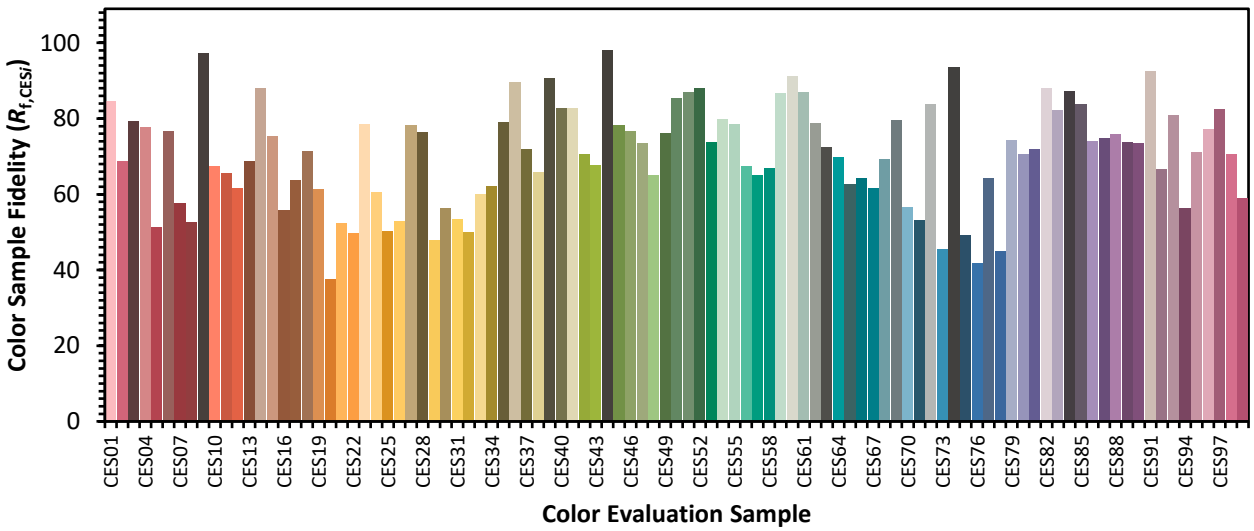



REPORT NUMBER: SP1-2407-184-6

TM-30-18

Color Rendition by Hue-Angle Bin

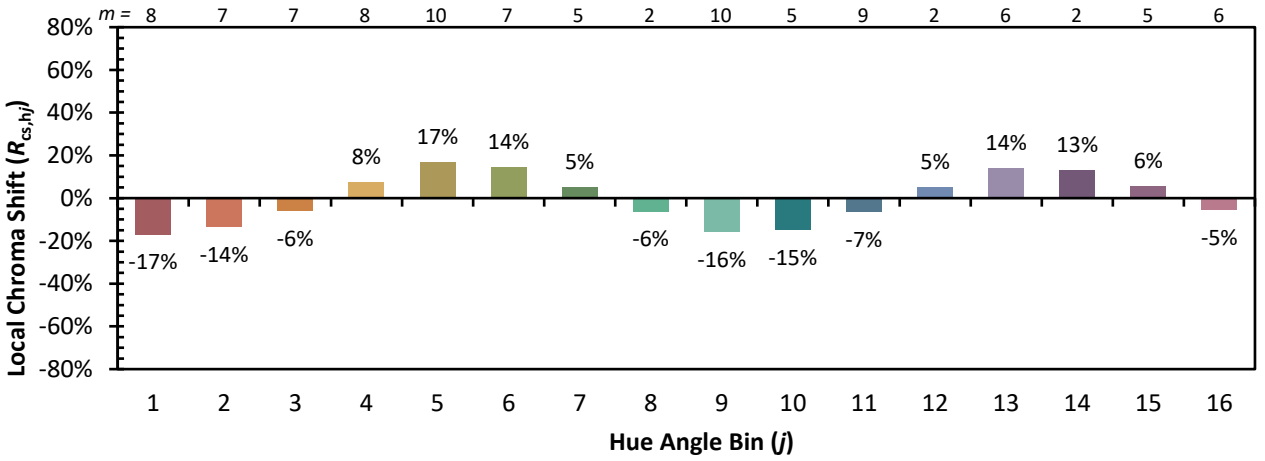

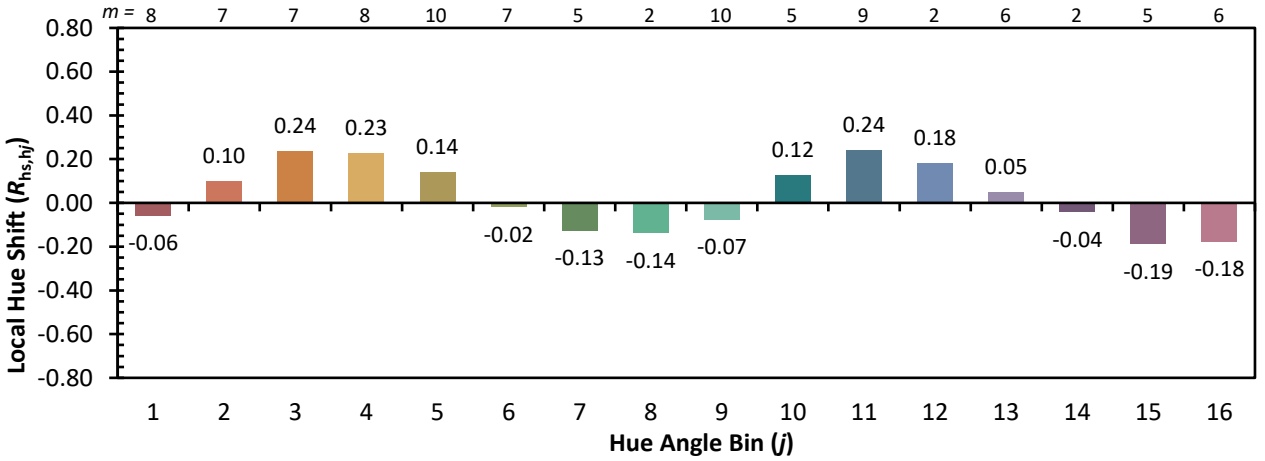


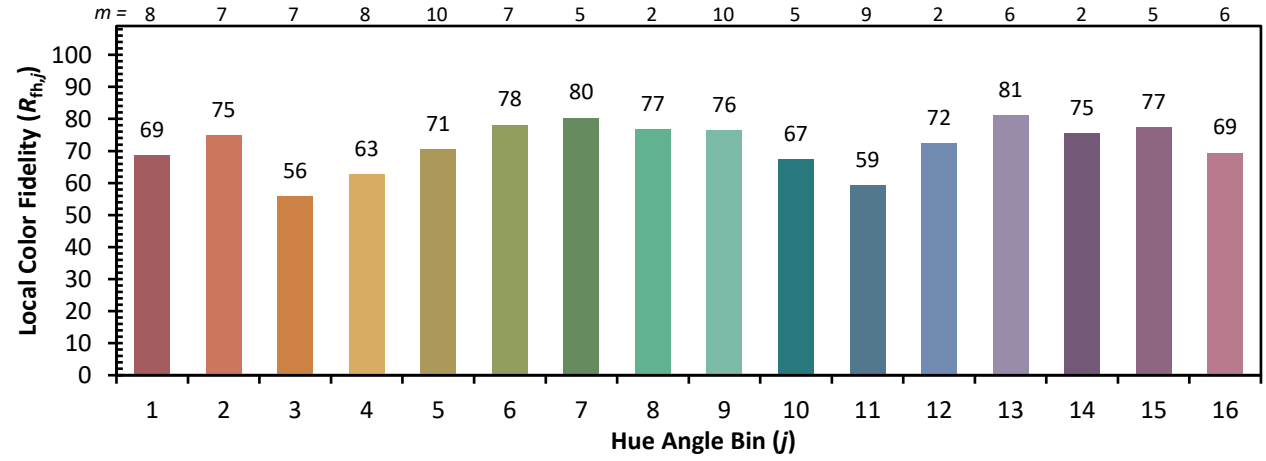


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Measure Comparisons

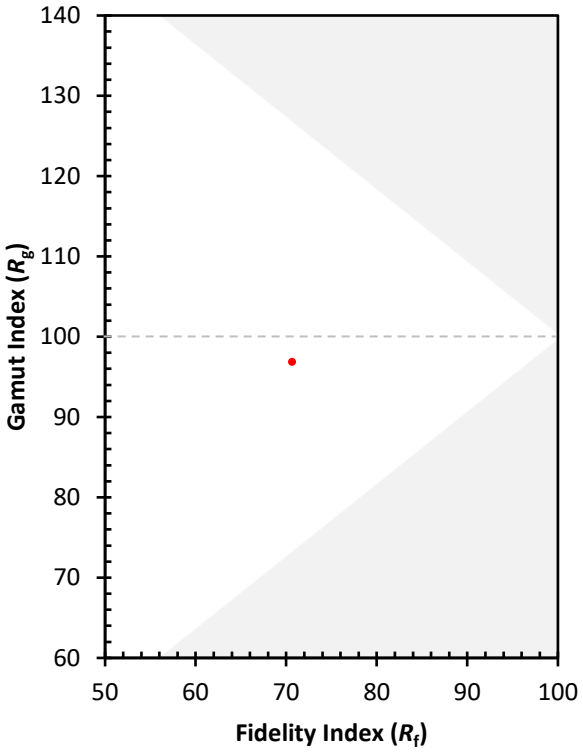

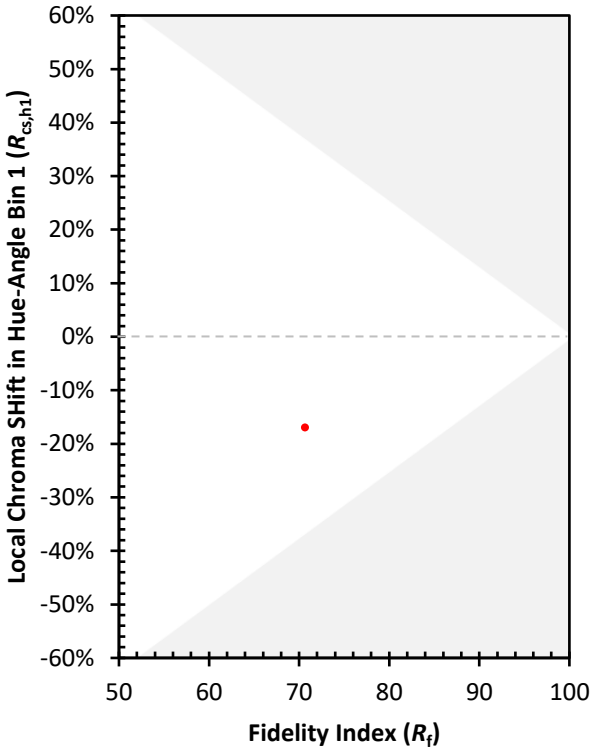

(END OF REPORT)