Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1359639

Luminaire Tested: **GSS-SB3A-750-U-T2-HSS**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1359639
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB3A-750-U-T2-HSS
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 3SQUARE 85W 70CRI 5000K FIXTURE w/ TYPE II DISTRIBUTION OPTIC AND HOUSE SIDE SHIELD
Light Source:	(78) 5000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	10282.6 lumens
Efficiency:	N/A
Efficacy:	121.0 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 0.5' x H: 0')
IES Classification:	Type II - Medium
BUG Rating:	B1 - U0 - G2


Input Watts (W):	85
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	11.0%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1359639
CATALOG NUMBER: GSS-SB3A-750-U-T2-HSS

Iso-Footcandle Lines of Horizontal Illumination

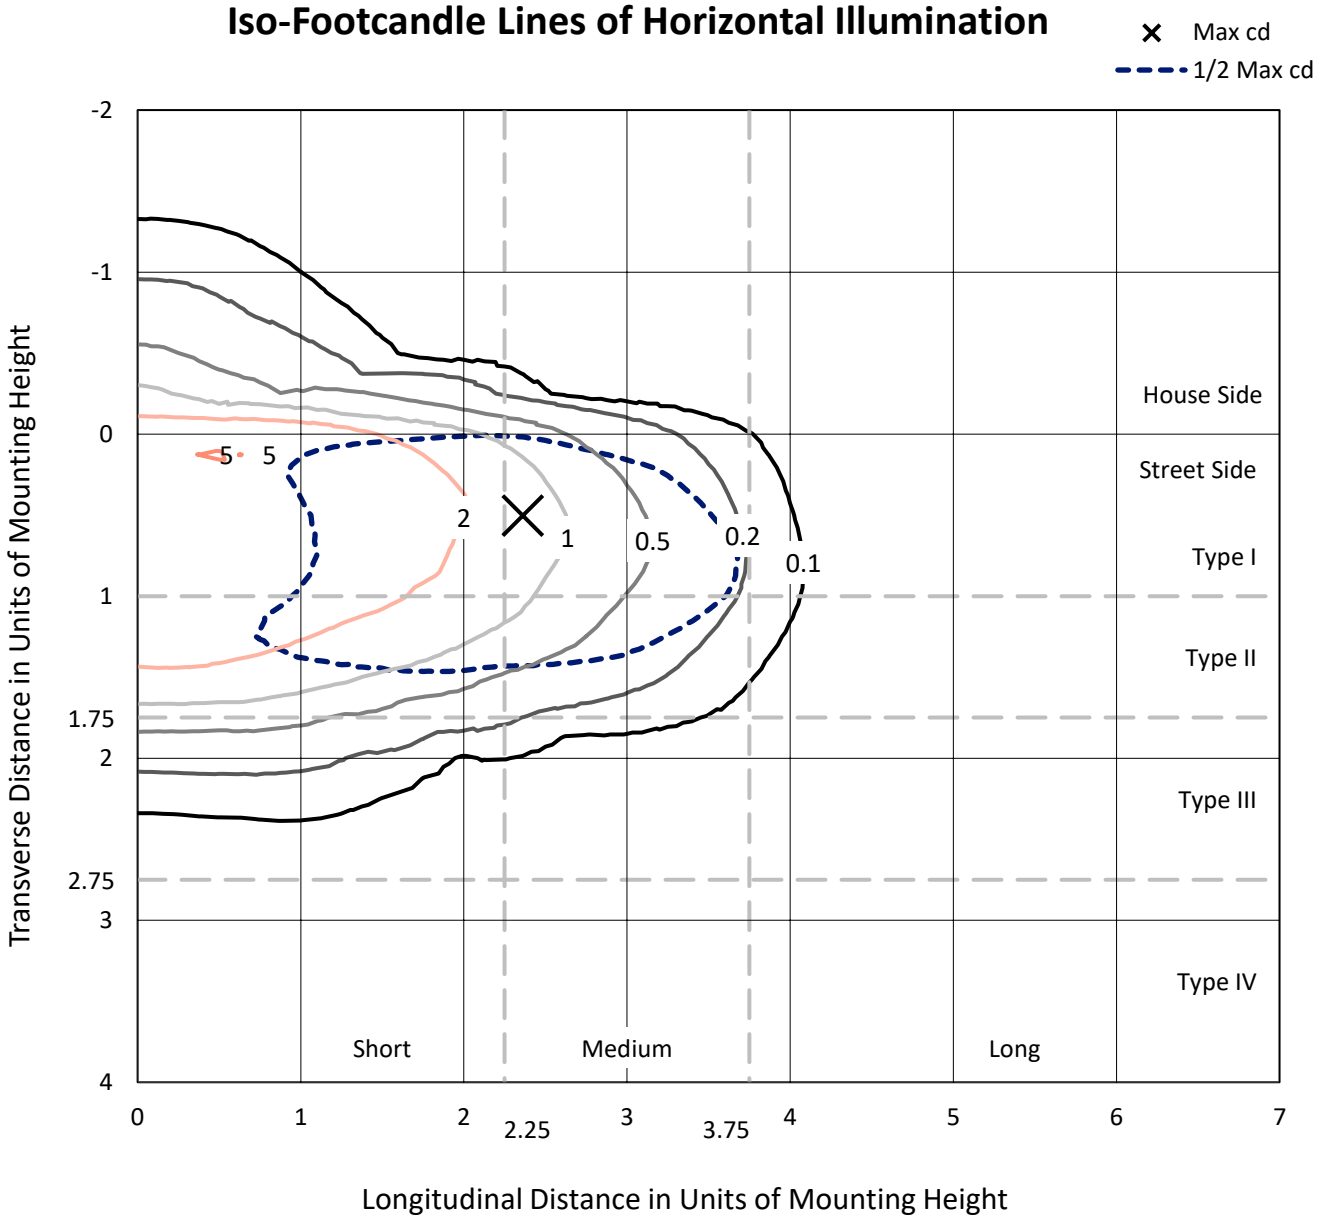


Based on 20 foot mounting height. Maximum calculated value = 5.2 fc
Type II - Medium - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1359639
CATALOG NUMBER: GSS-SB3A-750-U-T2-HSS

Luminous Intensity Polar Plot

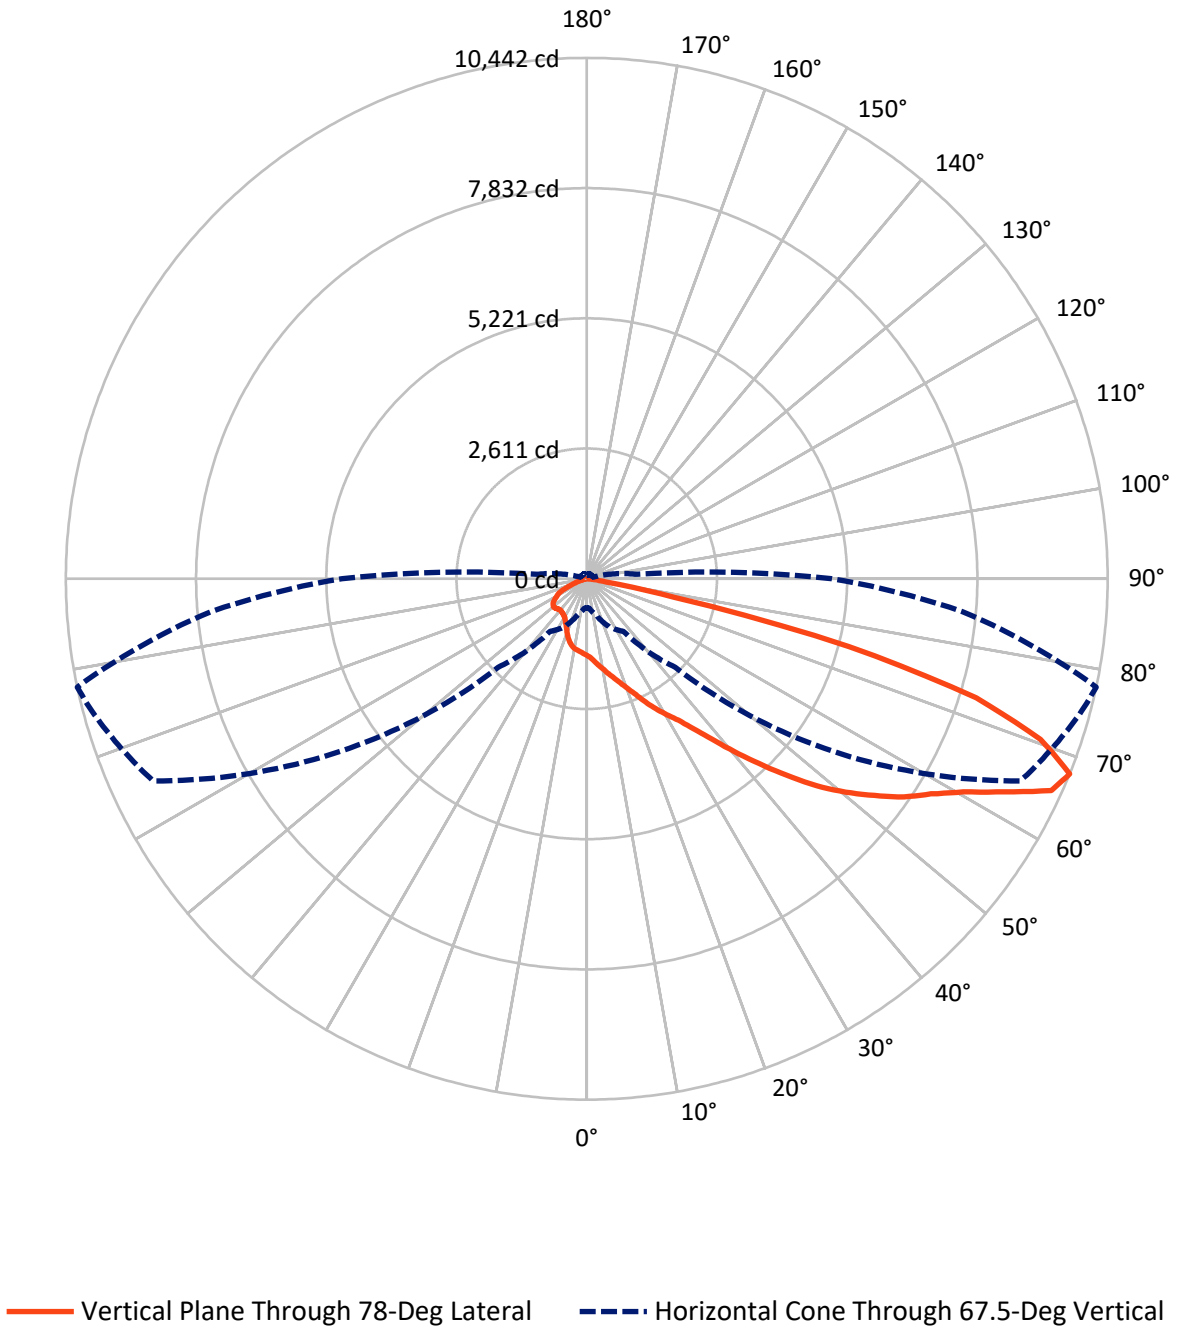

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1359639
CATALOG NUMBER: GSS-SB3A-750-U-T2-HSS

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	1103.4	0.0	1103.4
	% Fixture	10.7	0.0	10.7
Street Side	Lumens	9179.2	0.0	9179.2
	% Fixture	89.3	0.0	89.3
Total	Lumens	10282.6	0.0	10282.6
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	138.7	1.3
10°-20°	377.6	3.7
20°-30°	621.2	6.0
30°-40°	1085.0	10.6
40°-50°	1846.1	18.0
50°-60°	2662.7	25.9
60°-70°	2570.0	25.0
70°-80°	944.1	9.2
80°-90°	37.2	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	10282.6	100.0
0°-180°	10282.6	100.0

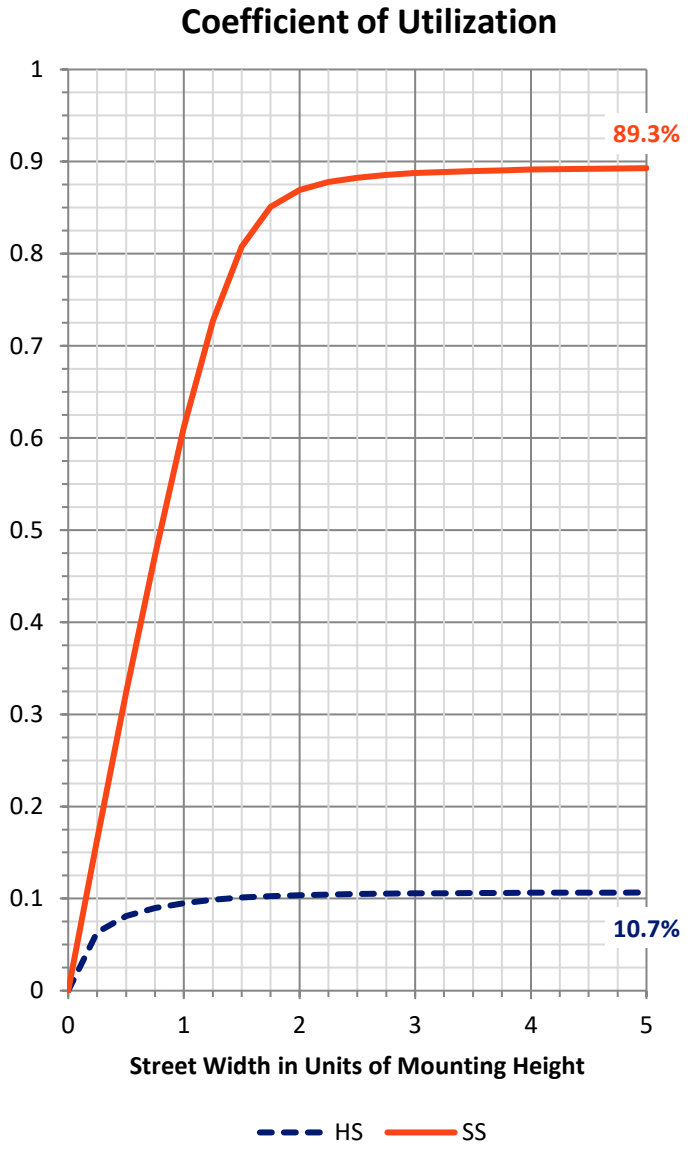

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1359639
CATALOG NUMBER: GSS-SB3A-750-U-T2-HSS

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	847.3	8.2			
FM	(30°-60°)	5037.8	49.0			
FH	(60°-80°)	3264.0	31.7			G2/5000
FVH	(80°-90°)	30.2	0.3			G1/100
BL	(0°-30°)	290.2	2.8	B1/500		
BM	(30°-60°)	556.1	5.4	B1/1000		
BH	(60°-80°)	250.1	2.4	B1/500		G1/500
BVH	(80°-90°)	7.0	0.1			G0/10
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B1-U0-G2
Type II Medium

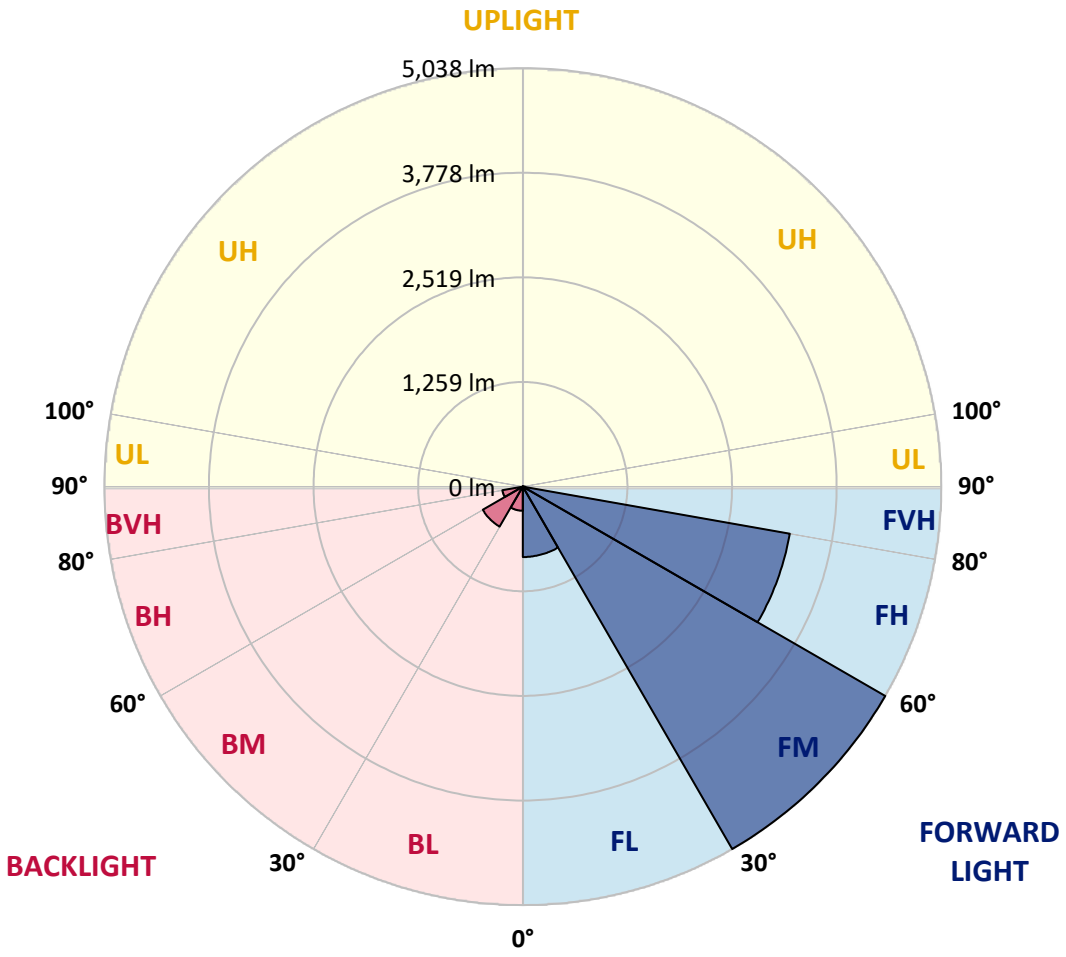

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1359639
CATALOG NUMBER: GSS-SB3A-750-U-T2-HSS

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	78°	85°
0°	1539.1	1539.1	1539.1	1539.1	1539.1	1539.1	1539.1	1539.1	1539.1	*1539.1*	1539.1
2.5°	1703.4	1700.5	1706.3	1694.7	1697.6	1683.2	1651.5	1631.3	1605.4	*1588.1*	1567.9
5°	1827.3	1830.2	1824.4	1827.3	1818.7	1798.5	1781.2	1729.3	1686.1	*1668.8*	1625.5
7.5°	1867.7	1873.4	1873.4	1887.8	1896.5	1905.1	1890.7	1835.9	1778.3	*1755.2*	1683.2
10°	1867.7	1867.7	1887.8	1908.0	1948.4	1977.2	1974.3	1954.1	1882.1	*1847.5*	1766.8
12.5°	1815.8	1812.9	1838.8	1896.5	1951.2	2017.5	2066.5	2049.2	1982.9	*1957.0*	1838.8
15°	1671.7	1674.5	1723.5	1810.0	1919.5	2031.9	2115.5	2153.0	2106.9	*2066.5*	1948.4
17.5°	1481.4	1493.0	1550.6	1671.7	1835.9	2017.5	2176.0	2265.4	2236.6	*2199.1*	2055.0
20°	1412.3	1415.1	1446.9	1533.3	1720.7	1962.8	2193.3	2386.4	2409.5	*2349.0*	2170.3
22.5°	1518.9	1530.4	1518.9	1524.7	1642.8	1896.5	2210.6	2493.1	2576.7	*2519.0*	2308.6
25°	1714.9	1703.4	1671.7	1645.7	1665.9	1847.5	2219.3	2628.5	2787.1	*2738.1*	2490.2
27.5°	1936.8	1910.9	1884.9	1824.4	1784.1	1876.3	2248.1	2709.2	2983.1	*2945.6*	2654.5
30°	2279.8	2274.0	2196.2	2057.9	1957.0	1988.7	2294.2	2792.8	3207.9	*3161.8*	2821.7
32.5°	2683.3	2668.9	2568.0	2380.7	2202.0	2147.2	2386.4	2873.5	3458.6	*3377.9*	3037.8
35°	3086.8	3083.9	3023.4	2749.6	2507.5	2363.4	2550.7	2997.5	3749.7	*3692.1*	3271.3
37.5°	3409.6	3429.8	3467.3	3101.2	2867.8	2648.7	2769.8	3196.3	4115.8	*4075.4*	3565.3
40°	3677.7	3712.2	3761.2	3452.9	3202.1	2991.7	3066.6	3522.0	4556.7	*4551.0*	3916.9
42.5°	3908.2	3963.0	3922.6	3746.8	3516.3	3340.4	3392.3	3896.7	5035.2	*5061.1*	4320.4
45°	4179.2	4213.7	4216.6	4032.2	3818.9	3697.8	3784.3	4323.3	5588.5	*5620.2*	4749.8
47.5°	4476.0	4464.5	4484.7	4349.2	4156.1	4046.6	4202.2	4775.8	6092.9	*6205.3*	5187.9
50°	4712.4	4752.7	4784.4	4709.5	4530.8	4435.7	4614.4	5242.7	6591.5	*6721.2*	5603.0
52.5°	4738.3	4761.4	4922.8	4994.8	4986.2	4833.4	5040.9	5677.9	7018.1	*7219.9*	5940.2
55°	4363.6	4525.0	4790.2	5038.0	5363.7	5389.7	5447.3	6092.9	7392.8	*7721.4*	6228.4
57.5°	3585.4	3706.5	4170.5	4761.4	5386.8	5925.8	6150.6	6542.5	7776.1	*8136.4*	6562.7
60°	2441.2	2392.2	2934.1	4075.4	5040.9	6136.2	7095.9	7326.5	8185.4	*8669.6*	6923.0
62.5°	1325.8	1360.4	1694.7	2625.7	4026.4	5836.4	7905.8	8707.1	8923.2	*9404.6*	7340.9
65°	850.2	881.9	1089.5	1495.9	2357.6	4556.7	7750.2	9888.8	9871.5	*10234.6*	7672.4
67.5°	*582.2*	*596.6*	*763.8*	*1060.6*	*1288.3*	*2510.4*	*6026.6*	*9591.9*	*10269.2*	*10442.1*	*7562.8*
70°	392.0	406.4	541.8	784.0	925.2	1101.0	3591.2	7914.5	9542.9	*9652.4*	6692.4
72.5°	247.9	262.3	328.6	524.6	697.5	622.6	1648.6	5519.4	7940.4	*8162.3*	5724.0
75°	141.2	149.9	204.6	363.2	441.0	409.3	443.9	3455.7	5332.0	*5427.1*	3810.2
77.5°	72.1	77.8	129.7	233.5	282.5	227.7	236.3	1504.5	1861.9	*1792.7*	1046.2
80°	34.6	40.4	80.7	141.2	184.5	129.7	138.3	340.1	446.7	*380.4*	245.0
82.5°	17.3	17.3	51.9	57.6	100.9	77.8	60.5	118.2	167.2	*170.0*	112.4
85°	11.5	8.6	14.4	20.2	23.1	31.7	34.6	49.0	54.8	*57.6*	43.2
87.5°	0.0	0.0	2.9	2.9	5.8	8.6	14.4	20.2	20.2	*23.1*	20.2
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	*0.0*	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1359639
CATALOG NUMBER: GSS-SB3A-750-U-T2-HSS

CANDELA DISTRIBUTION (continued):

	90°	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
0°	1539.1	1539.1	1539.1	1539.1	1539.1	1539.1	1539.1	1539.1	1539.1	1539.1	1539.1
2.5°	1556.4	1547.7	1493.0	1446.9	1406.5	1377.7	1340.2	1331.6	1308.5	1294.1	1297.0
5°	1582.3	1542.0	1441.1	1354.6	1259.5	1164.4	1080.8	1052.0	994.4	974.2	979.9
7.5°	1614.0	1565.0	1400.7	1230.7	1066.4	945.4	827.2	755.1	697.5	674.4	671.5
10°	1674.5	1591.0	1351.7	1106.8	879.1	714.8	611.0	570.7	550.5	544.7	544.7
12.5°	1738.0	1619.8	1285.5	956.9	694.6	567.8	527.4	515.9	510.1	507.3	507.3
15°	1801.4	1640.0	1190.3	775.3	564.9	513.0	495.7	490.0	481.3	478.4	484.2
17.5°	1890.7	1654.4	1080.8	634.1	507.3	481.3	464.0	458.3	449.6	446.7	449.6
20°	1968.5	1677.4	954.0	541.8	472.7	452.5	429.4	417.9	415.0	412.2	412.2
22.5°	2060.8	1703.4	807.0	490.0	443.9	415.0	389.1	380.4	374.7	374.7	374.7
25°	2190.5	1723.5	688.8	466.9	412.2	377.6	351.6	343.0	340.1	337.2	340.1
27.5°	2300.0	1723.5	611.0	452.5	386.2	345.9	322.8	317.0	311.3	305.5	308.4
30°	2403.7	1686.1	553.4	441.0	368.9	319.9	302.6	291.1	285.3	276.7	276.7
32.5°	2521.9	1651.5	530.3	429.4	351.6	299.7	282.5	273.8	268.0	259.4	259.4
35°	2648.7	1591.0	527.4	420.8	334.3	285.3	268.0	262.3	253.6	247.9	247.9
37.5°	2827.4	1553.5	521.7	409.3	319.9	270.9	253.6	250.7	245.0	239.2	242.1
40°	3066.6	1550.6	510.1	400.6	308.4	256.5	242.1	236.3	236.3	230.6	230.6
42.5°	3297.2	1562.1	510.1	383.3	296.9	242.1	230.6	227.7	221.9	213.3	213.3
45°	3579.7	1605.4	515.9	366.0	285.3	233.5	221.9	216.2	210.4	204.6	204.6
47.5°	3841.9	1660.1	521.7	348.7	273.8	224.8	216.2	213.3	204.6	198.9	201.8
50°	4063.9	1726.4	507.3	331.5	256.5	221.9	210.4	207.5	196.0	193.1	196.0
52.5°	4262.7	1766.8	464.0	314.2	239.2	216.2	204.6	201.8	190.2	187.3	184.5
55°	4415.5	1781.2	415.0	288.2	224.8	207.5	196.0	190.2	181.6	175.8	172.9
57.5°	4565.4	1723.5	351.6	253.6	207.5	193.1	184.5	178.7	167.2	155.6	152.8
60°	4738.3	1651.5	294.0	210.4	187.3	178.7	170.0	164.3	149.9	129.7	129.7
62.5°	4940.1	1616.9	233.5	172.9	164.3	155.6	155.6	149.9	126.8	106.6	103.8
65°	5089.9	1409.4	178.7	144.1	141.2	132.6	135.5	132.6	106.6	80.7	77.8
67.5°	*4911.2*	*1008.8*	*138.3*	*121.1*	*118.2*	*106.6*	*115.3*	*112.4*	*92.2*	*69.2*	*63.4*
70°	4193.6	657.1	112.4	100.9	95.1	80.7	95.1	98.0	77.8	54.8	51.9
72.5°	3568.1	420.8	89.3	80.7	66.3	57.6	74.9	83.6	63.4	43.2	40.4
75°	2470.0	265.2	66.3	60.5	46.1	40.4	60.5	66.3	51.9	28.8	28.8
77.5°	815.7	132.6	49.0	40.4	31.7	28.8	46.1	49.0	34.6	20.2	17.3
80°	155.6	63.4	34.6	25.9	23.1	17.3	28.8	25.9	14.4	11.5	11.5
82.5°	74.9	37.5	25.9	20.2	11.5	11.5	8.6	11.5	11.5	8.6	8.6
85°	34.6	23.1	17.3	11.5	8.6	5.8	5.8	8.6	8.6	8.6	5.8
87.5°	20.2	17.3	11.5	8.6	5.8	5.8	5.8	5.8	5.8	5.8	2.9
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-6

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-750-U-5WQ

Data in this report applies to families of products including GSS-SB1A-750-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-750-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 5000K CCT 26 LEDS

Spectral Parameters

CCT (K):	4896
CIE u':	0.2101
CIE v':	0.4901
Duv:	0.0035
CIE x:	0.3489
CIE y:	0.3618
CIE z:	0.2893
Peak Wavelength (nm):	443
Dominant Wavelength (nm):	570
Purity:	13.25435
Rf:	70.7
Rg:	96.8

CRI (Ra):	70.2
R1:	68.1
R2:	73.9
R3:	79.4
R4:	72.1
R5:	69.2
R6:	65.7
R7:	78.1
R8:	55.3
R9:	-35.1
R10:	39.3
R11:	71.1
R12:	43.8
R13:	68.1
R14:	88.4
R15:	59.7

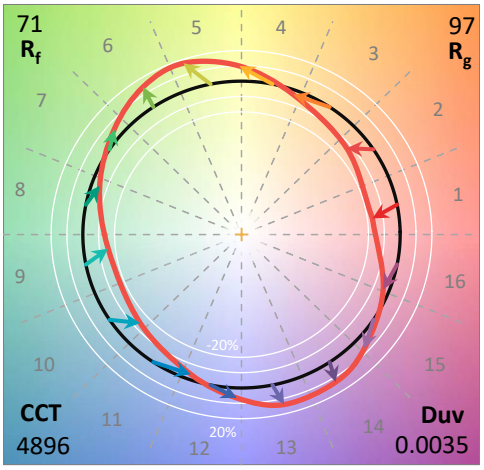

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-6

CIE 1931 Chromaticity Diagram

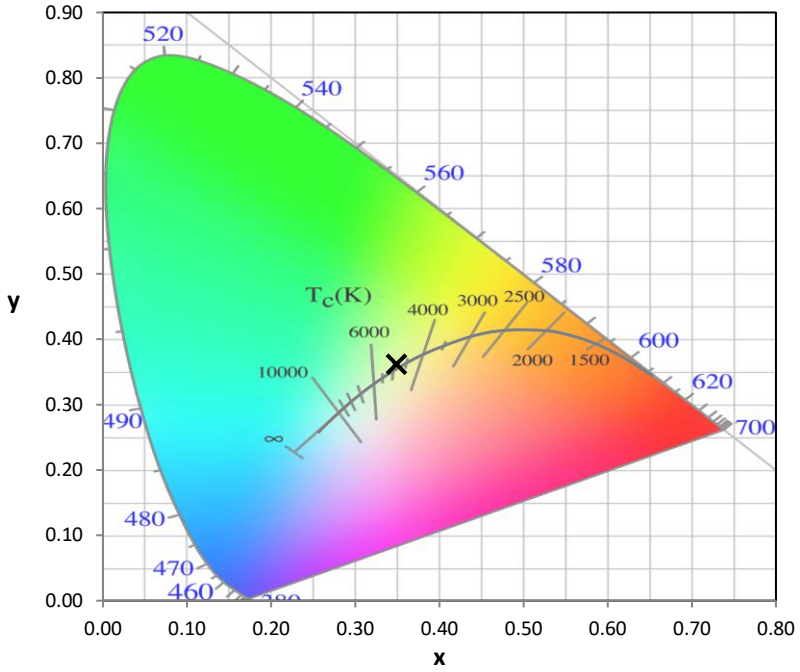

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

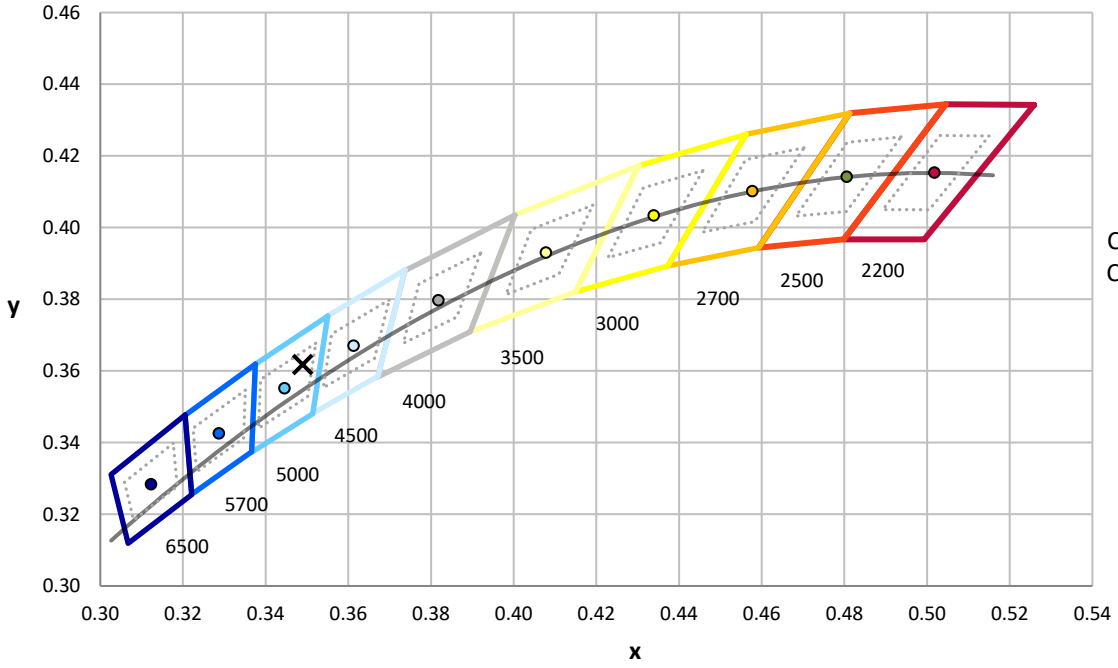


CCT = 4896K
CIE x = 0.3489
CIE y = 0.3618
Duv = 0.0035

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-6

Photopic Flux vs. Wavelength

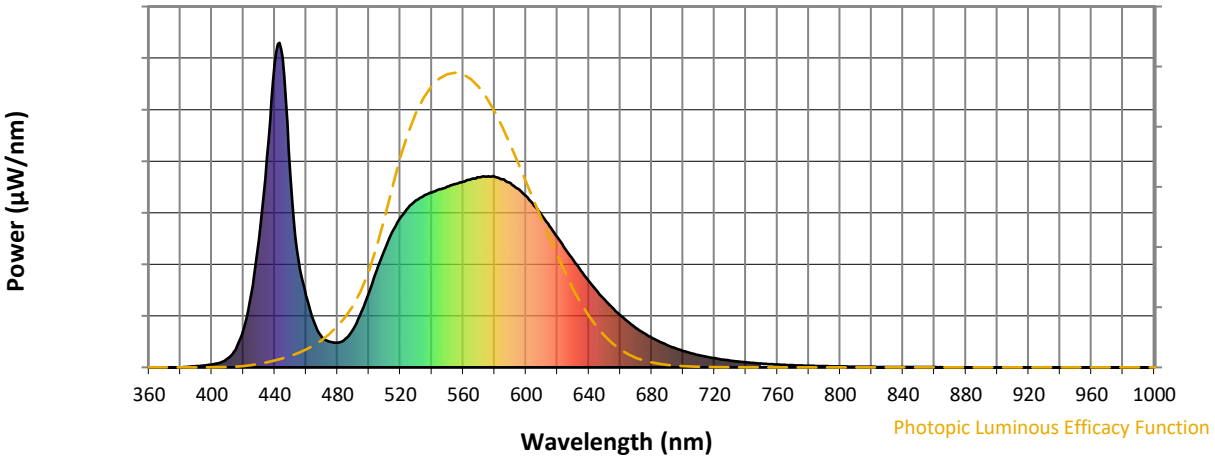


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Scotopic Flux vs. Wavelength

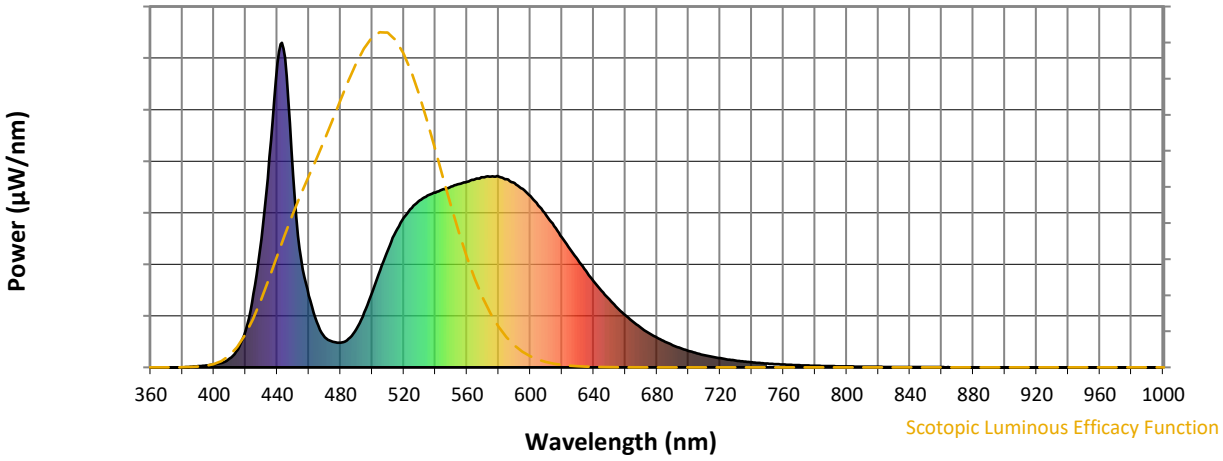


Scotopic Lumens: NR **S/P: 1.7**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Melanopic Flux vs. Wavelength

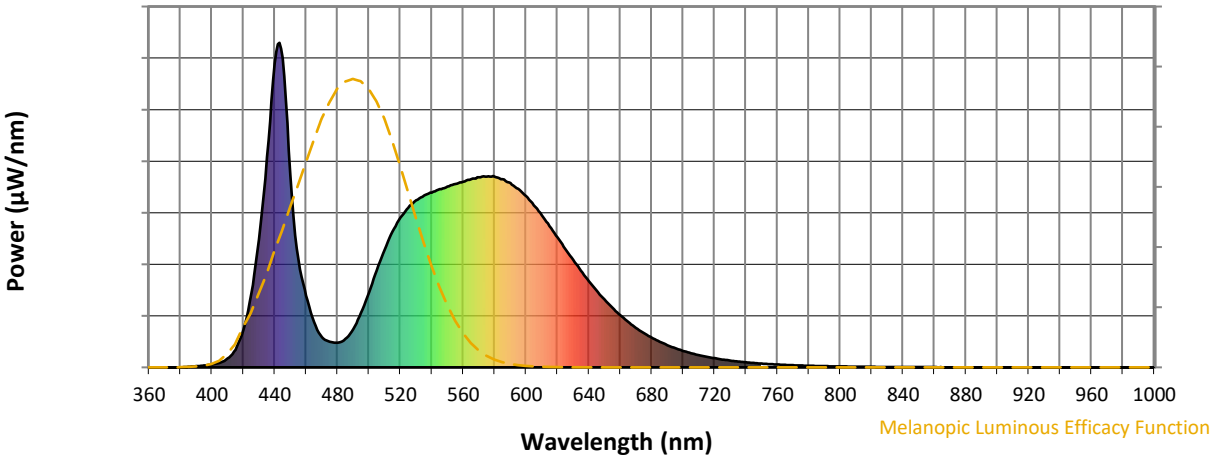

Melanopic Lumens: NR **M/P: 3.37**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			


REPORT NUMBER: SP1-2407-184-6

TM-30-18


Summary


R_f = 70.7
R_g = 96.8
CIE R_a = 70.2
R_9 = -35.1


Spectral Power Distribution Comparison

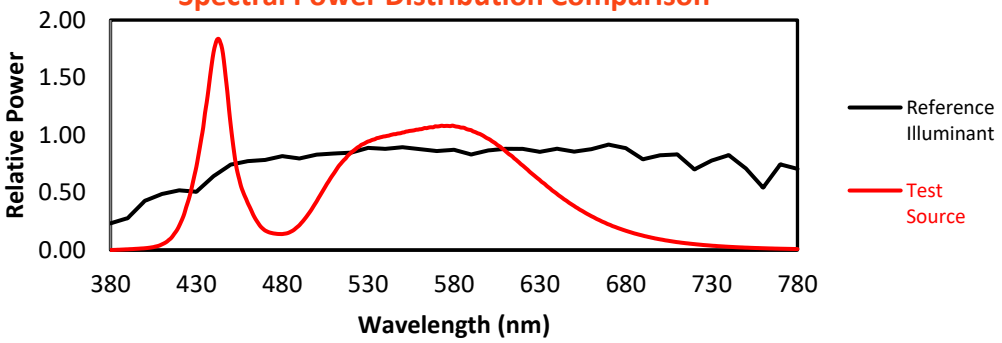


Color Vector Graphics

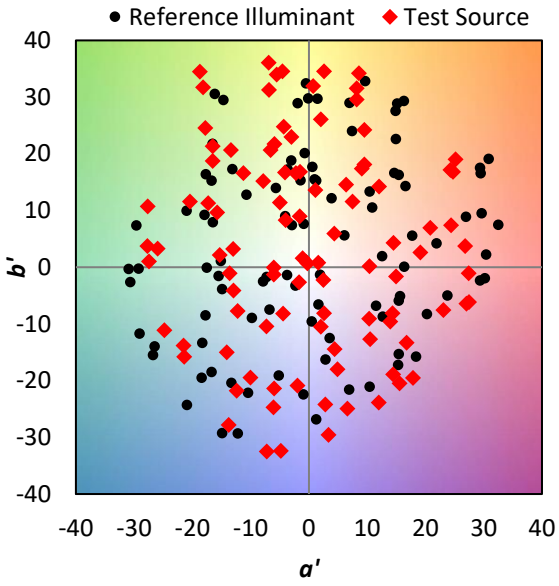

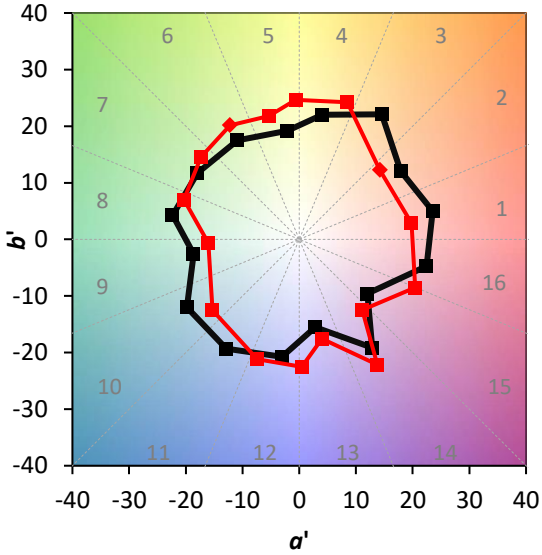

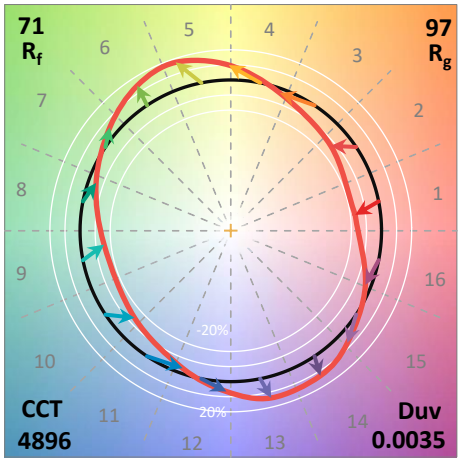

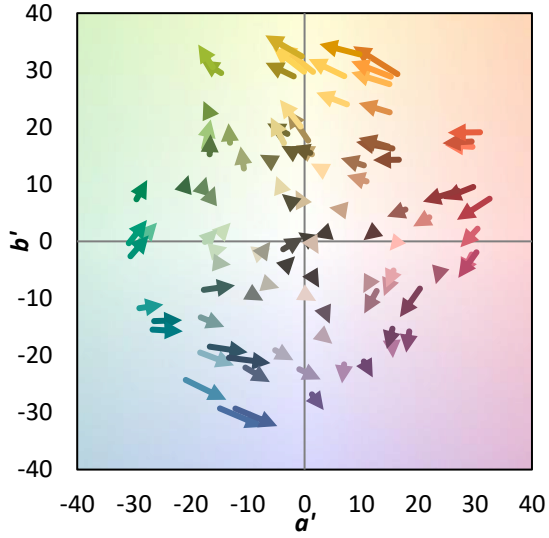


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 53	CES51 = 87	CES76 = 42
CES02 = 59	CES27 = 78	CES52 = 88	CES77 = 64
CES03 = 30	CES28 = 76	CES53 = 74	CES78 = 45
CES04 = 69	CES29 = 48	CES54 = 80	CES79 = 74
CES05 = 46	CES30 = 56	CES55 = 79	CES80 = 71
CES06 = 50	CES31 = 54	CES56 = 68	CES81 = 72
CES07 = 39	CES32 = 50	CES57 = 65	CES82 = 88
CES08 = 38	CES33 = 60	CES58 = 67	CES83 = 82
CES09 = 29	CES34 = 62	CES59 = 87	CES84 = 87
CES10 = 72	CES35 = 79	CES60 = 91	CES85 = 84
CES11 = 56	CES36 = 90	CES61 = 87	CES86 = 74
CES12 = 61	CES37 = 72	CES62 = 79	CES87 = 75
CES13 = 41	CES38 = 66	CES63 = 72	CES88 = 76
CES14 = 74	CES39 = 91	CES64 = 70	CES89 = 74
CES15 = 70	CES40 = 83	CES65 = 63	CES90 = 73
CES16 = 46	CES41 = 83	CES66 = 64	CES91 = 92
CES17 = 49	CES42 = 70	CES67 = 62	CES92 = 67
CES18 = 55	CES43 = 68	CES68 = 69	CES93 = 81
CES19 = 71	CES44 = 98	CES69 = 80	CES94 = 56
CES20 = 64	CES45 = 78	CES70 = 56	CES95 = 71
CES21 = 85	CES46 = 77	CES71 = 53	CES96 = 77
CES22 = 77	CES47 = 73	CES72 = 84	CES97 = 82
CES23 = 91	CES48 = 65	CES73 = 46	CES98 = 71
CES24 = 90	CES49 = 76	CES74 = 94	CES99 = 59
CES25 = 71	CES50 = 85	CES75 = 49	

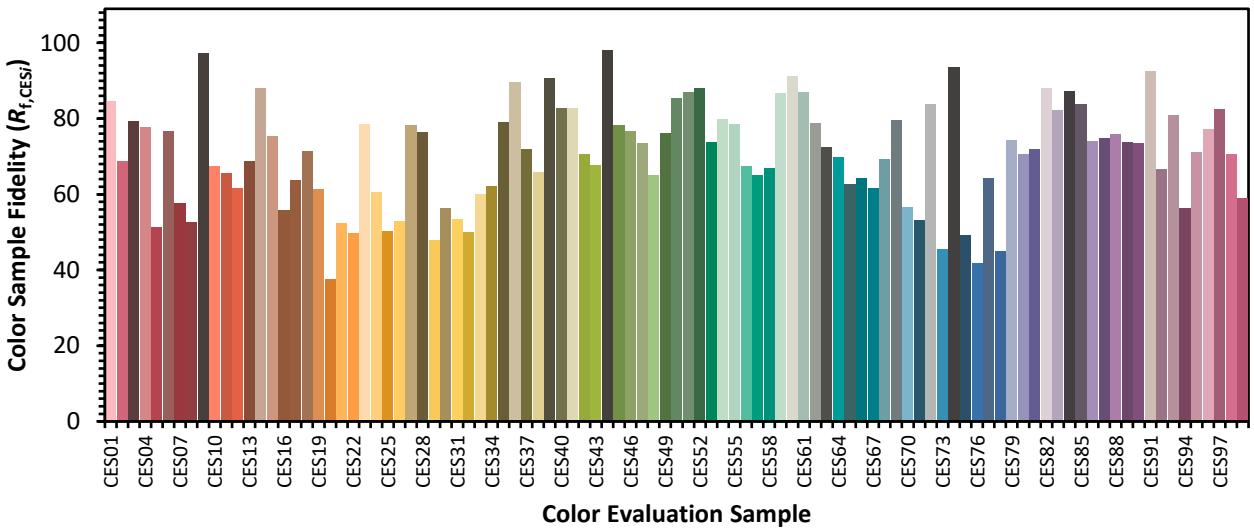



REPORT NUMBER: SP1-2407-184-6

TM-30-18

Color Rendition by Hue-Angle Bin

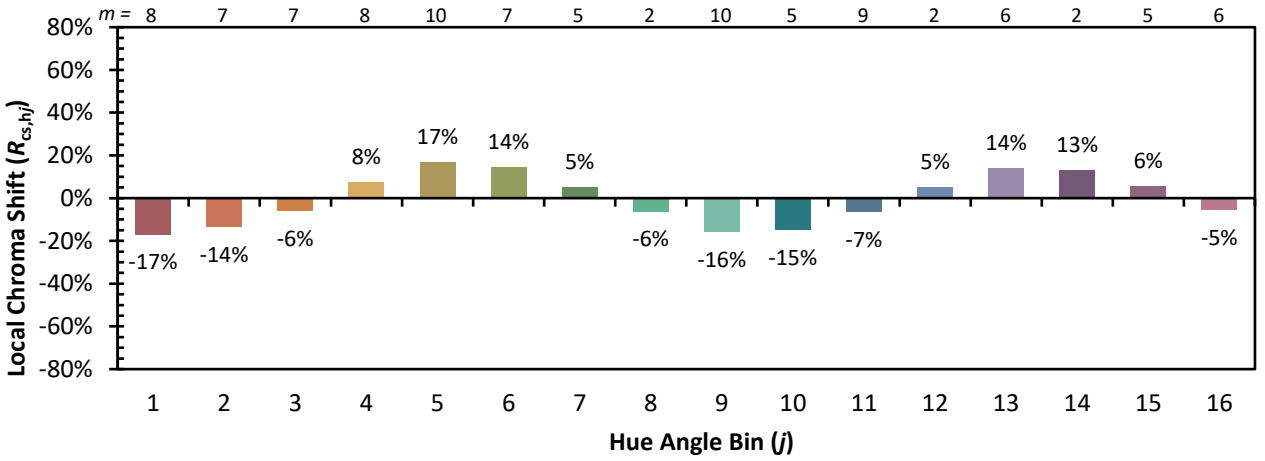

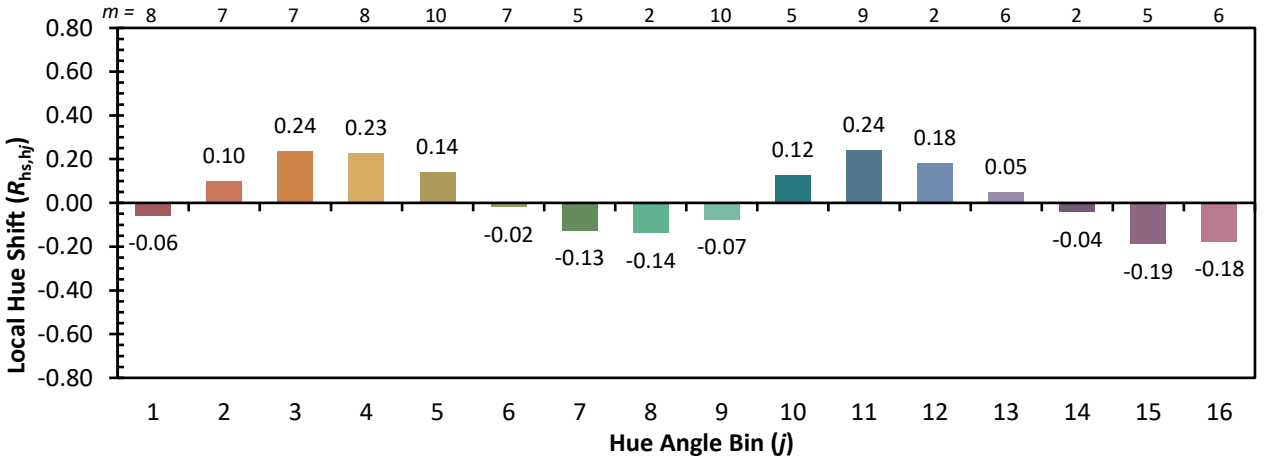


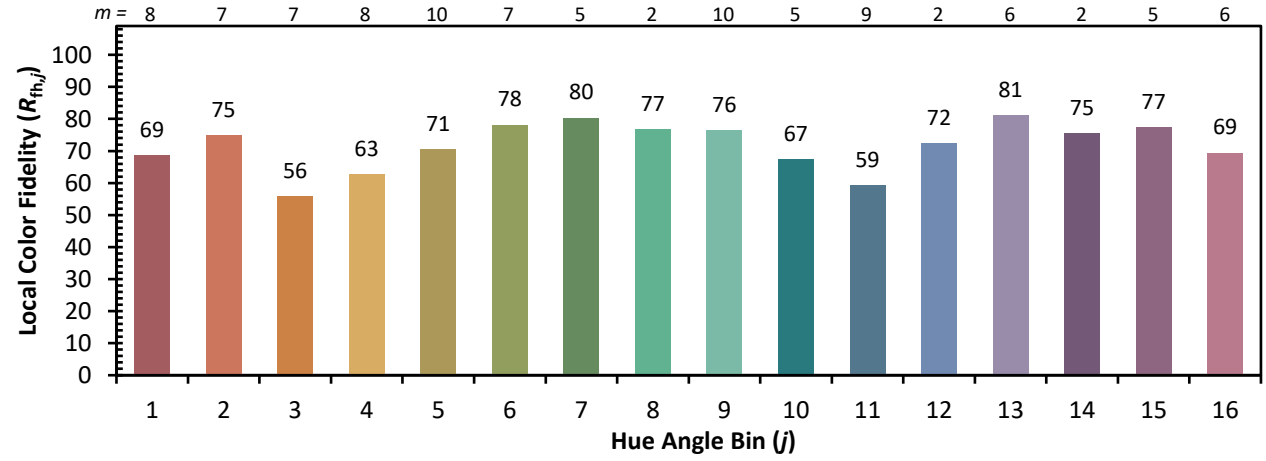


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Measure Comparisons

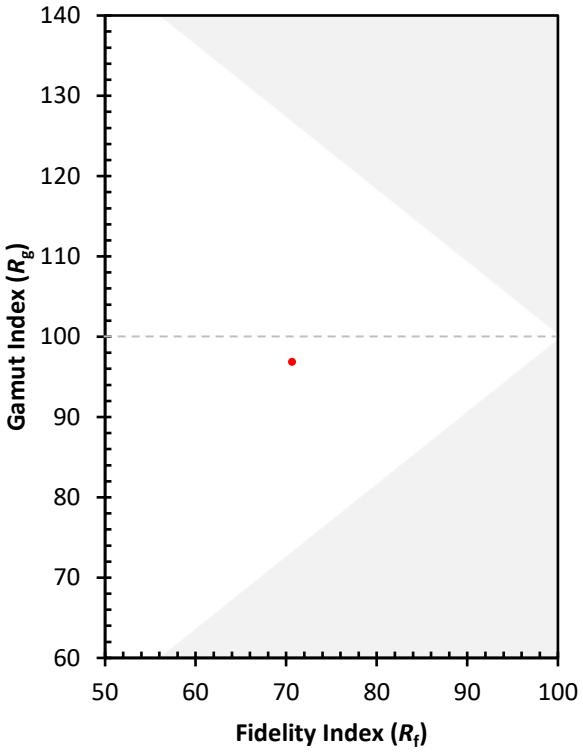

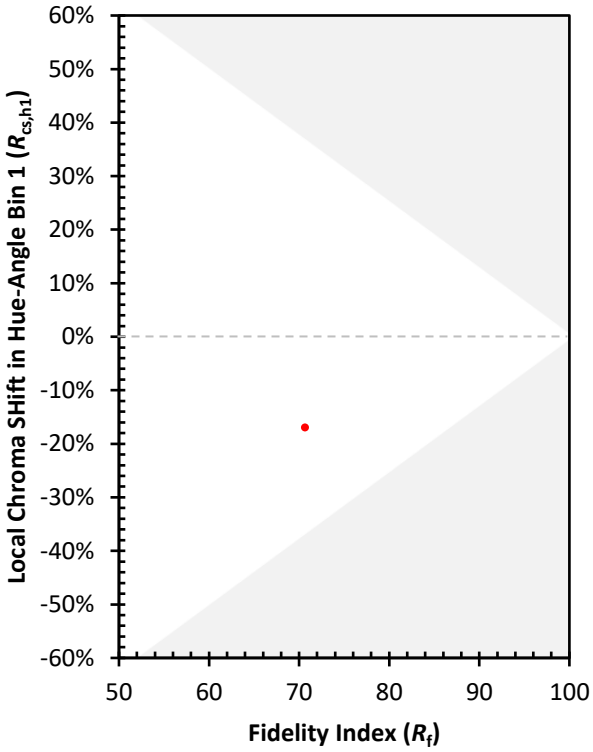

(END OF REPORT)