Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1358103

Luminaire Tested: **GSS-SB3A-750-U-T4FT-HSS**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1358103
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB3A-750-U-T4FT-HSS
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 3SQUARE 85W 70CRI 5000K FIXTURE w/ TYPE IV FORWARD THROW DISTRIBUTION OPTIC AND HOUSE SIDE SHIELD
Light Source:	(78) 5000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	9182 lumens
Efficiency:	N/A
Efficacy:	108.0 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 0.5' x H: 0')
IES Classification:	Type IV - Short
BUG Rating:	B1 - U0 - G2


Input Watts (W):	85
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	11.0%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358103
CATALOG NUMBER: GSS-SB3A-750-U-T4FT-HSS

Iso-Footcandle Lines of Horizontal Illumination

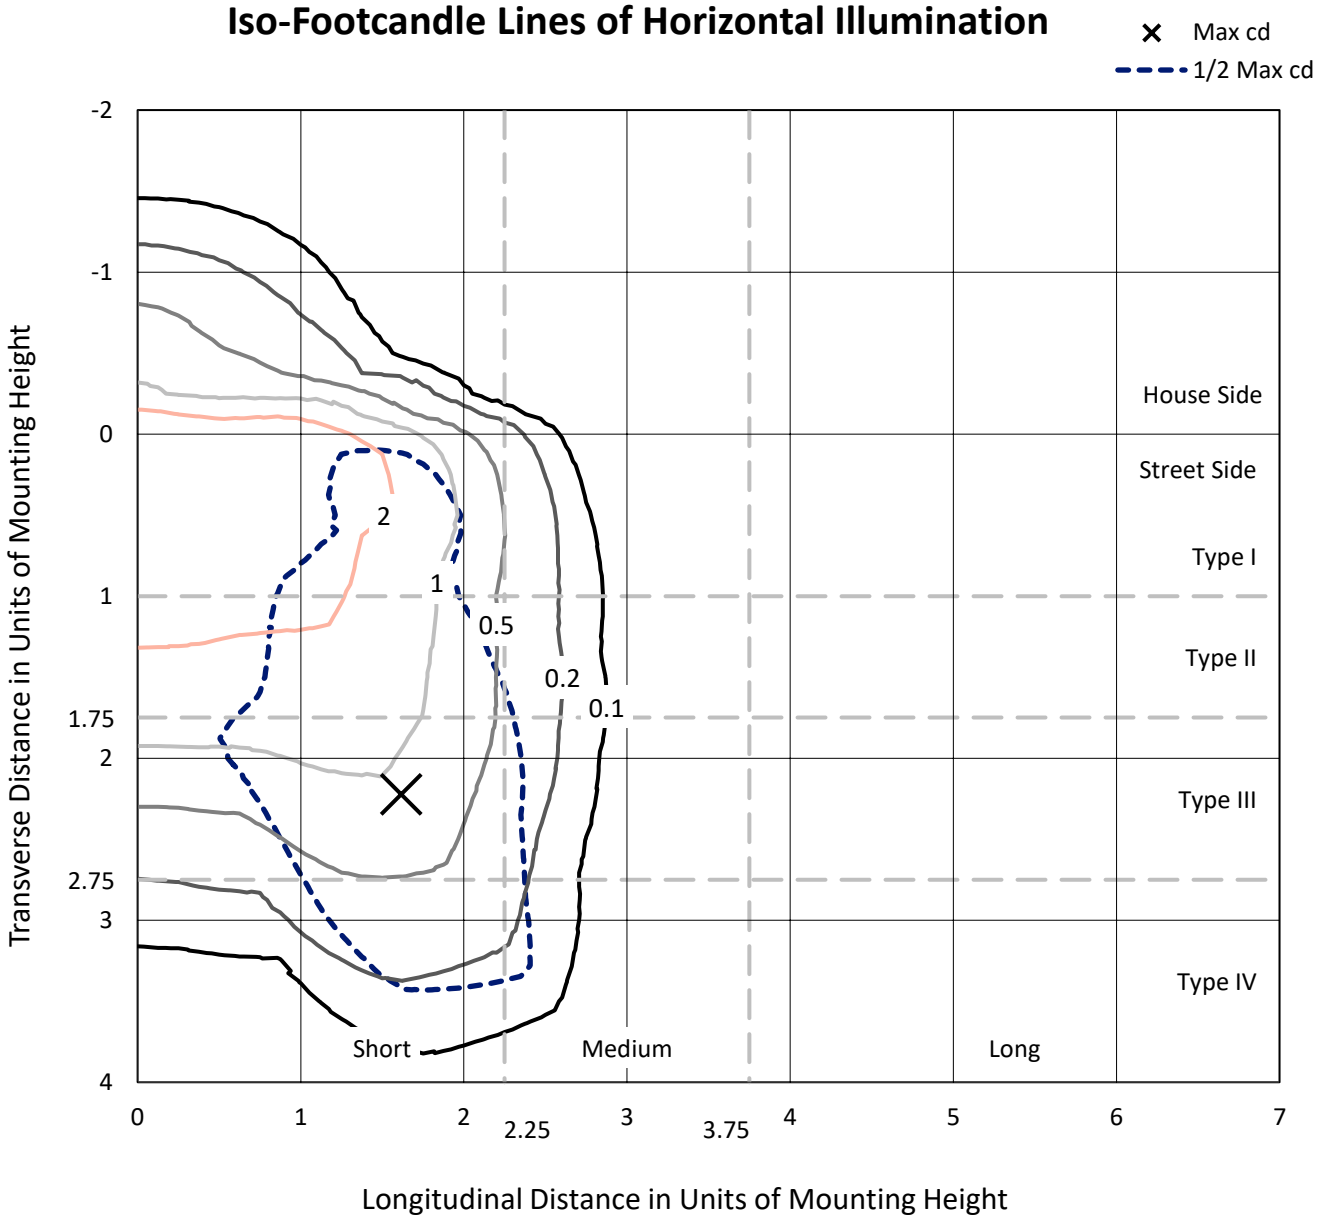


Based on 20 foot mounting height. Maximum calculated value = 3.7 fc
Type IV - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358103
CATALOG NUMBER: GSS-SB3A-750-U-T4FT-HSS

Luminous Intensity Polar Plot

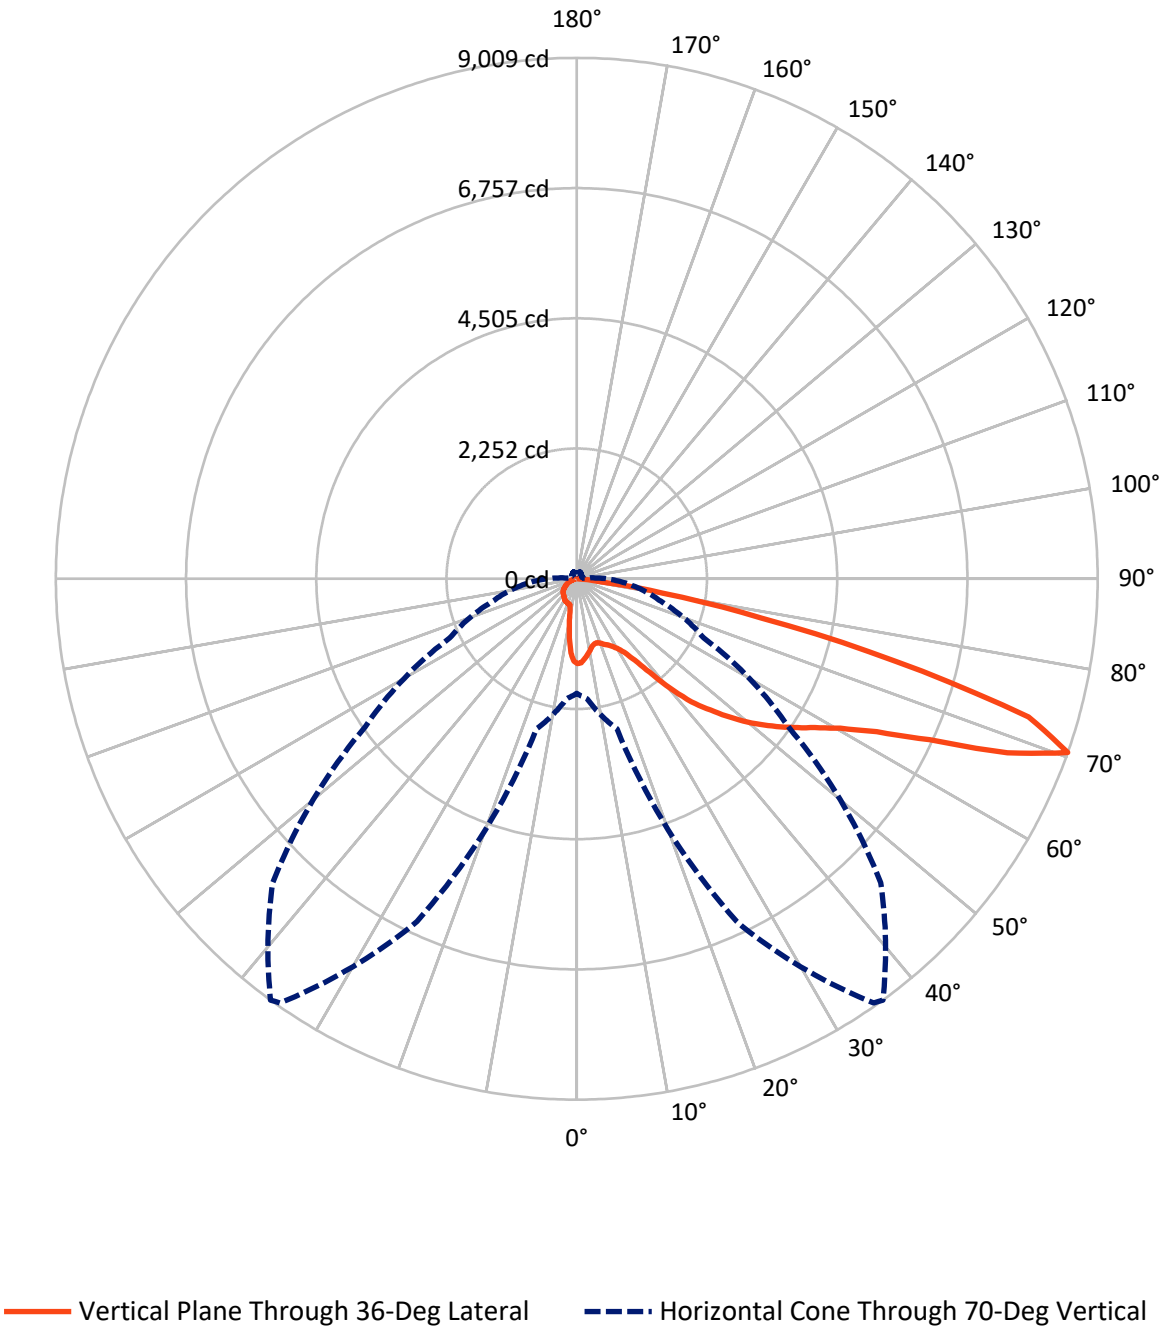

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1358103
CATALOG NUMBER: GSS-SB3A-750-U-T4FT-HSS

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	1143.7	0.0	1143.7
	% Fixture	12.5	0.0	12.5
Street Side	Lumens	8038.3	0.0	8038.3
	% Fixture	87.5	0.0	87.5
Total	Lumens	9182.0	0.0	9182.0
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	123.8	1.3
10°-20°	292.7	3.2
20°-30°	478.1	5.2
30°-40°	854.5	9.3
40°-50°	1529.8	16.7
50°-60°	2221.6	24.2
60°-70°	2477.7	27.0
70°-80°	1140.5	12.4
80°-90°	63.3	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	9182.0	100.0
0°-180°	9182.0	100.0

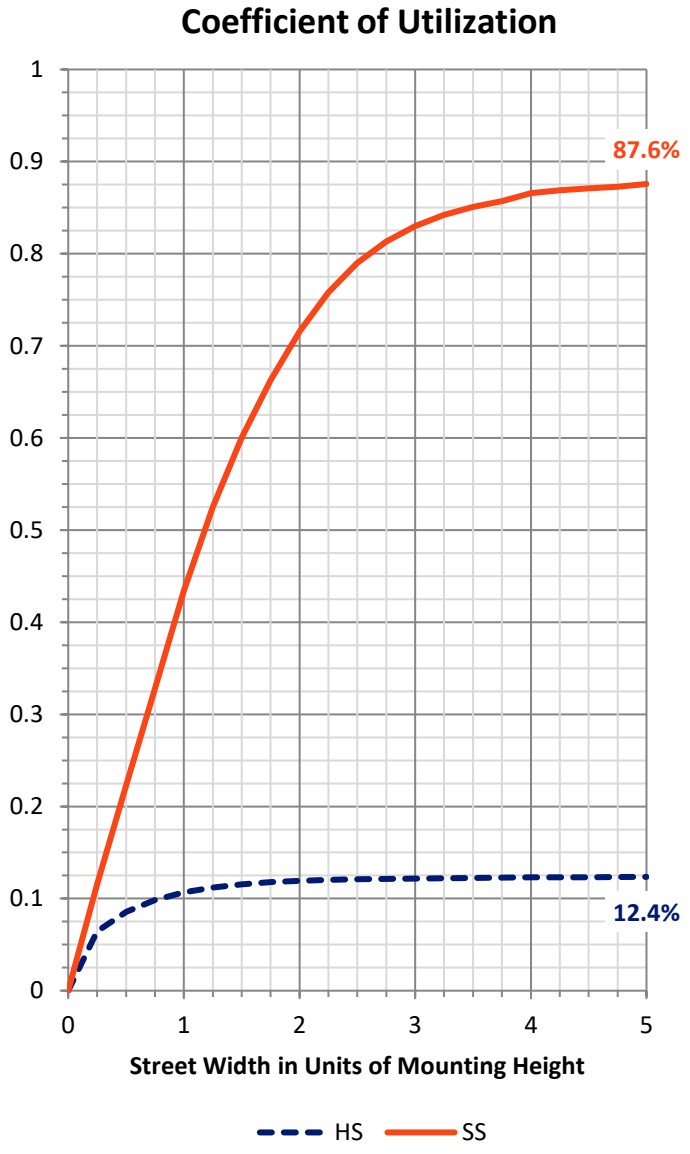

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1358103
CATALOG NUMBER: GSS-SB3A-750-U-T4FT-HSS

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	580.3	6.3			
FM	(30°-60°)	3937.3	42.9			
FH	(60°-80°)	3466.5	37.8			G2/5000
FVH	(80°-90°)	54.1	0.6			G1/100
BL	(0°-30°)	314.2	3.4	B1/500		
BM	(30°-60°)	668.6	7.3	B1/1000		
BH	(60°-80°)	151.7	1.7	B1/500		G1/500
BVH	(80°-90°)	9.2	0.1			G0/10
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B1-U0-G2
Type IV Short

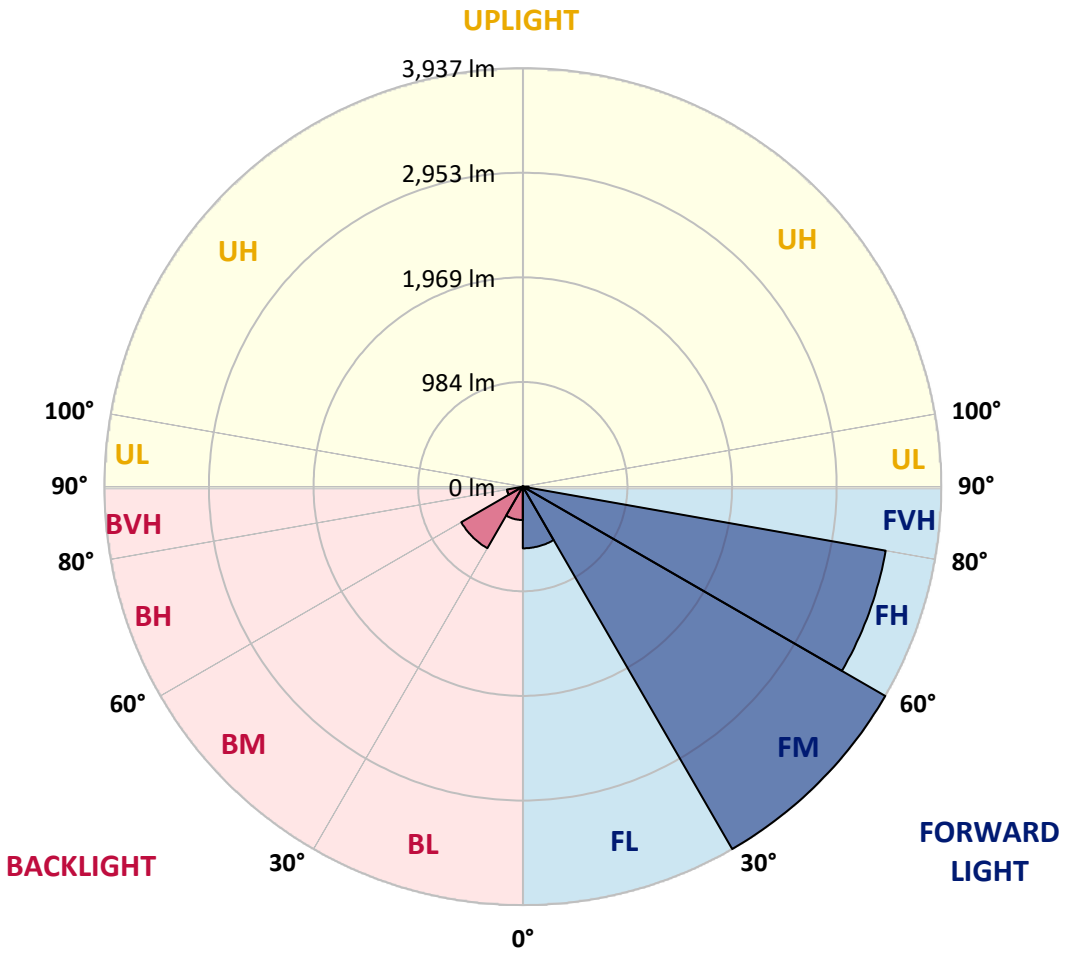

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358103
CATALOG NUMBER: GSS-SB3A-750-U-T4FT-HSS

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	36°	45°	55°	65°	75°	85°
0°	1467.0	1467.0	1467.0	1467.0	1467.0	*1467.0*	1467.0	1467.0	1467.0	1467.0	1467.0
2.5°	1449.7	1443.9	1443.9	1449.7	1464.1	*1455.5*	1449.7	1458.3	1461.2	1469.9	1472.7
5°	1363.2	1366.1	1357.5	1377.6	1392.0	*1394.9*	1415.1	1441.0	1455.5	1484.3	1487.2
7.5°	1250.8	1262.4	1268.1	1296.9	1325.8	*1328.6*	1366.1	1406.5	1449.7	1490.0	1510.2
10°	1161.5	1164.4	1170.1	1201.8	1253.7	*1259.5*	1311.3	1377.6	1441.0	1507.3	1530.4
12.5°	1103.8	1109.6	1109.6	1135.5	1187.4	*1193.2*	1253.7	1343.1	1435.3	1513.1	1556.3
15°	1103.8	1098.1	1098.1	1118.2	1158.6	*1164.4*	1222.0	1317.1	1420.9	1530.4	1599.6
17.5°	1109.6	1112.5	1106.7	1121.1	1155.7	*1161.5*	1213.4	1302.7	1423.7	1556.3	1634.1
20°	1132.7	1132.7	1126.9	1150.0	1181.7	*1190.3*	1233.5	1308.5	1435.3	1593.8	1683.1
22.5°	1164.4	1155.7	1152.8	1178.8	1219.1	*1233.5*	1271.0	1337.3	1452.6	1639.9	1735.0
25°	1210.5	1201.8	1196.1	1224.9	1262.4	*1268.1*	1334.4	1386.3	1498.7	1700.4	1821.5
27.5°	1296.9	1285.4	1256.6	1276.8	1322.9	*1328.6*	1394.9	1458.3	1562.1	1769.6	1919.5
30°	1562.1	1544.8	1461.2	1377.6	1394.9	*1403.6*	1469.9	1550.6	1648.6	1876.2	2066.5
32.5°	1876.2	1882.0	1775.4	1616.8	1513.1	*1516.0*	1559.2	1671.6	1775.4	2026.1	2248.0
35°	2279.7	2262.4	2118.3	1933.9	1737.9	*1729.2*	1717.7	1841.7	1959.8	2213.4	2475.7
37.5°	2665.9	2660.2	2542.0	2311.4	2083.7	*2049.2*	1968.5	2066.5	2176.0	2449.8	2729.3
40°	2954.1	2925.3	2856.1	2703.4	2510.3	*2490.1*	2320.1	2343.1	2446.9	2766.8	2994.5
42.5°	3141.5	3135.7	3055.0	3008.9	2919.5	*2910.9*	2709.2	2720.7	2778.3	3127.1	3305.7
45°	3325.9	3311.5	3242.3	3213.5	3219.3	*3239.5*	3210.6	3144.4	3187.6	3527.7	3640.1
47.5°	3510.4	3475.8	3423.9	3435.4	3556.5	*3582.4*	3677.5	3625.7	3570.9	3985.9	3954.2
50°	3579.5	3582.4	3596.8	3666.0	3864.9	*3925.4*	4147.3	4043.6	3957.1	4467.2	4317.4
52.5°	3605.5	3619.9	3717.9	3838.9	4156.0	*4230.9*	4663.2	4533.5	4294.3	4934.1	4553.7
55°	3634.3	3625.7	3821.6	3977.3	4461.5	*4542.2*	5135.9	4925.5	4611.3	5285.7	4755.4
57.5°	3781.3	3784.2	3936.9	4104.1	4746.8	*4856.3*	5568.2	5305.9	4787.1	5550.9	4813.1
60°	4014.7	4069.5	4173.3	4354.8	5086.9	*5242.5*	5994.7	5582.6	4965.8	5556.7	4562.3
62.5°	4150.2	4181.9	4475.9	4830.4	5669.1	*5824.7*	6447.2	5798.8	4873.6	5043.6	3919.6
65°	3683.3	3709.2	4369.2	5550.9	6576.9	*6706.6*	6945.8	5816.0	4386.5	4190.5	3043.5
67.5°	2749.5	2818.7	3605.5	6308.9	7969.0	*8032.4*	7551.1	5389.5	3605.5	2931.1	1786.9
70°	*1982.9*	*2086.6*	*2689.0*	*6542.3*	*8957.5*	*9009.4*	*7435.8*	*4470.1*	*2426.7*	*1504.4*	*841.6*
72.5°	1435.3	1490.0	1919.5	6136.0	8430.1	*8170.7*	5245.4	2795.6	1279.6	766.6	386.2
75°	991.4	1031.8	1222.0	4617.1	5744.0	*5692.1*	2645.8	1014.5	622.5	443.8	233.4
77.5°	409.3	409.3	547.6	2599.6	3213.5	*3265.4*	1201.8	276.7	328.6	256.5	135.5
80°	132.6	132.6	219.0	922.3	1487.2	*1504.4*	432.3	135.5	175.8	155.6	72.1
82.5°	49.0	46.1	112.4	305.5	368.9	*392.0*	118.2	66.3	106.6	92.2	34.6
85°	17.3	17.3	40.3	63.4	69.2	*60.5*	31.7	31.7	51.9	43.2	14.4
87.5°	0.0	0.0	2.9	5.8	8.6	*8.6*	8.6	8.6	11.5	8.6	8.6
90°	0.0	0.0	0.0	0.0	0.0	*0.0*	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358103
CATALOG NUMBER: GSS-SB3A-750-U-T4FT-HSS

CANDELA DISTRIBUTION (continued):

	90°	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
0°	1467.0	1467.0	1467.0	1467.0	1467.0	1467.0	1467.0	1467.0	1467.0	1467.0	1467.0
2.5°	1467.0	1472.7	1461.2	1449.7	1446.8	1432.4	1423.7	1412.2	1409.3	1406.5	1412.2
5°	1484.3	1484.3	1455.5	1423.7	1386.3	1334.4	1279.6	1230.6	1210.5	1187.4	1190.3
7.5°	1504.4	1490.0	1446.8	1363.2	1250.8	1126.9	1023.1	945.3	899.2	858.9	870.4
10°	1521.7	1507.3	1418.0	1256.6	1069.3	902.1	752.2	665.8	611.0	579.3	593.7
12.5°	1547.7	1518.9	1369.0	1121.1	864.6	660.0	544.7	498.6	484.2	475.5	475.5
15°	1576.5	1527.5	1294.1	968.4	668.6	498.6	466.9	466.9	469.8	469.8	472.7
17.5°	1605.3	1530.4	1213.4	792.6	518.8	455.4	458.3	461.1	466.9	461.1	461.1
20°	1639.9	1550.6	1109.6	636.9	455.4	446.7	449.6	455.4	461.1	455.4	458.3
22.5°	1697.5	1570.7	1020.3	536.1	446.7	441.0	441.0	449.6	452.5	443.8	446.7
25°	1763.8	1596.7	925.1	495.7	452.5	432.3	438.1	443.8	446.7	441.0	441.0
27.5°	1847.4	1639.9	832.9	495.7	458.3	426.5	429.4	438.1	443.8	435.2	441.0
30°	1968.5	1691.8	775.3	510.1	464.0	415.0	417.9	429.4	438.1	432.3	435.2
32.5°	2118.3	1781.1	726.3	521.7	461.1	403.5	400.6	417.9	432.3	429.4	435.2
35°	2302.8	1884.9	694.6	533.2	455.4	394.8	383.3	406.4	429.4	429.4	432.3
37.5°	2487.2	1994.4	709.0	530.3	441.0	389.1	368.9	389.1	415.0	423.7	429.4
40°	2706.3	2115.4	743.6	513.0	432.3	371.8	357.4	371.8	397.7	412.1	417.9
42.5°	2902.3	2230.7	778.2	492.8	420.8	354.5	345.8	357.4	371.8	386.2	394.8
45°	3132.8	2320.1	766.6	469.8	409.3	340.1	337.2	340.1	345.8	351.6	357.4
47.5°	3297.1	2348.9	714.8	449.6	383.3	328.6	322.8	319.9	314.1	314.1	317.0
50°	3475.8	2268.2	611.0	426.5	345.8	314.1	302.6	294.0	285.3	279.6	282.4
52.5°	3553.6	2060.7	513.0	386.2	302.6	294.0	279.6	268.0	256.5	253.6	250.7
55°	3521.9	1775.4	423.7	325.7	270.9	270.9	256.5	245.0	233.4	224.8	221.9
57.5°	3400.9	1481.4	340.1	242.1	239.2	245.0	233.4	221.9	210.4	198.9	198.9
60°	3118.4	1135.5	262.3	196.0	207.5	216.2	213.3	204.6	184.5	167.2	167.2
62.5°	2631.3	769.5	187.3	158.5	175.8	190.2	193.1	184.5	161.4	141.2	138.3
65°	2000.2	452.5	144.1	135.5	149.9	164.3	170.0	161.4	135.5	112.4	106.6
67.5°	1216.2	245.0	112.4	115.3	129.7	138.3	147.0	141.2	118.2	95.1	92.2
70°	*518.8*	*123.9*	*92.2*	*95.1*	*103.8*	*106.6*	*123.9*	*126.8*	*106.6*	*83.6*	*80.7*
72.5°	239.2	92.2	74.9	80.7	77.8	80.7	106.6	112.4	92.2	66.3	66.3
75°	138.3	69.2	57.6	63.4	51.9	60.5	86.5	92.2	77.8	54.8	51.9
77.5°	74.9	49.0	40.3	43.2	37.5	46.1	69.2	72.1	57.6	43.2	43.2
80°	43.2	31.7	28.8	25.9	25.9	31.7	49.0	46.1	37.5	37.5	37.5
82.5°	23.1	17.3	17.3	17.3	17.3	20.2	25.9	28.8	31.7	31.7	31.7
85°	11.5	8.6	8.6	8.6	11.5	14.4	20.2	23.1	25.9	25.9	25.9
87.5°	5.8	5.8	5.8	5.8	5.8	8.6	14.4	17.3	20.2	11.5	5.8
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-6

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-750-U-5WQ

Data in this report applies to families of products including GSS-SB1A-750-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-750-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 5000K CCT 26 LEDS

Spectral Parameters

CCT (K):	4896
CIE u':	0.2101
CIE v':	0.4901
Duv:	0.0035
CIE x:	0.3489
CIE y:	0.3618
CIE z:	0.2893
Peak Wavelength (nm):	443
Dominant Wavelength (nm):	570
Purity:	13.25435
Rf:	70.7
Rg:	96.8

CRI (Ra):	70.2
R1:	68.1
R2:	73.9
R3:	79.4
R4:	72.1
R5:	69.2
R6:	65.7
R7:	78.1
R8:	55.3
R9:	-35.1
R10:	39.3
R11:	71.1
R12:	43.8
R13:	68.1
R14:	88.4
R15:	59.7

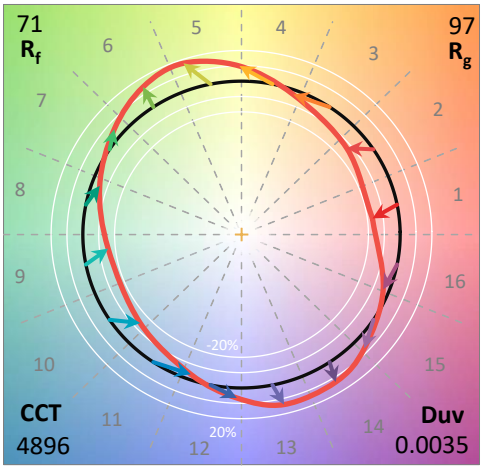

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-6

CIE 1931 Chromaticity Diagram

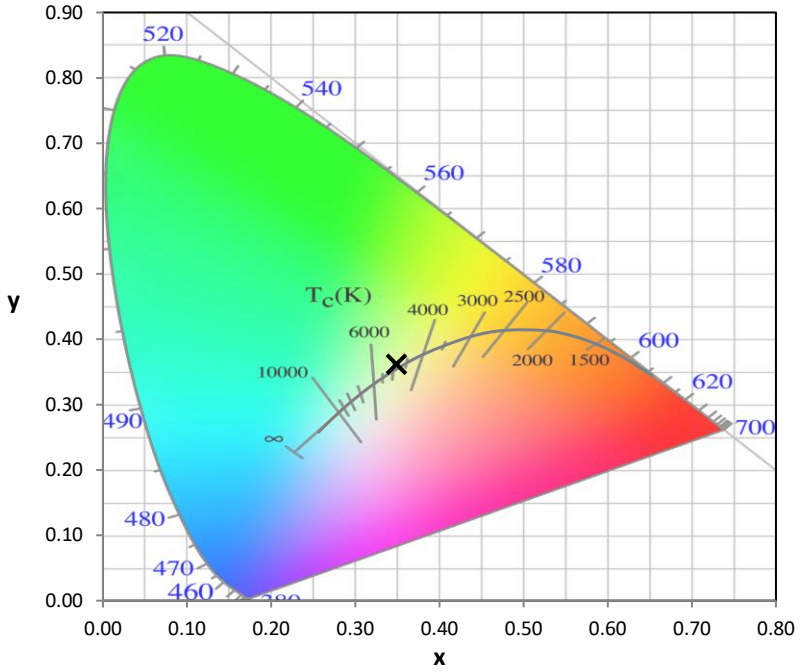

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

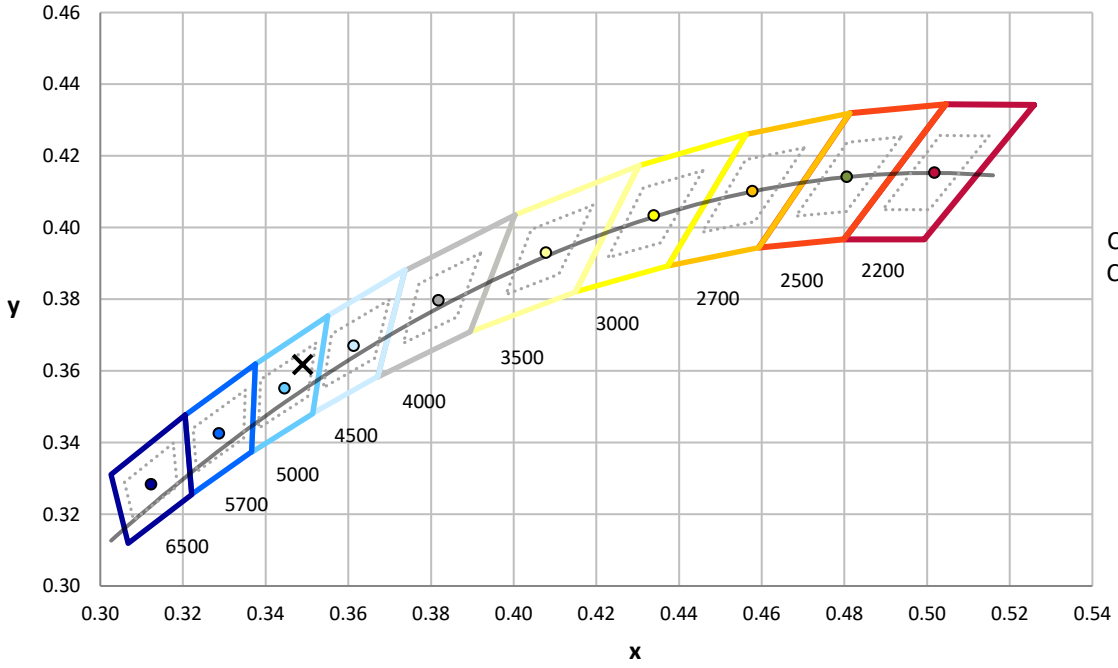


CCT = 4896K
CIE x = 0.3489
CIE y = 0.3618
Duv = 0.0035

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-6

Photopic Flux vs. Wavelength

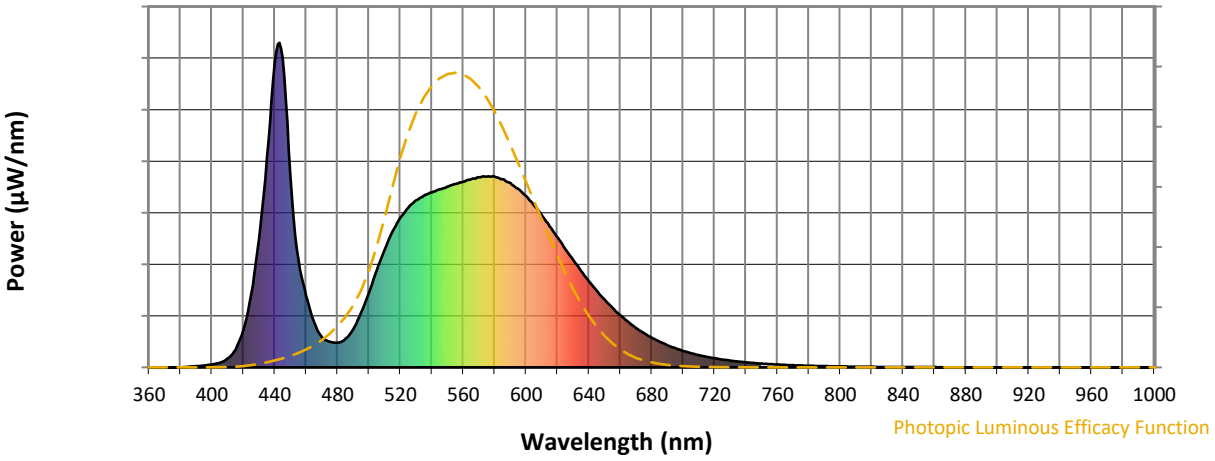


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Scotopic Flux vs. Wavelength

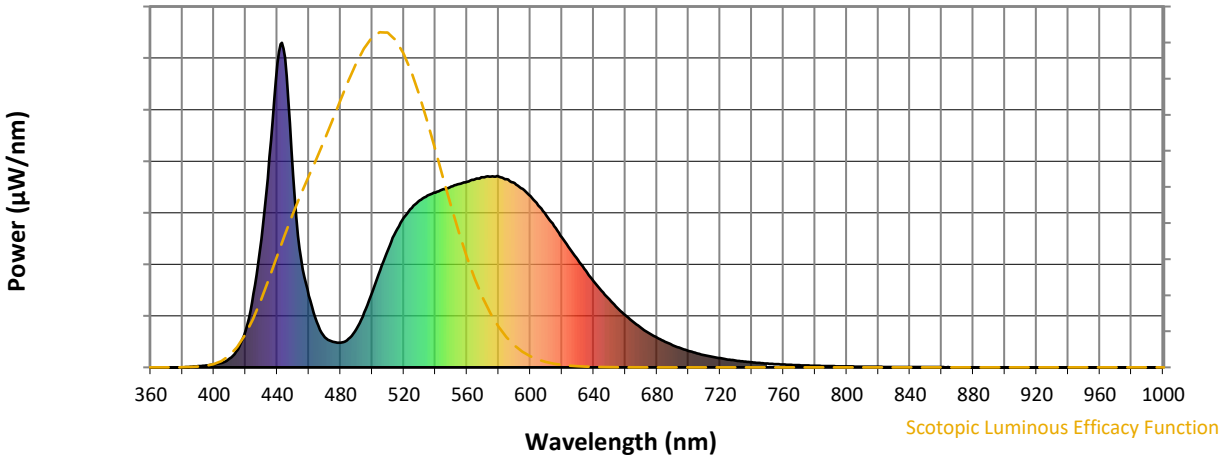


Scotopic Lumens: NR **S/P: 1.7**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Melanopic Flux vs. Wavelength

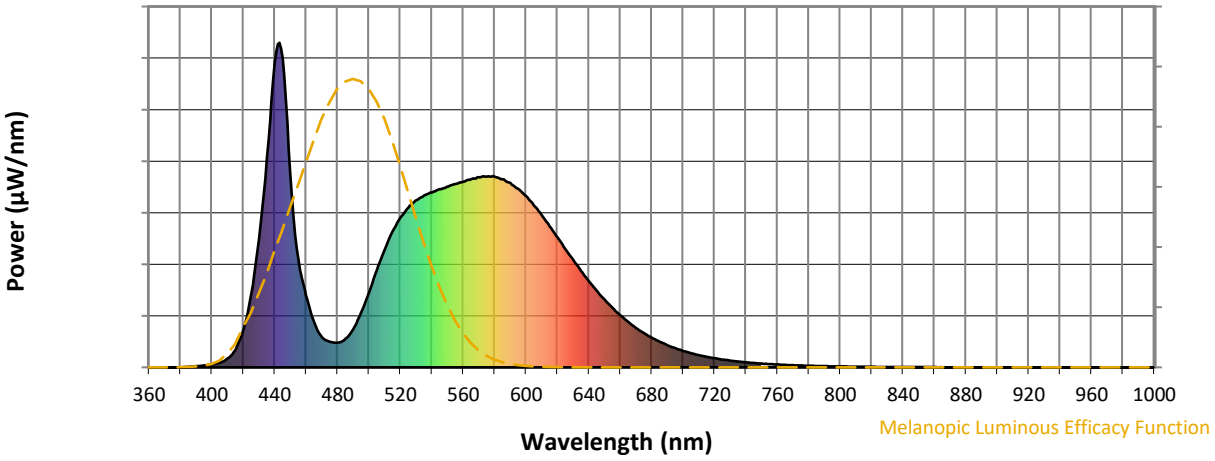

Melanopic Lumens: NR **M/P: 3.37**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			


REPORT NUMBER: SP1-2407-184-6

TM-30-18


Summary


R_f = 70.7
R_g = 96.8
CIE R_a = 70.2
R_9 = -35.1


Spectral Power Distribution Comparison

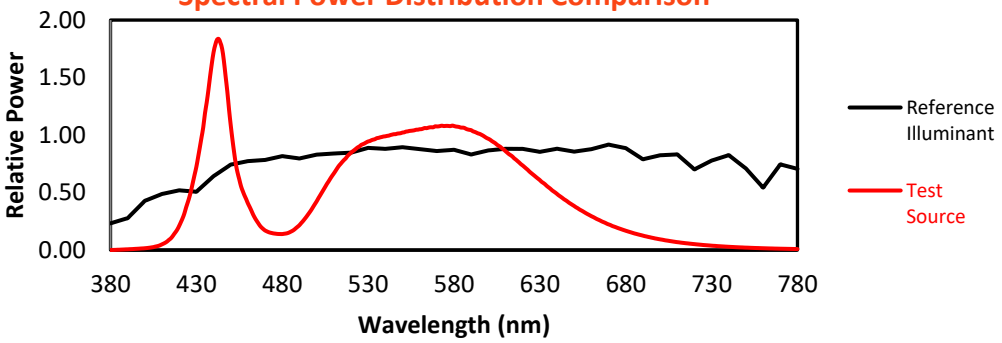


Color Vector Graphics

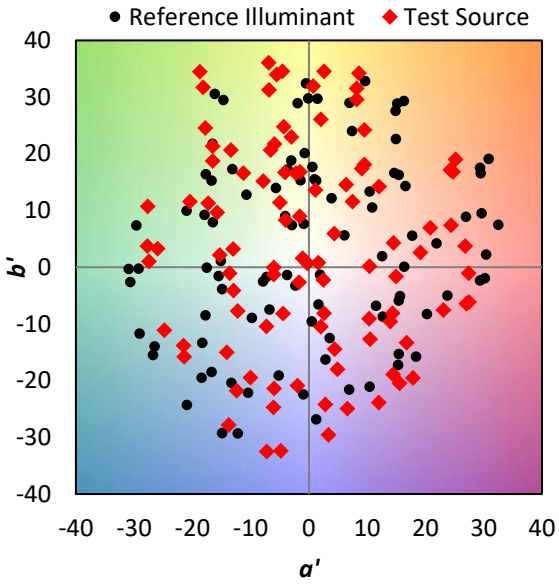

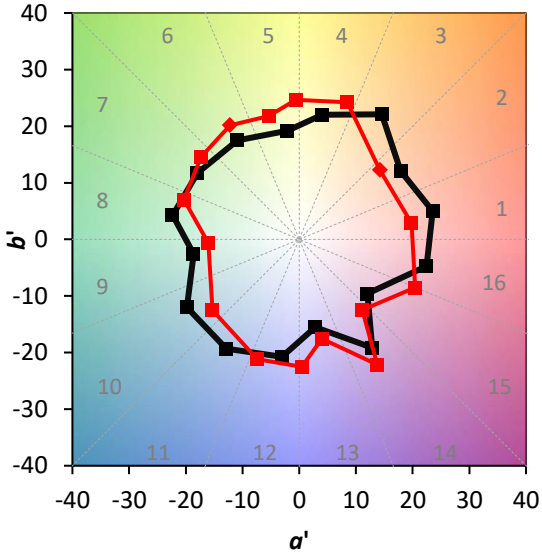

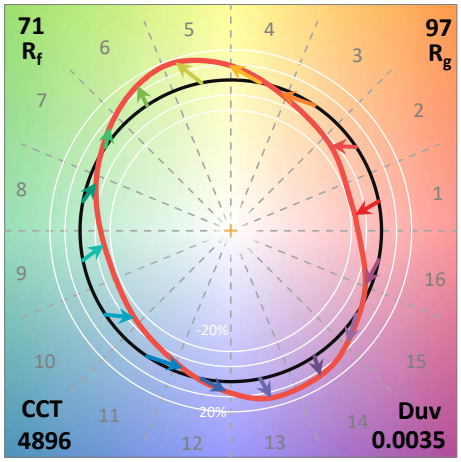

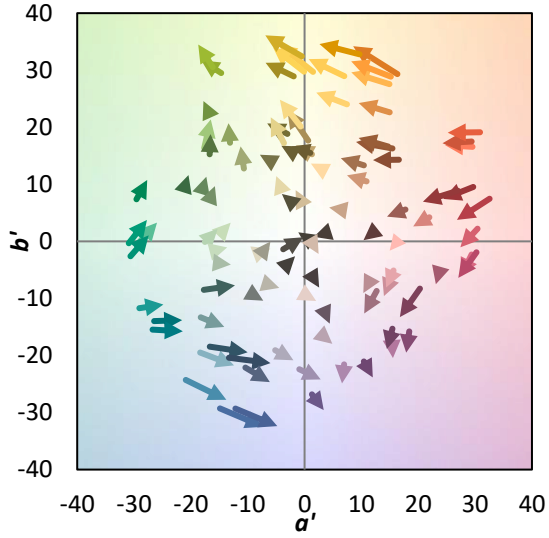


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 53	CES51 = 87	CES76 = 42
CES02 = 59	CES27 = 78	CES52 = 88	CES77 = 64
CES03 = 30	CES28 = 76	CES53 = 74	CES78 = 45
CES04 = 69	CES29 = 48	CES54 = 80	CES79 = 74
CES05 = 46	CES30 = 56	CES55 = 79	CES80 = 71
CES06 = 50	CES31 = 54	CES56 = 68	CES81 = 72
CES07 = 39	CES32 = 50	CES57 = 65	CES82 = 88
CES08 = 38	CES33 = 60	CES58 = 67	CES83 = 82
CES09 = 29	CES34 = 62	CES59 = 87	CES84 = 87
CES10 = 72	CES35 = 79	CES60 = 91	CES85 = 84
CES11 = 56	CES36 = 90	CES61 = 87	CES86 = 74
CES12 = 61	CES37 = 72	CES62 = 79	CES87 = 75
CES13 = 41	CES38 = 66	CES63 = 72	CES88 = 76
CES14 = 74	CES39 = 91	CES64 = 70	CES89 = 74
CES15 = 70	CES40 = 83	CES65 = 63	CES90 = 73
CES16 = 46	CES41 = 83	CES66 = 64	CES91 = 92
CES17 = 49	CES42 = 70	CES67 = 62	CES92 = 67
CES18 = 55	CES43 = 68	CES68 = 69	CES93 = 81
CES19 = 71	CES44 = 98	CES69 = 80	CES94 = 56
CES20 = 64	CES45 = 78	CES70 = 56	CES95 = 71
CES21 = 85	CES46 = 77	CES71 = 53	CES96 = 77
CES22 = 77	CES47 = 73	CES72 = 84	CES97 = 82
CES23 = 91	CES48 = 65	CES73 = 46	CES98 = 71
CES24 = 90	CES49 = 76	CES74 = 94	CES99 = 59
CES25 = 71	CES50 = 85	CES75 = 49	

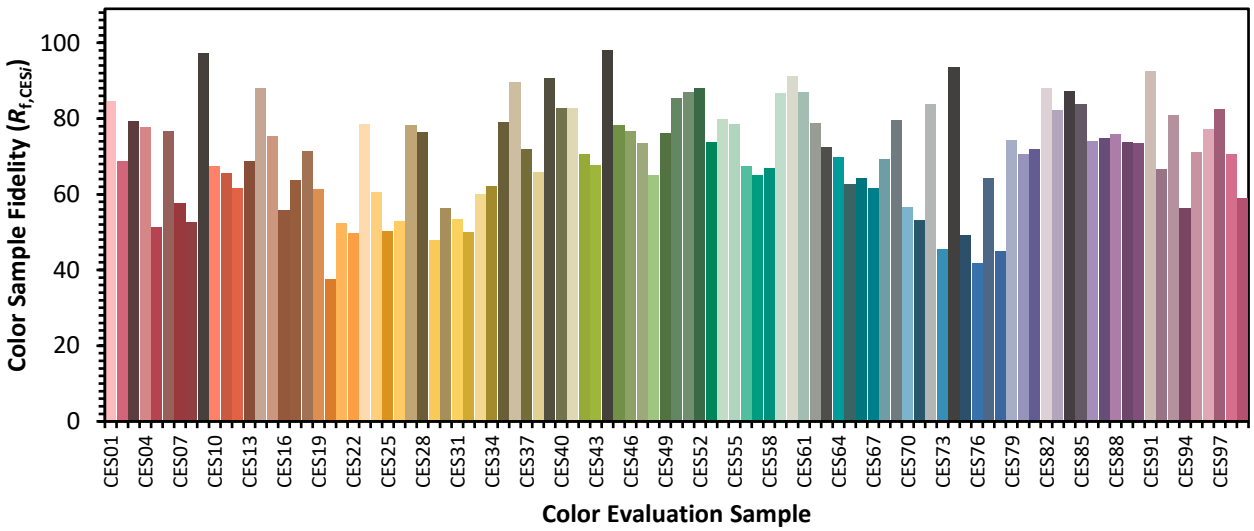



REPORT NUMBER: SP1-2407-184-6

TM-30-18

Color Rendition by Hue-Angle Bin

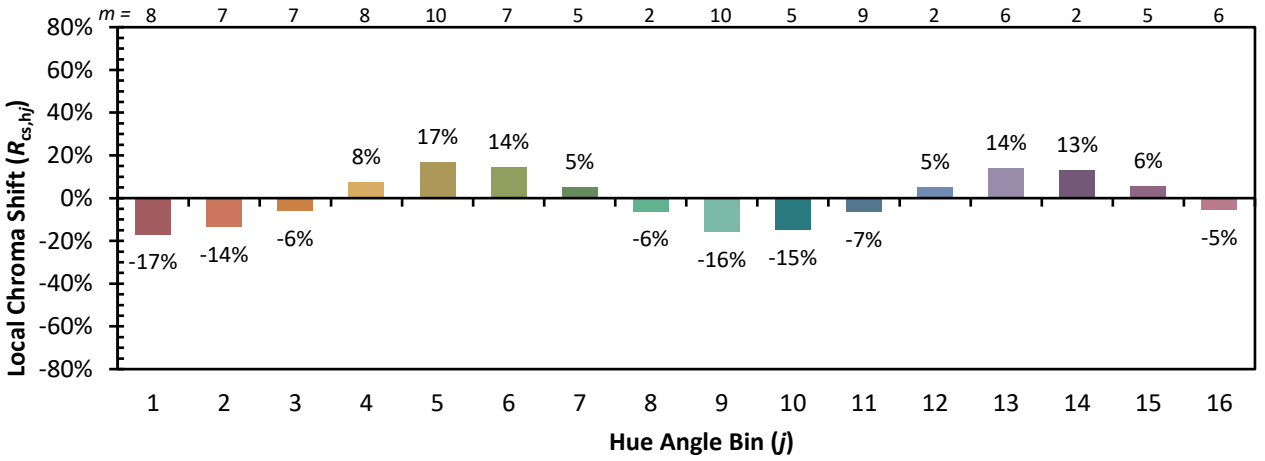

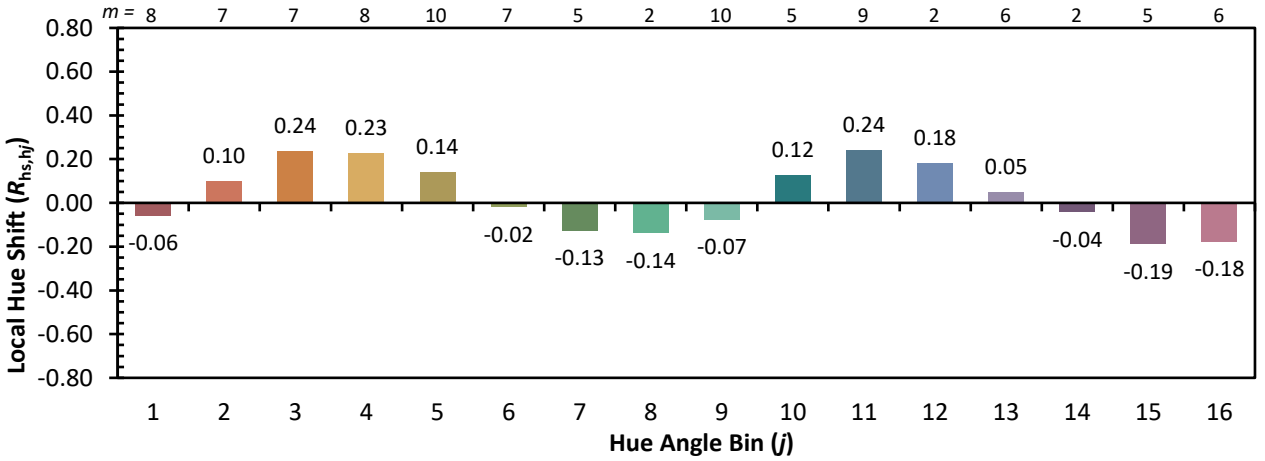


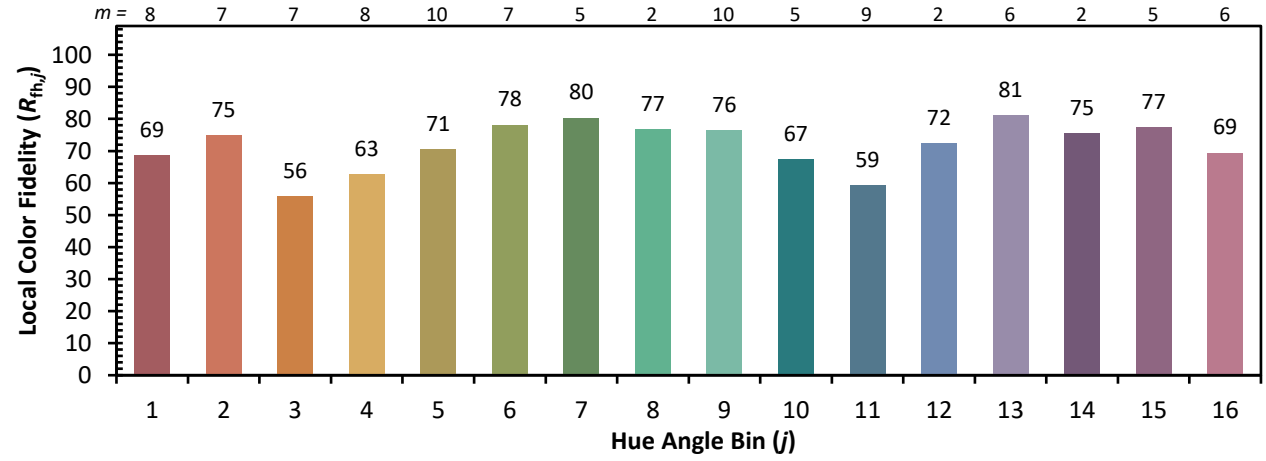


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Measure Comparisons

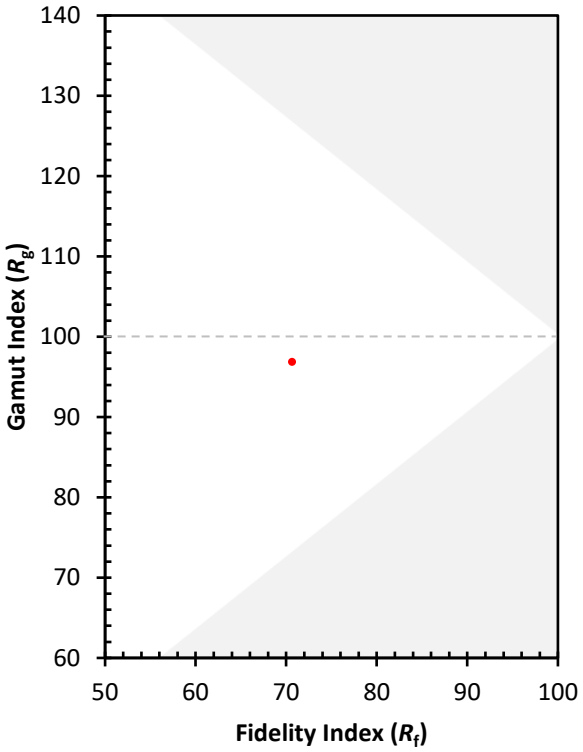

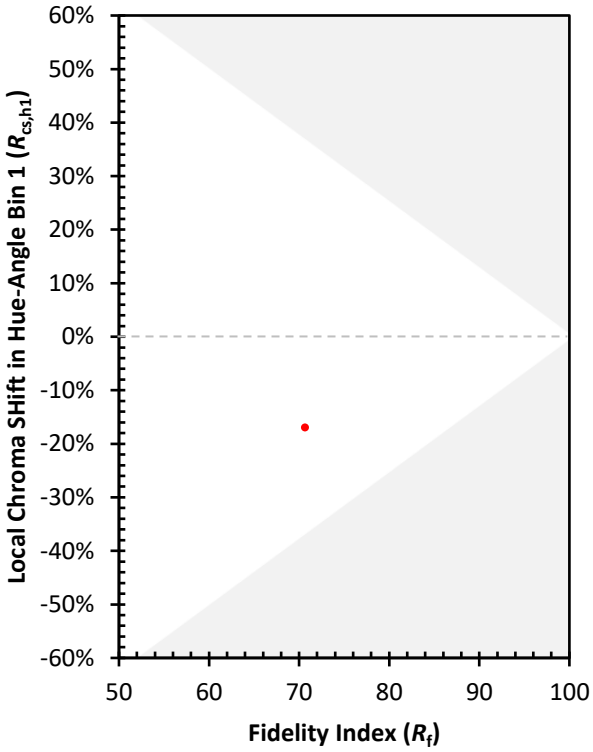

(END OF REPORT)