Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360784

Luminaire Tested: **GSS-SB1B-750-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360784
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB1B-750-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 1SQUARE 40W 70CRI 5000K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(26) 5000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	5363 lumens
Efficiency:	N/A
Efficacy:	134.1 lumens/watt
Luminous Opening:	Rectangular (W 0.5' x L: 0.5' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B2 - U0 - G2


Input Watts (W):	40
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	5.3%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360784
CATALOG NUMBER: GSS-SB1B-750-U-T1

Iso-Footcandle Lines of Horizontal Illumination

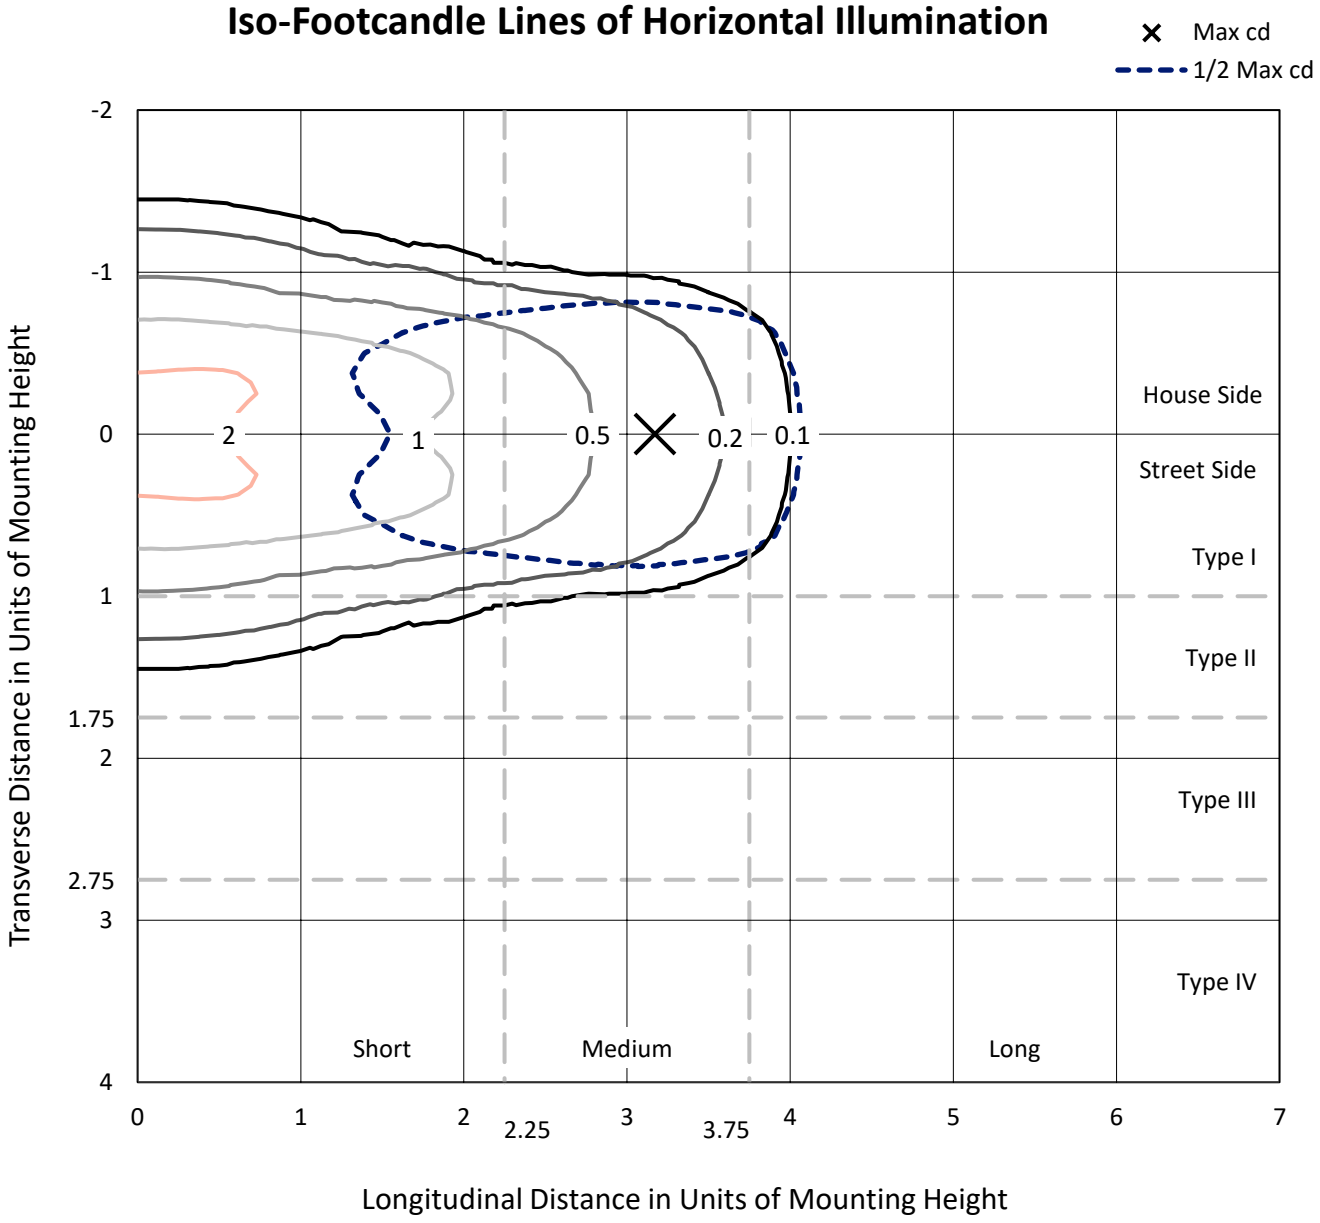


Based on 20 foot mounting height. Maximum calculated value = 2.6 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360784
CATALOG NUMBER: GSS-SB1B-750-U-T1

Luminous Intensity Polar Plot

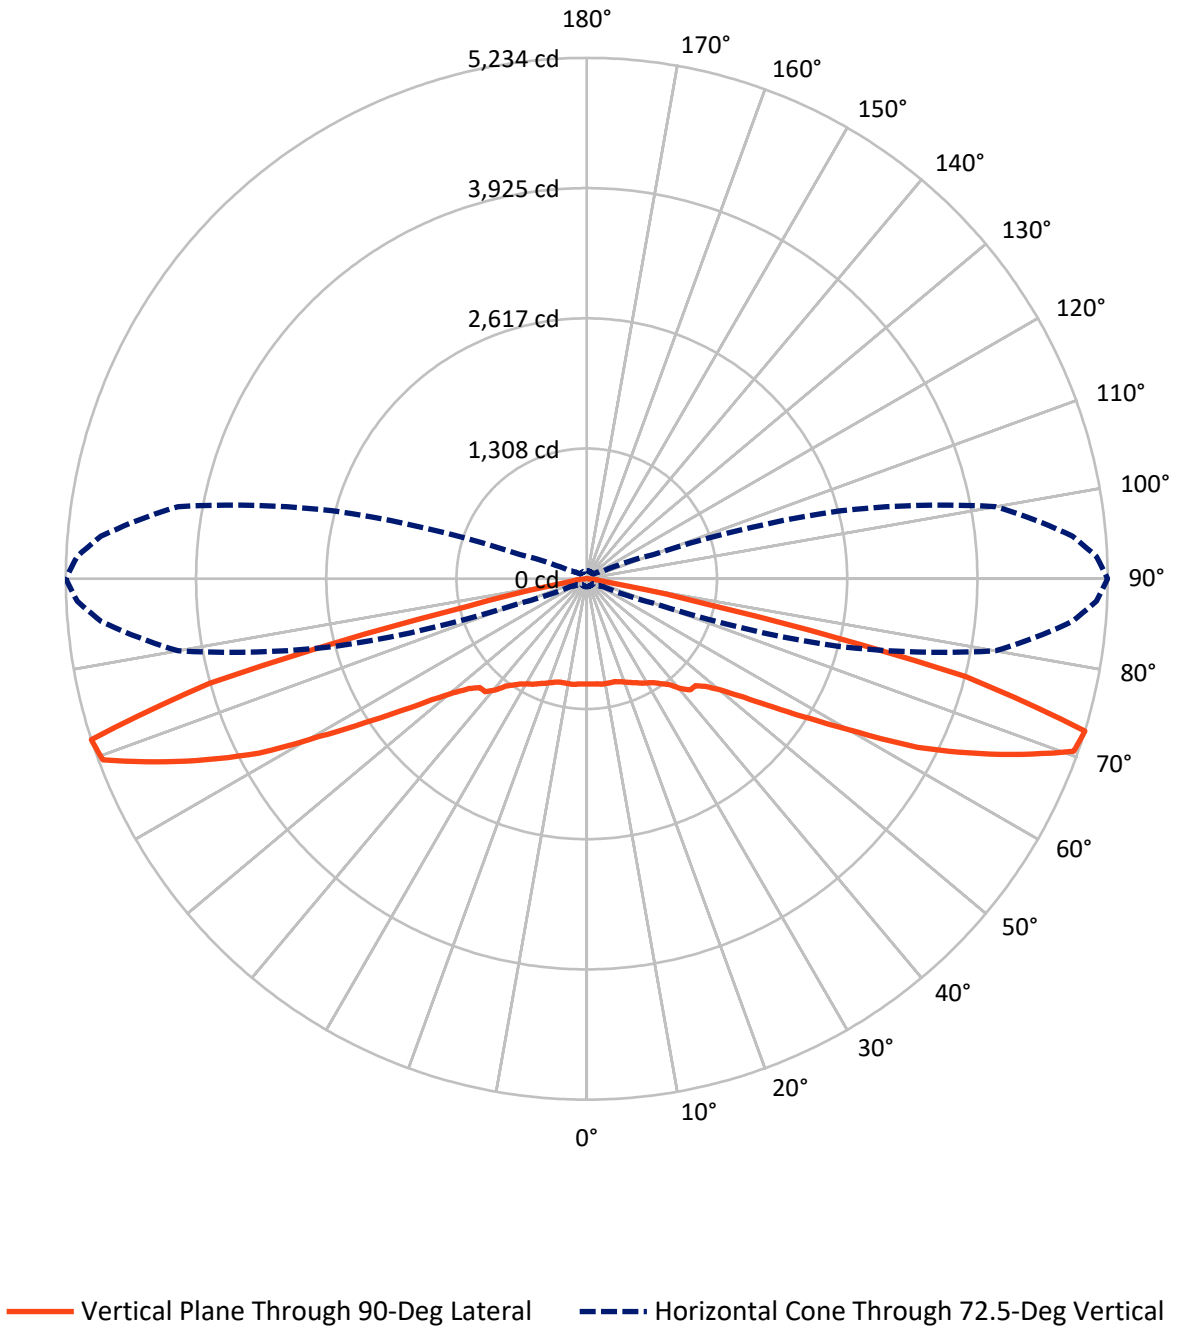

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360784
CATALOG NUMBER: GSS-SB1B-750-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	2681.5	0.0	2681.5
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	2681.5	0.0	2681.5
	% Fixture	50.0	0.0	50.0
Total	Lumens	5363.0	0.0	5363.0
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	102.3	1.9
10°-20°	311.7	5.8
20°-30°	521.0	9.7
30°-40°	718.5	13.4
40°-50°	880.8	16.4
50°-60°	1032.2	19.2
60°-70°	1146.2	21.4
70°-80°	623.3	11.6
80°-90°	27.0	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	5363.0	100.0
0°-180°	5363.0	100.0

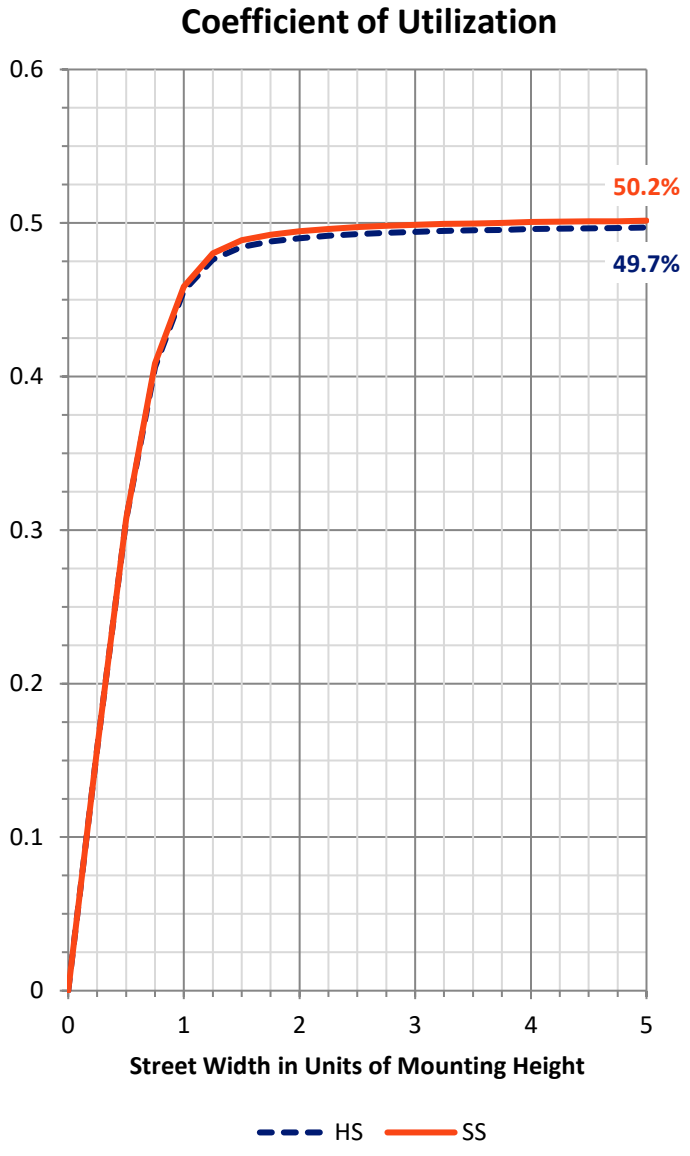

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360784
CATALOG NUMBER: GSS-SB1B-750-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	467.5	8.7			
FM	(30°-60°)	1315.7	24.5			
FH	(60°-80°)	884.8	16.5			G1/1800
FVH	(80°-90°)	13.5	0.3			G1/100
BL	(0°-30°)	467.5	8.7	B1/500		
BM	(30°-60°)	1315.7	24.5	B2/2500		
BH	(60°-80°)	884.8	16.5	B2/1000		G2/1000
BVH	(80°-90°)	13.5	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B2-U0-G2
Type I Short

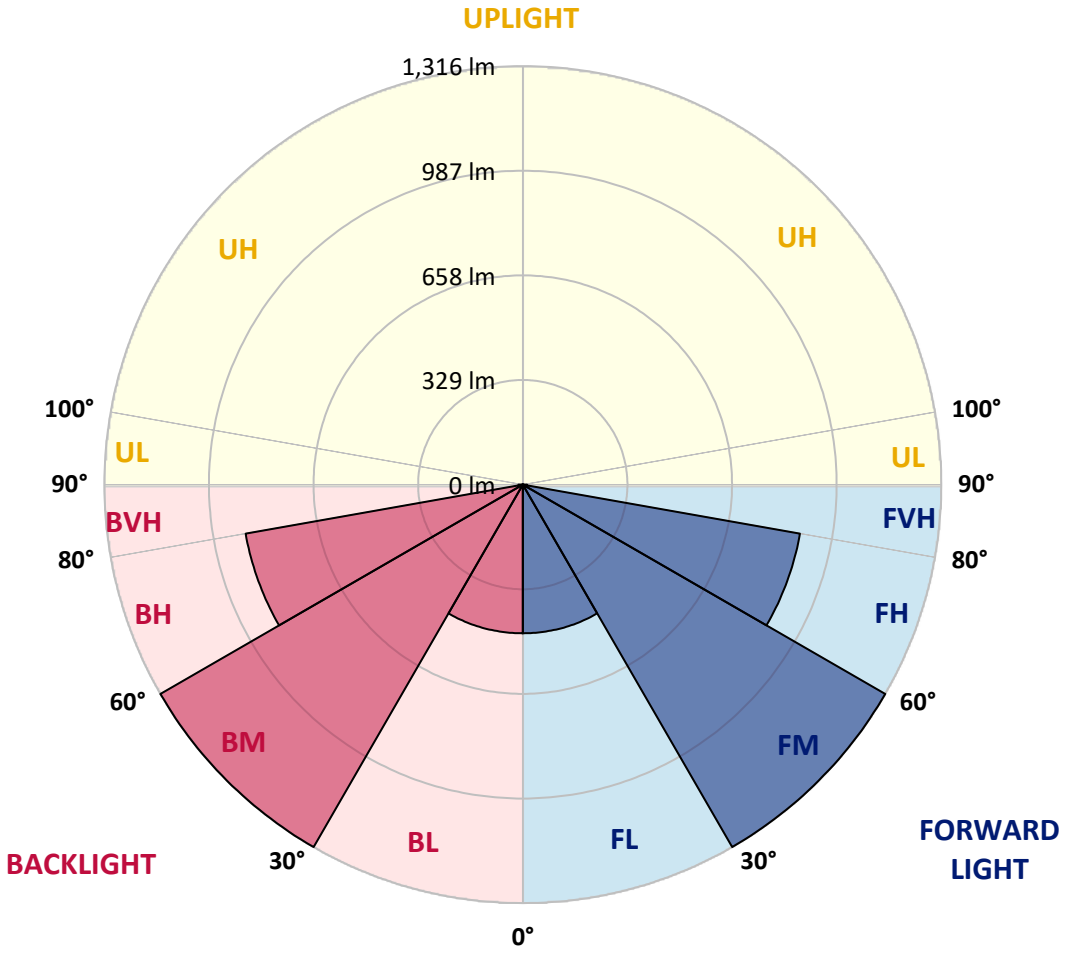

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360784
CATALOG NUMBER: GSS-SB1B-750-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	1056.6	1056.6	1056.6	1056.6	1056.6	1056.6	1056.6	1056.6	1056.6	1056.6	1056.6
2.5°	1057.8	1057.8	1054.3	1059.0	1056.6	1057.8	1059.0	1057.8	1056.6	1057.8	1059.0
5°	1063.7	1061.3	1063.7	1066.0	1062.5	1064.9	1063.7	1057.8	1061.3	1061.3	1061.3
7.5°	1074.3	1076.6	1074.3	1080.1	1076.6	1083.7	1076.6	1071.9	1070.7	1069.6	1069.6
10°	1079.0	1079.0	1077.8	1088.3	1090.7	1097.7	1093.0	1086.0	1082.5	1077.8	1073.1
12.5°	1066.0	1068.4	1074.3	1094.2	1103.6	1117.7	1114.2	1100.1	1089.5	1086.0	1079.0
15°	1052.0	1054.3	1066.0	1090.7	1113.0	1134.1	1133.0	1115.4	1102.4	1093.0	1082.5
17.5°	1029.6	1033.2	1049.6	1087.2	1127.1	1150.6	1157.6	1140.0	1125.9	1110.7	1096.6
20°	992.1	992.1	1021.4	1069.6	1124.7	1177.6	1196.4	1182.3	1165.8	1141.2	1122.4
22.5°	949.8	952.2	981.5	1044.9	1123.6	1201.1	1237.5	1222.2	1205.8	1178.8	1150.6
25°	907.5	907.5	940.4	1012.0	1108.3	1217.5	1285.6	1277.4	1244.5	1219.8	1183.4
27.5°	868.8	868.8	904.0	979.2	1082.5	1222.2	1333.7	1333.7	1297.3	1260.9	1221.0
30°	823.0	834.8	874.7	953.3	1059.0	1214.0	1368.9	1391.3	1358.4	1311.4	1252.7
32.5°	784.3	792.5	833.6	916.9	1024.9	1204.6	1408.9	1464.0	1430.0	1365.4	1299.7
35°	738.5	737.3	784.3	866.5	976.8	1183.4	1440.6	1550.9	1518.1	1448.8	1359.6
37.5°	678.6	678.6	726.7	806.6	931.0	1147.1	1466.4	1647.2	1622.5	1543.9	1448.8
40°	614.0	621.1	663.3	744.4	875.8	1103.6	1466.4	1725.9	1738.8	1657.8	1559.1
42.5°	567.1	569.4	608.2	684.5	814.8	1047.3	1447.6	1794.0	1832.7	1764.6	1636.6
45°	517.8	523.6	556.5	626.9	751.4	980.3	1414.7	1870.3	1932.5	1885.5	1717.6
47.5°	457.9	463.8	501.3	572.9	691.5	907.5	1359.6	1950.1	2080.4	2046.4	1862.1
50°	388.6	393.3	428.5	504.8	624.6	824.2	1290.3	2010.0	2228.4	2262.4	2080.4
52.5°	304.1	307.6	345.2	419.1	544.8	744.4	1192.8	2046.4	2377.5	2497.2	2372.8
55°	218.4	224.2	257.1	318.2	439.1	637.5	1076.6	2065.2	2540.7	2775.5	2735.5
57.5°	157.3	159.7	182.0	228.9	326.4	511.9	927.5	2033.5	2687.4	3107.7	3191.1
60°	130.3	130.3	133.8	156.1	223.1	361.6	749.0	1916.1	2813.0	3443.5	3700.6
62.5°	119.8	119.8	122.1	125.6	146.8	234.8	535.4	1677.7	2827.1	3766.4	4259.5
65°	109.2	109.2	111.5	113.9	118.6	152.6	322.9	1228.1	2551.2	3769.9	4560.0
67.5°	99.8	99.8	101.0	102.1	104.5	111.5	177.3	744.4	2041.7	3670.1	4675.1
70°	90.4	90.4	90.4	89.2	92.8	93.9	117.4	378.0	1365.4	3314.4	4619.9
72.5°	*79.8*	*79.8*	*78.7*	*76.3*	*77.5*	*77.5*	*86.9*	*185.5*	*709.1*	*2634.6*	*4171.4*
75°	68.1	69.3	64.6	62.2	61.1	62.2	69.3	105.7	317.0	1597.9	3117.1
77.5°	57.5	59.9	52.8	48.1	47.0	47.0	54.0	65.7	136.2	580.0	1397.1
80°	43.4	44.6	38.7	34.0	34.0	32.9	39.9	48.1	64.6	172.6	313.5
82.5°	24.7	24.7	22.3	20.0	18.8	20.0	27.0	32.9	39.9	61.1	85.7
85°	5.9	5.9	7.0	8.2	8.2	10.6	15.3	17.6	21.1	24.7	32.9
87.5°	1.2	1.2	1.2	2.3	3.5	3.5	5.9	8.2	10.6	12.9	14.1
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360784
CATALOG NUMBER: GSS-SB1B-750-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	1056.6	1056.6	*1056.6*
2.5°	1059.0	1060.2	*1059.0*
5°	1066.0	1063.7	*1060.2*
7.5°	1067.2	1068.4	*1069.6*
10°	1071.9	1076.6	*1069.6*
12.5°	1076.6	1073.1	*1070.7*
15°	1080.1	1079.0	*1071.9*
17.5°	1093.0	1088.3	*1087.2*
20°	1113.0	1111.8	*1108.3*
22.5°	1136.5	1134.1	*1133.0*
25°	1170.5	1162.3	*1157.6*
27.5°	1198.7	1191.7	*1189.3*
30°	1226.9	1212.8	*1212.8*
32.5°	1251.5	1248.0	*1245.7*
35°	1310.2	1292.6	*1295.0*
37.5°	1381.9	1364.3	*1349.0*
40°	1482.8	1459.4	*1450.0*
42.5°	1547.4	1523.9	*1526.3*
45°	1583.8	1542.7	*1532.1*
47.5°	1682.4	1630.8	*1616.7*
50°	1842.1	1778.7	*1761.1*
52.5°	2100.4	1998.2	*1974.8*
55°	2424.4	2298.8	*2275.3*
57.5°	2868.2	2701.5	*2651.0*
60°	3408.3	3201.6	*3125.3*
62.5°	4057.5	3802.8	*3730.0*
65°	4545.9	4333.4	*4220.7*
67.5°	4936.9	4762.0	*4708.0*
70°	5169.4	5177.6	*5191.7*
72.5°	*4900.5*	*5125.9*	*5233.9*
75°	3591.4	3766.4	*3934.3*
77.5°	1387.7	1251.5	*1211.6*
80°	224.2	210.2	*217.2*
82.5°	101.0	106.8	*112.7*
85°	65.7	76.3	*81.0*
87.5°	15.3	15.3	*15.3*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-6

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-750-U-5WQ

Data in this report applies to families of products including GSS-SB1A-750-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-750-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 5000K CCT 26 LEDS

Spectral Parameters

CCT (K):	4896
CIE u':	0.2101
CIE v':	0.4901
Duv:	0.0035
CIE x:	0.3489
CIE y:	0.3618
CIE z:	0.2893
Peak Wavelength (nm):	443
Dominant Wavelength (nm):	570
Purity:	13.25435
Rf:	70.7
Rg:	96.8

CRI (Ra):	70.2
R1:	68.1
R2:	73.9
R3:	79.4
R4:	72.1
R5:	69.2
R6:	65.7
R7:	78.1
R8:	55.3
R9:	-35.1
R10:	39.3
R11:	71.1
R12:	43.8
R13:	68.1
R14:	88.4
R15:	59.7

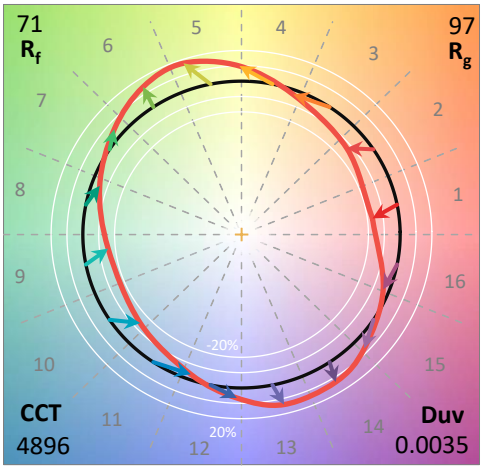

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-6

CIE 1931 Chromaticity Diagram

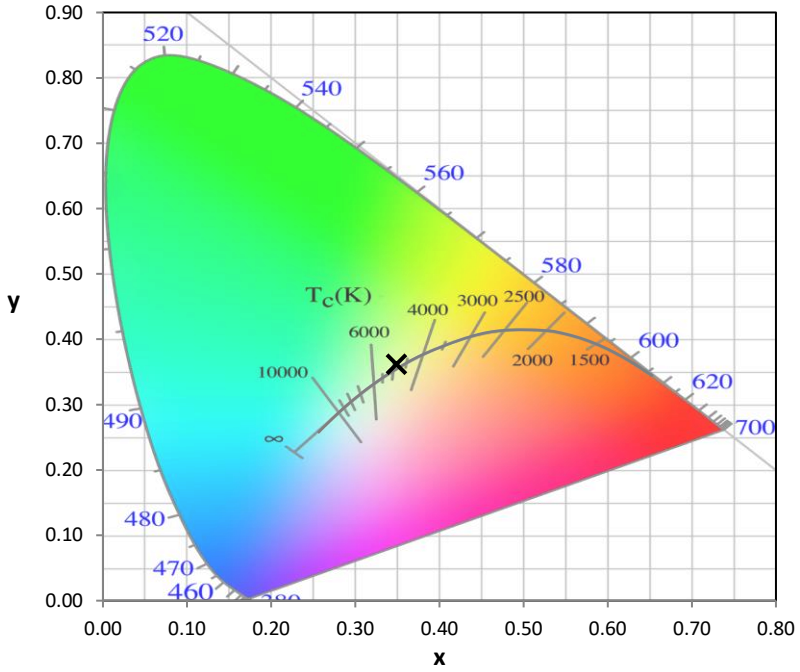

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

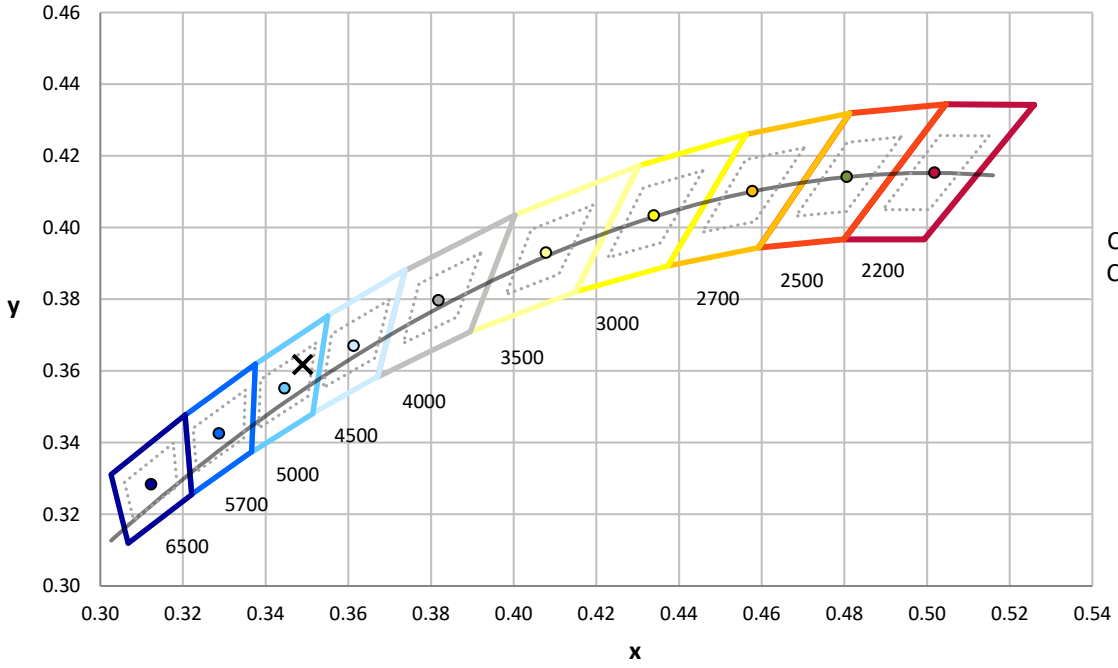


CCT = 4896K
CIE x = 0.3489
CIE y = 0.3618
Duv = 0.0035

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-6

Photopic Flux vs. Wavelength

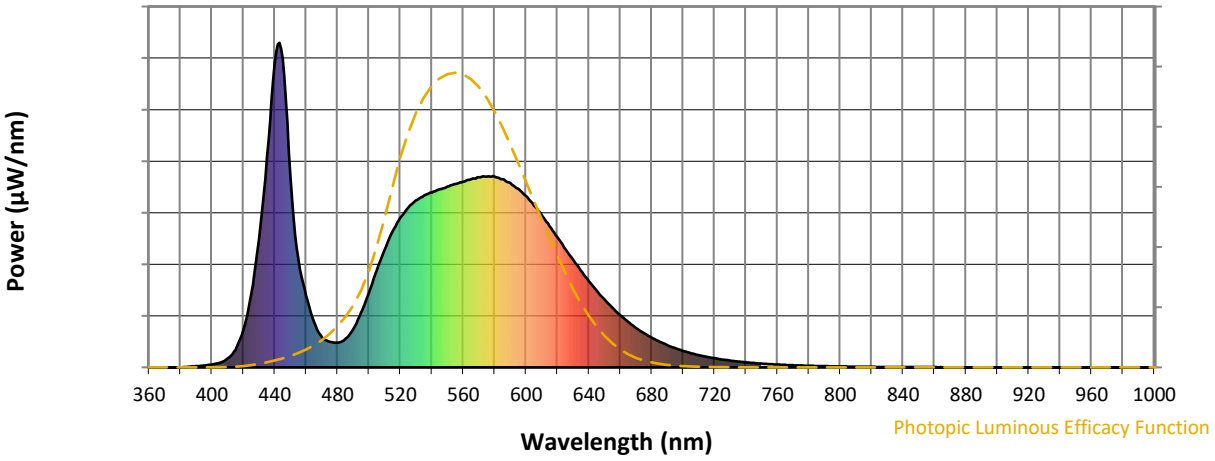


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Scotopic Flux vs. Wavelength

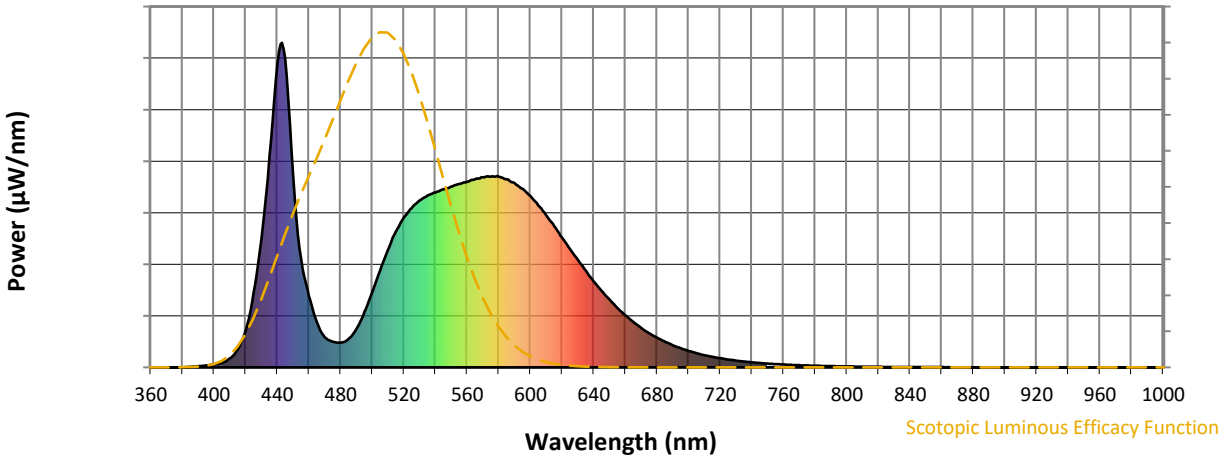


Scotopic Lumens: NR **S/P: 1.7**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Melanopic Flux vs. Wavelength

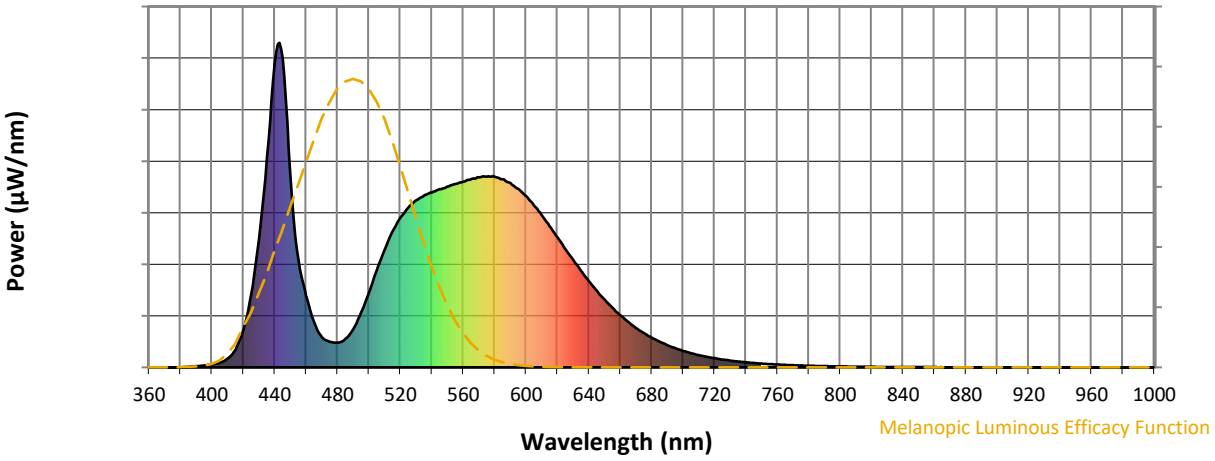

Melanopic Lumens: NR **M/P: 3.37**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			


REPORT NUMBER: SP1-2407-184-6

TM-30-18


Summary


R_f = 70.7
R_g = 96.8
CIE R_a = 70.2
R_9 = -35.1


Spectral Power Distribution Comparison

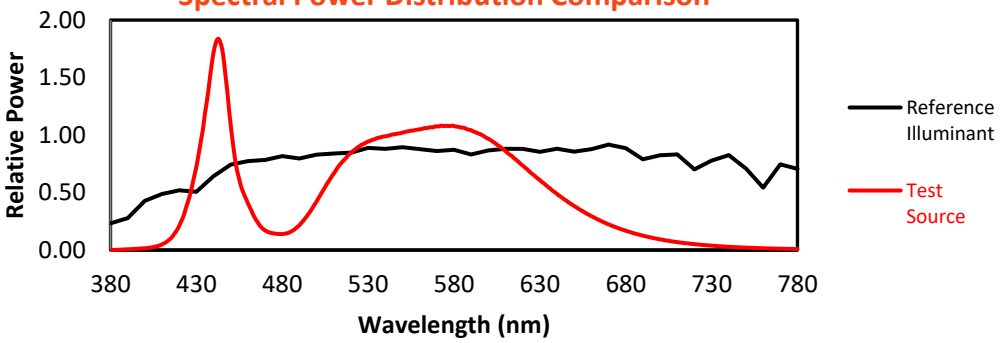


Color Vector Graphics

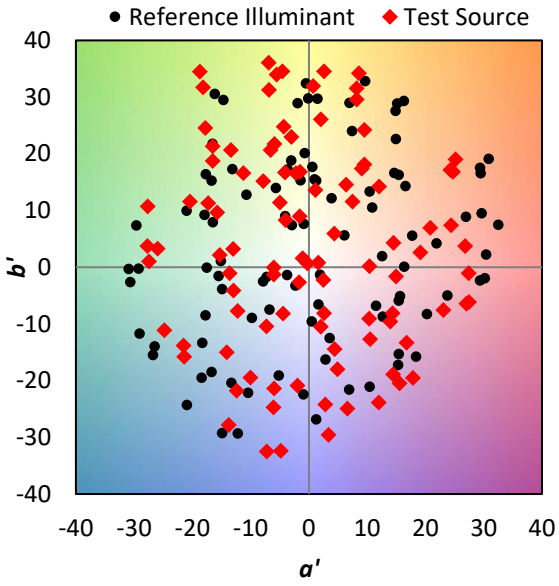

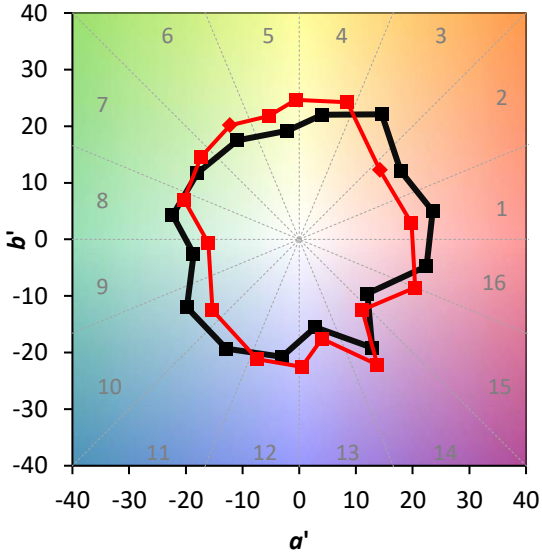

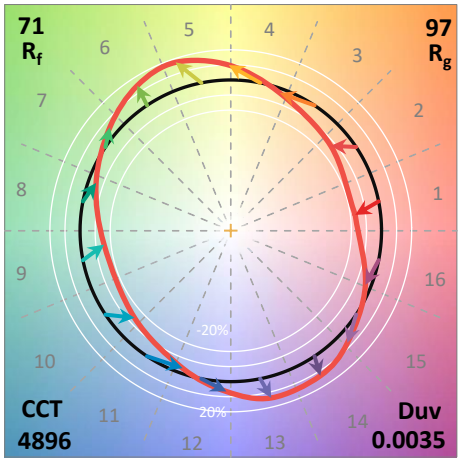

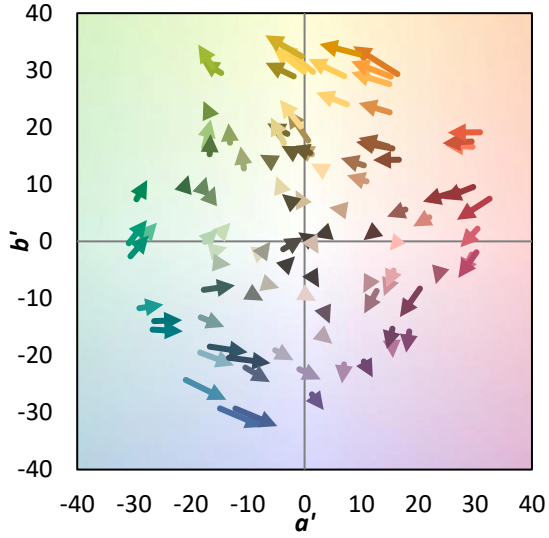


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 53	CES51 = 87	CES76 = 42
CES02 = 59	CES27 = 78	CES52 = 88	CES77 = 64
CES03 = 30	CES28 = 76	CES53 = 74	CES78 = 45
CES04 = 69	CES29 = 48	CES54 = 80	CES79 = 74
CES05 = 46	CES30 = 56	CES55 = 79	CES80 = 71
CES06 = 50	CES31 = 54	CES56 = 68	CES81 = 72
CES07 = 39	CES32 = 50	CES57 = 65	CES82 = 88
CES08 = 38	CES33 = 60	CES58 = 67	CES83 = 82
CES09 = 29	CES34 = 62	CES59 = 87	CES84 = 87
CES10 = 72	CES35 = 79	CES60 = 91	CES85 = 84
CES11 = 56	CES36 = 90	CES61 = 87	CES86 = 74
CES12 = 61	CES37 = 72	CES62 = 79	CES87 = 75
CES13 = 41	CES38 = 66	CES63 = 72	CES88 = 76
CES14 = 74	CES39 = 91	CES64 = 70	CES89 = 74
CES15 = 70	CES40 = 83	CES65 = 63	CES90 = 73
CES16 = 46	CES41 = 83	CES66 = 64	CES91 = 92
CES17 = 49	CES42 = 70	CES67 = 62	CES92 = 67
CES18 = 55	CES43 = 68	CES68 = 69	CES93 = 81
CES19 = 71	CES44 = 98	CES69 = 80	CES94 = 56
CES20 = 64	CES45 = 78	CES70 = 56	CES95 = 71
CES21 = 85	CES46 = 77	CES71 = 53	CES96 = 77
CES22 = 77	CES47 = 73	CES72 = 84	CES97 = 82
CES23 = 91	CES48 = 65	CES73 = 46	CES98 = 71
CES24 = 90	CES49 = 76	CES74 = 94	CES99 = 59
CES25 = 71	CES50 = 85	CES75 = 49	

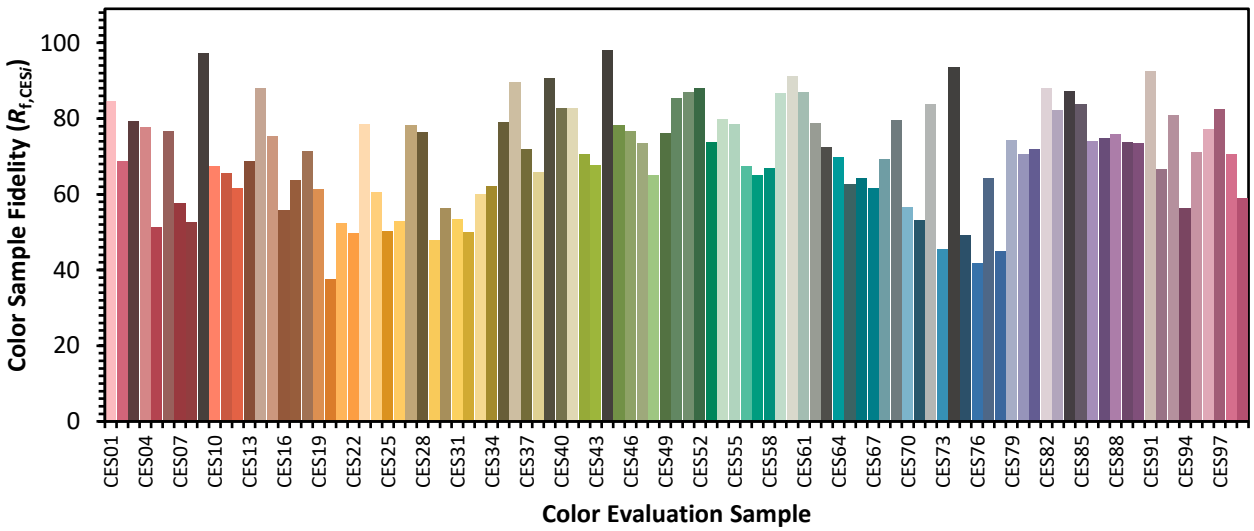



REPORT NUMBER: SP1-2407-184-6

TM-30-18

Color Rendition by Hue-Angle Bin

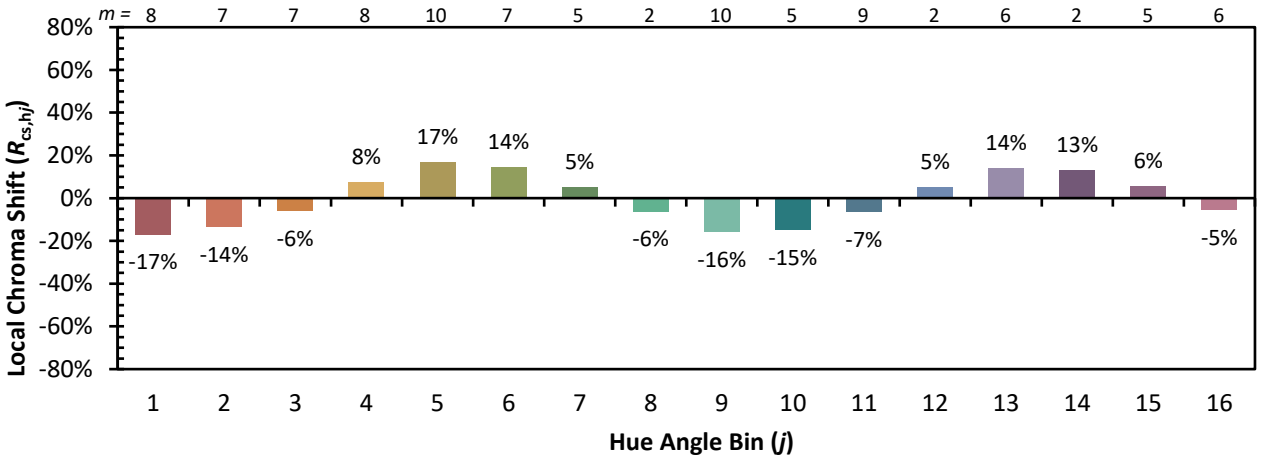

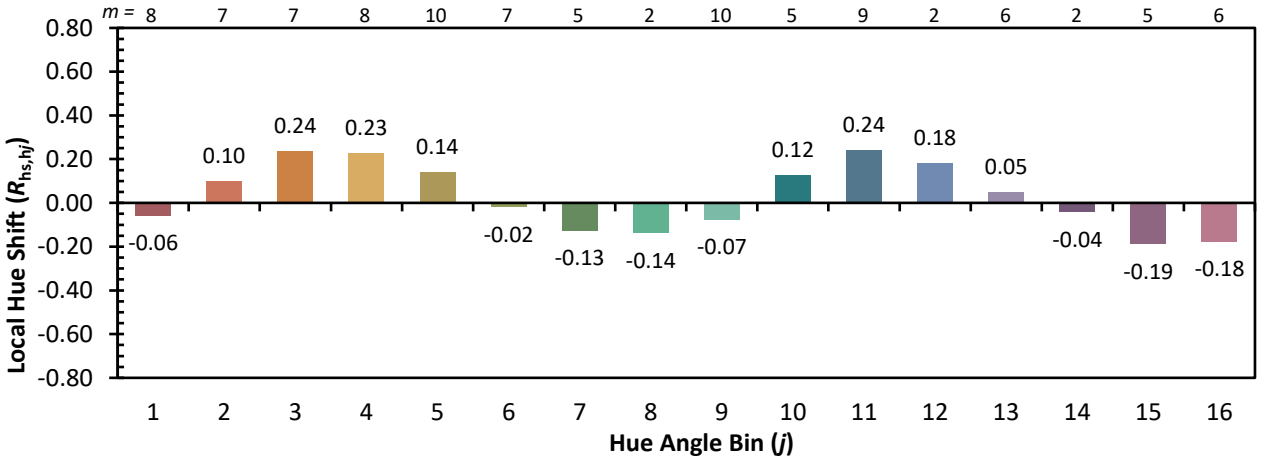


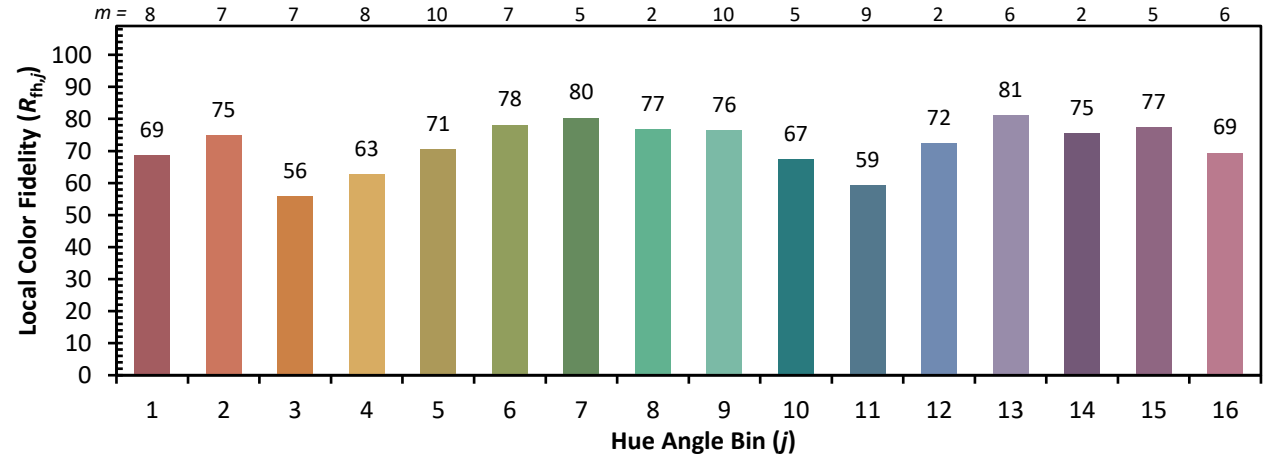


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Measure Comparisons

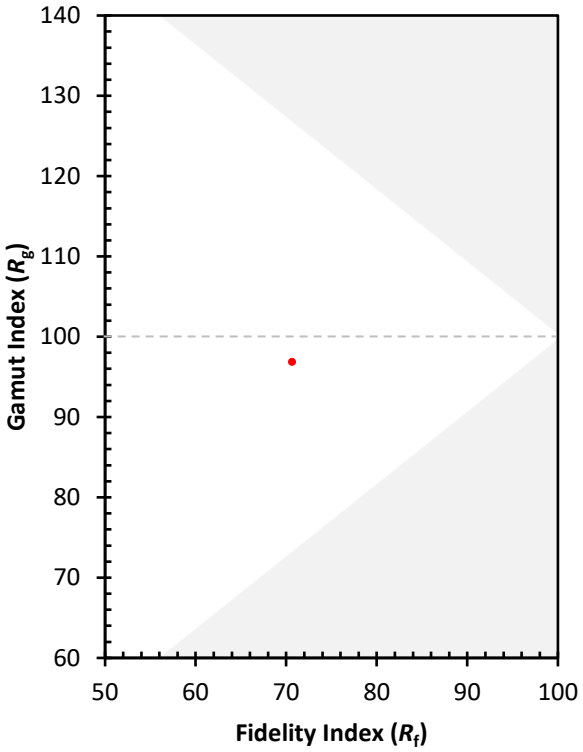

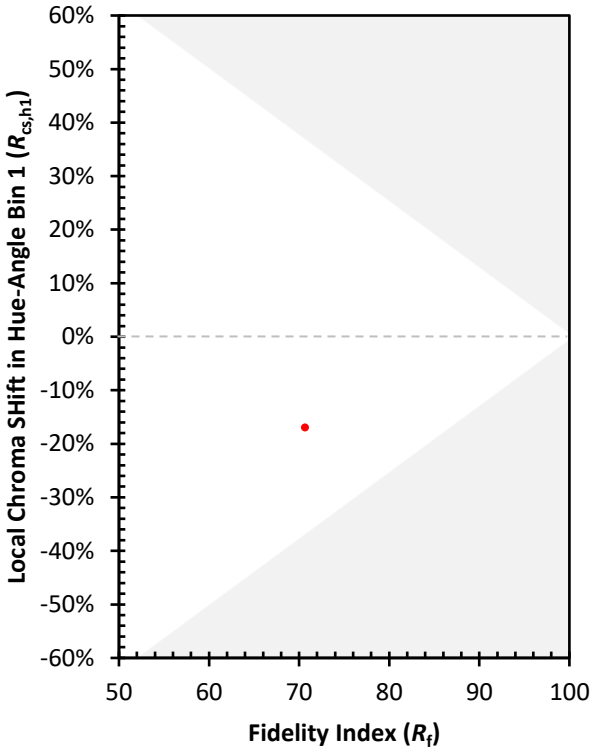

(END OF REPORT)