Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360788

Luminaire Tested: **GSS-SB2B-750-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360788
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB2B-750-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 2SQUARE 74W 70CRI 5000K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(52) 5000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	10950.2 lumens
Efficiency:	N/A
Efficacy:	148.0 lumens/watt
Luminous Opening:	Rectangular (W 1' x L: 0.5' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B3 - U0 - G3


Input Watts (W):	74
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	13.6%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360788
CATALOG NUMBER: GSS-SB2B-750-U-T1

Iso-Footcandle Lines of Horizontal Illumination

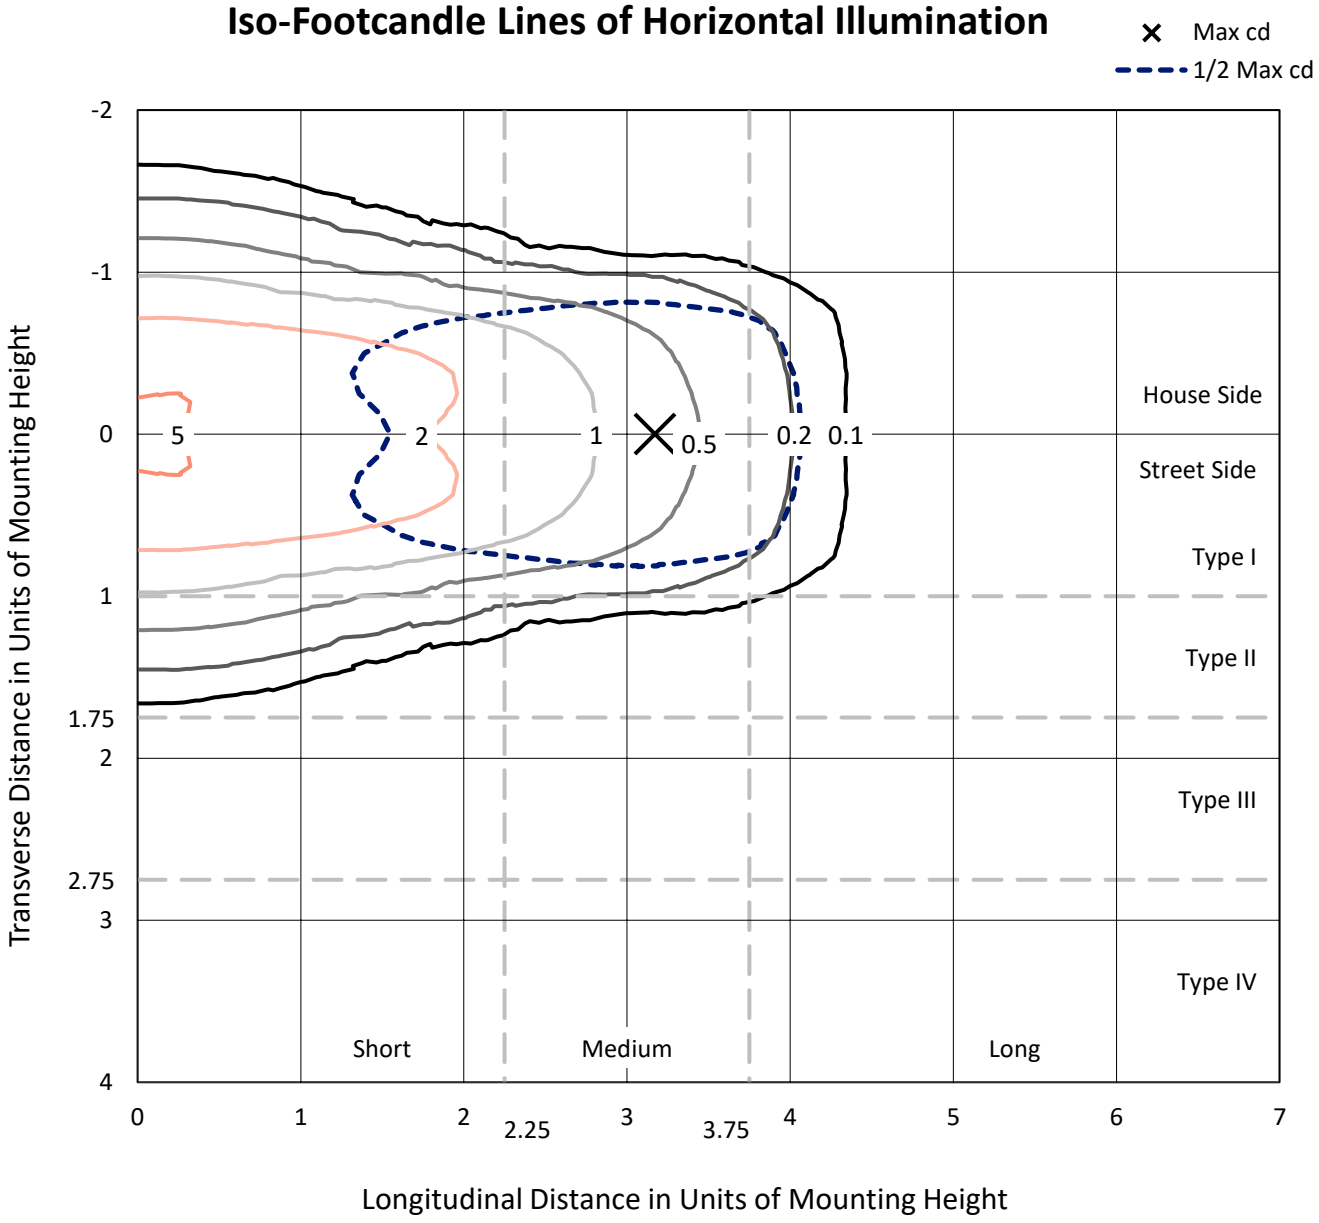


Based on 20 foot mounting height. Maximum calculated value = 5.4 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360788
CATALOG NUMBER: GSS-SB2B-750-U-T1

Luminous Intensity Polar Plot

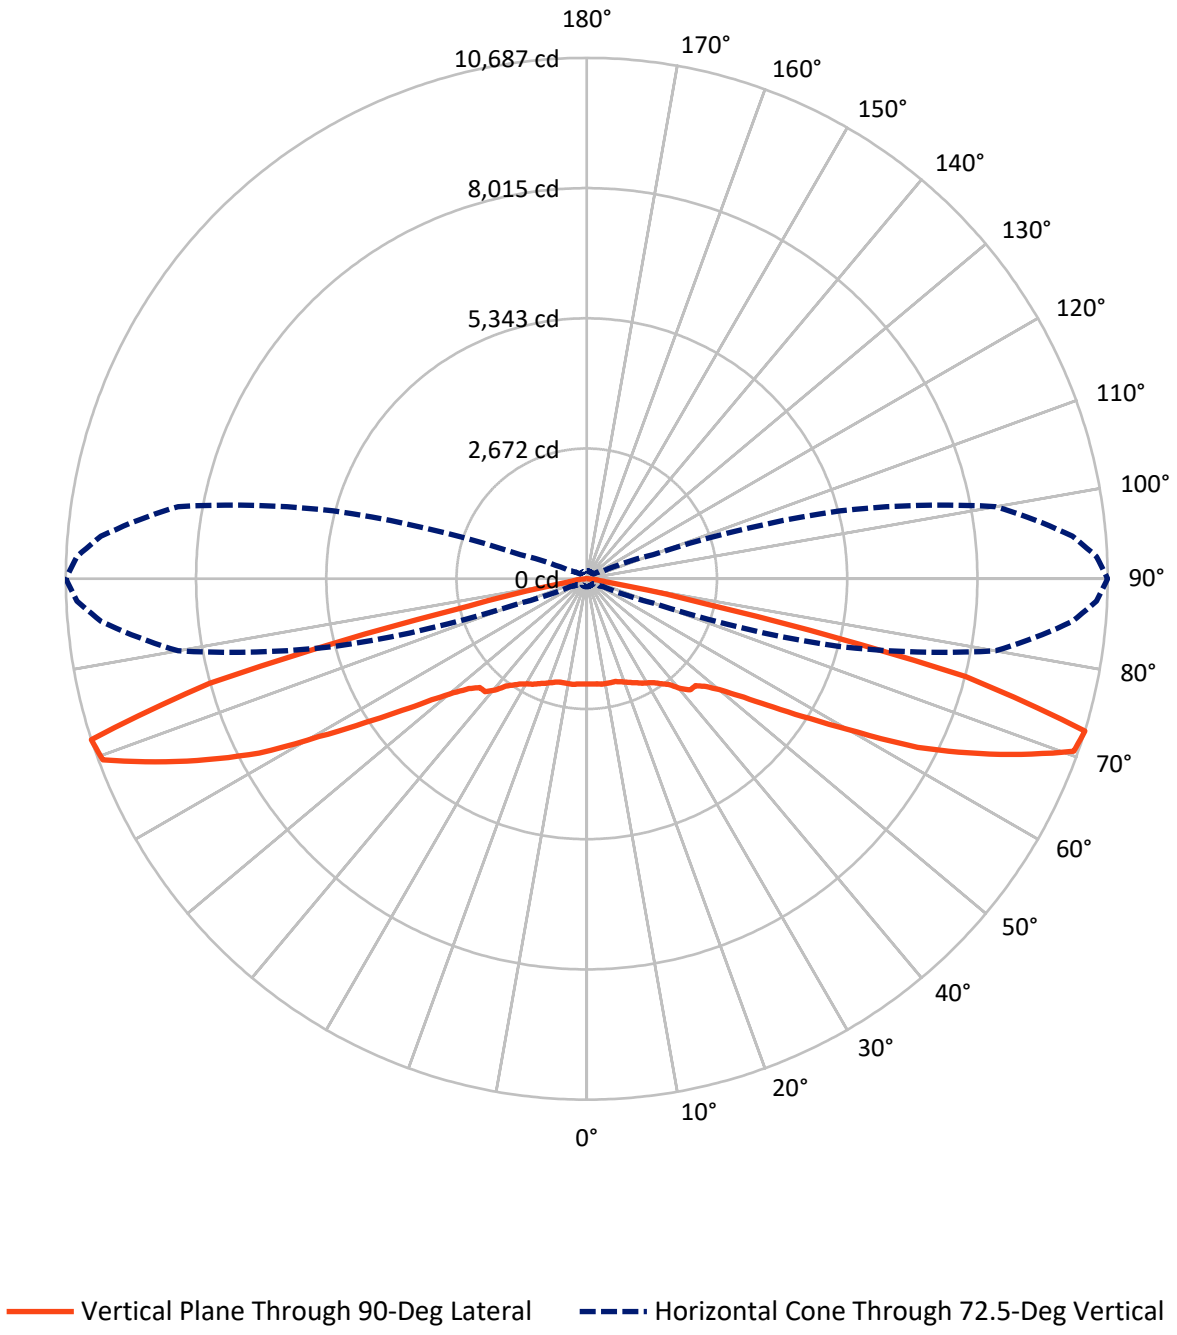

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360788
CATALOG NUMBER: GSS-SB2B-750-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	5475.1	0.0	5475.1
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	5475.1	0.0	5475.1
	% Fixture	50.0	0.0	50.0
Total	Lumens	10950.2	0.0	10950.2
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	208.8	1.9
10°-20°	636.5	5.8
20°-30°	1063.8	9.7
30°-40°	1467.1	13.4
40°-50°	1798.4	16.4
50°-60°	2107.5	19.2
60°-70°	2340.3	21.4
70°-80°	1272.7	11.6
80°-90°	55.2	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	10950.2	100.0
0°-180°	10950.2	100.0

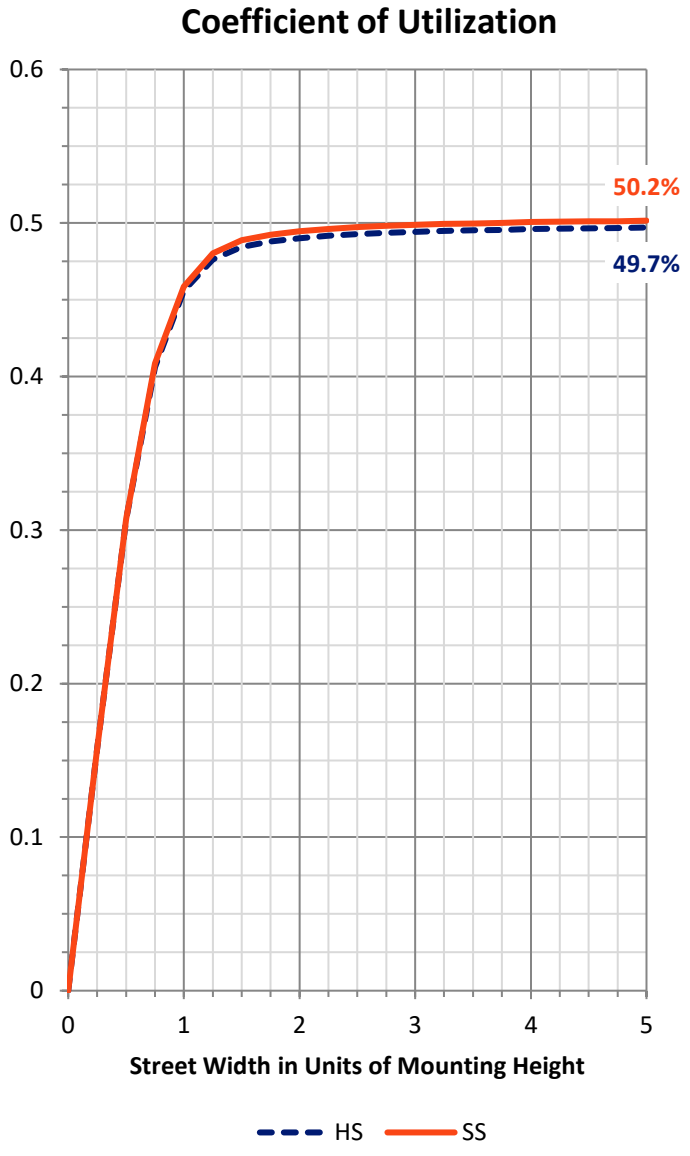

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360788
CATALOG NUMBER: GSS-SB2B-750-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	954.5	8.7			
FM	(30°-60°)	2686.5	24.5			
FH	(60°-80°)	1806.5	16.5			G2/5000
FVH	(80°-90°)	27.6	0.3			G1/100
BL	(0°-30°)	954.5	8.7	B2/1000		
BM	(30°-60°)	2686.5	24.5	B3/5000		
BH	(60°-80°)	1806.5	16.5	B3/2500		G3/2500
BVH	(80°-90°)	27.6	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B3-U0-G3
Type I Short

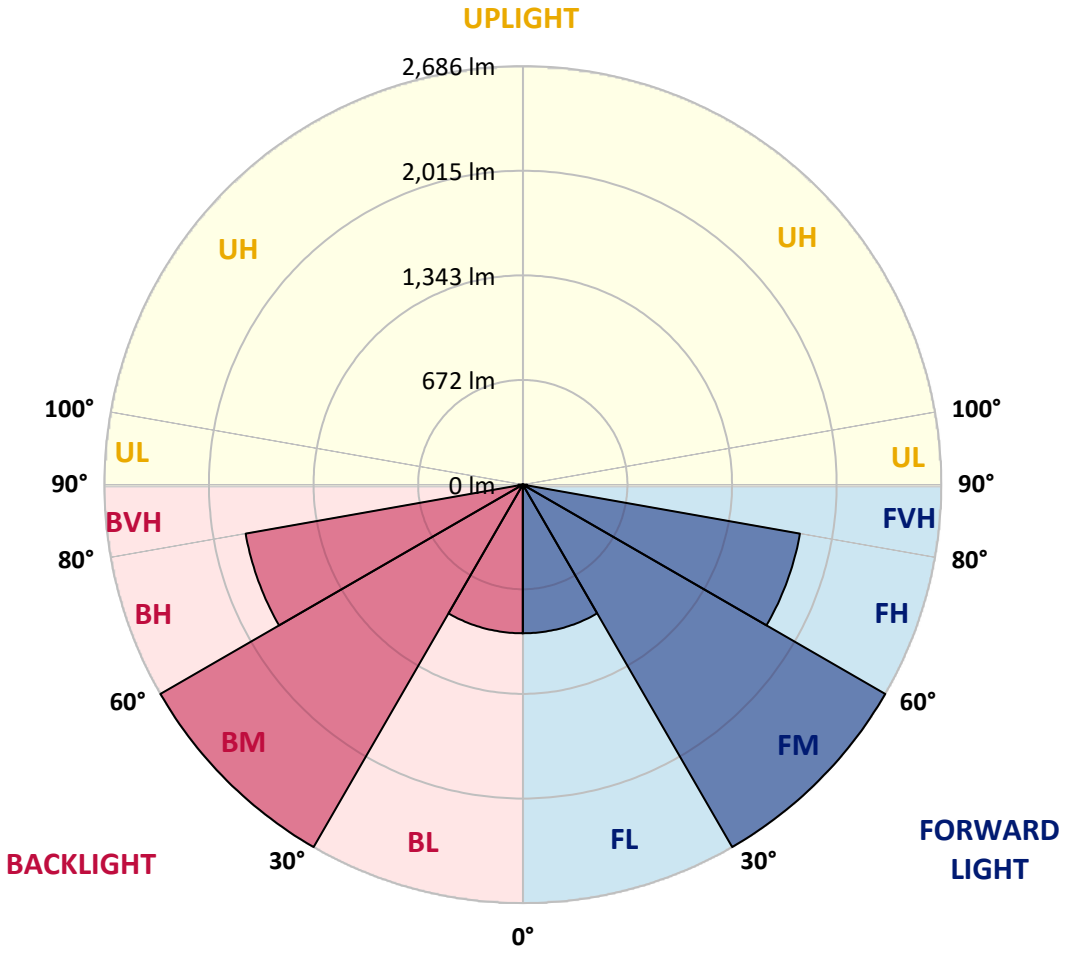

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360788
CATALOG NUMBER: GSS-SB2B-750-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	2157.5	2157.5	2157.5	2157.5	2157.5	2157.5	2157.5	2157.5	2157.5	2157.5	2157.5
2.5°	2159.9	2159.9	2152.7	2162.3	2157.5	2159.9	2162.3	2159.9	2157.5	2159.9	2162.3
5°	2171.8	2167.1	2171.8	2176.6	2169.5	2174.2	2171.8	2159.9	2167.1	2167.1	2167.1
7.5°	2193.4	2198.2	2193.4	2205.4	2198.2	2212.6	2198.2	2188.6	2186.2	2183.8	2183.8
10°	2203.0	2203.0	2200.6	2222.2	2227.0	2241.4	2231.8	2217.4	2210.2	2200.6	2191.0
12.5°	2176.6	2181.4	2193.4	2234.2	2253.4	2282.1	2274.9	2246.2	2224.6	2217.4	2203.0
15°	2147.9	2152.7	2176.6	2227.0	2272.5	2315.7	2313.3	2277.3	2251.0	2231.8	2210.2
17.5°	2102.3	2109.5	2143.1	2219.8	2301.3	2349.2	2363.6	2327.7	2298.9	2267.7	2239.0
20°	2025.6	2025.6	2085.5	2183.8	2296.5	2404.4	2442.7	2414.0	2380.4	2330.1	2291.7
22.5°	1939.3	1944.1	2004.0	2133.5	2294.1	2452.3	2526.6	2495.5	2461.9	2406.8	2349.2
25°	1853.0	1853.0	1920.1	2066.4	2262.9	2485.9	2624.9	2608.1	2541.0	2490.7	2416.4
27.5°	1773.9	1773.9	1845.8	1999.3	2210.2	2495.5	2723.2	2723.2	2648.9	2574.6	2493.1
30°	1680.4	1704.4	1785.9	1946.5	2162.3	2478.7	2795.1	2840.7	2773.5	2677.7	2557.8
32.5°	1601.3	1618.1	1702.0	1872.2	2092.7	2459.5	2876.6	2989.3	2919.8	2787.9	2653.7
35°	1507.8	1505.4	1601.3	1769.1	1994.5	2416.4	2941.3	3166.7	3099.6	2958.1	2775.9
37.5°	1385.6	1385.6	1483.9	1646.9	1901.0	2342.0	2994.1	3363.2	3312.9	3152.3	2958.1
40°	1253.7	1268.1	1354.4	1519.8	1788.3	2253.4	2994.1	3523.9	3550.2	3384.8	3183.5
42.5°	1157.8	1162.6	1241.7	1397.6	1663.6	2138.3	2955.7	3662.9	3742.0	3603.0	3341.7
45°	1057.2	1069.1	1136.3	1280.1	1534.2	2001.6	2888.6	3818.7	3945.8	3849.9	3507.1
47.5°	934.9	946.9	1023.6	1169.8	1411.9	1853.0	2775.9	3981.7	4247.8	4178.3	3801.9
50°	793.5	803.1	875.0	1030.8	1275.3	1682.8	2634.5	4104.0	4549.9	4619.4	4247.8
52.5°	620.9	628.1	704.8	855.8	1112.3	1519.8	2435.5	4178.3	4854.3	5098.8	4844.7
55°	445.9	457.9	525.0	649.6	896.5	1301.7	2198.2	4216.6	5187.5	5666.9	5585.4
57.5°	321.2	326.0	371.6	467.5	666.4	1045.2	1893.8	4151.9	5487.2	6345.3	6515.5
60°	266.1	266.1	273.3	318.8	455.5	738.3	1529.4	3912.2	5743.7	7030.9	7555.9
62.5°	244.5	244.5	249.3	256.5	299.6	479.4	1093.1	3425.6	5772.4	7690.2	8697.0
65°	222.9	222.9	227.7	232.5	242.1	311.6	659.2	2507.5	5209.1	7697.4	9310.7
67.5°	203.8	203.8	206.2	208.6	213.3	227.7	362.0	1519.8	4168.7	7493.6	9545.6
70°	184.6	184.6	184.6	182.2	189.4	191.8	239.7	771.9	2787.9	6767.2	9432.9
72.5°	*163.0*	*163.0*	*160.6*	*155.8*	*158.2*	*158.2*	*177.4*	*378.8*	*1447.9*	*5379.3*	*8517.2*
75°	139.0	141.4	131.8	127.1	124.7	127.1	141.4	215.7	647.2	3262.6	6364.5
77.5°	117.5	122.3	107.9	98.3	95.9	95.9	110.3	134.2	278.1	1184.2	2852.6
80°	88.7	91.1	79.1	69.5	69.5	67.1	81.5	98.3	131.8	352.4	640.0
82.5°	50.3	50.3	45.5	40.8	38.4	40.8	55.1	67.1	81.5	124.7	175.0
85°	12.0	12.0	14.4	16.8	16.8	21.6	31.2	36.0	43.1	50.3	67.1
87.5°	2.4	2.4	2.4	4.8	7.2	7.2	12.0	16.8	21.6	26.4	28.8
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360788
CATALOG NUMBER: GSS-SB2B-750-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	2157.5	2157.5	*2157.5*
2.5°	2162.3	2164.7	*2162.3*
5°	2176.6	2171.8	*2164.7*
7.5°	2179.0	2181.4	*2183.8*
10°	2188.6	2198.2	*2183.8*
12.5°	2198.2	2191.0	*2186.2*
15°	2205.4	2203.0	*2188.6*
17.5°	2231.8	2222.2	*2219.8*
20°	2272.5	2270.1	*2262.9*
22.5°	2320.5	2315.7	*2313.3*
25°	2390.0	2373.2	*2363.6*
27.5°	2447.5	2433.1	*2428.3*
30°	2505.1	2476.3	*2476.3*
32.5°	2555.4	2548.2	*2543.4*
35°	2675.3	2639.3	*2644.1*
37.5°	2821.5	2785.5	*2754.4*
40°	3027.6	2979.7	*2960.5*
42.5°	3159.5	3111.5	*3116.3*
45°	3233.8	3149.9	*3128.3*
47.5°	3435.2	3329.7	*3300.9*
50°	3761.2	3631.7	*3595.8*
52.5°	4288.6	4080.0	*4032.1*
55°	4950.2	4693.7	*4645.7*
57.5°	5856.3	5515.9	*5412.8*
60°	6959.0	6537.1	*6381.3*
62.5°	8284.7	7764.5	*7615.9*
65°	9281.9	8848.0	*8617.9*
67.5°	10080.2	9723.0	*9612.7*
70°	10554.8	10571.6	*10600.3*
72.5°	*10005.8*	*10466.1*	*10686.6*
75°	7333.0	7690.2	*8033.0*
77.5°	2833.5	2555.4	*2473.9*
80°	457.9	429.1	*443.5*
82.5°	206.2	218.1	*230.1*
85°	134.2	155.8	*165.4*
87.5°	31.2	31.2	*31.2*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-6

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-750-U-5WQ

Data in this report applies to families of products including GSS-SB1A-750-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-750-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 5000K CCT 26 LEDS

Spectral Parameters

CCT (K):	4896
CIE u':	0.2101
CIE v':	0.4901
Duv:	0.0035
CIE x:	0.3489
CIE y:	0.3618
CIE z:	0.2893
Peak Wavelength (nm):	443
Dominant Wavelength (nm):	570
Purity:	13.25435
Rf:	70.7
Rg:	96.8

CRI (Ra):	70.2
R1:	68.1
R2:	73.9
R3:	79.4
R4:	72.1
R5:	69.2
R6:	65.7
R7:	78.1
R8:	55.3
R9:	-35.1
R10:	39.3
R11:	71.1
R12:	43.8
R13:	68.1
R14:	88.4
R15:	59.7

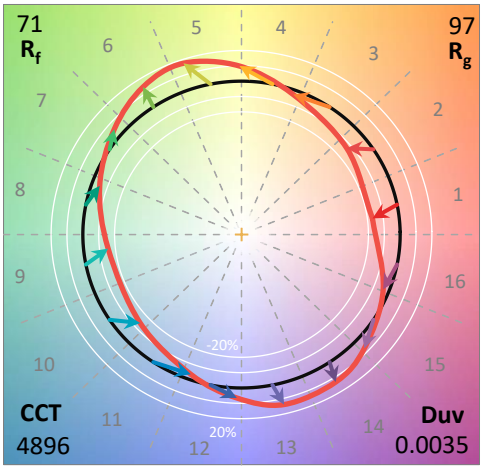

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-6

CIE 1931 Chromaticity Diagram

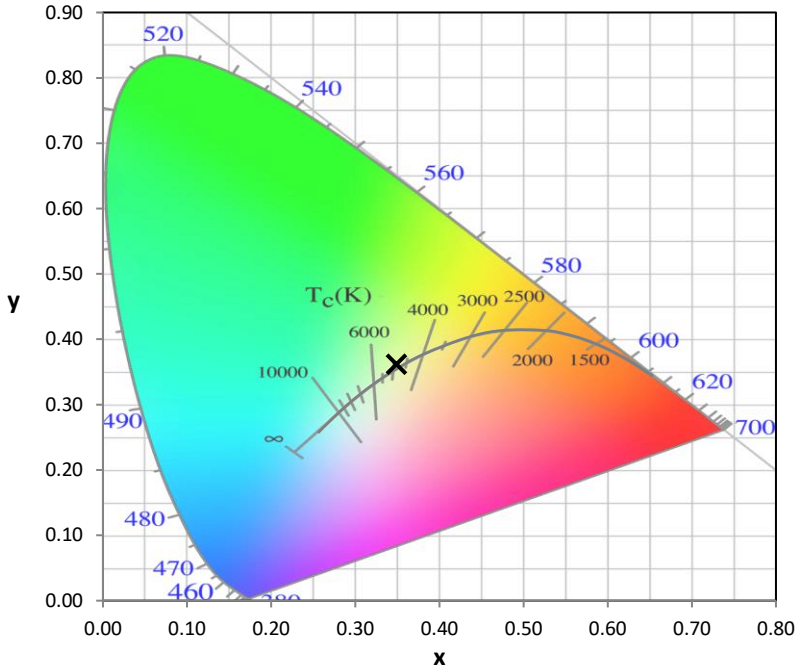

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

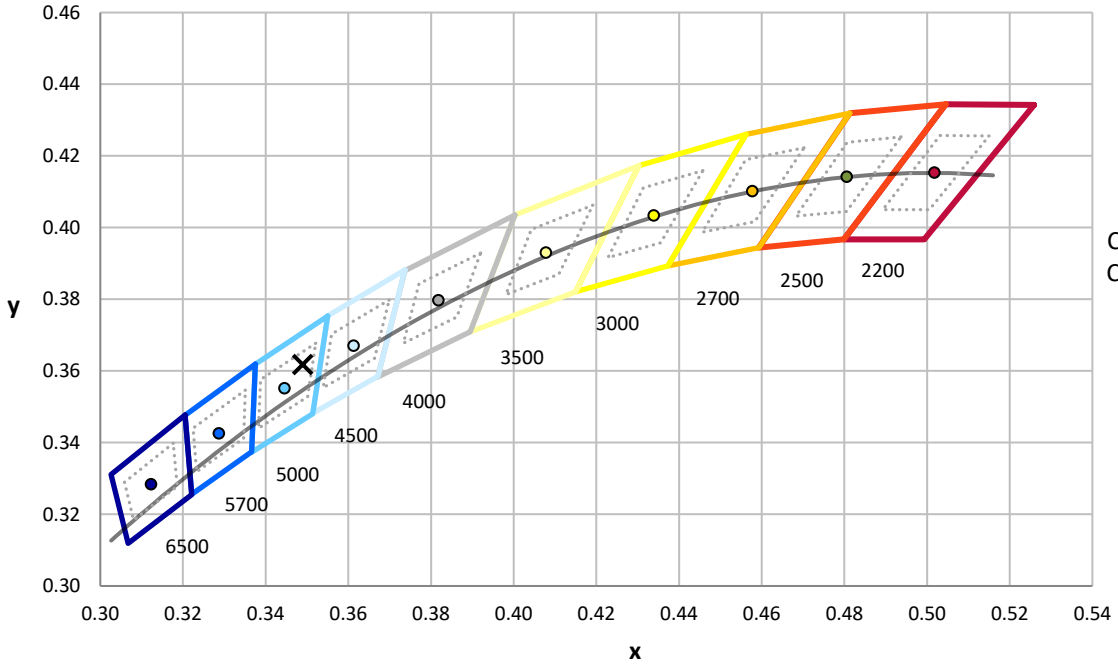


CCT = 4896K
CIE x = 0.3489
CIE y = 0.3618
Duv = 0.0035

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-6

Photopic Flux vs. Wavelength

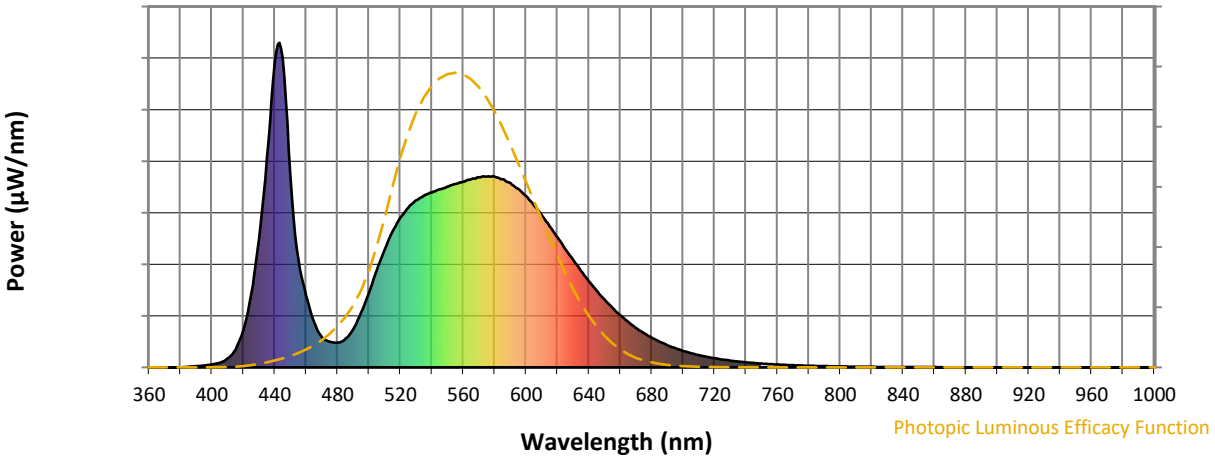


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Scotopic Flux vs. Wavelength

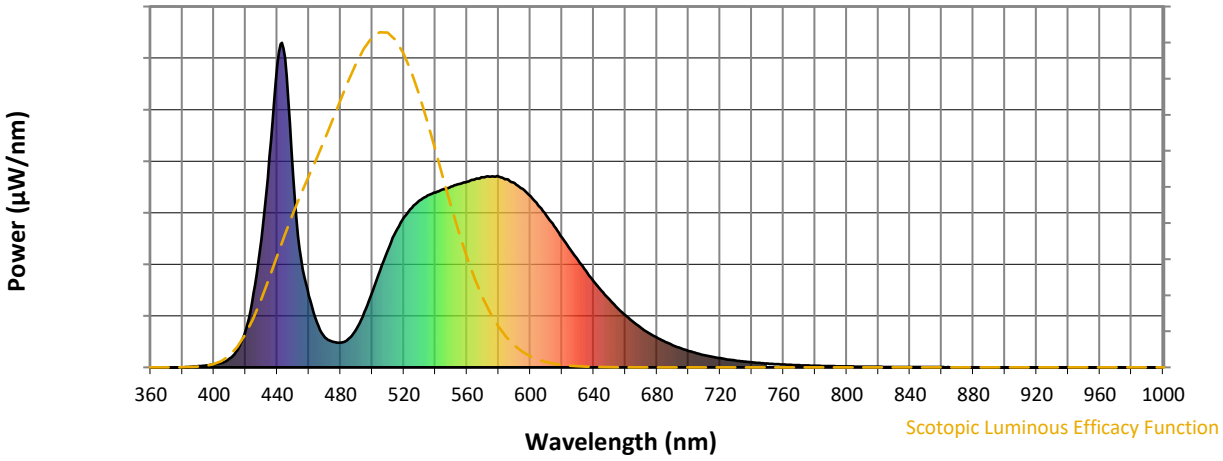


Scotopic Lumens: NR **S/P: 1.7**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Melanopic Flux vs. Wavelength

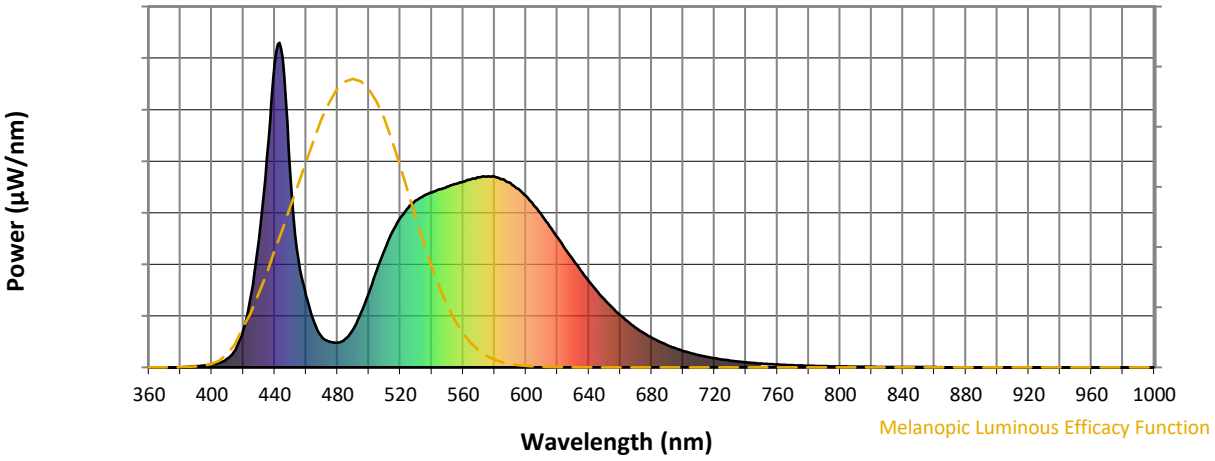

Melanopic Lumens: NR **M/P: 3.37**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			


REPORT NUMBER: SP1-2407-184-6

TM-30-18


Summary


R_f = 70.7
R_g = 96.8
CIE R_a = 70.2
R_9 = -35.1


Spectral Power Distribution Comparison

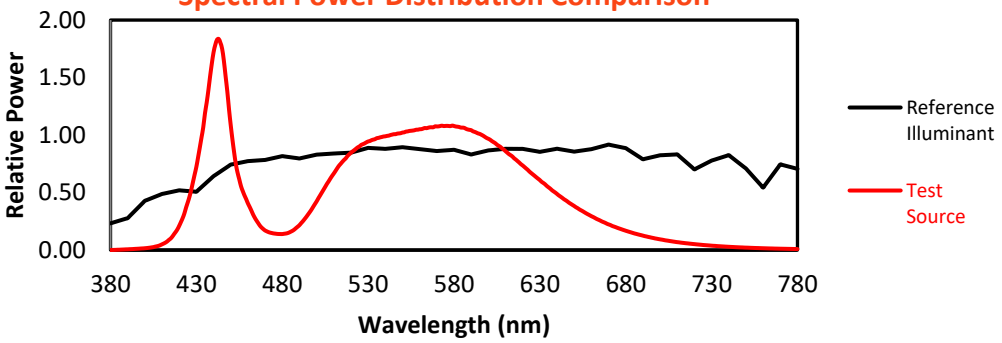


Color Vector Graphics

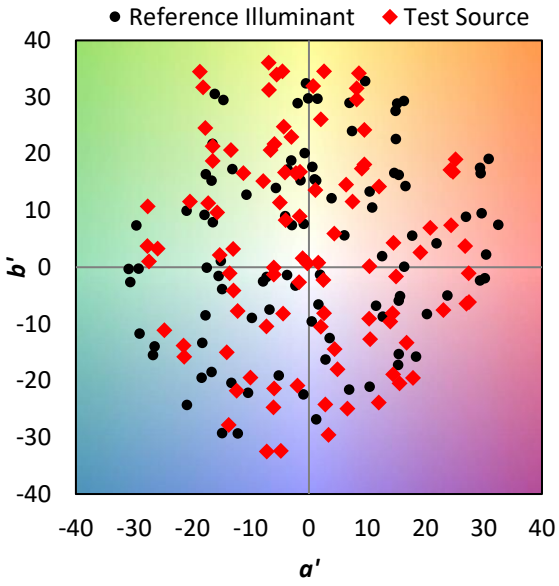

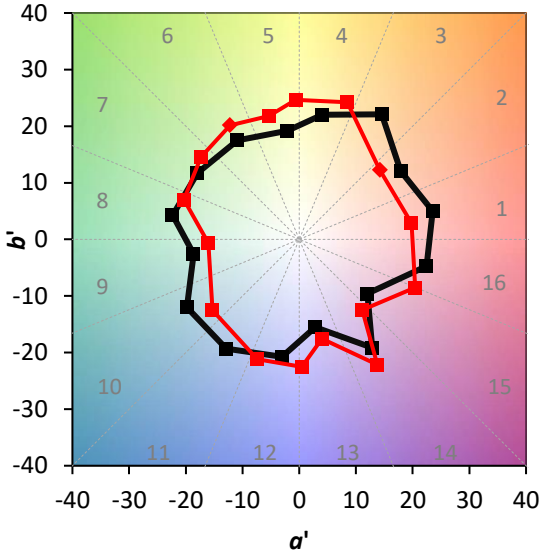

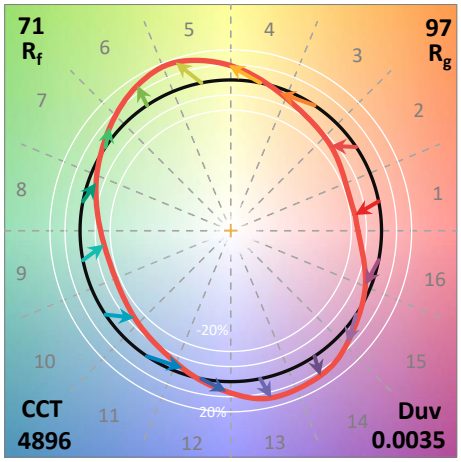

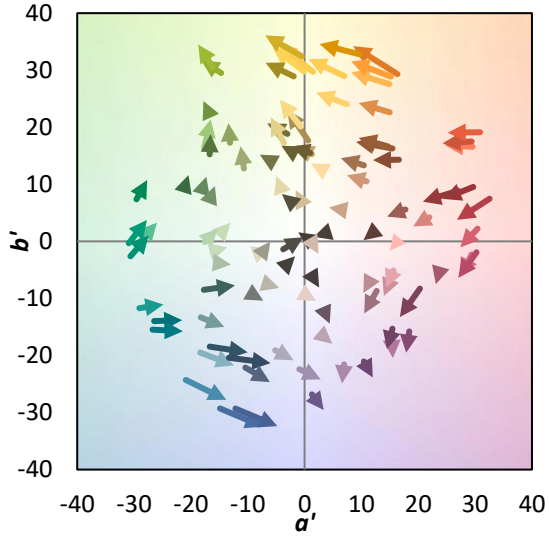


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 53	CES51 = 87	CES76 = 42
CES02 = 59	CES27 = 78	CES52 = 88	CES77 = 64
CES03 = 30	CES28 = 76	CES53 = 74	CES78 = 45
CES04 = 69	CES29 = 48	CES54 = 80	CES79 = 74
CES05 = 46	CES30 = 56	CES55 = 79	CES80 = 71
CES06 = 50	CES31 = 54	CES56 = 68	CES81 = 72
CES07 = 39	CES32 = 50	CES57 = 65	CES82 = 88
CES08 = 38	CES33 = 60	CES58 = 67	CES83 = 82
CES09 = 29	CES34 = 62	CES59 = 87	CES84 = 87
CES10 = 72	CES35 = 79	CES60 = 91	CES85 = 84
CES11 = 56	CES36 = 90	CES61 = 87	CES86 = 74
CES12 = 61	CES37 = 72	CES62 = 79	CES87 = 75
CES13 = 41	CES38 = 66	CES63 = 72	CES88 = 76
CES14 = 74	CES39 = 91	CES64 = 70	CES89 = 74
CES15 = 70	CES40 = 83	CES65 = 63	CES90 = 73
CES16 = 46	CES41 = 83	CES66 = 64	CES91 = 92
CES17 = 49	CES42 = 70	CES67 = 62	CES92 = 67
CES18 = 55	CES43 = 68	CES68 = 69	CES93 = 81
CES19 = 71	CES44 = 98	CES69 = 80	CES94 = 56
CES20 = 64	CES45 = 78	CES70 = 56	CES95 = 71
CES21 = 85	CES46 = 77	CES71 = 53	CES96 = 77
CES22 = 77	CES47 = 73	CES72 = 84	CES97 = 82
CES23 = 91	CES48 = 65	CES73 = 46	CES98 = 71
CES24 = 90	CES49 = 76	CES74 = 94	CES99 = 59
CES25 = 71	CES50 = 85	CES75 = 49	

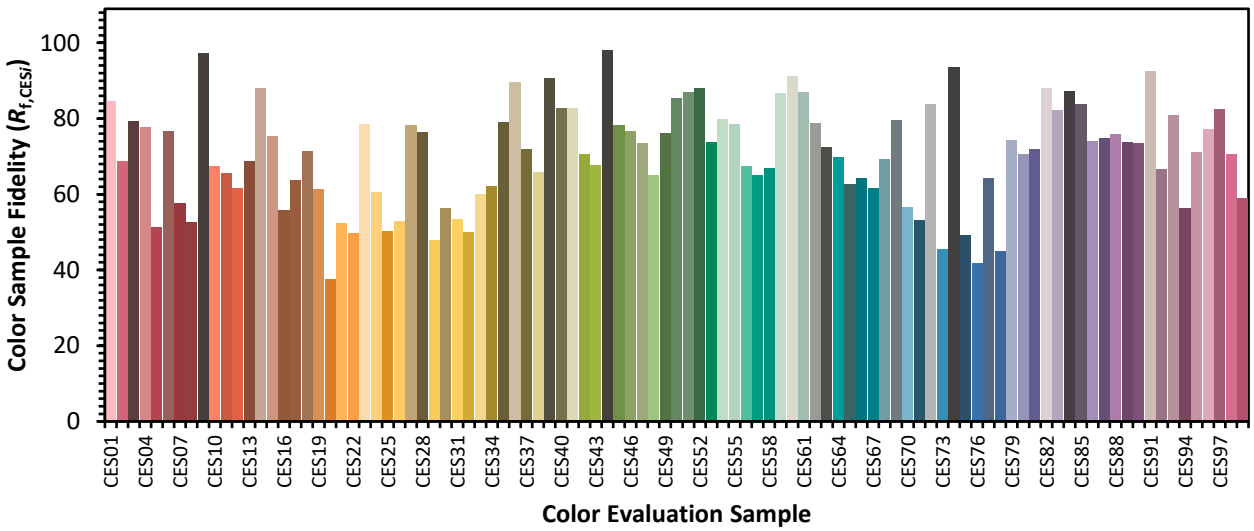



REPORT NUMBER: SP1-2407-184-6

TM-30-18

Color Rendition by Hue-Angle Bin

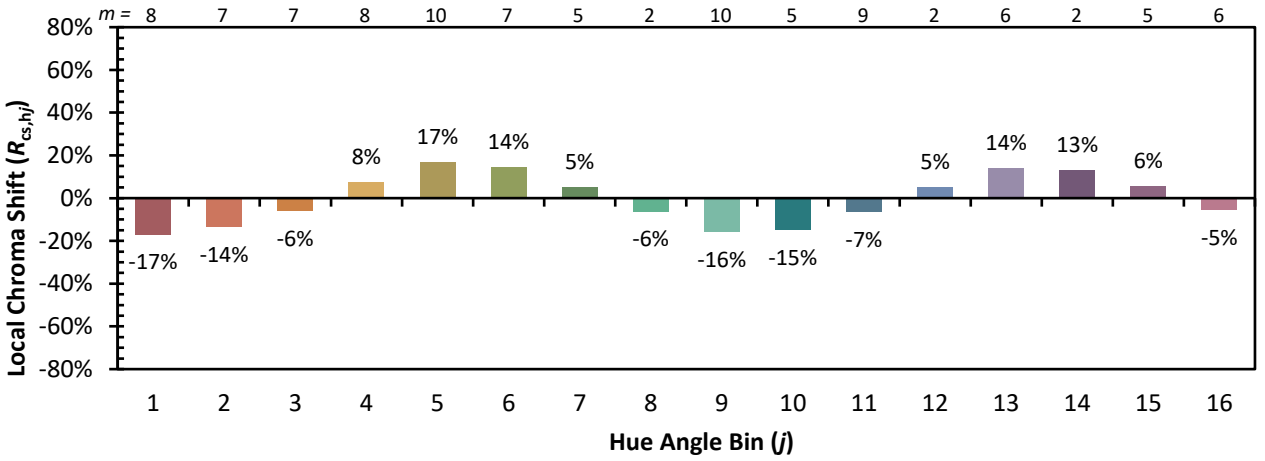

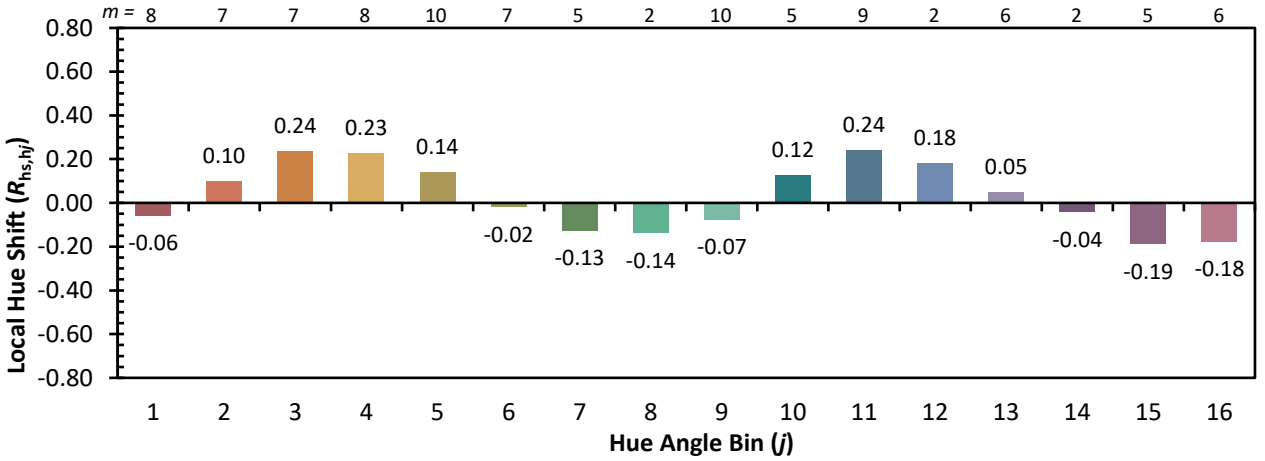


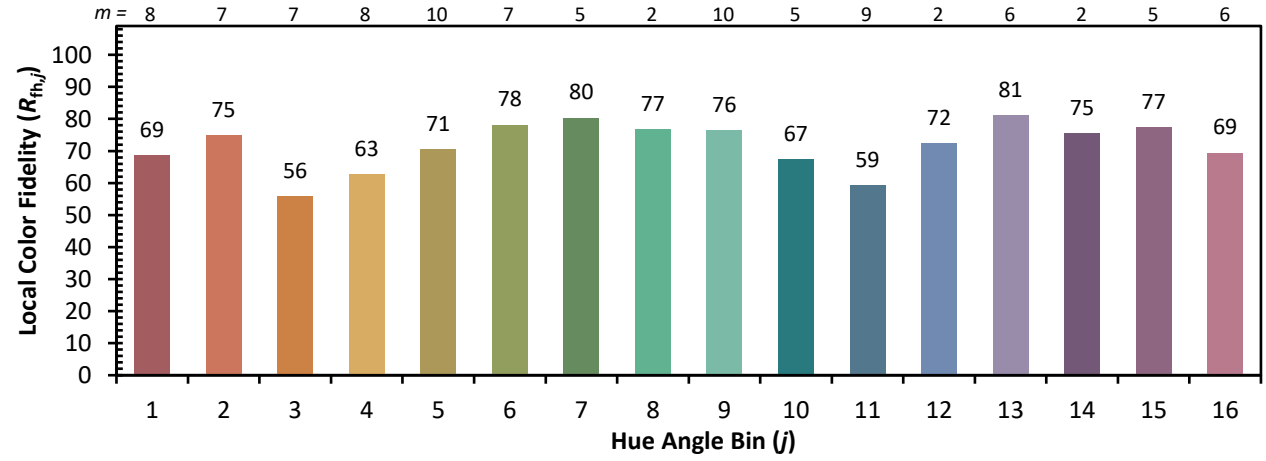


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Measure Comparisons

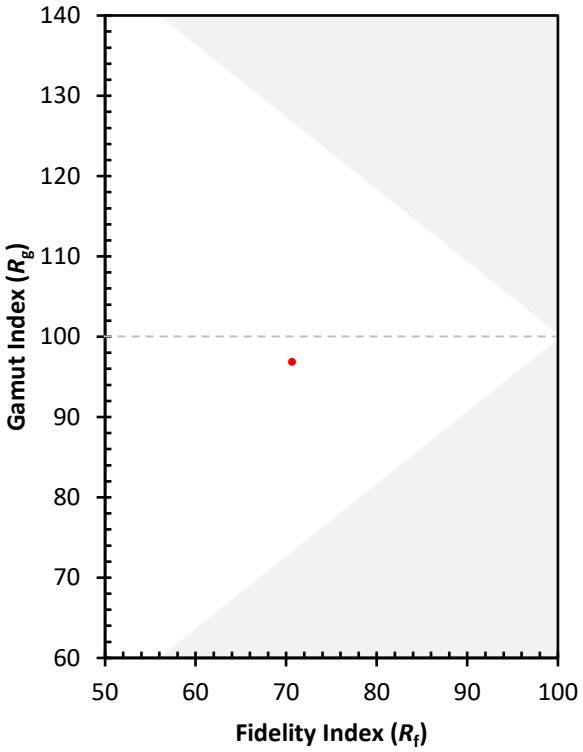

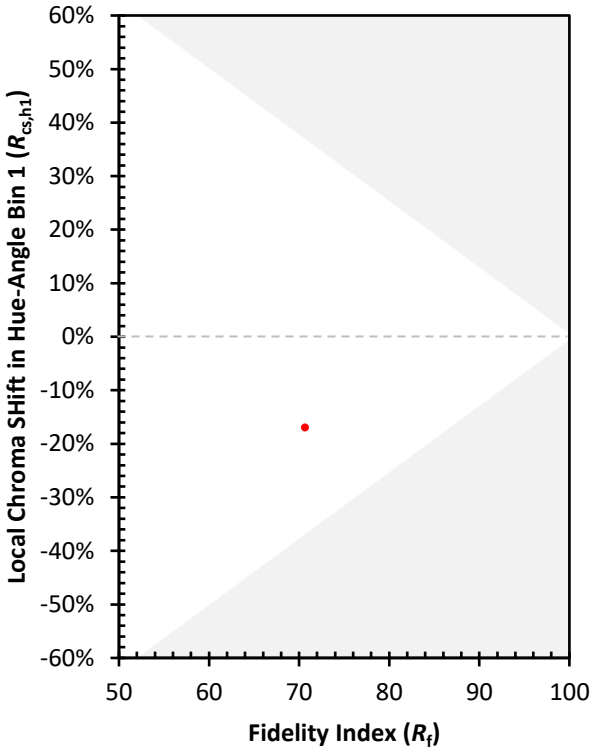

(END OF REPORT)