Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1358104

Luminaire Tested: **GSS-SB3B-750-U-T4FT-HSS**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1358104
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB3B-750-U-T4FT-HSS
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 3SQUARE 109W 70CRI 5000K FIXTURE w/ TYPE IV FORWARD THROW DISTRIBUTION OPTIC AND HOUSE SIDE SHIELD
Light Source:	(78) 5000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	11568 lumens
Efficiency:	N/A
Efficacy:	106.1 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 0.5' x H: 0')
IES Classification:	Type IV - Short
BUG Rating:	B1 - U0 - G2


Input Watts (W):	109
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	8.7%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358104
CATALOG NUMBER: GSS-SB3B-750-U-T4FT-HSS

Iso-Footcandle Lines of Horizontal Illumination

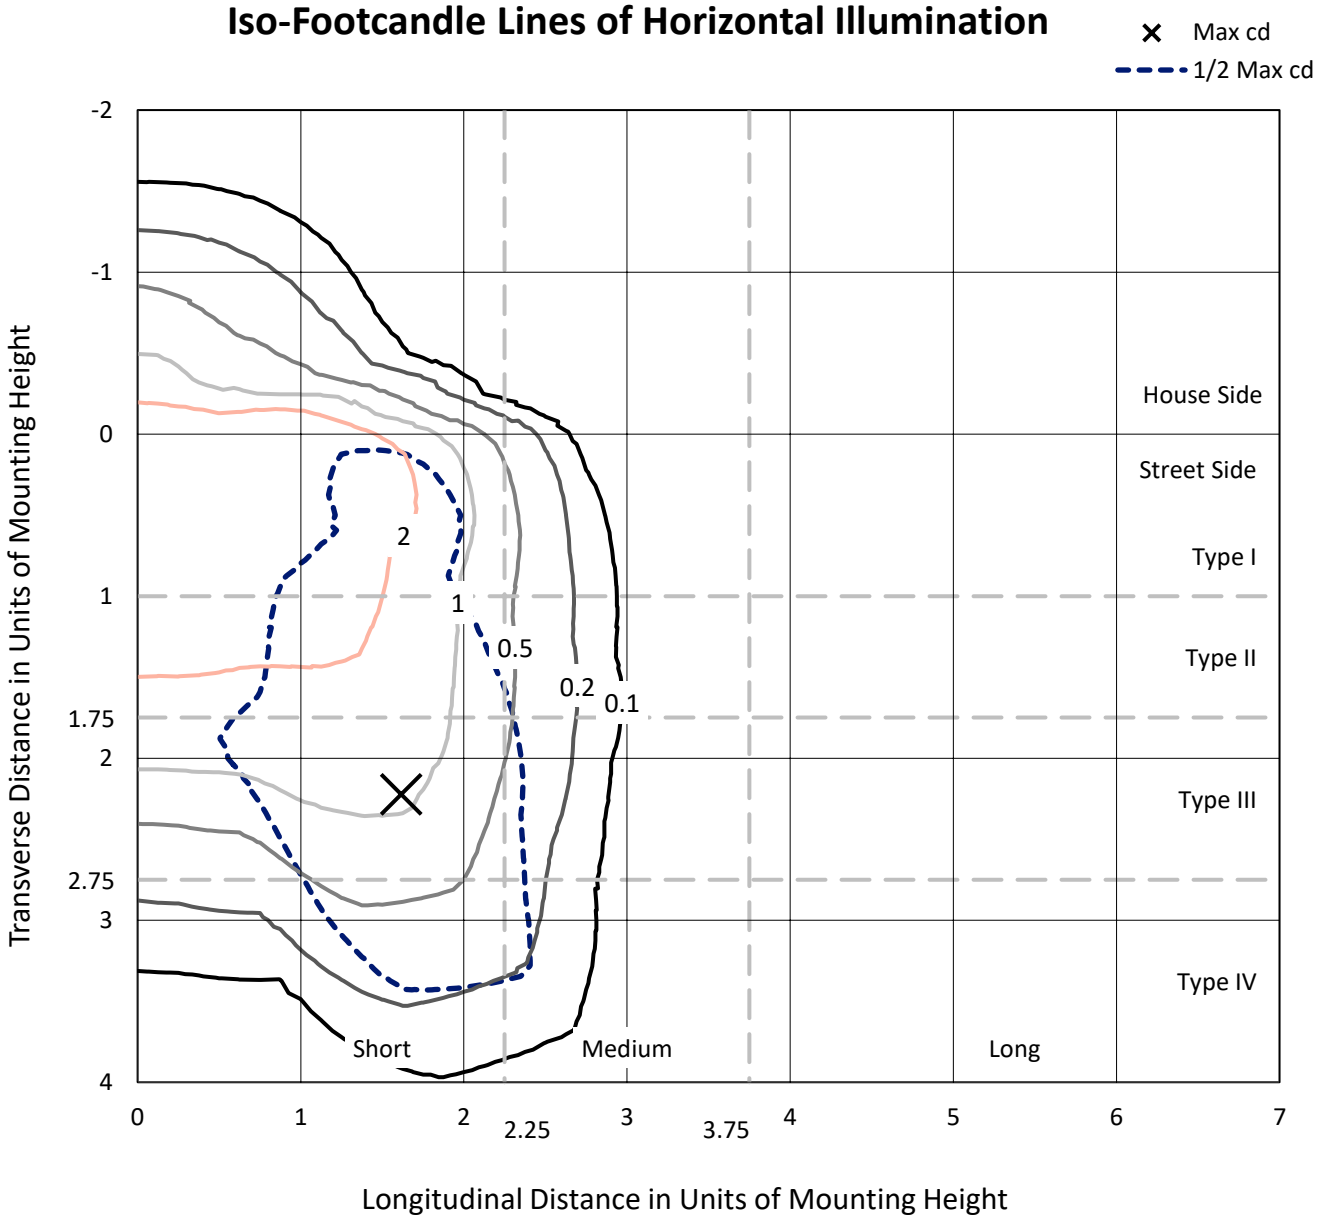


Based on 20 foot mounting height. Maximum calculated value = 4.6 fc
Type IV - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358104
CATALOG NUMBER: GSS-SB3B-750-U-T4FT-HSS

Luminous Intensity Polar Plot

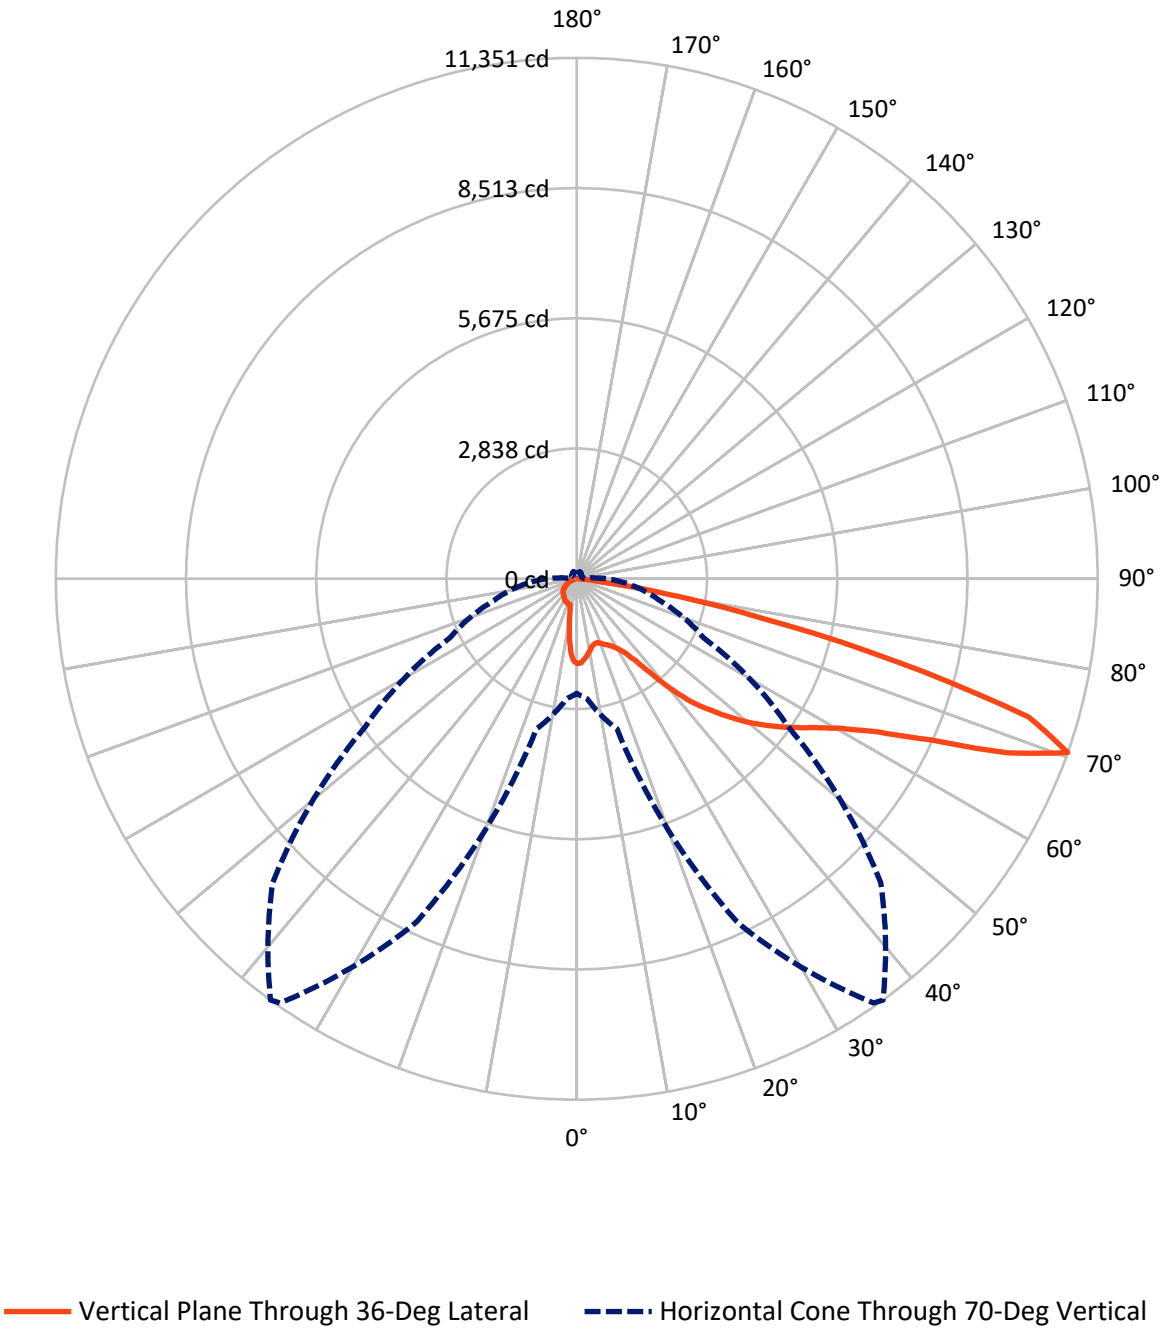

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1358104
CATALOG NUMBER: GSS-SB3B-750-U-T4FT-HSS

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	1440.9	0.0	1440.9
	% Fixture	12.5	0.0	12.5
Street Side	Lumens	10127.0	0.0	10127.0
	% Fixture	87.5	0.0	87.5
Total	Lumens	11568.0	0.0	11568.0
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	156.0	1.3
10°-20°	368.7	3.2
20°-30°	602.3	5.2
30°-40°	1076.5	9.3
40°-50°	1927.3	16.7
50°-60°	2798.9	24.2
60°-70°	3121.5	27.0
70°-80°	1436.9	12.4
80°-90°	79.8	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	11568.0	100.0
0°-180°	11568.0	100.0

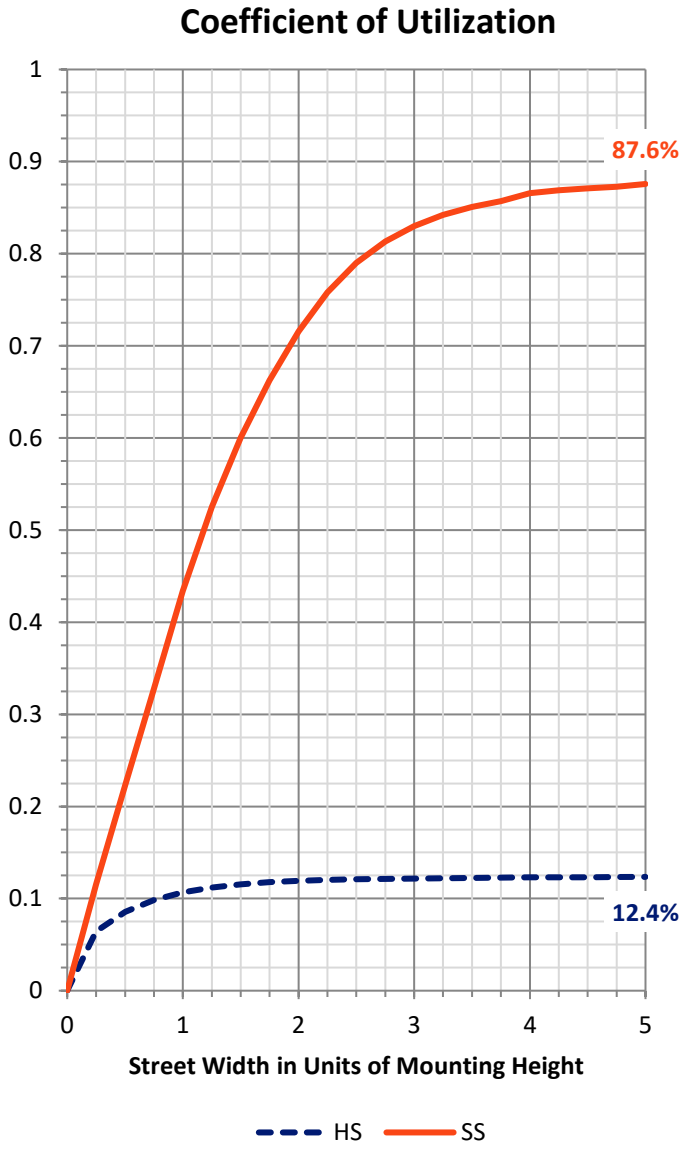

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1358104
CATALOG NUMBER: GSS-SB3B-750-U-T4FT-HSS

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	731.1	6.3			
FM	(30°-60°)	4960.4	42.9			
FH	(60°-80°)	4367.3	37.8			G2/5000
FVH	(80°-90°)	68.2	0.6			G1/100
BL	(0°-30°)	395.9	3.4	B1/500		
BM	(30°-60°)	842.4	7.3	B1/1000		
BH	(60°-80°)	191.1	1.7	B1/500		G1/500
BVH	(80°-90°)	11.6	0.1			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B1-U0-G2
Type IV Short

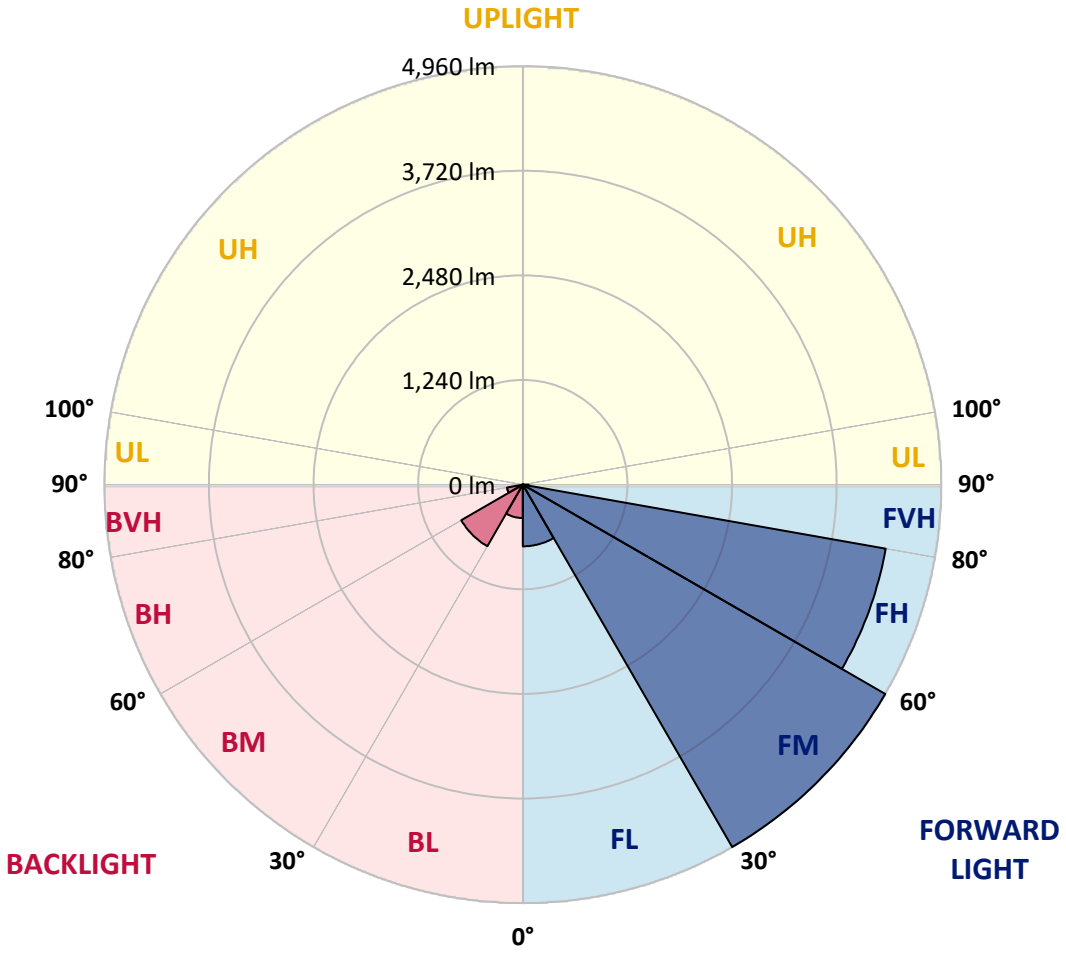

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358104
CATALOG NUMBER: GSS-SB3B-750-U-T4FT-HSS

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	36°	45°	55°	65°	75°	85°
0°	1848.2	1848.2	1848.2	1848.2	1848.2	*1848.2*	1848.2	1848.2	1848.2	1848.2	1848.2
2.5°	1826.4	1819.1	1819.1	1826.4	1844.5	*1833.7*	1826.4	1837.3	1840.9	1851.8	1855.4
5°	1717.5	1721.1	1710.2	1735.6	1753.8	*1757.4*	1782.8	1815.5	1833.7	1870.0	1873.6
7.5°	1575.9	1590.4	1597.6	1634.0	1670.3	*1673.9*	1721.1	1771.9	1826.4	1877.2	1902.6
10°	1463.3	1466.9	1474.2	1514.1	1579.5	*1586.7*	1652.1	1735.6	1815.5	1899.0	1928.1
12.5°	1390.7	1397.9	1397.9	1430.6	1496.0	*1503.2*	1579.5	1692.0	1808.2	1906.3	1960.7
15°	1390.7	1383.4	1383.4	1408.8	1459.7	*1466.9*	1539.5	1659.4	1790.1	1928.1	2015.2
17.5°	1397.9	1401.6	1394.3	1412.5	1456.0	*1463.3*	1528.7	1641.2	1793.7	1960.7	2058.8
20°	1427.0	1427.0	1419.7	1448.8	1488.7	*1499.6*	1554.1	1648.5	1808.2	2007.9	2120.5
22.5°	1466.9	1456.0	1452.4	1485.1	1535.9	*1554.1*	1601.3	1684.8	1830.0	2066.0	2185.9
25°	1525.0	1514.1	1506.9	1543.2	1590.4	*1597.6*	1681.2	1746.5	1888.1	2142.3	2294.8
27.5°	1634.0	1619.4	1583.1	1608.5	1666.6	*1673.9*	1757.4	1837.3	1968.0	2229.4	2418.2
30°	1968.0	1946.2	1840.9	1735.6	1757.4	*1768.3*	1851.8	1953.5	2076.9	2363.8	2603.4
32.5°	2363.8	2371.0	2236.7	2037.0	1906.3	*1909.9*	1964.4	2106.0	2236.7	2552.6	2832.2
35°	2872.1	2850.3	2668.8	2436.4	2189.5	*2178.6*	2164.1	2320.2	2469.1	2788.6	3119.0
37.5°	3358.7	3351.4	3202.5	2912.1	2625.2	*2581.6*	2480.0	2603.4	2741.4	3086.4	3438.6
40°	3721.8	3685.5	3598.3	3405.9	3162.6	*3137.2*	2923.0	2952.0	3082.7	3485.8	3772.6
42.5°	3957.8	3950.5	3848.9	3790.8	3678.2	*3667.3*	3413.1	3427.7	3500.3	3939.6	4164.8
45°	4190.2	4172.0	4084.9	4048.6	4055.8	*4081.2*	4044.9	3961.4	4015.9	4444.3	4586.0
47.5°	4422.6	4379.0	4313.6	4328.2	4480.7	*4513.3*	4633.2	4567.8	4498.8	5021.7	4981.7
50°	4509.7	4513.3	4531.5	4618.6	4869.2	*4945.4*	5225.0	5094.3	4985.4	5628.1	5439.2
52.5°	4542.4	4560.5	4684.0	4836.5	5235.9	*5330.3*	5875.0	5711.6	5410.2	6216.3	5737.0
55°	4578.7	4567.8	4814.7	5010.8	5620.8	*5722.5*	6470.4	6205.4	5809.6	6659.3	5991.2
57.5°	4763.9	4767.5	4960.0	5170.5	5980.3	*6118.2*	7015.1	6684.7	6031.1	6993.3	6063.8
60°	5058.0	5127.0	5257.7	5486.4	6408.7	*6604.8*	7552.5	7033.3	6256.2	7000.6	5747.9
62.5°	5228.6	5268.6	5638.9	6085.6	7142.2	*7338.3*	8122.6	7305.6	6140.0	6354.3	4938.2
65°	4640.4	4673.1	5504.6	6993.3	8285.9	*8449.3*	8750.7	7327.4	5526.4	5279.5	3834.3
67.5°	3464.0	3551.1	4542.4	7948.3	10039.7	*10119.6*	9513.2	6790.0	4542.4	3692.7	2251.2
70°	*2498.1*	*2628.8*	*3387.7*	*8242.4*	*11285.2*	*11350.5*	*9368.0*	*5631.7*	*3057.3*	*1895.4*	*1060.3*
72.5°	1808.2	1877.2	2418.2	7730.4	10620.7	*10293.9*	6608.4	3522.1	1612.2	965.8	486.6
75°	1249.1	1299.9	1539.5	5816.9	7236.6	*7171.2*	3333.3	1278.1	784.3	559.2	294.1
77.5°	515.6	515.6	689.9	3275.2	4048.6	*4113.9*	1514.1	348.6	413.9	323.2	170.7
80°	167.0	167.0	276.0	1161.9	1873.6	*1895.4*	544.7	170.7	221.5	196.1	90.8
82.5°	61.7	58.1	141.6	384.9	464.8	*493.8*	148.9	83.5	134.3	116.2	43.6
85°	21.8	21.8	50.8	79.9	87.1	*76.3*	39.9	39.9	65.4	54.5	18.2
87.5°	0.0	0.0	3.6	7.3	10.9	*10.9*	10.9	10.9	14.5	10.9	10.9
90°	0.0	0.0	0.0	0.0	0.0	*0.0*	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358104
CATALOG NUMBER: GSS-SB3B-750-U-T4FT-HSS

CANDELA DISTRIBUTION (continued):

	90°	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
0°	1848.2	1848.2	1848.2	1848.2	1848.2	1848.2	1848.2	1848.2	1848.2	1848.2	1848.2
2.5°	1848.2	1855.4	1840.9	1826.4	1822.8	1804.6	1793.7	1779.2	1775.6	1771.9	1779.2
5°	1870.0	1870.0	1833.7	1793.7	1746.5	1681.2	1612.2	1550.4	1525.0	1496.0	1499.6
7.5°	1895.4	1877.2	1822.8	1717.5	1575.9	1419.7	1289.0	1191.0	1132.9	1082.0	1096.6
10°	1917.2	1899.0	1786.5	1583.1	1347.1	1136.5	947.7	838.8	769.8	729.8	748.0
12.5°	1949.8	1913.5	1724.7	1412.5	1089.3	831.5	686.3	628.2	610.0	599.1	599.1
15°	1986.2	1924.4	1630.3	1220.0	842.4	628.2	588.2	588.2	591.9	591.9	595.5
17.5°	2022.5	1928.1	1528.7	998.5	653.6	573.7	577.3	581.0	588.2	581.0	581.0
20°	2066.0	1953.5	1397.9	802.5	573.7	562.8	566.4	573.7	581.0	573.7	577.3
22.5°	2138.7	1978.9	1285.4	675.4	562.8	555.5	555.5	566.4	570.1	559.2	562.8
25°	2222.2	2011.6	1165.6	624.5	570.1	544.7	551.9	559.2	562.8	555.5	555.5
27.5°	2327.5	2066.0	1049.4	624.5	577.3	537.4	541.0	551.9	559.2	548.3	555.5
30°	2480.0	2131.4	976.7	642.7	584.6	522.9	526.5	541.0	551.9	544.7	548.3
32.5°	2668.8	2244.0	915.0	657.2	581.0	508.3	504.7	526.5	544.7	541.0	548.3
35°	2901.2	2374.7	875.1	671.7	573.7	497.4	482.9	512.0	541.0	541.0	544.7
37.5°	3133.6	2512.7	893.2	668.1	555.5	490.2	464.8	490.2	522.9	533.8	541.0
40°	3409.5	2665.2	936.8	646.3	544.7	468.4	450.2	468.4	501.1	519.2	526.5
42.5°	3656.4	2810.4	980.4	620.9	530.1	446.6	435.7	450.2	468.4	486.6	497.4
45°	3946.9	2923.0	965.8	591.9	515.6	428.5	424.8	428.5	435.7	443.0	450.2
47.5°	4153.9	2959.3	900.5	566.4	482.9	413.9	406.7	403.0	395.8	395.8	399.4
50°	4379.0	2857.6	769.8	537.4	435.7	395.8	381.3	370.4	359.5	352.2	355.8
52.5°	4477.0	2596.2	646.3	486.6	381.3	370.4	352.2	337.7	323.2	319.5	315.9
55°	4437.1	2236.7	533.8	410.3	341.3	341.3	323.2	308.6	294.1	283.2	279.6
57.5°	4284.6	1866.3	428.5	305.0	301.4	308.6	294.1	279.6	265.1	250.5	250.5
60°	3928.7	1430.6	330.4	246.9	261.4	272.3	268.7	257.8	232.4	210.6	210.6
62.5°	3315.1	969.5	236.0	199.7	221.5	239.6	243.3	232.4	203.3	177.9	174.3
65°	2519.9	570.1	181.6	170.7	188.8	207.0	214.2	203.3	170.7	141.6	134.3
67.5°	1532.3	308.6	141.6	145.2	163.4	174.3	185.2	177.9	148.9	119.8	116.2
70°	*653.6*	*156.1*	*116.2*	*119.8*	*130.7*	*134.3*	*156.1*	*159.8*	*134.3*	*105.3*	*101.7*
72.5°	301.4	116.2	94.4	101.7	98.0	101.7	134.3	141.6	116.2	83.5	83.5
75°	174.3	87.1	72.6	79.9	65.4	76.3	108.9	116.2	98.0	69.0	65.4
77.5°	94.4	61.7	50.8	54.5	47.2	58.1	87.1	90.8	72.6	54.5	54.5
80°	54.5	39.9	36.3	32.7	32.7	39.9	61.7	58.1	47.2	47.2	47.2
82.5°	29.0	21.8	21.8	21.8	21.8	25.4	32.7	36.3	39.9	39.9	39.9
85°	14.5	10.9	10.9	10.9	14.5	18.2	25.4	29.0	32.7	32.7	32.7
87.5°	7.3	7.3	7.3	7.3	7.3	10.9	18.2	21.8	25.4	14.5	7.3
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-6

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-750-U-5WQ

Data in this report applies to families of products including GSS-SB1A-750-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-750-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 5000K CCT 26 LEDS

Spectral Parameters

CCT (K):	4896
CIE u':	0.2101
CIE v':	0.4901
Duv:	0.0035
CIE x:	0.3489
CIE y:	0.3618
CIE z:	0.2893
Peak Wavelength (nm):	443
Dominant Wavelength (nm):	570
Purity:	13.25435
Rf:	70.7
Rg:	96.8

CRI (Ra):	70.2
R1:	68.1
R2:	73.9
R3:	79.4
R4:	72.1
R5:	69.2
R6:	65.7
R7:	78.1
R8:	55.3
R9:	-35.1
R10:	39.3
R11:	71.1
R12:	43.8
R13:	68.1
R14:	88.4
R15:	59.7

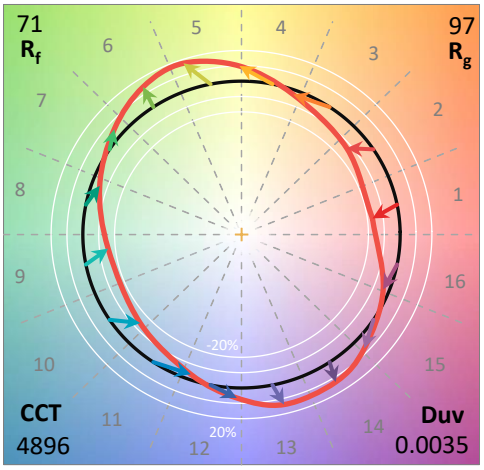

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-6

CIE 1931 Chromaticity Diagram

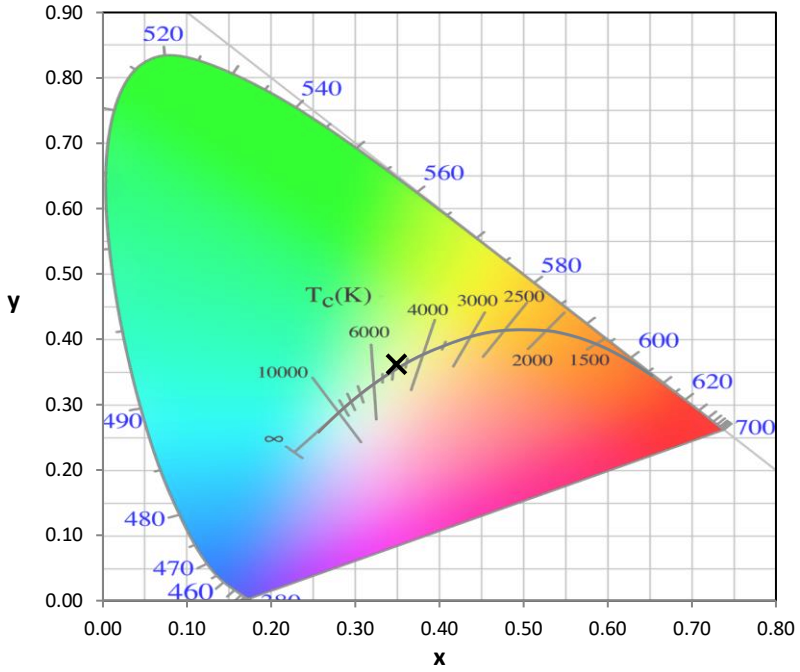

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

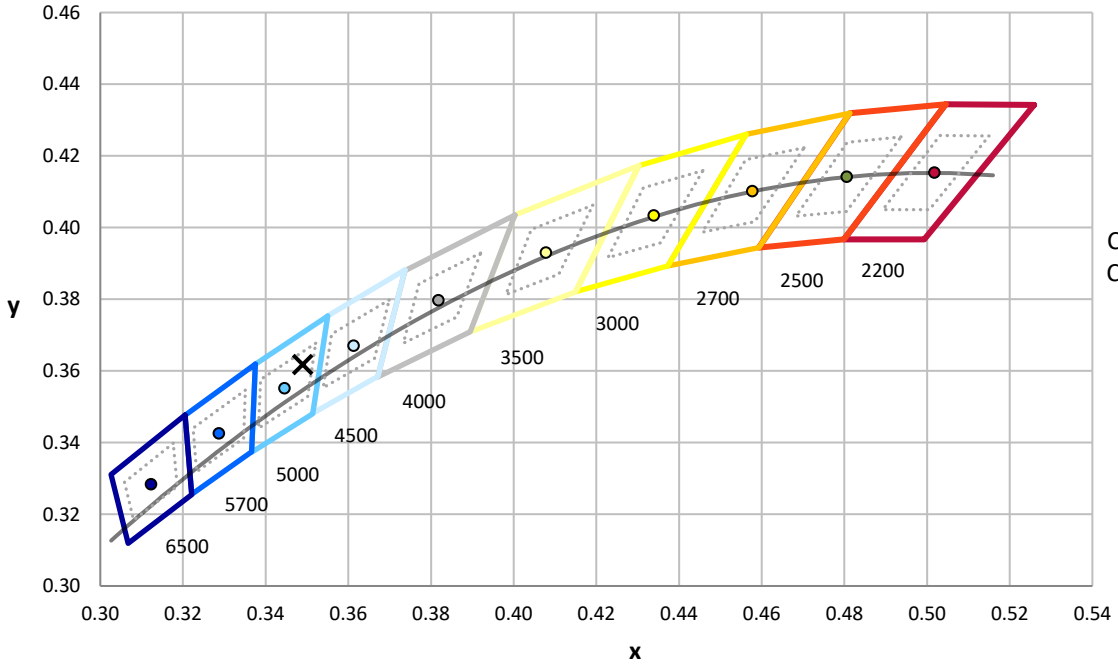


CCT = 4896K
CIE x = 0.3489
CIE y = 0.3618
Duv = 0.0035

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-6

Photopic Flux vs. Wavelength

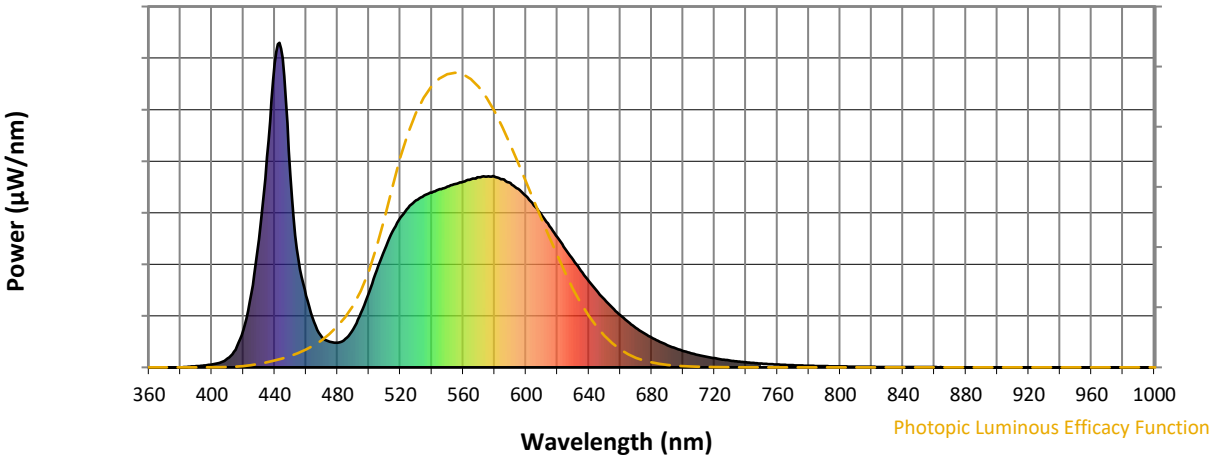


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Scotopic Flux vs. Wavelength

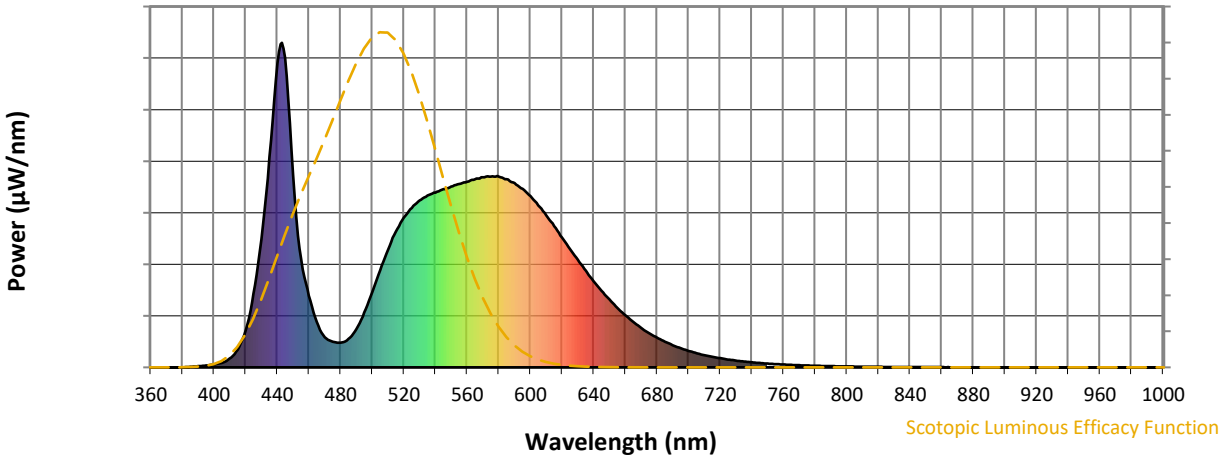


Scotopic Lumens: NR **S/P: 1.7**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Melanopic Flux vs. Wavelength

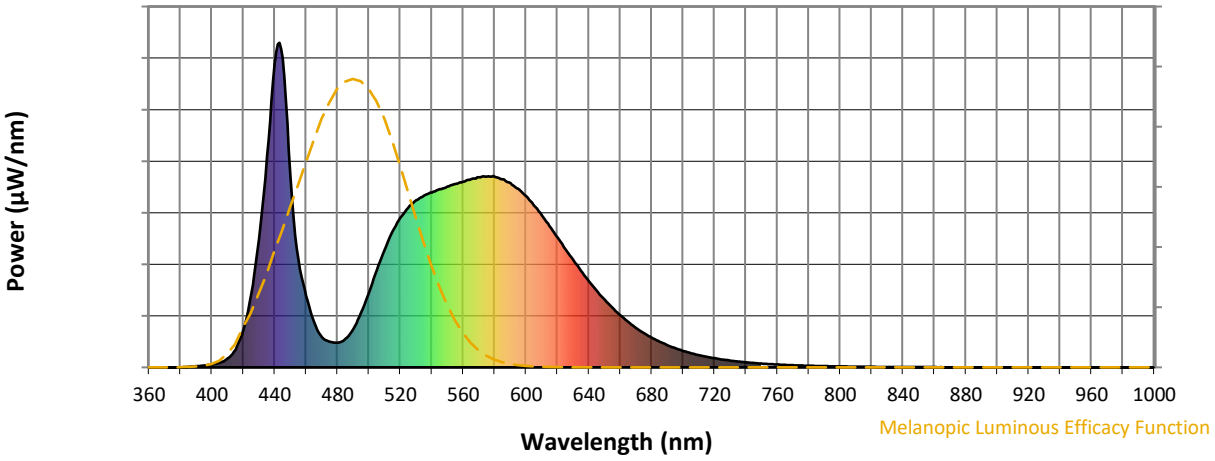

Melanopic Lumens: NR **M/P: 3.37**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			


REPORT NUMBER: SP1-2407-184-6

TM-30-18


Summary


R_f = 70.7
R_g = 96.8
CIE R_a = 70.2
R_9 = -35.1


Spectral Power Distribution Comparison

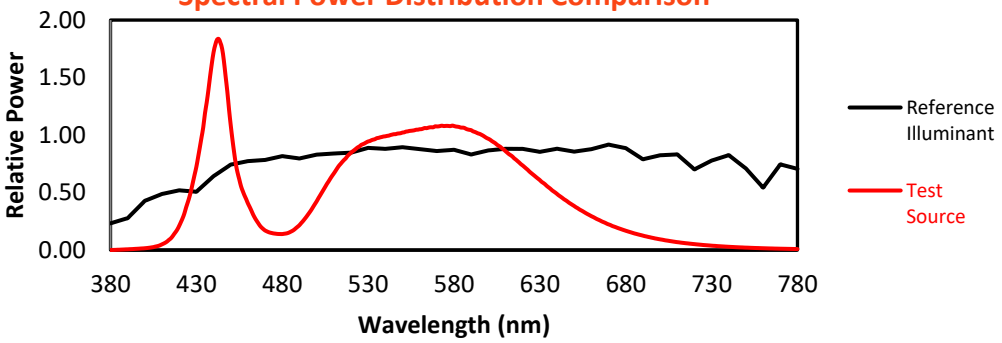


Color Vector Graphics

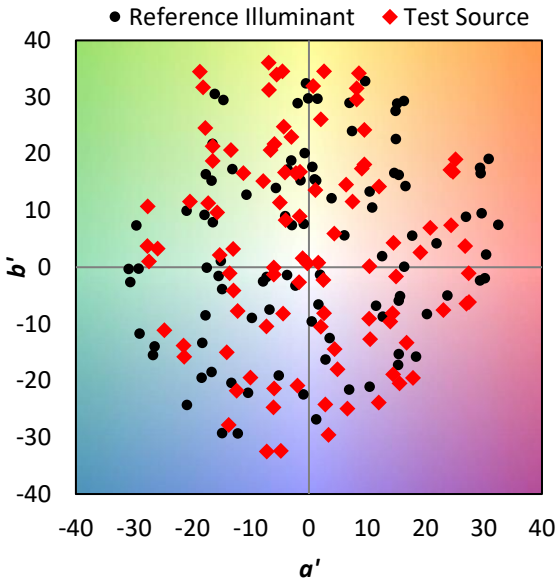

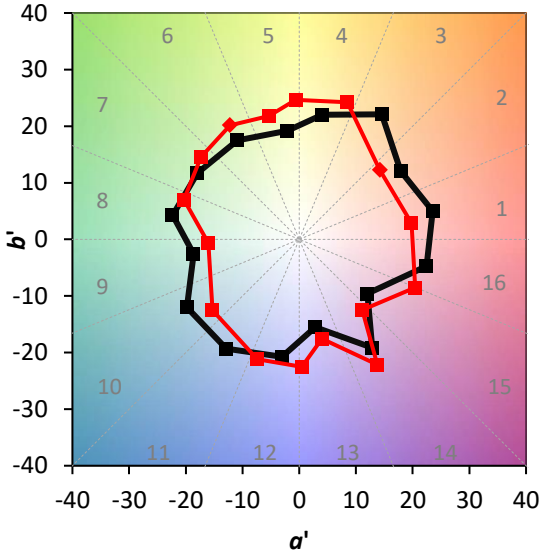

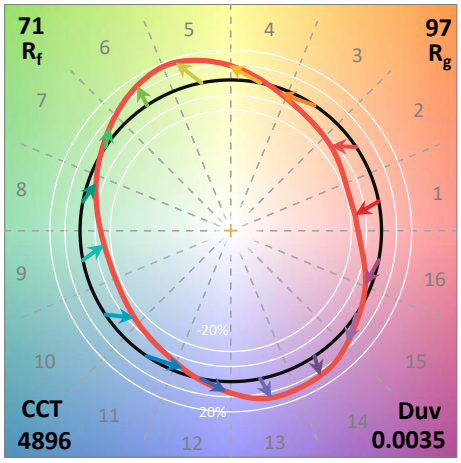

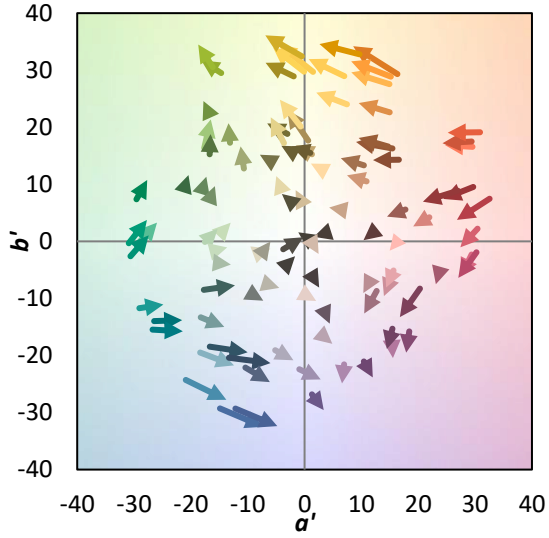


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 53	CES51 = 87	CES76 = 42
CES02 = 59	CES27 = 78	CES52 = 88	CES77 = 64
CES03 = 30	CES28 = 76	CES53 = 74	CES78 = 45
CES04 = 69	CES29 = 48	CES54 = 80	CES79 = 74
CES05 = 46	CES30 = 56	CES55 = 79	CES80 = 71
CES06 = 50	CES31 = 54	CES56 = 68	CES81 = 72
CES07 = 39	CES32 = 50	CES57 = 65	CES82 = 88
CES08 = 38	CES33 = 60	CES58 = 67	CES83 = 82
CES09 = 29	CES34 = 62	CES59 = 87	CES84 = 87
CES10 = 72	CES35 = 79	CES60 = 91	CES85 = 84
CES11 = 56	CES36 = 90	CES61 = 87	CES86 = 74
CES12 = 61	CES37 = 72	CES62 = 79	CES87 = 75
CES13 = 41	CES38 = 66	CES63 = 72	CES88 = 76
CES14 = 74	CES39 = 91	CES64 = 70	CES89 = 74
CES15 = 70	CES40 = 83	CES65 = 63	CES90 = 73
CES16 = 46	CES41 = 83	CES66 = 64	CES91 = 92
CES17 = 49	CES42 = 70	CES67 = 62	CES92 = 67
CES18 = 55	CES43 = 68	CES68 = 69	CES93 = 81
CES19 = 71	CES44 = 98	CES69 = 80	CES94 = 56
CES20 = 64	CES45 = 78	CES70 = 56	CES95 = 71
CES21 = 85	CES46 = 77	CES71 = 53	CES96 = 77
CES22 = 77	CES47 = 73	CES72 = 84	CES97 = 82
CES23 = 91	CES48 = 65	CES73 = 46	CES98 = 71
CES24 = 90	CES49 = 76	CES74 = 94	CES99 = 59
CES25 = 71	CES50 = 85	CES75 = 49	

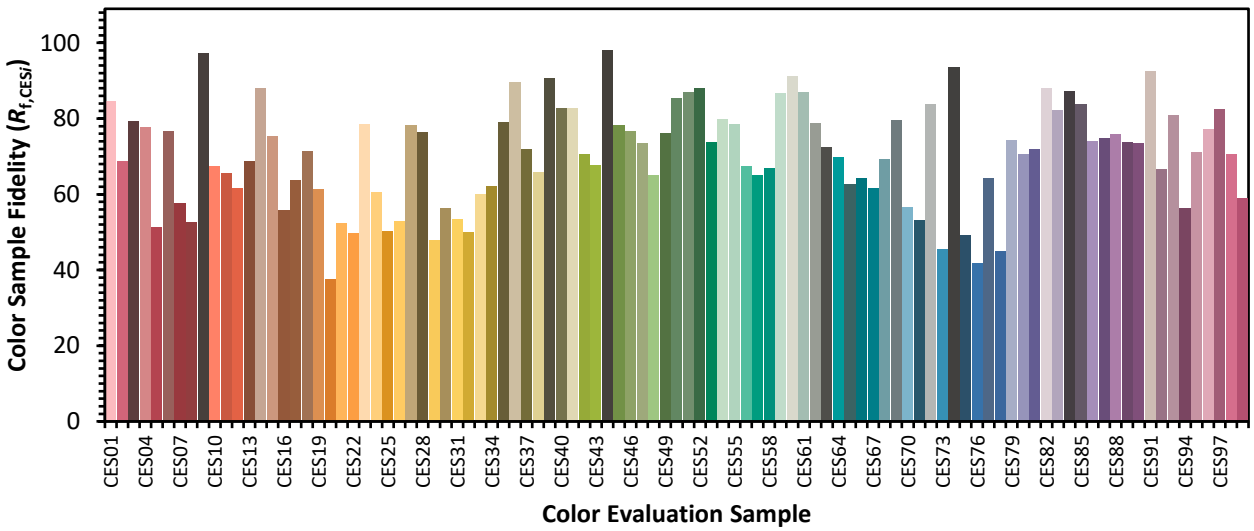



REPORT NUMBER: SP1-2407-184-6

TM-30-18

Color Rendition by Hue-Angle Bin

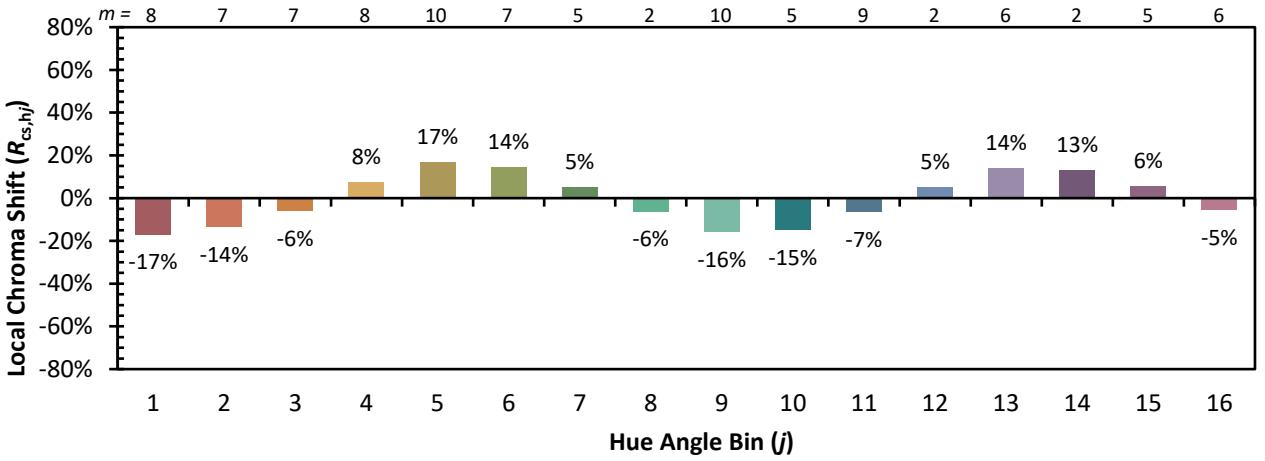

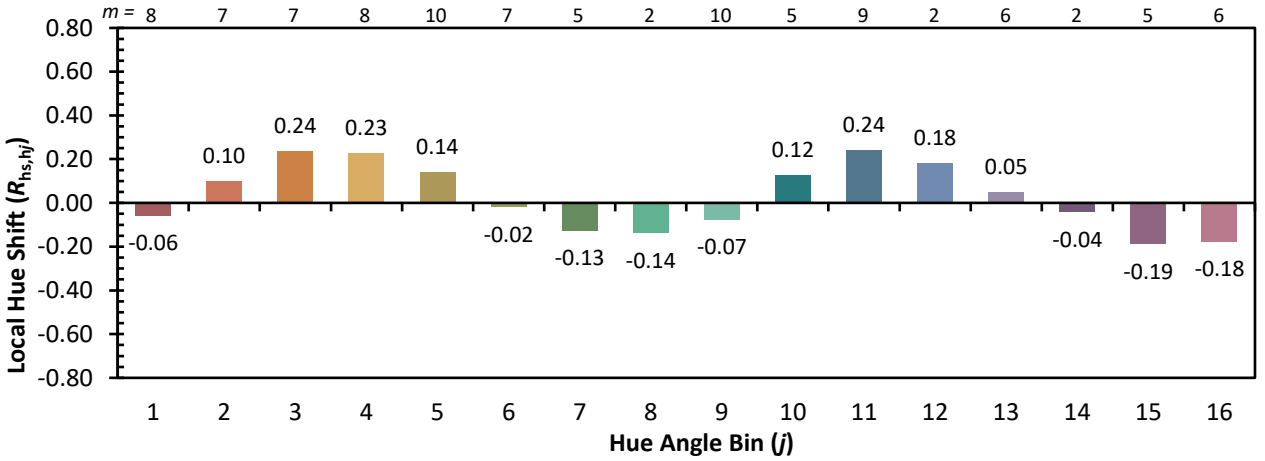


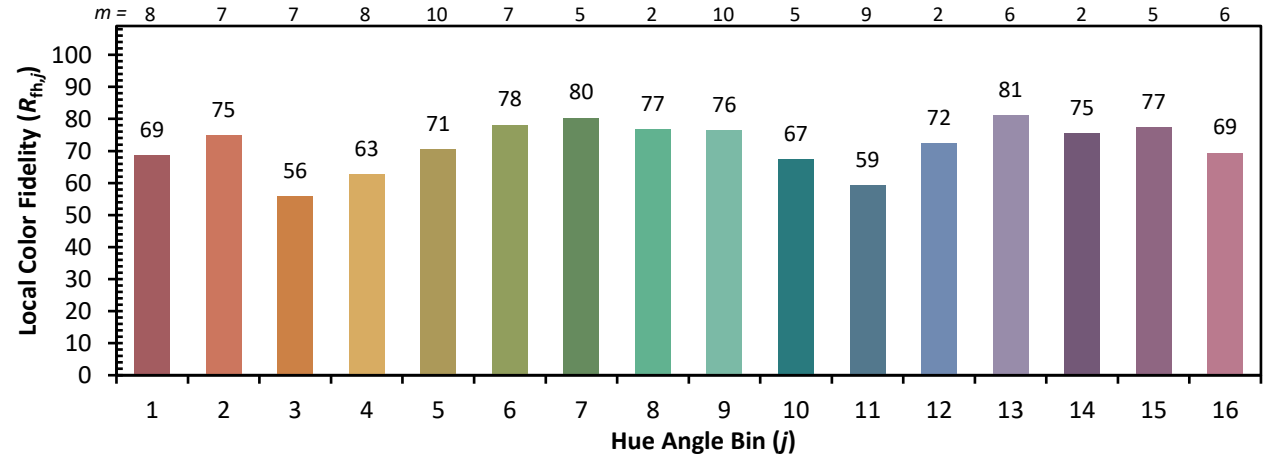


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Measure Comparisons

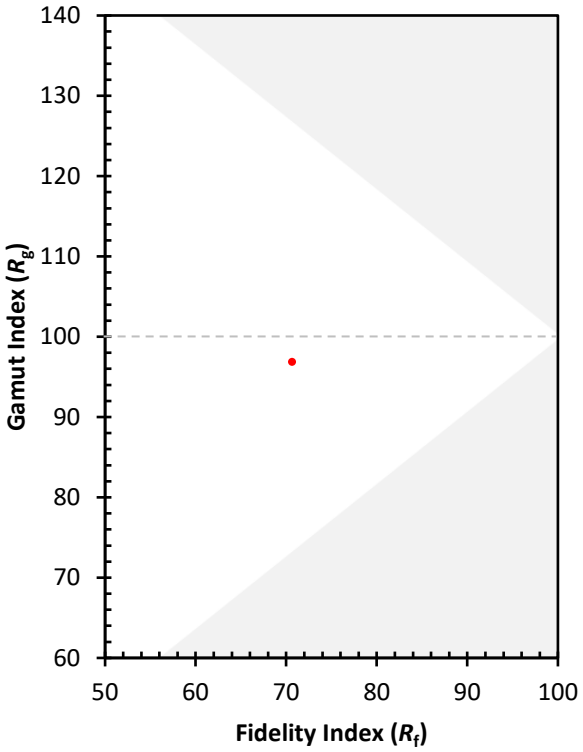

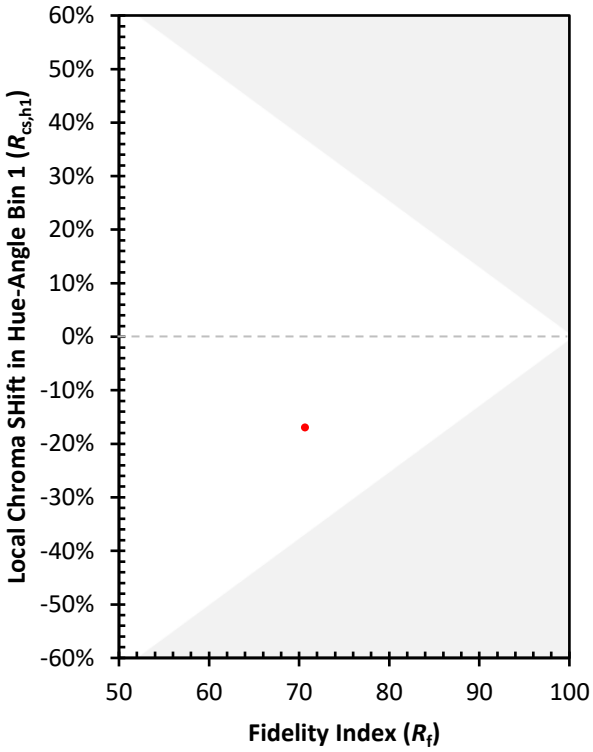

(END OF REPORT)