Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360796

Luminaire Tested: **GSS-SB4B-750-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360796
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB4B-750-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 4SQUARE 148W 70CRI 5000K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(104) 5000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	22932.6 lumens
Efficiency:	N/A
Efficacy:	155.0 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 1' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B4 - U0 - G4


Input Watts (W):	148
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	13.6%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360796
CATALOG NUMBER: GSS-SB4B-750-U-T1

Iso-Footcandle Lines of Horizontal Illumination

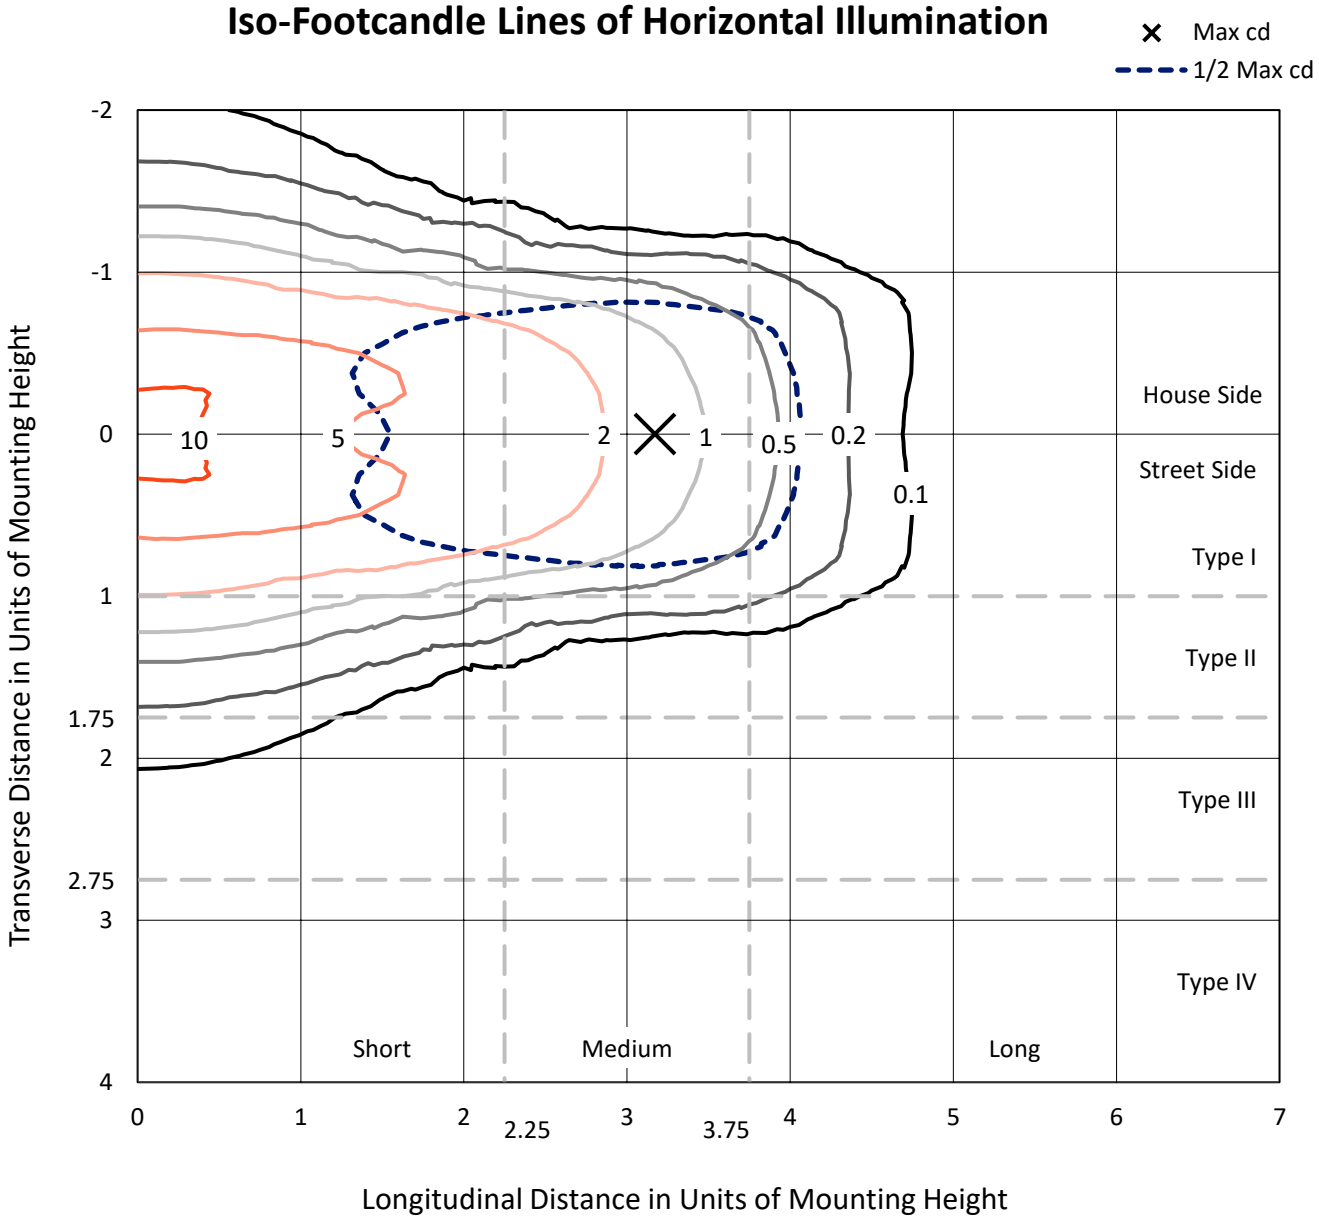


Based on 20 foot mounting height. Maximum calculated value = 11.3 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360796
CATALOG NUMBER: GSS-SB4B-750-U-T1

Luminous Intensity Polar Plot

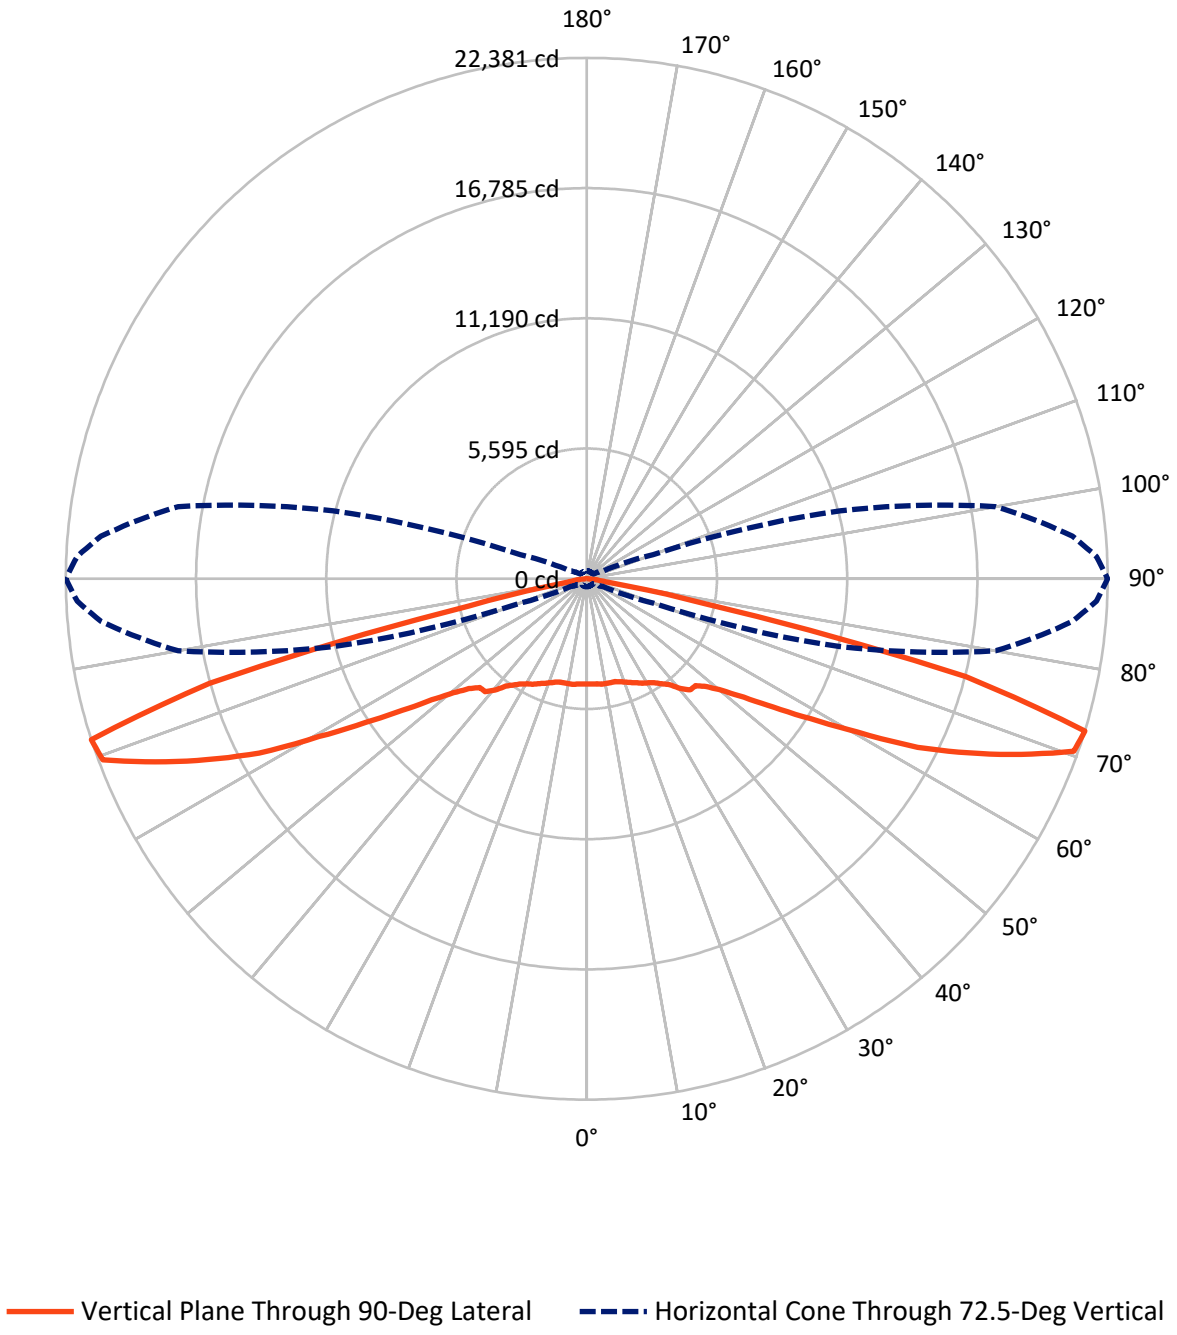

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360796
CATALOG NUMBER: GSS-SB4B-750-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	11466.3	0.0	11466.3
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	11466.3	0.0	11466.3
	% Fixture	50.0	0.0	50.0
Total	Lumens	22932.6	0.0	22932.6
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	437.3	1.9
10°-20°	1332.9	5.8
20°-30°	2227.9	9.7
30°-40°	3072.4	13.4
40°-50°	3766.4	16.4
50°-60°	4413.6	19.2
60°-70°	4901.3	21.4
70°-80°	2665.3	11.6
80°-90°	115.5	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	22932.6	100.0
0°-180°	22932.6	100.0

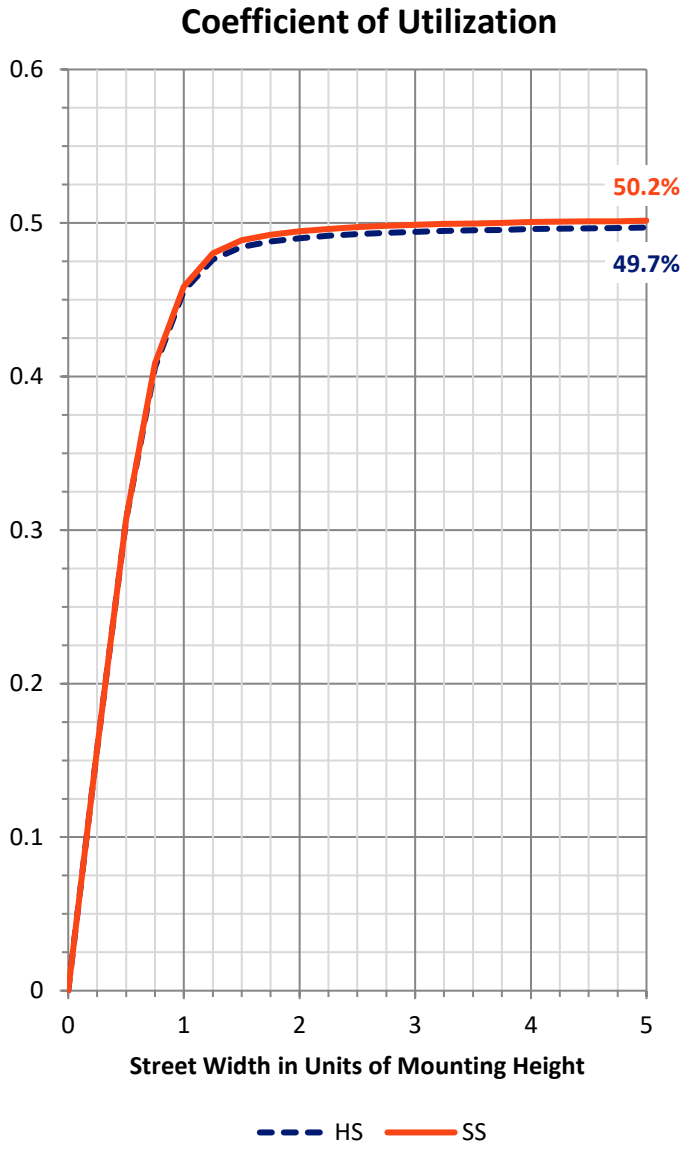

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360796
CATALOG NUMBER: GSS-SB4B-750-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	1999.1	8.7			
FM	(30°-60°)	5626.2	24.5			
FH	(60°-80°)	3783.3	16.5			G2/5000
FVH	(80°-90°)	57.7	0.3			G1/100
BL	(0°-30°)	1999.1	8.7	B3/2500		
BM	(30°-60°)	5626.2	24.5	B4/8500		
BH	(60°-80°)	3783.3	16.5	B4/5000		G4/5000
BVH	(80°-90°)	57.7	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B4-U0-G4
Type I Short

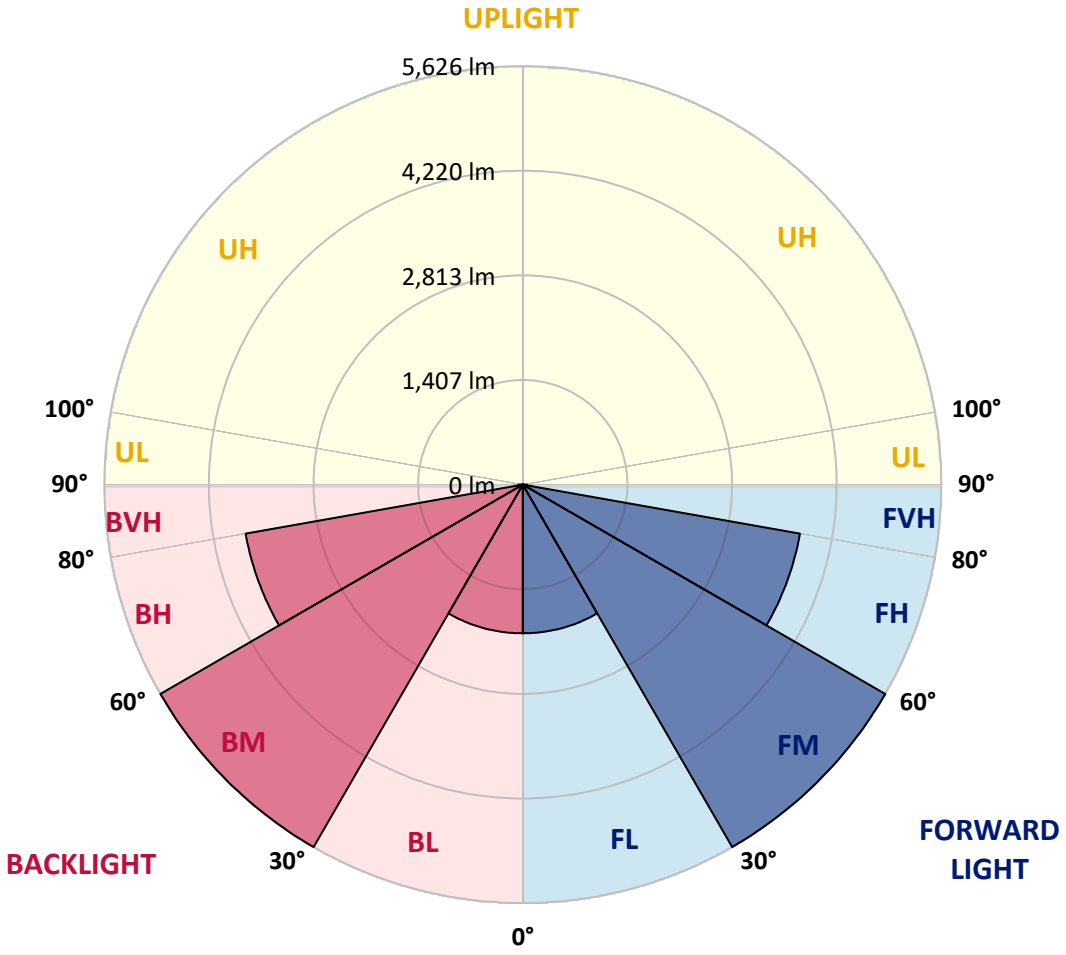

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360796
CATALOG NUMBER: GSS-SB4B-750-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	4518.3	4518.3	4518.3	4518.3	4518.3	4518.3	4518.3	4518.3	4518.3	4518.3	4518.3
2.5°	4523.3	4523.3	4508.2	4528.3	4518.3	4523.3	4528.3	4523.3	4518.3	4523.3	4528.3
5°	4548.4	4538.4	4548.4	4558.5	4543.4	4553.4	4548.4	4523.3	4538.4	4538.4	4538.4
7.5°	4593.6	4603.6	4593.6	4618.7	4603.6	4633.8	4603.6	4583.6	4578.5	4573.5	4573.5
10°	4613.7	4613.7	4608.7	4653.8	4663.9	4694.0	4673.9	4643.8	4628.7	4608.7	4588.6
12.5°	4558.5	4568.5	4593.6	4678.9	4719.1	4779.3	4764.3	4704.0	4658.9	4643.8	4613.7
15°	4498.2	4508.2	4558.5	4663.9	4759.3	4849.6	4844.6	4769.3	4714.1	4673.9	4628.7
17.5°	4402.8	4417.9	4488.2	4648.8	4819.5	4919.9	4950.0	4874.7	4814.5	4749.2	4689.0
20°	4242.2	4242.2	4367.7	4573.5	4809.5	5035.4	5115.7	5055.5	4985.2	4879.8	4799.4
22.5°	4061.4	4071.5	4197.0	4468.1	4804.4	5135.8	5291.4	5226.2	5155.9	5040.4	4919.9
25°	3880.7	3880.7	4021.3	4327.5	4739.2	5206.1	5497.3	5462.1	5321.5	5216.1	5060.5
27.5°	3715.0	3715.0	3865.6	4186.9	4628.7	5226.2	5703.1	5703.1	5547.5	5391.8	5221.1
30°	3519.2	3569.4	3740.1	4076.5	4528.3	5191.0	5853.7	5949.1	5808.5	5607.7	5356.7
32.5°	3353.6	3388.7	3564.4	3920.9	4382.7	5150.9	6024.4	6260.3	6114.8	5838.6	5557.5
35°	3157.8	3152.8	3353.6	3705.0	4176.9	5060.5	6159.9	6631.8	6491.3	6195.1	5813.5
37.5°	2901.7	2901.7	3107.6	3449.0	3981.1	4904.9	6270.4	7043.5	6938.1	6601.7	6195.1
40°	2625.6	2655.8	2836.5	3182.9	3745.2	4719.1	6270.4	7379.9	7435.1	7088.7	6667.0
42.5°	2424.8	2434.9	2600.5	2926.8	3484.1	4478.1	6190.1	7671.1	7836.7	7545.5	6998.3
45°	2214.0	2239.1	2379.6	2680.9	3213.0	4192.0	6049.5	7997.4	8263.5	8062.6	7344.7
47.5°	1957.9	1983.0	2143.7	2449.9	2957.0	3880.7	5813.5	8338.8	8896.0	8750.4	7962.2
50°	1661.7	1681.8	1832.4	2158.7	2670.8	3524.3	5517.3	8594.8	9528.6	9674.2	8896.0
52.5°	1300.3	1315.3	1476.0	1792.3	2329.4	3182.9	5100.6	8750.4	10166.2	10678.2	10146.1
55°	933.8	958.9	1099.5	1360.5	1877.6	2726.0	4603.6	8830.7	10864.0	11868.0	11697.4
57.5°	672.7	682.8	778.1	979.0	1395.6	2188.9	3966.1	8695.2	11491.5	13288.8	13645.2
60°	557.3	557.3	572.3	667.7	953.9	1546.3	3203.0	8193.2	12028.7	14724.6	15824.1
62.5°	512.1	512.1	522.1	537.2	627.5	1004.1	2289.3	7174.0	12088.9	16105.2	18213.7
65°	466.9	466.9	476.9	487.0	507.1	652.6	1380.6	5251.3	10909.2	16120.3	19498.9
67.5°	426.7	426.7	431.7	436.8	446.8	476.9	758.1	3182.9	8730.3	15693.5	19990.9
70°	386.6	386.6	386.6	381.5	396.6	401.6	502.0	1616.5	5838.6	14172.4	19755.0
72.5°	*341.4*	*341.4*	*336.4*	*326.3*	*331.3*	*331.3*	*371.5*	*793.2*	*3032.3*	*11265.6*	*17837.2*
75°	291.2	296.2	276.1	266.1	261.1	266.1	296.2	451.8	1355.5	6832.7	13329.0
77.5°	246.0	256.0	225.9	205.8	200.8	200.8	230.9	281.1	582.4	2480.0	5974.2
80°	185.8	190.8	165.7	145.6	145.6	140.6	170.7	205.8	276.1	738.0	1340.4
82.5°	105.4	105.4	95.4	85.3	80.3	85.3	115.5	140.6	170.7	261.1	366.5
85°	25.1	25.1	30.1	35.1	35.1	45.2	65.3	75.3	90.4	105.4	140.6
87.5°	5.0	5.0	5.0	10.0	15.1	15.1	25.1	35.1	45.2	55.2	60.2
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360796
CATALOG NUMBER: GSS-SB4B-750-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	4518.3	4518.3	*4518.3*
2.5°	4528.3	4533.4	*4528.3*
5°	4558.5	4548.4	*4533.4*
7.5°	4563.5	4568.5	*4573.5*
10°	4583.6	4603.6	*4573.5*
12.5°	4603.6	4588.6	*4578.5*
15°	4618.7	4613.7	*4583.6*
17.5°	4673.9	4653.8	*4648.8*
20°	4759.3	4754.2	*4739.2*
22.5°	4859.7	4849.6	*4844.6*
25°	5005.3	4970.1	*4950.0*
27.5°	5125.7	5095.6	*5085.6*
30°	5246.2	5186.0	*5186.0*
32.5°	5351.7	5336.6	*5326.6*
35°	5602.7	5527.4	*5537.4*
37.5°	5908.9	5833.6	*5768.4*
40°	6340.7	6240.3	*6200.1*
42.5°	6616.8	6516.4	*6526.4*
45°	6772.4	6596.7	*6551.5*
47.5°	7194.1	6973.2	*6913.0*
50°	7876.9	7605.8	*7530.5*
52.5°	8981.4	8544.6	*8444.2*
55°	10367.0	9829.8	*9729.4*
57.5°	12264.6	11551.8	*11335.9*
60°	14574.0	13690.4	*13364.1*
62.5°	17350.2	16260.8	*15949.6*
65°	19438.7	18530.0	*18048.1*
67.5°	21110.5	20362.4	*20131.5*
70°	22104.5	22139.6	*22199.9*
72.5°	*20954.8*	*21918.7*	*22380.6*
75°	15357.2	16105.2	*16823.1*
77.5°	5934.0	5351.7	*5181.0*
80°	958.9	898.6	*928.8*
82.5°	431.7	456.8	*482.0*
85°	281.1	326.3	*346.4*
87.5°	65.3	65.3	*65.3*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-6

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-750-U-5WQ

Data in this report applies to families of products including GSS-SB1A-750-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-750-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 5000K CCT 26 LEDS

Spectral Parameters

CCT (K):	4896
CIE u':	0.2101
CIE v':	0.4901
Duv:	0.0035
CIE x:	0.3489
CIE y:	0.3618
CIE z:	0.2893
Peak Wavelength (nm):	443
Dominant Wavelength (nm):	570
Purity:	13.25435
Rf:	70.7
Rg:	96.8

CRI (Ra):	70.2
R1:	68.1
R2:	73.9
R3:	79.4
R4:	72.1
R5:	69.2
R6:	65.7
R7:	78.1
R8:	55.3
R9:	-35.1
R10:	39.3
R11:	71.1
R12:	43.8
R13:	68.1
R14:	88.4
R15:	59.7

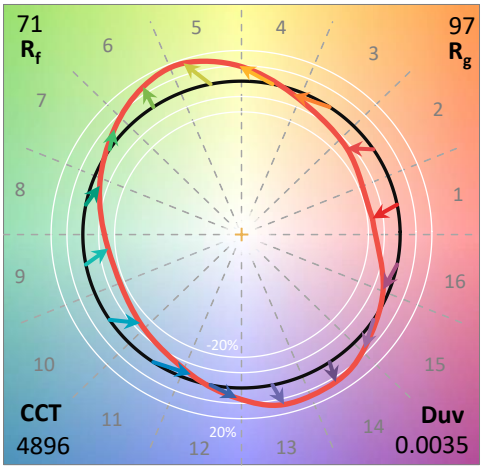

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-6

CIE 1931 Chromaticity Diagram

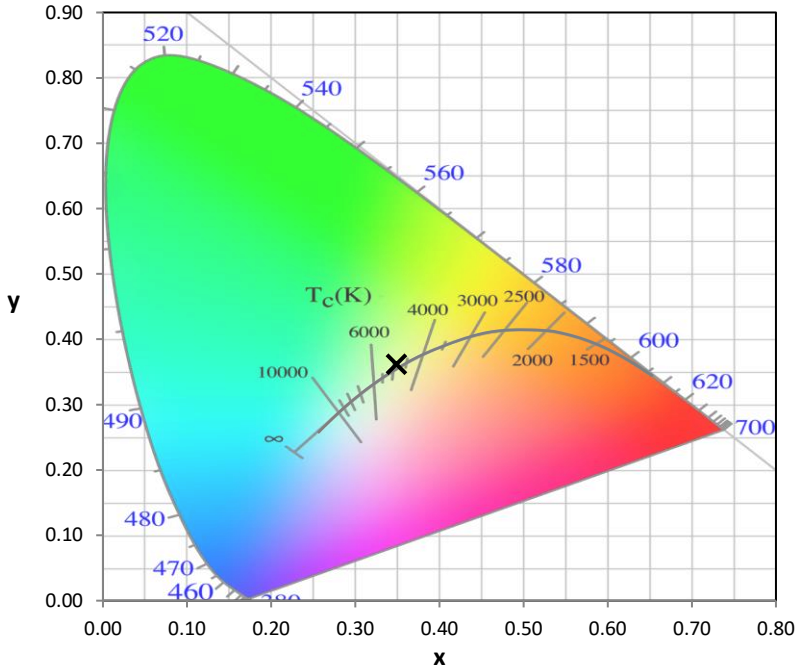

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

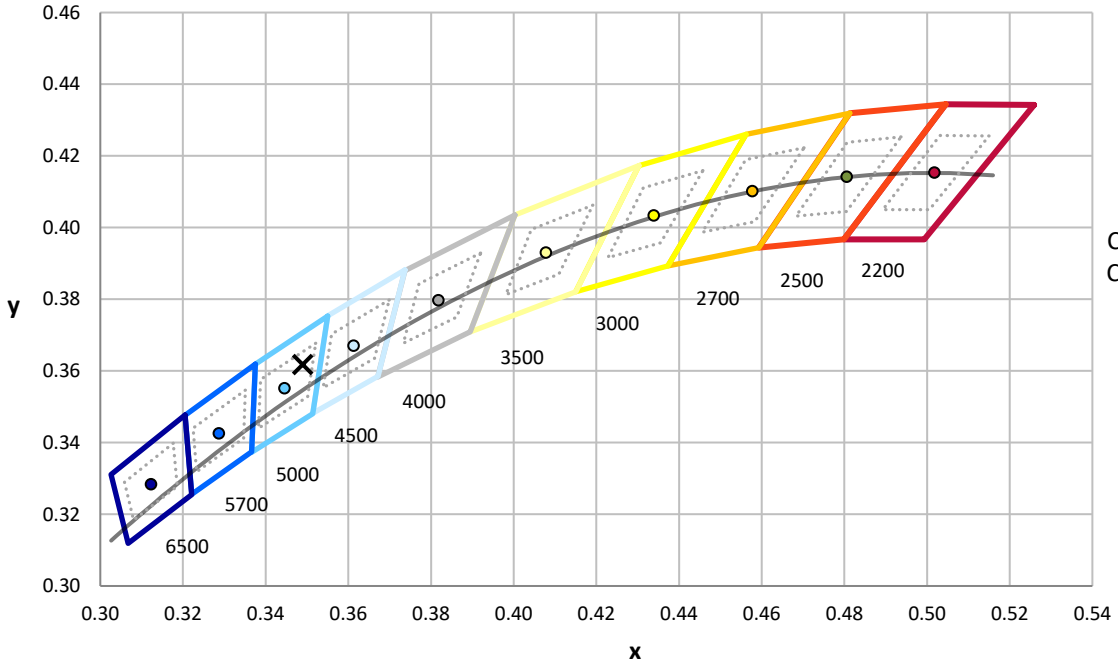


CCT = 4896K
CIE x = 0.3489
CIE y = 0.3618
Duv = 0.0035

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-6

Photopic Flux vs. Wavelength

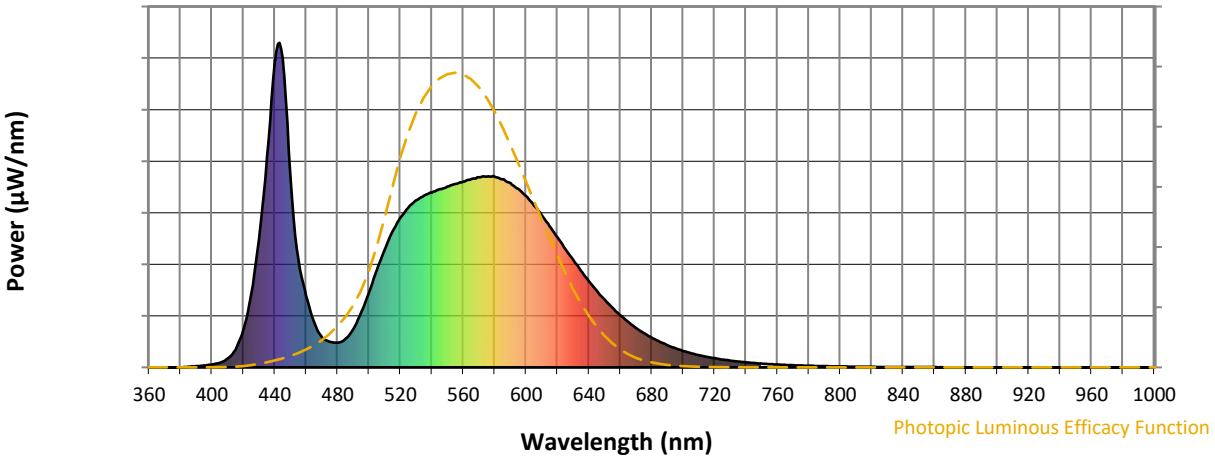


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Scotopic Flux vs. Wavelength

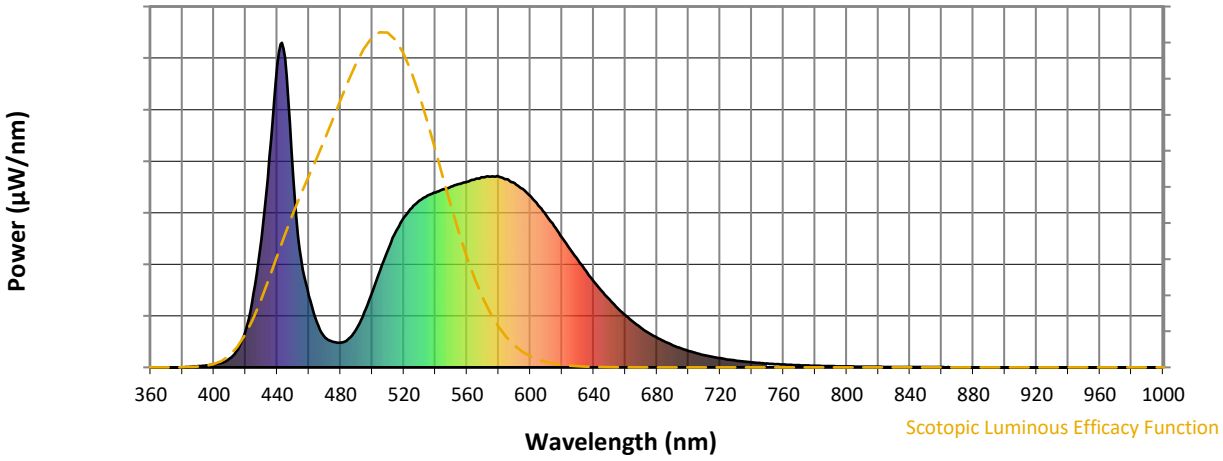


Scotopic Lumens: NR **S/P: 1.7**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Melanopic Flux vs. Wavelength

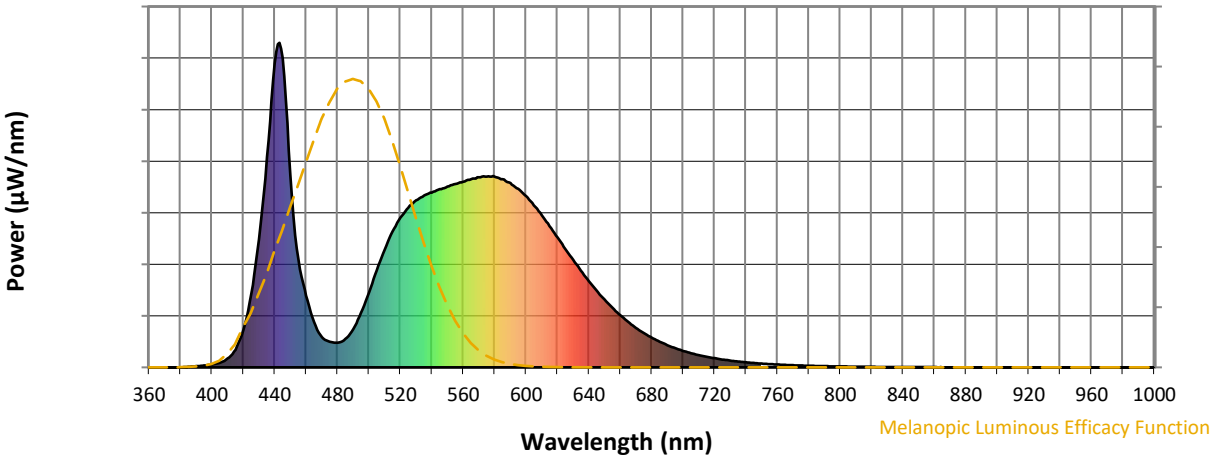

Melanopic Lumens: NR **M/P: 3.37**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			


REPORT NUMBER: SP1-2407-184-6

TM-30-18


Summary


R_f = 70.7
R_g = 96.8
CIE R_a = 70.2
R_9 = -35.1


Spectral Power Distribution Comparison

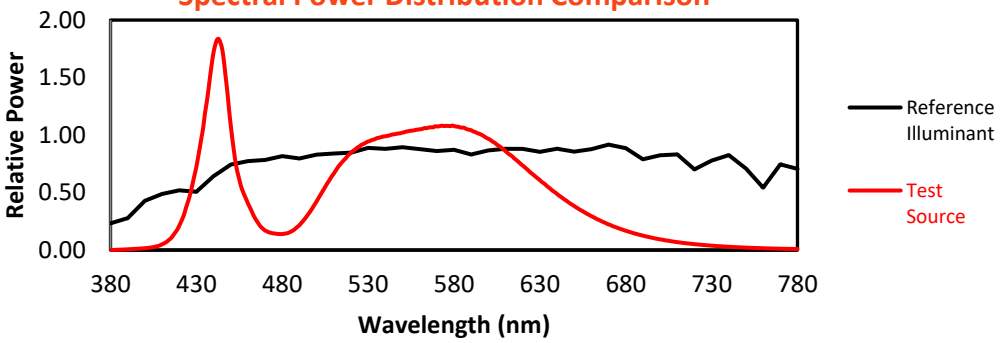


Color Vector Graphics

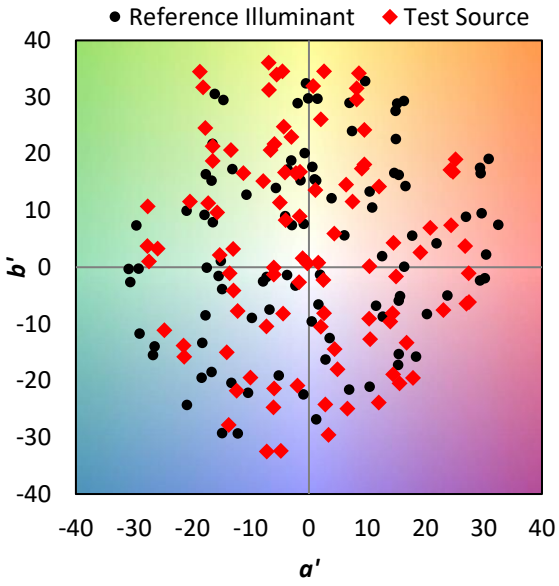

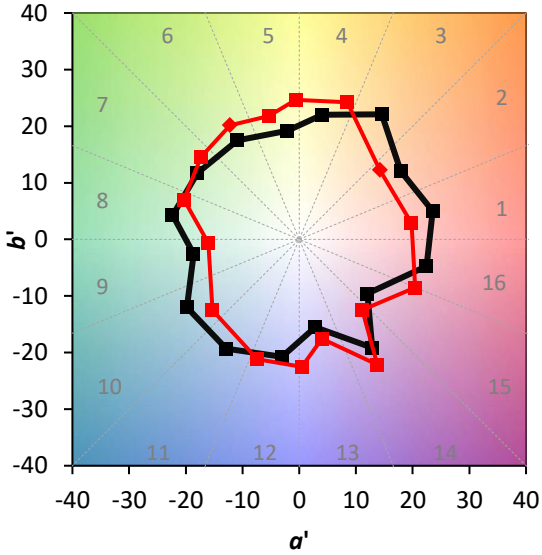

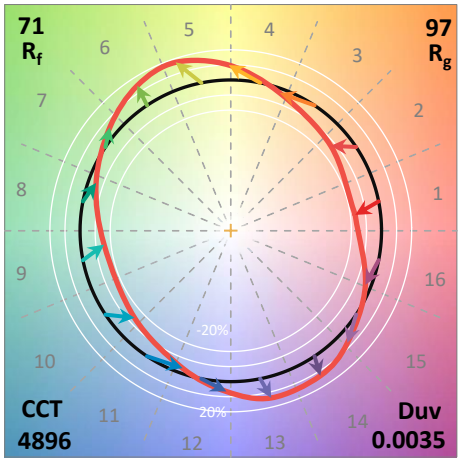

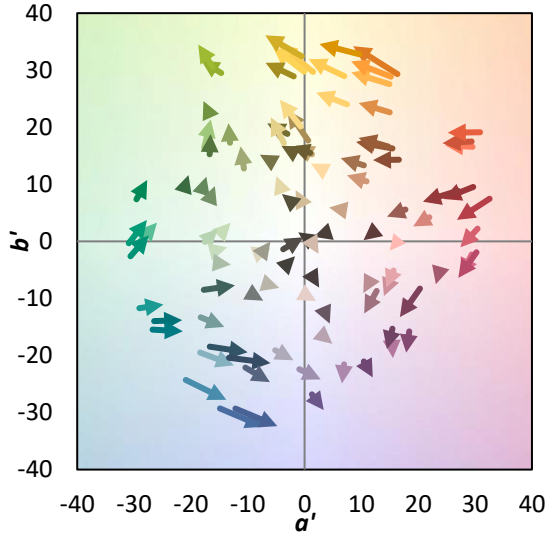


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 53	CES51 = 87	CES76 = 42
CES02 = 59	CES27 = 78	CES52 = 88	CES77 = 64
CES03 = 30	CES28 = 76	CES53 = 74	CES78 = 45
CES04 = 69	CES29 = 48	CES54 = 80	CES79 = 74
CES05 = 46	CES30 = 56	CES55 = 79	CES80 = 71
CES06 = 50	CES31 = 54	CES56 = 68	CES81 = 72
CES07 = 39	CES32 = 50	CES57 = 65	CES82 = 88
CES08 = 38	CES33 = 60	CES58 = 67	CES83 = 82
CES09 = 29	CES34 = 62	CES59 = 87	CES84 = 87
CES10 = 72	CES35 = 79	CES60 = 91	CES85 = 84
CES11 = 56	CES36 = 90	CES61 = 87	CES86 = 74
CES12 = 61	CES37 = 72	CES62 = 79	CES87 = 75
CES13 = 41	CES38 = 66	CES63 = 72	CES88 = 76
CES14 = 74	CES39 = 91	CES64 = 70	CES89 = 74
CES15 = 70	CES40 = 83	CES65 = 63	CES90 = 73
CES16 = 46	CES41 = 83	CES66 = 64	CES91 = 92
CES17 = 49	CES42 = 70	CES67 = 62	CES92 = 67
CES18 = 55	CES43 = 68	CES68 = 69	CES93 = 81
CES19 = 71	CES44 = 98	CES69 = 80	CES94 = 56
CES20 = 64	CES45 = 78	CES70 = 56	CES95 = 71
CES21 = 85	CES46 = 77	CES71 = 53	CES96 = 77
CES22 = 77	CES47 = 73	CES72 = 84	CES97 = 82
CES23 = 91	CES48 = 65	CES73 = 46	CES98 = 71
CES24 = 90	CES49 = 76	CES74 = 94	CES99 = 59
CES25 = 71	CES50 = 85	CES75 = 49	

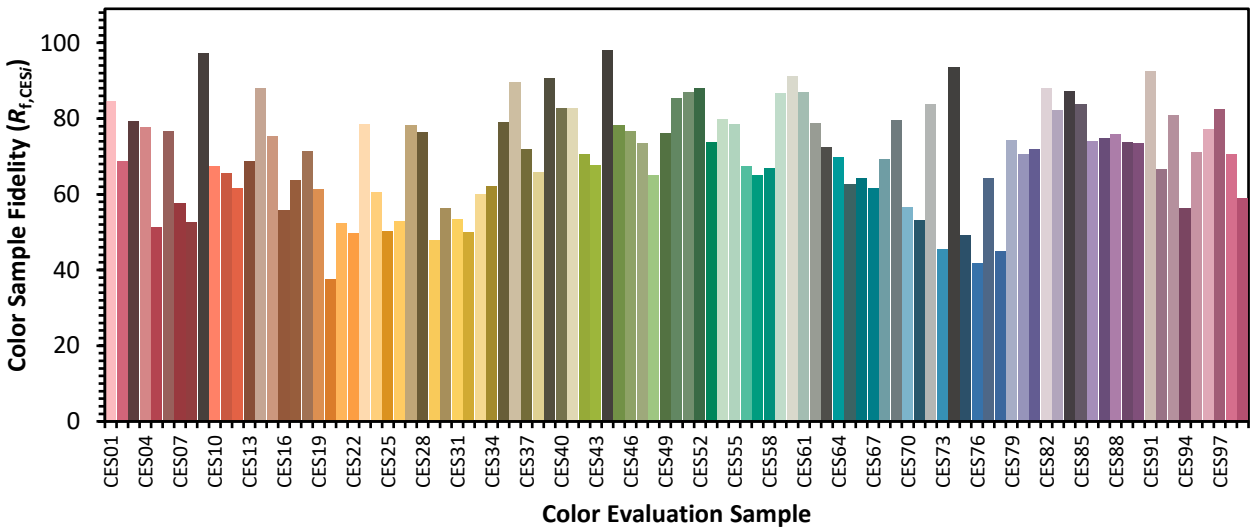



REPORT NUMBER: SP1-2407-184-6

TM-30-18

Color Rendition by Hue-Angle Bin

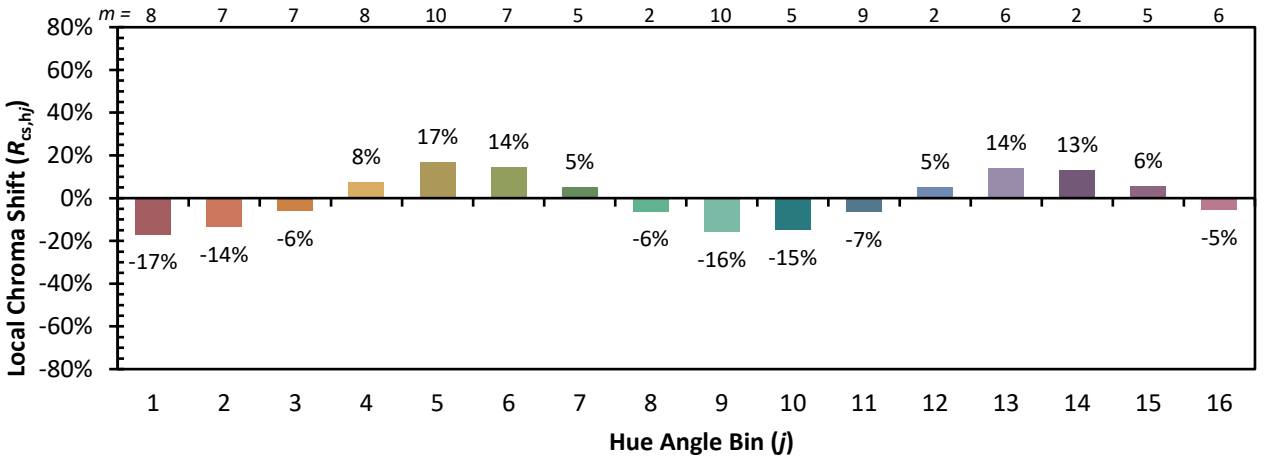

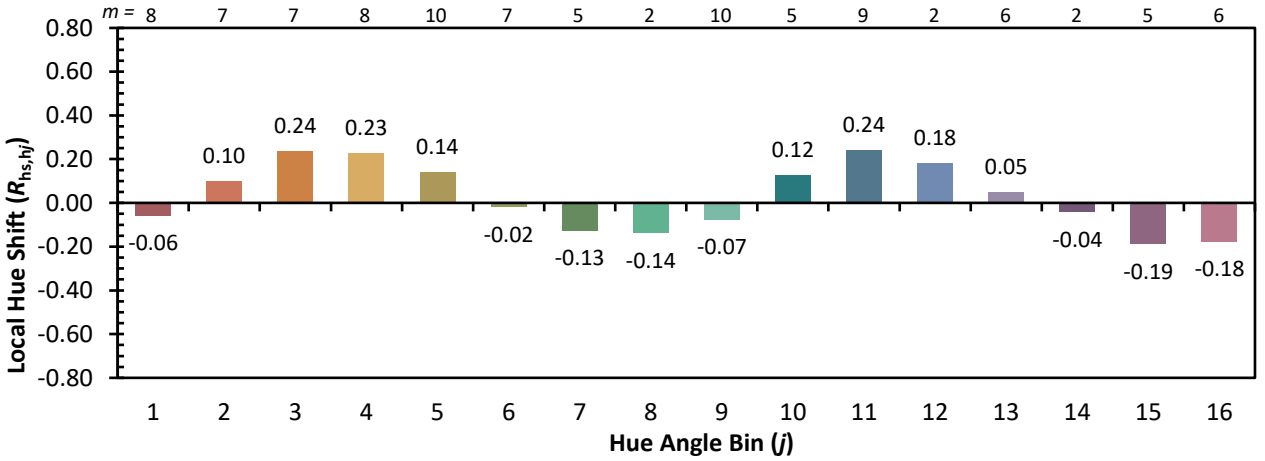


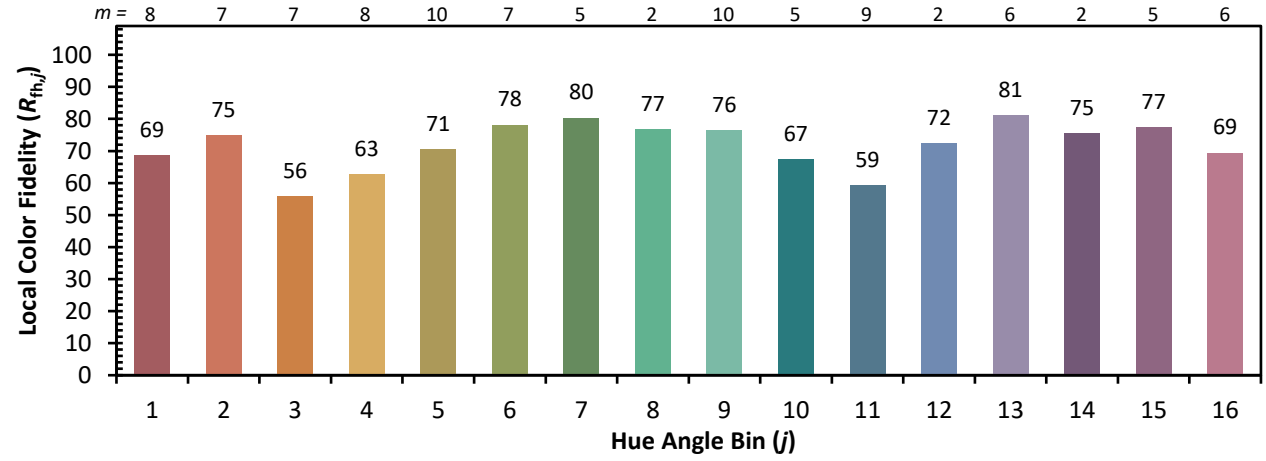


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Measure Comparisons

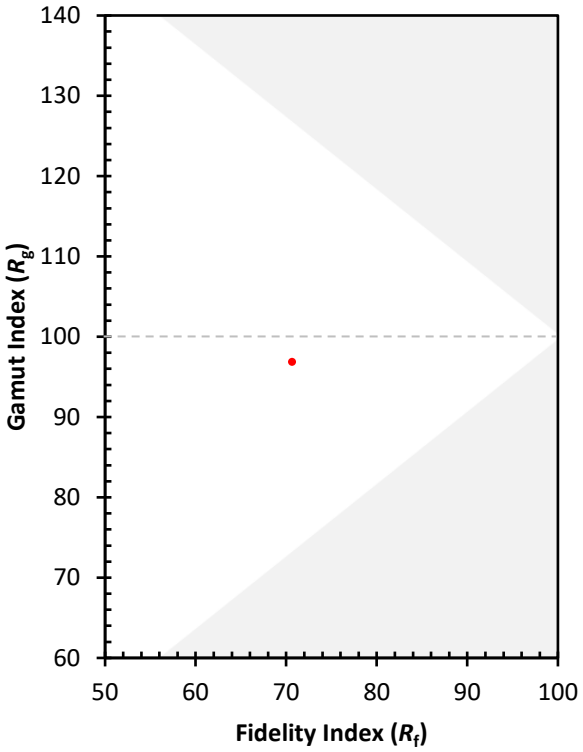

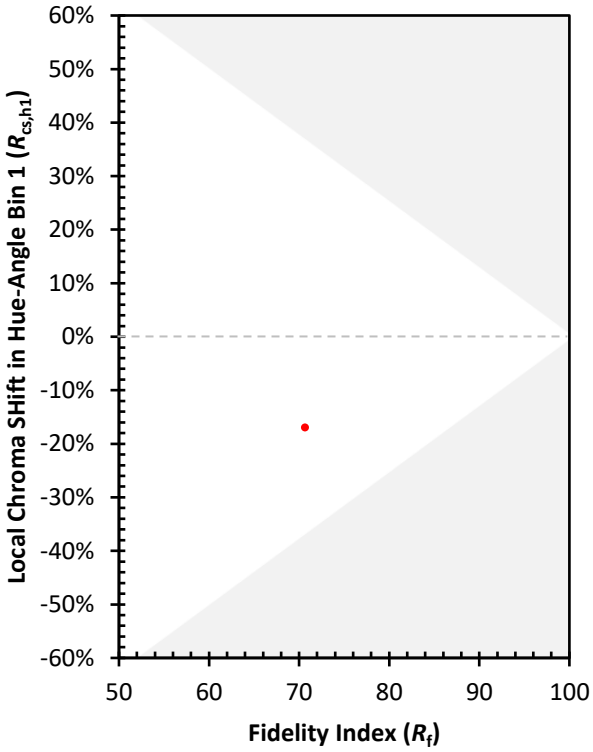

(END OF REPORT)