Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1364629

Luminaire Tested: **GSS-SB2C-750-U-SLR-HSS**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1364629
Test Lab:	INNOVATION CENTER(G1)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB2C-750-U-SLR-HSS
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 2SQUARE 102W 70CRI 5000K FIXTURE w/ 90° Spill Light Eliminator RIGHT OPTIC AND HOUSE SIDE SHIELD
Light Source:	(52) 5000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	11046.5 lumens
Efficiency:	N/A
Efficacy:	108.3 lumens/watt
Luminous Opening:	Rectangular (W 1' x L: 0.5' x H: 0')
IES Classification:	Type III - Short
BUG Rating:	B1 - U0 - G2


Input Watts (W):	102
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	9.5%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1364629
CATALOG NUMBER: GSS-SB2C-750-U-SLR-HSS

Iso-Footcandle Lines of Horizontal Illumination

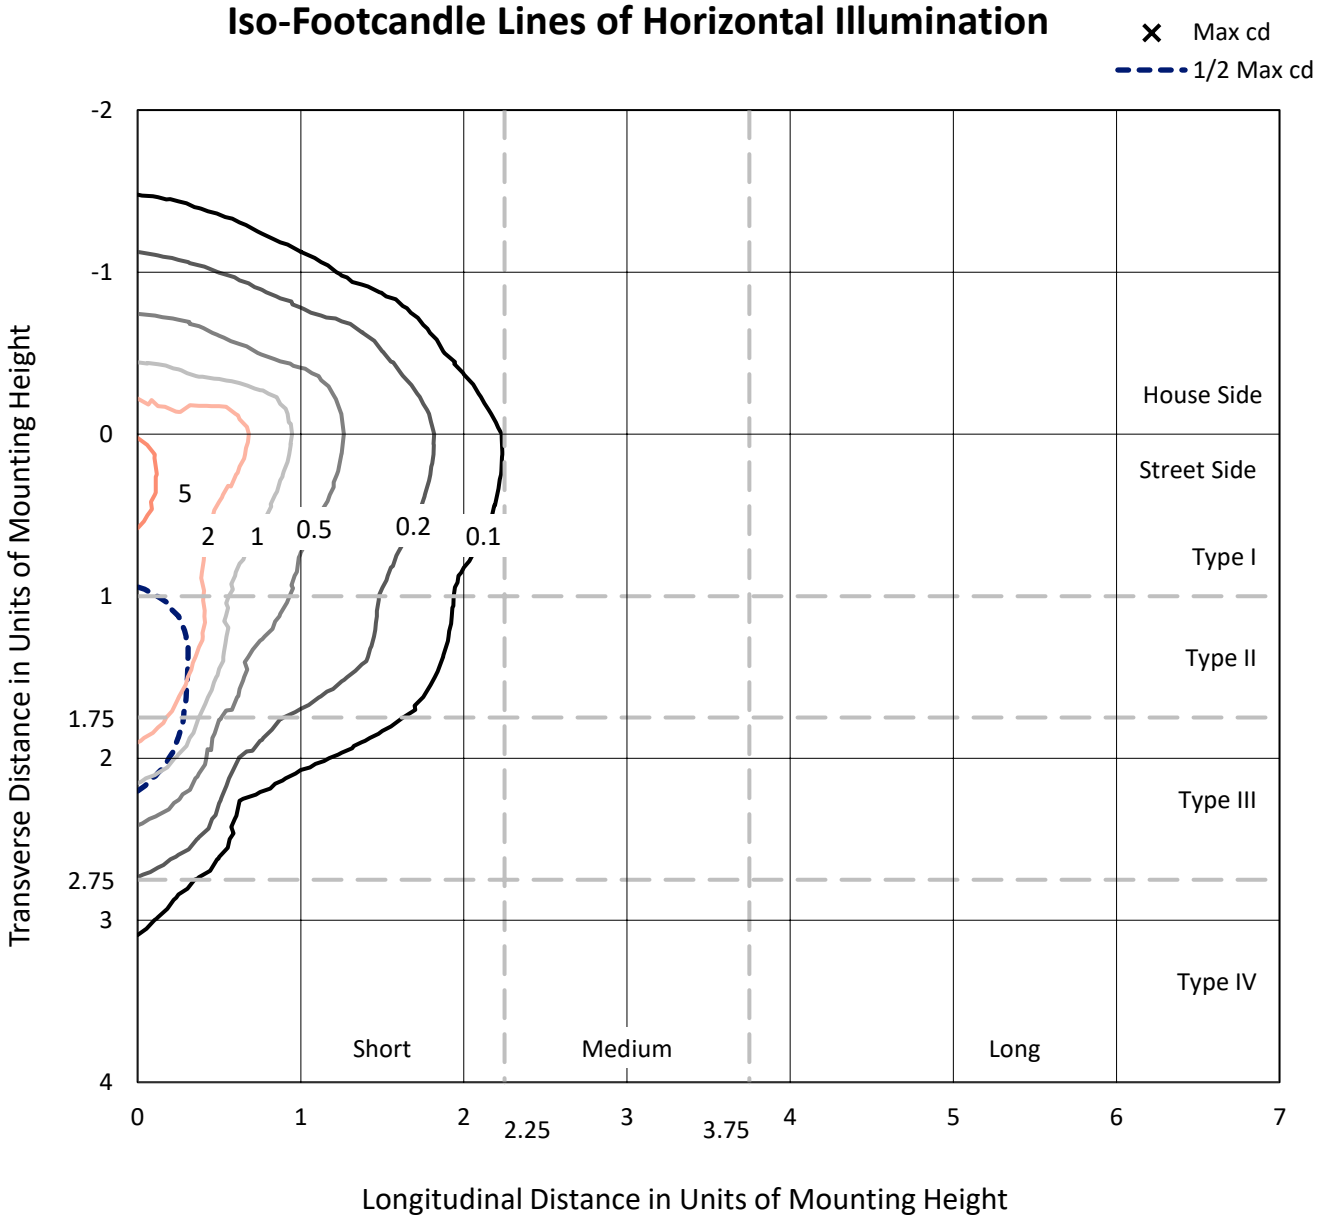


Based on 20 foot mounting height. Maximum calculated value = 6 fc
Type III - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1364629
CATALOG NUMBER: GSS-SB2C-750-U-SLR-HSS

Luminous Intensity Polar Plot

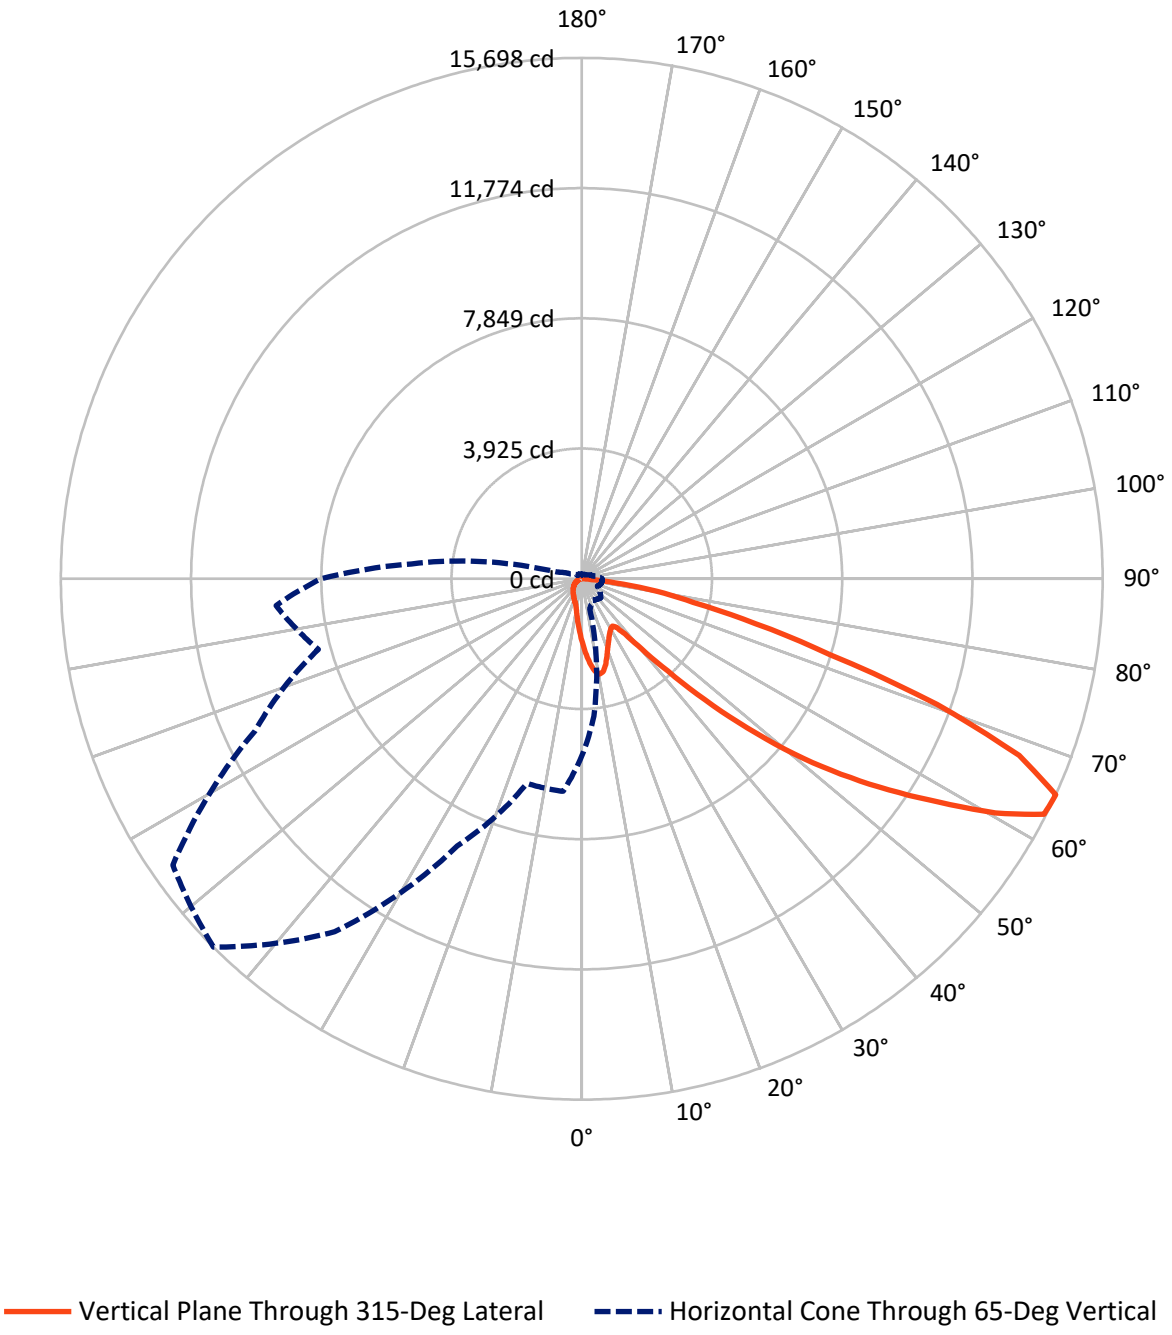

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1364629
CATALOG NUMBER: GSS-SB2C-750-U-SLR-HSS

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	1785.7	0.0	1785.7
	% Fixture	16.2	0.0	16.2
Street Side	Lumens	9260.7	0.0	9260.7
	% Fixture	83.8	0.0	83.8
Total	Lumens	11046.5	0.0	11046.5
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	183.5	1.7
10°-20°	507.6	4.6
20°-30°	727.0	6.6
30°-40°	911.9	8.3
40°-50°	1497.9	13.6
50°-60°	2703.1	24.5
60°-70°	2999.9	27.2
70°-80°	1355.4	12.3
80°-90°	160.3	1.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	11046.5	100.0
0°-180°	11046.5	100.0

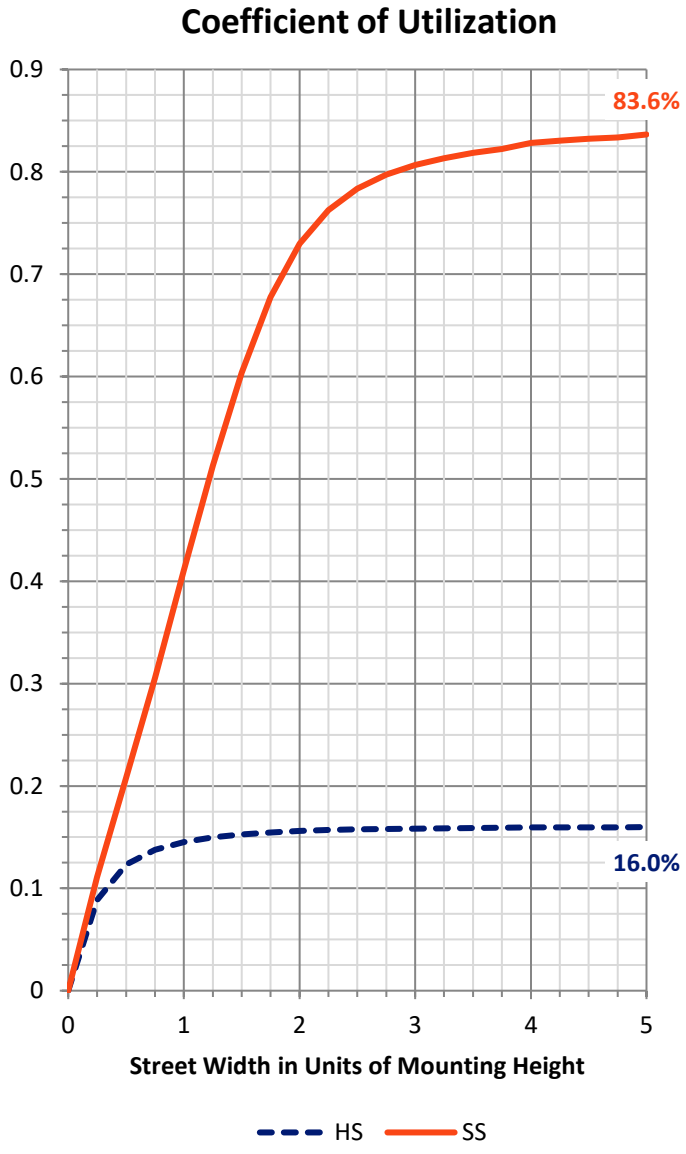

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1364629
CATALOG NUMBER: GSS-SB2C-750-U-SLR-HSS

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	946.2	8.6			
FM	(30°-60°)	4194.6	38.0			
FH	(60°-80°)	3976.0	36.0			G2/5000
FVH	(80°-90°)	143.9	1.3			G2/225
BL	(0°-30°)	471.9	4.3	B1/500		
BM	(30°-60°)	918.2	8.3	B1/1000		
BH	(60°-80°)	379.2	3.4	B1/500		G1/500
BVH	(80°-90°)	16.4	0.1			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B1-U0-G2
Type III Short

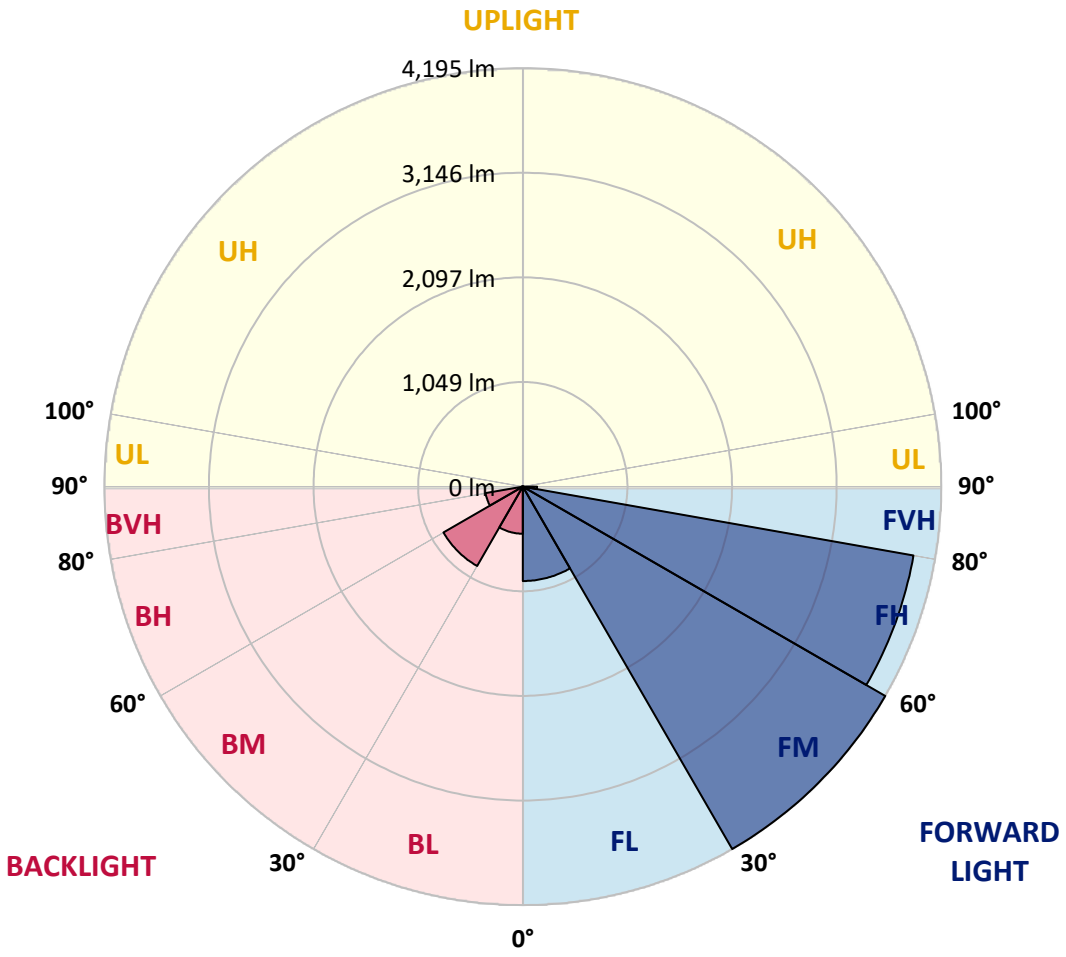

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1364629
CATALOG NUMBER: GSS-SB2C-750-U-SLR-HSS

CANDELA DISTRIBUTION (FULL):

	0°	1°	5°	15°	25°	35°	45°	55°	65°	75°	85°
0°	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7
2.5°	2153.9	2151.9	2143.8	2092.9	2042.0	1997.9	1953.8	1909.7	1848.6	1801.2	1760.5
5°	2357.4	2346.6	2303.2	2225.2	2140.4	2065.7	1980.9	1899.5	1807.9	1733.3	1655.3
7.5°	2496.5	2485.7	2442.3	2313.4	2184.5	2092.9	2001.3	1916.5	1814.7	1716.4	1604.4
10°	2561.0	2548.8	2499.9	2360.8	2211.6	2099.7	2008.1	1930.1	1845.3	1746.9	1607.8
12.5°	2605.1	2590.1	2530.4	2371.0	2218.4	2106.4	2011.5	1936.8	1875.8	1818.1	1682.4
15°	2632.2	2618.6	2564.4	2398.2	2221.8	2096.3	1984.3	1913.1	1892.7	1902.9	1838.5
17.5°	2672.9	2660.0	2608.5	2432.1	2242.1	2079.3	1926.7	1848.6	1892.7	1984.3	2004.7
20°	2727.2	2713.6	2659.3	2476.2	2259.1	2028.4	1818.1	1743.5	1855.4	2008.1	2113.2
22.5°	2788.2	2777.4	2734.0	2527.1	2276.0	1953.8	1675.7	1641.7	1777.4	1940.2	2075.9
25°	2862.9	2852.7	2812.0	2598.3	2293.0	1852.0	1553.5	1560.3	1675.7	1804.6	1943.6
27.5°	2964.6	2955.1	2917.1	2686.5	2313.4	1746.9	1455.2	1489.1	1573.9	1662.1	1746.9
30°	3076.6	3069.1	3039.2	2791.6	2354.1	1648.5	1397.5	1417.9	1475.5	1546.8	1597.6
32.5°	3229.2	3217.0	3168.1	2890.0	2350.7	1573.9	1370.4	1350.0	1367.0	1424.6	1475.5
35°	3419.2	3409.7	3371.7	2991.8	2289.6	1506.1	1356.8	1285.6	1275.4	1309.3	1360.2
37.5°	3697.3	3689.2	3656.6	3158.0	2194.6	1421.3	1322.9	1217.7	1183.8	1207.6	1241.5
40°	4114.5	4093.5	4009.4	3347.9	2089.5	1336.5	1261.8	1136.3	1088.8	1105.8	1143.1
42.5°	4681.0	4641.0	4480.9	3602.3	1947.0	1255.0	1170.2	1054.9	1004.0	1014.2	1048.1
45°	5406.9	5346.5	5105.0	3951.7	1797.8	1190.6	1075.3	970.1	915.8	926.0	963.3
47.5°	6254.9	6172.1	5841.0	4318.0	1638.3	1153.3	1000.6	885.3	844.6	868.4	905.7
50°	7255.5	7172.1	6838.3	4552.1	1509.4	1129.5	943.0	807.3	790.3	820.9	851.4
52.5°	8347.7	8229.0	7754.1	4402.8	1404.3	1109.2	922.6	753.0	759.8	783.6	814.1
55°	9409.4	9145.5	8090.0	3907.6	1268.6	1085.4	936.2	712.3	729.3	759.8	783.6
57.5°	10101.4	9642.8	7808.4	3147.8	1126.1	1058.3	946.4	692.0	705.5	739.5	766.6
60°	9497.6	9036.3	7191.1	2357.4	1004.0	1000.6	929.4	685.2	664.8	712.3	736.1
62.5°	7781.3	7401.4	5881.8	1506.1	888.7	892.1	892.1	681.8	597.0	658.1	678.4
65°	*5345.8*	*5108.4*	*4158.6*	*932.8*	*725.9*	*759.8*	*810.7*	*661.4*	*525.8*	*597.0*	*617.3*
67.5°	3514.1	3339.8	2642.4	576.6	559.7	624.1	702.1	620.7	471.5	535.9	549.5
70°	1906.3	1774.0	1244.9	379.9	366.3	488.5	552.9	525.8	424.0	478.3	491.8
72.5°	1258.4	1149.9	715.7	268.0	268.0	383.3	386.7	430.8	379.9	424.0	437.6
75°	946.4	849.4	461.3	186.6	206.9	244.2	301.9	308.7	318.8	359.6	376.5
77.5°	434.2	381.3	169.6	111.9	152.6	169.6	230.7	196.7	237.4	268.0	274.8
80°	251.0	219.8	95.0	74.6	98.4	108.5	190.0	115.3	142.5	190.0	200.1
82.5°	105.2	93.6	47.5	50.9	61.1	64.4	105.2	81.4	91.6	125.5	122.1
85°	30.5	30.5	30.5	33.9	37.3	37.3	61.1	57.7	54.3	57.7	57.7
87.5°	20.4	20.4	20.4	20.4	23.7	23.7	27.1	30.5	33.9	33.9	33.9
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1364629
CATALOG NUMBER: GSS-SB2C-750-U-SLR-HSS

CANDELA DISTRIBUTION (continued):

	90°	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
0°	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7
2.5°	1743.5	1719.8	1689.2	1645.1	1638.3	1614.6	1597.6	1614.6	1631.6	1662.1	1665.5
5°	1614.6	1577.3	1506.1	1451.8	1390.7	1360.2	1356.8	1350.0	1370.4	1414.5	1441.6
7.5°	1543.4	1482.3	1353.4	1258.4	1173.6	1143.1	1119.4	1139.7	1136.3	1194.0	1217.7
10°	1526.4	1431.4	1251.7	1109.2	1004.0	963.3	939.6	936.2	943.0	976.9	1000.6
12.5°	1587.5	1465.4	1210.9	1000.6	878.5	834.4	807.3	783.6	783.6	790.3	820.9
15°	1723.1	1577.3	1234.7	949.8	817.5	759.8	715.7	685.2	661.4	664.8	668.2
17.5°	1913.1	1740.1	1295.7	932.8	780.2	719.1	664.8	634.3	607.2	600.4	600.4
20°	2062.3	1896.1	1343.2	919.2	749.6	671.6	624.1	597.0	573.3	563.1	563.1
22.5°	2079.3	1960.6	1383.9	902.3	712.3	624.1	580.0	556.3	539.3	535.9	535.9
25°	1967.4	1909.7	1370.4	881.9	675.0	580.0	546.1	525.8	508.8	505.4	508.8
27.5°	1780.8	1750.3	1322.9	854.8	644.5	546.1	515.6	498.6	481.7	478.3	481.7
30°	1614.6	1580.7	1241.5	810.7	620.7	519.0	485.1	468.1	451.1	451.1	454.5
32.5°	1478.9	1445.0	1160.1	759.8	590.2	488.5	457.9	441.0	424.0	424.0	430.8
35°	1356.8	1329.7	1095.6	708.9	559.7	461.3	427.4	413.8	400.3	396.9	403.6
37.5°	1251.7	1238.1	1038.0	654.7	529.2	434.2	403.6	390.1	373.1	369.7	376.5
40°	1149.9	1143.1	973.5	607.2	491.8	407.0	376.5	362.9	342.6	342.6	349.4
42.5°	1054.9	1051.5	915.8	576.6	457.9	379.9	346.0	332.4	315.5	315.5	322.2
45°	980.3	976.9	861.6	559.7	424.0	349.4	318.8	301.9	288.3	291.7	298.5
47.5°	912.5	905.7	803.9	563.1	407.0	329.0	288.3	271.4	261.2	268.0	278.1
50°	858.2	851.4	763.2	566.5	379.9	301.9	264.6	247.6	240.8	251.0	261.2
52.5°	824.3	817.5	722.5	546.1	346.0	281.5	240.8	230.7	230.7	240.8	247.6
55°	790.3	783.6	654.7	502.0	308.7	261.2	223.9	217.1	217.1	227.3	234.0
57.5°	770.0	756.4	583.4	451.1	278.1	237.4	206.9	206.9	206.9	210.3	213.7
60°	739.5	705.5	508.8	386.7	254.4	213.7	193.3	190.0	190.0	186.6	190.0
62.5°	675.0	617.3	427.4	329.0	227.3	193.3	176.4	173.0	162.8	152.6	156.0
65°	*610.6*	*522.4*	*339.2*	*274.8*	*196.7*	*166.2*	*156.0*	*152.6*	*135.7*	*122.1*	*125.5*
67.5°	529.2	417.2	254.4	230.7	169.6	142.5	132.3	132.3	122.1	111.9	111.9
70°	471.5	325.6	213.7	173.0	135.7	111.9	111.9	118.7	108.5	95.0	95.0
72.5°	417.2	264.6	173.0	139.1	105.2	88.2	95.0	98.4	88.2	78.0	78.0
75°	356.2	206.9	135.7	108.5	78.0	67.8	71.2	78.0	71.2	61.1	64.4
77.5°	257.8	142.5	91.6	71.2	57.7	50.9	54.3	54.3	50.9	47.5	47.5
80°	179.8	95.0	61.1	47.5	40.7	37.3	37.3	33.9	33.9	37.3	37.3
82.5°	108.5	67.8	44.1	37.3	30.5	23.7	23.7	27.1	27.1	30.5	30.5
85°	47.5	40.7	30.5	27.1	20.4	17.0	20.4	20.4	23.7	27.1	27.1
87.5°	30.5	30.5	23.7	20.4	17.0	13.6	13.6	17.0	17.0	20.4	23.7
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1364629
CATALOG NUMBER: GSS-SB2C-750-U-SLR-HSS

CANDELA DISTRIBUTION (continued):

	185°	195°	205°	215°	225°	235°	245°	255°	265°	270°	275°
0°	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7
2.5°	1679.0	1713.0	1753.7	1811.3	1862.2	1923.3	1984.3	2042.0	2096.3	2103.0	2126.8
5°	1462.0	1526.4	1607.8	1702.8	1818.1	1940.2	2059.0	2184.5	2286.2	2323.5	2377.8
7.5°	1238.1	1319.5	1438.2	1584.1	1746.9	1930.1	2113.2	2289.6	2442.3	2513.5	2584.7
10°	1024.4	1102.4	1248.3	1424.6	1635.0	1882.6	2126.8	2364.2	2550.8	2632.2	2700.0
12.5°	831.0	909.1	1027.8	1231.3	1485.7	1784.2	2106.4	2391.4	2598.3	2683.1	2747.5
15°	678.4	742.9	854.8	1044.7	1312.7	1648.5	2035.2	2371.0	2608.5	2689.9	2737.4
17.5°	597.0	614.0	685.2	858.2	1149.9	1526.4	1943.6	2343.9	2615.2	2689.9	2717.0
20°	563.1	563.1	576.6	668.2	953.2	1397.5	1875.8	2326.9	2625.4	2700.0	2696.7
22.5°	532.5	539.3	539.3	559.7	725.9	1217.7	1804.6	2320.1	2655.9	2713.6	2666.1
25°	505.4	515.6	515.6	522.4	569.9	1004.0	1716.4	2333.7	2710.2	2740.7	2645.8
27.5°	481.7	491.8	491.8	498.6	508.8	746.2	1570.5	2337.1	2771.3	2774.7	2618.6
30°	457.9	468.1	474.9	474.9	481.7	549.5	1387.3	2316.7	2839.1	2818.8	2615.2
32.5°	430.8	444.4	447.7	454.5	457.9	478.3	1149.9	2282.8	2923.9	2879.8	2618.6
35°	407.0	424.0	427.4	427.4	434.2	454.5	919.2	2245.5	3039.2	2961.2	2632.2
37.5°	383.3	396.9	400.3	403.6	410.4	430.8	729.3	2191.2	3137.6	3063.0	2700.0
40°	356.2	373.1	376.5	379.9	386.7	407.0	627.5	2123.4	3286.9	3232.6	2801.8
42.5°	329.0	346.0	352.8	356.2	359.6	386.7	573.3	2075.9	3527.7	3470.0	3008.7
45°	305.3	322.2	329.0	329.0	335.8	373.1	525.8	2181.1	3860.1	3833.0	3286.9
47.5°	284.9	301.9	305.3	305.3	308.7	352.8	485.1	2462.6	4368.9	4297.7	3721.0
50°	268.0	281.5	288.3	281.5	284.9	335.8	508.8	2927.3	5020.2	5043.9	4358.7
52.5°	254.4	268.0	271.4	257.8	257.8	312.1	539.3	3307.2	5851.2	6068.3	5369.6
55°	237.4	251.0	254.4	237.4	237.4	274.8	468.1	3331.0	6797.6	7496.4	6685.7
57.5°	220.5	234.0	234.0	220.5	217.1	237.4	379.9	2954.4	7530.3	9114.3	8486.8
60°	200.1	213.7	210.3	203.5	196.7	217.1	349.4	2252.3	7431.9	10169.3	10552.6
62.5°	162.8	183.2	190.0	186.6	173.0	196.7	325.6	1468.7	6431.3	9253.4	10488.1
65°	*135.7*	*152.6*	*162.8*	*162.8*	*152.6*	*217.1*	*284.9*	*773.4*	*5149.1*	*7852.5*	*9246.6*
67.5°	118.7	135.7	142.5	139.1	132.3	193.3	179.8	373.1	3948.3	6767.1	8276.5
70°	105.2	118.7	125.5	115.3	108.5	156.0	128.9	220.5	2642.4	5647.7	7370.8
72.5°	84.8	98.4	105.2	95.0	84.8	115.3	98.4	145.9	1719.8	4813.3	6550.0
75°	67.8	81.4	84.8	78.0	67.8	84.8	78.0	101.8	1122.8	3982.2	5569.7
77.5°	50.9	57.7	64.4	61.1	50.9	61.1	54.3	71.2	641.1	2795.0	3907.6
80°	40.7	44.1	44.1	44.1	40.7	37.3	37.3	47.5	288.3	1377.2	2038.6
82.5°	33.9	37.3	37.3	33.9	30.5	27.1	23.7	27.1	84.8	617.3	939.6
85°	30.5	33.9	27.1	23.7	20.4	17.0	10.2	10.2	23.7	98.4	183.2
87.5°	23.7	20.4	17.0	13.6	6.8	3.4	3.4	0.0	3.4	3.4	3.4
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1364629
CATALOG NUMBER: GSS-SB2C-750-U-SLR-HSS

CANDELA DISTRIBUTION (continued):

	285°	295°	305°	315°	325°	335°	345°	355°	359°	360°
0°	1909.7	1909.7	1909.7	*1909.7*	1909.7	1909.7	1909.7	1909.7	1909.7	1909.7
2.5°	2164.1	2198.0	2221.8	*2242.1*	2235.3	2218.4	2184.5	2160.7	2155.3	2153.9
5°	2449.0	2503.3	2550.8	*2544.0*	2550.8	2499.9	2449.0	2388.0	2363.6	2357.4
7.5°	2686.5	2754.3	2812.0	*2805.2*	2784.8	2727.2	2642.4	2550.8	2507.4	2496.5
10°	2815.4	2893.4	2940.9	*2923.9*	2890.0	2815.4	2730.6	2622.0	2573.2	2561.0
12.5°	2839.1	2890.0	2879.8	*2873.0*	2866.3	2828.9	2764.5	2666.1	2617.3	2605.1
15°	2778.1	2757.7	2700.0	*2686.5*	2737.4	2784.8	2771.3	2689.9	2643.7	2632.2
17.5°	2676.3	2571.1	2466.0	*2452.4*	2537.2	2669.5	2774.7	2727.2	2683.8	2672.9
20°	2564.4	2367.6	2252.3	*2228.6*	2333.7	2530.4	2737.4	2764.5	2734.6	2727.2
22.5°	2432.1	2201.4	2079.3	*2065.7*	2143.8	2374.4	2683.1	2805.2	2791.6	2788.2
25°	2316.7	2055.6	1940.2	*1919.9*	2021.6	2245.5	2628.8	2873.0	2864.9	2862.9
27.5°	2221.8	1950.4	1828.3	*1814.7*	1913.1	2137.0	2561.0	2930.7	2957.8	2964.6
30°	2147.1	1872.4	1750.3	*1733.3*	1841.9	2062.3	2513.5	3012.1	3063.7	3076.6
32.5°	2089.5	1828.3	1713.0	*1702.8*	1818.1	2031.8	2486.3	3096.9	3202.7	3229.2
35°	2069.1	1841.9	1763.8	*1787.6*	1875.8	2062.3	2506.7	3236.0	3382.5	3419.2
37.5°	2113.2	1991.1	2045.4	*2106.4*	2140.4	2208.2	2601.7	3459.9	3649.8	3697.3
40°	2255.7	2391.4	2645.8	*2764.5*	2750.9	2594.9	2818.8	3775.3	4046.7	4114.5
42.5°	2618.6	3059.6	3598.9	*3799.1*	3683.7	3212.2	3164.7	4294.3	4603.6	4681.0
45°	3158.0	3866.9	4752.2	*5203.3*	4806.5	3995.8	3710.9	5033.7	5332.2	5406.9
47.5°	3697.3	4769.2	6176.9	*6712.8*	5932.6	4772.6	4426.6	5919.1	6187.7	6254.9
50°	4246.8	5766.4	7598.1	*8313.8*	7055.4	5562.9	5186.4	7011.3	7206.7	7255.5
52.5°	4813.3	6658.5	9165.2	*9782.6*	8229.0	6173.5	6054.7	8201.9	8318.6	8347.7
55°	5444.2	7503.1	10735.7	*11234.4*	9297.5	6706.0	7072.3	9446.8	9416.9	9409.4
57.5°	6285.4	8391.8	12000.9	*12696.3*	10267.6	7425.1	8432.5	10830.7	10247.3	10101.4
60°	7754.1	9772.4	13574.8	*14331.3*	11566.8	8476.6	9433.2	10800.2	9758.1	9497.6
62.5°	9456.9	11102.1	14999.5	*15637.2*	12933.7	9521.4	8636.1	9070.2	8039.1	7781.3
65°	*8215.5*	*10868.0*	*15043.6*	*15698.2*	*12984.6*	*8883.7*	*6383.8*	*6431.3*	*5562.9*	*5345.8*
67.5°	6990.9	9633.3	13700.3	*14215.9*	11583.7	7343.7	4233.2	4195.9	3650.5	3514.1
70°	6224.3	8439.3	11807.6	*11363.2*	9738.5	6207.4	2812.0	2330.3	1991.1	1906.3
72.5°	5593.4	6695.8	9568.9	*7832.2*	8079.8	5050.7	1787.6	1587.5	1324.2	1258.4
75°	5064.3	5539.2	5969.9	*5413.7*	5739.3	4162.0	1516.2	1224.5	1002.0	946.4
77.5°	4029.7	4311.2	3534.5	*3432.7*	4019.5	2961.2	753.0	515.6	450.5	434.2
80°	2398.2	2038.6	2004.7	*2286.2*	2676.3	1536.6	461.3	284.9	257.8	251.0
82.5°	1451.8	736.1	800.5	*1010.8*	1424.6	698.8	274.8	122.1	108.5	105.2
85°	244.2	200.1	308.7	*295.1*	278.1	149.2	74.6	33.9	31.2	30.5
87.5°	6.8	10.2	13.6	*17.0*	17.0	17.0	17.0	17.0	19.7	20.4
90°	0.0	0.0	0.0	*0.0*	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-6

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-750-U-5WQ

Data in this report applies to families of products including GSS-SB1A-750-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-750-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 5000K CCT 26 LEDS

Spectral Parameters

CCT (K):	4896
CIE u':	0.2101
CIE v':	0.4901
Duv:	0.0035
CIE x:	0.3489
CIE y:	0.3618
CIE z:	0.2893
Peak Wavelength (nm):	443
Dominant Wavelength (nm):	570
Purity:	13.25435
Rf:	70.7
Rg:	96.8

CRI (Ra):	70.2
R1:	68.1
R2:	73.9
R3:	79.4
R4:	72.1
R5:	69.2
R6:	65.7
R7:	78.1
R8:	55.3
R9:	-35.1
R10:	39.3
R11:	71.1
R12:	43.8
R13:	68.1
R14:	88.4
R15:	59.7

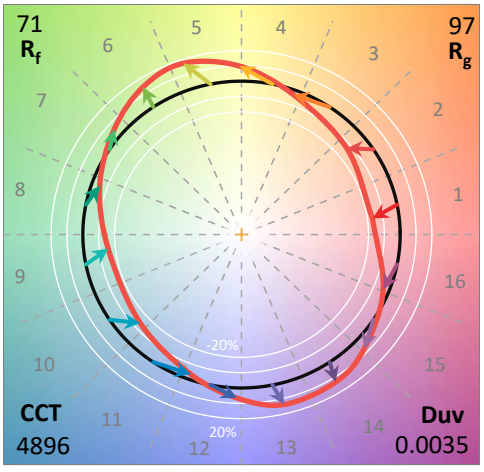

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-6

CIE 1931 Chromaticity Diagram

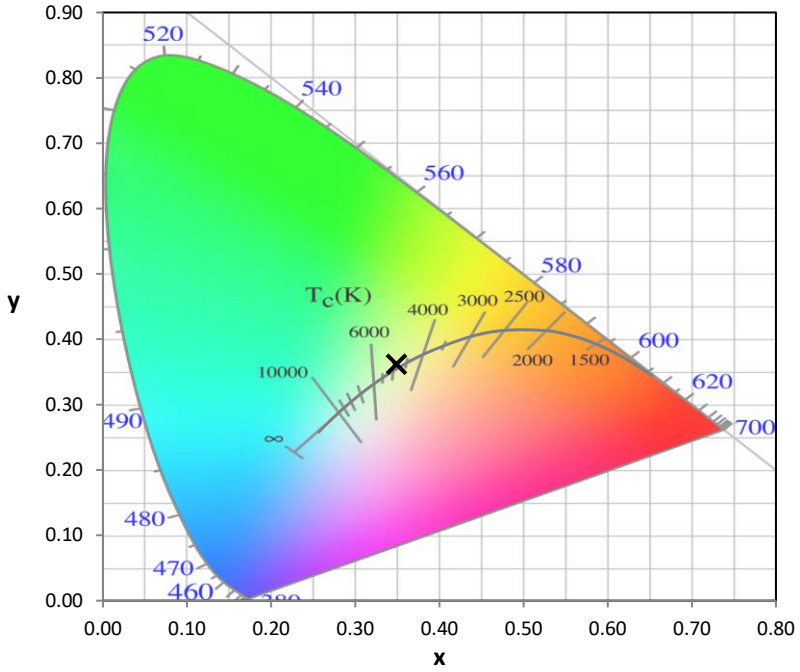

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

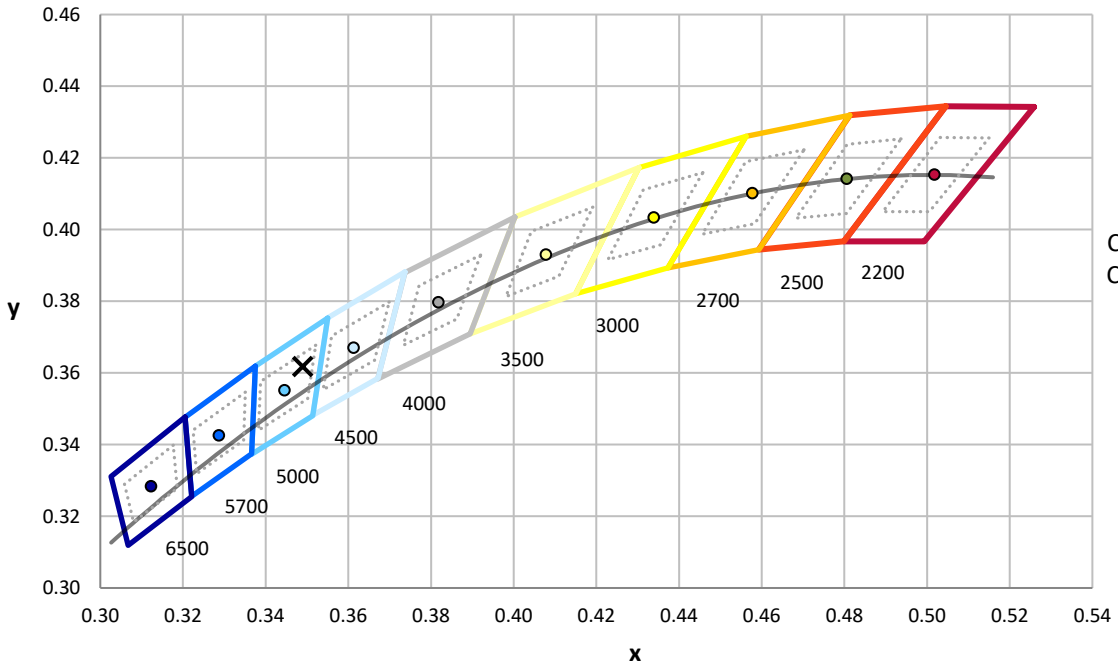


CCT = 4896K
CIE x = 0.3489
CIE y = 0.3618
Duv = 0.0035

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-6

Photopic Flux vs. Wavelength

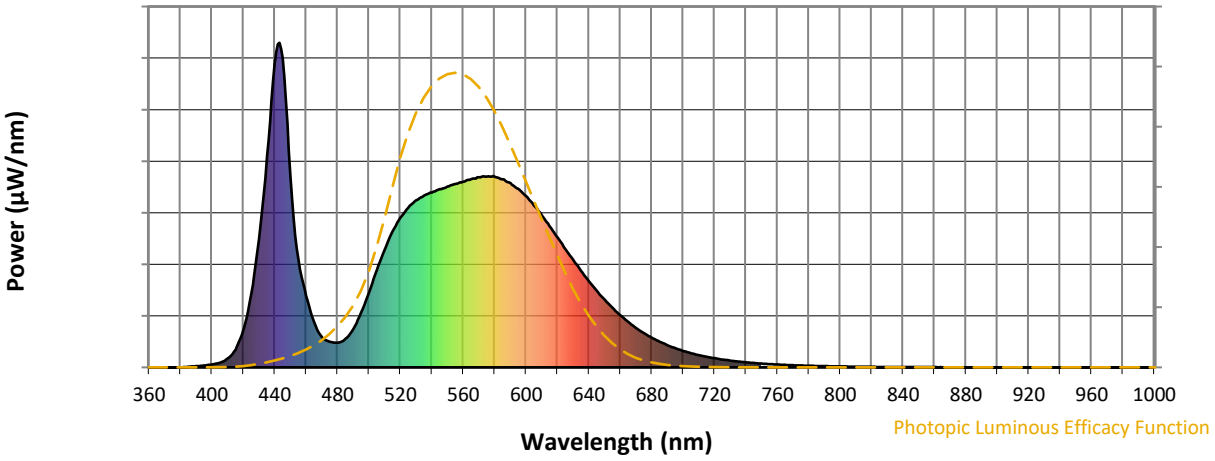


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Scotopic Flux vs. Wavelength

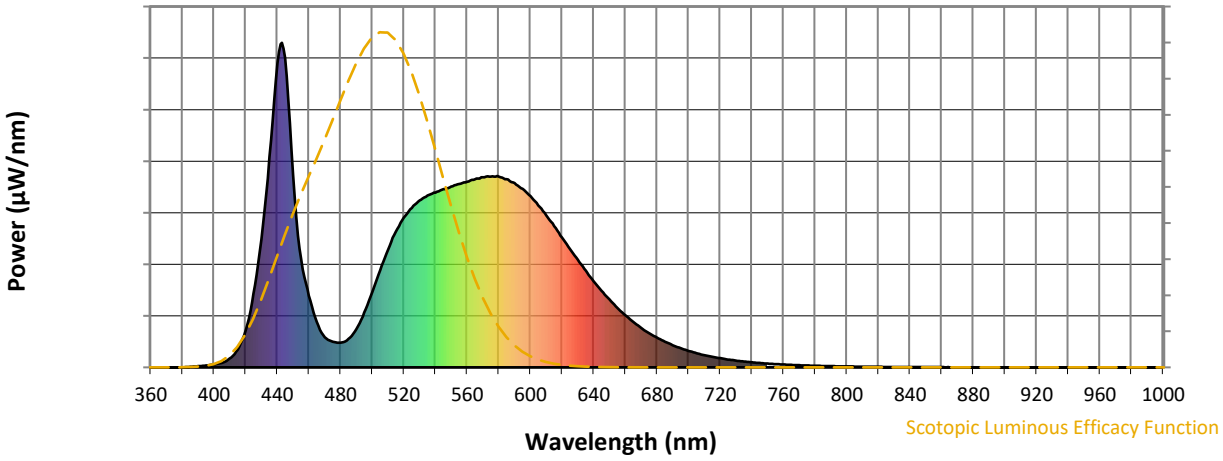


Scotopic Lumens: NR **S/P: 1.7**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Melanopic Flux vs. Wavelength

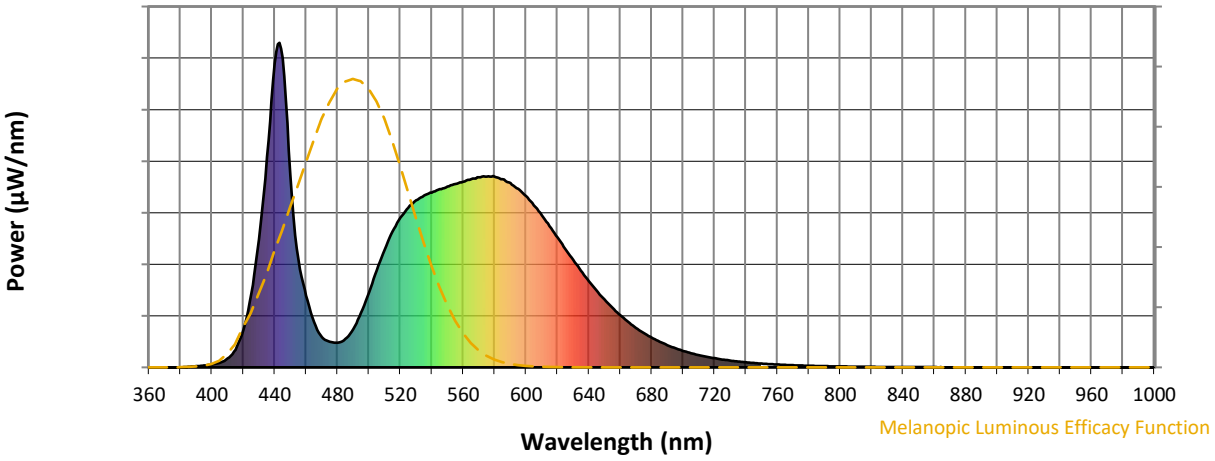

Melanopic Lumens: NR **M/P: 3.37**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			


REPORT NUMBER: SP1-2407-184-6

TM-30-18


Summary


R_f = 70.7
R_g = 96.8
CIE R_a = 70.2
R_9 = -35.1


Spectral Power Distribution Comparison

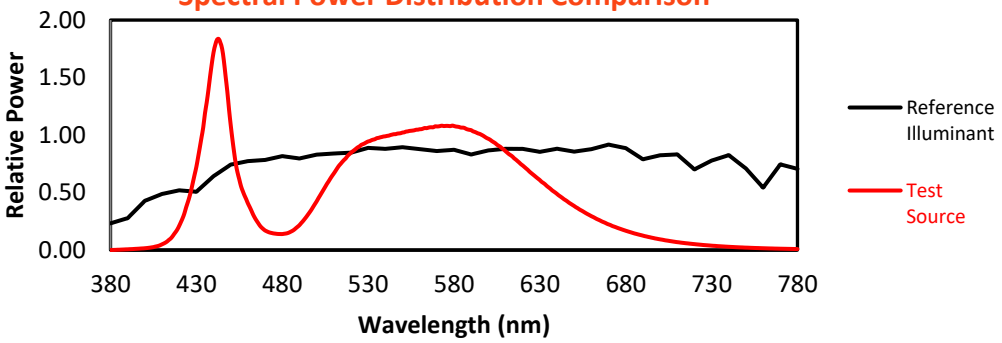


Color Vector Graphics

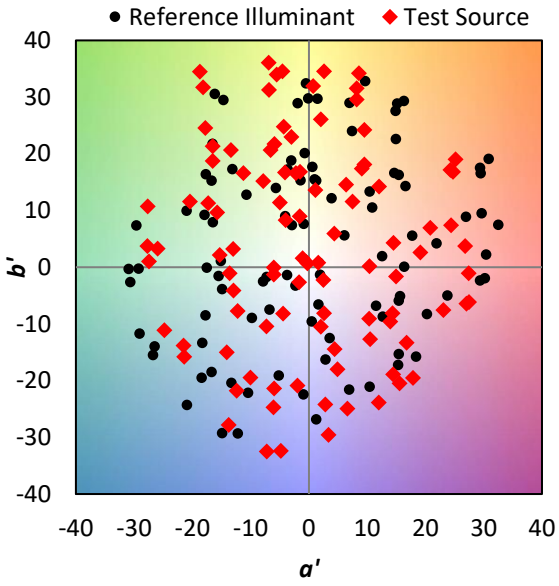

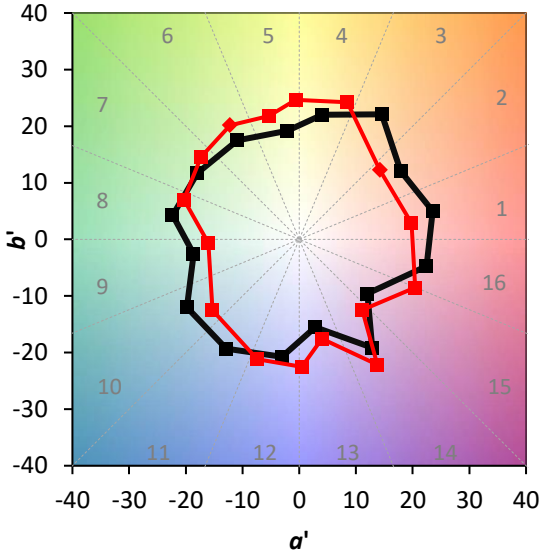

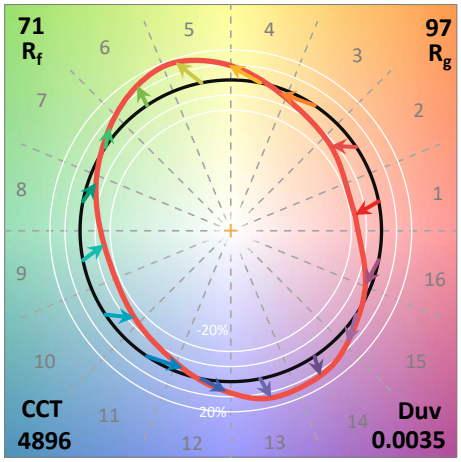

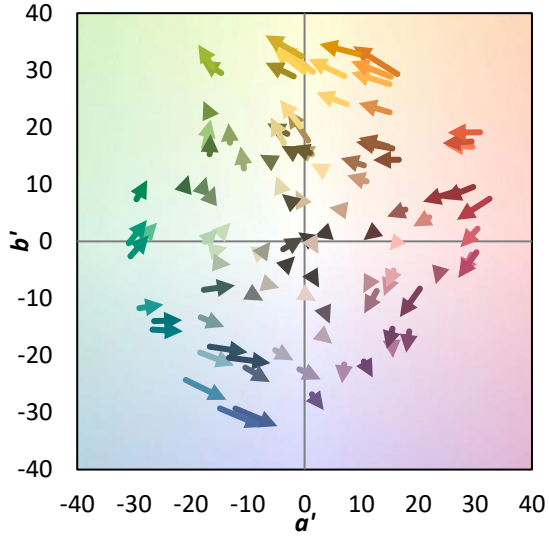


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 53	CES51 = 87	CES76 = 42
CES02 = 59	CES27 = 78	CES52 = 88	CES77 = 64
CES03 = 30	CES28 = 76	CES53 = 74	CES78 = 45
CES04 = 69	CES29 = 48	CES54 = 80	CES79 = 74
CES05 = 46	CES30 = 56	CES55 = 79	CES80 = 71
CES06 = 50	CES31 = 54	CES56 = 68	CES81 = 72
CES07 = 39	CES32 = 50	CES57 = 65	CES82 = 88
CES08 = 38	CES33 = 60	CES58 = 67	CES83 = 82
CES09 = 29	CES34 = 62	CES59 = 87	CES84 = 87
CES10 = 72	CES35 = 79	CES60 = 91	CES85 = 84
CES11 = 56	CES36 = 90	CES61 = 87	CES86 = 74
CES12 = 61	CES37 = 72	CES62 = 79	CES87 = 75
CES13 = 41	CES38 = 66	CES63 = 72	CES88 = 76
CES14 = 74	CES39 = 91	CES64 = 70	CES89 = 74
CES15 = 70	CES40 = 83	CES65 = 63	CES90 = 73
CES16 = 46	CES41 = 83	CES66 = 64	CES91 = 92
CES17 = 49	CES42 = 70	CES67 = 62	CES92 = 67
CES18 = 55	CES43 = 68	CES68 = 69	CES93 = 81
CES19 = 71	CES44 = 98	CES69 = 80	CES94 = 56
CES20 = 64	CES45 = 78	CES70 = 56	CES95 = 71
CES21 = 85	CES46 = 77	CES71 = 53	CES96 = 77
CES22 = 77	CES47 = 73	CES72 = 84	CES97 = 82
CES23 = 91	CES48 = 65	CES73 = 46	CES98 = 71
CES24 = 90	CES49 = 76	CES74 = 94	CES99 = 59
CES25 = 71	CES50 = 85	CES75 = 49	

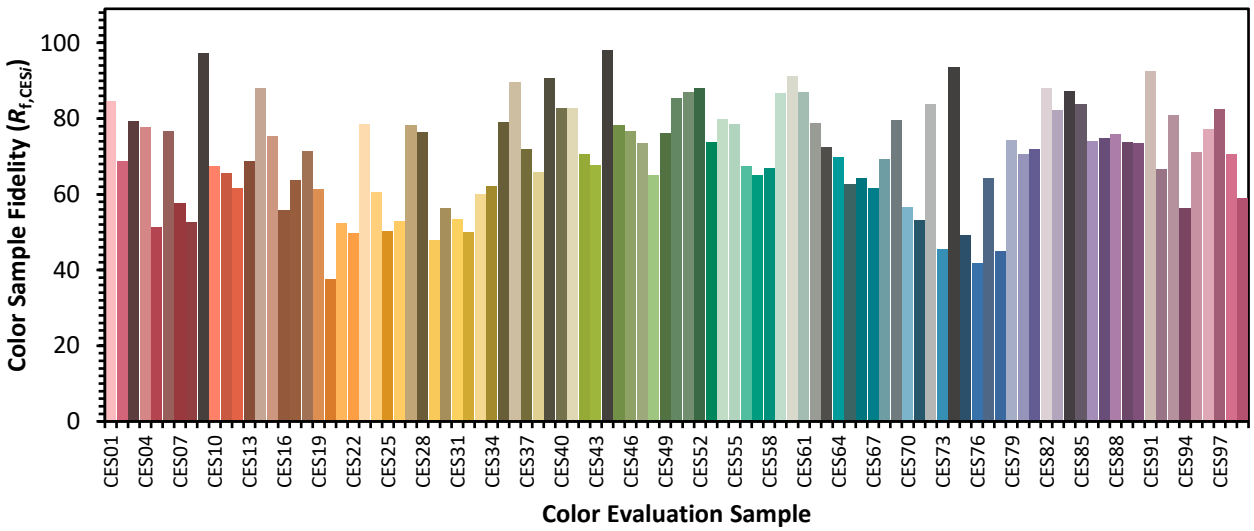



REPORT NUMBER: SP1-2407-184-6

TM-30-18

Color Rendition by Hue-Angle Bin

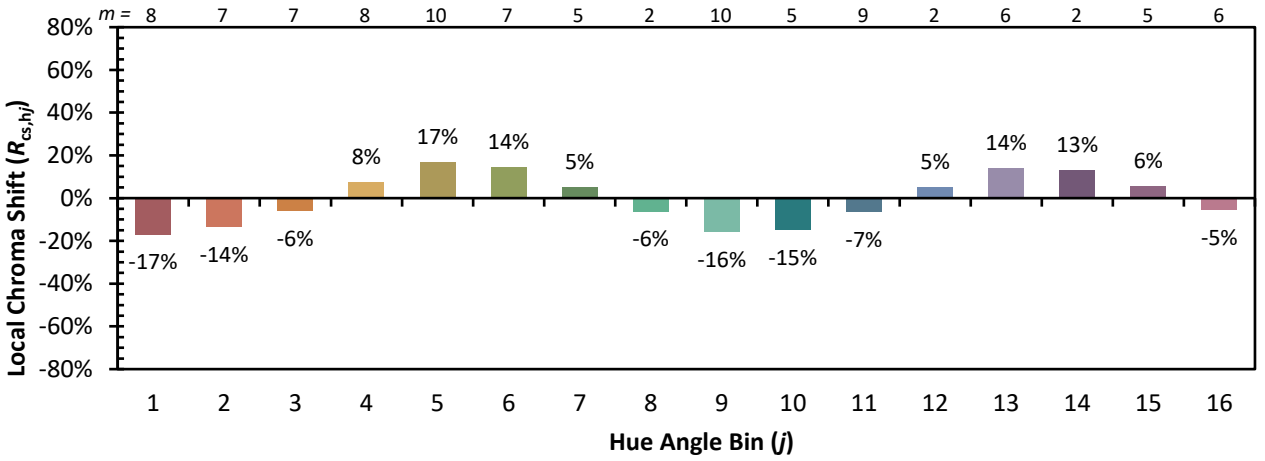

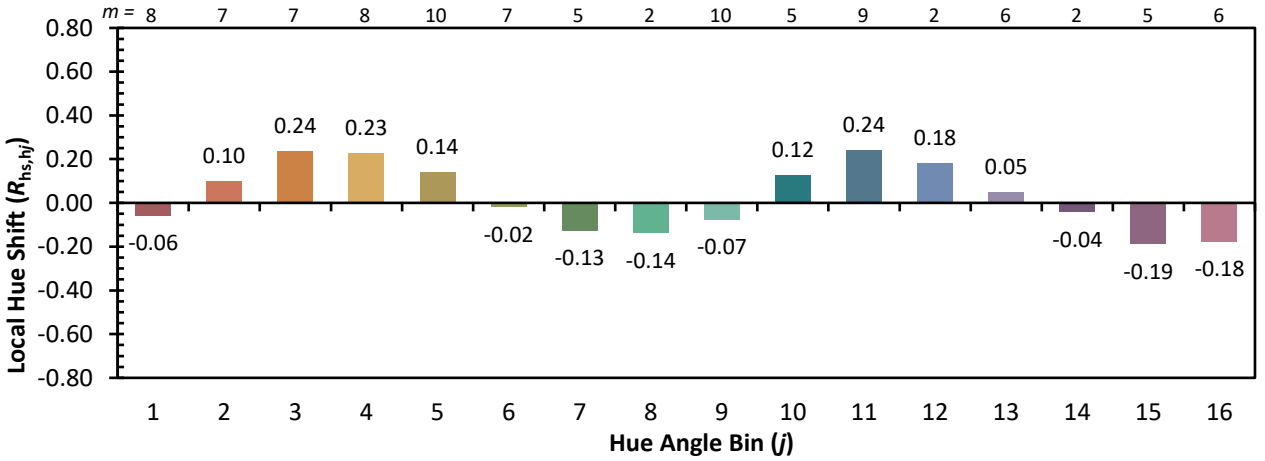


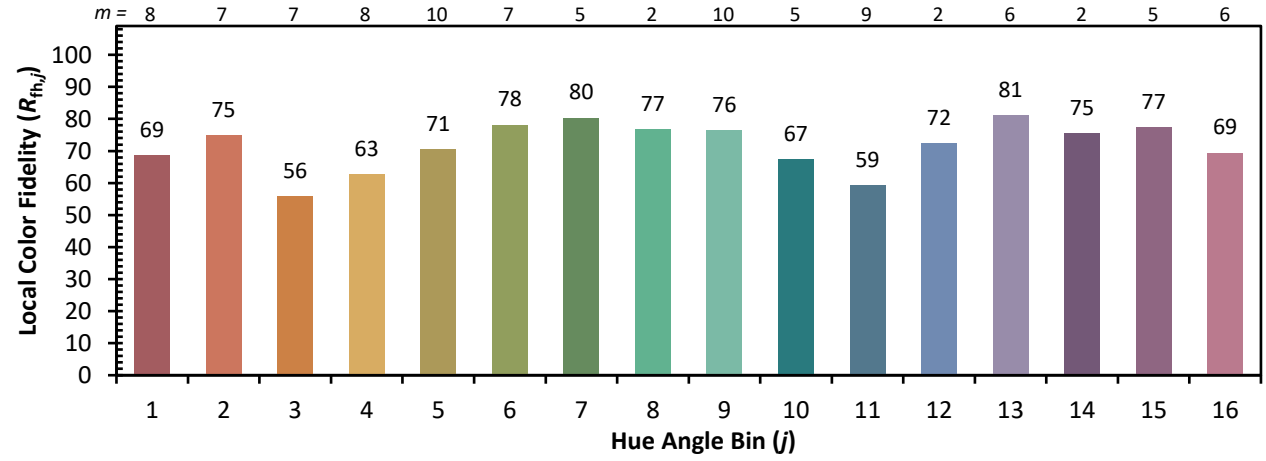


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Measure Comparisons

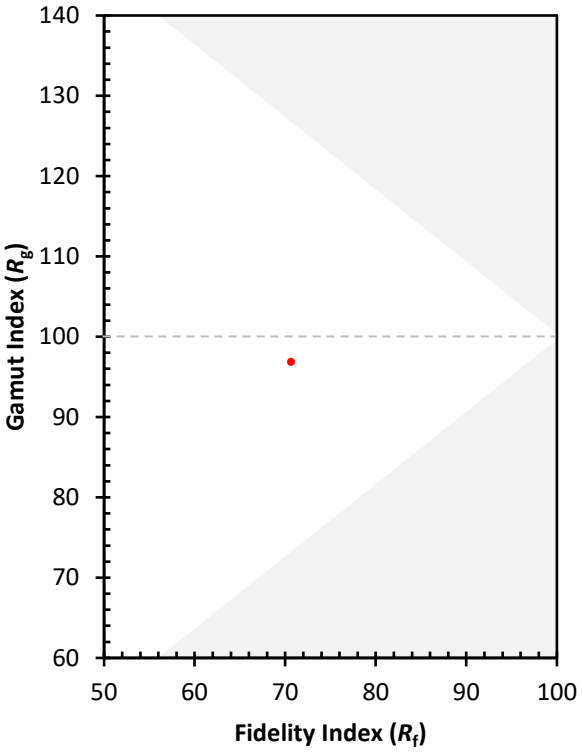

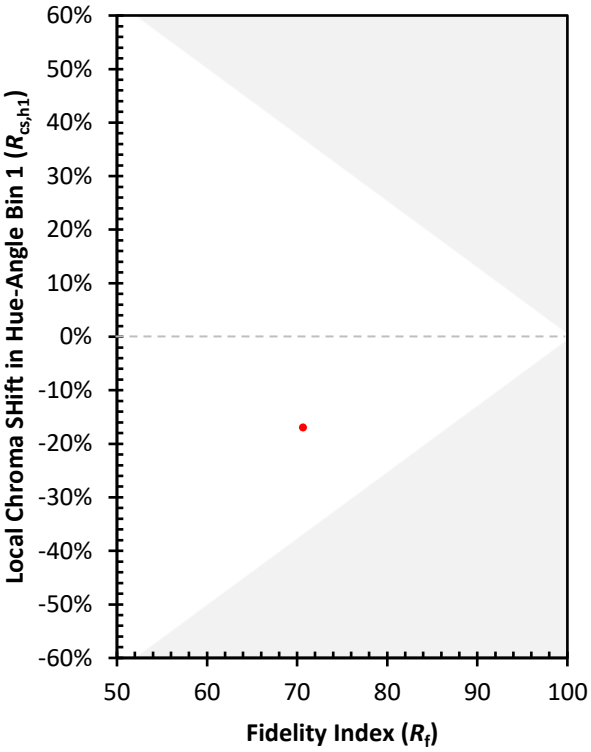

(END OF REPORT)