Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360789

Luminaire Tested: **GSS-SB2C-750-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360789
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB2C-750-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 2SQUARE 102W 70CRI 5000K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(52) 5000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	14440.2 lumens
Efficiency:	N/A
Efficacy:	141.6 lumens/watt
Luminous Opening:	Rectangular (W 1' x L: 0.5' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B3 - U0 - G3


Input Watts (W):	102
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	9.5%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360789
CATALOG NUMBER: GSS-SB2C-750-U-T1

Iso-Footcandle Lines of Horizontal Illumination

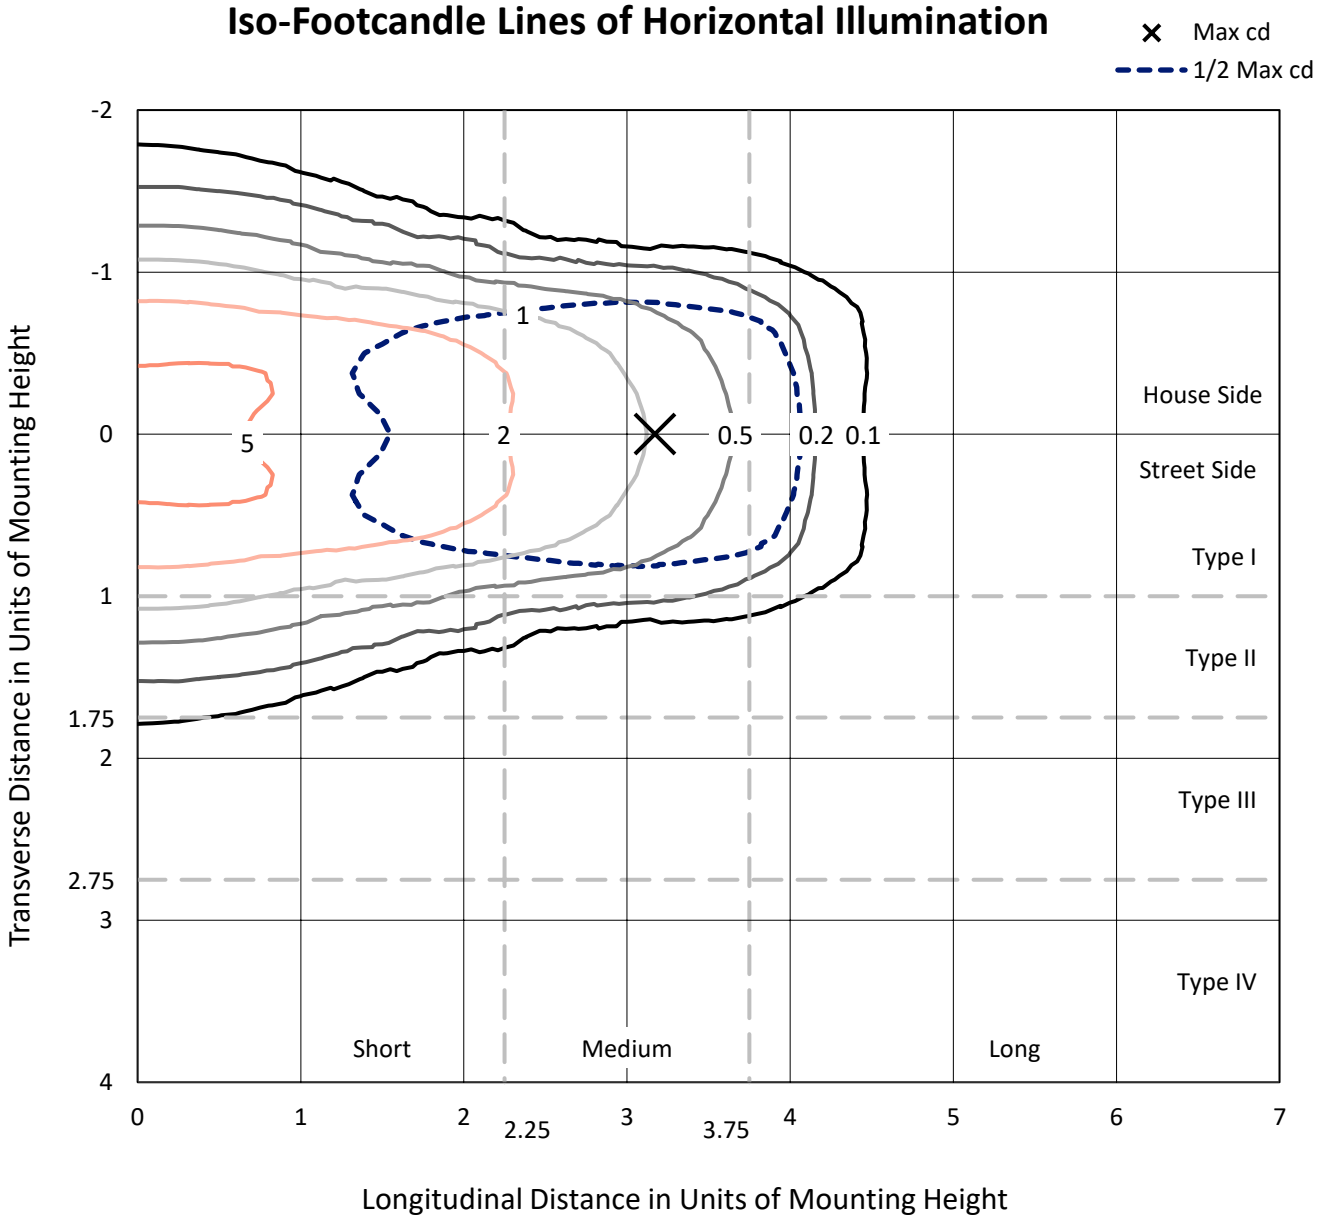


Based on 20 foot mounting height. Maximum calculated value = 7.1 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360789
CATALOG NUMBER: GSS-SB2C-750-U-T1

Luminous Intensity Polar Plot

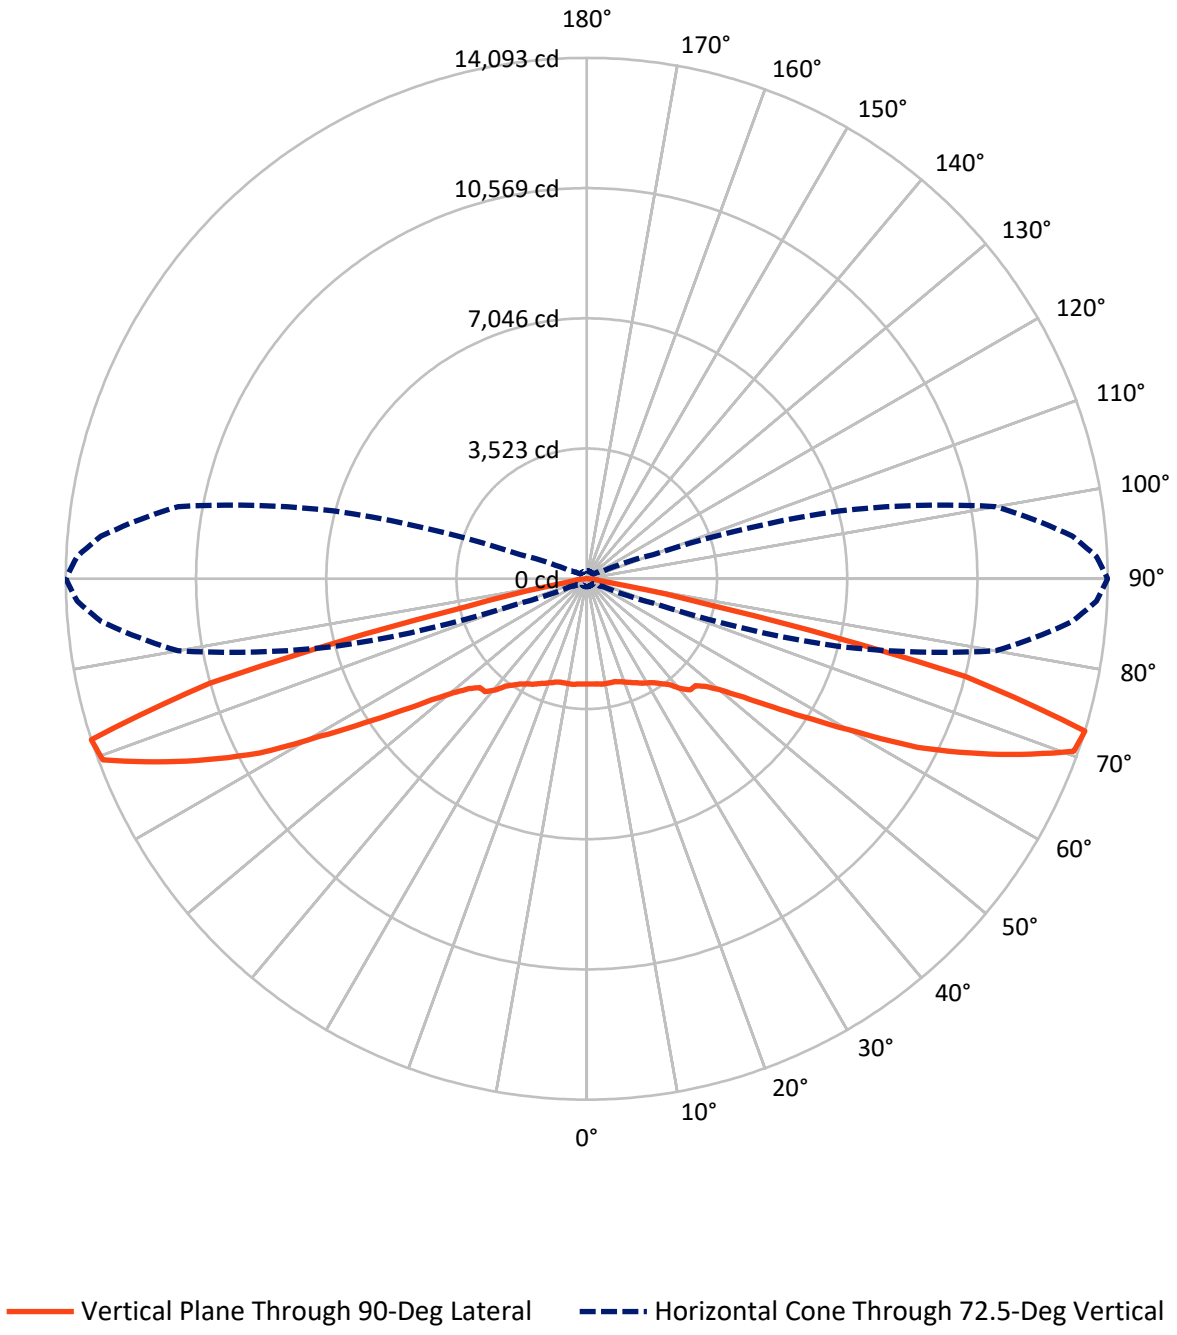

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360789
CATALOG NUMBER: GSS-SB2C-750-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	7220.1	0.0	7220.1
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	7220.1	0.0	7220.1
	% Fixture	50.0	0.0	50.0
Total	Lumens	14440.2	0.0	14440.2
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	275.4	1.9
10°-20°	839.3	5.8
20°-30°	1402.9	9.7
30°-40°	1934.6	13.4
40°-50°	2371.6	16.4
50°-60°	2779.2	19.2
60°-70°	3086.2	21.4
70°-80°	1678.3	11.6
80°-90°	72.7	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	14440.2	100.0
0°-180°	14440.2	100.0

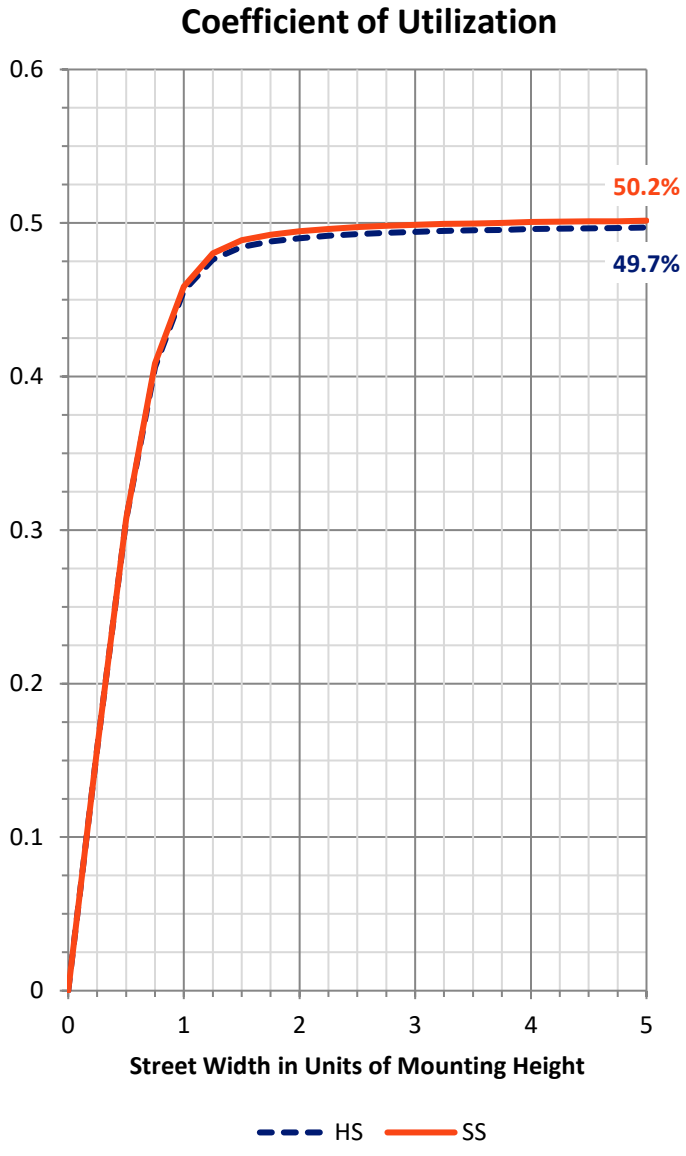

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360789
CATALOG NUMBER: GSS-SB2C-750-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	1258.8	8.7			
FM	(30°-60°)	3542.7	24.5			
FH	(60°-80°)	2382.3	16.5			G2/5000
FVH	(80°-90°)	36.4	0.3			G1/100
BL	(0°-30°)	1258.8	8.7	B3/2500		
BM	(30°-60°)	3542.7	24.5	B3/5000		
BH	(60°-80°)	2382.3	16.5	B3/2500		G3/2500
BVH	(80°-90°)	36.4	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B3-U0-G3
Type I Short

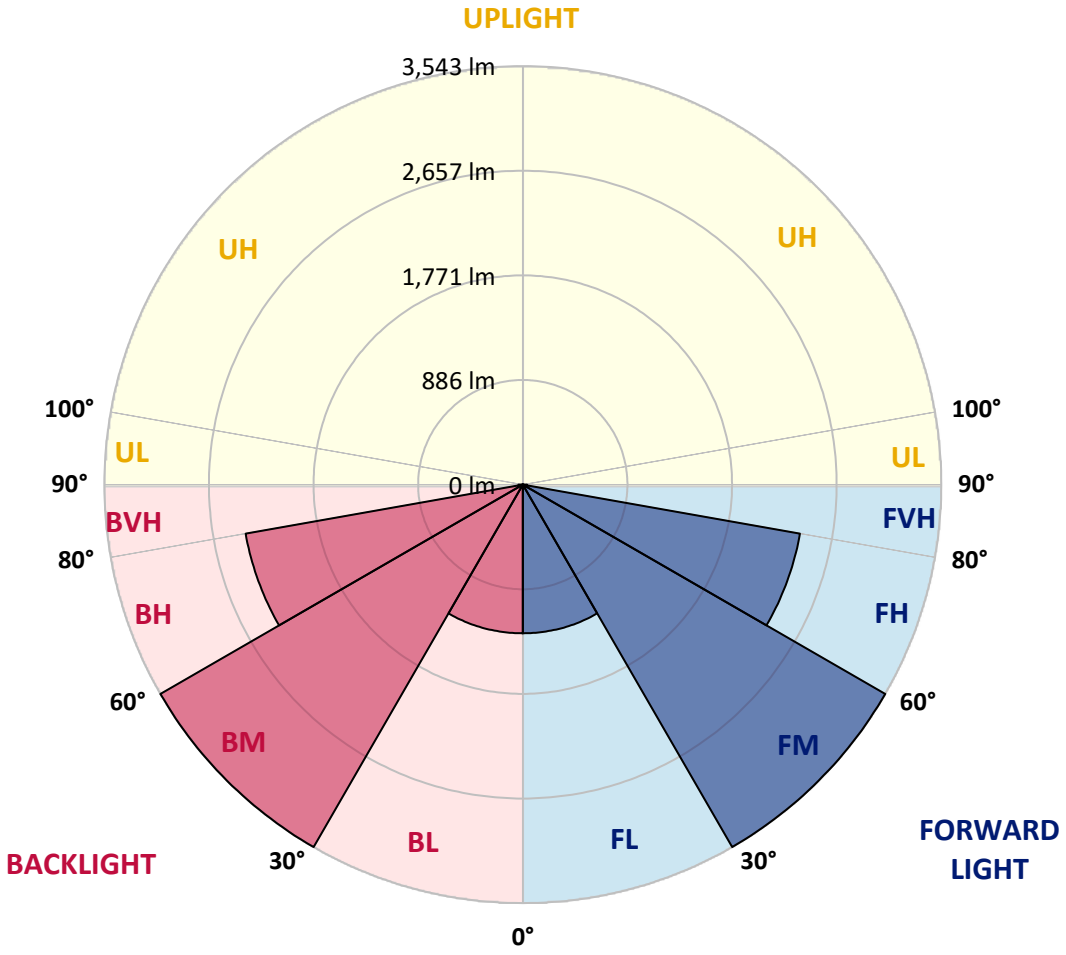

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360789
CATALOG NUMBER: GSS-SB2C-750-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	2845.1	2845.1	2845.1	2845.1	2845.1	2845.1	2845.1	2845.1	2845.1	2845.1	2845.1
2.5°	2848.2	2848.2	2838.8	2851.4	2845.1	2848.2	2851.4	2848.2	2845.1	2848.2	2851.4
5°	2864.0	2857.7	2864.0	2870.4	2860.9	2867.2	2864.0	2848.2	2857.7	2857.7	2857.7
7.5°	2892.5	2898.8	2892.5	2908.3	2898.8	2917.8	2898.8	2886.2	2883.0	2879.9	2879.9
10°	2905.1	2905.1	2902.0	2930.4	2936.8	2955.7	2943.1	2924.1	2914.6	2902.0	2889.3
12.5°	2870.4	2876.7	2892.5	2946.2	2971.5	3009.5	3000.0	2962.0	2933.6	2924.1	2905.1
15°	2832.4	2838.8	2870.4	2936.8	2996.8	3053.7	3050.6	3003.1	2968.4	2943.1	2914.6
17.5°	2772.4	2781.9	2826.1	2927.3	3034.8	3098.0	3116.9	3069.5	3031.6	2990.5	2952.6
20°	2671.2	2671.2	2750.2	2879.9	3028.4	3170.7	3221.3	3183.3	3139.1	3072.7	3022.1
22.5°	2557.4	2563.7	2642.8	2813.5	3025.3	3233.9	3331.9	3290.8	3246.6	3173.8	3098.0
25°	2443.6	2443.6	2532.1	2725.0	2984.2	3278.2	3461.5	3439.4	3350.9	3284.5	3186.5
27.5°	2339.3	2339.3	2434.1	2636.4	2914.6	3290.8	3591.1	3591.1	3493.1	3395.1	3287.7
30°	2216.0	2247.6	2355.1	2566.9	2851.4	3268.7	3686.0	3746.0	3657.5	3531.1	3373.0
32.5°	2111.7	2133.8	2244.5	2468.9	2759.7	3243.4	3793.4	3942.0	3850.3	3676.5	3499.5
35°	1988.4	1985.2	2111.7	2333.0	2630.1	3186.5	3878.8	4175.9	4087.4	3900.9	3660.7
37.5°	1827.2	1827.2	1956.8	2171.7	2506.8	3088.5	3948.3	4435.2	4368.8	4157.0	3900.9
40°	1653.3	1672.3	1786.1	2004.2	2358.3	2971.5	3948.3	4647.0	4681.7	4463.6	4198.1
42.5°	1526.9	1533.2	1637.5	1843.0	2193.9	2819.8	3897.8	4830.3	4934.6	4751.3	4406.7
45°	1394.1	1409.9	1498.4	1688.1	2023.2	2639.6	3809.2	5035.8	5203.3	5076.9	4624.8
47.5°	1232.9	1248.7	1349.8	1542.7	1861.9	2443.6	3660.7	5250.8	5601.7	5510.0	5013.7
50°	1046.4	1059.0	1153.8	1359.3	1681.8	2219.2	3474.2	5412.0	6000.0	6091.6	5601.7
52.5°	818.8	828.2	929.4	1128.5	1466.8	2004.2	3211.8	5510.0	6401.4	6723.9	6388.8
55°	588.0	603.8	692.3	856.7	1182.3	1716.5	2898.8	5560.6	6840.8	7473.1	7365.6
57.5°	423.6	429.9	490.0	616.4	878.8	1378.3	2497.3	5475.2	7236.0	8367.7	8592.1
60°	350.9	350.9	360.4	420.4	600.6	973.7	2016.8	5159.1	7574.2	9271.8	9964.1
62.5°	322.4	322.4	328.8	338.2	395.2	632.2	1441.5	4517.4	7612.2	10141.1	11468.8
65°	294.0	294.0	300.3	306.6	319.3	411.0	869.3	3306.6	6869.3	10150.6	12278.1
67.5°	268.7	268.7	271.9	275.0	281.3	300.3	477.3	2004.2	5497.3	9881.9	12587.9
70°	243.4	243.4	243.4	240.3	249.7	252.9	316.1	1017.9	3676.5	8924.1	12439.3
72.5°	*215.0*	*215.0*	*211.8*	*205.5*	*208.6*	*208.6*	*233.9*	*499.5*	*1909.4*	*7093.7*	*11231.8*
75°	183.3	186.5	173.9	167.5	164.4	167.5	186.5	284.5	853.5	4302.4	8393.0
77.5°	154.9	161.2	142.3	129.6	126.4	126.4	145.4	177.0	366.7	1561.6	3761.8
80°	117.0	120.1	104.3	91.7	91.7	88.5	107.5	129.6	173.9	464.7	844.0
82.5°	66.4	66.4	60.1	53.7	50.6	53.7	72.7	88.5	107.5	164.4	230.8
85°	15.8	15.8	19.0	22.1	22.1	28.5	41.1	47.4	56.9	66.4	88.5
87.5°	3.2	3.2	3.2	6.3	9.5	9.5	15.8	22.1	28.5	34.8	37.9
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360789
CATALOG NUMBER: GSS-SB2C-750-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	2845.1	2845.1	*2845.1*
2.5°	2851.4	2854.6	*2851.4*
5°	2870.4	2864.0	*2854.6*
7.5°	2873.5	2876.7	*2879.9*
10°	2886.2	2898.8	*2879.9*
12.5°	2898.8	2889.3	*2883.0*
15°	2908.3	2905.1	*2886.2*
17.5°	2943.1	2930.4	*2927.3*
20°	2996.8	2993.7	*2984.2*
22.5°	3060.0	3053.7	*3050.6*
25°	3151.7	3129.6	*3116.9*
27.5°	3227.6	3208.6	*3202.3*
30°	3303.5	3265.5	*3265.5*
32.5°	3369.8	3360.4	*3354.0*
35°	3527.9	3480.5	*3486.8*
37.5°	3720.7	3673.3	*3632.2*
40°	3992.6	3929.4	*3904.1*
42.5°	4166.5	4103.2	*4109.6*
45°	4264.5	4153.8	*4125.4*
47.5°	4530.0	4390.9	*4353.0*
50°	4959.9	4789.2	*4741.8*
52.5°	5655.4	5380.4	*5317.1*
55°	6527.9	6189.6	*6126.4*
57.5°	7722.8	7273.9	*7138.0*
60°	9177.0	8620.6	*8415.1*
62.5°	10925.1	10239.1	*10043.1*
65°	12240.2	11668.0	*11364.5*
67.5°	13292.9	12821.8	*12676.4*
70°	13918.8	13940.9	*13978.8*
72.5°	*13194.9*	*13801.8*	*14092.6*
75°	9670.1	10141.1	*10593.2*
77.5°	3736.5	3369.8	*3262.4*
80°	603.8	565.9	*584.8*
82.5°	271.9	287.7	*303.5*
85°	177.0	205.5	*218.1*
87.5°	41.1	41.1	*41.1*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-6

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-750-U-5WQ

Data in this report applies to families of products including GSS-SB1A-750-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-750-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 5000K CCT 26 LEDS

Spectral Parameters

CCT (K):	4896
CIE u':	0.2101
CIE v':	0.4901
Duv:	0.0035
CIE x:	0.3489
CIE y:	0.3618
CIE z:	0.2893
Peak Wavelength (nm):	443
Dominant Wavelength (nm):	570
Purity:	13.25435
Rf:	70.7
Rg:	96.8

CRI (Ra):	70.2
R1:	68.1
R2:	73.9
R3:	79.4
R4:	72.1
R5:	69.2
R6:	65.7
R7:	78.1
R8:	55.3
R9:	-35.1
R10:	39.3
R11:	71.1
R12:	43.8
R13:	68.1
R14:	88.4
R15:	59.7

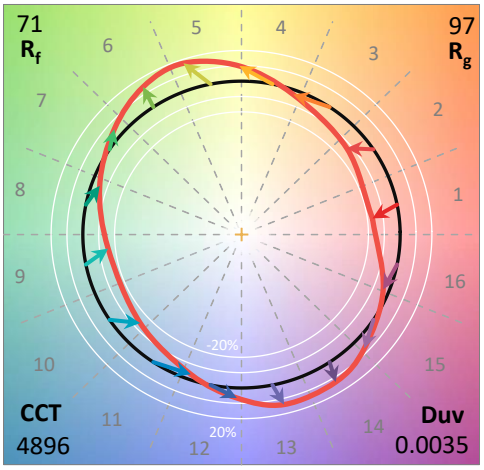

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-6

CIE 1931 Chromaticity Diagram

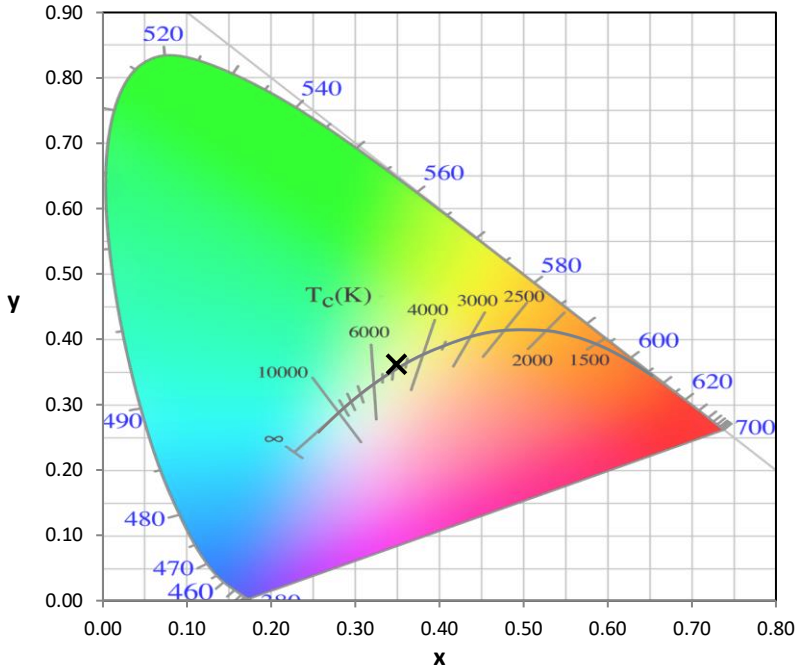

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

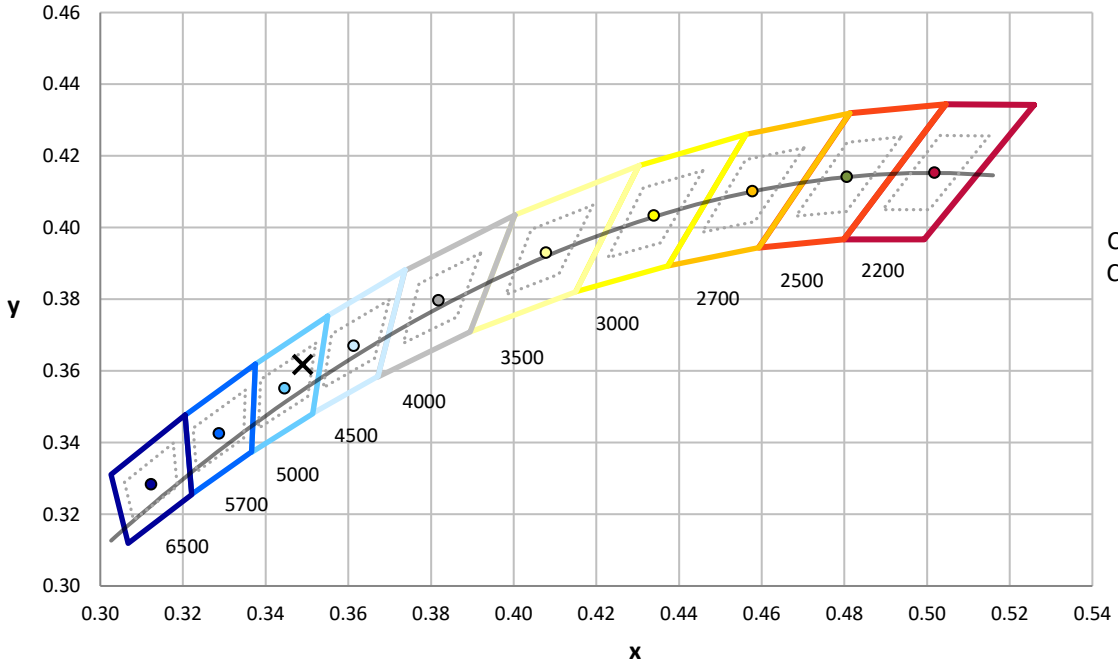


CCT = 4896K
CIE x = 0.3489
CIE y = 0.3618
Duv = 0.0035

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-6

Photopic Flux vs. Wavelength

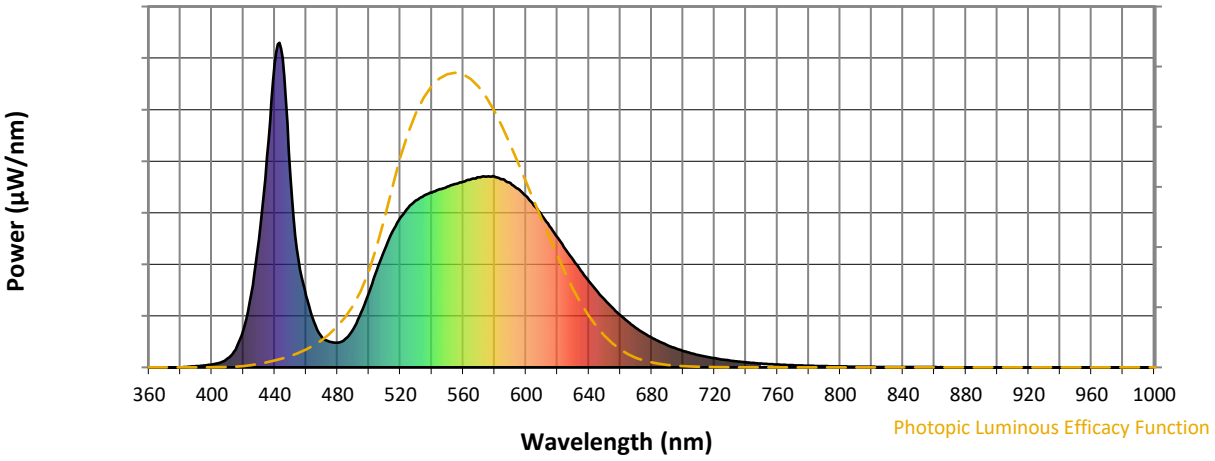


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Scotopic Flux vs. Wavelength

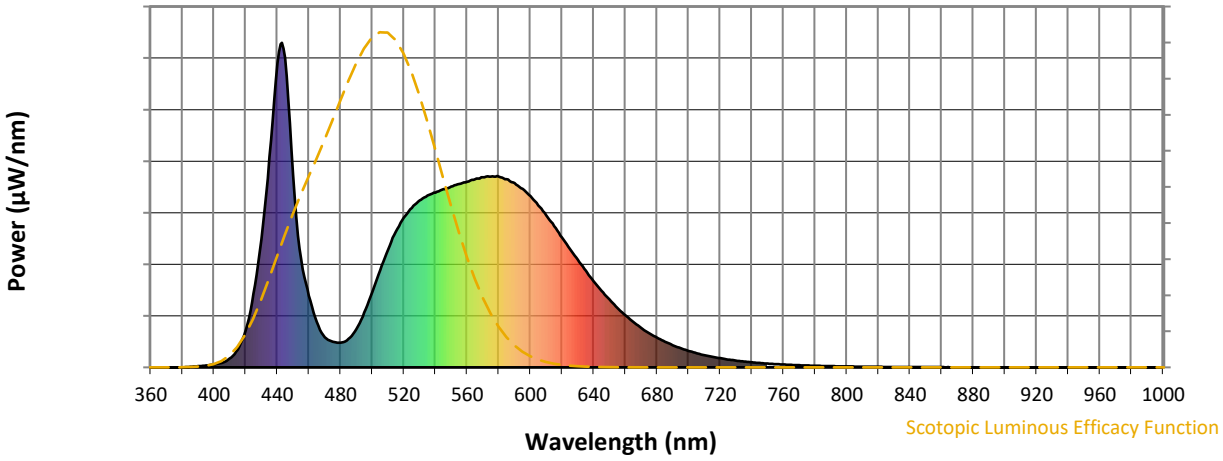


Scotopic Lumens: NR **S/P: 1.7**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Melanopic Flux vs. Wavelength

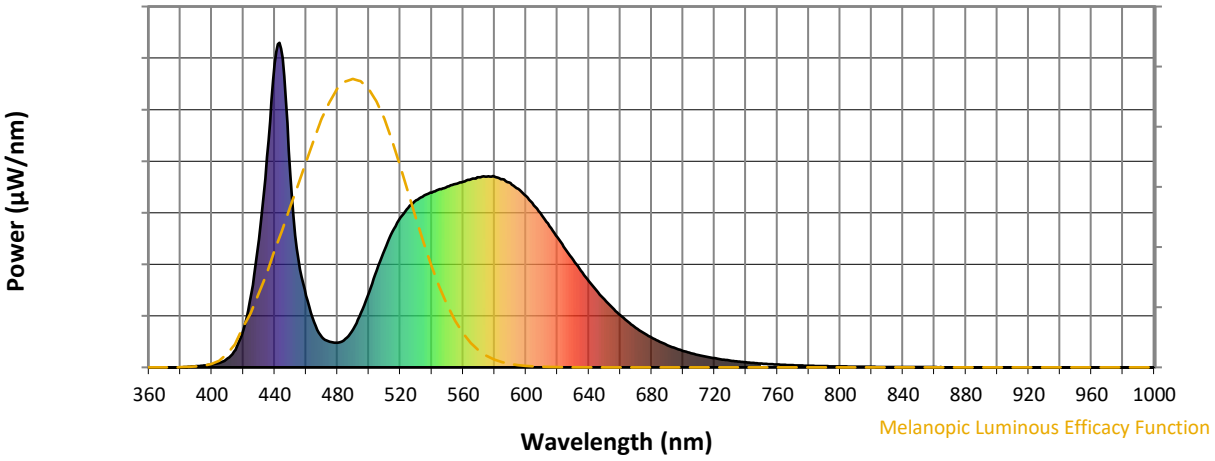

Melanopic Lumens: NR **M/P: 3.37**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			


REPORT NUMBER: SP1-2407-184-6

TM-30-18


Summary


R_f = 70.7
R_g = 96.8
CIE R_a = 70.2
R_9 = -35.1


Spectral Power Distribution Comparison

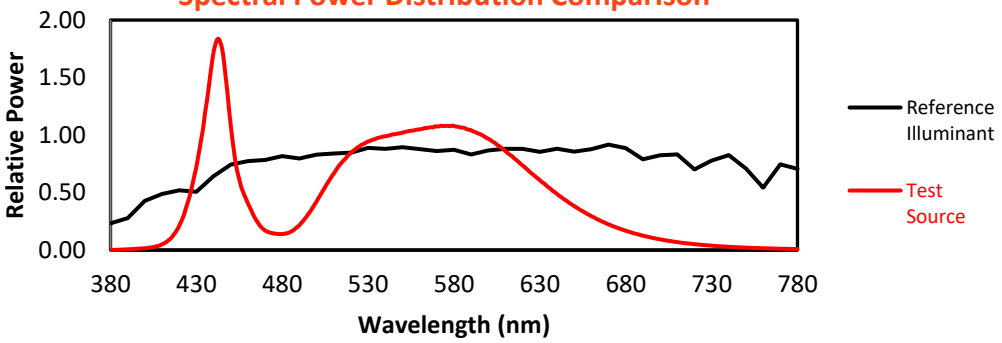


Color Vector Graphics

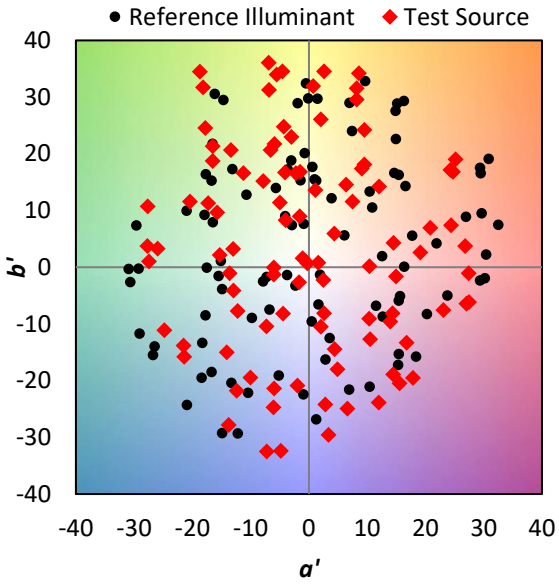

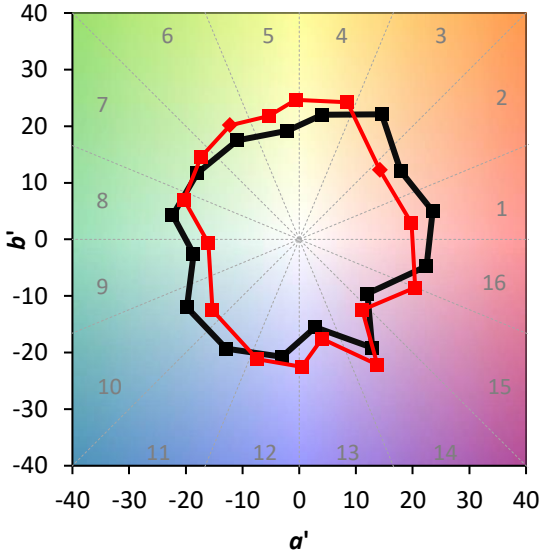

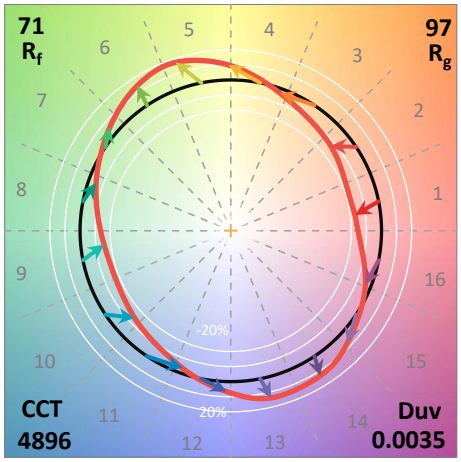

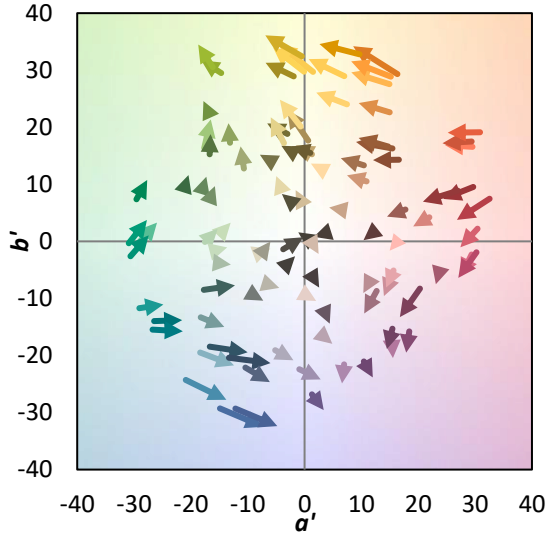


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 53	CES51 = 87	CES76 = 42
CES02 = 59	CES27 = 78	CES52 = 88	CES77 = 64
CES03 = 30	CES28 = 76	CES53 = 74	CES78 = 45
CES04 = 69	CES29 = 48	CES54 = 80	CES79 = 74
CES05 = 46	CES30 = 56	CES55 = 79	CES80 = 71
CES06 = 50	CES31 = 54	CES56 = 68	CES81 = 72
CES07 = 39	CES32 = 50	CES57 = 65	CES82 = 88
CES08 = 38	CES33 = 60	CES58 = 67	CES83 = 82
CES09 = 29	CES34 = 62	CES59 = 87	CES84 = 87
CES10 = 72	CES35 = 79	CES60 = 91	CES85 = 84
CES11 = 56	CES36 = 90	CES61 = 87	CES86 = 74
CES12 = 61	CES37 = 72	CES62 = 79	CES87 = 75
CES13 = 41	CES38 = 66	CES63 = 72	CES88 = 76
CES14 = 74	CES39 = 91	CES64 = 70	CES89 = 74
CES15 = 70	CES40 = 83	CES65 = 63	CES90 = 73
CES16 = 46	CES41 = 83	CES66 = 64	CES91 = 92
CES17 = 49	CES42 = 70	CES67 = 62	CES92 = 67
CES18 = 55	CES43 = 68	CES68 = 69	CES93 = 81
CES19 = 71	CES44 = 98	CES69 = 80	CES94 = 56
CES20 = 64	CES45 = 78	CES70 = 56	CES95 = 71
CES21 = 85	CES46 = 77	CES71 = 53	CES96 = 77
CES22 = 77	CES47 = 73	CES72 = 84	CES97 = 82
CES23 = 91	CES48 = 65	CES73 = 46	CES98 = 71
CES24 = 90	CES49 = 76	CES74 = 94	CES99 = 59
CES25 = 71	CES50 = 85	CES75 = 49	

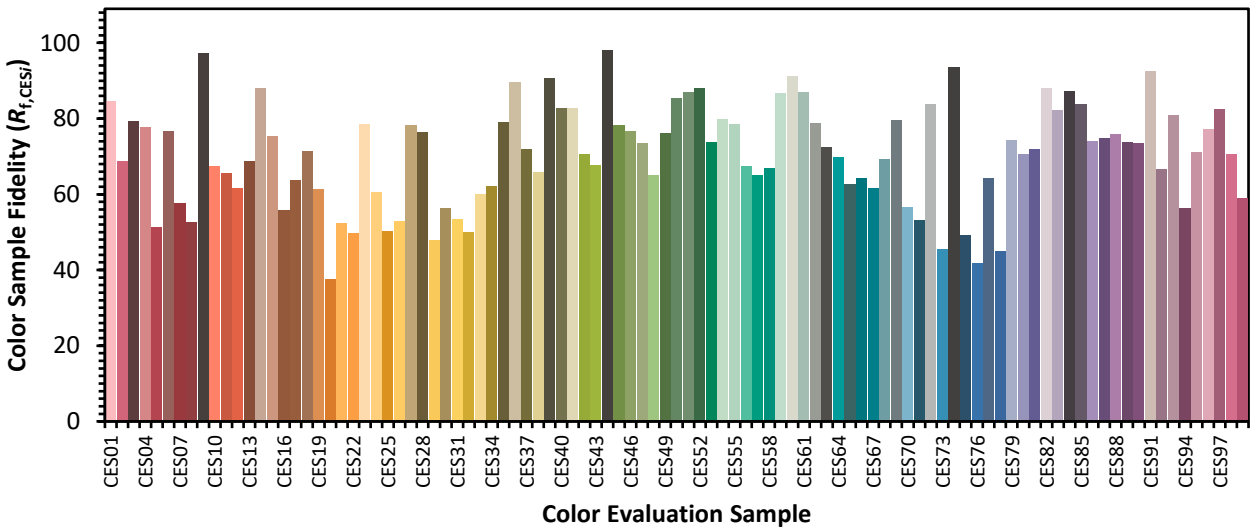



REPORT NUMBER: SP1-2407-184-6

TM-30-18

Color Rendition by Hue-Angle Bin

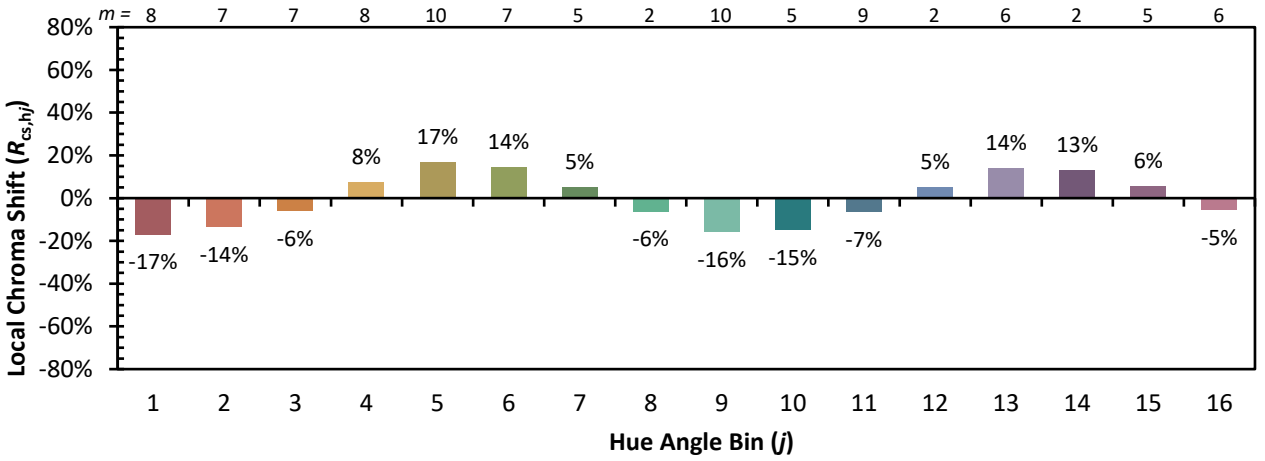

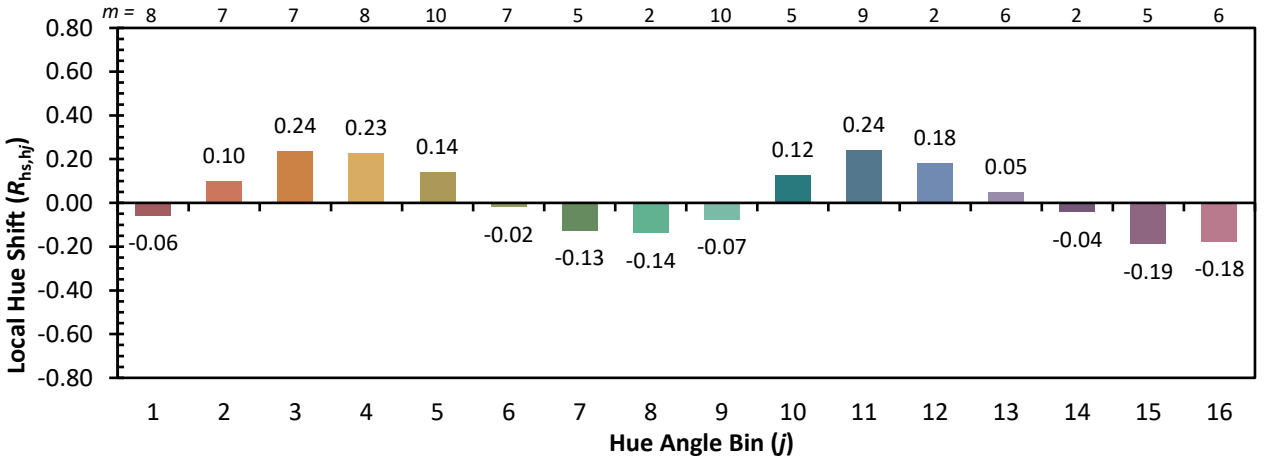


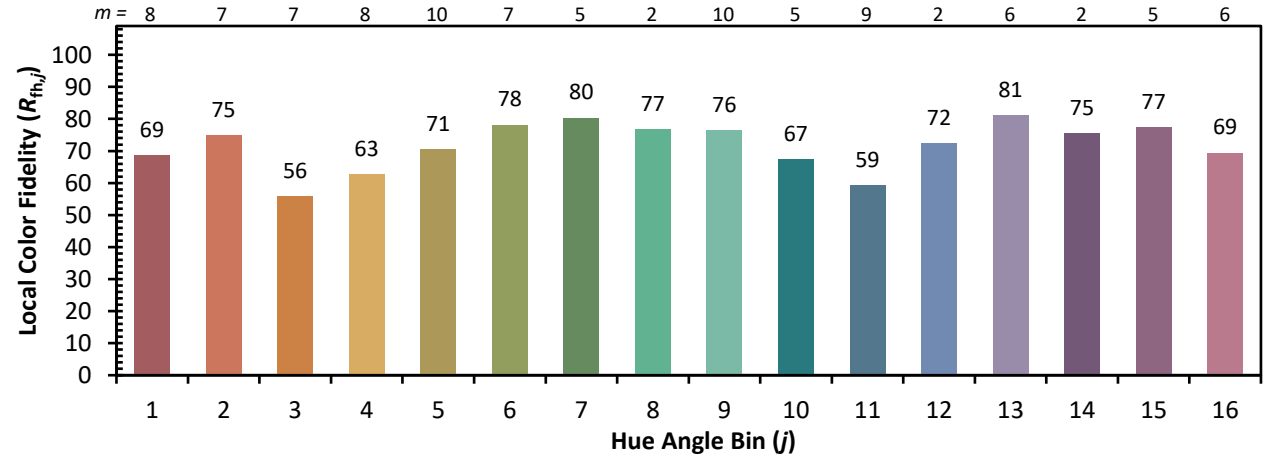


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Measure Comparisons

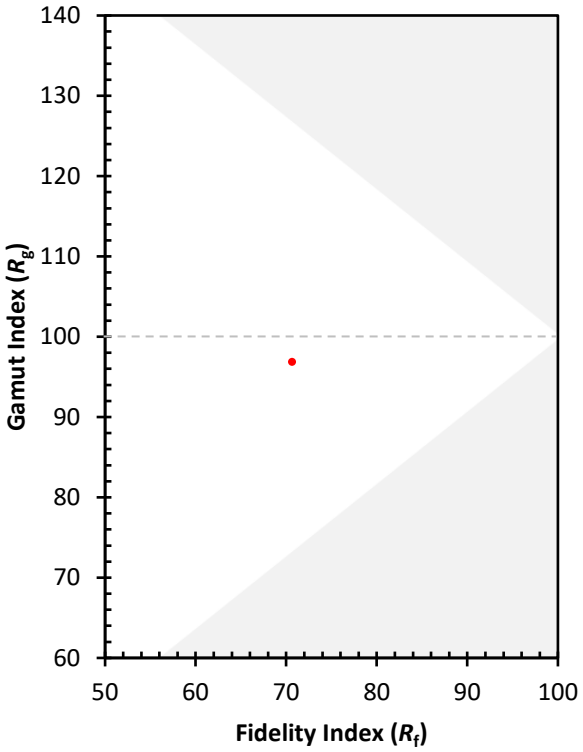

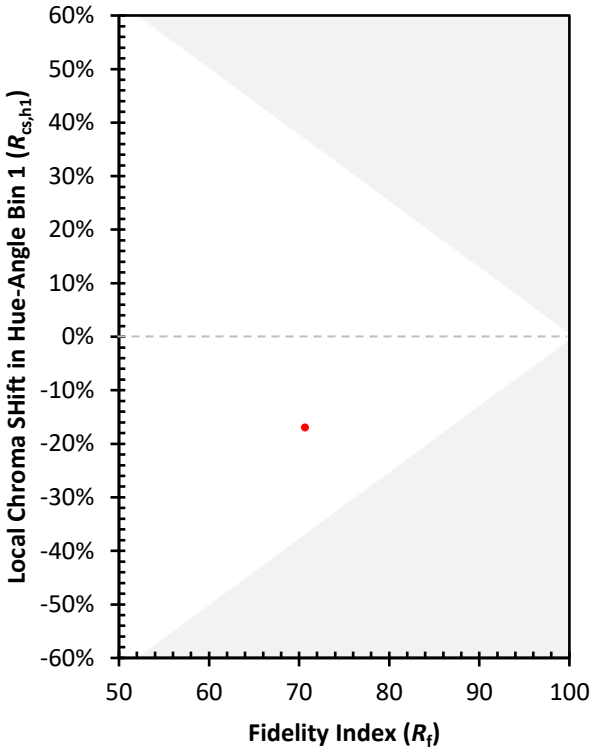

(END OF REPORT)