Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360793

Luminaire Tested: **GSS-SB3C-750-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360793
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB3C-750-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 3SQUARE 150W 70CRI 5000K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(78) 5000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	21753 lumens
Efficiency:	N/A
Efficacy:	145.0 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 0.5' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B4 - U0 - G4


Input Watts (W):	150
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	6.3%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360793
CATALOG NUMBER: GSS-SB3C-750-U-T1

Iso-Footcandle Lines of Horizontal Illumination

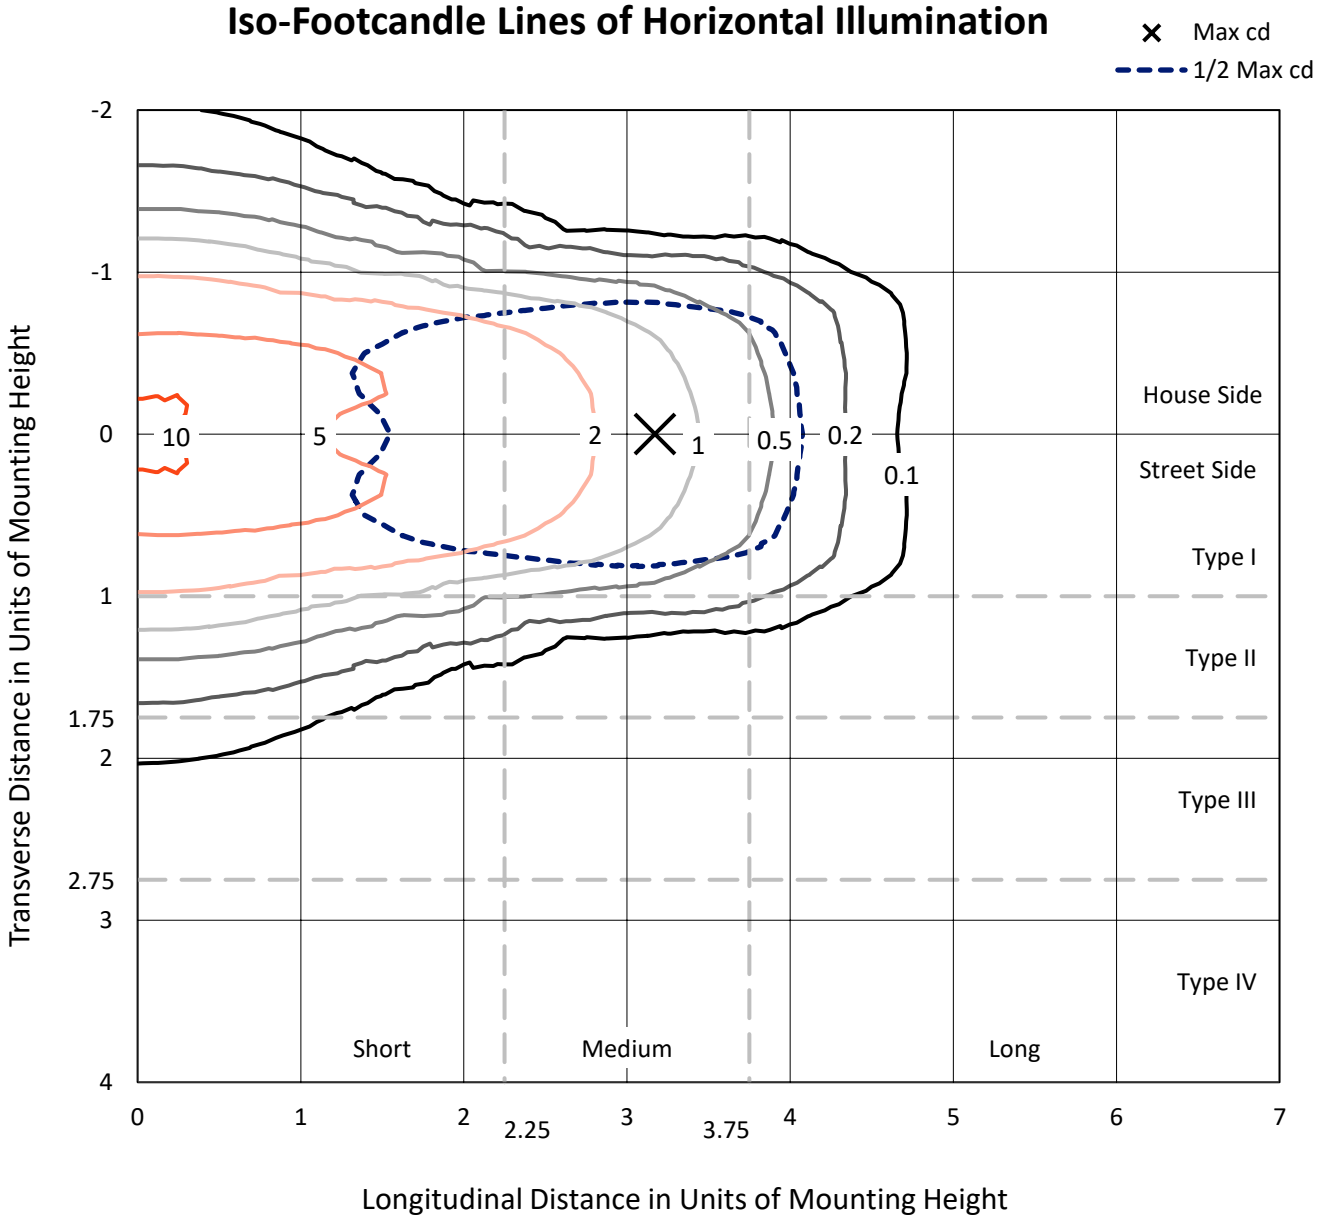


Based on 20 foot mounting height. Maximum calculated value = 10.7 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360793
CATALOG NUMBER: GSS-SB3C-750-U-T1

Luminous Intensity Polar Plot

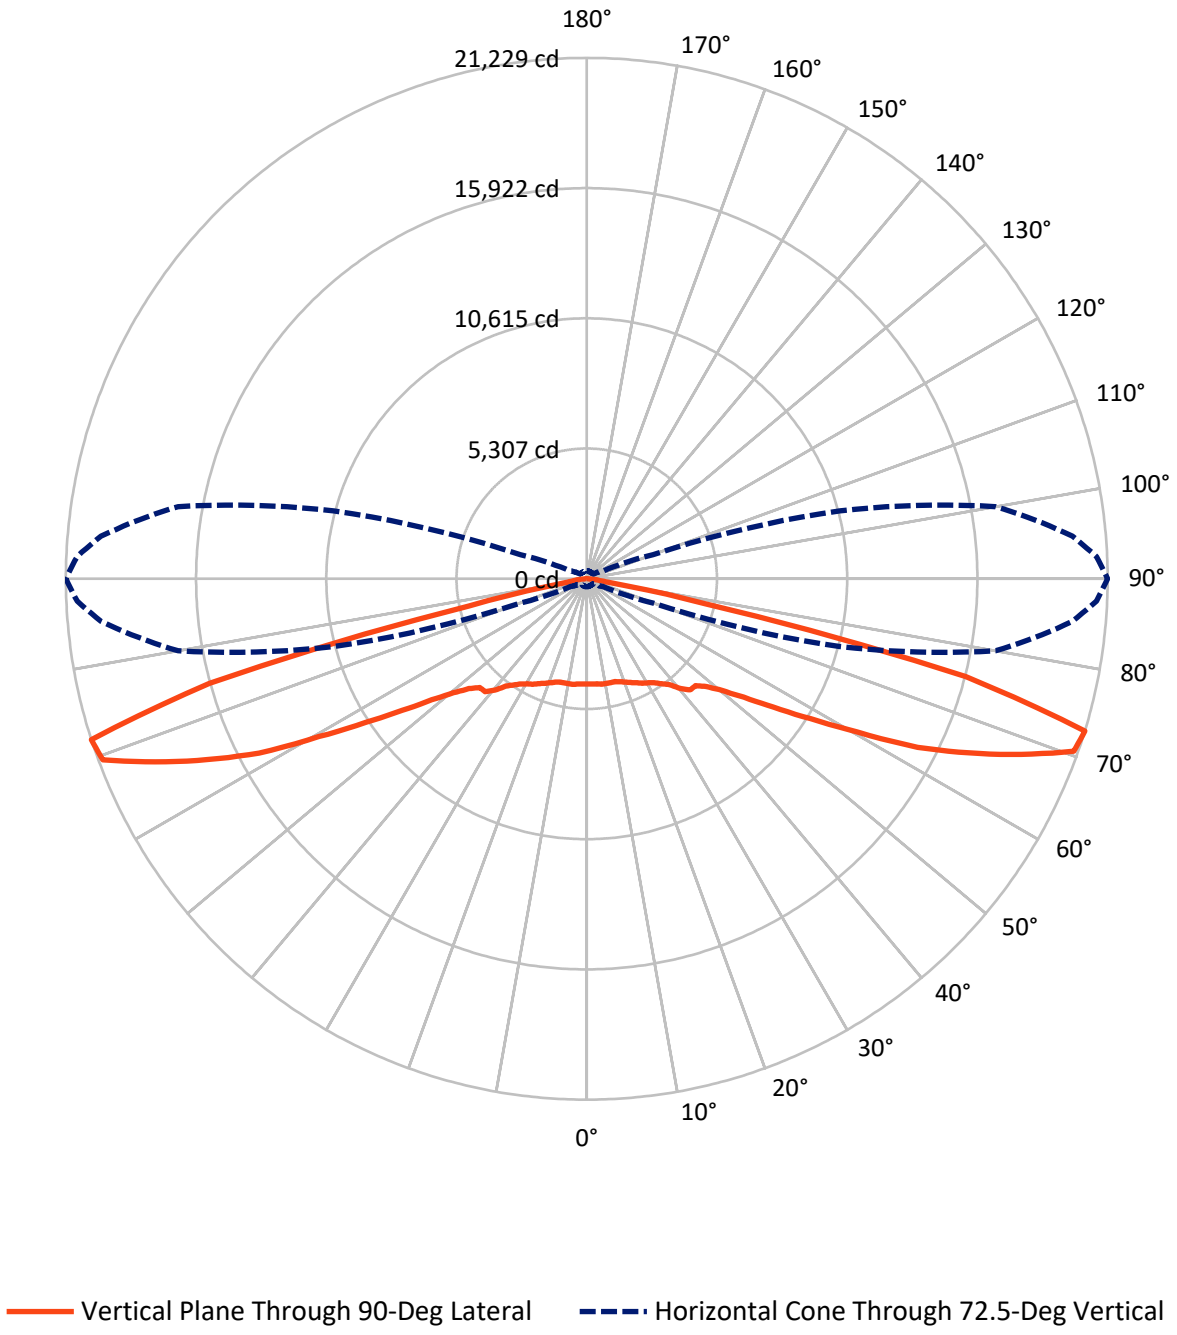

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360793
CATALOG NUMBER: GSS-SB3C-750-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	10876.5	0.0	10876.5
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	10876.5	0.0	10876.5
	% Fixture	50.0	0.0	50.0
Total	Lumens	21753.0	0.0	21753.0
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	414.8	1.9
10°-20°	1264.4	5.8
20°-30°	2113.3	9.7
30°-40°	2914.4	13.4
40°-50°	3572.6	16.4
50°-60°	4186.6	19.2
60°-70°	4649.2	21.4
70°-80°	2528.2	11.6
80°-90°	109.6	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	21753.0	100.0
0°-180°	21753.0	100.0

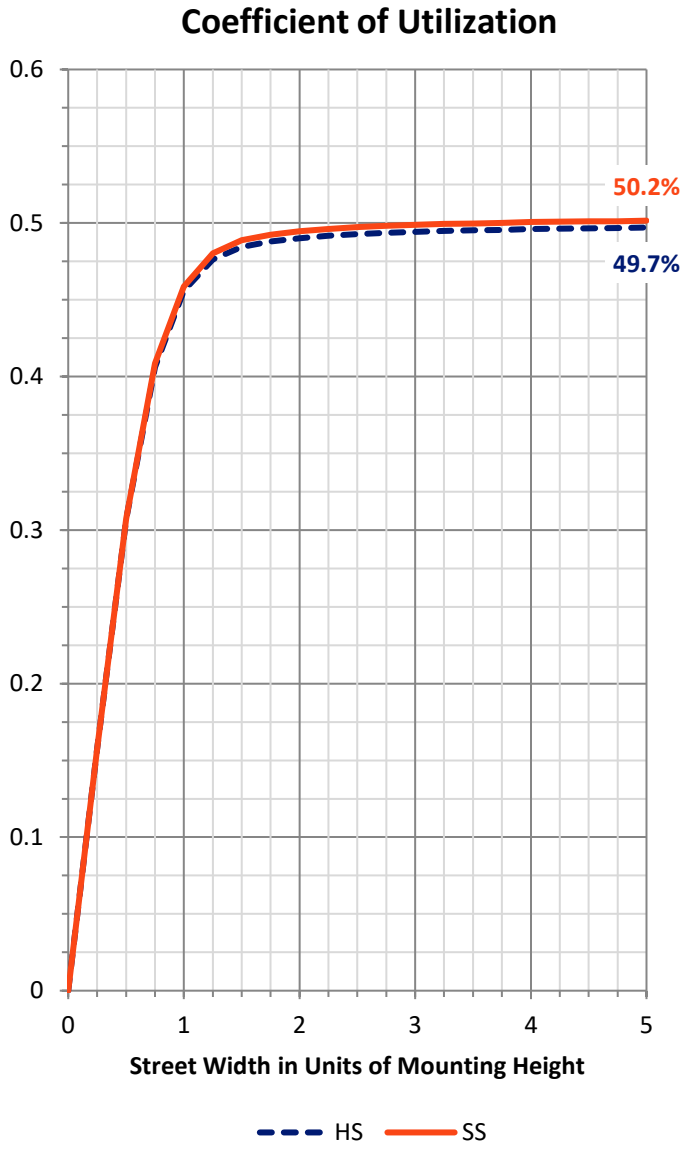

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360793
CATALOG NUMBER: GSS-SB3C-750-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	1896.2	8.7			
FM	(30°-60°)	5336.8	24.5			
FH	(60°-80°)	3588.7	16.5			G2/5000
FVH	(80°-90°)	54.8	0.3			G1/100
BL	(0°-30°)	1896.2	8.7	B3/2500		
BM	(30°-60°)	5336.8	24.5	B4/8500		
BH	(60°-80°)	3588.7	16.5	B4/5000		G4/5000
BVH	(80°-90°)	54.8	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B4-U0-G4
Type I Short

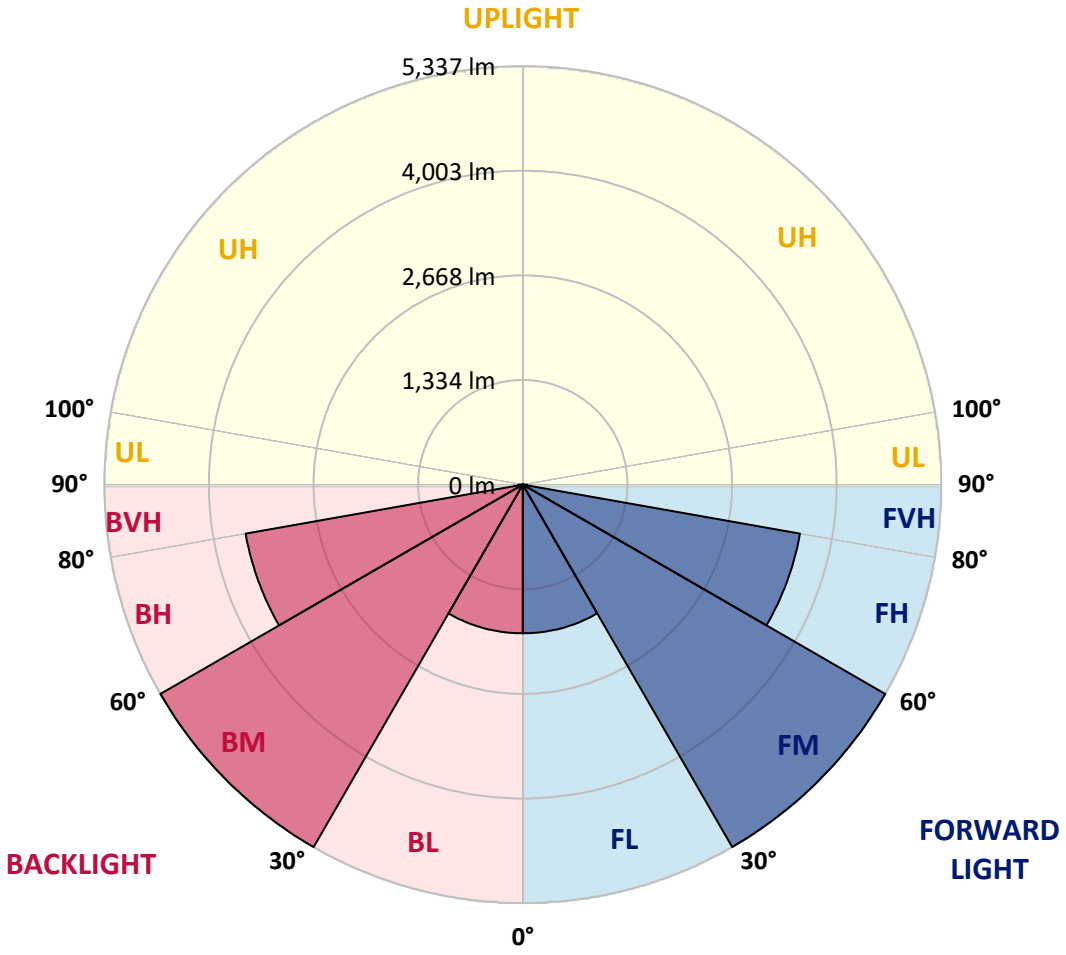

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360793
CATALOG NUMBER: GSS-SB3C-750-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	4285.9	4285.9	4285.9	4285.9	4285.9	4285.9	4285.9	4285.9	4285.9	4285.9	4285.9
2.5°	4290.6	4290.6	4276.4	4295.4	4285.9	4290.6	4295.4	4290.6	4285.9	4290.6	4295.4
5°	4314.5	4304.9	4314.5	4324.0	4309.7	4319.2	4314.5	4290.6	4304.9	4304.9	4304.9
7.5°	4357.3	4366.8	4357.3	4381.1	4366.8	4395.4	4366.8	4347.8	4343.0	4338.3	4338.3
10°	4376.4	4376.4	4371.6	4414.5	4424.0	4452.6	4433.5	4404.9	4390.6	4371.6	4352.5
12.5°	4324.0	4333.5	4357.3	4438.3	4476.4	4533.5	4519.2	4462.1	4419.2	4404.9	4376.4
15°	4266.8	4276.4	4324.0	4424.0	4514.5	4600.2	4595.4	4524.0	4471.6	4433.5	4390.6
17.5°	4176.4	4190.6	4257.3	4409.7	4571.6	4666.8	4695.4	4624.0	4566.8	4504.9	4447.8
20°	4024.0	4024.0	4143.0	4338.3	4562.1	4776.4	4852.6	4795.4	4728.8	4628.7	4552.6
22.5°	3852.5	3862.1	3981.1	4238.3	4557.3	4871.6	5019.2	4957.3	4890.7	4781.1	4666.8
25°	3681.1	3681.1	3814.4	4104.9	4495.4	4938.3	5214.5	5181.2	5047.8	4947.8	4800.2
27.5°	3523.9	3523.9	3666.8	3971.6	4390.6	4957.3	5409.7	5409.7	5262.1	5114.5	4952.6
30°	3338.2	3385.8	3547.8	3866.8	4295.4	4924.0	5552.6	5643.1	5509.7	5319.3	5081.1
32.5°	3181.1	3214.4	3381.1	3719.2	4157.3	4885.9	5714.5	5938.3	5800.2	5538.3	5271.6
35°	2995.4	2990.6	3181.1	3514.4	3962.1	4800.2	5843.1	6290.7	6157.4	5876.4	5514.5
37.5°	2752.5	2752.5	2947.7	3271.6	3776.3	4652.6	5947.8	6681.2	6581.2	6262.1	5876.4
40°	2490.6	2519.1	2690.6	3019.2	3552.5	4476.4	5947.8	7000.3	7052.7	6724.1	6324.1
42.5°	2300.1	2309.6	2466.8	2776.3	3304.9	4247.8	5871.7	7276.5	7433.6	7157.4	6638.3
45°	2100.1	2123.9	2257.2	2543.0	3047.7	3976.3	5738.3	7586.0	7838.4	7647.9	6966.9
47.5°	1857.2	1881.0	2033.4	2323.9	2804.9	3681.1	5514.5	7909.8	8438.4	8300.3	7552.7
50°	1576.3	1595.3	1738.2	2047.7	2533.4	3343.0	5233.5	8152.7	9038.4	9176.5	8438.4
52.5°	1233.4	1247.7	1400.1	1700.1	2209.6	3019.2	4838.3	8300.3	9643.2	10129.0	9624.2
55°	885.7	909.6	1042.9	1290.5	1781.0	2585.8	4366.8	8376.5	10305.2	11257.6	11095.7
57.5°	638.1	647.6	738.1	928.6	1323.9	2076.3	3762.0	8247.9	10900.4	12605.2	12943.4
60°	528.6	528.6	542.9	633.4	904.8	1466.7	3038.2	7771.7	11410.0	13967.2	15010.1
62.5°	485.7	485.7	495.3	509.5	595.3	952.4	2171.5	6805.0	11467.1	15276.8	17276.9
65°	442.9	442.9	452.4	461.9	481.0	619.1	1309.6	4981.1	10348.0	15291.1	18495.9
67.5°	404.8	404.8	409.5	414.3	423.8	452.4	719.1	3019.2	8281.3	14886.3	18962.6
70°	366.7	366.7	366.7	361.9	376.2	381.0	476.2	1533.4	5538.3	13443.4	18738.8
72.5°	*323.8*	*323.8*	*319.1*	*309.5*	*314.3*	*314.3*	*352.4*	*752.4*	*2876.3*	*10686.1*	*16919.7*
75°	276.2	281.0	261.9	252.4	247.6	252.4	281.0	428.6	1285.8	6481.2	12643.3
77.5°	233.3	242.9	214.3	195.2	190.5	190.5	219.1	266.7	552.4	2352.5	5666.9
80°	176.2	181.0	157.1	138.1	138.1	133.3	161.9	195.2	261.9	700.0	1271.5
82.5°	100.0	100.0	90.5	81.0	76.2	81.0	109.5	133.3	161.9	247.6	347.6
85°	23.8	23.8	28.6	33.3	33.3	42.9	61.9	71.4	85.7	100.0	133.3
87.5°	4.8	4.8	4.8	9.5	14.3	14.3	23.8	33.3	42.9	52.4	57.1
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360793
CATALOG NUMBER: GSS-SB3C-750-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	4285.9	4285.9	*4285.9*
2.5°	4295.4	4300.2	*4295.4*
5°	4324.0	4314.5	*4300.2*
7.5°	4328.7	4333.5	*4338.3*
10°	4347.8	4366.8	*4338.3*
12.5°	4366.8	4352.5	*4343.0*
15°	4381.1	4376.4	*4347.8*
17.5°	4433.5	4414.5	*4409.7*
20°	4514.5	4509.7	*4495.4*
22.5°	4609.7	4600.2	*4595.4*
25°	4747.8	4714.5	*4695.4*
27.5°	4862.1	4833.5	*4824.0*
30°	4976.4	4919.2	*4919.2*
32.5°	5076.4	5062.1	*5052.6*
35°	5314.5	5243.1	*5252.6*
37.5°	5605.0	5533.5	*5471.6*
40°	6014.5	5919.3	*5881.2*
42.5°	6276.4	6181.2	*6190.7*
45°	6424.1	6257.4	*6214.5*
47.5°	6824.1	6614.5	*6557.4*
50°	7471.7	7214.6	*7143.1*
52.5°	8519.4	8105.1	*8009.8*
55°	9833.7	9324.2	*9228.9*
57.5°	11633.8	10957.6	*10752.8*
60°	13824.3	12986.2	*12676.7*
62.5°	16457.8	15424.4	*15129.2*
65°	18438.8	17576.9	*17119.7*
67.5°	20024.6	19315.0	*19096.0*
70°	20967.5	21000.8	*21057.9*
72.5°	*19877.0*	*20791.3*	*21229.4*
75°	14567.2	15276.8	*15957.8*
77.5°	5628.8	5076.4	*4914.5*
80°	909.6	852.4	*881.0*
82.5°	409.5	433.3	*457.2*
85°	266.7	309.5	*328.6*
87.5°	61.9	61.9	*61.9*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-6

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-750-U-5WQ

Data in this report applies to families of products including GSS-SB1A-750-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-750-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 5000K CCT 26 LEDS

Spectral Parameters

CCT (K):	4896
CIE u':	0.2101
CIE v':	0.4901
Duv:	0.0035
CIE x:	0.3489
CIE y:	0.3618
CIE z:	0.2893
Peak Wavelength (nm):	443
Dominant Wavelength (nm):	570
Purity:	13.25435
Rf:	70.7
Rg:	96.8

CRI (Ra):	70.2
R1:	68.1
R2:	73.9
R3:	79.4
R4:	72.1
R5:	69.2
R6:	65.7
R7:	78.1
R8:	55.3
R9:	-35.1
R10:	39.3
R11:	71.1
R12:	43.8
R13:	68.1
R14:	88.4
R15:	59.7

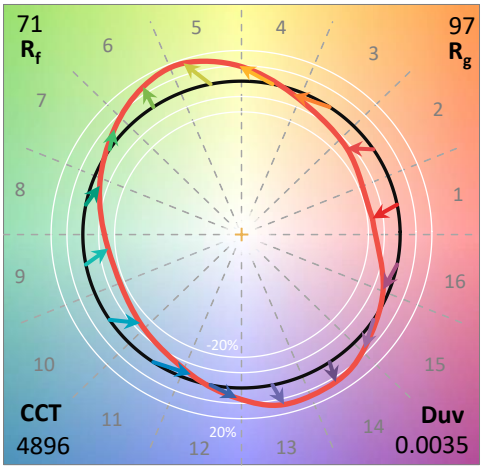

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-6

CIE 1931 Chromaticity Diagram

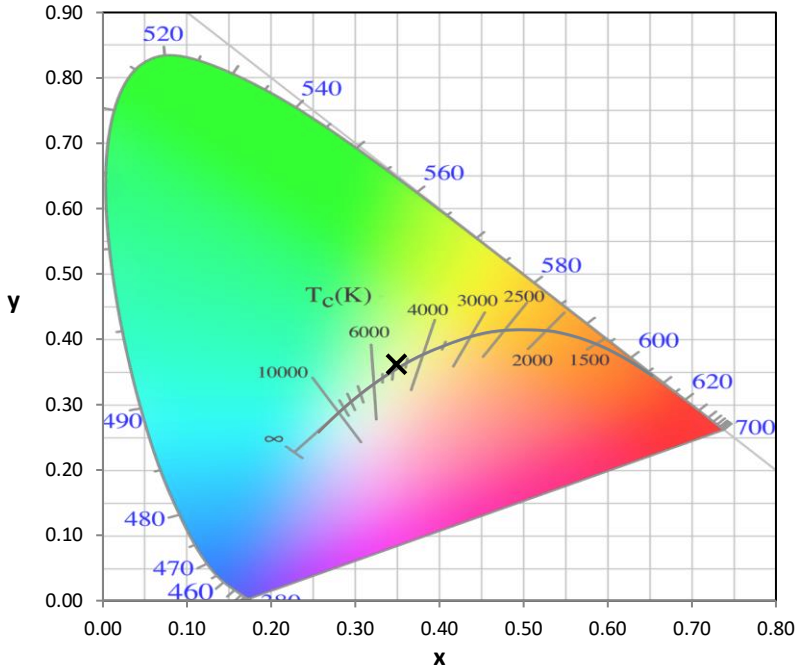

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

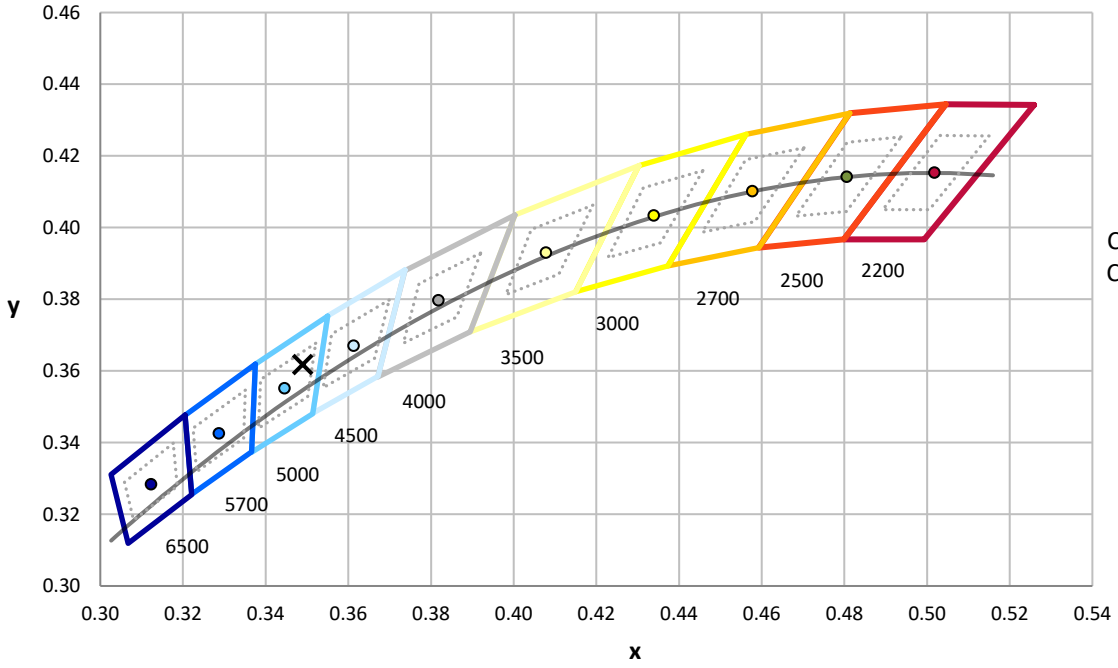


CCT = 4896K
CIE x = 0.3489
CIE y = 0.3618
Duv = 0.0035

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-6

Photopic Flux vs. Wavelength

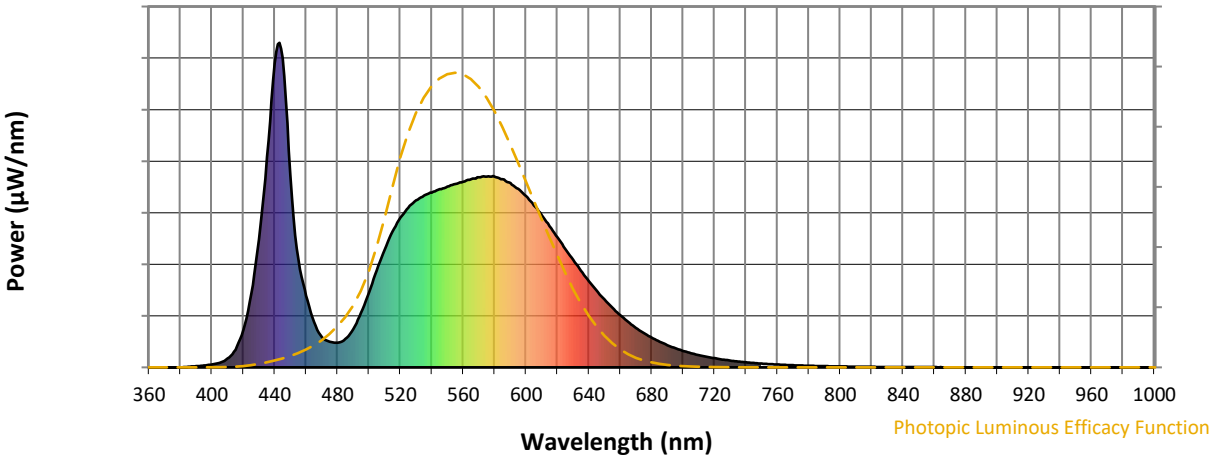


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Scotopic Flux vs. Wavelength

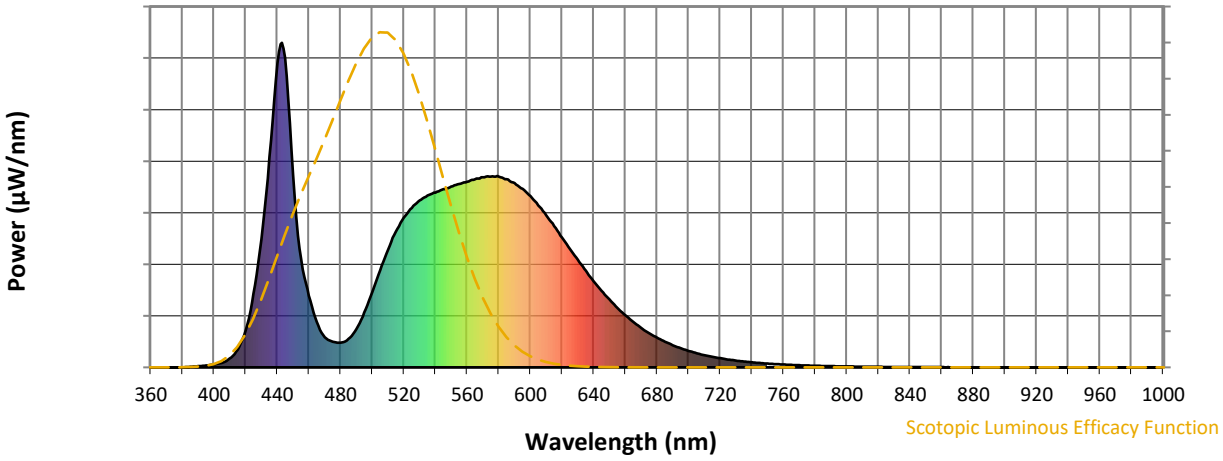


Scotopic Lumens: NR **S/P: 1.7**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Melanopic Flux vs. Wavelength

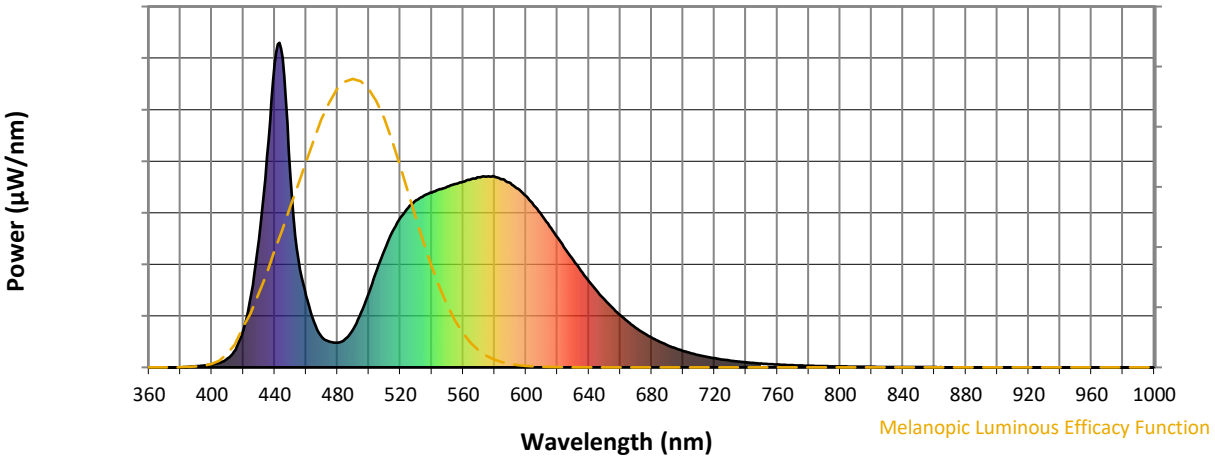

Melanopic Lumens: NR **M/P: 3.37**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			


REPORT NUMBER: SP1-2407-184-6

TM-30-18


Summary


R_f = 70.7
R_g = 96.8
CIE R_a = 70.2
R_9 = -35.1


Spectral Power Distribution Comparison

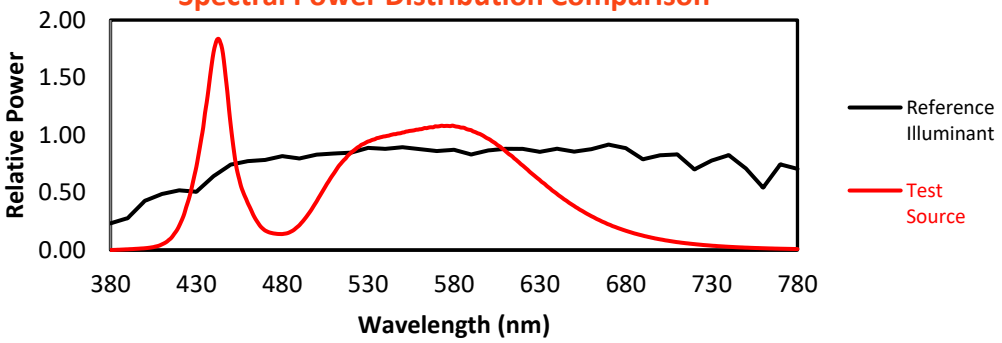


Color Vector Graphics

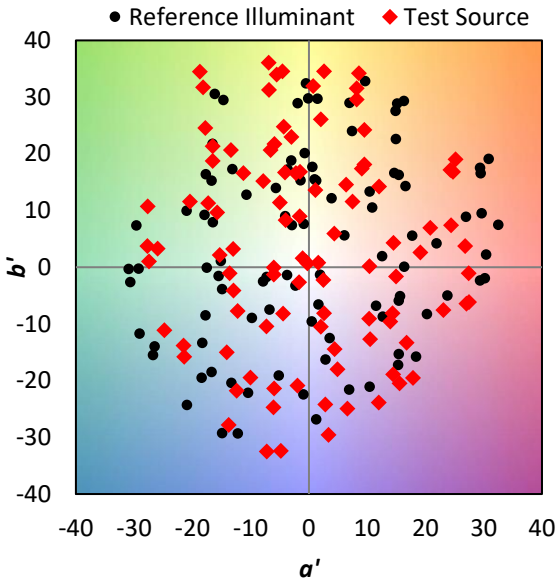

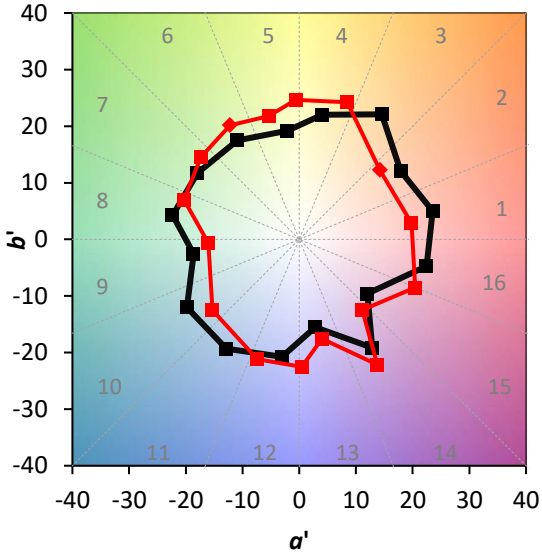

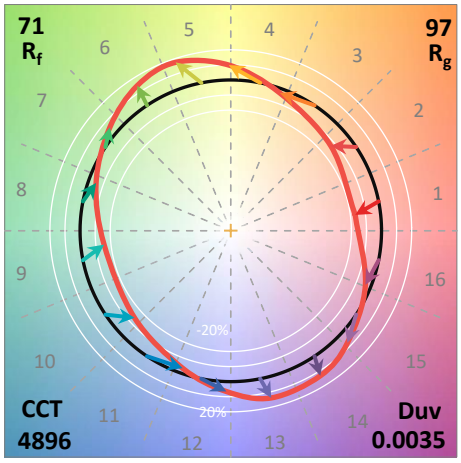

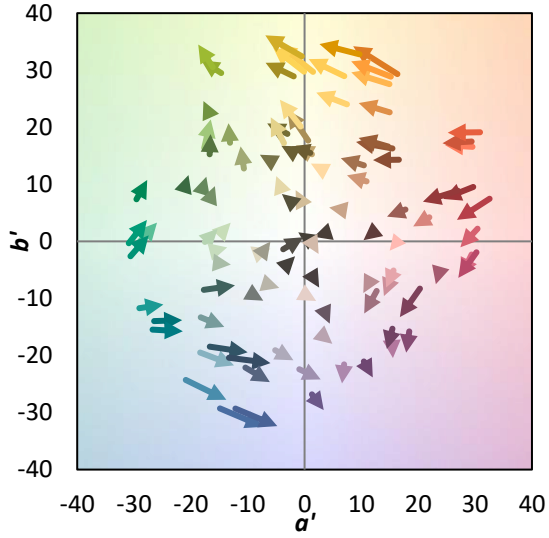


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 53	CES51 = 87	CES76 = 42
CES02 = 59	CES27 = 78	CES52 = 88	CES77 = 64
CES03 = 30	CES28 = 76	CES53 = 74	CES78 = 45
CES04 = 69	CES29 = 48	CES54 = 80	CES79 = 74
CES05 = 46	CES30 = 56	CES55 = 79	CES80 = 71
CES06 = 50	CES31 = 54	CES56 = 68	CES81 = 72
CES07 = 39	CES32 = 50	CES57 = 65	CES82 = 88
CES08 = 38	CES33 = 60	CES58 = 67	CES83 = 82
CES09 = 29	CES34 = 62	CES59 = 87	CES84 = 87
CES10 = 72	CES35 = 79	CES60 = 91	CES85 = 84
CES11 = 56	CES36 = 90	CES61 = 87	CES86 = 74
CES12 = 61	CES37 = 72	CES62 = 79	CES87 = 75
CES13 = 41	CES38 = 66	CES63 = 72	CES88 = 76
CES14 = 74	CES39 = 91	CES64 = 70	CES89 = 74
CES15 = 70	CES40 = 83	CES65 = 63	CES90 = 73
CES16 = 46	CES41 = 83	CES66 = 64	CES91 = 92
CES17 = 49	CES42 = 70	CES67 = 62	CES92 = 67
CES18 = 55	CES43 = 68	CES68 = 69	CES93 = 81
CES19 = 71	CES44 = 98	CES69 = 80	CES94 = 56
CES20 = 64	CES45 = 78	CES70 = 56	CES95 = 71
CES21 = 85	CES46 = 77	CES71 = 53	CES96 = 77
CES22 = 77	CES47 = 73	CES72 = 84	CES97 = 82
CES23 = 91	CES48 = 65	CES73 = 46	CES98 = 71
CES24 = 90	CES49 = 76	CES74 = 94	CES99 = 59
CES25 = 71	CES50 = 85	CES75 = 49	

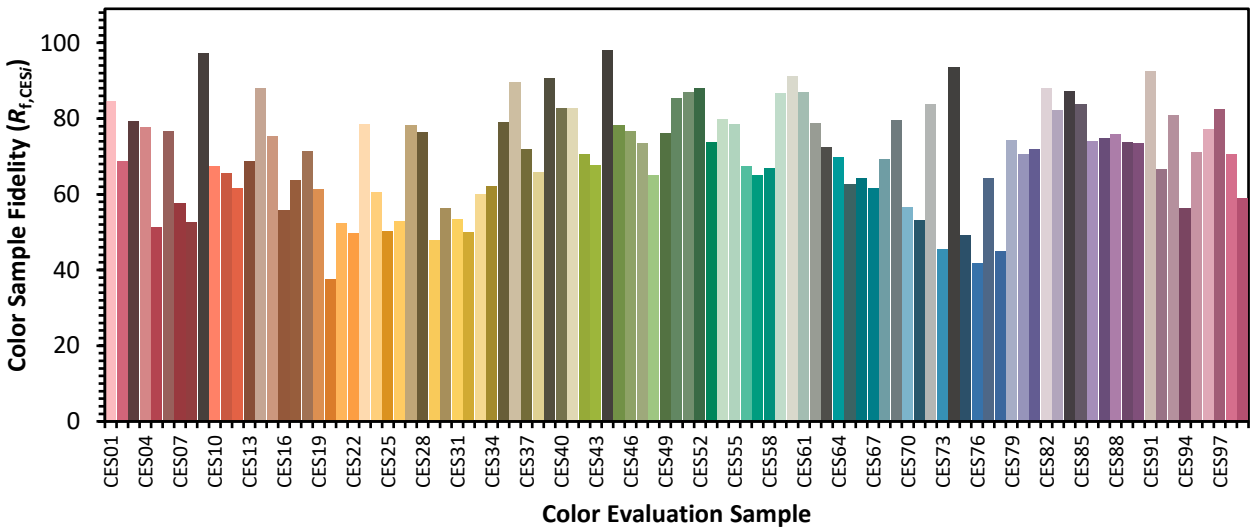



REPORT NUMBER: SP1-2407-184-6

TM-30-18

Color Rendition by Hue-Angle Bin

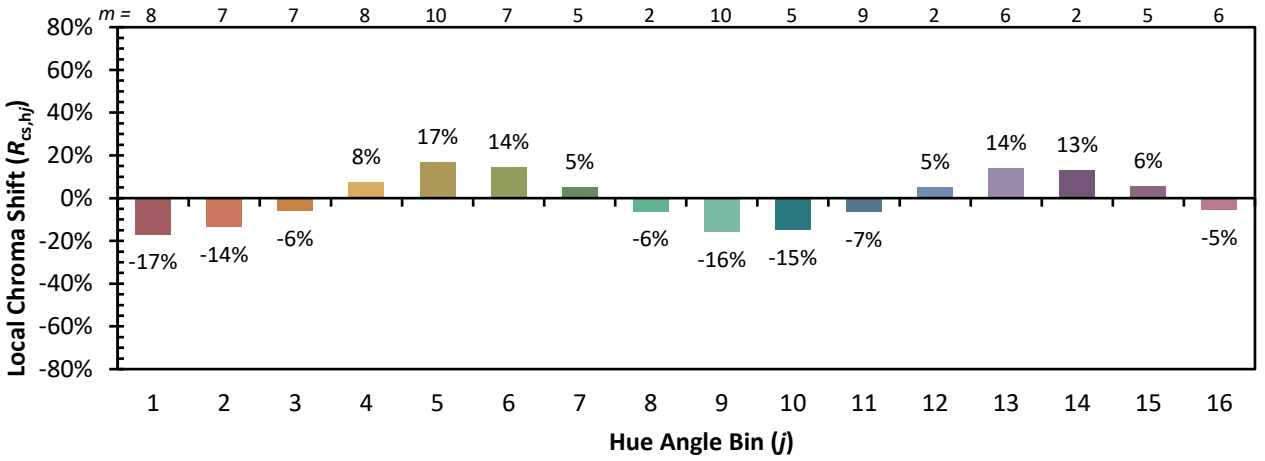

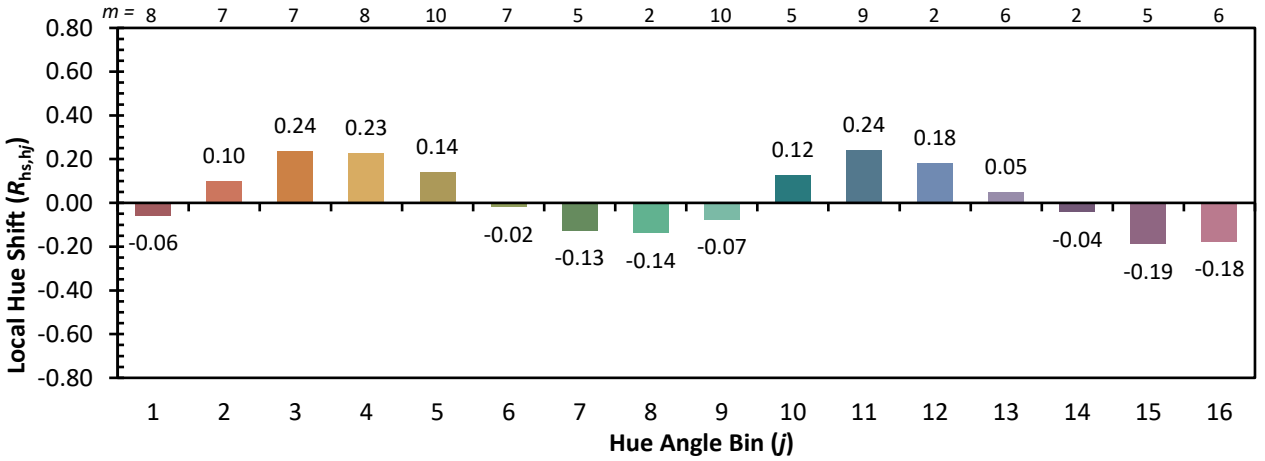


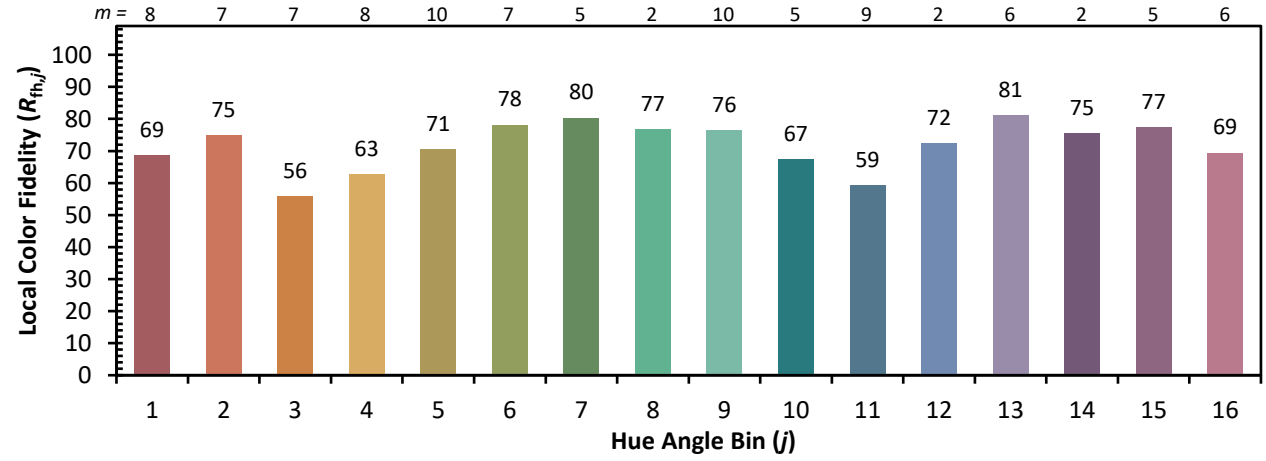


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Measure Comparisons

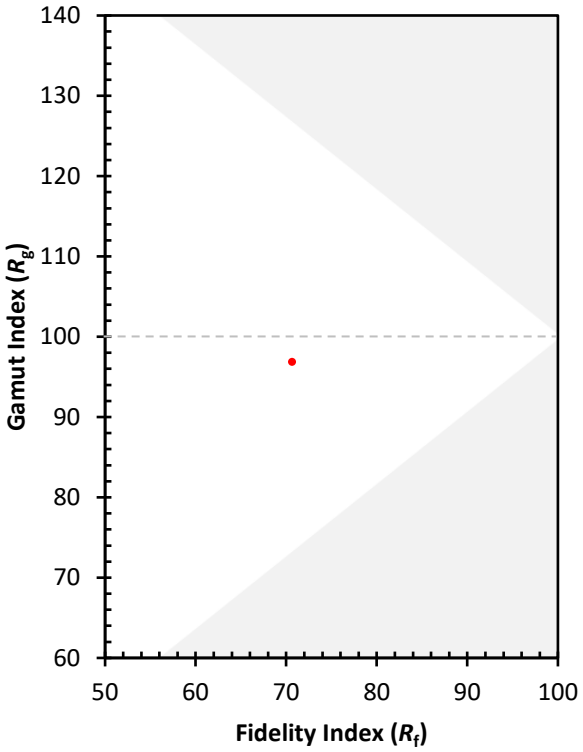

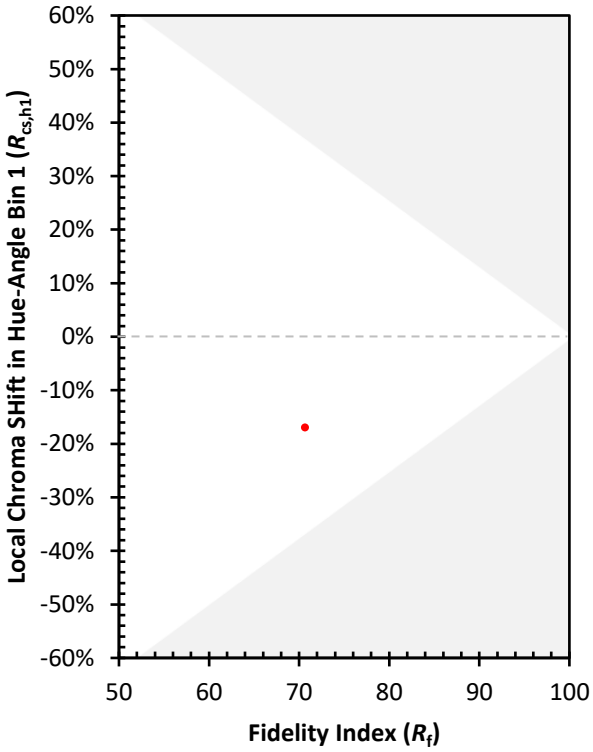

(END OF REPORT)