Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360786

Luminaire Tested: **GSS-SB1D-750-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360786
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB1D-750-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 1SQUARE 76W 70CRI 5000K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(26) 5000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	9720.8 lumens
Efficiency:	N/A
Efficacy:	127.9 lumens/watt
Luminous Opening:	Rectangular (W 0.5' x L: 0.5' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B3 - U0 - G3


Input Watts (W):	76
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	6.7%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360786
CATALOG NUMBER: GSS-SB1D-750-U-T1

Iso-Footcandle Lines of Horizontal Illumination

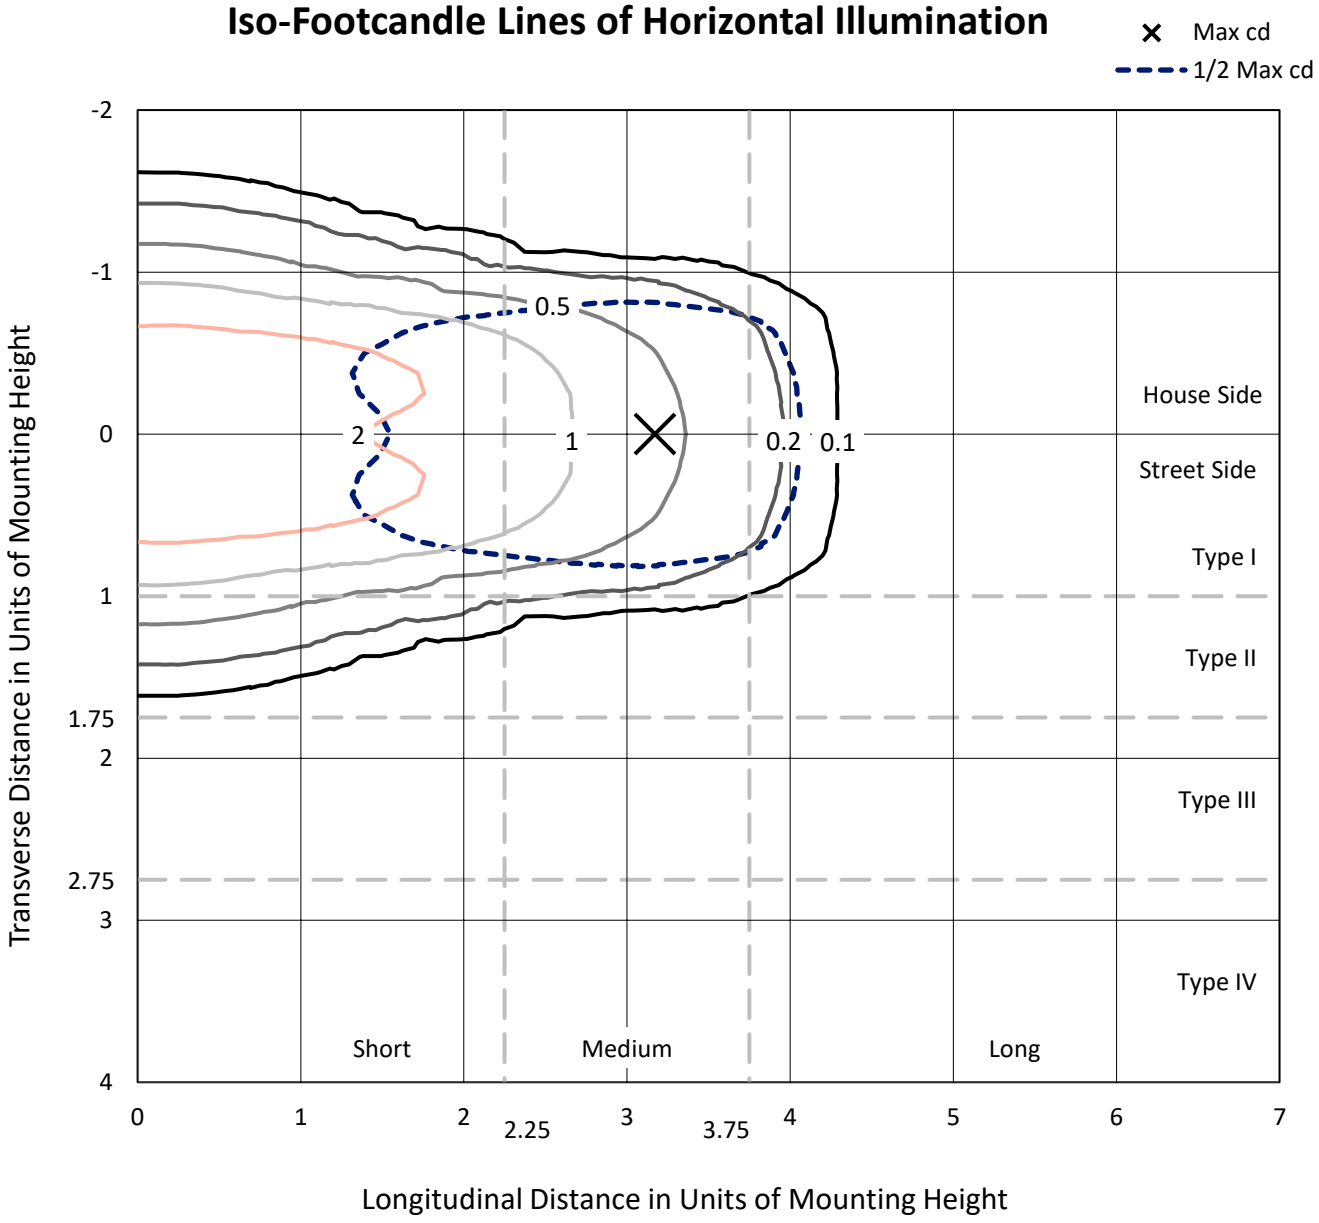


Based on 20 foot mounting height. Maximum calculated value = 4.8 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360786
CATALOG NUMBER: GSS-SB1D-750-U-T1

Luminous Intensity Polar Plot

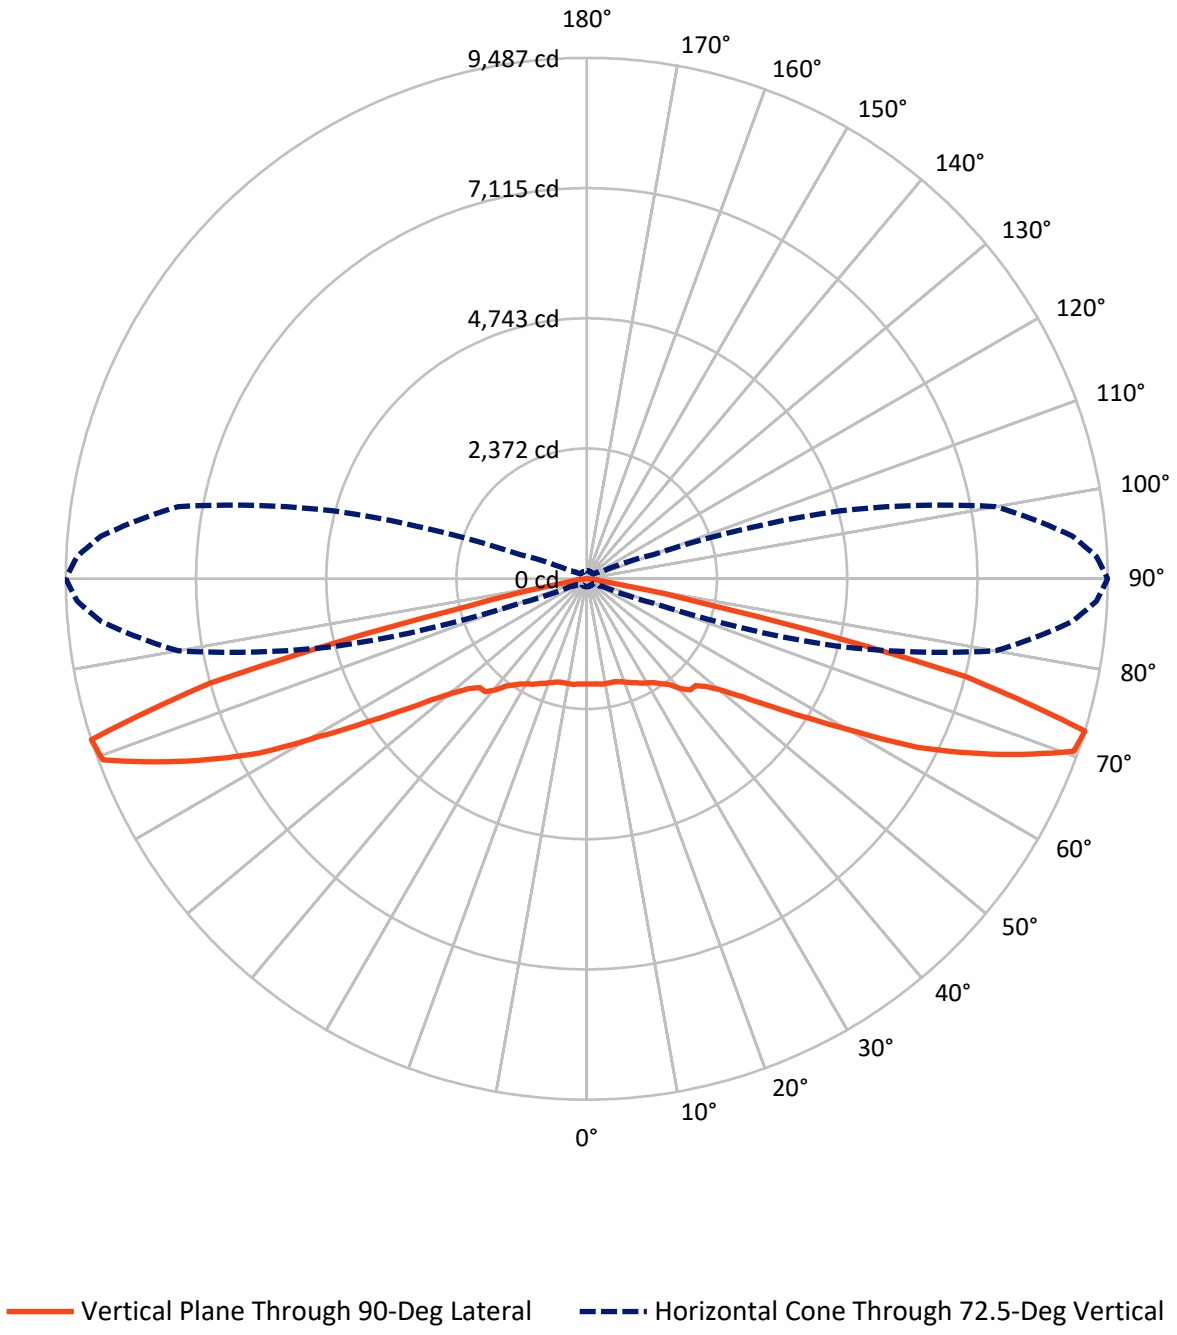

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360786
CATALOG NUMBER: GSS-SB1D-750-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	4860.4	0.0	4860.4
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	4860.4	0.0	4860.4
	% Fixture	50.0	0.0	50.0
Total	Lumens	9720.8	0.0	9720.8
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	185.4	1.9
10°-20°	565.0	5.8
20°-30°	944.4	9.7
30°-40°	1302.3	13.4
40°-50°	1596.5	16.4
50°-60°	1870.9	19.2
60°-70°	2077.6	21.4
70°-80°	1129.8	11.6
80°-90°	49.0	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	9720.8	100.0
0°-180°	9720.8	100.0

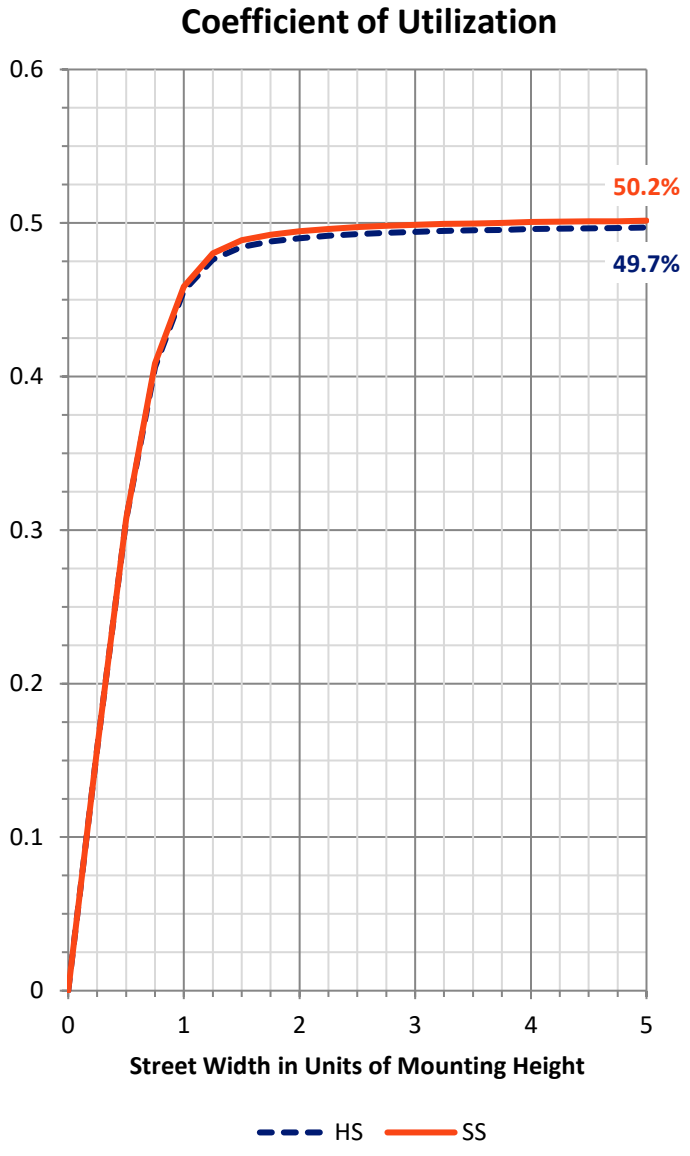

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360786
CATALOG NUMBER: GSS-SB1D-750-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	847.4	8.7			
FM	(30°-60°)	2384.9	24.5			
FH	(60°-80°)	1603.7	16.5			G1/1800
FVH	(80°-90°)	24.5	0.3			G1/100
BL	(0°-30°)	847.4	8.7	B2/1000		
BM	(30°-60°)	2384.9	24.5	B2/2500		
BH	(60°-80°)	1603.7	16.5	B3/2500		G3/2500
BVH	(80°-90°)	24.5	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B3-U0-G3
Type I Short

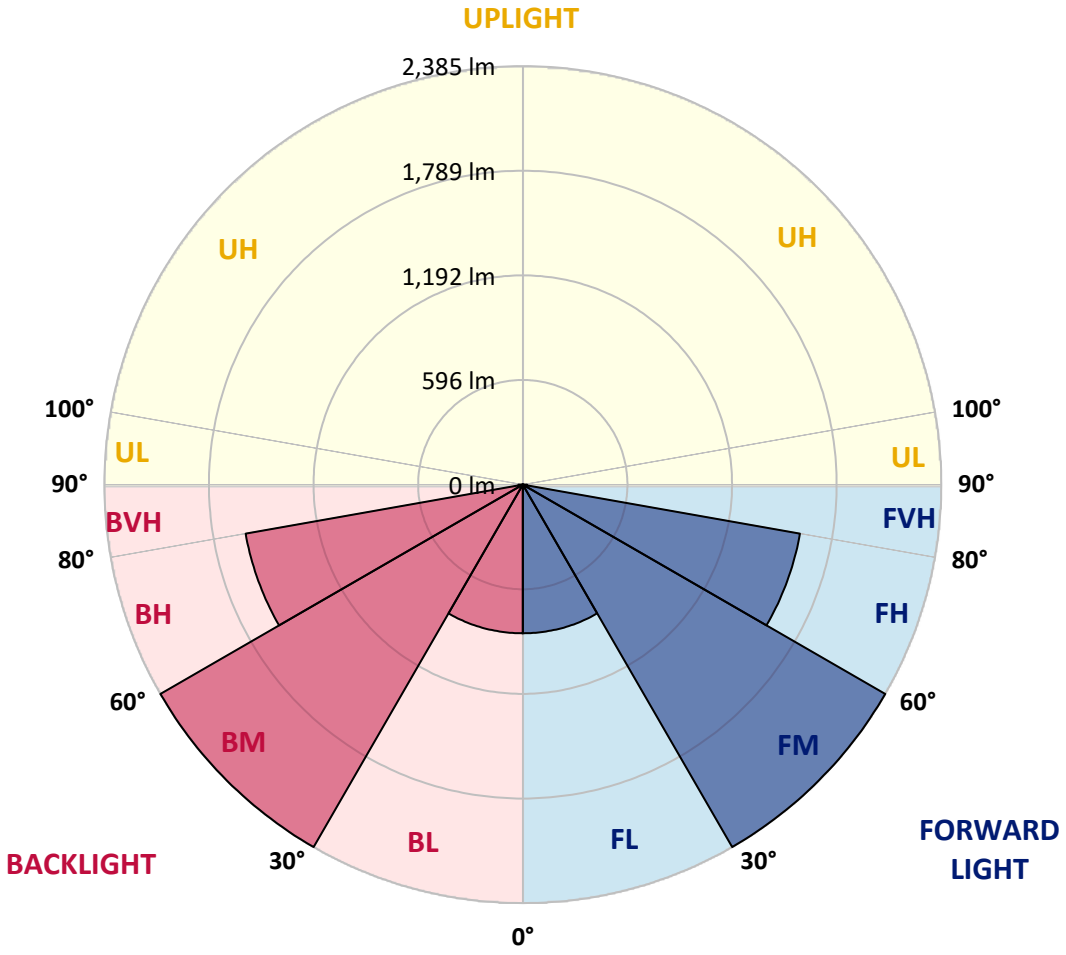

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360786
CATALOG NUMBER: GSS-SB1D-750-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	1915.2	1915.2	1915.2	1915.2	1915.2	1915.2	1915.2	1915.2	1915.2	1915.2	1915.2
2.5°	1917.4	1917.4	1911.0	1919.5	1915.2	1917.4	1919.5	1917.4	1915.2	1917.4	1919.5
5°	1928.0	1923.8	1928.0	1932.3	1925.9	1930.1	1928.0	1917.4	1923.8	1923.8	1923.8
7.5°	1947.2	1951.4	1947.2	1957.8	1951.4	1964.2	1951.4	1942.9	1940.8	1938.6	1938.6
10°	1955.7	1955.7	1953.5	1972.7	1977.0	1989.7	1981.2	1968.4	1962.1	1953.5	1945.0
12.5°	1932.3	1936.5	1947.2	1983.3	2000.4	2025.9	2019.5	1994.0	1974.8	1968.4	1955.7
15°	1906.7	1911.0	1932.3	1977.0	2017.4	2055.7	2053.6	2021.6	1998.2	1981.2	1962.1
17.5°	1866.3	1872.7	1902.5	1970.6	2042.9	2085.5	2098.3	2066.3	2040.8	2013.1	1987.6
20°	1798.2	1798.2	1851.4	1938.6	2038.7	2134.4	2168.5	2142.9	2113.1	2068.5	2034.4
22.5°	1721.6	1725.8	1779.0	1894.0	2036.5	2177.0	2243.0	2215.3	2185.5	2136.6	2085.5
25°	1645.0	1645.0	1704.6	1834.4	2008.9	2206.8	2330.2	2315.3	2255.7	2211.0	2145.1
27.5°	1574.8	1574.8	1638.6	1774.8	1962.1	2215.3	2417.5	2417.5	2351.5	2285.5	2213.2
30°	1491.8	1513.0	1585.4	1728.0	1919.5	2200.4	2481.3	2521.7	2462.1	2377.0	2270.6
32.5°	1421.5	1436.4	1510.9	1662.0	1857.8	2183.4	2553.7	2653.7	2592.0	2474.9	2355.7
35°	1338.5	1336.4	1421.5	1570.5	1770.5	2145.1	2611.1	2811.1	2751.6	2626.0	2464.3
37.5°	1230.0	1230.0	1317.3	1462.0	1687.5	2079.1	2657.9	2985.6	2941.0	2798.4	2626.0
40°	1113.0	1125.7	1202.3	1349.2	1587.5	2000.4	2657.9	3128.2	3151.6	3004.8	2826.0
42.5°	1027.8	1032.1	1102.3	1240.6	1476.9	1898.2	2623.9	3251.6	3321.9	3198.4	2966.5
45°	938.5	949.1	1008.7	1136.4	1361.9	1776.9	2564.3	3390.0	3502.8	3417.6	3113.3
47.5°	829.9	840.6	908.7	1038.5	1253.4	1645.0	2464.3	3534.7	3770.9	3709.2	3375.1
50°	704.4	712.9	776.7	915.1	1132.1	1493.9	2338.7	3643.2	4039.0	4100.7	3770.9
52.5°	551.2	557.5	625.6	759.7	987.4	1349.2	2162.1	3709.2	4309.3	4526.3	4300.8
55°	395.8	406.5	466.0	576.7	795.9	1155.5	1951.4	3743.2	4605.1	5030.7	4958.3
57.5°	285.2	289.4	329.8	415.0	591.6	927.8	1681.2	3685.8	4871.1	5632.9	5784.0
60°	236.2	236.2	242.6	283.0	404.3	655.4	1357.7	3473.0	5098.8	6241.5	6707.6
62.5°	217.1	217.1	221.3	227.7	266.0	425.6	970.4	3041.0	5124.3	6826.8	7720.5
65°	197.9	197.9	202.2	206.4	214.9	276.6	585.2	2225.9	4624.2	6833.1	8265.3
67.5°	180.9	180.9	183.0	185.1	189.4	202.2	321.3	1349.2	3700.7	6652.3	8473.9
70°	163.9	163.9	163.9	161.7	168.1	170.2	212.8	685.2	2474.9	6007.5	8373.8
72.5°	*144.7*	*144.7*	*142.6*	*138.3*	*140.5*	*140.5*	*157.5*	*336.2*	*1285.3*	*4775.3*	*7560.9*
75°	123.4	125.6	117.0	112.8	110.7	112.8	125.6	191.5	574.6	2896.3	5650.0
77.5°	104.3	108.5	95.8	87.2	85.1	85.1	97.9	119.2	246.9	1051.3	2532.4
80°	78.7	80.9	70.2	61.7	61.7	59.6	72.4	87.2	117.0	312.8	568.2
82.5°	44.7	44.7	40.4	36.2	34.0	36.2	48.9	59.6	72.4	110.7	155.3
85°	10.6	10.6	12.8	14.9	14.9	19.2	27.7	31.9	38.3	44.7	59.6
87.5°	2.1	2.1	2.1	4.3	6.4	6.4	10.6	14.9	19.2	23.4	25.5
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360786
CATALOG NUMBER: GSS-SB1D-750-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	1915.2	1915.2	*1915.2*
2.5°	1919.5	1921.6	*1919.5*
5°	1932.3	1928.0	*1921.6*
7.5°	1934.4	1936.5	*1938.6*
10°	1942.9	1951.4	*1938.6*
12.5°	1951.4	1945.0	*1940.8*
15°	1957.8	1955.7	*1942.9*
17.5°	1981.2	1972.7	*1970.6*
20°	2017.4	2015.3	*2008.9*
22.5°	2059.9	2055.7	*2053.6*
25°	2121.7	2106.8	*2098.3*
27.5°	2172.7	2160.0	*2155.7*
30°	2223.8	2198.3	*2198.3*
32.5°	2268.5	2262.1	*2257.9*
35°	2374.9	2343.0	*2347.2*
37.5°	2504.7	2472.8	*2445.1*
40°	2687.7	2645.2	*2628.1*
42.5°	2804.8	2762.2	*2766.5*
45°	2870.7	2796.2	*2777.1*
47.5°	3049.5	2955.9	*2930.3*
50°	3338.9	3224.0	*3192.1*
52.5°	3807.1	3621.9	*3579.4*
55°	4394.4	4166.7	*4124.1*
57.5°	5198.8	4896.6	*4805.1*
60°	6177.7	5803.2	*5664.8*
62.5°	7354.5	6892.7	*6760.8*
65°	8239.8	7854.6	*7650.3*
67.5°	8948.4	8631.3	*8533.5*
70°	9369.8	9384.7	*9410.2*
72.5°	*8882.5*	*9291.0*	*9486.8*
75°	6509.7	6826.8	*7131.1*
77.5°	2515.3	2268.5	*2196.1*
80°	406.5	380.9	*393.7*
82.5°	183.0	193.7	*204.3*
85°	119.2	138.3	*146.8*
87.5°	27.7	27.7	*27.7*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-6

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-750-U-5WQ

Data in this report applies to families of products including GSS-SB1A-750-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-750-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 5000K CCT 26 LEDS

Spectral Parameters

CCT (K):	4896
CIE u':	0.2101
CIE v':	0.4901
Duv:	0.0035
CIE x:	0.3489
CIE y:	0.3618
CIE z:	0.2893
Peak Wavelength (nm):	443
Dominant Wavelength (nm):	570
Purity:	13.25435
Rf:	70.7
Rg:	96.8

CRI (Ra):	70.2
R1:	68.1
R2:	73.9
R3:	79.4
R4:	72.1
R5:	69.2
R6:	65.7
R7:	78.1
R8:	55.3
R9:	-35.1
R10:	39.3
R11:	71.1
R12:	43.8
R13:	68.1
R14:	88.4
R15:	59.7

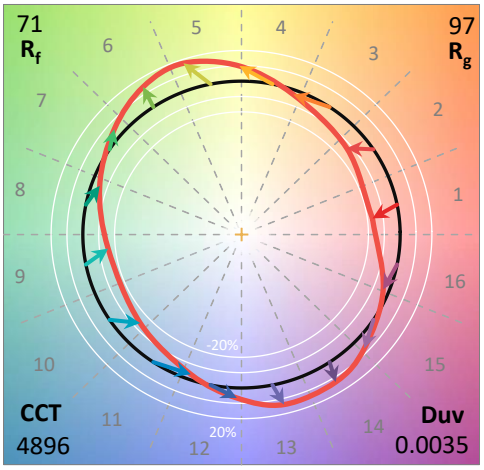

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-6

CIE 1931 Chromaticity Diagram

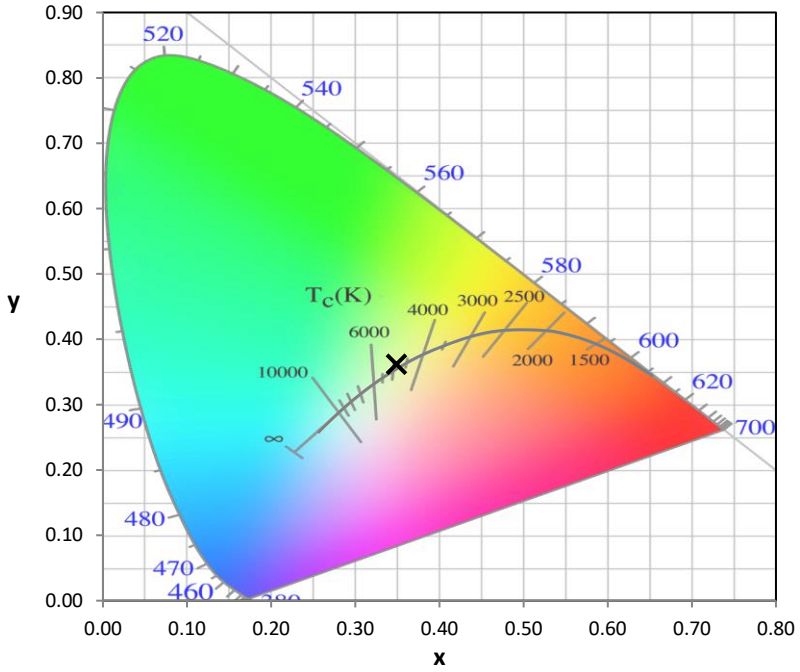

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

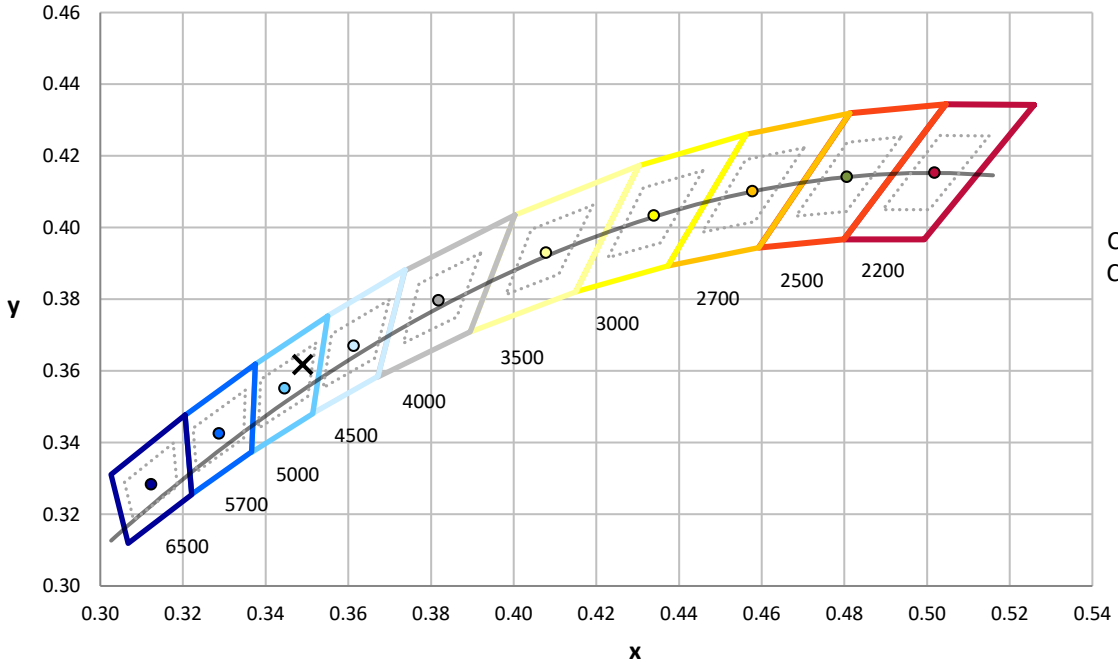


CCT = 4896K
CIE x = 0.3489
CIE y = 0.3618
Duv = 0.0035

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-6

Photopic Flux vs. Wavelength

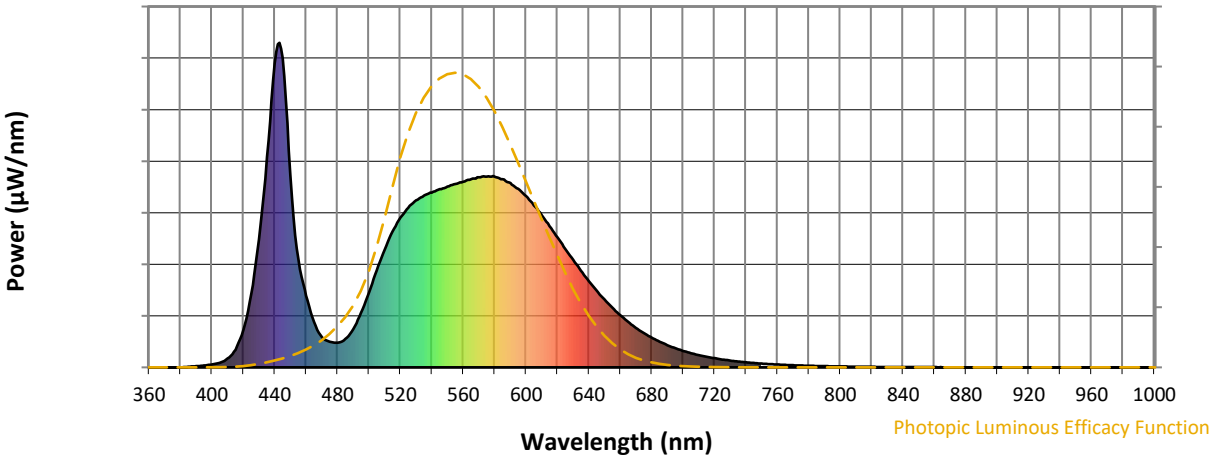


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Scotopic Flux vs. Wavelength

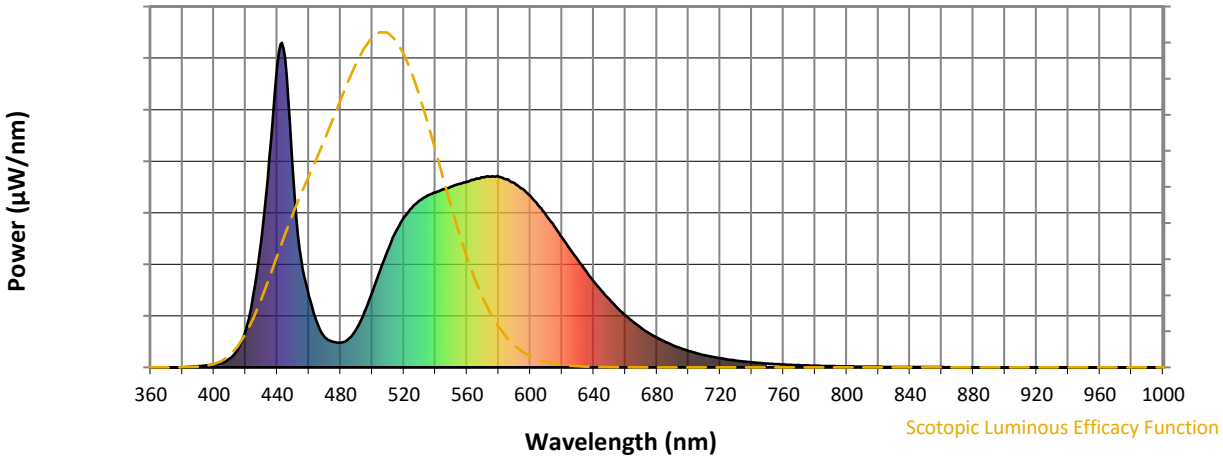


Scotopic Lumens: NR **S/P: 1.7**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Melanopic Flux vs. Wavelength

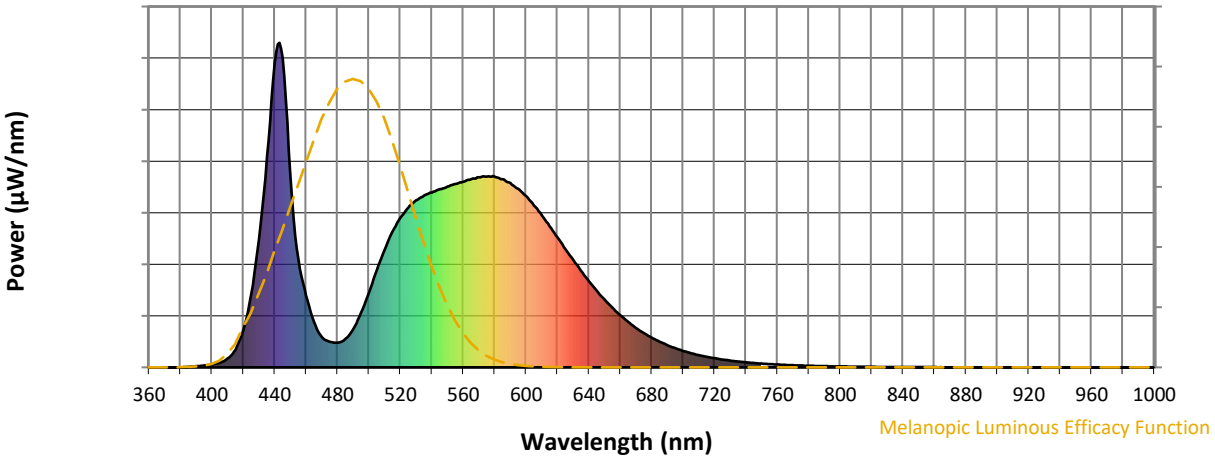

Melanopic Lumens: NR **M/P: 3.37**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			


REPORT NUMBER: SP1-2407-184-6

TM-30-18


Summary


R_f = 70.7
R_g = 96.8
CIE R_a = 70.2
R_9 = -35.1


Spectral Power Distribution Comparison

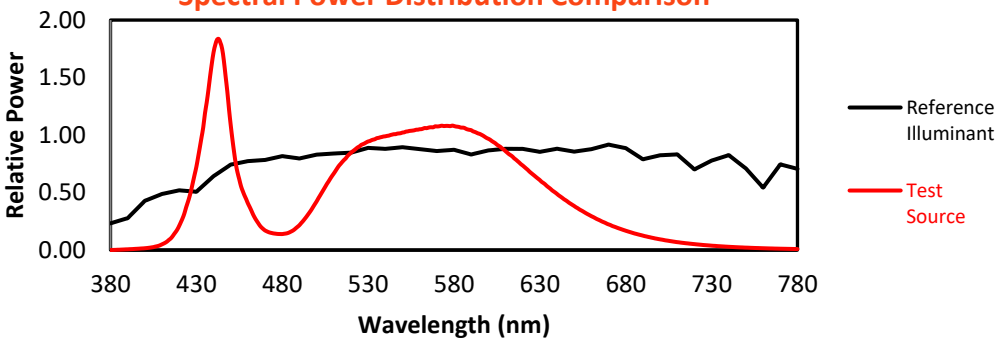


Color Vector Graphics

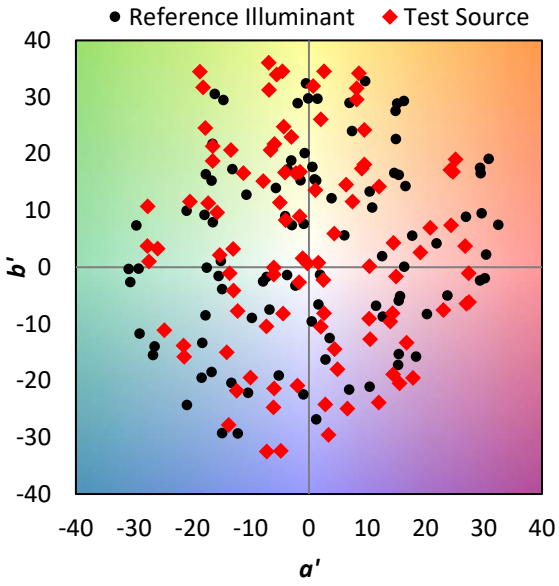

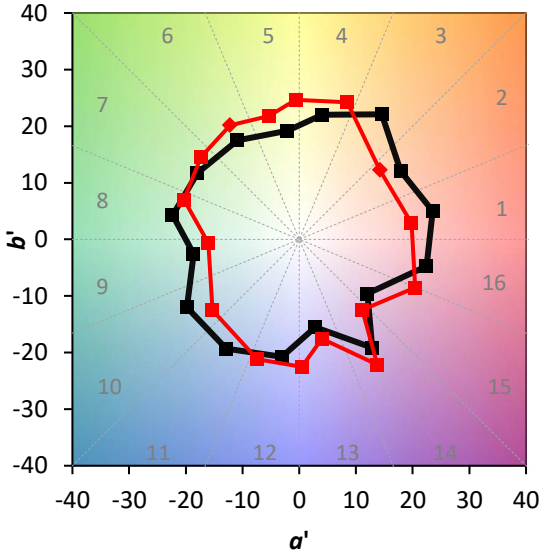

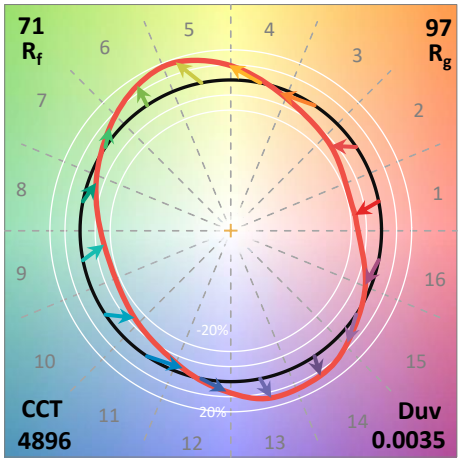

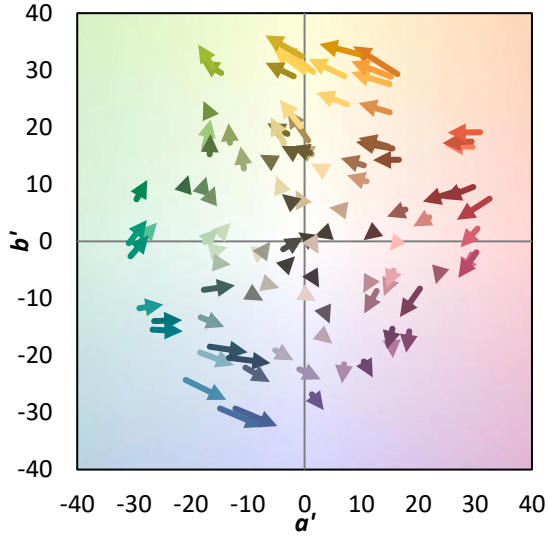


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 53	CES51 = 87	CES76 = 42
CES02 = 59	CES27 = 78	CES52 = 88	CES77 = 64
CES03 = 30	CES28 = 76	CES53 = 74	CES78 = 45
CES04 = 69	CES29 = 48	CES54 = 80	CES79 = 74
CES05 = 46	CES30 = 56	CES55 = 79	CES80 = 71
CES06 = 50	CES31 = 54	CES56 = 68	CES81 = 72
CES07 = 39	CES32 = 50	CES57 = 65	CES82 = 88
CES08 = 38	CES33 = 60	CES58 = 67	CES83 = 82
CES09 = 29	CES34 = 62	CES59 = 87	CES84 = 87
CES10 = 72	CES35 = 79	CES60 = 91	CES85 = 84
CES11 = 56	CES36 = 90	CES61 = 87	CES86 = 74
CES12 = 61	CES37 = 72	CES62 = 79	CES87 = 75
CES13 = 41	CES38 = 66	CES63 = 72	CES88 = 76
CES14 = 74	CES39 = 91	CES64 = 70	CES89 = 74
CES15 = 70	CES40 = 83	CES65 = 63	CES90 = 73
CES16 = 46	CES41 = 83	CES66 = 64	CES91 = 92
CES17 = 49	CES42 = 70	CES67 = 62	CES92 = 67
CES18 = 55	CES43 = 68	CES68 = 69	CES93 = 81
CES19 = 71	CES44 = 98	CES69 = 80	CES94 = 56
CES20 = 64	CES45 = 78	CES70 = 56	CES95 = 71
CES21 = 85	CES46 = 77	CES71 = 53	CES96 = 77
CES22 = 77	CES47 = 73	CES72 = 84	CES97 = 82
CES23 = 91	CES48 = 65	CES73 = 46	CES98 = 71
CES24 = 90	CES49 = 76	CES74 = 94	CES99 = 59
CES25 = 71	CES50 = 85	CES75 = 49	

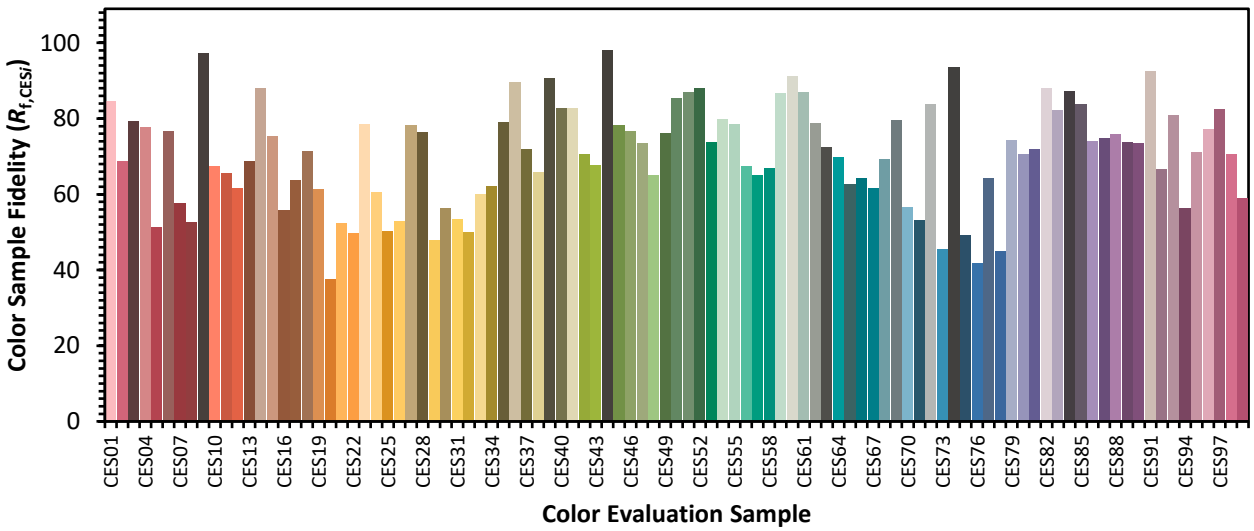



REPORT NUMBER: SP1-2407-184-6

TM-30-18

Color Rendition by Hue-Angle Bin

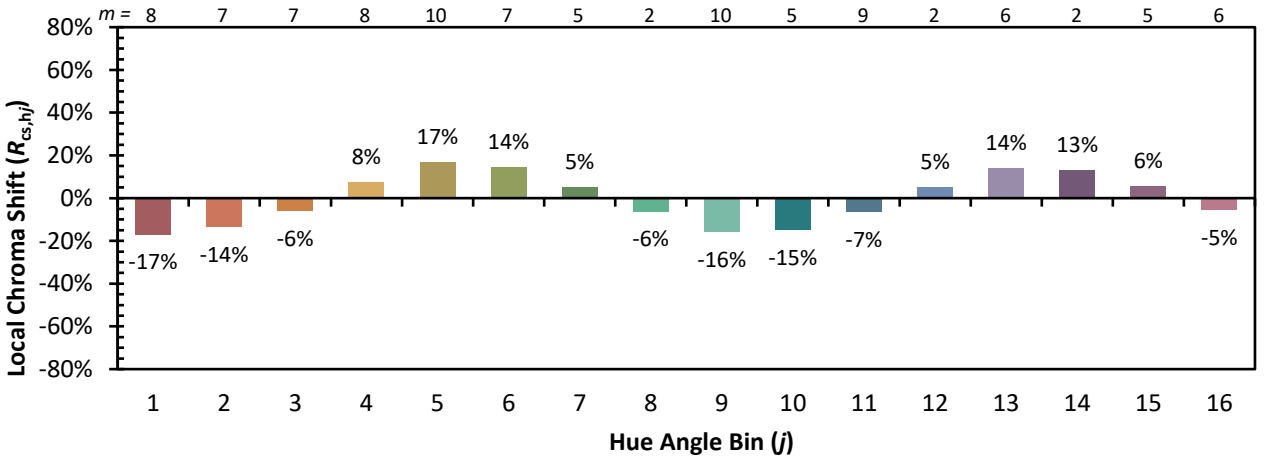

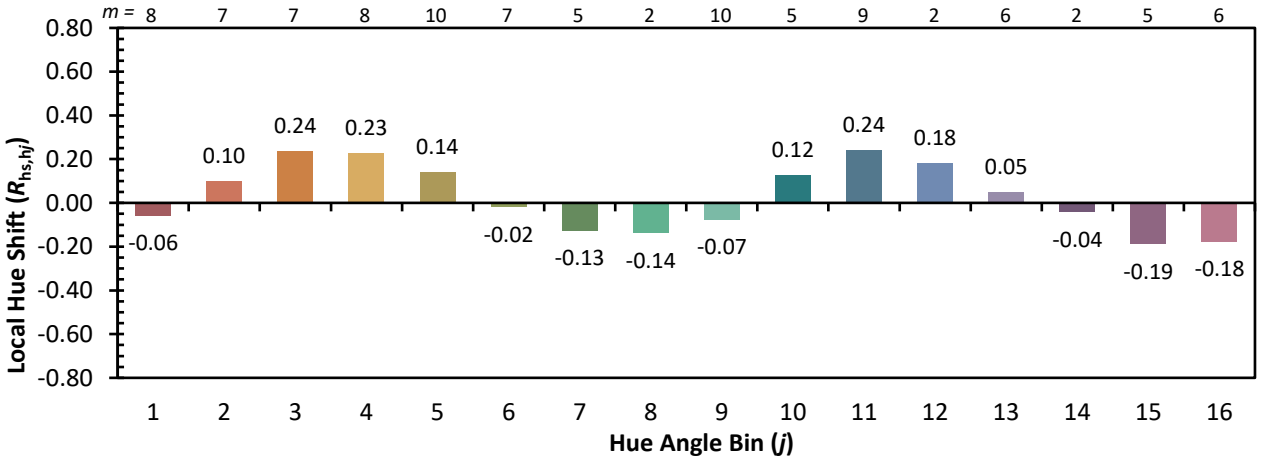


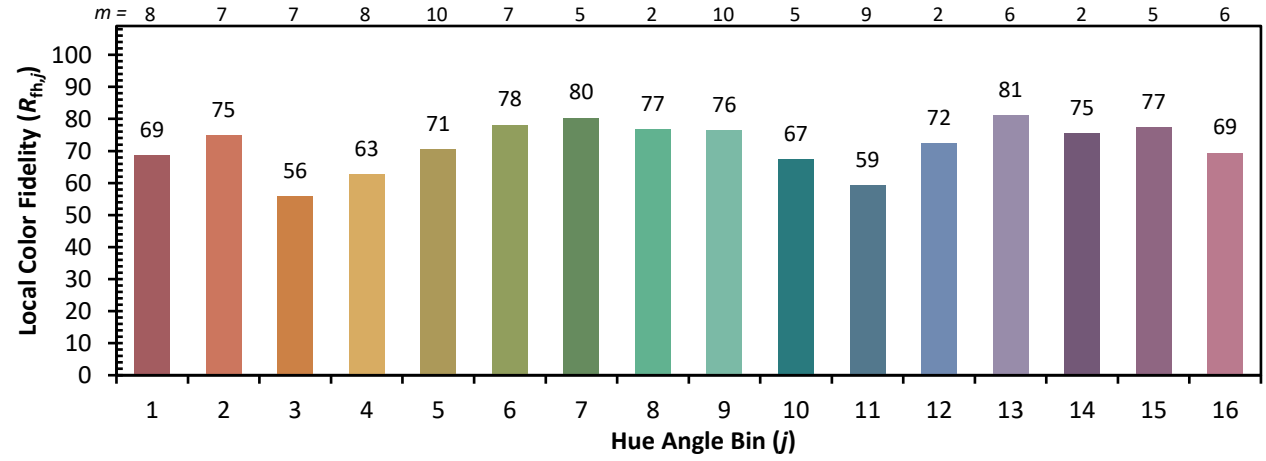


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Measure Comparisons

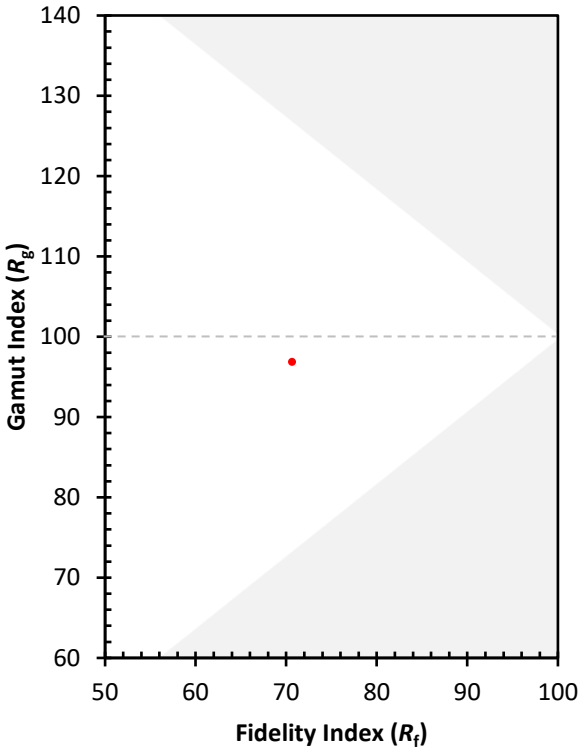

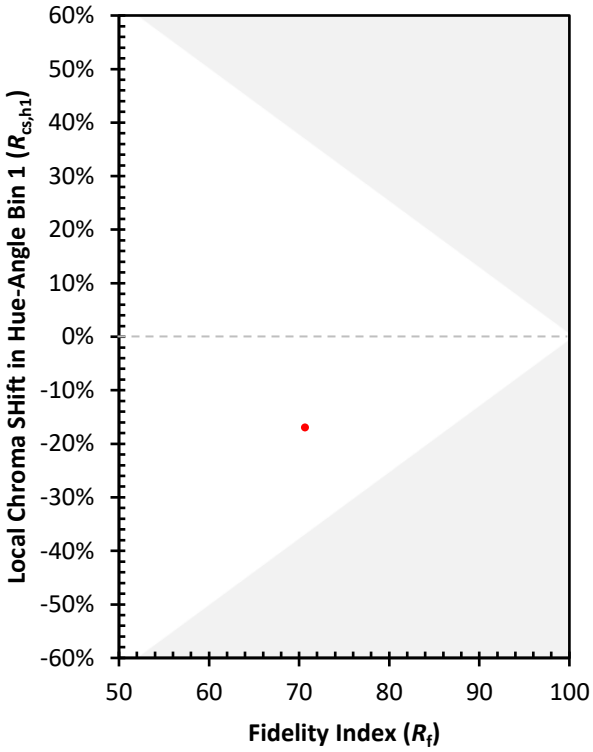

(END OF REPORT)