Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360790

Luminaire Tested: **GSS-SB2D-750-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360790
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB2D-750-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 2SQUARE 147W 70CRI 5000K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(52) 5000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	19848.1 lumens
Efficiency:	N/A
Efficacy:	135.0 lumens/watt
Luminous Opening:	Rectangular (W 1' x L: 0.5' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B4 - U0 - G4


Input Watts (W):	147
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	3.1%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360790
CATALOG NUMBER: GSS-SB2D-750-U-T1

Iso-Footcandle Lines of Horizontal Illumination

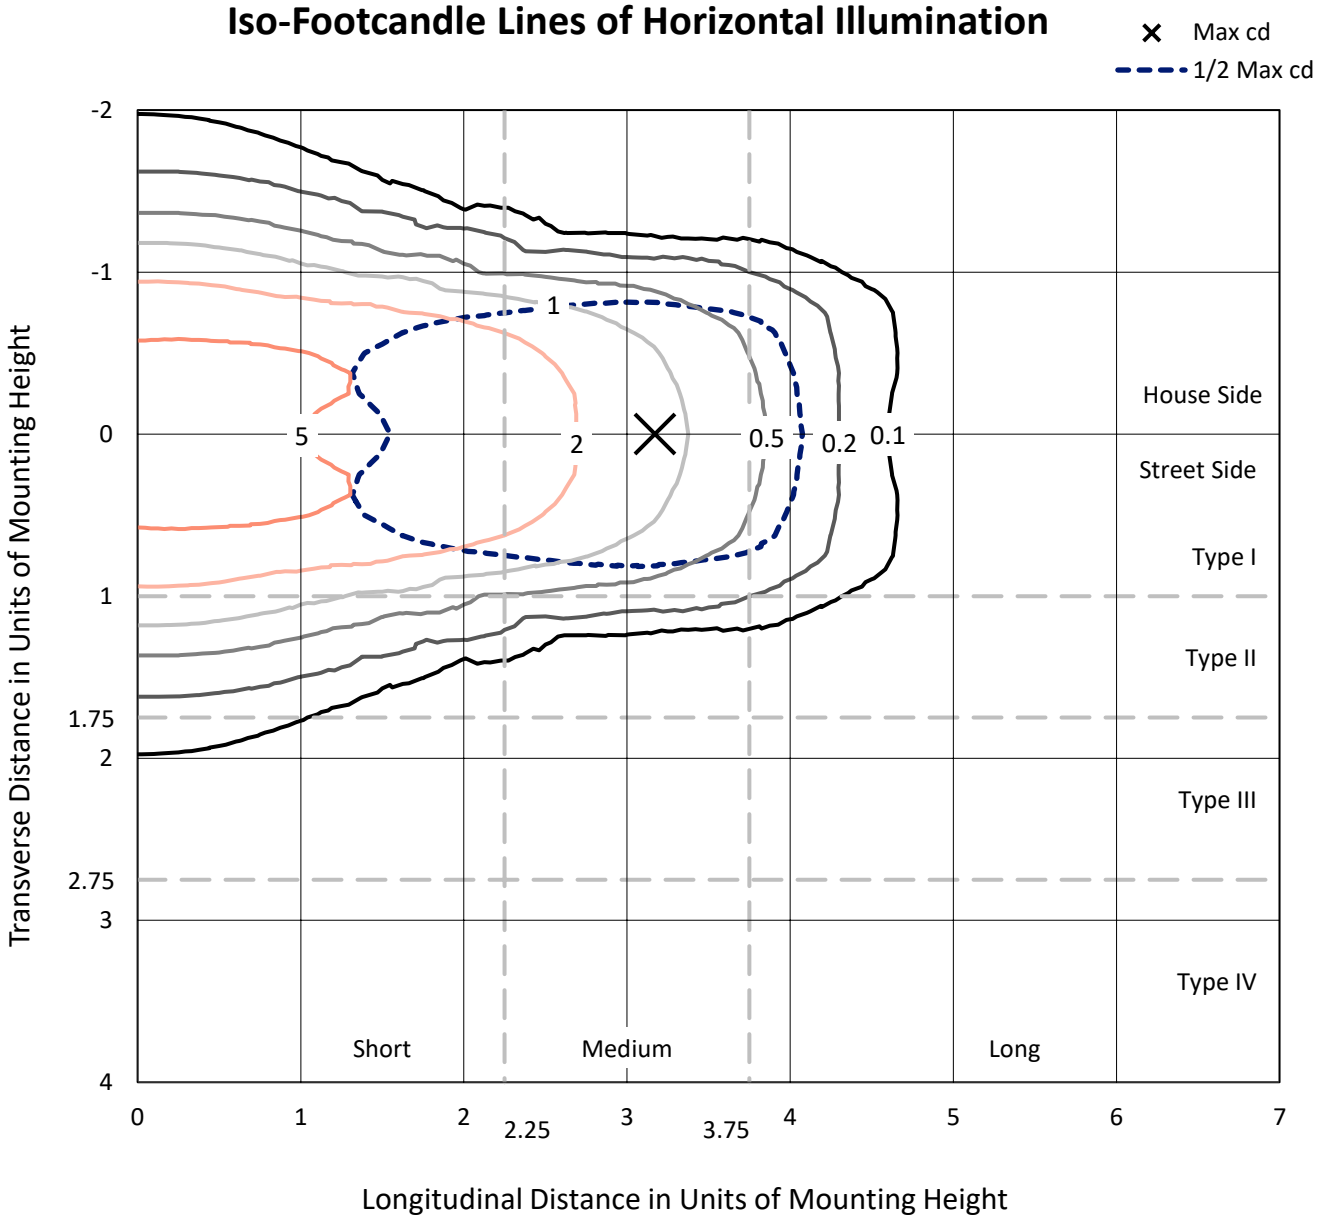


Based on 20 foot mounting height. Maximum calculated value = 9.8 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360790
CATALOG NUMBER: GSS-SB2D-750-U-T1

Luminous Intensity Polar Plot

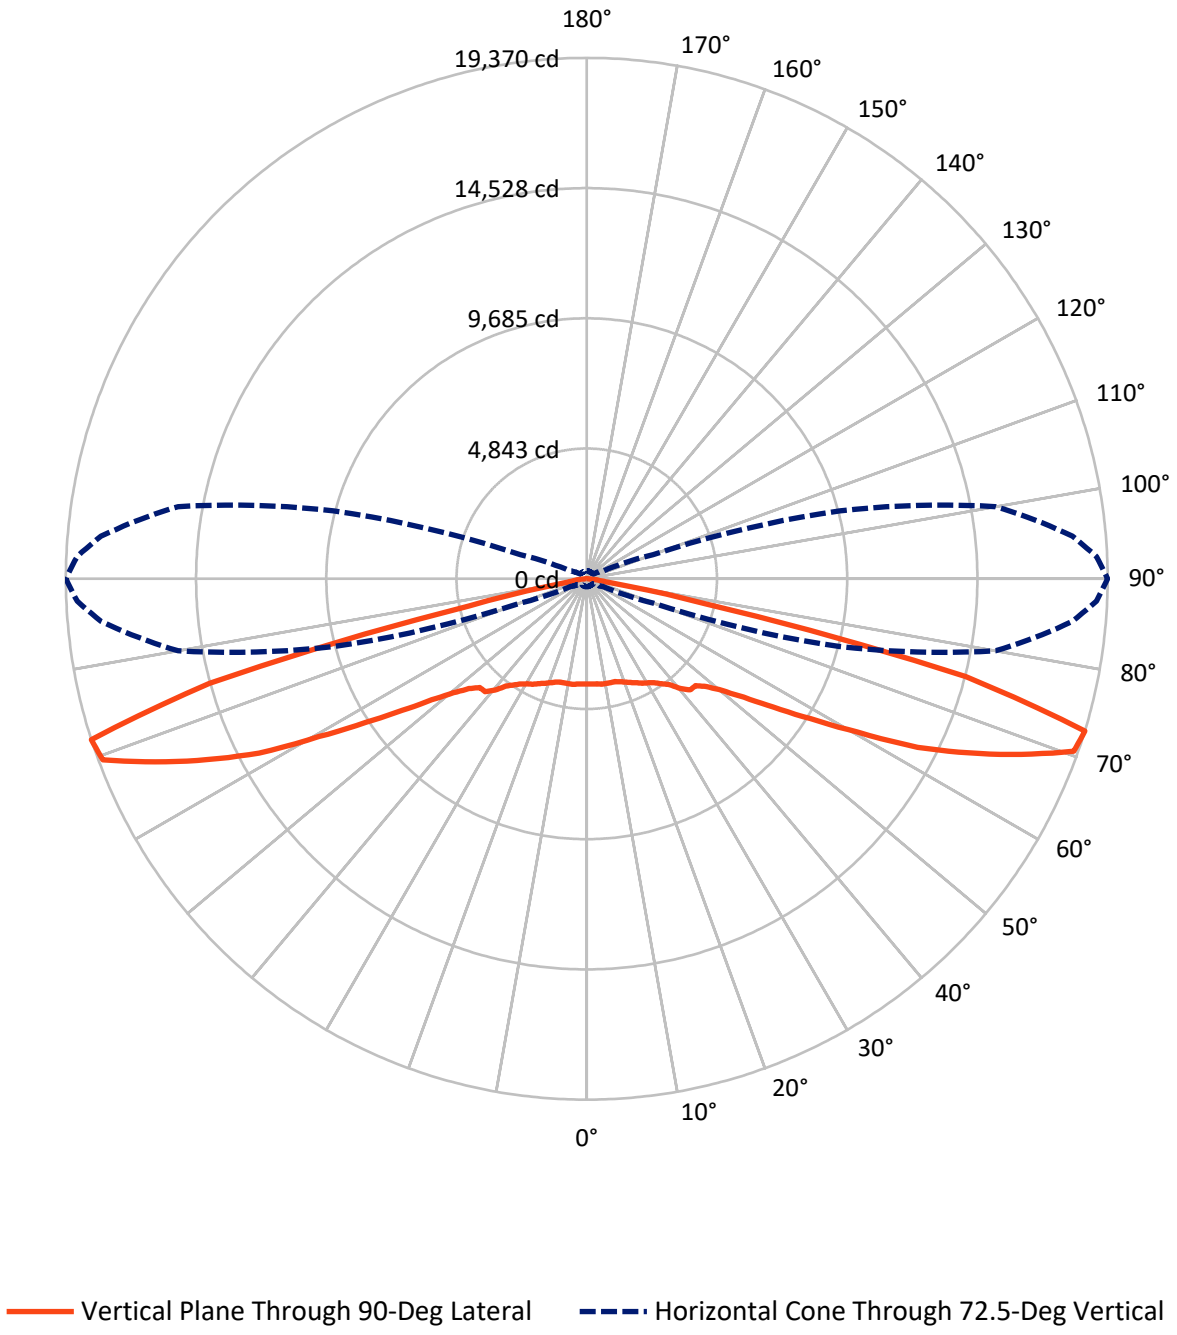

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360790
CATALOG NUMBER: GSS-SB2D-750-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	9924.0	0.0	9924.0
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	9924.0	0.0	9924.0
	% Fixture	50.0	0.0	50.0
Total	Lumens	19848.1	0.0	19848.1
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	378.5	1.9
10°-20°	1153.6	5.8
20°-30°	1928.2	9.7
30°-40°	2659.1	13.4
40°-50°	3259.8	16.4
50°-60°	3820.0	19.2
60°-70°	4242.0	21.4
70°-80°	2306.8	11.6
80°-90°	100.0	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	19848.1	100.0
0°-180°	19848.1	100.0

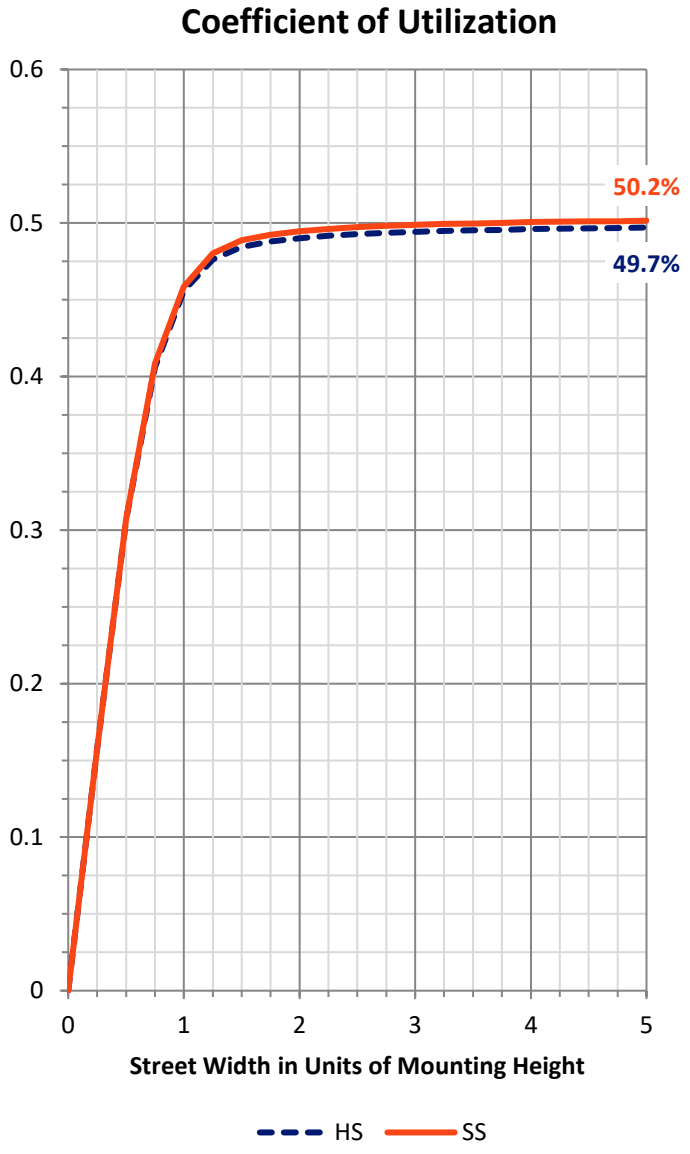

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360790
CATALOG NUMBER: GSS-SB2D-750-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	1730.2	8.7			
FM	(30°-60°)	4869.4	24.5			
FH	(60°-80°)	3274.4	16.5			G2/5000
FVH	(80°-90°)	50.0	0.3			G1/100
BL	(0°-30°)	1730.2	8.7	B3/2500		
BM	(30°-60°)	4869.4	24.5	B3/5000		
BH	(60°-80°)	3274.4	16.5	B4/5000		G4/5000
BVH	(80°-90°)	50.0	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B4-U0-G4
Type I Short

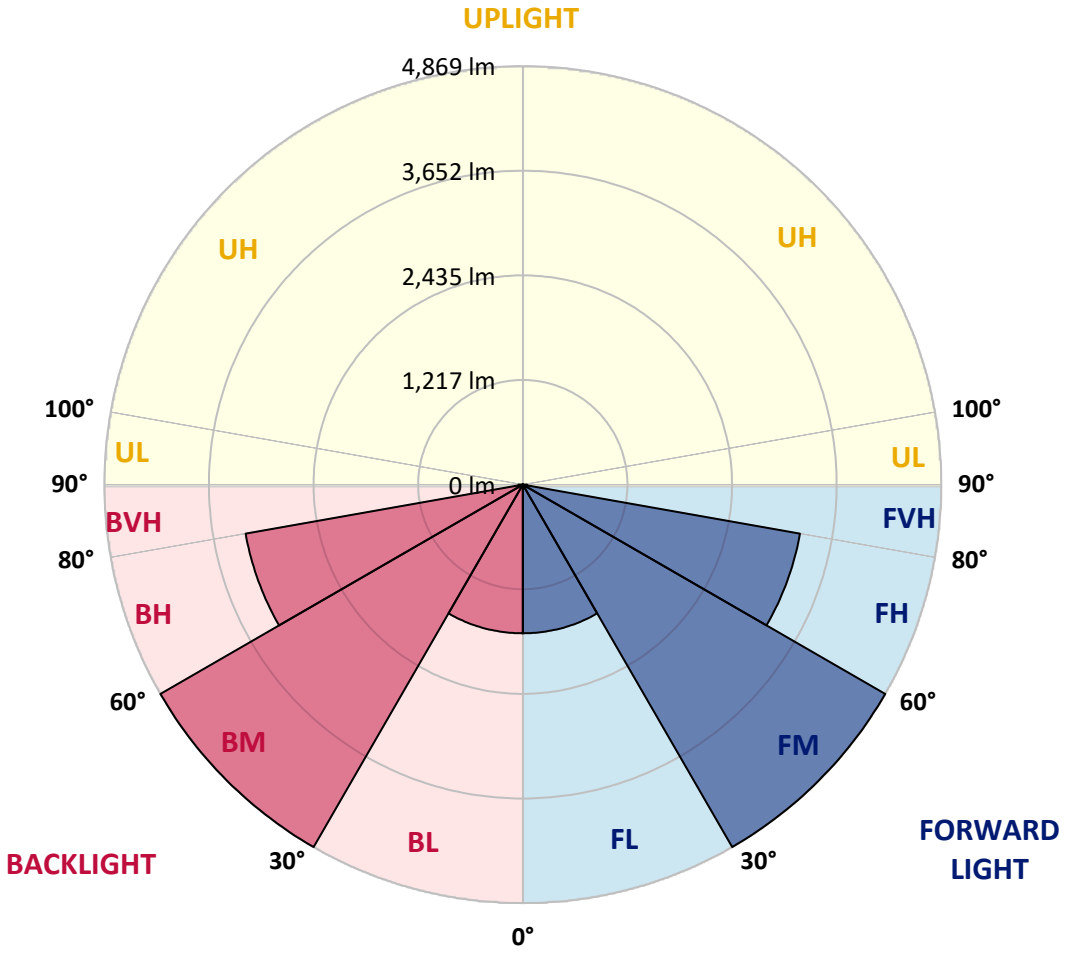

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360790
CATALOG NUMBER: GSS-SB2D-750-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	3910.6	3910.6	3910.6	3910.6	3910.6	3910.6	3910.6	3910.6	3910.6	3910.6	3910.6
2.5°	3914.9	3914.9	3901.9	3919.3	3910.6	3914.9	3919.3	3914.9	3910.6	3914.9	3919.3
5°	3936.6	3927.9	3936.6	3945.3	3932.3	3941.0	3936.6	3914.9	3927.9	3927.9	3927.9
7.5°	3975.7	3984.4	3975.7	3997.5	3984.4	4010.5	3984.4	3967.1	3962.7	3958.4	3958.4
10°	3993.1	3993.1	3988.8	4027.9	4036.6	4062.6	4045.3	4019.2	4006.2	3988.8	3971.4
12.5°	3945.3	3954.0	3975.7	4049.6	4084.4	4136.5	4123.5	4071.3	4032.2	4019.2	3993.1
15°	3893.2	3901.9	3945.3	4036.6	4119.1	4197.3	4193.0	4127.8	4080.0	4045.3	4006.2
17.5°	3810.6	3823.7	3884.5	4023.5	4171.3	4258.2	4284.2	4219.1	4166.9	4110.4	4058.3
20°	3671.6	3671.6	3780.2	3958.4	4162.6	4358.1	4427.6	4375.5	4314.7	4223.4	4153.9
22.5°	3515.2	3523.9	3632.5	3867.1	4158.2	4445.0	4579.7	4523.2	4462.4	4362.5	4258.2
25°	3358.7	3358.7	3480.4	3745.5	4101.7	4505.8	4757.9	4727.4	4605.8	4514.5	4379.8
27.5°	3215.4	3215.4	3345.7	3623.8	4006.2	4523.2	4936.0	4936.0	4801.3	4666.6	4518.9
30°	3045.9	3089.3	3237.1	3528.2	3919.3	4492.8	5066.4	5148.9	5027.2	4853.4	4636.2
32.5°	2902.5	2932.9	3085.0	3393.5	3793.2	4458.0	5214.1	5418.3	5292.3	5053.3	4810.0
35°	2733.1	2728.7	2902.5	3206.7	3615.1	4379.8	5331.4	5739.8	5618.2	5361.8	5031.6
37.5°	2511.5	2511.5	2689.6	2985.1	3445.6	4245.1	5427.0	6096.1	6004.9	5713.8	5361.8
40°	2272.5	2298.5	2455.0	2754.8	3241.4	4084.4	5427.0	6387.3	6435.1	6135.2	5770.3
42.5°	2098.7	2107.4	2250.7	2533.2	3015.5	3875.8	5357.5	6639.3	6782.7	6530.6	6057.0
45°	1916.2	1937.9	2059.6	2320.3	2780.8	3628.1	5235.8	6921.7	7152.0	6978.2	6356.8
47.5°	1694.6	1716.3	1855.3	2120.4	2559.2	3358.7	5031.6	7217.2	7699.5	7573.5	6891.3
50°	1438.2	1455.6	1586.0	1868.4	2311.6	3050.2	4775.2	7438.8	8246.9	8373.0	7699.5
52.5°	1125.4	1138.4	1277.5	1551.2	2016.1	2754.8	4414.6	7573.5	8798.8	9242.0	8781.4
55°	808.2	829.9	951.6	1177.5	1625.1	2359.4	3984.4	7643.0	9402.7	10271.8	10124.0
57.5°	582.2	590.9	673.5	847.3	1207.9	1894.5	3432.6	7525.7	9945.9	11501.4	11809.9
60°	482.3	482.3	495.3	577.9	825.6	1338.3	2772.2	7091.2	10410.8	12744.1	13695.7
62.5°	443.2	443.2	451.9	464.9	543.1	869.0	1981.4	6209.1	10462.9	13939.0	15763.9
65°	404.1	404.1	412.8	421.5	438.9	564.9	1194.9	4544.9	9441.8	13952.0	16876.3
67.5°	369.3	369.3	373.7	378.0	386.7	412.8	656.1	2754.8	7556.1	13582.7	17302.1
70°	334.6	334.6	334.6	330.2	343.3	347.6	434.5	1399.1	5053.3	12266.1	17097.9
72.5°	*295.5*	*295.5*	*291.1*	*282.4*	*286.8*	*286.8*	*321.5*	*686.5*	*2624.4*	*9750.3*	*15438.0*
75°	252.0	256.4	239.0	230.3	225.9	230.3	256.4	391.1	1173.2	5913.6	11536.2
77.5°	212.9	221.6	195.5	178.1	173.8	173.8	199.9	243.3	504.0	2146.5	5170.6
80°	160.8	165.1	143.4	126.0	126.0	121.7	147.7	178.1	239.0	638.7	1160.1
82.5°	91.2	91.2	82.6	73.9	69.5	73.9	99.9	121.7	147.7	225.9	317.2
85°	21.7	21.7	26.1	30.4	30.4	39.1	56.5	65.2	78.2	91.2	121.7
87.5°	4.3	4.3	4.3	8.7	13.0	13.0	21.7	30.4	39.1	47.8	52.1
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360790
CATALOG NUMBER: GSS-SB2D-750-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	3910.6	3910.6	*3910.6*
2.5°	3919.3	3923.6	*3919.3*
5°	3945.3	3936.6	*3923.6*
7.5°	3949.7	3954.0	*3958.4*
10°	3967.1	3984.4	*3958.4*
12.5°	3984.4	3971.4	*3962.7*
15°	3997.5	3993.1	*3967.1*
17.5°	4045.3	4027.9	*4023.5*
20°	4119.1	4114.8	*4101.7*
22.5°	4206.0	4197.3	*4193.0*
25°	4332.0	4301.6	*4284.2*
27.5°	4436.3	4410.2	*4401.6*
30°	4540.6	4488.5	*4488.5*
32.5°	4631.8	4618.8	*4610.1*
35°	4849.1	4783.9	*4792.6*
37.5°	5114.1	5049.0	*4992.5*
40°	5487.8	5400.9	*5366.2*
42.5°	5726.8	5639.9	*5648.6*
45°	5861.5	5709.4	*5670.3*
47.5°	6226.5	6035.3	*5983.2*
50°	6817.4	6582.8	*6517.6*
52.5°	7773.3	7395.3	*7308.4*
55°	8972.6	8507.7	*8420.7*
57.5°	10615.0	9998.0	*9811.2*
60°	12613.7	11849.0	*11566.6*
62.5°	15016.6	14073.7	*13804.3*
65°	16824.1	16037.7	*15620.5*
67.5°	18271.0	17623.6	*17423.7*
70°	19131.4	19161.8	*19213.9*
72.5°	*18136.3*	*18970.6*	*19370.3*
75°	13291.6	13939.0	*14560.3*
77.5°	5135.9	4631.8	*4484.1*
80°	829.9	777.8	*803.8*
82.5°	373.7	395.4	*417.1*
85°	243.3	282.4	*299.8*
87.5°	56.5	56.5	*56.5*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-6

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-750-U-5WQ

Data in this report applies to families of products including GSS-SB1A-750-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-750-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 5000K CCT 26 LEDS

Spectral Parameters

CCT (K):	4896
CIE u':	0.2101
CIE v':	0.4901
Duv:	0.0035
CIE x:	0.3489
CIE y:	0.3618
CIE z:	0.2893
Peak Wavelength (nm):	443
Dominant Wavelength (nm):	570
Purity:	13.25435
Rf:	70.7
Rg:	96.8

CRI (Ra):	70.2
R1:	68.1
R2:	73.9
R3:	79.4
R4:	72.1
R5:	69.2
R6:	65.7
R7:	78.1
R8:	55.3
R9:	-35.1
R10:	39.3
R11:	71.1
R12:	43.8
R13:	68.1
R14:	88.4
R15:	59.7

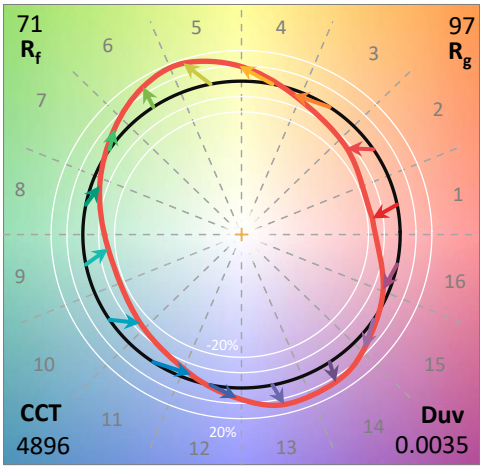

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-6

CIE 1931 Chromaticity Diagram

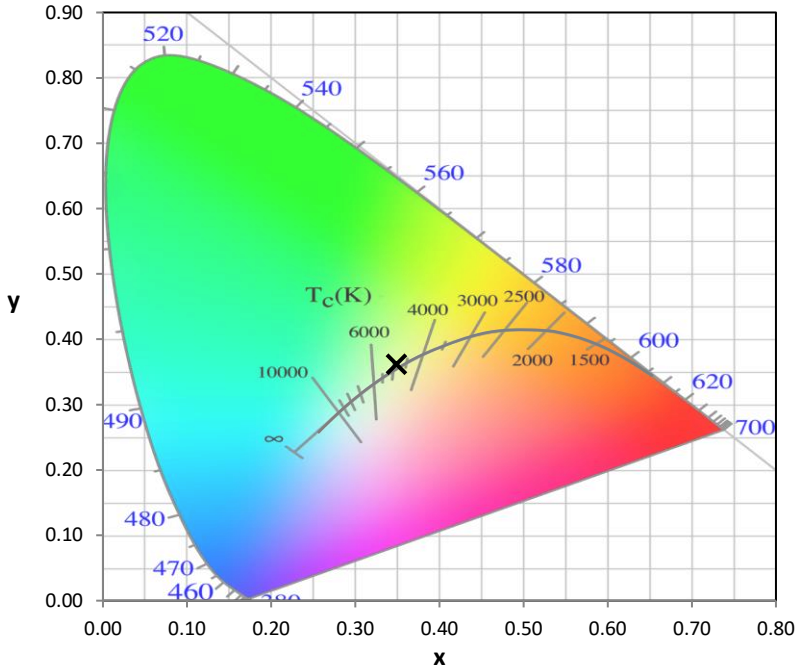

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

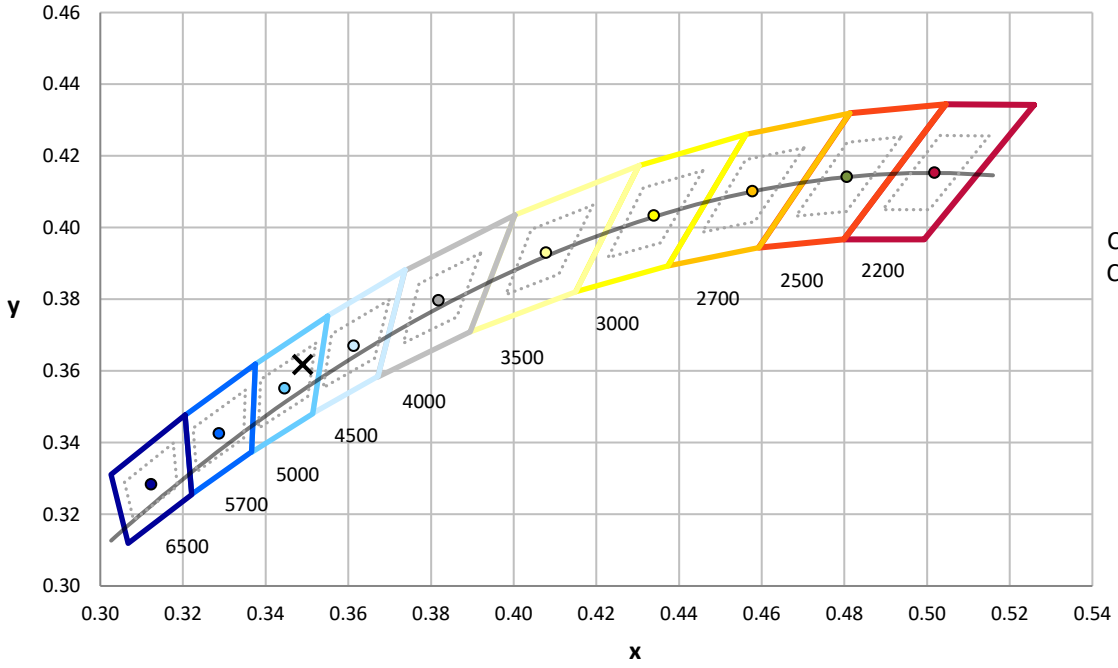


CCT = 4896K
CIE x = 0.3489
CIE y = 0.3618
Duv = 0.0035

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-6

Photopic Flux vs. Wavelength

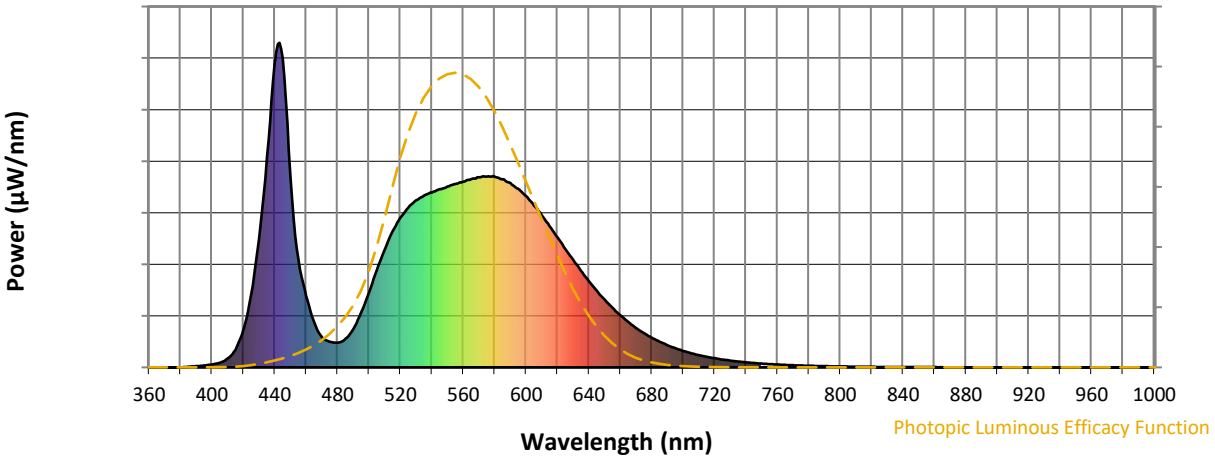


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Scotopic Flux vs. Wavelength

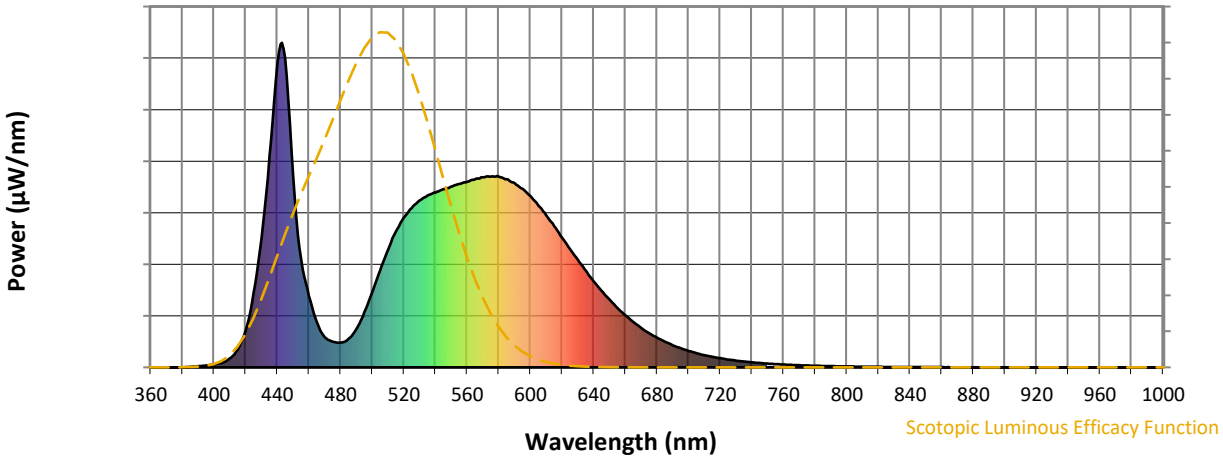


Scotopic Lumens: NR **S/P: 1.7**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Melanopic Flux vs. Wavelength

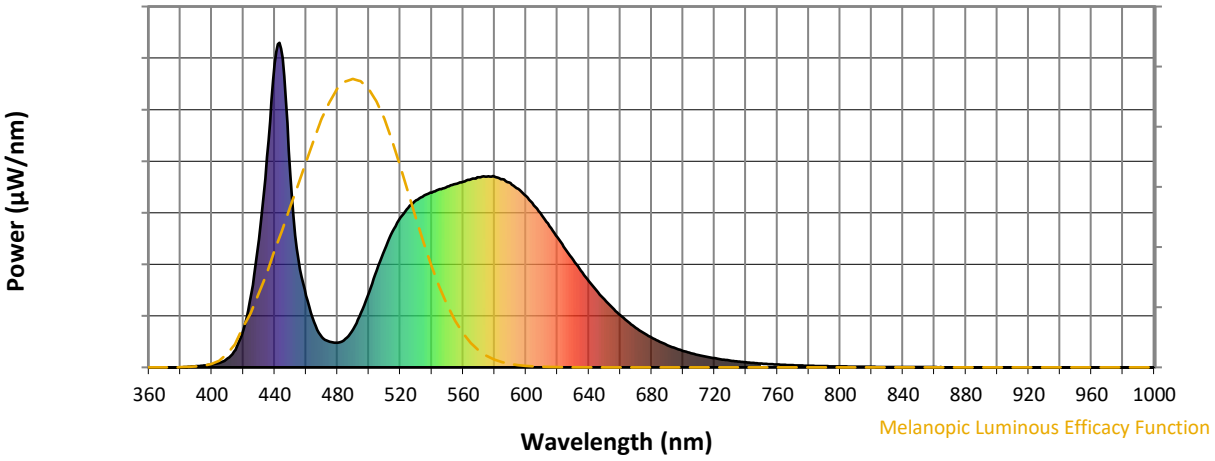

Melanopic Lumens: NR **M/P: 3.37**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			


REPORT NUMBER: SP1-2407-184-6

TM-30-18


Summary


R_f = 70.7
R_g = 96.8
CIE R_a = 70.2
R_9 = -35.1


Spectral Power Distribution Comparison

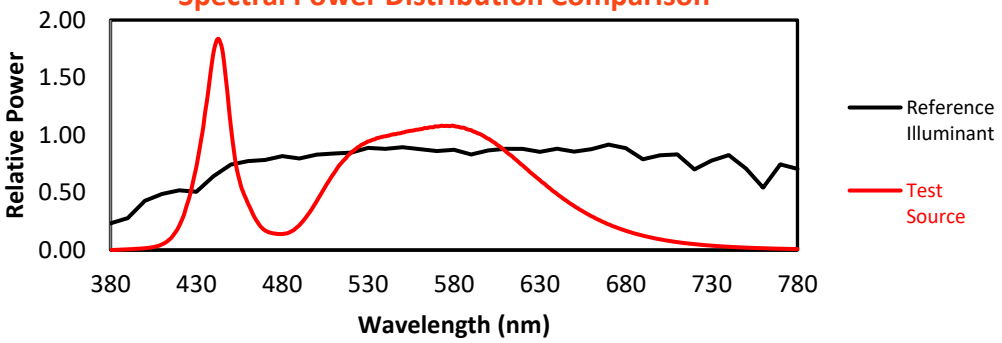


Color Vector Graphics

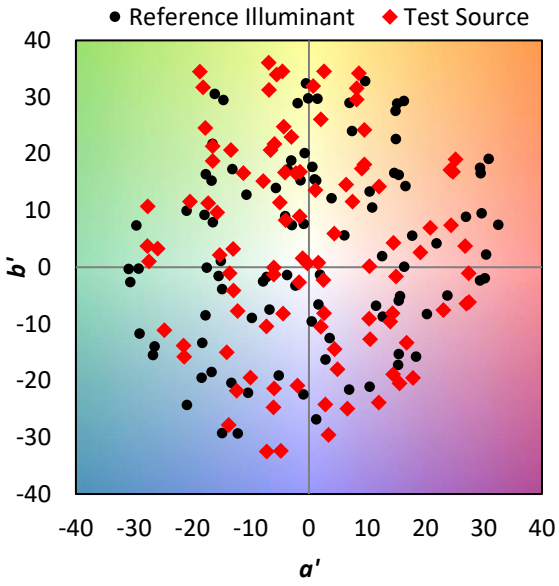

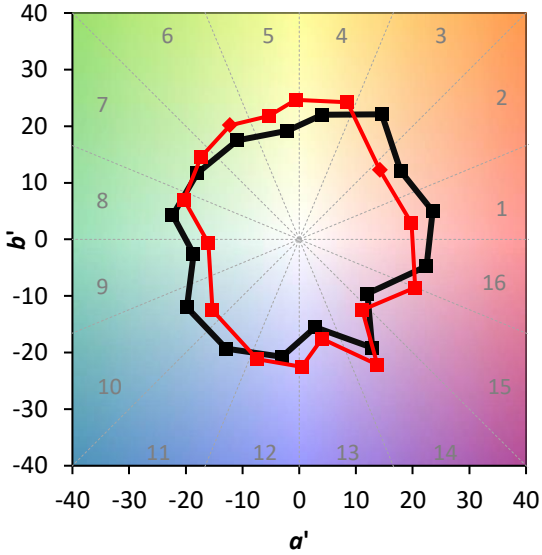

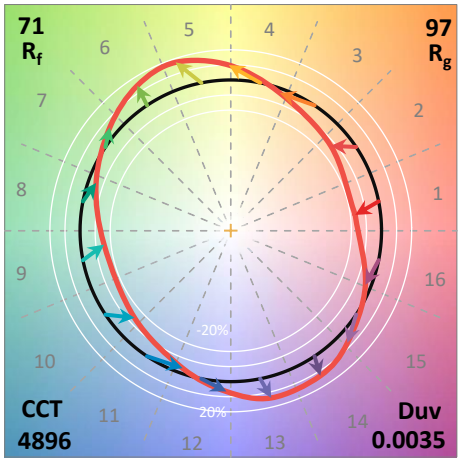

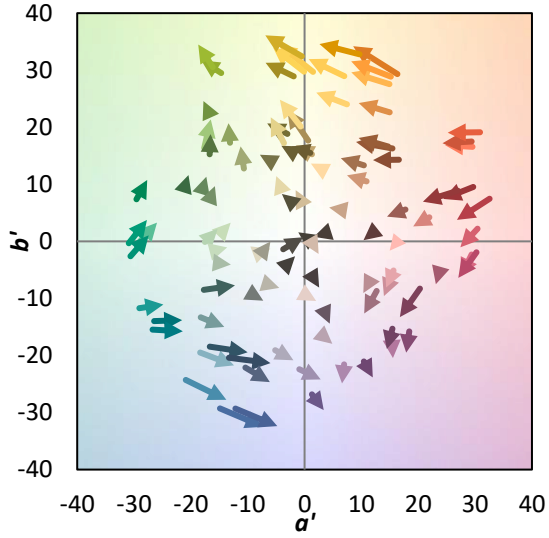


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 53	CES51 = 87	CES76 = 42
CES02 = 59	CES27 = 78	CES52 = 88	CES77 = 64
CES03 = 30	CES28 = 76	CES53 = 74	CES78 = 45
CES04 = 69	CES29 = 48	CES54 = 80	CES79 = 74
CES05 = 46	CES30 = 56	CES55 = 79	CES80 = 71
CES06 = 50	CES31 = 54	CES56 = 68	CES81 = 72
CES07 = 39	CES32 = 50	CES57 = 65	CES82 = 88
CES08 = 38	CES33 = 60	CES58 = 67	CES83 = 82
CES09 = 29	CES34 = 62	CES59 = 87	CES84 = 87
CES10 = 72	CES35 = 79	CES60 = 91	CES85 = 84
CES11 = 56	CES36 = 90	CES61 = 87	CES86 = 74
CES12 = 61	CES37 = 72	CES62 = 79	CES87 = 75
CES13 = 41	CES38 = 66	CES63 = 72	CES88 = 76
CES14 = 74	CES39 = 91	CES64 = 70	CES89 = 74
CES15 = 70	CES40 = 83	CES65 = 63	CES90 = 73
CES16 = 46	CES41 = 83	CES66 = 64	CES91 = 92
CES17 = 49	CES42 = 70	CES67 = 62	CES92 = 67
CES18 = 55	CES43 = 68	CES68 = 69	CES93 = 81
CES19 = 71	CES44 = 98	CES69 = 80	CES94 = 56
CES20 = 64	CES45 = 78	CES70 = 56	CES95 = 71
CES21 = 85	CES46 = 77	CES71 = 53	CES96 = 77
CES22 = 77	CES47 = 73	CES72 = 84	CES97 = 82
CES23 = 91	CES48 = 65	CES73 = 46	CES98 = 71
CES24 = 90	CES49 = 76	CES74 = 94	CES99 = 59
CES25 = 71	CES50 = 85	CES75 = 49	

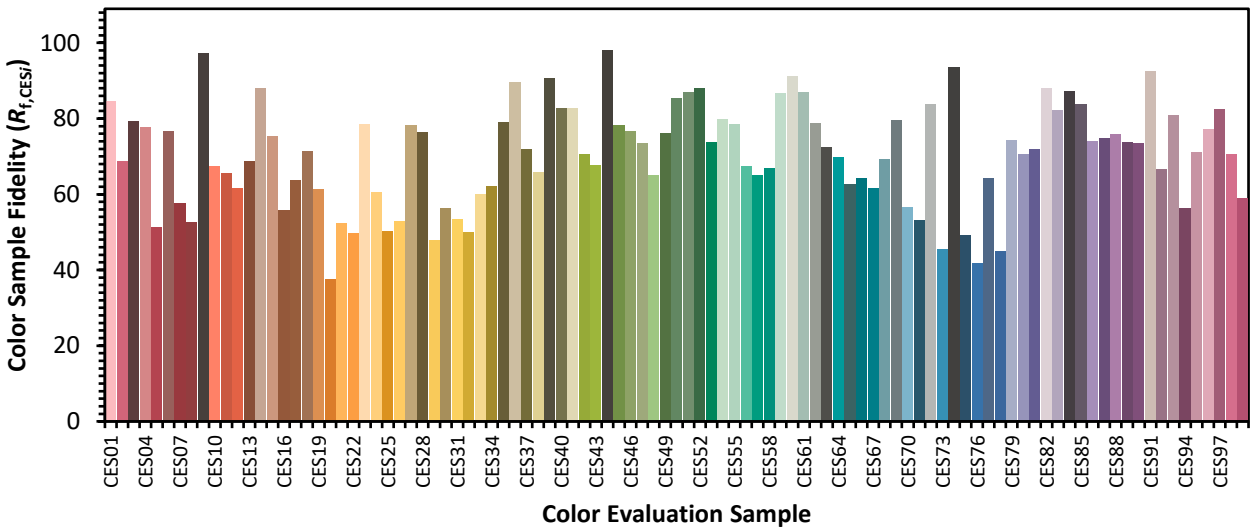



REPORT NUMBER: SP1-2407-184-6

TM-30-18

Color Rendition by Hue-Angle Bin

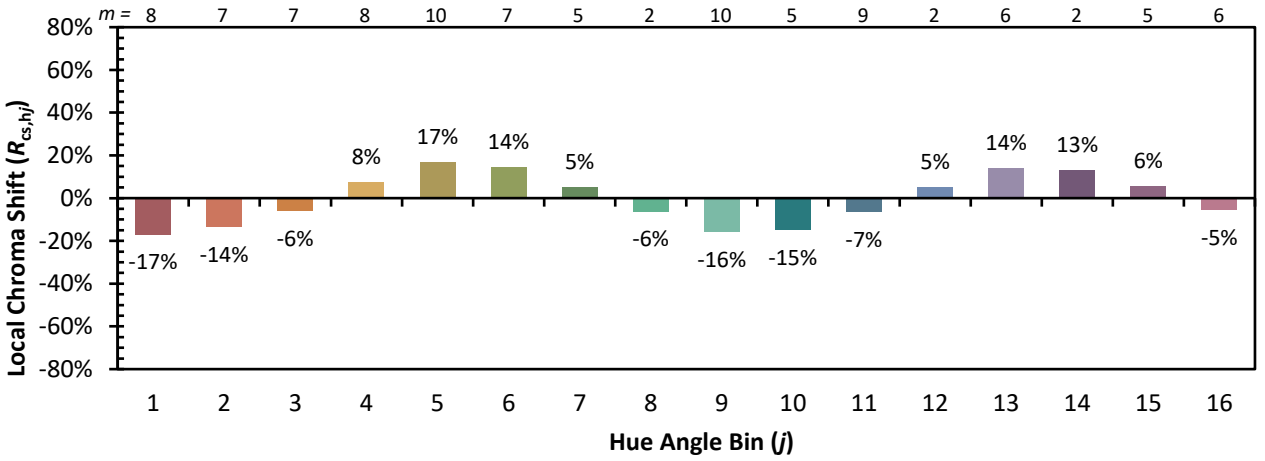

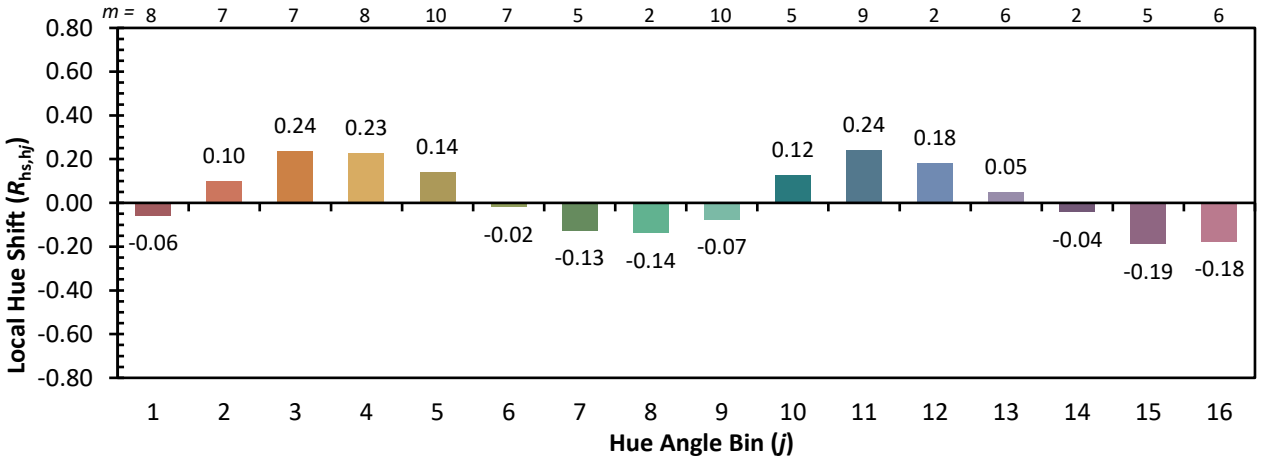


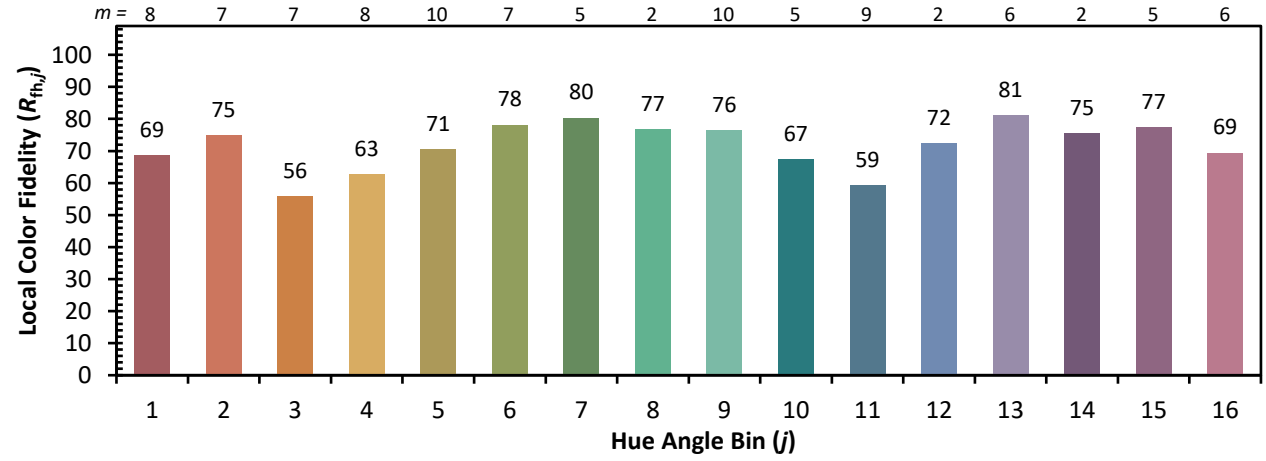


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Measure Comparisons

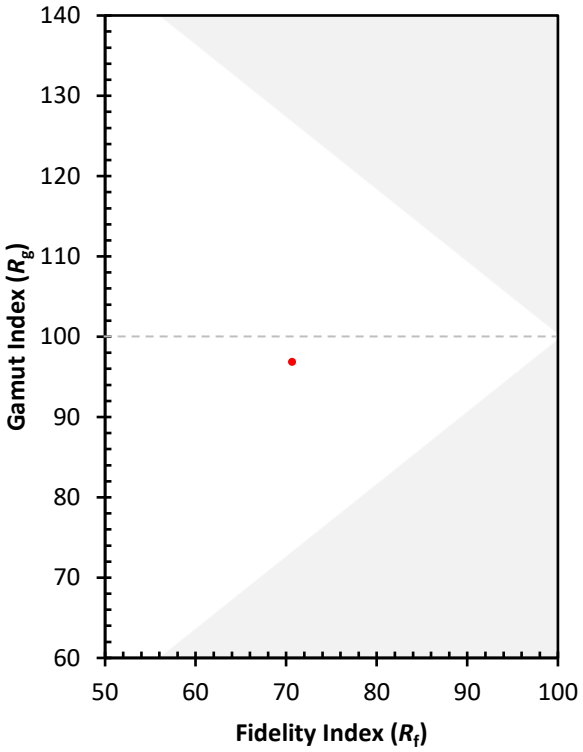

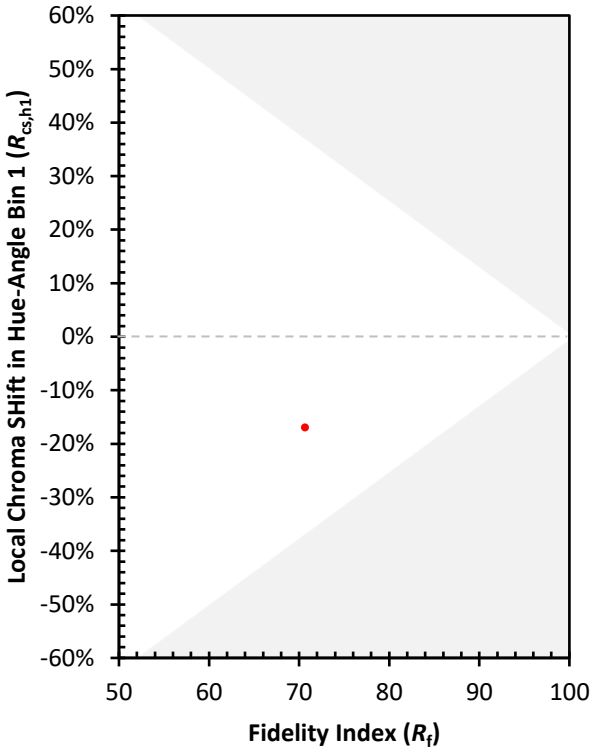

(END OF REPORT)