Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360794

Luminaire Tested: **GSS-SB3D-750-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360794
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB3D-750-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 3SQUARE 219W 70CRI 5000K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(78) 5000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	29898.7 lumens
Efficiency:	N/A
Efficacy:	136.5 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 0.5' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B4 - U0 - G4


Input Watts (W):	219
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	2.5%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360794
CATALOG NUMBER: GSS-SB3D-750-U-T1

Iso-Footcandle Lines of Horizontal Illumination

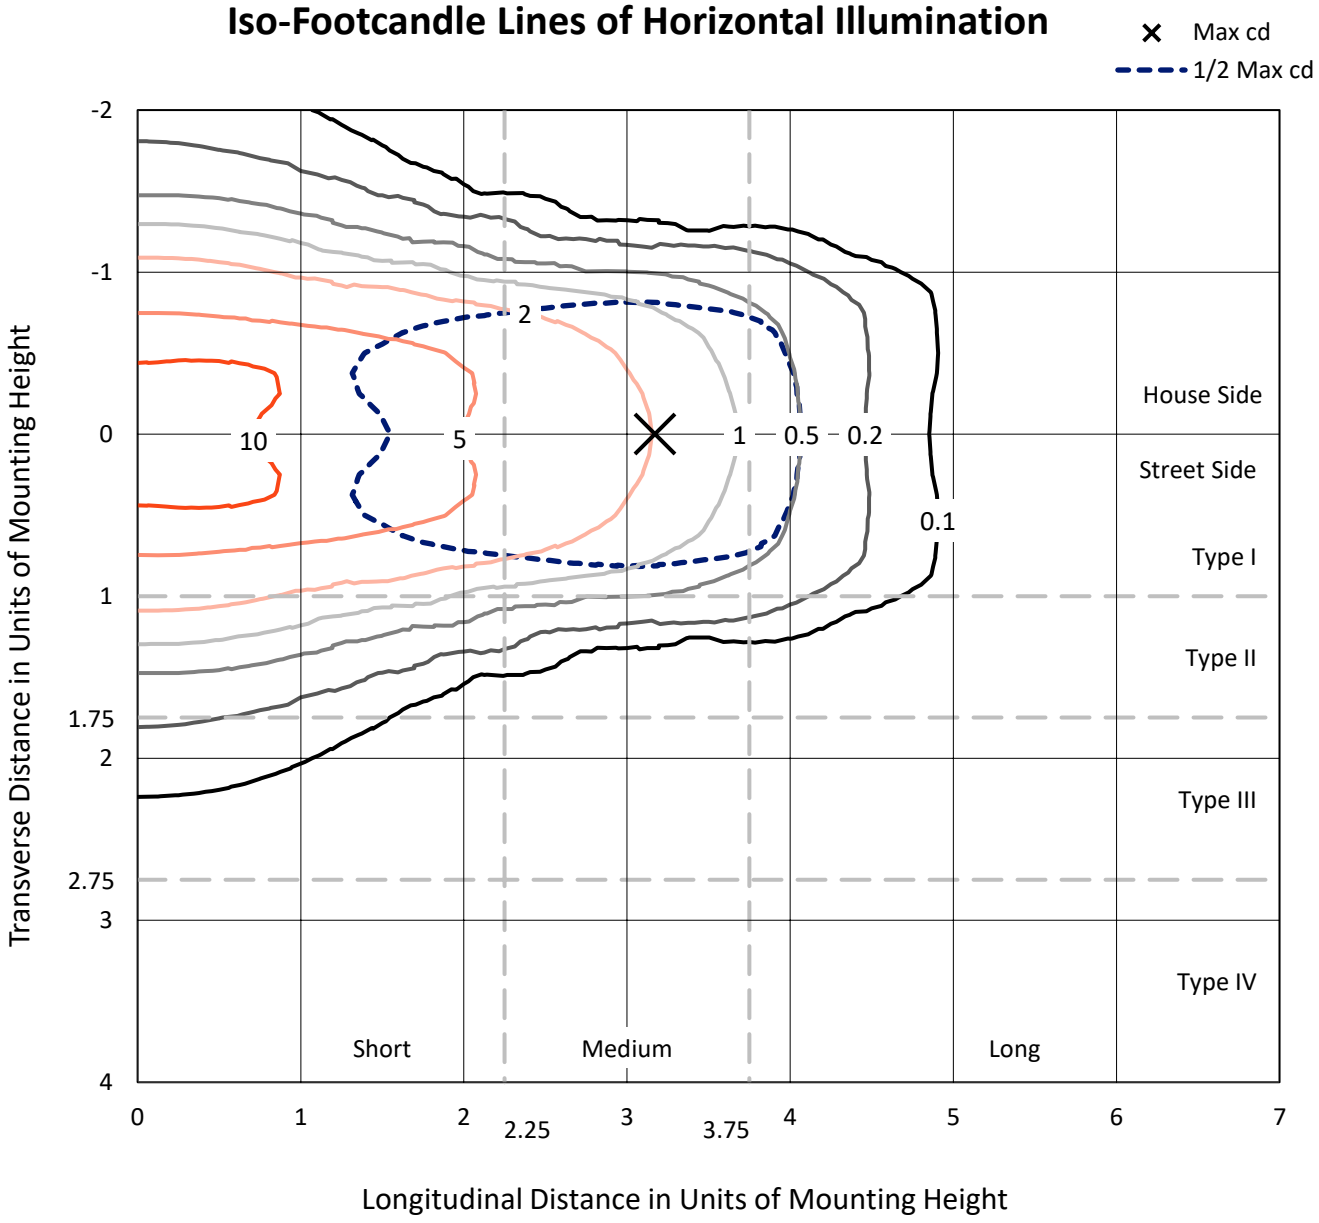


Based on 20 foot mounting height. Maximum calculated value = 14.7 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360794
CATALOG NUMBER: GSS-SB3D-750-U-T1

Luminous Intensity Polar Plot

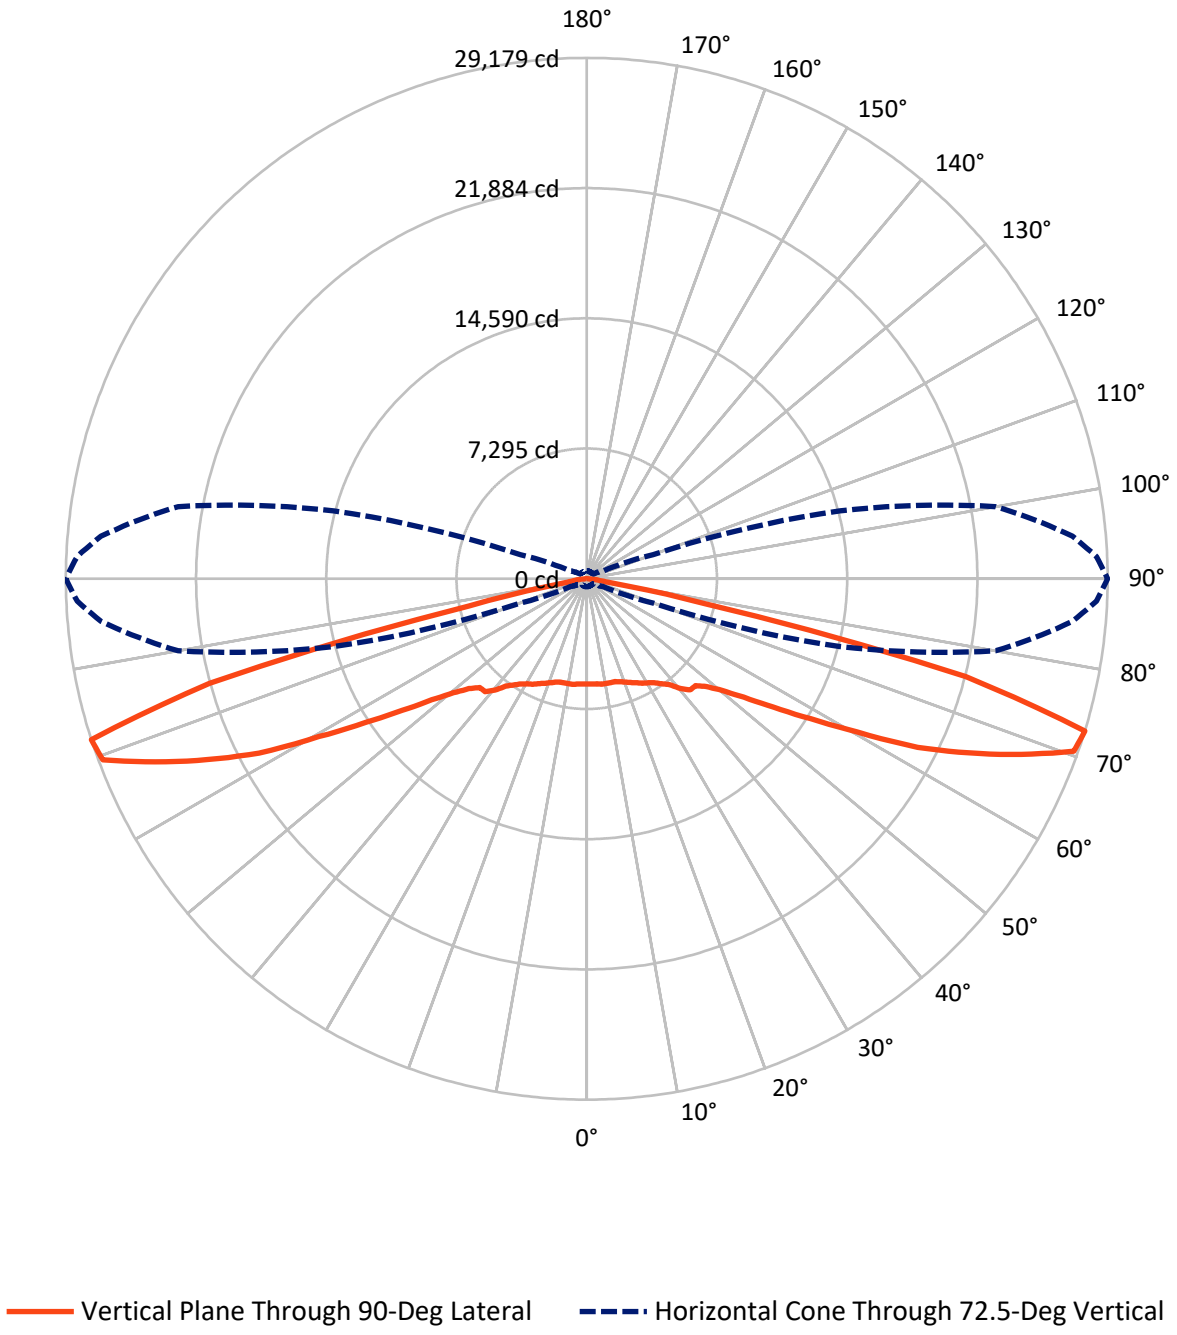

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360794
CATALOG NUMBER: GSS-SB3D-750-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	14949.3	0.0	14949.3
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	14949.3	0.0	14949.3
	% Fixture	50.0	0.0	50.0
Total	Lumens	29898.7	0.0	29898.7
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	570.2	1.9
10°-20°	1737.8	5.8
20°-30°	2904.6	9.7
30°-40°	4005.7	13.4
40°-50°	4910.4	16.4
50°-60°	5754.3	19.2
60°-70°	6390.1	21.4
70°-80°	3474.9	11.6
80°-90°	150.6	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	29898.7	100.0
0°-180°	29898.7	100.0

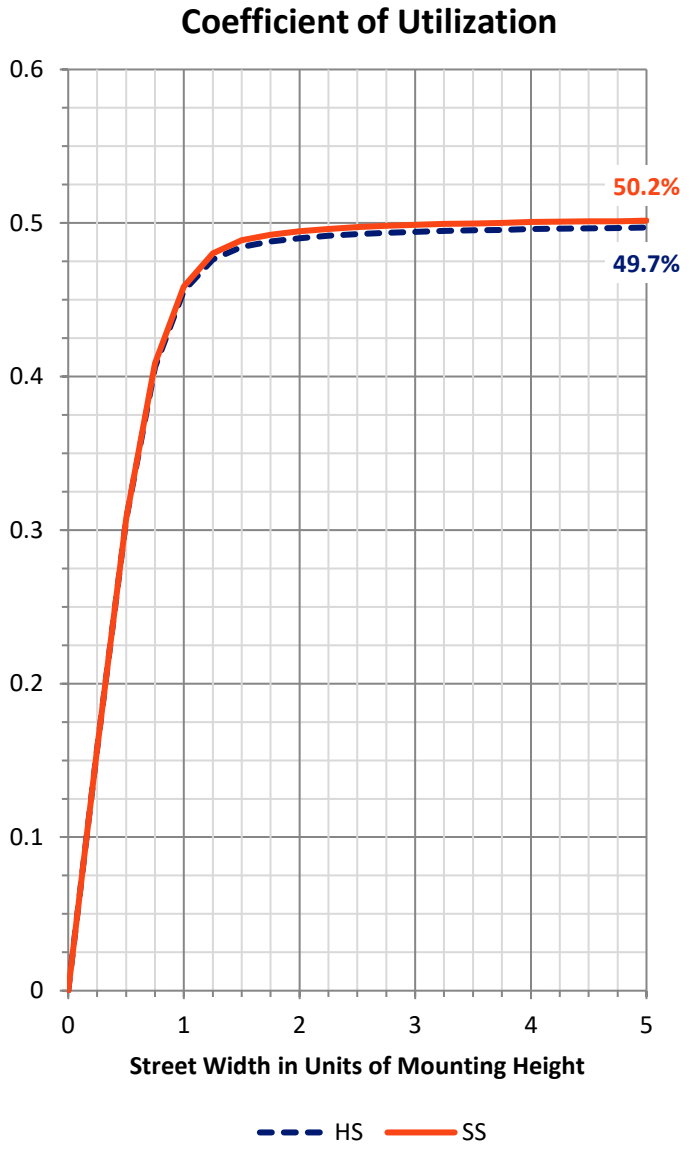

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360794
CATALOG NUMBER: GSS-SB3D-750-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	2606.3	8.7			
FM	(30°-60°)	7335.2	24.5			
FH	(60°-80°)	4932.5	16.5			G2/5000
FVH	(80°-90°)	75.3	0.3			G1/100
BL	(0°-30°)	2606.3	8.7	B4/5000		
BM	(30°-60°)	7335.2	24.5	B4/8500		
BH	(60°-80°)	4932.5	16.5	B4/5000		G4/5000
BVH	(80°-90°)	75.3	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B4-U0-G4
Type I Short

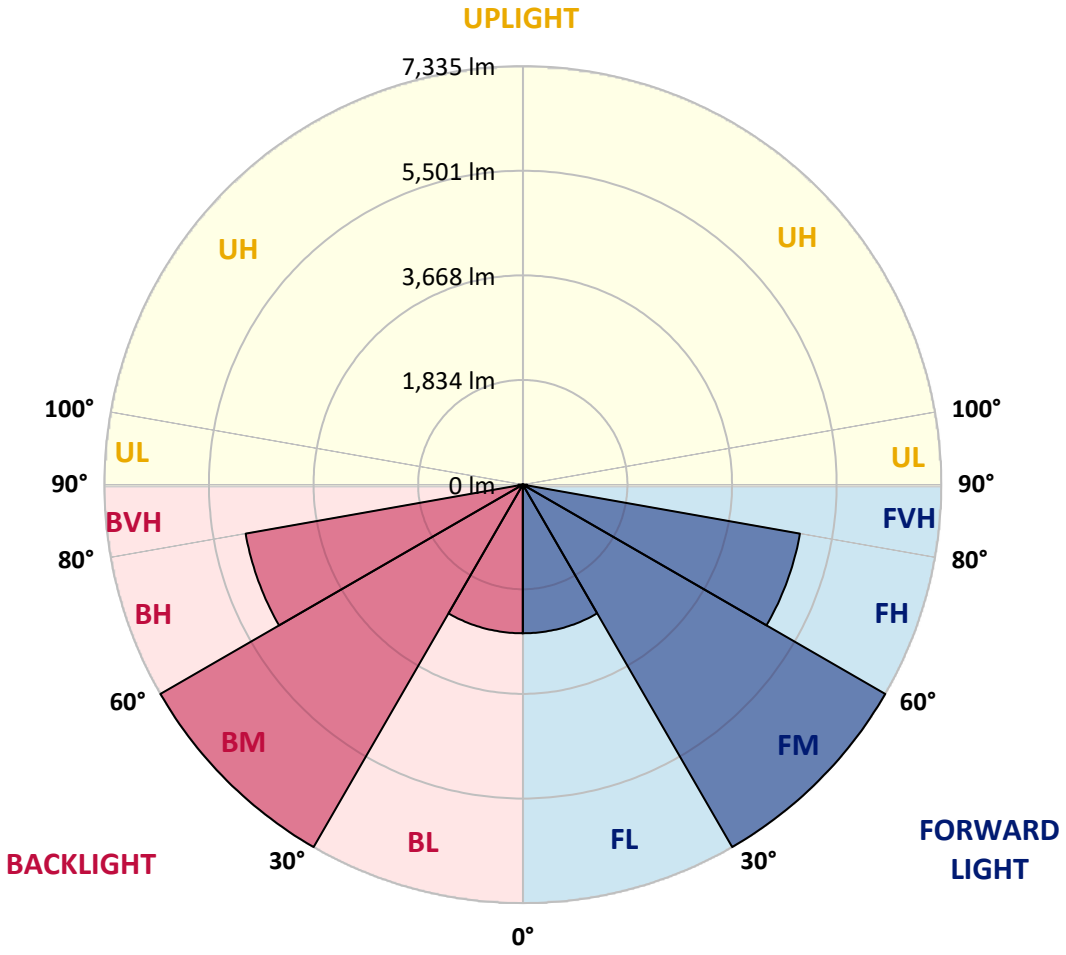

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360794
CATALOG NUMBER: GSS-SB3D-750-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	5890.8	5890.8	5890.8	5890.8	5890.8	5890.8	5890.8	5890.8	5890.8	5890.8	5890.8
2.5°	5897.3	5897.3	5877.7	5903.9	5890.8	5897.3	5903.9	5897.3	5890.8	5897.3	5903.9
5°	5930.0	5917.0	5930.0	5943.1	5923.5	5936.6	5930.0	5897.3	5917.0	5917.0	5917.0
7.5°	5989.0	6002.0	5989.0	6021.7	6002.0	6041.3	6002.0	5975.9	5969.3	5962.8	5962.8
10°	6015.1	6015.1	6008.6	6067.5	6080.6	6119.9	6093.7	6054.4	6034.8	6008.6	5982.4
12.5°	5943.1	5956.2	5989.0	6100.2	6152.6	6231.1	6211.5	6133.0	6074.0	6054.4	6015.1
15°	5864.6	5877.7	5943.1	6080.6	6205.0	6322.8	6316.2	6218.0	6146.0	6093.7	6034.8
17.5°	5740.2	5759.9	5851.5	6061.0	6283.5	6414.4	6453.7	6355.5	6276.9	6191.9	6113.3
20°	5530.8	5530.8	5694.4	5962.8	6270.4	6564.9	6669.7	6591.1	6499.5	6362.0	6257.3
22.5°	5295.2	5308.2	5471.9	5825.3	6263.9	6695.8	6898.8	6813.7	6722.0	6571.5	6414.4
25°	5059.5	5059.5	5242.8	5642.1	6178.8	6787.5	7167.1	7121.3	6938.0	6800.6	6597.7
27.5°	4843.5	4843.5	5039.9	5458.8	6034.8	6813.7	7435.5	7435.5	7232.6	7029.7	6807.1
30°	4588.3	4653.7	4876.3	5314.8	5903.9	6767.8	7631.8	7756.2	7572.9	7311.1	6983.8
32.5°	4372.3	4418.1	4647.2	5111.9	5714.1	6715.5	7854.4	8162.0	7972.2	7612.2	7245.7
35°	4117.0	4110.5	4372.3	4830.4	5445.7	6597.7	8031.1	8646.4	8463.1	8076.9	7579.5
37.5°	3783.2	3783.2	4051.5	4496.6	5190.4	6394.8	8175.1	9183.1	9045.6	8607.1	8076.9
40°	3423.2	3462.5	3698.1	4149.7	4882.8	6152.6	8175.1	9621.6	9693.6	9242.0	8692.2
42.5°	3161.4	3174.5	3390.5	3815.9	4542.4	5838.4	8070.4	10001.2	10217.2	9837.6	9124.2
45°	2886.5	2919.2	3102.5	3495.2	4189.0	5465.3	7887.1	10426.7	10773.6	10511.8	9575.8
47.5°	2552.7	2585.4	2794.8	3194.1	3855.2	5059.5	7579.5	10871.8	11598.3	11408.5	10380.9
50°	2166.5	2192.7	2389.0	2814.5	3482.1	4594.8	7193.3	11205.6	12423.0	12612.8	11598.3
52.5°	1695.2	1714.9	1924.3	2336.7	3037.0	4149.7	6650.0	11408.5	13254.2	13921.9	13228.1
55°	1217.4	1250.2	1433.4	1773.8	2447.9	3554.1	6002.0	11513.2	14164.0	15473.1	15250.6
57.5°	877.1	890.2	1014.5	1276.3	1819.6	2853.8	5170.8	11336.5	14982.2	17325.4	17790.1
60°	726.5	726.5	746.2	870.5	1243.6	2016.0	4175.9	10681.9	15682.6	19197.4	20630.8
62.5°	667.6	667.6	680.7	700.3	818.2	1309.1	2984.7	9353.2	15761.1	20997.3	23746.4
65°	608.7	608.7	621.8	634.9	661.1	850.9	1800.0	6846.4	14223.0	21017.0	25422.0
67.5°	556.4	556.4	562.9	569.4	582.5	621.8	988.3	4149.7	11382.3	20460.6	26063.4
70°	504.0	504.0	504.0	497.4	517.1	523.6	654.5	2107.6	7612.2	18477.4	25755.8
72.5°	*445.1*	*445.1*	*438.5*	*425.4*	*432.0*	*432.0*	*484.4*	*1034.2*	*3953.4*	*14687.7*	*23255.5*
75°	379.6	386.2	360.0	346.9	340.4	346.9	386.2	589.1	1767.2	8908.2	17377.8
77.5°	320.7	333.8	294.5	268.4	261.8	261.8	301.1	366.5	759.3	3233.4	7788.9
80°	242.2	248.7	216.0	189.8	189.8	183.3	222.5	268.4	360.0	962.2	1747.6
82.5°	137.5	137.5	124.4	111.3	104.7	111.3	150.5	183.3	222.5	340.4	477.8
85°	32.7	32.7	39.3	45.8	45.8	58.9	85.1	98.2	117.8	137.5	183.3
87.5°	6.5	6.5	6.5	13.1	19.6	19.6	32.7	45.8	58.9	72.0	78.5
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360794
CATALOG NUMBER: GSS-SB3D-750-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	5890.8	5890.8	*5890.8*
2.5°	5903.9	5910.4	*5903.9*
5°	5943.1	5930.0	*5910.4*
7.5°	5949.7	5956.2	*5962.8*
10°	5975.9	6002.0	*5962.8*
12.5°	6002.0	5982.4	*5969.3*
15°	6021.7	6015.1	*5975.9*
17.5°	6093.7	6067.5	*6061.0*
20°	6205.0	6198.4	*6178.8*
22.5°	6335.9	6322.8	*6316.2*
25°	6525.7	6479.9	*6453.7*
27.5°	6682.8	6643.5	*6630.4*
30°	6839.8	6761.3	*6761.3*
32.5°	6977.3	6957.7	*6944.6*
35°	7304.6	7206.4	*7219.5*
37.5°	7703.8	7605.6	*7520.6*
40°	8266.7	8135.8	*8083.5*
42.5°	8626.7	8495.8	*8508.9*
45°	8829.6	8600.5	*8541.6*
47.5°	9379.4	9091.4	*9012.9*
50°	10269.6	9916.1	*9818.0*
52.5°	11709.6	11140.1	*11009.2*
55°	13516.1	12815.7	*12684.8*
57.5°	15990.2	15060.8	*14779.3*
60°	19001.0	17849.1	*17423.6*
62.5°	22620.6	21200.2	*20794.4*
65°	25343.4	24158.7	*23530.4*
67.5°	27523.0	26547.8	*26246.7*
70°	28819.0	28864.8	*28943.3*
72.5°	*27320.1*	*28576.8*	*29179.0*
75°	20022.1	20997.3	*21933.3*
77.5°	7736.6	6977.3	*6754.8*
80°	1250.2	1171.6	*1210.9*
82.5°	562.9	595.6	*628.3*
85°	366.5	425.4	*451.6*
87.5°	85.1	85.1	*85.1*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-6

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-750-U-5WQ

Data in this report applies to families of products including GSS-SB1A-750-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-750-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 5000K CCT 26 LEDS

Spectral Parameters

CCT (K):	4896
CIE u':	0.2101
CIE v':	0.4901
Duv:	0.0035
CIE x:	0.3489
CIE y:	0.3618
CIE z:	0.2893
Peak Wavelength (nm):	443
Dominant Wavelength (nm):	570
Purity:	13.25435
Rf:	70.7
Rg:	96.8

CRI (Ra):	70.2
R1:	68.1
R2:	73.9
R3:	79.4
R4:	72.1
R5:	69.2
R6:	65.7
R7:	78.1
R8:	55.3
R9:	-35.1
R10:	39.3
R11:	71.1
R12:	43.8
R13:	68.1
R14:	88.4
R15:	59.7

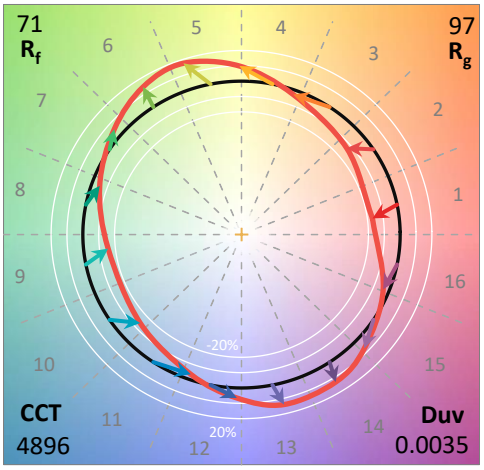

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-6

CIE 1931 Chromaticity Diagram

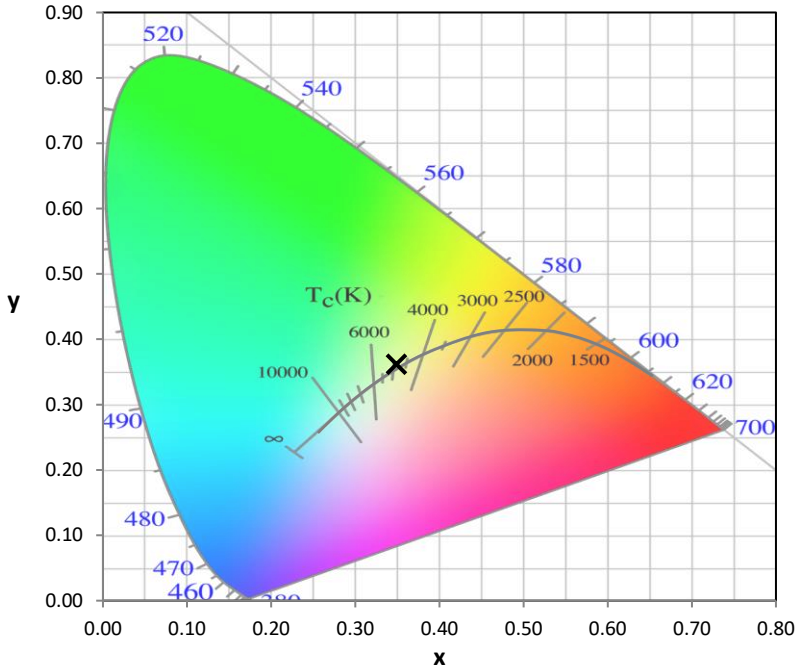

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

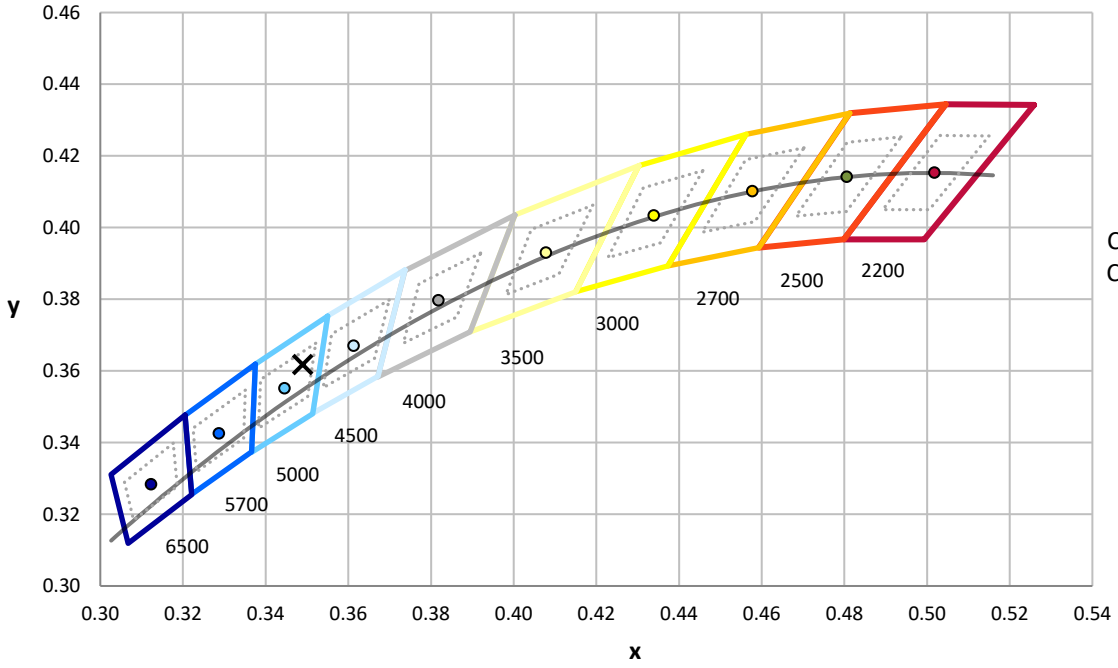


CCT = 4896K
CIE x = 0.3489
CIE y = 0.3618
Duv = 0.0035

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-6

Photopic Flux vs. Wavelength

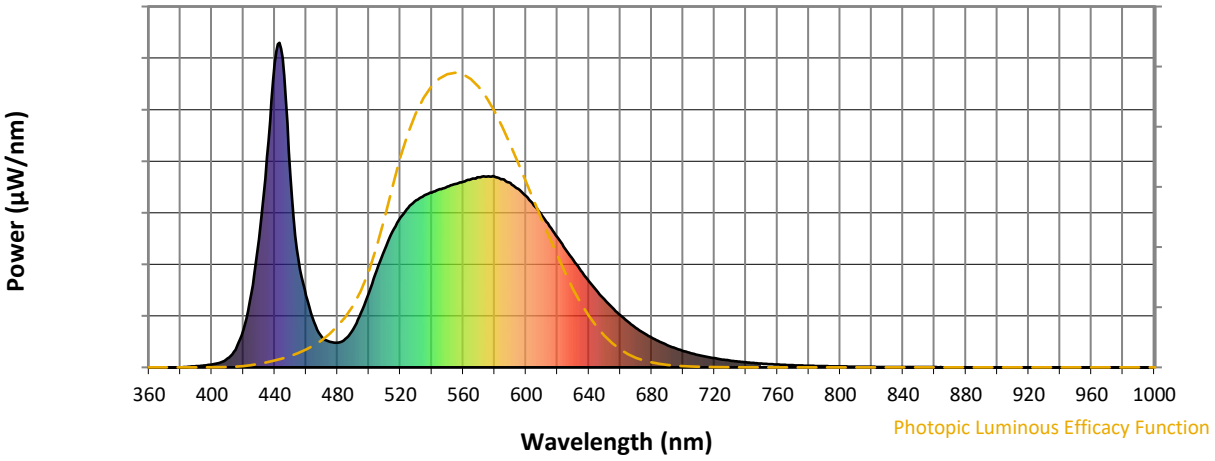


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Scotopic Flux vs. Wavelength

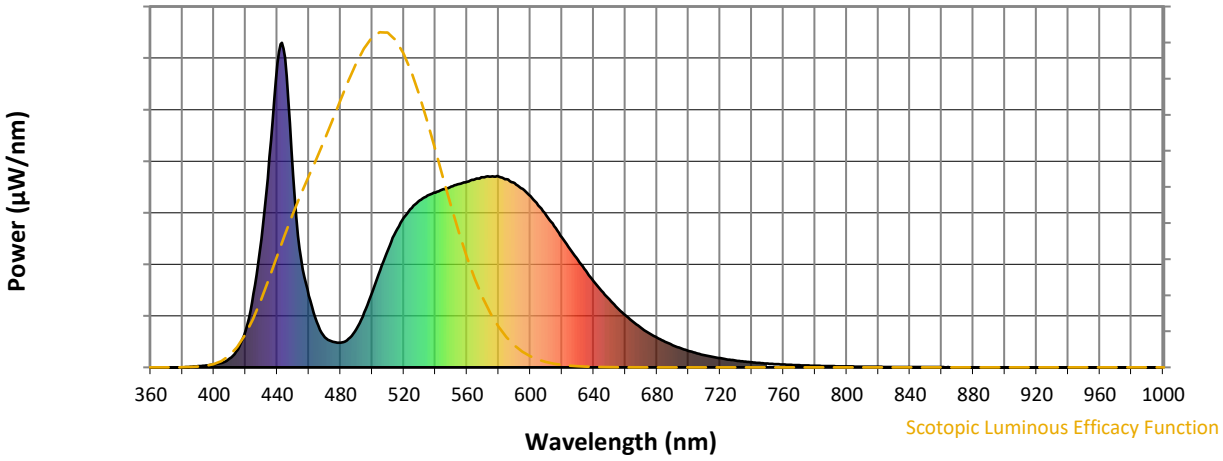


Scotopic Lumens: NR **S/P: 1.7**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			

REPORT NUMBER: SP1-2407-184-6

Melanopic Flux vs. Wavelength

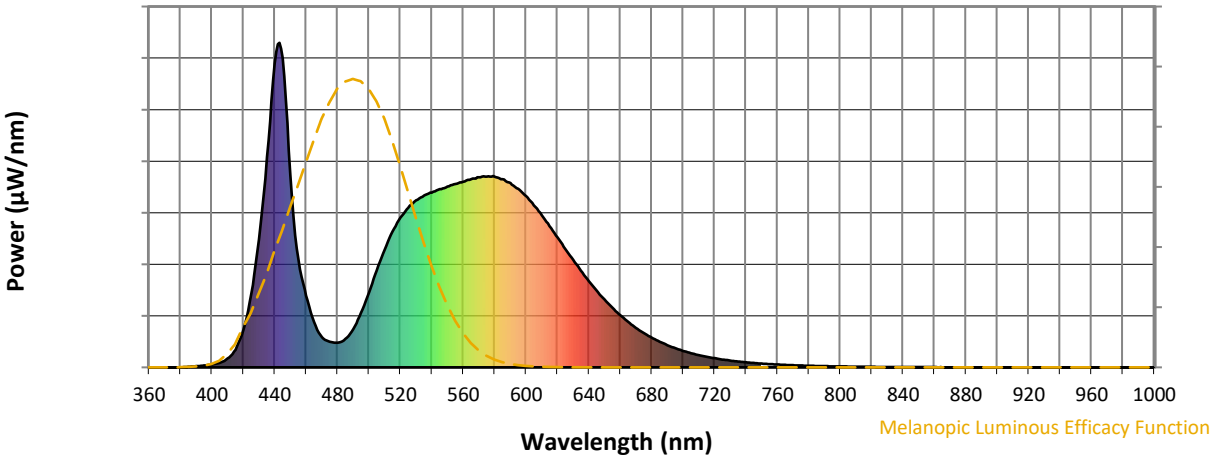

Melanopic Lumens: NR **M/P: 3.37**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	118	NR	620	401	NR	750	12	NR	880	0	NR
365	0	NR	495	168	NR	625	365	NR	755	10	NR	885	0	NR
370	0	NR	500	230	NR	630	331	NR	760	9	NR	890	0	NR
375	0	NR	505	299	NR	635	298	NR	765	8	NR	895	0	NR
380	0	NR	510	362	NR	640	266	NR	770	6	NR	900	0	NR
385	2	NR	515	418	NR	645	236	NR	775	6	NR	905	0	NR
390	4	NR	520	461	NR	650	209	NR	780	5	NR	910	0	NR
395	6	NR	525	491	NR	655	184	NR	785	4	NR	915	0	NR
400	9	NR	530	514	NR	660	160	NR	790	4	NR	920	0	NR
405	14	NR	535	530	NR	665	140	NR	795	3	NR	925	0	NR
410	27	NR	540	539	NR	670	122	NR	800	3	NR	930	0	NR
415	55	NR	545	549	NR	675	106	NR	805	2	NR	935	0	NR
420	115	NR	550	557	NR	680	92	NR	810	2	NR	940	0	NR
425	226	NR	555	565	NR	685	79	NR	815	2	NR	945	0	NR
430	395	NR	560	572	NR	690	68	NR	820	2	NR	950	0	NR
435	648	NR	565	580	NR	695	59	NR	825	1	NR	955	0	NR
440	937	NR	570	586	NR	700	51	NR	830	1	NR	960	0	NR
445	953	NR	575	588	NR	705	44	NR	835	1	NR	965	0	NR
450	591	NR	580	588	NR	710	38	NR	840	1	NR	970	0	NR
455	334	NR	585	580	NR	715	32	NR	845	1	NR	975	0	NR
460	221	NR	590	568	NR	720	28	NR	850	1	NR	980	0	NR
465	140	NR	595	550	NR	725	24	NR	855	1	NR	985	0	NR
470	93	NR	600	527	NR	730	21	NR	860	1	NR	990	0	NR
475	79	NR	605	499	NR	735	18	NR	865	0	NR	995	0	NR
480	76	NR	610	469	NR	740	15	NR	870	0	NR	1000	0	NR
485	87	NR	615	435	NR	745	13	NR	875	0	NR			


REPORT NUMBER: SP1-2407-184-6

TM-30-18


Summary


R_f = 70.7
R_g = 96.8
CIE R_a = 70.2
R_9 = -35.1


Spectral Power Distribution Comparison

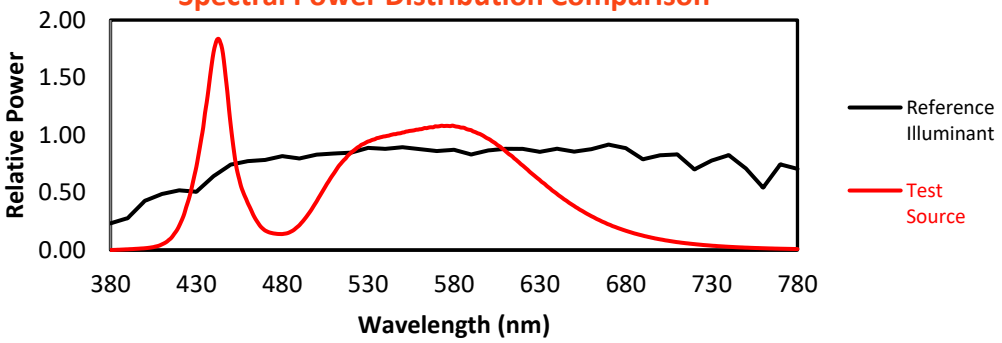


Color Vector Graphics

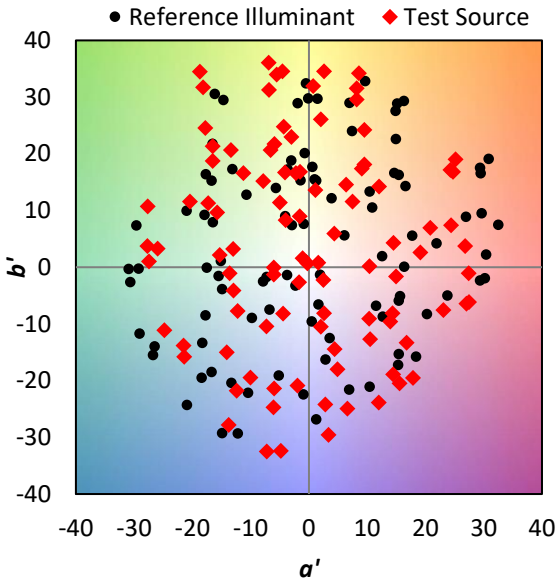

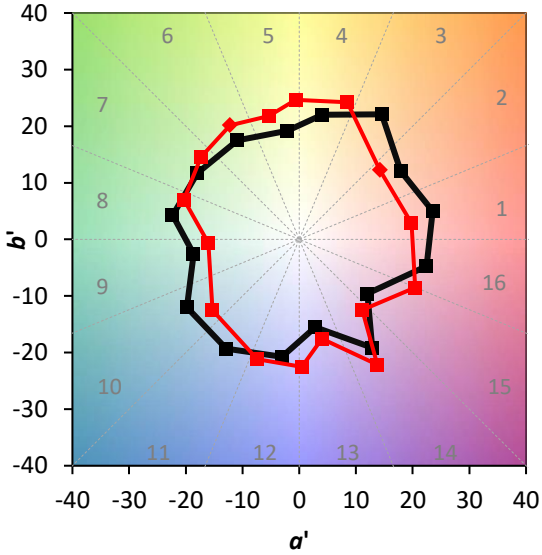

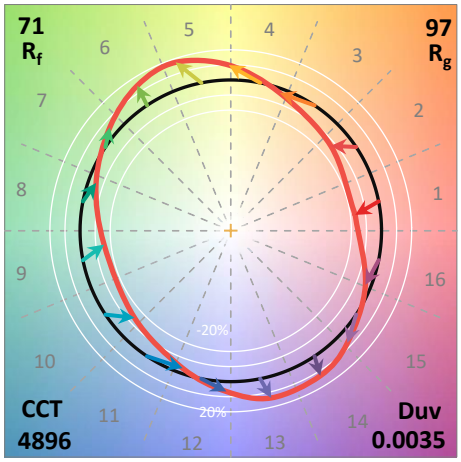

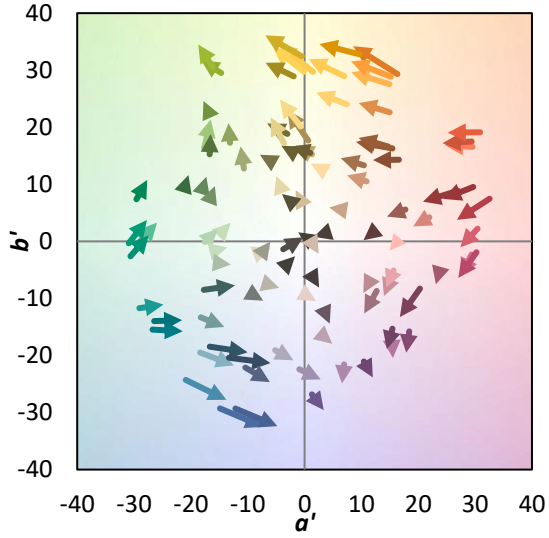


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 53	CES51 = 87	CES76 = 42
CES02 = 59	CES27 = 78	CES52 = 88	CES77 = 64
CES03 = 30	CES28 = 76	CES53 = 74	CES78 = 45
CES04 = 69	CES29 = 48	CES54 = 80	CES79 = 74
CES05 = 46	CES30 = 56	CES55 = 79	CES80 = 71
CES06 = 50	CES31 = 54	CES56 = 68	CES81 = 72
CES07 = 39	CES32 = 50	CES57 = 65	CES82 = 88
CES08 = 38	CES33 = 60	CES58 = 67	CES83 = 82
CES09 = 29	CES34 = 62	CES59 = 87	CES84 = 87
CES10 = 72	CES35 = 79	CES60 = 91	CES85 = 84
CES11 = 56	CES36 = 90	CES61 = 87	CES86 = 74
CES12 = 61	CES37 = 72	CES62 = 79	CES87 = 75
CES13 = 41	CES38 = 66	CES63 = 72	CES88 = 76
CES14 = 74	CES39 = 91	CES64 = 70	CES89 = 74
CES15 = 70	CES40 = 83	CES65 = 63	CES90 = 73
CES16 = 46	CES41 = 83	CES66 = 64	CES91 = 92
CES17 = 49	CES42 = 70	CES67 = 62	CES92 = 67
CES18 = 55	CES43 = 68	CES68 = 69	CES93 = 81
CES19 = 71	CES44 = 98	CES69 = 80	CES94 = 56
CES20 = 64	CES45 = 78	CES70 = 56	CES95 = 71
CES21 = 85	CES46 = 77	CES71 = 53	CES96 = 77
CES22 = 77	CES47 = 73	CES72 = 84	CES97 = 82
CES23 = 91	CES48 = 65	CES73 = 46	CES98 = 71
CES24 = 90	CES49 = 76	CES74 = 94	CES99 = 59
CES25 = 71	CES50 = 85	CES75 = 49	

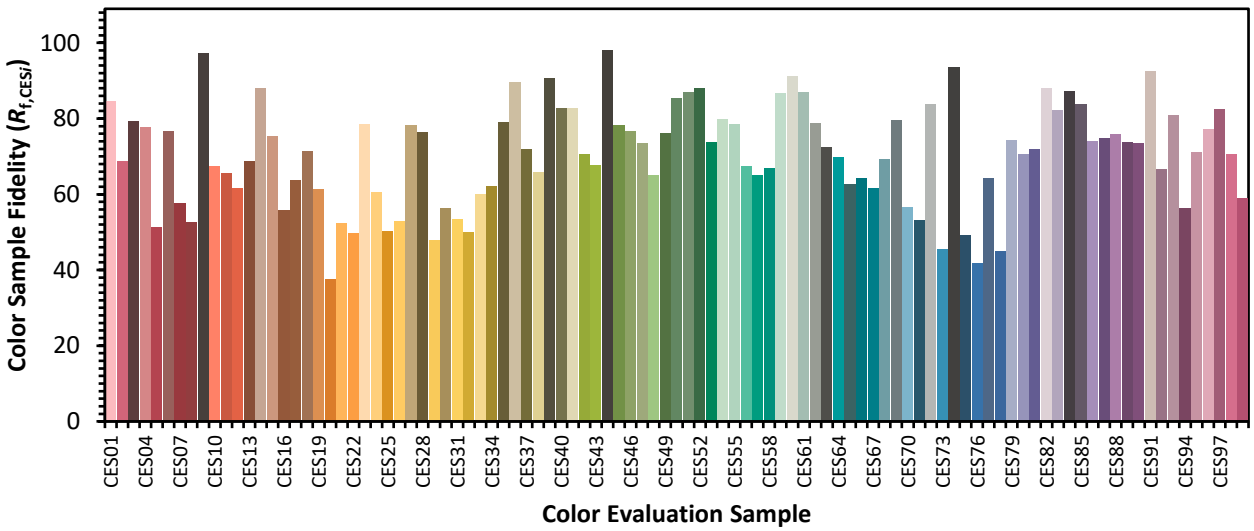



REPORT NUMBER: SP1-2407-184-6

TM-30-18

Color Rendition by Hue-Angle Bin

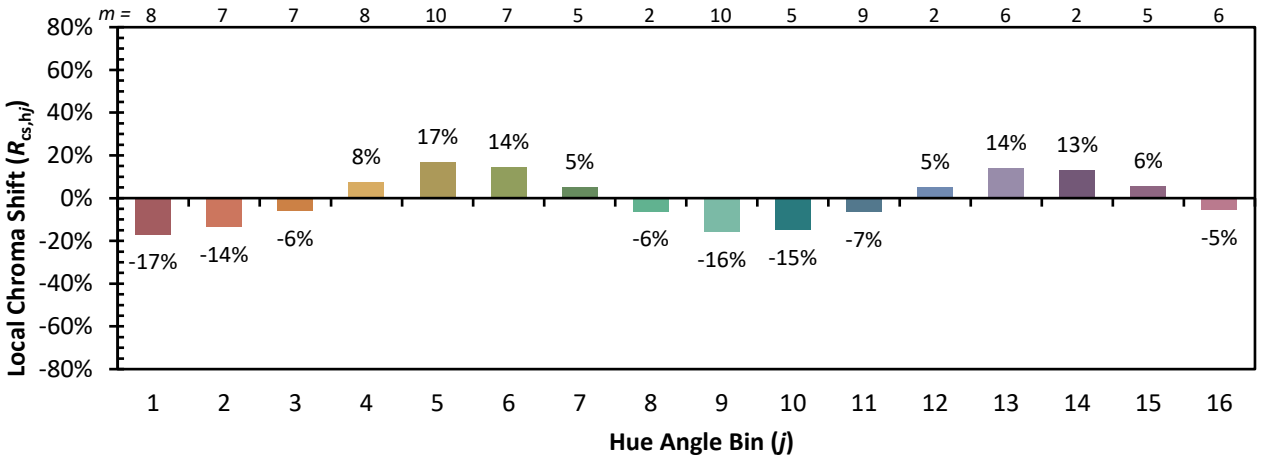

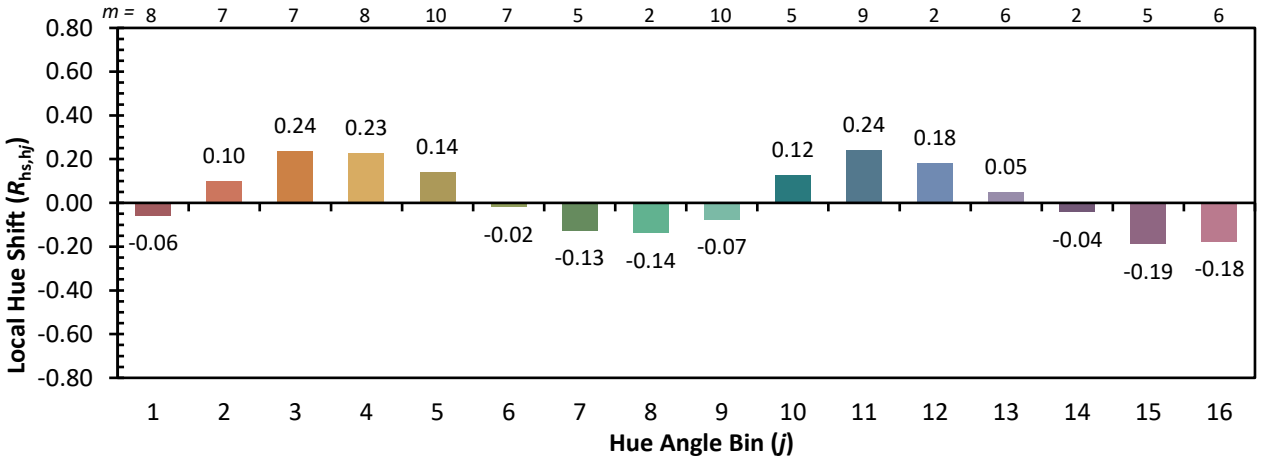


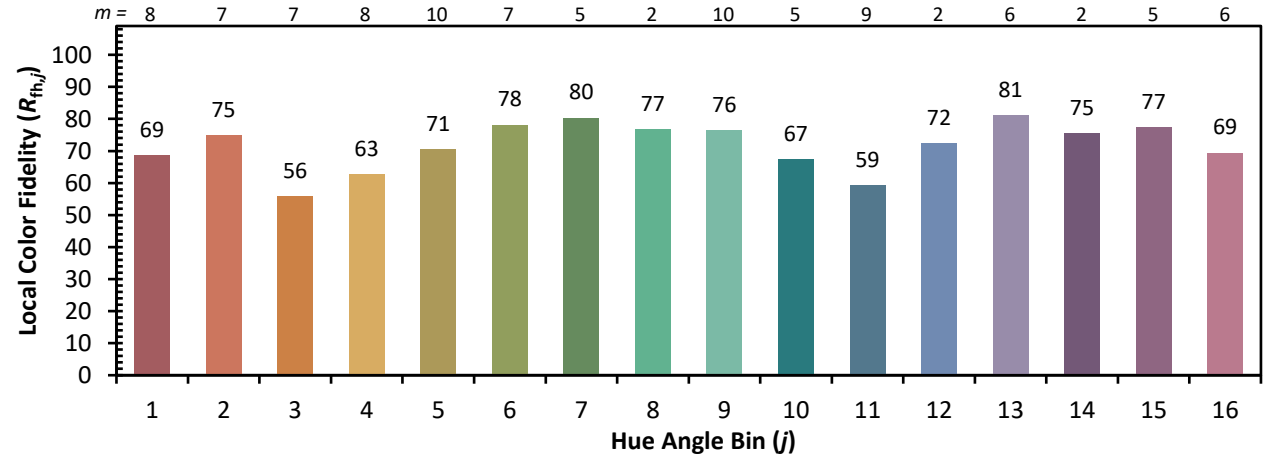


REPORT NUMBER: SP1-2407-184-6

TM-30-18

Measure Comparisons

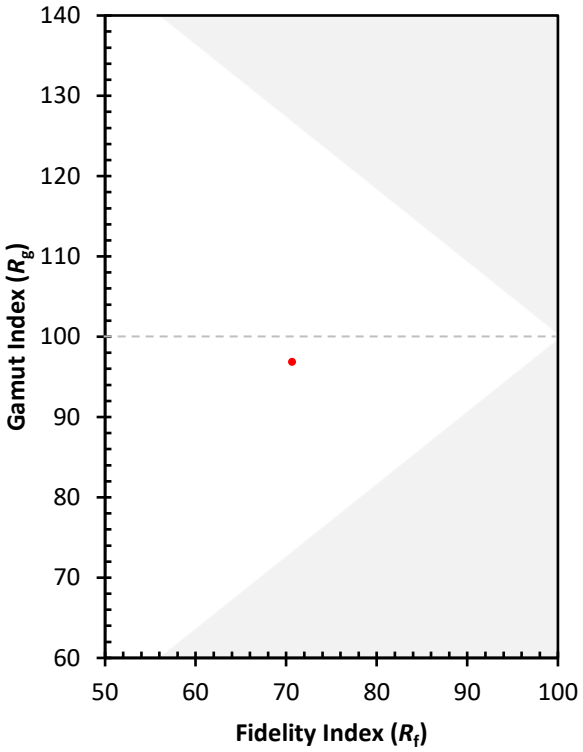

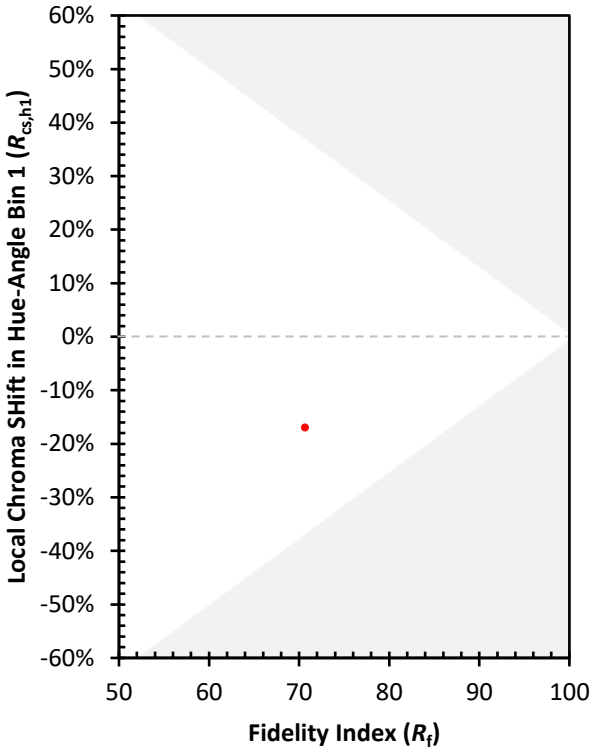

(END OF REPORT)