

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P400642

Luminaire Tested: **TT-D4-735-U-5MQ-PM**

Issue Date: 5/19/2020

Test Information

Test Method: LM-79-08
Report Number: P400642
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1908-473-16)
Test Lab: INNOVATION CENTER
Issue Date: 5/19/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: McGRAW-EDISON
Catalog Number: TT-D4-735-U-5MQ-PM
Description: TOPTIER LED SITE LUMINAIRE
3500K, 70 CRI LEDS AND MEDIUM DISTRIBUTION
Light Source: -
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7564 lumens
Efficiency: N/A
Efficacy: 131.3 lumens/watt
Luminous Opening: Circular (Dia: 1.12' x H: 0')
IES Classification: Type V - Short
BUG Rating: B3 - U0 - G2


Input Watts (W): 57.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT



REPORT NUMBER: P400642
 CATALOG NUMBER: TT-D4-735-U-5MQ-PM

Iso-Footcandle Lines of Horizontal Illumination


✕ Max cd
 - - - 1/2 Max cd

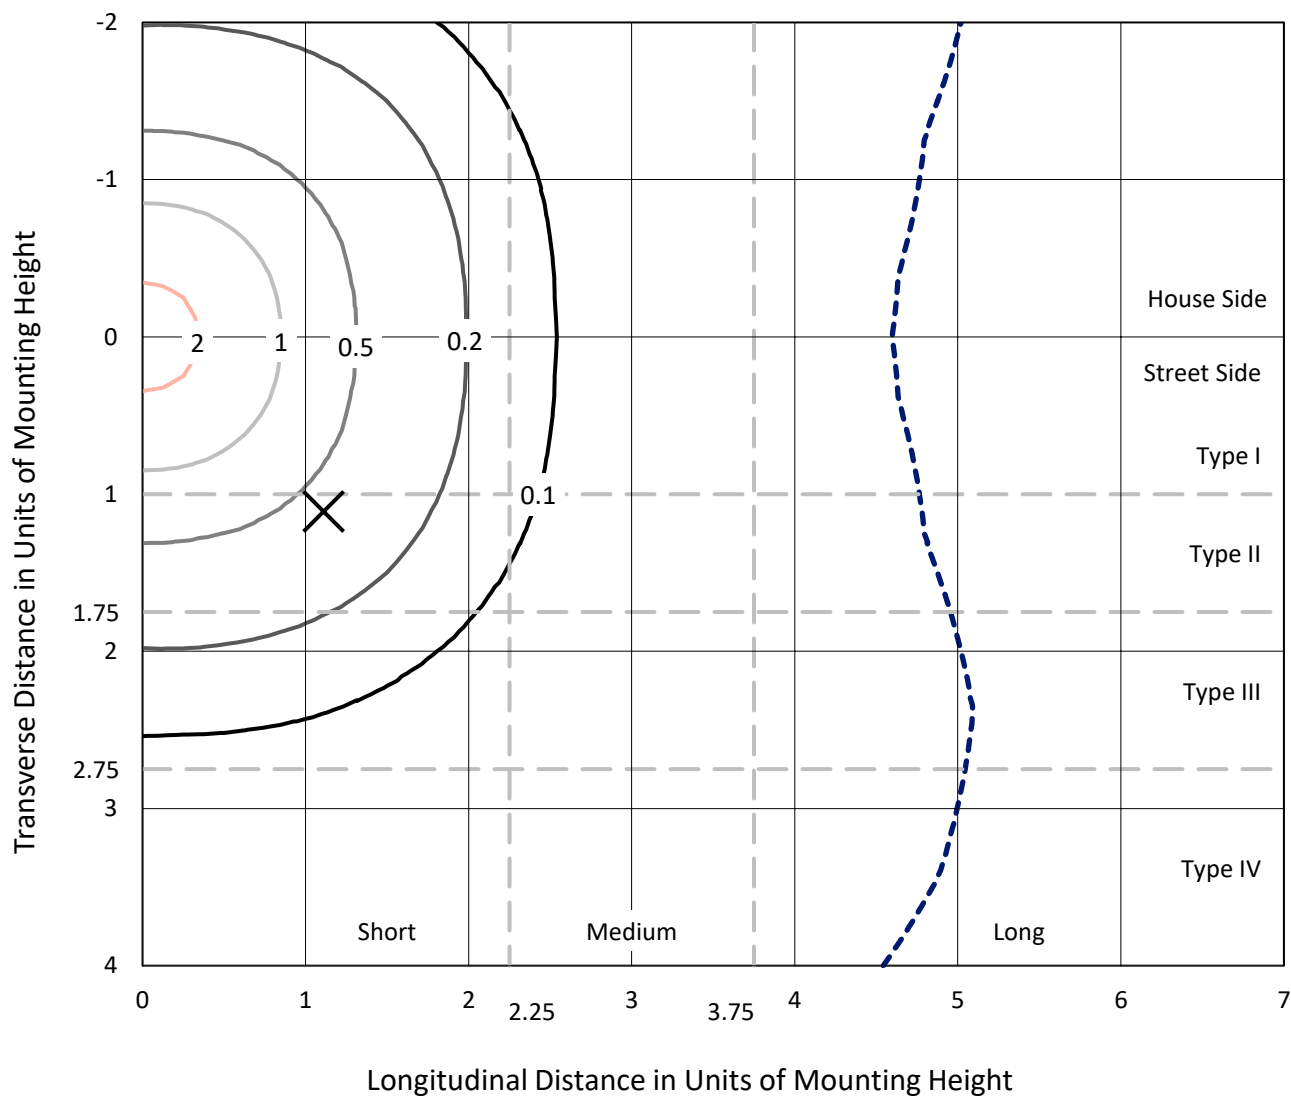

Based on 25 foot mounting height. Maximum calculated value = 2.4 fc
 Type V - Short - N/A

REPORT NUMBER: P400642
CATALOG NUMBER: TT-D4-735-U-5MQ-PM

Luminous Intensity Polar Plot

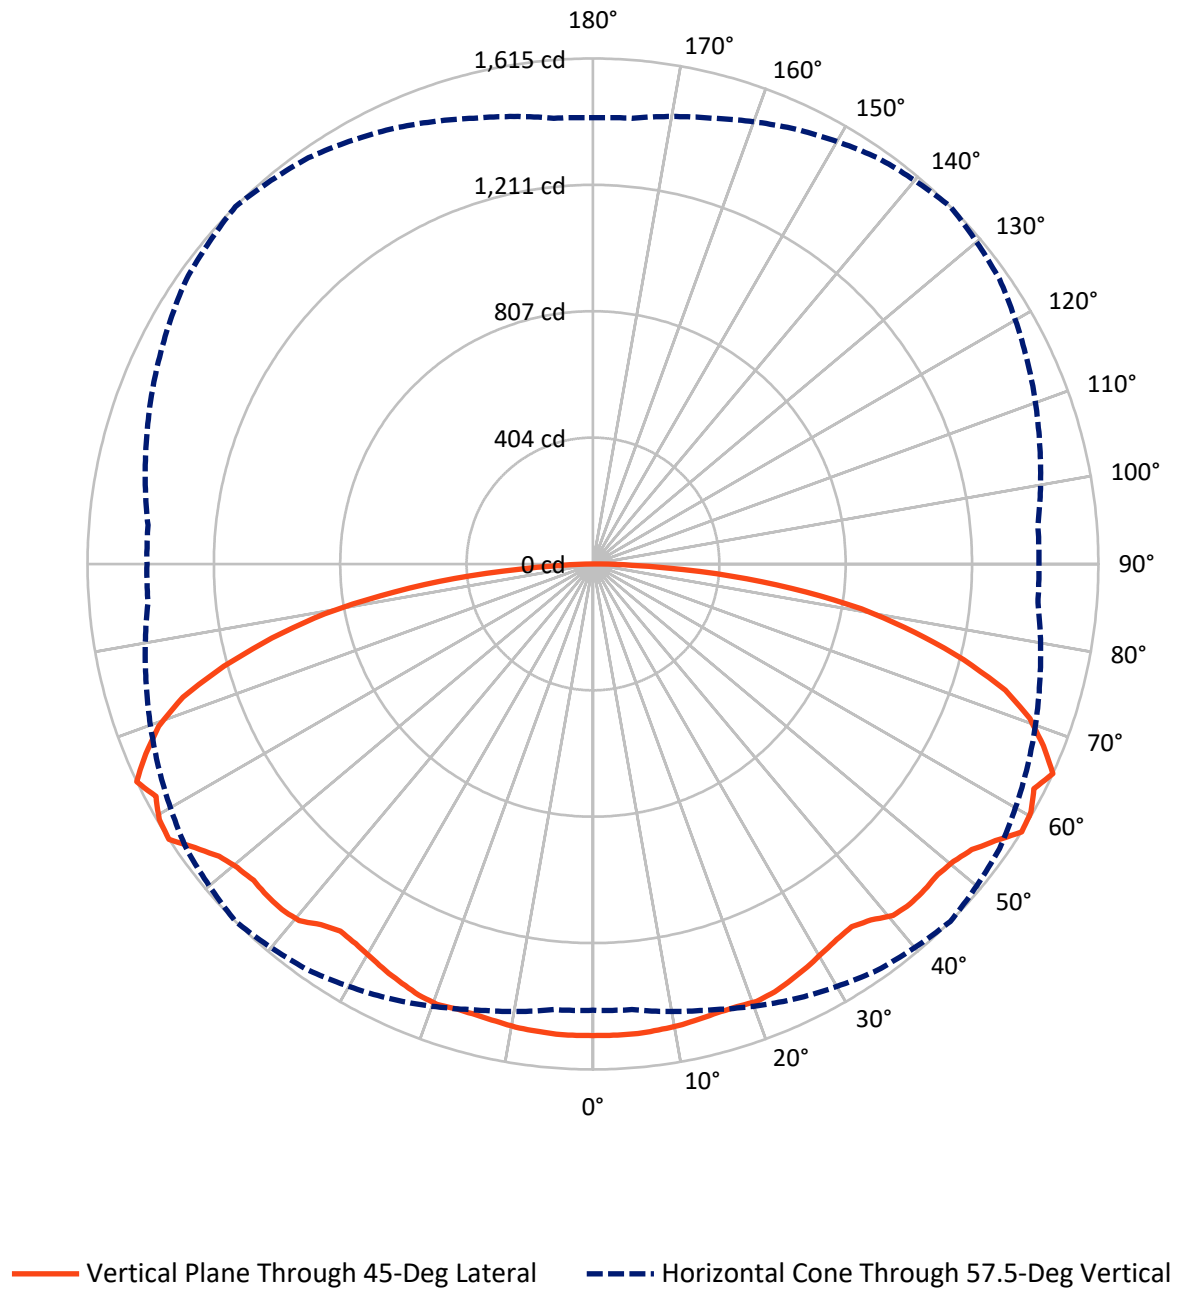

REPORT NUMBER: P400642

CATALOG NUMBER: TT-D4-735-U-5MQ-PM


FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	3782.0	0.0	3782.0
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	3782.0	0.0	3782.0
	% Fixture	50.0	0.0	50.0
Total	Lumens	7564.0	0.0	7564.0
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	143.6	1.9
10°-20°	422.2	5.6
20°-30°	678.5	9.0
30°-40°	895.7	11.8
40°-50°	1120.6	14.8
50°-60°	1332.9	17.6
60°-70°	1445.7	19.1
70°-80°	1150.7	15.2
80°-90°	374.0	4.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	7564.0	100.0
0°-180°	7564.0	100.0

Coefficient of Utilization

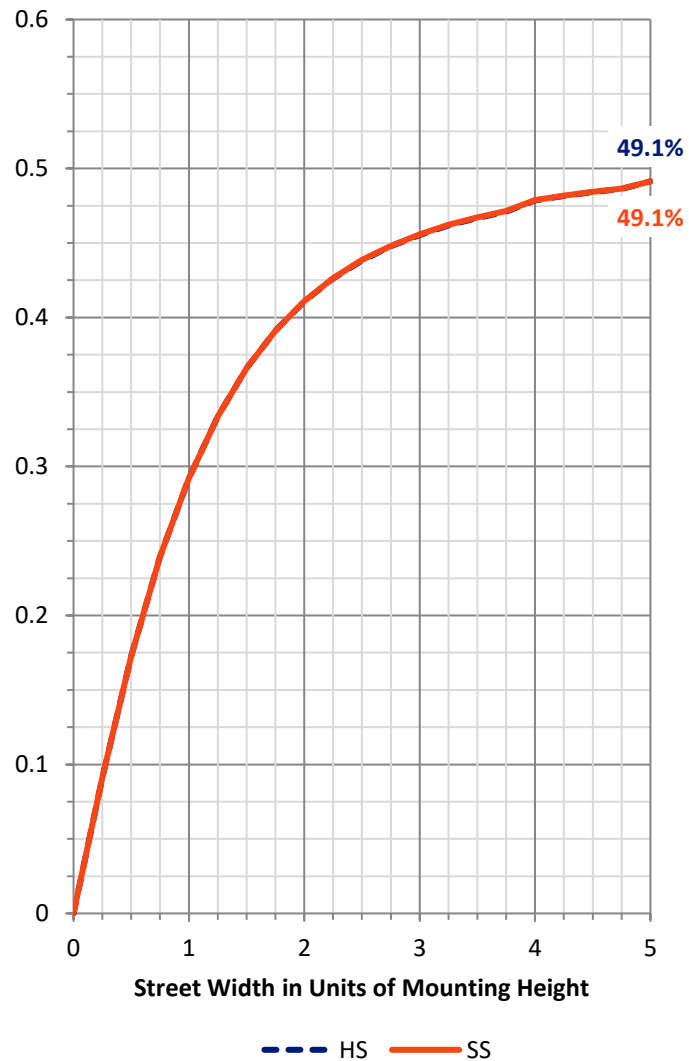

REPORT NUMBER: P400642


CATALOG NUMBER: TT-D4-735-U-5MQ-PM

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit		
				B	U	G
FL	(0°-30°)	622.1	8.2			
FM	(30°-60°)	1674.6	22.1			
FH	(60°-80°)	1298.2	17.2			G1/1800
FVH	(80°-90°)	187.0	2.5			G2/225
BL	(0°-30°)	622.1	8.2	B2/1000		
BM	(30°-60°)	1674.6	22.1	B2/2500		
BH	(60°-80°)	1298.2	17.2	B3/2500		G1/1800
BVH	(80°-90°)	187.0	2.5			G2/225
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B3-U0-G2

Type V Short

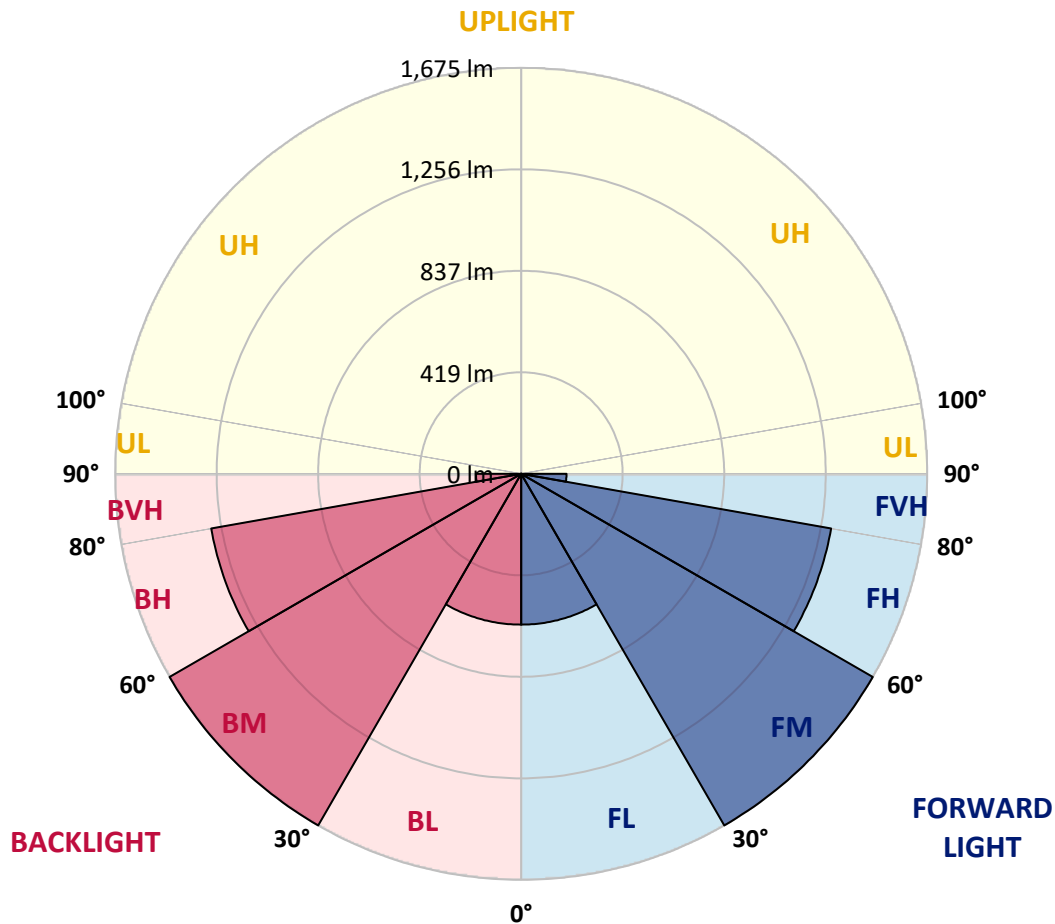

REPORT NUMBER: P400642

CATALOG NUMBER: TT-D4-735-U-5MQ-PM

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
0°	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5
2.5°	1508.8	1507.6	1508.8	1507.6	1507.6	1506.5	1507.6	1507.6	1507.6	1507.6	1507.6
5°	1507.6	1506.5	1506.5	1507.6	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5
7.5°	1503.1	1503.1	1504.3	1503.1	1503.1	1503.1	1503.1	1503.1	1503.1	1504.3	1504.3
10°	1499.8	1498.6	1499.8	1499.8	1498.6	1499.8	1498.6	1499.8	1499.8	1499.8	1499.8
12.5°	1495.3	1494.1	1495.3	1495.3	1494.1	1493.0	1494.1	1494.1	1495.3	1495.3	1495.3
15°	1487.4	1487.4	1489.6	1488.5	1488.5	1487.4	1489.6	1488.5	1487.4	1488.5	1488.5
17.5°	1481.8	1481.8	1484.0	1486.3	1486.3	1486.3	1486.3	1485.1	1482.9	1484.0	1481.8
20°	1482.9	1484.0	1485.1	1488.5	1490.8	1491.9	1491.9	1488.5	1485.1	1486.3	1485.1
22.5°	1479.5	1478.4	1479.5	1481.8	1485.1	1485.1	1485.1	1480.6	1479.5	1478.4	1478.4
25°	1466.0	1466.0	1468.3	1470.5	1472.8	1471.6	1472.8	1470.5	1468.3	1466.0	1466.0
27.5°	1450.3	1450.3	1453.6	1455.9	1458.1	1458.1	1457.0	1454.8	1453.6	1451.4	1450.3
30°	1434.5	1434.5	1437.9	1440.1	1443.5	1442.4	1442.4	1439.0	1435.6	1433.4	1433.4
32.5°	1417.6	1416.5	1419.9	1425.5	1430.0	1430.0	1430.0	1423.3	1418.8	1416.5	1415.4
35°	1403.0	1403.0	1407.5	1417.6	1423.3	1423.3	1421.0	1416.5	1406.4	1403.0	1403.0
37.5°	1398.5	1401.9	1414.3	1428.9	1440.1	1442.4	1439.0	1426.6	1413.1	1403.0	1399.6
40°	1413.1	1416.5	1432.3	1455.9	1472.8	1476.1	1472.8	1454.8	1431.1	1415.4	1414.3
42.5°	1415.4	1417.6	1436.8	1463.8	1479.5	1485.1	1479.5	1461.5	1435.6	1416.5	1415.4
45°	1407.5	1408.6	1431.1	1459.3	1478.4	1485.1	1478.4	1457.0	1430.0	1408.6	1407.5
47.5°	1397.4	1399.6	1424.4	1453.6	1477.3	1481.8	1476.1	1452.5	1422.1	1400.8	1397.4
50°	1389.5	1396.3	1418.8	1451.4	1479.5	1493.0	1479.5	1448.0	1417.6	1394.0	1389.5
52.5°	1394.0	1396.3	1425.5	1471.6	1509.9	1515.5	1508.8	1471.6	1423.3	1396.3	1392.9
55°	1407.5	1417.6	1449.1	1515.5	1550.4	1560.5	1545.9	1513.3	1450.3	1417.6	1407.5
57.5°	1425.5	1428.9	1473.9	1532.4	1584.1	1614.5	1585.3	1531.3	1477.3	1426.6	1424.4
60°	1410.9	1400.8	1457.0	1525.6	1595.4	1607.8	1590.9	1526.8	1454.8	1399.6	1409.8
62.5°	1371.5	1378.3	1424.4	1518.9	1567.3	1580.8	1562.8	1518.9	1422.1	1383.9	1368.1
65°	1340.0	1380.5	1431.1	1498.6	1576.3	1614.5	1577.4	1496.4	1433.4	1373.8	1336.6
67.5°	1296.1	1304.0	1379.4	1462.6	1532.4	1551.5	1531.3	1463.8	1372.6	1298.4	1304.0
70°	1221.9	1210.6	1287.1	1383.9	1450.3	1480.6	1452.5	1379.4	1283.7	1208.4	1218.5
72.5°	1099.2	1106.0	1176.9	1279.2	1347.9	1377.1	1349.0	1271.4	1174.6	1112.7	1106.0
75°	971.0	978.8	1047.5	1140.9	1210.6	1223.0	1215.1	1135.2	1049.7	977.7	971.0
77.5°	824.7	832.6	888.8	991.2	1032.8	1052.0	1035.1	996.8	886.6	831.5	822.5
80°	662.7	660.4	709.9	797.7	849.5	870.8	849.5	799.9	707.7	664.9	650.3
82.5°	473.7	475.9	522.0	582.8	632.3	639.1	628.9	588.4	517.5	481.5	461.3
85°	263.3	273.4	307.2	352.2	384.8	396.0	379.2	340.9	306.0	277.9	268.9
87.5°	63.0	68.6	79.9	101.3	113.6	124.9	113.6	105.8	75.4	68.6	63.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

MCGRAW EDISON

Report Number: SP1-2411-284-1

Test Date: 11/15/2024

Luminaire Tested: TTN-D0-735-U-WQ

Data in this report applies to families of products including TT-D* and TTN-D*

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2411-284-1
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 11/15/2024
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: MCGRAW EDISON
 Catalog Number: **TTN-D0-735-U-WQ**
 Description: TOPTIER NANO LED PARKING GARAGE LUMINAIRE. 3500K, 70 CRI LEDS AND WIDE DISTRIBUTION

Spectral Parameters

CCT (K):	3405	CRI (Ra):	73.9		
CIE u':	0.2365	R1:	71.3	R9:	-18.0
CIE v':	0.5180	R2:	80.3	R10:	53.1
Duv:	0.0036	R3:	87.8	R11:	68.6
CIE x:	0.4148	R4:	73.2	R12:	42.6
CIE y:	0.4038	R5:	69.8	R13:	72.5
CIE z:	0.1814	R6:	71.8	R14:	92.7
Peak Wavelength (nm):	596	R7:	82.8	R15:	64.3
Dominant Wavelength (nm):	579	R8:	54.1		
Purity:	45.70672				
Rf:	76.6				
Rg:	95.4				



Test Conditions

Stabilization Time: 38M
 Operation Time: 1H 38M
 Sphere Temperature (°C): 24.9

REPORT NUMBER: SP1-2411-284-1

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/22/2024	10/22/2025
DC Power Source	IN0208	10/22/2024	10/22/2025
Sphere Thermometer	IN0085	10/22/2024	10/22/2025
Room Thermometer	IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2411-284-1

CIE 1931 Chromaticity Diagram




CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2411-284-1

Photopic Flux vs. Wavelength

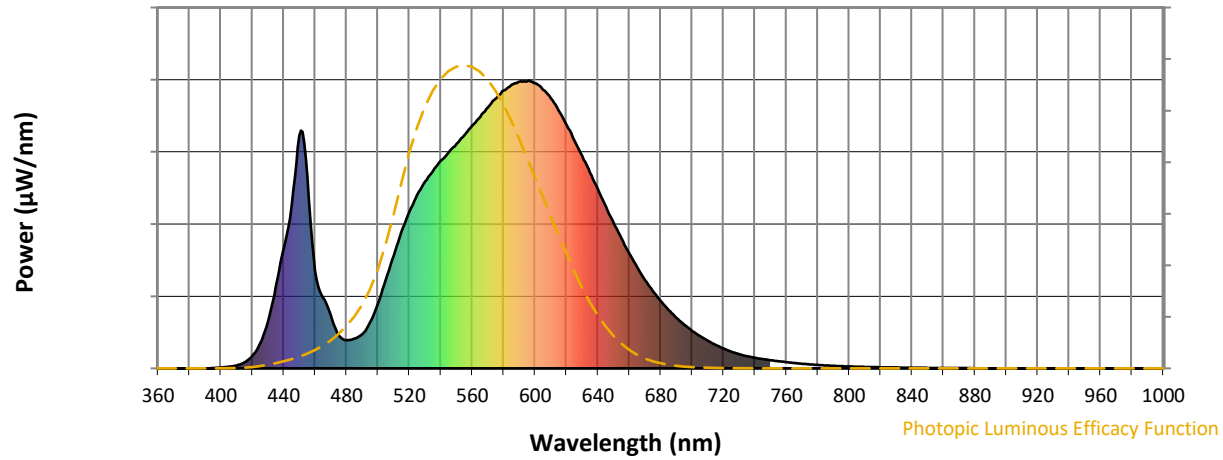

Photopic Lumens: NR

λ (nm)	Power W/nm	Lumens (ϕ/nm)	λ (nm)	Power W/nm	Lumens (ϕ/nm)	λ (nm)	Power W/nm	Lumens (ϕ/nm)	λ (nm)	Power W/nm	Lumens (ϕ/nm)	λ (nm)	Power W/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	846	NR	750	28	NR	880	1	NR
365	0	NR	495	160	NR	625	793	NR	755	25	NR	885	0	NR
370	0	NR	500	225	NR	630	739	NR	760	22	NR	890	0	NR
375	0	NR	505	308	NR	635	681	NR	765	19	NR	895	0	NR
380	0	NR	510	392	NR	640	623	NR	770	16	NR	900	0	NR
385	0	NR	515	474	NR	645	563	NR	775	14	NR	905	0	NR
390	0	NR	520	545	NR	650	506	NR	780	12	NR	910	0	NR
395	1	NR	525	603	NR	655	451	NR	785	10	NR	915	0	NR
400	3	NR	530	649	NR	660	399	NR	790	9	NR	920	0	NR
405	5	NR	535	687	NR	665	352	NR	795	8	NR	925	0	NR
410	11	NR	540	721	NR	670	307	NR	800	6	NR	930	0	NR
415	21	NR	545	751	NR	675	268	NR	805	6	NR	935	0	NR
420	43	NR	550	779	NR	680	234	NR	810	5	NR	940	0	NR
425	88	NR	555	811	NR	685	203	NR	815	4	NR	945	0	NR
430	163	NR	560	843	NR	690	176	NR	820	4	NR	950	0	NR
435	288	NR	565	873	NR	695	152	NR	825	3	NR	955	0	NR
440	416	NR	570	907	NR	700	131	NR	830	3	NR	960	0	NR
445	566	NR	575	938	NR	705	112	NR	835	3	NR	965	0	NR
450	810	NR	580	965	NR	710	96	NR	840	2	NR	970	0	NR
455	669	NR	585	986	NR	715	81	NR	845	2	NR	975	0	NR
460	338	NR	590	997	NR	720	69	NR	850	2	NR	980	0	NR
465	246	NR	595	997	NR	725	58	NR	855	1	NR	985	0	NR
470	182	NR	600	991	NR	730	49	NR	860	1	NR	990	0	NR
475	115	NR	605	968	NR	735	42	NR	865	1	NR	995	0	NR
480	97	NR	610	939	NR	740	37	NR	870	1	NR	1000	0	NR
485	103	NR	615	896	NR	745	32	NR	875	1	NR			

REPORT NUMBER: SP1-2411-284-1

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.33

λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)
360	0	NR	490	119	NR	620	846	NR	750	28	NR	880	1	NR
365	0	NR	495	160	NR	625	793	NR	755	25	NR	885	0	NR
370	0	NR	500	225	NR	630	739	NR	760	22	NR	890	0	NR
375	0	NR	505	308	NR	635	681	NR	765	19	NR	895	0	NR
380	0	NR	510	392	NR	640	623	NR	770	16	NR	900	0	NR
385	0	NR	515	474	NR	645	563	NR	775	14	NR	905	0	NR
390	0	NR	520	545	NR	650	506	NR	780	12	NR	910	0	NR
395	1	NR	525	603	NR	655	451	NR	785	10	NR	915	0	NR
400	3	NR	530	649	NR	660	399	NR	790	9	NR	920	0	NR
405	5	NR	535	687	NR	665	352	NR	795	8	NR	925	0	NR
410	11	NR	540	721	NR	670	307	NR	800	6	NR	930	0	NR
415	21	NR	545	751	NR	675	268	NR	805	6	NR	935	0	NR
420	43	NR	550	779	NR	680	234	NR	810	5	NR	940	0	NR
425	88	NR	555	811	NR	685	203	NR	815	4	NR	945	0	NR
430	163	NR	560	843	NR	690	176	NR	820	4	NR	950	0	NR
435	288	NR	565	873	NR	695	152	NR	825	3	NR	955	0	NR
440	416	NR	570	907	NR	700	131	NR	830	3	NR	960	0	NR
445	566	NR	575	938	NR	705	112	NR	835	3	NR	965	0	NR
450	810	NR	580	965	NR	710	96	NR	840	2	NR	970	0	NR
455	669	NR	585	986	NR	715	81	NR	845	2	NR	975	0	NR
460	338	NR	590	997	NR	720	69	NR	850	2	NR	980	0	NR
465	246	NR	595	997	NR	725	58	NR	855	1	NR	985	0	NR
470	182	NR	600	991	NR	730	49	NR	860	1	NR	990	0	NR
475	115	NR	605	968	NR	735	42	NR	865	1	NR	995	0	NR
480	97	NR	610	939	NR	740	37	NR	870	1	NR	1000	0	NR
485	103	NR	615	896	NR	745	32	NR	875	1	NR			

REPORT NUMBER: SP1-2411-284-1

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 2.47

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	119	NR	620	846	NR	750	28	NR	880	1	NR
365	0	NR	495	160	NR	625	793	NR	755	25	NR	885	0	NR
370	0	NR	500	225	NR	630	739	NR	760	22	NR	890	0	NR
375	0	NR	505	308	NR	635	681	NR	765	19	NR	895	0	NR
380	0	NR	510	392	NR	640	623	NR	770	16	NR	900	0	NR
385	0	NR	515	474	NR	645	563	NR	775	14	NR	905	0	NR
390	0	NR	520	545	NR	650	506	NR	780	12	NR	910	0	NR
395	1	NR	525	603	NR	655	451	NR	785	10	NR	915	0	NR
400	3	NR	530	649	NR	660	399	NR	790	9	NR	920	0	NR
405	5	NR	535	687	NR	665	352	NR	795	8	NR	925	0	NR
410	11	NR	540	721	NR	670	307	NR	800	6	NR	930	0	NR
415	21	NR	545	751	NR	675	268	NR	805	6	NR	935	0	NR
420	43	NR	550	779	NR	680	234	NR	810	5	NR	940	0	NR
425	88	NR	555	811	NR	685	203	NR	815	4	NR	945	0	NR
430	163	NR	560	843	NR	690	176	NR	820	4	NR	950	0	NR
435	288	NR	565	873	NR	695	152	NR	825	3	NR	955	0	NR
440	416	NR	570	907	NR	700	131	NR	830	3	NR	960	0	NR
445	566	NR	575	938	NR	705	112	NR	835	3	NR	965	0	NR
450	810	NR	580	965	NR	710	96	NR	840	2	NR	970	0	NR
455	669	NR	585	986	NR	715	81	NR	845	2	NR	975	0	NR
460	338	NR	590	997	NR	720	69	NR	850	2	NR	980	0	NR
465	246	NR	595	997	NR	725	58	NR	855	1	NR	985	0	NR
470	182	NR	600	991	NR	730	49	NR	860	1	NR	990	0	NR
475	115	NR	605	968	NR	735	42	NR	865	1	NR	995	0	NR
480	97	NR	610	939	NR	740	37	NR	870	1	NR	1000	0	NR
485	103	NR	615	896	NR	745	32	NR	875	1	NR			

REPORT NUMBER: SP1-2411-284-1


TM-30-18

Summary

$R_f = 76.6$
 $R_g = 95.4$
 $CIE R_a = 73.9$
 $R_g = -18.0$



Color Vector Graphics



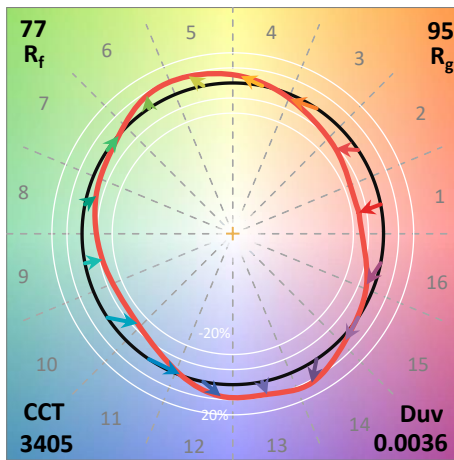


Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 67	CES51 = 88	CES76 = 56
CES02 = 62	CES27 = 89	CES52 = 88	CES77 = 75
CES03 = 31	CES28 = 83	CES53 = 78	CES78 = 60
CES04 = 70	CES29 = 69	CES54 = 86	CES79 = 85
CES05 = 48	CES30 = 83	CES55 = 85	CES80 = 82
CES06 = 51	CES31 = 72	CES56 = 75	CES81 = 78
CES07 = 41	CES32 = 65	CES57 = 75	CES82 = 92
CES08 = 40	CES33 = 78	CES58 = 76	CES83 = 90
CES09 = 29	CES34 = 74	CES59 = 87	CES84 = 88
CES10 = 75	CES35 = 86	CES60 = 91	CES85 = 79
CES11 = 58	CES36 = 93	CES61 = 84	CES86 = 72
CES12 = 64	CES37 = 81	CES62 = 88	CES87 = 79
CES13 = 43	CES38 = 92	CES63 = 74	CES88 = 82
CES14 = 74	CES39 = 96	CES64 = 69	CES89 = 72
CES15 = 71	CES40 = 92	CES65 = 66	CES90 = 82
CES16 = 47	CES41 = 93	CES66 = 62	CES91 = 79
CES17 = 50	CES42 = 83	CES67 = 60	CES92 = 63
CES18 = 56	CES43 = 79	CES68 = 68	CES93 = 77
CES19 = 72	CES44 = 99	CES69 = 76	CES94 = 56
CES20 = 65	CES45 = 86	CES70 = 61	CES95 = 70
CES21 = 86	CES46 = 83	CES71 = 55	CES96 = 79
CES22 = 79	CES47 = 85	CES72 = 85	CES97 = 85
CES23 = 92	CES48 = 78	CES73 = 53	CES98 = 78
CES24 = 91	CES49 = 81	CES74 = 95	CES99 = 68
CES25 = 72	CES50 = 88	CES75 = 57	



Color Rendition by Hue-Angle Bin

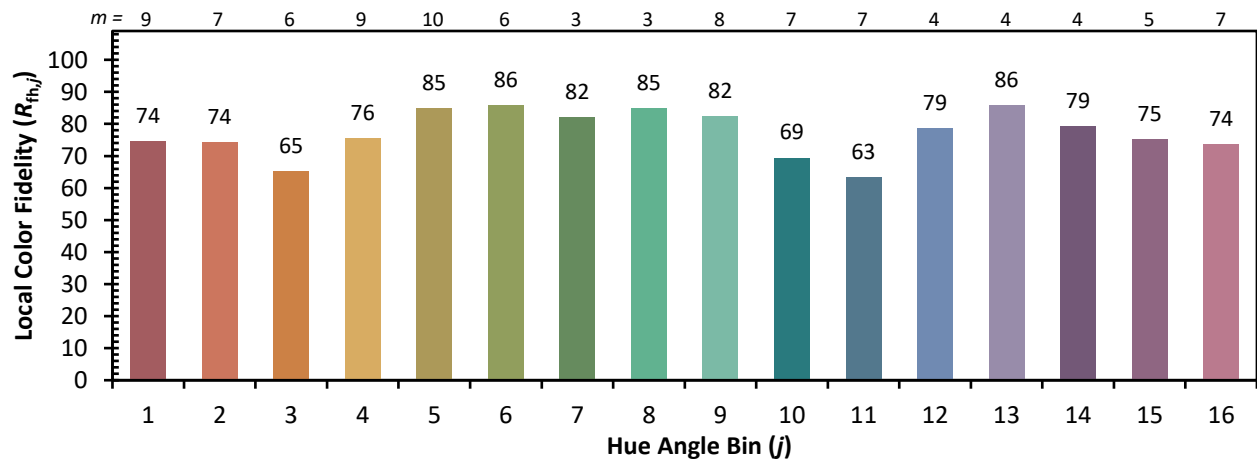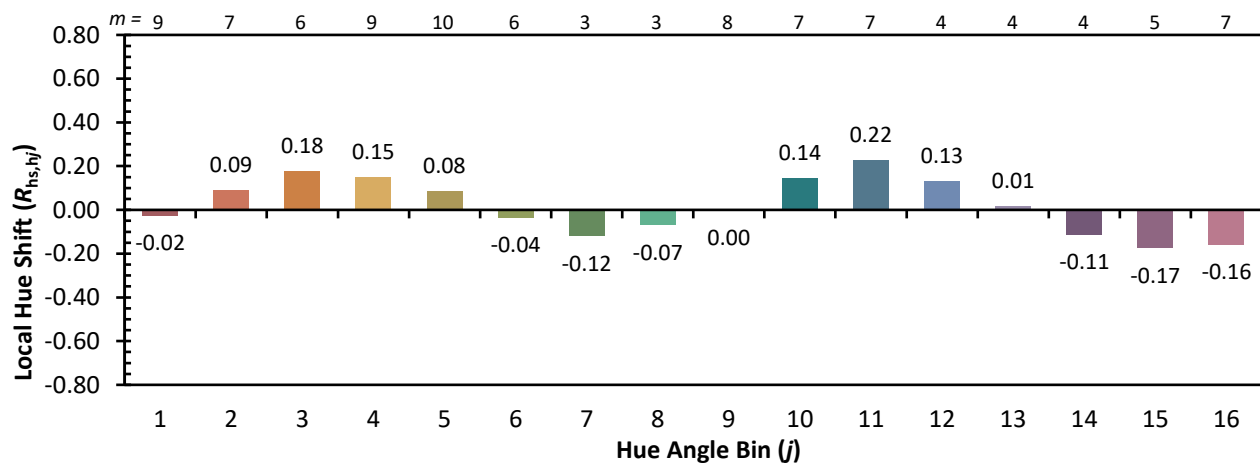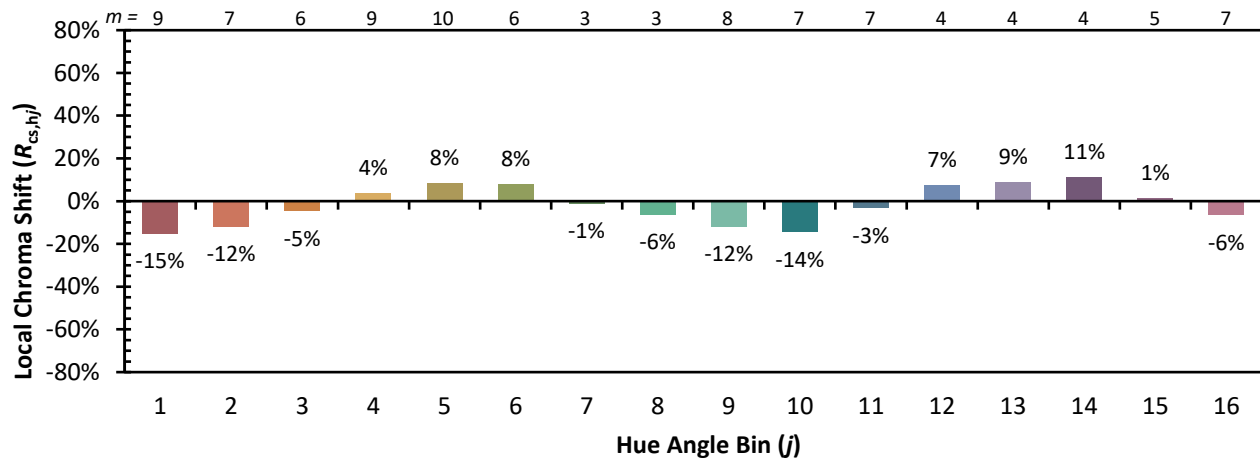

Measure Comparisons



(END OF REPORT)