Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P821509

Luminaire Tested: **TT-D5-735-12VDC-RW-UPL**

Issue Date: 10/29/2020

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P821509
	REPORT IS FROM IESNA LM-79-08 TEST DATA - UPLIGHT (G2-2002-677-2) AND
Test Lab:	INNOVATION CENTER
Issue Date:	10/29/2020
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	TT-D5-735-12VDC-RW-UPL
Description:	TOPTIER LED PARKING GARAGE LUMINAIRE WITH UPLIGHT
	3500K, 70 CRI LEDS AND RECTANGULAR DISTRIBUTION
Light Source:	-
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	8033.7 lumens
Efficiency:	N/A
Efficacy:	110.1 lumens/watt
Luminous Opening:	Vertical Cylinder (Dia: 1.12' x H: 0.1')
IES Classification:	Type IV - Short
BUG Rating:	B3 - U4 - G3


Input Watts (W):	73
Input Voltage (V):	NR
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	25 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821509
CATALOG NUMBER: TT-D5-735-12VDC-RW-UPL

Iso-Footcandle Lines of Horizontal Illumination

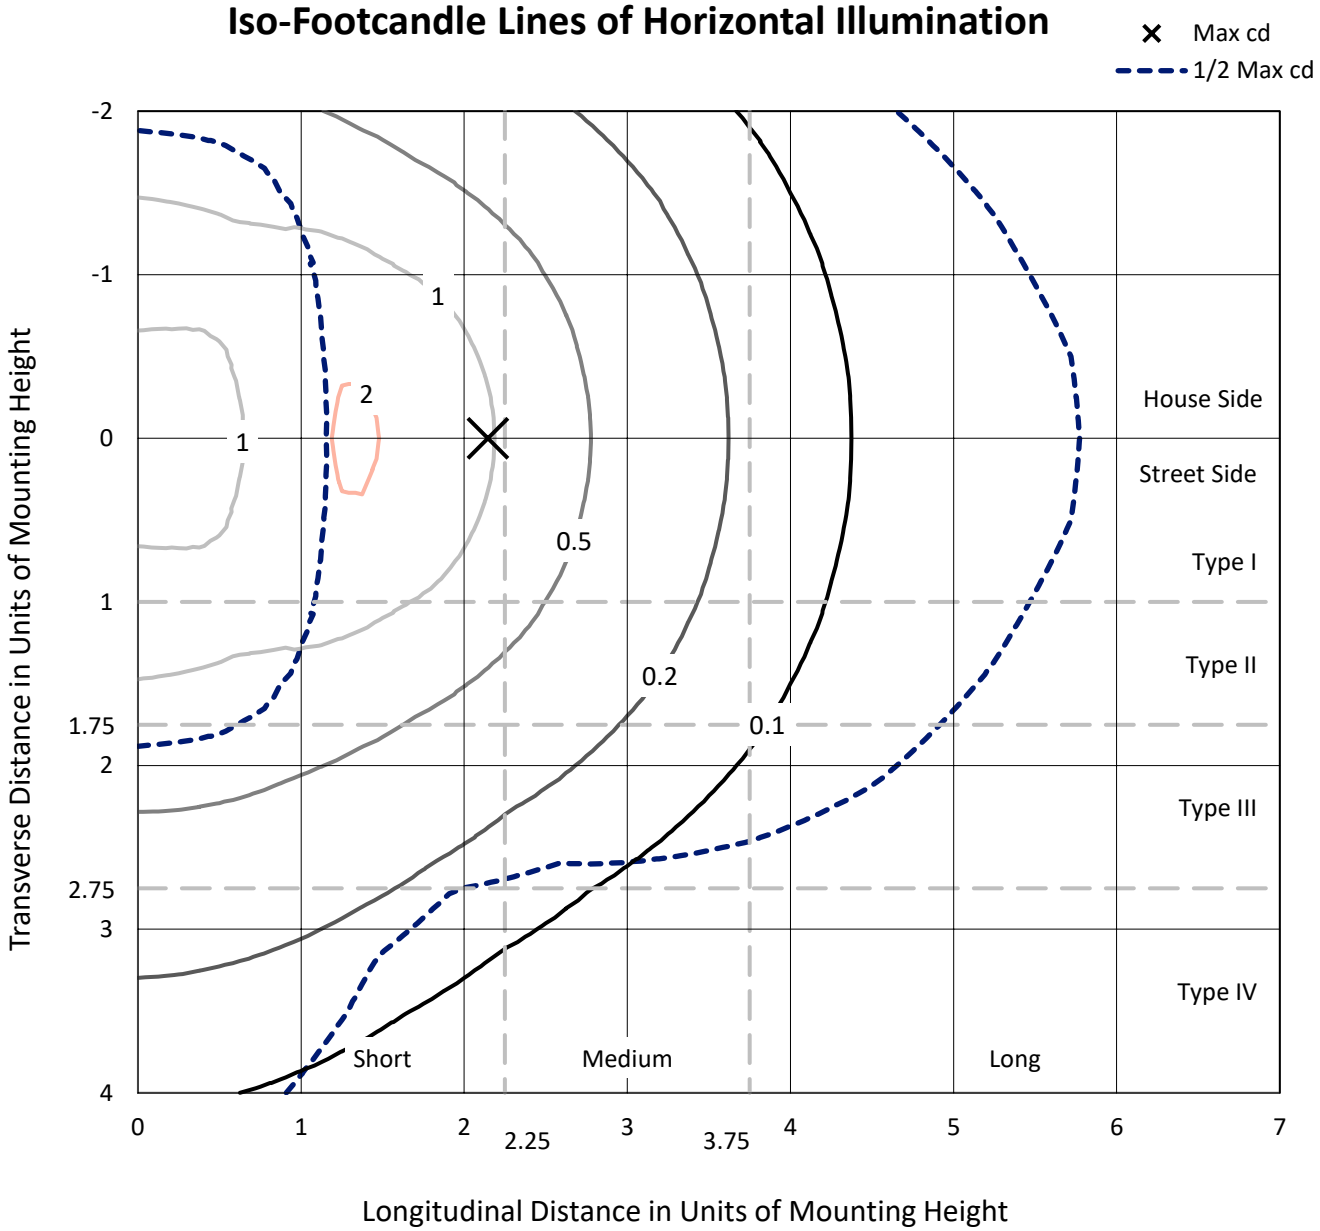


Based on 15 foot mounting height. Maximum calculated value = 2.2 fc
Type IV - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821509
CATALOG NUMBER: TT-D5-735-12VDC-RW-UPL

Luminous Intensity Polar Plot

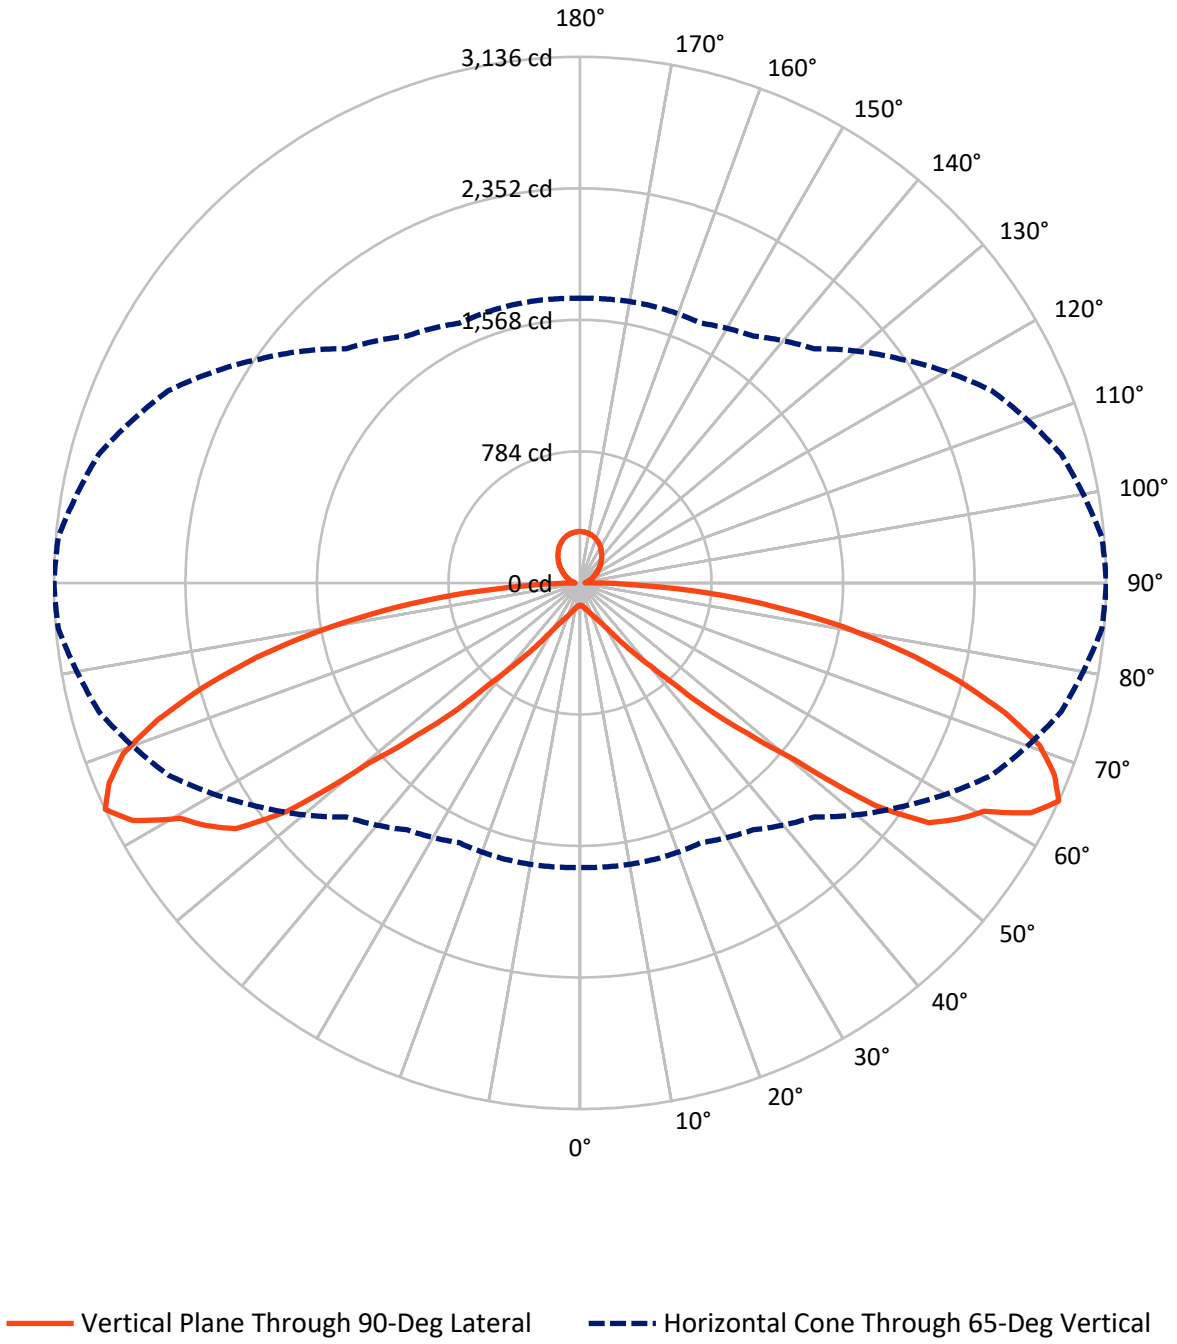

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P821509
CATALOG NUMBER: TT-D5-735-12VDC-RW-UPL

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	3601.0	415.9	4016.9
	% Fixture	44.8	5.2	50.0
Street Side	Lumens	3601.0	415.9	4016.9
	% Fixture	44.8	5.2	50.0
Total	Lumens	7202.0	831.7	8033.7
	% Fixture	89.6	10.4	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	13.7	0.2
10°-20°	51.3	0.6
20°-30°	118.6	1.5
30°-40°	268.2	3.3
40°-50°	653.3	8.1
50°-60°	1469.0	18.3
60°-70°	2147.0	26.7
70°-80°	1870.8	23.3
80°-90°	610.0	7.6
90°-100°	42.6	0.5
100°-110°	66.0	0.8
110°-120°	91.9	1.1
120°-130°	119.0	1.5
130°-140°	138.7	1.7
140°-150°	140.5	1.7
150°-160°	121.9	1.5
160°-170°	82.2	1.0
170°-180°	28.9	0.4
0°-90°	7202.0	89.6
0°-180°	8033.7	100.0

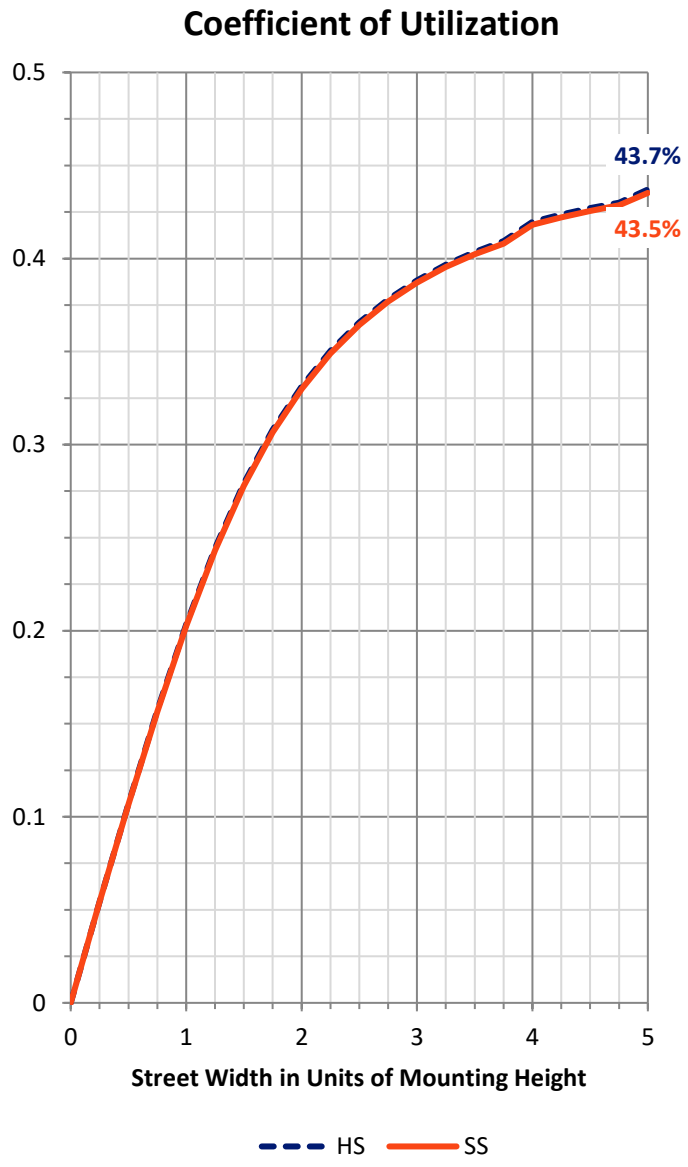

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P821509
CATALOG NUMBER: TT-D5-735-12VDC-RW-UPL

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	91.8	1.1			
FM	(30°-60°)	1195.3	14.9			
FH	(60°-80°)	2008.9	25.0			G2/5000
FVH	(80°-90°)	305.0	3.8			G3/500
BL	(0°-30°)	91.8	1.1	B0/110		
BM	(30°-60°)	1195.3	14.9	B2/2500		
BH	(60°-80°)	2008.9	25.0	B3/2500		G3/2500
BVH	(80°-90°)	305.0	3.8			G3/500
UL	(90°-100°)	42.6	0.5		U2/50	
UH	(100°-180°)	789.1	9.8		U4/1000	

BUG Rating: B3-U4-G3
Type IV Short

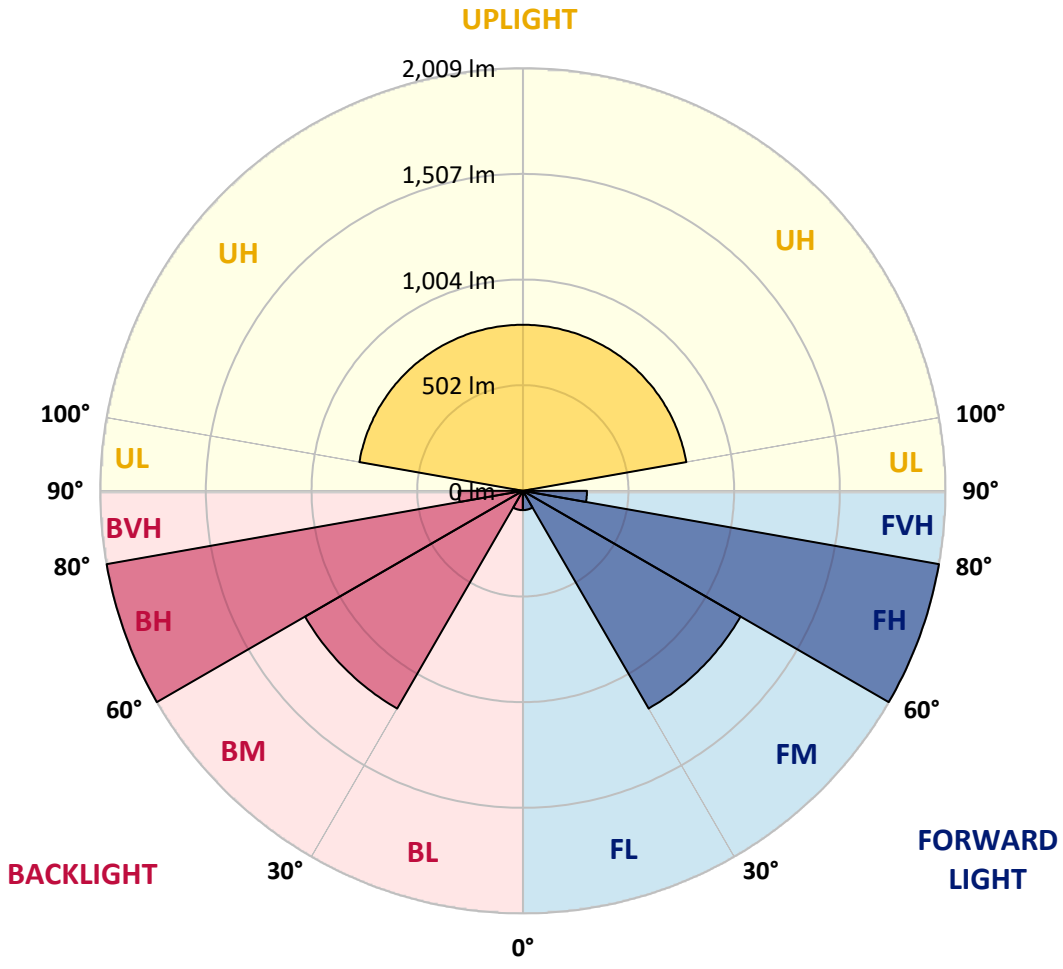

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821509
CATALOG NUMBER: TT-D5-735-12VDC-RW-UPL

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
0°	131.5	131.5	131.5	131.5	131.5	131.5	131.5	131.5	131.5	131.5	131.5
2.5°	133.2	133.2	134.9	134.9	134.9	134.9	134.9	134.9	134.9	134.9	134.9
5°	138.3	138.3	138.3	138.3	140.0	140.0	138.3	138.3	138.3	138.3	138.3
7.5°	146.9	145.2	146.9	146.9	146.9	145.2	145.2	145.2	143.5	143.5	143.5
10°	155.4	155.4	157.1	155.4	155.4	153.7	153.7	153.7	152.0	152.0	152.0
12.5°	167.4	167.4	167.4	167.4	165.7	165.7	164.0	162.3	160.5	160.5	160.5
15°	182.7	181.0	181.0	179.3	177.6	175.9	174.2	174.2	172.5	172.5	172.5
17.5°	198.1	198.1	196.4	194.7	191.3	189.6	189.6	187.9	186.2	186.2	186.2
20°	216.9	216.9	215.2	211.8	208.4	206.7	204.9	204.9	203.2	203.2	203.2
22.5°	239.1	237.4	234.0	230.6	227.2	225.4	223.7	222.0	222.0	222.0	222.0
25°	263.0	261.3	259.6	254.5	249.4	247.6	244.2	244.2	242.5	244.2	244.2
27.5°	292.1	290.3	286.9	281.8	275.0	271.6	269.8	269.8	271.6	271.6	273.3
30°	327.9	324.5	321.1	314.3	307.4	302.3	302.3	304.0	309.1	312.5	312.5
32.5°	370.6	368.9	363.8	357.0	345.0	341.6	345.0	355.2	362.1	367.2	370.6
35°	420.1	418.4	411.6	399.6	391.1	389.4	399.6	416.7	438.9	445.8	449.2
37.5°	474.8	476.5	468.0	454.3	445.8	449.2	469.7	502.1	524.3	539.7	543.1
40°	543.1	546.5	536.3	520.9	512.4	526.0	558.5	596.1	635.3	654.1	659.3
42.5°	623.4	628.5	614.8	599.5	594.4	616.6	662.7	724.2	794.2	816.4	824.9
45°	722.4	725.9	708.8	695.1	691.7	731.0	809.5	912.0	1023.0	1074.3	1082.8
47.5°	840.3	838.6	823.2	806.1	809.5	865.9	983.8	1122.1	1239.9	1318.5	1335.6
50°	975.2	966.7	954.7	934.2	956.4	1038.4	1187.0	1354.4	1552.5	1622.5	1653.2
52.5°	1110.1	1094.8	1084.5	1070.9	1110.1	1216.0	1424.4	1716.4	2015.3	2175.9	2208.3
55°	1231.4	1219.4	1214.3	1216.0	1277.5	1429.5	1702.8	2076.8	2365.4	2498.7	2522.6
57.5°	1351.0	1344.1	1339.0	1349.2	1446.6	1644.7	1952.1	2302.3	2539.7	2638.7	2655.8
60°	1463.7	1470.5	1467.1	1497.8	1615.7	1815.5	2081.9	2426.9	2655.8	2746.3	2765.1
62.5°	1588.3	1593.5	1593.5	1627.6	1723.3	1899.2	2170.7	2573.8	2864.2	2997.4	3017.9
65°	1695.9	1699.4	1706.2	1707.9	1796.7	1972.6	2327.9	2708.7	2968.3	3122.0	3135.7
67.5°	1776.2	1779.6	1771.1	1762.6	1830.9	1989.7	2315.9	2691.7	2922.2	3038.4	3048.6
70°	1841.1	1825.7	1801.8	1759.1	1781.3	1900.9	2216.9	2555.0	2787.3	2891.5	2906.9
72.5°	1849.7	1836.0	1760.8	1665.2	1637.9	1742.1	2042.7	2346.7	2546.5	2645.5	2647.2
75°	1798.4	1762.6	1637.9	1494.4	1443.2	1542.2	1800.1	2076.8	2237.4	2321.0	2329.6
77.5°	1625.9	1591.8	1434.6	1270.7	1212.6	1298.0	1516.6	1740.4	1894.1	1976.0	1981.2
80°	1320.2	1308.3	1164.8	1014.5	944.5	994.0	1185.3	1361.2	1485.9	1583.2	1591.8
82.5°	973.5	963.3	854.0	722.4	666.1	707.1	843.7	973.5	1089.6	1168.2	1173.3
85°	608.0	587.5	519.2	427.0	389.4	416.7	507.2	594.4	698.5	760.0	763.4
87.5°	203.2	194.7	167.4	138.3	116.1	121.3	148.6	181.0	264.7	292.1	309.1
90°	30.1	29.1	29.1	29.1	29.1	29.1	29.1	29.1	29.1	29.1	29.1
92.5°	34.8	34.2	34.2	33.8	33.8	33.8	33.8	33.8	33.8	33.8	33.8
95°	39.4	39.4	39.4	38.5	38.5	38.5	38.5	38.5	38.5	38.5	38.5
97.5°	44.6	44.6	44.6	44.2	44.2	44.2	44.2	44.2	44.2	44.2	44.2
100°	49.8	49.8	49.8	49.8	49.8	49.8	49.8	49.8	49.8	49.8	49.8
102.5°	55.9	55.9	55.9	55.9	55.9	55.9	55.9	56.4	55.9	55.9	55.9
105°	62.0	62.0	62.0	62.0	62.0	62.0	62.0	62.9	62.0	62.0	62.0
107.5°	68.6	68.6	69.0	69.0	69.0	69.0	69.0	69.5	69.0	69.0	69.0
110°	75.1	75.1	76.1	76.1	76.1	76.1	76.1	76.1	76.1	76.1	76.1

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821509
CATALOG NUMBER: TT-D5-735-12VDC-RW-UPL

CANDELA DISTRIBUTION (continued):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
112.5°	83.1	83.1	84.0	84.0	84.0	84.0	84.6	84.6	84.0	84.0	*84.0*
115°	91.1	91.1	92.0	92.0	92.0	92.0	93.0	93.0	92.0	92.0	*92.0*
117.5°	100.5	100.5	101.0	101.4	101.4	101.4	102.4	102.4	101.4	101.4	*101.4*
120°	109.9	109.9	109.9	110.8	110.8	110.8	111.8	111.8	110.8	110.8	*110.8*
122.5°	120.7	120.7	121.2	121.6	121.6	121.6	122.6	122.6	122.1	122.1	*121.6*
125°	131.5	131.5	132.4	132.4	132.4	132.4	133.4	133.4	133.4	133.4	*132.4*
127.5°	143.2	143.2	144.2	144.2	144.2	144.2	145.1	145.1	145.1	145.1	*144.2*
130°	155.0	155.0	155.9	155.9	155.9	155.9	156.8	156.8	156.8	156.8	*155.9*
132.5°	167.2	167.2	167.6	167.6	167.6	168.1	168.6	168.6	168.6	168.6	*168.1*
135°	179.4	179.4	179.4	179.4	179.4	180.3	180.3	180.3	180.3	180.3	*180.3*
137.5°	191.2	190.6	191.2	190.6	191.2	191.6	191.6	191.6	191.6	191.6	*191.6*
140°	202.9	201.9	202.9	201.9	202.9	202.9	202.9	202.9	202.9	202.9	*202.9*
142.5°	213.7	213.2	213.7	212.7	213.7	213.7	213.7	213.7	213.7	213.7	*213.7*
145°	224.5	224.5	224.5	223.5	224.5	224.5	224.5	224.5	224.5	224.5	*224.5*
147.5°	235.8	235.3	235.8	234.8	235.8	235.8	235.8	235.8	235.8	235.8	*235.8*
150°	247.0	246.1	247.0	246.1	247.0	247.0	247.0	247.0	247.0	247.0	*247.0*
152.5°	256.0	255.5	256.4	255.5	256.0	256.0	256.4	256.0	256.0	256.0	*256.0*
155°	264.9	264.9	265.8	264.9	264.9	264.9	265.8	264.9	264.9	264.9	*264.9*
157.5°	272.4	272.4	273.3	272.4	272.4	272.4	273.3	272.4	272.4	272.4	*272.4*
160°	279.9	279.9	280.8	279.9	279.9	279.9	280.8	279.9	279.9	279.9	*279.9*
162.5°	286.0	286.0	286.9	286.0	286.0	286.0	286.9	286.0	286.0	286.0	*286.0*
165°	292.1	292.1	293.0	292.1	292.1	292.1	293.0	292.1	292.1	292.1	*292.1*
167.5°	295.8	295.8	296.8	295.8	295.8	295.8	296.8	295.8	295.8	295.8	*295.8*
170°	299.6	299.6	300.5	299.6	299.6	299.6	300.5	299.6	299.6	299.6	*299.6*
172.5°	302.0	302.0	302.8	302.0	302.4	302.0	302.8	302.0	302.0	302.0	*302.0*
175°	304.3	304.3	305.2	304.3	305.2	304.3	305.2	304.3	304.3	304.3	*304.3*
177.5°	305.2	305.2	305.7	305.2	305.7	305.2	305.7	305.2	305.2	305.2	*305.2*
180°	306.2	306.2	306.2	306.2	306.2	306.2	306.2	306.2	306.2	306.2	*306.2*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Streetworks

Report Number: SP1-2407-176-4

Test Date: 09/24/2024

Luminaire Tested: MEM2-HTN-VA-30-735-U-WQ

Data in this report applies to families of products including MEM2-HTN-VA-30-735-U-WQ


Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04

Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-176-4
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	09/27/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	Streetworks
Catalog Number:	**MEM2-HTN-VA-30-735-U-WQ**
Description:	EPIC MODERN VISUAL COMFORT 30W WAVESTREAM WIDE

Spectral Parameters

CCT (K):	3348	CRI (Ra):	73.4		
CIE u':	0.2384	R1:	70.8	R9:	-19.2
CIE v':	0.5184	R2:	79.9	R10:	52.5
Duv:	0.0030	R3:	87.6	R11:	68.0
CIE x:	0.4177	R4:	72.6	R12:	42.6
CIE y:	0.4036	R5:	69.3	R13:	72.0
CIE z:	0.1787	R6:	71.3	R14:	92.6
Peak Wavelength (nm):	593	R7:	82.1	R15:	63.8
Dominant Wavelength (nm):	580	R8:	53.3		
Purity:	46.5223				
Rf:	75.8				
Rg:	95.8				

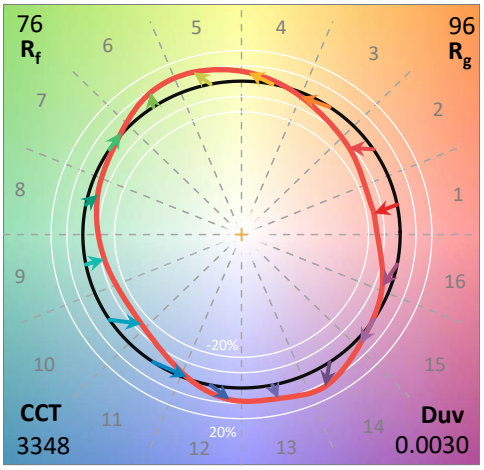

Test Conditions


Stabilization Time:	30M
Operation Time:	1H 30M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-176-4


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-176-4

CIE 1931 Chromaticity Diagram

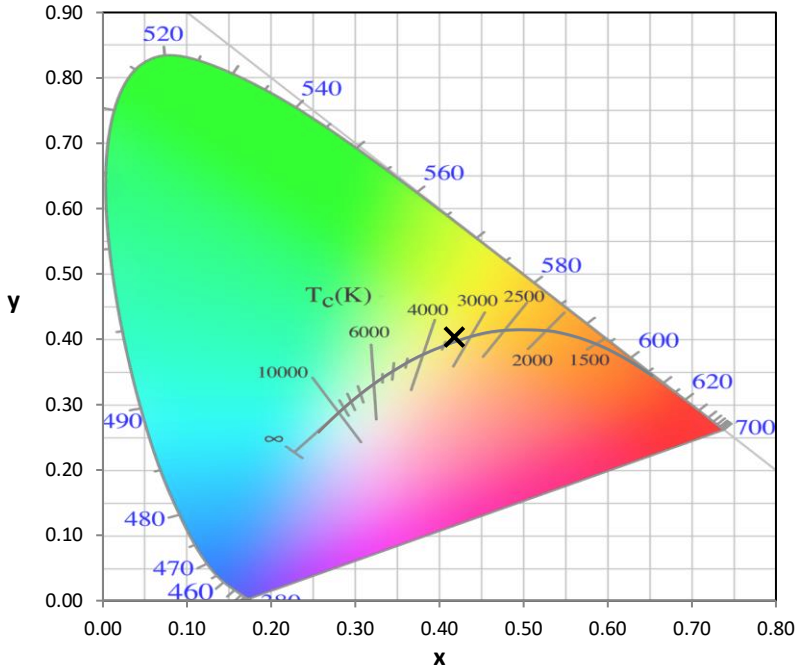

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

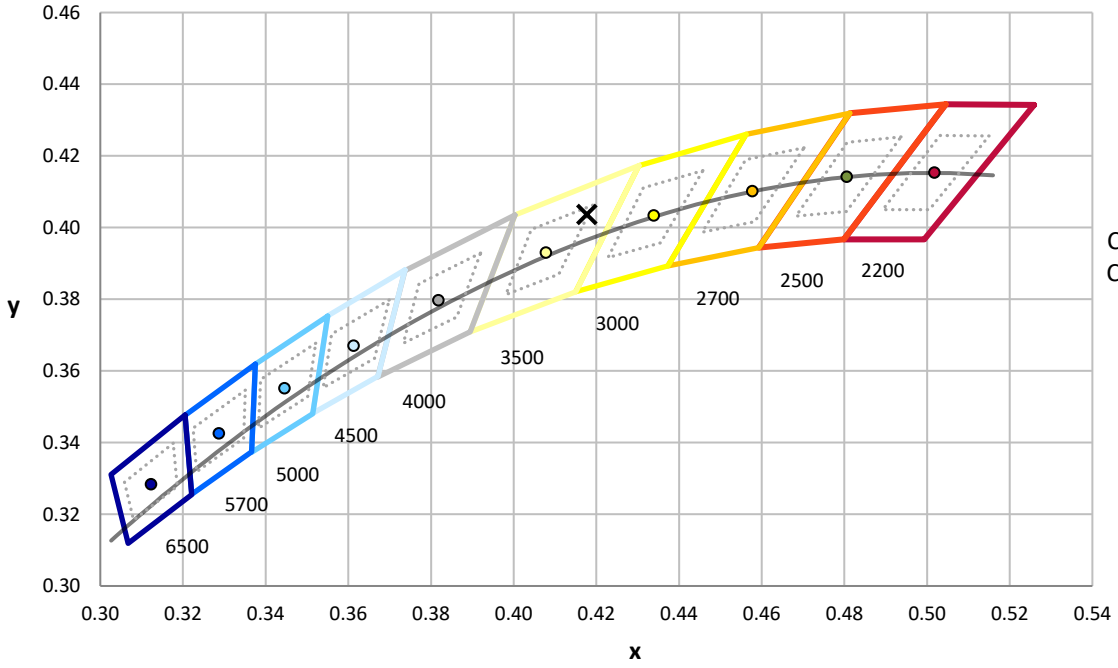


CCT = 3348K
CIE x = 0.4177
CIE y = 0.4036
Duv = 0.0030

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-176-4

Photopic Flux vs. Wavelength

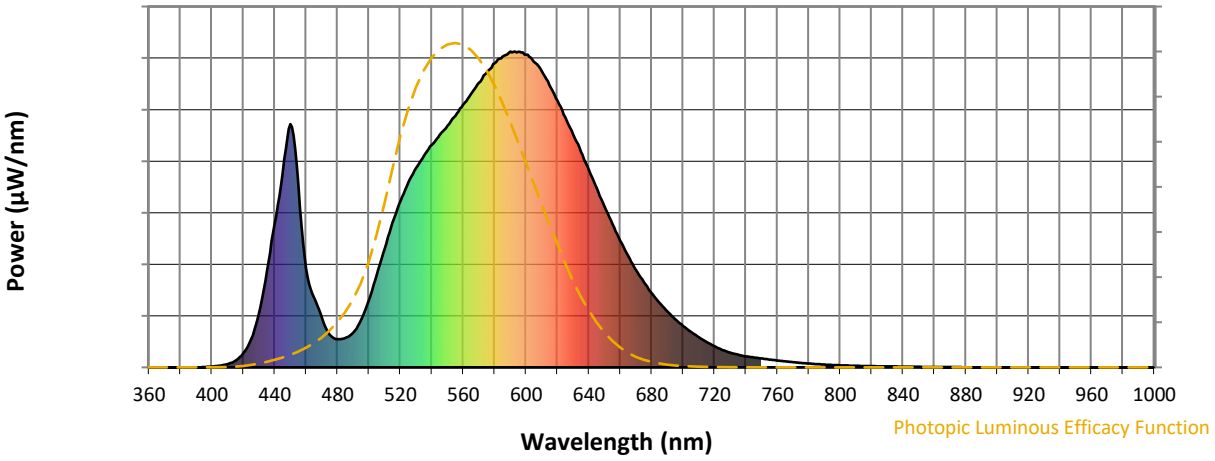


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	110	NR	620	844	NR	750	28	NR	880	0	NR
365	0	NR	495	150	NR	625	792	NR	755	25	NR	885	0	NR
370	0	NR	500	214	NR	630	737	NR	760	22	NR	890	0	NR
375	0	NR	505	293	NR	635	683	NR	765	19	NR	895	0	NR
380	0	NR	510	376	NR	640	625	NR	770	16	NR	900	0	NR
385	0	NR	515	458	NR	645	566	NR	775	14	NR	905	0	NR
390	0	NR	520	526	NR	650	509	NR	780	12	NR	910	0	NR
395	1	NR	525	584	NR	655	453	NR	785	10	NR	915	0	NR
400	3	NR	530	631	NR	660	401	NR	790	9	NR	920	0	NR
405	5	NR	535	671	NR	665	353	NR	795	8	NR	925	0	NR
410	10	NR	540	704	NR	670	308	NR	800	7	NR	930	0	NR
415	21	NR	545	737	NR	675	269	NR	805	6	NR	935	0	NR
420	44	NR	550	766	NR	680	235	NR	810	5	NR	940	0	NR
425	90	NR	555	797	NR	685	204	NR	815	4	NR	945	0	NR
430	171	NR	560	832	NR	690	177	NR	820	4	NR	950	0	NR
435	305	NR	565	866	NR	695	152	NR	825	3	NR	955	0	NR
440	455	NR	570	901	NR	700	131	NR	830	3	NR	960	0	NR
445	615	NR	575	933	NR	705	112	NR	835	3	NR	965	0	NR
450	771	NR	580	963	NR	710	96	NR	840	2	NR	970	0	NR
455	579	NR	585	984	NR	715	80	NR	845	2	NR	975	0	NR
460	313	NR	590	1000	NR	720	67	NR	850	2	NR	980	0	NR
465	221	NR	595	999	NR	725	55	NR	855	1	NR	985	0	NR
470	156	NR	600	990	NR	730	46	NR	860	1	NR	990	0	NR
475	103	NR	605	968	NR	735	40	NR	865	1	NR	995	0	NR
480	89	NR	610	937	NR	740	35	NR	870	1	NR	1000	0	NR
485	93	NR	615	893	NR	745	31	NR	875	1	NR			

REPORT NUMBER: SP1-2407-176-4

Scotopic Flux vs. Wavelength

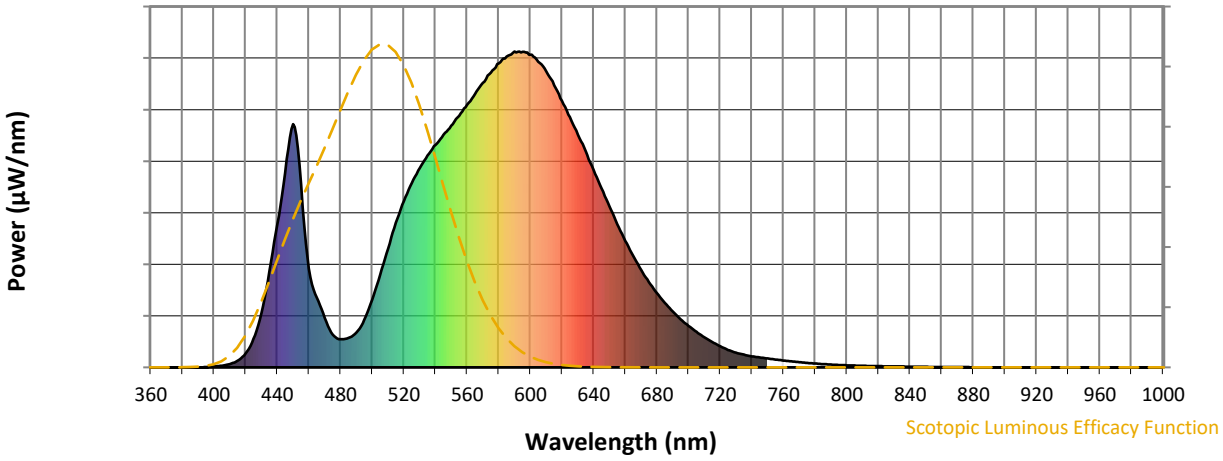


Scotopic Lumens: NR **S/P: 1.31**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	110	NR	620	844	NR	750	28	NR	880	0	NR
365	0	NR	495	150	NR	625	792	NR	755	25	NR	885	0	NR
370	0	NR	500	214	NR	630	737	NR	760	22	NR	890	0	NR
375	0	NR	505	293	NR	635	683	NR	765	19	NR	895	0	NR
380	0	NR	510	376	NR	640	625	NR	770	16	NR	900	0	NR
385	0	NR	515	458	NR	645	566	NR	775	14	NR	905	0	NR
390	0	NR	520	526	NR	650	509	NR	780	12	NR	910	0	NR
395	1	NR	525	584	NR	655	453	NR	785	10	NR	915	0	NR
400	3	NR	530	631	NR	660	401	NR	790	9	NR	920	0	NR
405	5	NR	535	671	NR	665	353	NR	795	8	NR	925	0	NR
410	10	NR	540	704	NR	670	308	NR	800	7	NR	930	0	NR
415	21	NR	545	737	NR	675	269	NR	805	6	NR	935	0	NR
420	44	NR	550	766	NR	680	235	NR	810	5	NR	940	0	NR
425	90	NR	555	797	NR	685	204	NR	815	4	NR	945	0	NR
430	171	NR	560	832	NR	690	177	NR	820	4	NR	950	0	NR
435	305	NR	565	866	NR	695	152	NR	825	3	NR	955	0	NR
440	455	NR	570	901	NR	700	131	NR	830	3	NR	960	0	NR
445	615	NR	575	933	NR	705	112	NR	835	3	NR	965	0	NR
450	771	NR	580	963	NR	710	96	NR	840	2	NR	970	0	NR
455	579	NR	585	984	NR	715	80	NR	845	2	NR	975	0	NR
460	313	NR	590	1000	NR	720	67	NR	850	2	NR	980	0	NR
465	221	NR	595	999	NR	725	55	NR	855	1	NR	985	0	NR
470	156	NR	600	990	NR	730	46	NR	860	1	NR	990	0	NR
475	103	NR	605	968	NR	735	40	NR	865	1	NR	995	0	NR
480	89	NR	610	937	NR	740	35	NR	870	1	NR	1000	0	NR
485	93	NR	615	893	NR	745	31	NR	875	1	NR			

REPORT NUMBER: SP1-2407-176-4

Melanopic Flux vs. Wavelength

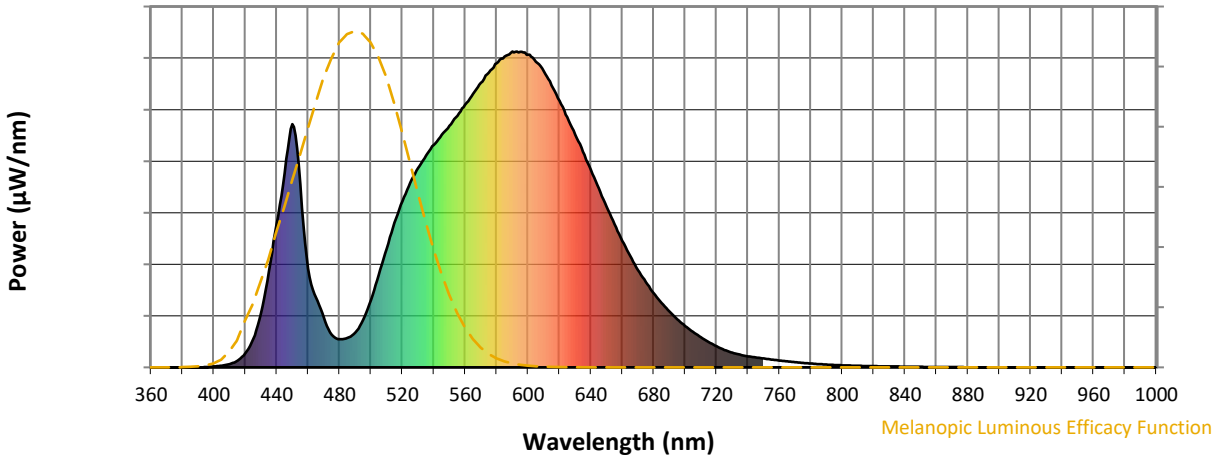

Melanopic Lumens: NR **M/P: 2.4**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	110	NR	620	844	NR	750	28	NR	880	0	NR
365	0	NR	495	150	NR	625	792	NR	755	25	NR	885	0	NR
370	0	NR	500	214	NR	630	737	NR	760	22	NR	890	0	NR
375	0	NR	505	293	NR	635	683	NR	765	19	NR	895	0	NR
380	0	NR	510	376	NR	640	625	NR	770	16	NR	900	0	NR
385	0	NR	515	458	NR	645	566	NR	775	14	NR	905	0	NR
390	0	NR	520	526	NR	650	509	NR	780	12	NR	910	0	NR
395	1	NR	525	584	NR	655	453	NR	785	10	NR	915	0	NR
400	3	NR	530	631	NR	660	401	NR	790	9	NR	920	0	NR
405	5	NR	535	671	NR	665	353	NR	795	8	NR	925	0	NR
410	10	NR	540	704	NR	670	308	NR	800	7	NR	930	0	NR
415	21	NR	545	737	NR	675	269	NR	805	6	NR	935	0	NR
420	44	NR	550	766	NR	680	235	NR	810	5	NR	940	0	NR
425	90	NR	555	797	NR	685	204	NR	815	4	NR	945	0	NR
430	171	NR	560	832	NR	690	177	NR	820	4	NR	950	0	NR
435	305	NR	565	866	NR	695	152	NR	825	3	NR	955	0	NR
440	455	NR	570	901	NR	700	131	NR	830	3	NR	960	0	NR
445	615	NR	575	933	NR	705	112	NR	835	3	NR	965	0	NR
450	771	NR	580	963	NR	710	96	NR	840	2	NR	970	0	NR
455	579	NR	585	984	NR	715	80	NR	845	2	NR	975	0	NR
460	313	NR	590	1000	NR	720	67	NR	850	2	NR	980	0	NR
465	221	NR	595	999	NR	725	55	NR	855	1	NR	985	0	NR
470	156	NR	600	990	NR	730	46	NR	860	1	NR	990	0	NR
475	103	NR	605	968	NR	735	40	NR	865	1	NR	995	0	NR
480	89	NR	610	937	NR	740	35	NR	870	1	NR	1000	0	NR
485	93	NR	615	893	NR	745	31	NR	875	1	NR			


REPORT NUMBER: SP1-2407-176-4

TM-30-18


Summary


R_f = 75.8
R_g = 95.8
CIE R_a = 73.4
R_9 = -19.2


Spectral Power Distribution Comparison

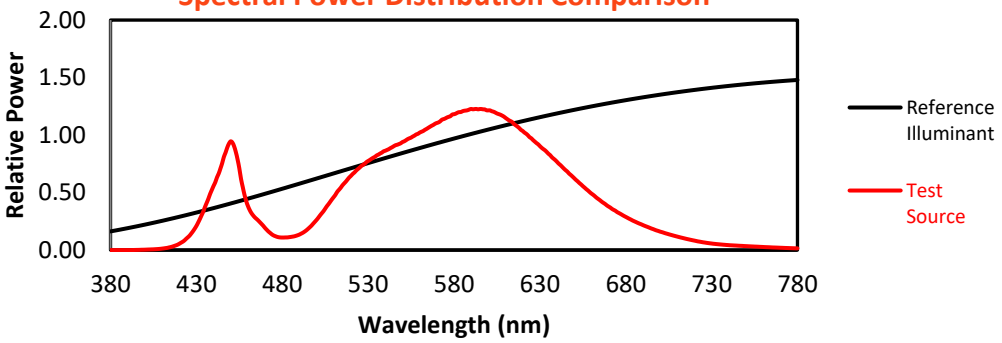


Color Vector Graphics

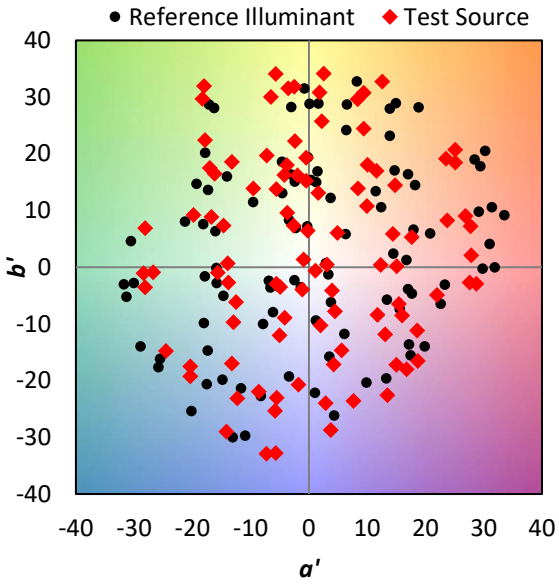

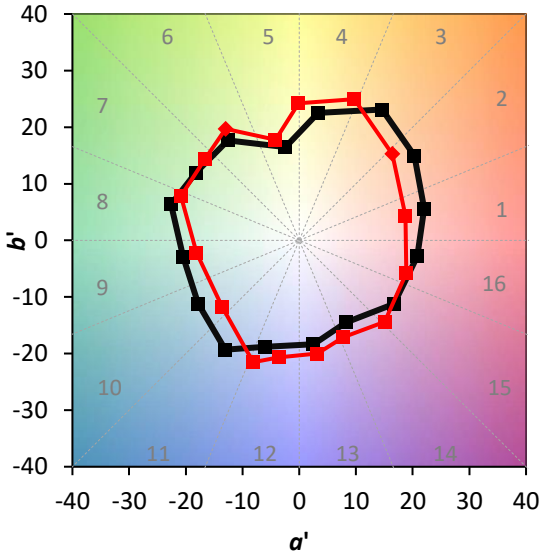

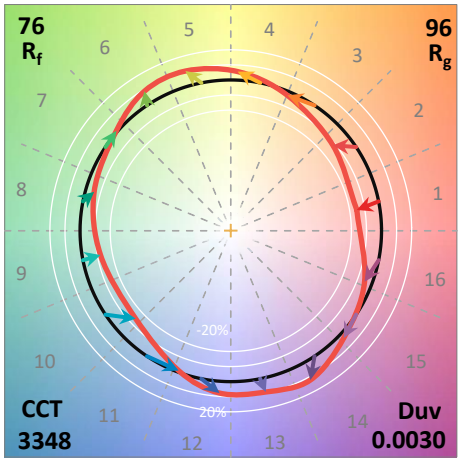

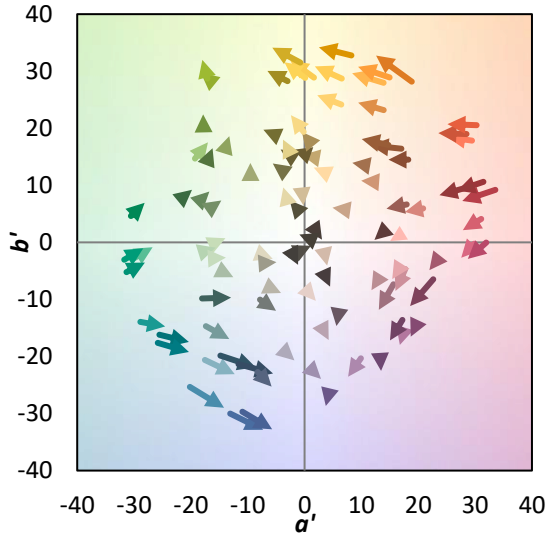


REPORT NUMBER: SP1-2407-176-4

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 65	CES51 = 88	CES76 = 55
CES02 = 62	CES27 = 88	CES52 = 87	CES77 = 74
CES03 = 31	CES28 = 83	CES53 = 77	CES78 = 58
CES04 = 70	CES29 = 66	CES54 = 86	CES79 = 84
CES05 = 48	CES30 = 79	CES55 = 84	CES80 = 81
CES06 = 51	CES31 = 69	CES56 = 74	CES81 = 78
CES07 = 41	CES32 = 62	CES57 = 73	CES82 = 92
CES08 = 40	CES33 = 75	CES58 = 75	CES83 = 89
CES09 = 29	CES34 = 73	CES59 = 87	CES84 = 88
CES10 = 75	CES35 = 85	CES60 = 91	CES85 = 79
CES11 = 58	CES36 = 95	CES61 = 84	CES86 = 71
CES12 = 64	CES37 = 80	CES62 = 88	CES87 = 79
CES13 = 43	CES38 = 88	CES63 = 73	CES88 = 81
CES14 = 74	CES39 = 96	CES64 = 69	CES89 = 71
CES15 = 71	CES40 = 91	CES65 = 66	CES90 = 80
CES16 = 47	CES41 = 91	CES66 = 62	CES91 = 81
CES17 = 50	CES42 = 81	CES67 = 60	CES92 = 63
CES18 = 56	CES43 = 77	CES68 = 68	CES93 = 78
CES19 = 72	CES44 = 99	CES69 = 76	CES94 = 56
CES20 = 65	CES45 = 85	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 82	CES71 = 55	CES96 = 79
CES22 = 79	CES47 = 83	CES72 = 85	CES97 = 84
CES23 = 92	CES48 = 75	CES73 = 52	CES98 = 77
CES24 = 91	CES49 = 79	CES74 = 96	CES99 = 68
CES25 = 72	CES50 = 87	CES75 = 57	

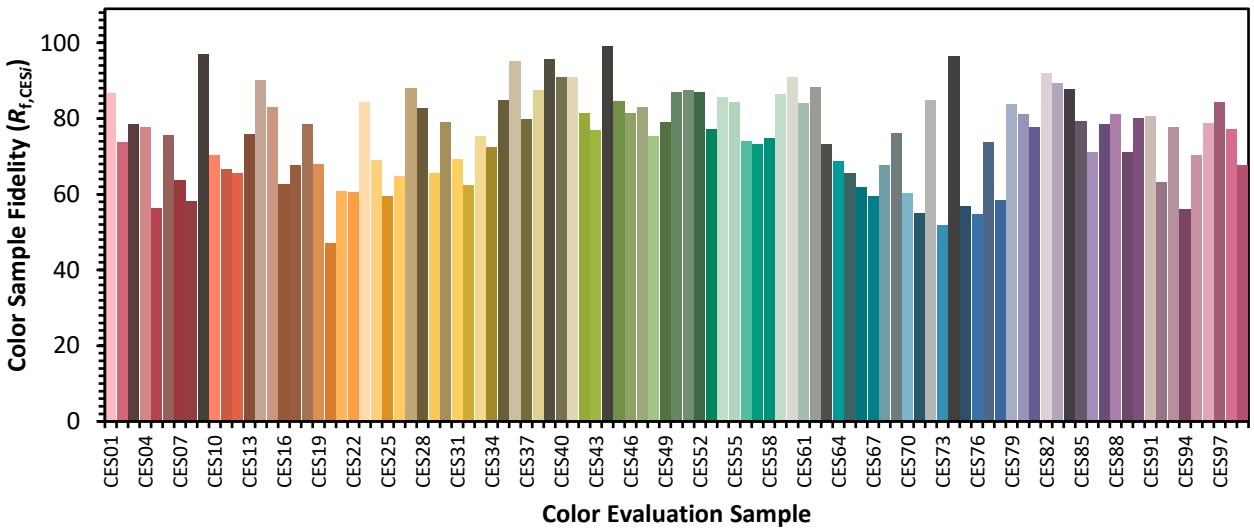



REPORT NUMBER: SP1-2407-176-4

TM-30-18

Color Rendition by Hue-Angle Bin

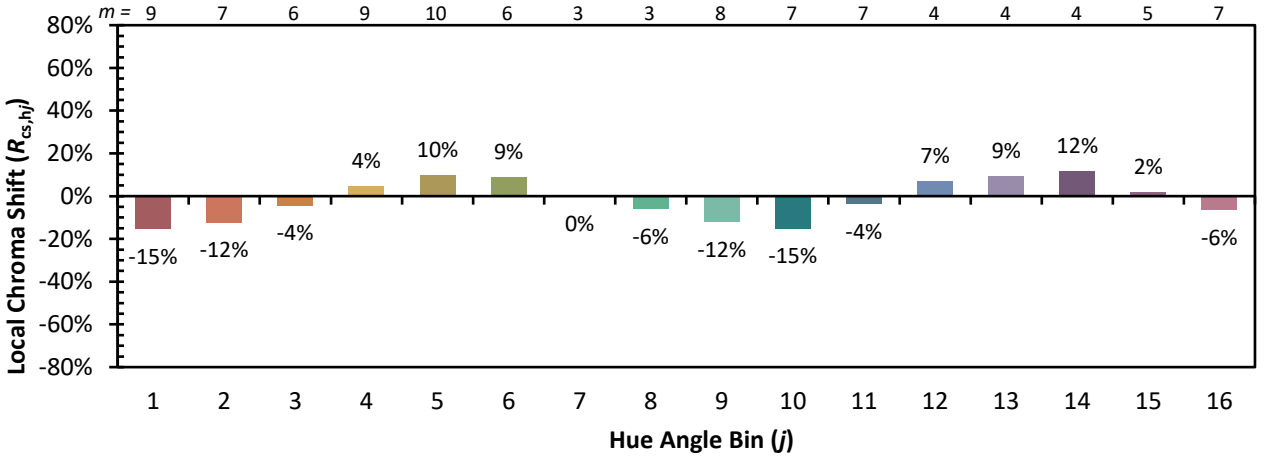

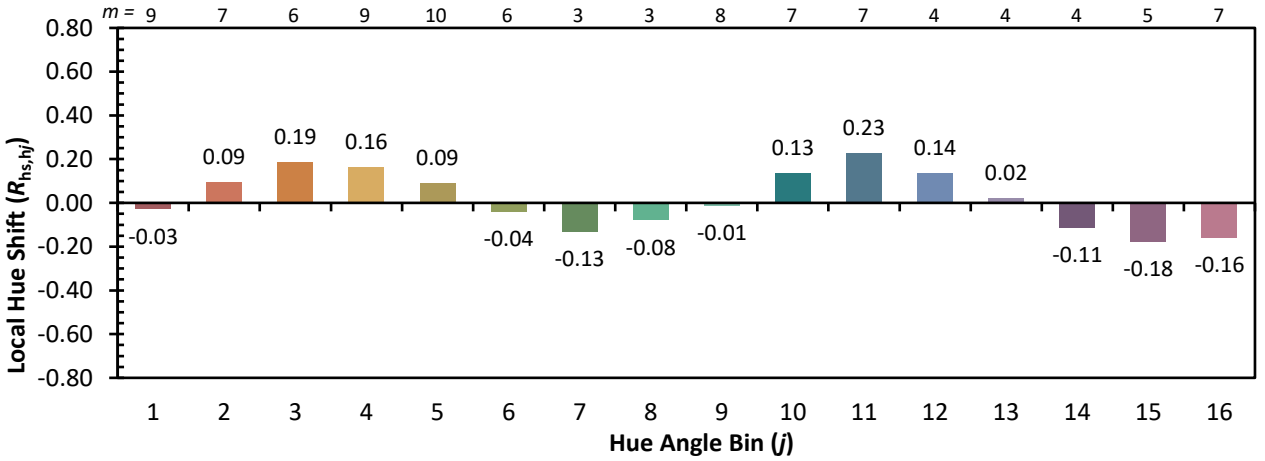


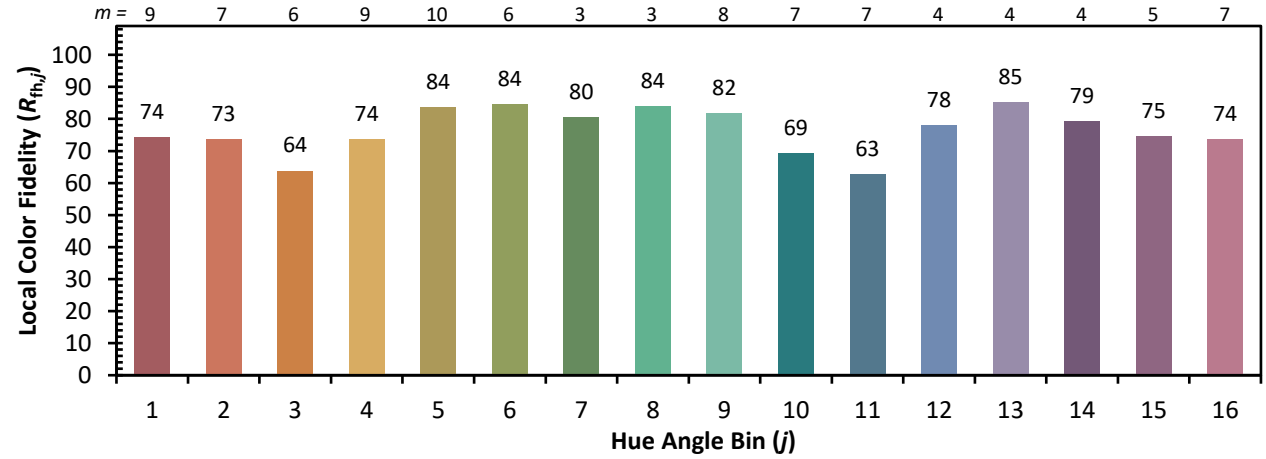


REPORT NUMBER: SP1-2407-176-4

TM-30-18

Measure Comparisons

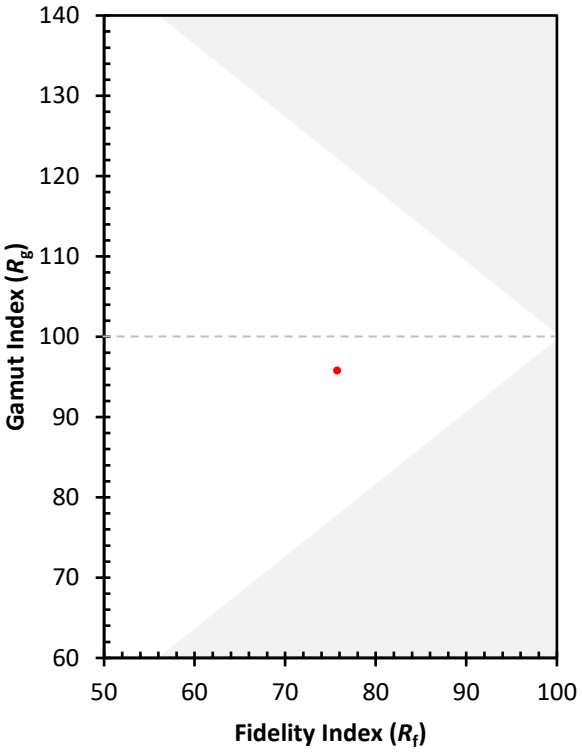

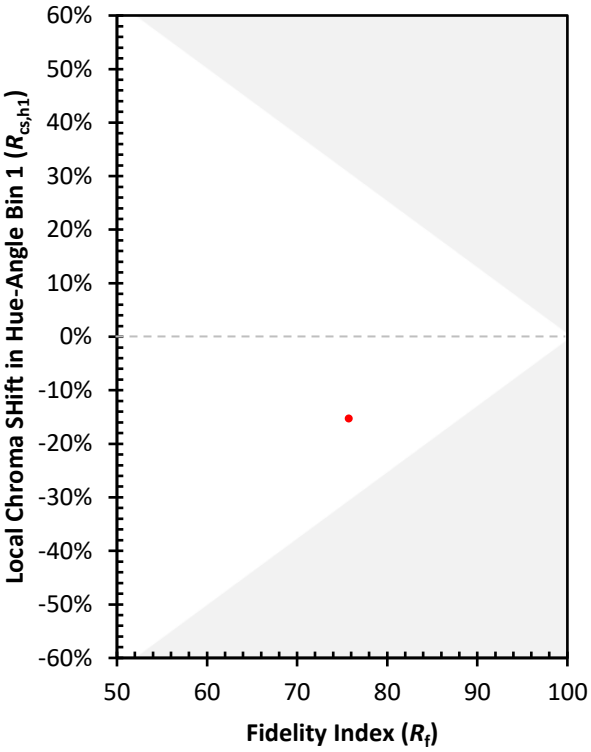

(END OF REPORT)