Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P821583

Luminaire Tested: **TT-D2-750-12VDC-RW-UPL**

Issue Date: 10/29/2020

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P821583
	REPORT IS FROM IESNA LM-79-08 TEST DATA - UPLIGHT (G2-2002-677-1) AND
Test Lab:	INNOVATION CENTER
Issue Date:	10/29/2020
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	TT-D2-750-12VDC-RW-UPL
Description:	TOPTIER LED PARKING GARAGE LUMINAIRE WITH UPLIGHT
	5000K, 70 CRI LEDS AND RECTANGULAR DISTRIBUTION
Light Source:	-
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	5104.7 lumens
Efficiency:	N/A
Efficacy:	134.3 lumens/watt
Luminous Opening:	Vertical Cylinder (Dia: 1.12' x H: 0.1')
IES Classification:	Type IV - Short
BUG Rating:	B3 - U4 - G3


Input Watts (W):	38
Input Voltage (V):	NR
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	25 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821583
CATALOG NUMBER: TT-D2-750-12VDC-RW-UPL

Iso-Footcandle Lines of Horizontal Illumination

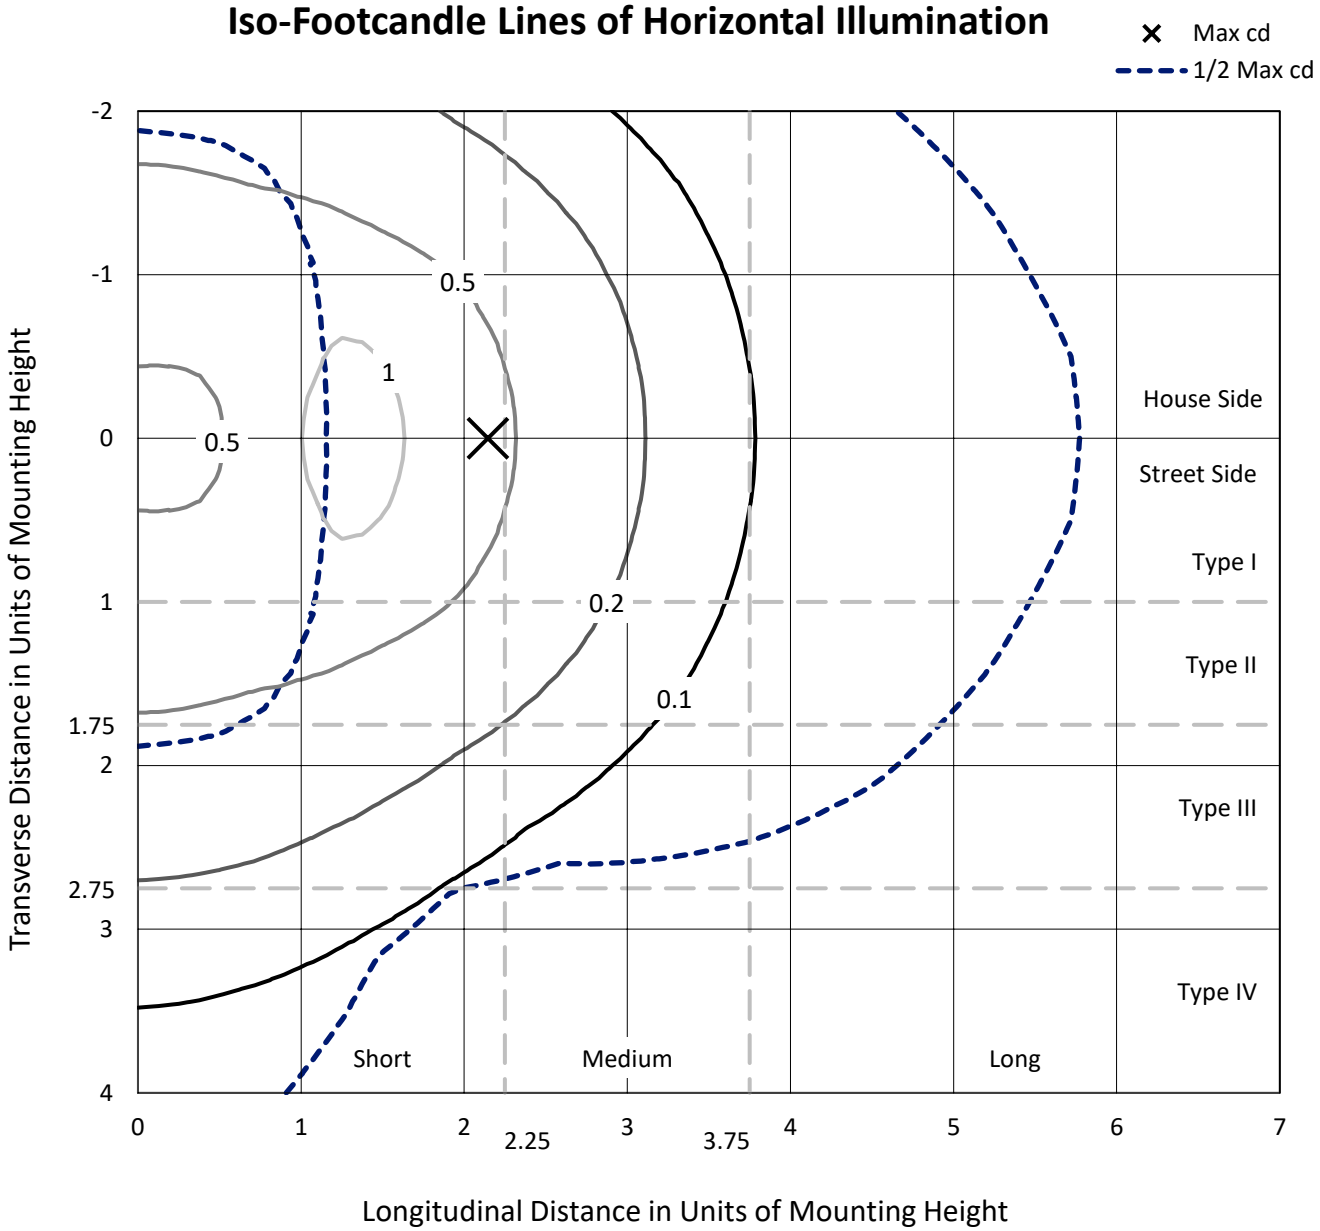


Based on 15 foot mounting height. Maximum calculated value = 1.3 fc
Type IV - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821583
CATALOG NUMBER: TT-D2-750-12VDC-RW-UPL

Luminous Intensity Polar Plot

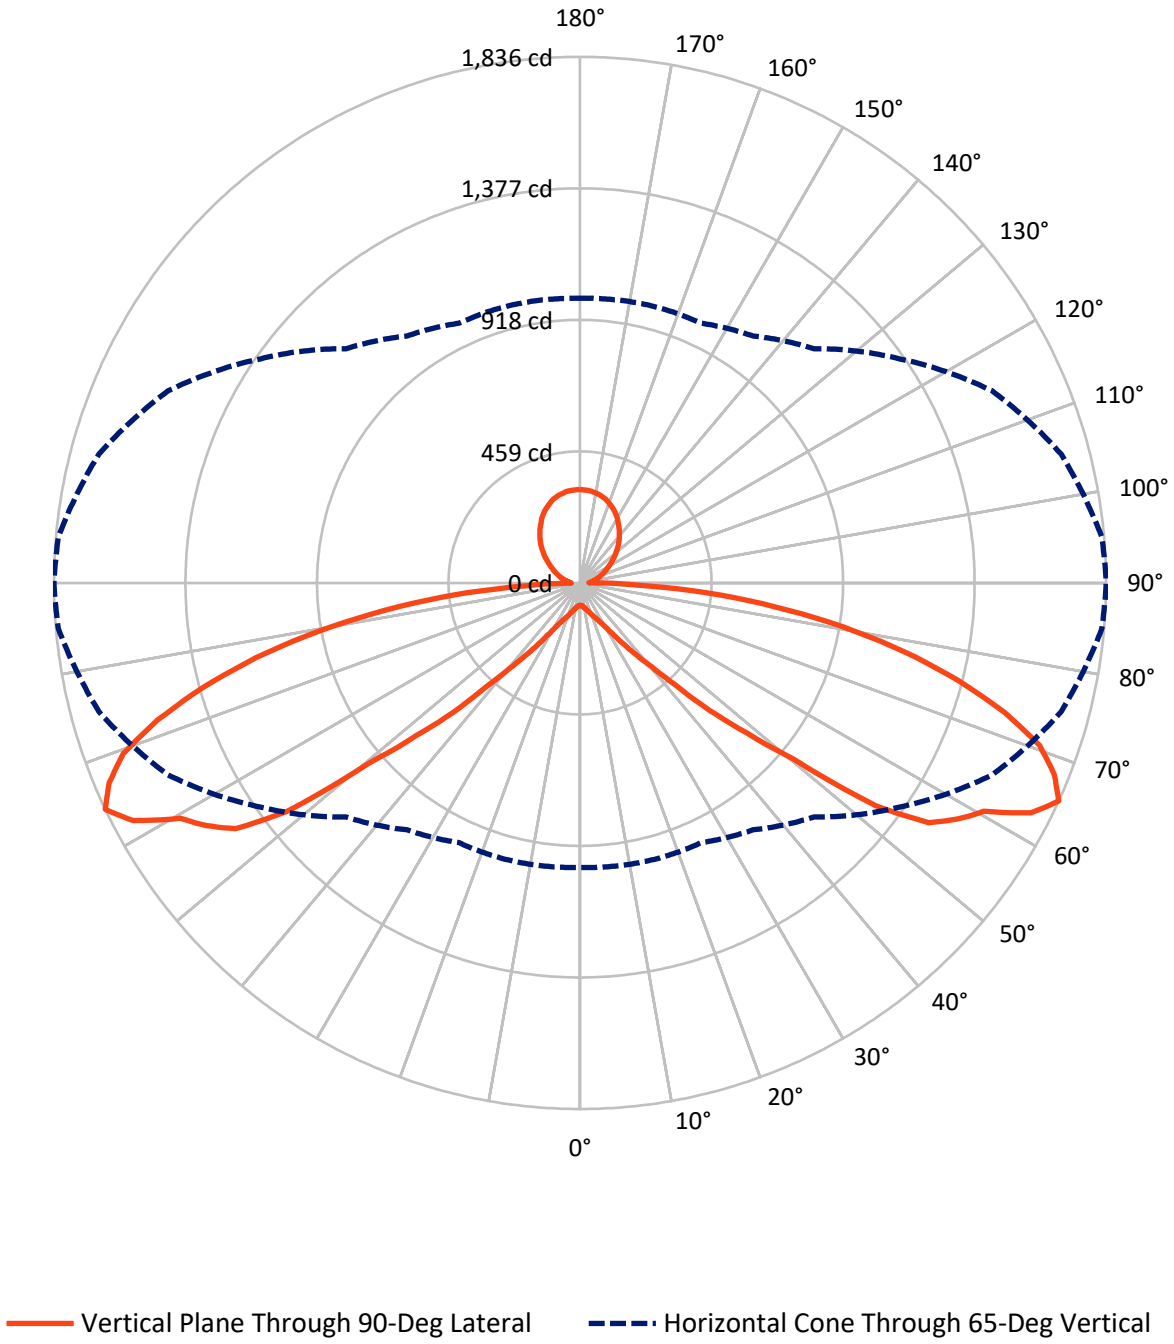

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P821583
CATALOG NUMBER: TT-D2-750-12VDC-RW-UPL

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	2109.6	442.7	2552.3
	% Fixture	41.3	8.7	50.0
Street Side	Lumens	2109.6	442.7	2552.3
	% Fixture	41.3	8.7	50.0
Total	Lumens	4219.2	885.5	5104.7
	% Fixture	82.7	17.3	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	8.0	0.2
10°-20°	30.1	0.6
20°-30°	69.4	1.4
30°-40°	157.0	3.1
40°-50°	382.6	7.5
50°-60°	860.3	16.9
60°-70°	1257.2	24.6
70°-80°	1095.5	21.5
80°-90°	359.1	7.0
90°-100°	45.4	0.9
100°-110°	70.3	1.4
110°-120°	97.7	1.9
120°-130°	126.6	2.5
130°-140°	147.6	2.9
140°-150°	149.5	2.9
150°-160°	129.8	2.5
160°-170°	87.7	1.7
170°-180°	30.8	0.6
0°-90°	4219.2	82.7
0°-180°	5104.7	100.0

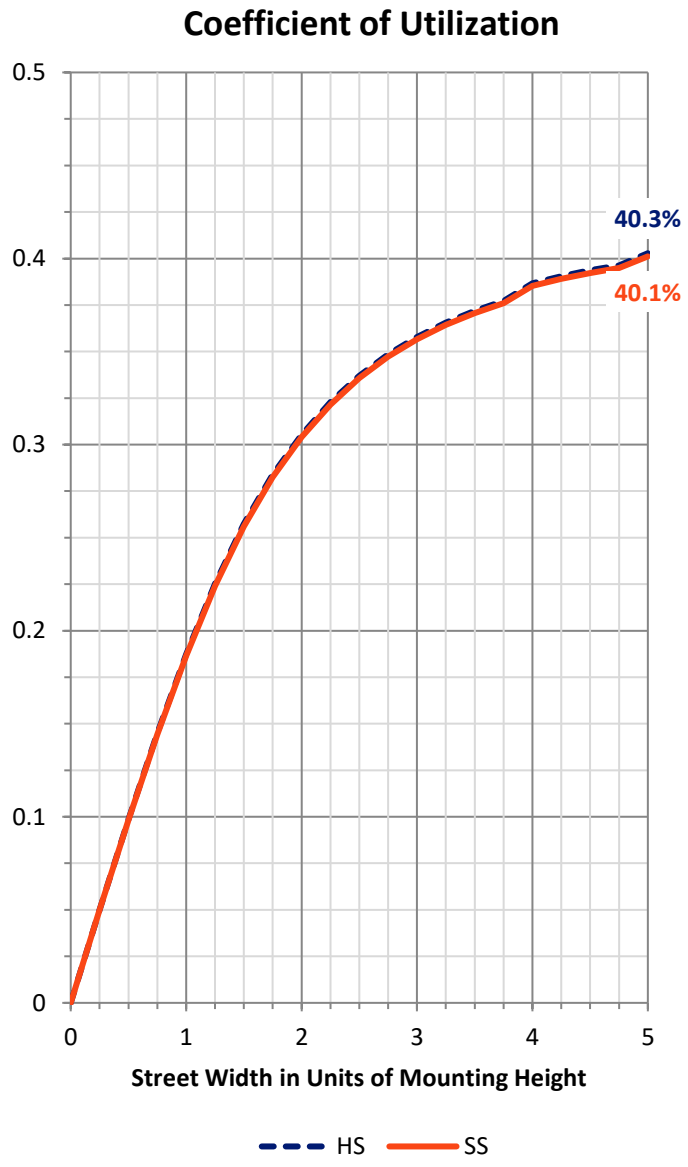

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P821583
CATALOG NUMBER: TT-D2-750-12VDC-RW-UPL

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	53.8	1.1			
FM	(30°-60°)	699.9	13.7			
FH	(60°-80°)	1176.4	23.0			G1/1800
FVH	(80°-90°)	179.6	3.5			G2/225
BL	(0°-30°)	53.8	1.1	B0/110		
BM	(30°-60°)	699.9	13.7	B1/1000		
BH	(60°-80°)	1176.4	23.0	B3/2500		G3/2500
BVH	(80°-90°)	179.6	3.5			G2/225
UL	(90°-100°)	45.4	0.9		U2/50	
UH	(100°-180°)	840.1	16.5		U4/1000	

BUG Rating: B3-U4-G3
Type IV Short

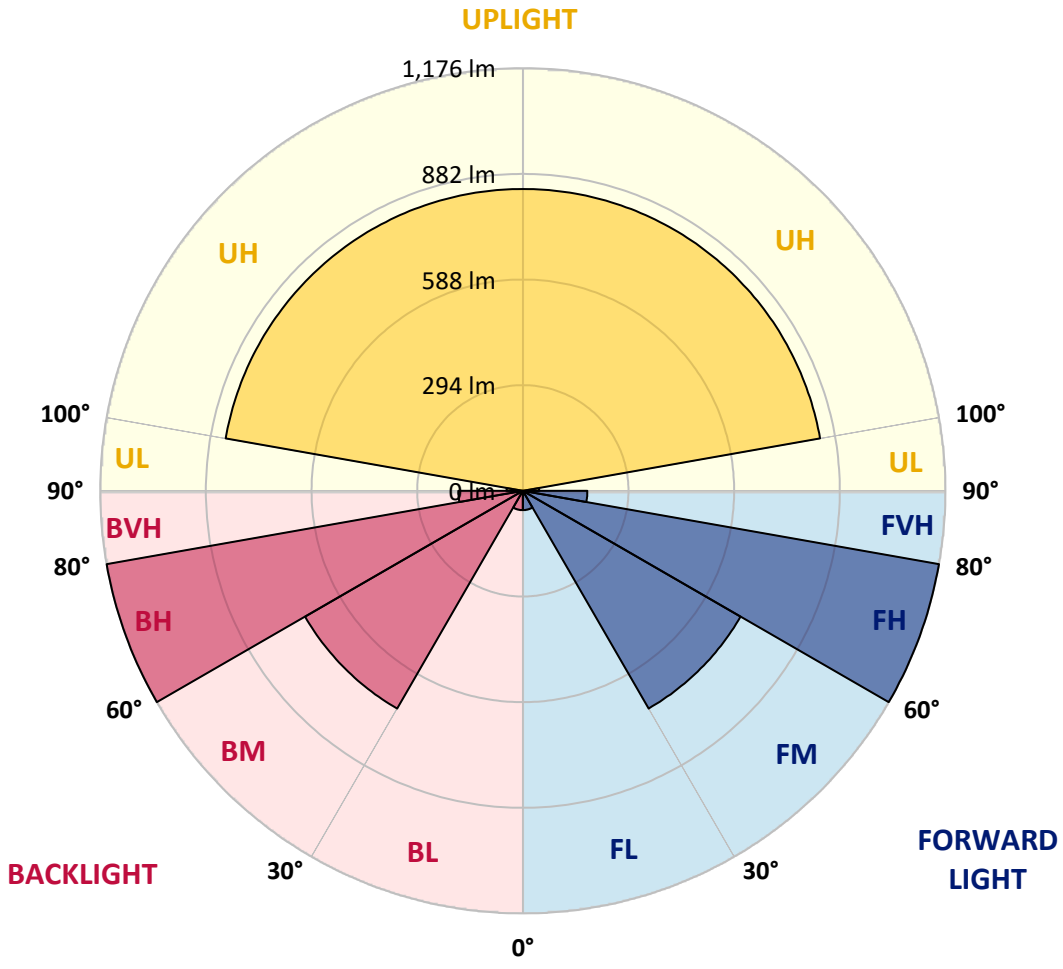

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821583
CATALOG NUMBER: TT-D2-750-12VDC-RW-UPL

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
0°	77.0	77.0	77.0	77.0	77.0	77.0	77.0	77.0	77.0	77.0	*77.0*
2.5°	78.0	78.0	79.0	79.0	79.0	79.0	79.0	79.0	79.0	79.0	*79.0*
5°	81.0	81.0	81.0	81.0	82.0	82.0	81.0	81.0	81.0	81.0	*81.0*
7.5°	86.0	85.0	86.0	86.0	86.0	85.0	85.0	85.0	84.0	84.0	*84.0*
10°	91.0	91.0	92.0	91.0	91.0	90.0	90.0	90.0	89.0	89.0	*89.0*
12.5°	98.0	98.0	98.0	98.0	97.0	97.0	96.0	95.0	94.0	94.0	*94.0*
15°	107.0	106.0	106.0	105.0	104.0	103.0	102.0	102.0	101.0	101.0	*101.0*
17.5°	116.0	116.0	115.0	114.0	112.0	111.0	111.0	110.0	109.0	109.0	*109.0*
20°	127.0	127.0	126.0	124.0	122.0	121.0	120.0	120.0	119.0	119.0	*119.0*
22.5°	140.0	139.0	137.0	135.0	133.0	132.0	131.0	130.0	130.0	130.0	*130.0*
25°	154.0	153.0	152.0	149.0	146.0	145.0	143.0	143.0	142.0	143.0	*143.0*
27.5°	171.0	170.0	168.0	165.0	161.0	159.0	158.0	158.0	159.0	159.0	*160.0*
30°	192.0	190.0	188.0	184.0	180.0	177.0	177.0	178.0	181.0	183.0	*183.0*
32.5°	217.0	216.0	213.0	209.0	202.0	200.0	202.0	208.0	212.0	215.0	*217.0*
35°	246.0	245.0	241.0	234.0	229.0	228.0	234.0	244.0	257.0	261.0	*263.0*
37.5°	278.0	279.0	274.0	266.0	261.0	263.0	275.0	294.0	307.0	316.0	*318.0*
40°	318.0	320.0	314.0	305.0	300.0	308.0	327.0	349.0	372.0	383.0	*386.0*
42.5°	365.0	368.0	360.0	351.0	348.0	361.0	388.0	424.0	465.1	478.1	*483.1*
45°	423.0	425.0	415.0	407.0	405.0	428.0	474.1	534.1	599.1	629.1	*634.1*
47.5°	492.1	491.1	482.1	472.1	474.1	507.1	576.1	657.1	726.1	772.1	*782.1*
50°	571.1	566.1	559.1	547.1	560.1	608.1	695.1	793.1	909.1	950.1	*968.1*
52.5°	650.1	641.1	635.1	627.1	650.1	712.1	834.1	1005.1	1180.1	1274.1	*1293.1*
55°	721.1	714.1	711.1	712.1	748.1	837.1	997.1	1216.1	1385.2	1463.2	*1477.2*
57.5°	791.1	787.1	784.1	790.1	847.1	963.1	1143.1	1348.2	1487.2	1545.2	*1555.2*
60°	857.1	861.1	859.1	877.1	946.1	1063.1	1219.1	1421.2	1555.2	1608.2	*1619.2*
62.5°	930.1	933.1	933.1	953.1	1009.1	1112.1	1271.1	1507.2	1677.2	1755.2	*1767.2*
65°	*993.1*	*995.1*	*999.1*	*1000.1*	*1052.1*	*1155.1*	*1363.2*	*1586.2*	*1738.2*	*1828.2*	*1836.2*
67.5°	1040.1	1042.1	1037.1	1032.1	1072.1	1165.1	1356.2	1576.2	1711.2	1779.2	*1785.2*
70°	1078.1	1069.1	1055.1	1030.1	1043.1	1113.1	1298.1	1496.2	1632.2	1693.2	*1702.2*
72.5°	1083.1	1075.1	1031.1	975.1	959.1	1020.1	1196.1	1374.2	1491.2	1549.2	*1550.2*
75°	1053.1	1032.1	959.1	875.1	845.1	903.1	1054.1	1216.1	1310.1	1359.2	*1364.2*
77.5°	952.1	932.1	840.1	744.1	710.1	760.1	888.1	1019.1	1109.1	1157.1	*1160.1*
80°	773.1	766.1	682.1	594.1	553.1	582.1	694.1	797.1	870.1	927.1	*932.1*
82.5°	570.1	564.1	500.1	423.0	390.0	414.0	494.1	570.1	638.1	684.1	*687.1*
85°	356.0	344.0	304.0	250.0	228.0	244.0	297.0	348.0	409.0	445.1	*447.1*
87.5°	119.0	114.0	98.0	81.0	68.0	71.0	87.0	106.0	155.0	171.0	*181.0*
90°	32.0	31.0	31.0	31.0	31.0	31.0	31.0	31.0	31.0	31.0	*31.0*
92.5°	37.0	37.0	36.0	36.0	36.0	36.0	36.0	36.0	36.0	36.0	*36.0*
95°	42.0	42.0	42.0	41.0	41.0	41.0	41.0	41.0	41.0	41.0	*41.0*
97.5°	48.0	48.0	47.0	47.0	47.0	47.0	47.0	47.0	47.0	47.0	*47.0*
100°	53.0	53.0	53.0	53.0	53.0	53.0	53.0	53.0	53.0	53.0	*53.0*
102.5°	60.0	59.0	60.0	60.0	59.0	59.0	59.0	60.0	60.0	60.0	*59.0*
105°	66.0	66.0	66.0	66.0	66.0	66.0	66.0	67.0	66.0	66.0	*66.0*
107.5°	73.0	73.0	73.0	74.0	74.0	74.0	74.0	74.0	73.0	74.0	*73.0*
110°	80.0	80.0	81.0	81.0	81.0	81.0	81.0	81.0	81.0	81.0	*81.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821583
CATALOG NUMBER: TT-D2-750-12VDC-RW-UPL

CANDELA DISTRIBUTION (continued):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
112.5°	89.0	89.0	89.0	89.0	89.0	90.0	90.0	90.0	90.0	90.0	*89.0*
115°	97.0	97.0	98.0	98.0	98.0	98.0	99.0	99.0	98.0	98.0	*98.0*
117.5°	107.0	107.0	107.0	107.0	107.0	108.0	108.0	108.0	108.0	108.0	*107.0*
120°	117.0	117.0	117.0	118.0	118.0	118.0	119.0	119.0	118.0	118.0	*118.0*
122.5°	129.0	128.0	129.0	129.0	129.0	129.0	130.0	130.0	130.0	130.0	*129.0*
125°	140.0	140.0	141.0	141.0	141.0	141.0	142.0	142.0	142.0	142.0	*141.0*
127.5°	153.0	153.0	153.0	153.0	153.0	154.0	154.0	154.0	154.0	154.0	*154.0*
130°	165.0	165.0	166.0	166.0	166.0	166.0	167.0	167.0	167.0	167.0	*166.0*
132.5°	179.0	178.0	179.0	178.0	178.0	179.0	179.0	180.0	179.0	180.0	*179.0*
135°	191.0	191.0	191.0	191.0	191.0	192.0	192.0	192.0	192.0	192.0	*192.0*
137.5°	204.0	203.0	204.0	203.0	203.0	204.0	204.0	204.0	204.0	204.0	*204.0*
140°	216.0	215.0	216.0	215.0	216.0	216.0	216.0	216.0	216.0	216.0	*216.0*
142.5°	228.0	227.0	228.0	227.0	227.0	228.0	228.0	228.0	228.0	228.0	*228.0*
145°	239.0	239.0	239.0	238.0	239.0	239.0	239.0	239.0	239.0	239.0	*239.0*
147.5°	250.0	249.0	250.0	249.0	249.0	250.0	250.0	250.0	250.0	250.0	*250.0*
150°	263.0	262.0	263.0	262.0	263.0	263.0	263.0	263.0	263.0	263.0	*263.0*
152.5°	273.0	273.0	273.0	273.0	273.0	273.0	273.0	273.0	273.0	273.0	*273.0*
155°	282.0	282.0	283.0	282.0	282.0	282.0	283.0	282.0	282.0	282.0	*282.0*
157.5°	290.0	290.0	290.0	290.0	290.0	290.0	291.0	291.0	290.0	291.0	*290.0*
160°	298.0	298.0	299.0	298.0	298.0	298.0	299.0	298.0	298.0	298.0	*298.0*
162.5°	306.0	305.0	306.0	305.0	306.0	306.0	306.0	306.0	306.0	306.0	*306.0*
165°	311.0	311.0	312.0	311.0	311.0	311.0	312.0	311.0	311.0	311.0	*311.0*
167.5°	316.0	315.0	316.0	316.0	316.0	316.0	316.0	316.0	316.0	316.0	*316.0*
170°	319.0	319.0	320.0	319.0	319.0	319.0	320.0	319.0	319.0	319.0	*319.0*
172.5°	323.0	323.0	323.0	323.0	323.0	323.0	323.0	323.0	323.0	323.0	*323.0*
175°	324.0	324.0	325.0	324.0	325.0	324.0	325.0	324.0	324.0	324.0	*324.0*
177.5°	325.0	325.0	326.0	325.0	325.0	325.0	325.0	325.0	325.0	325.0	*325.0*
180°	326.0	326.0	326.0	326.0	326.0	326.0	326.0	326.0	326.0	326.0	*326.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Streetworks

Report Number: SP1-2407-176-6

Test Date: 09/26/2024

Luminaire Tested: MEM2-HTN-VA-30-750-U-WQ

Data in this report applies to families of products including MEM2-HTN-VA-30-750-U-WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-176-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	09/27/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	Streetworks
Catalog Number:	**MEM2-HTN-VA-30-750-U-WQ**
Description:	EPIC MODERN VISUAL COMFORT 30W WAVESTREAM WIDE

Spectral Parameters

CCT (K):	4786
CIE u':	0.2093
CIE v':	0.4953
Duv:	0.0066
CIE x:	0.3533
CIE y:	0.3716
CIE z:	0.2751
Peak Wavelength (nm):	449
Dominant Wavelength (nm):	570
Purity:	17.53512
Rf:	73
Rg:	94.6

CRI (Ra):	70.9				
R1:	67.8	R9:	-29.8		
R2:	75.1	R10:	40.9		
R3:	80.6	R11:	67.4		
R4:	71.6	R12:	35.3		
R5:	67.8	R13:	68.5		
R6:	65.4	R14:	89.0		
R7:	82.0	R15:	60.9		
R8:	57.0				

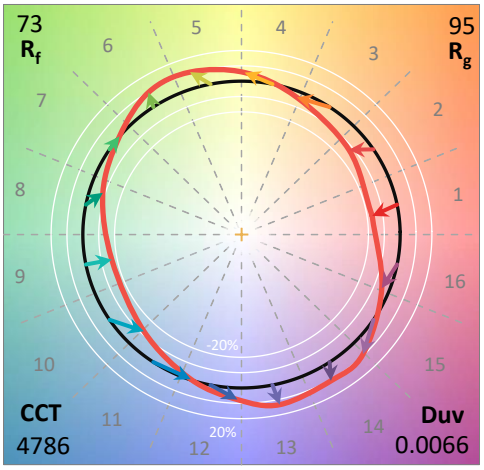

Test Conditions


Stabilization Time:	45M
Operation Time:	1H 45M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-176-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-176-6

CIE 1931 Chromaticity Diagram

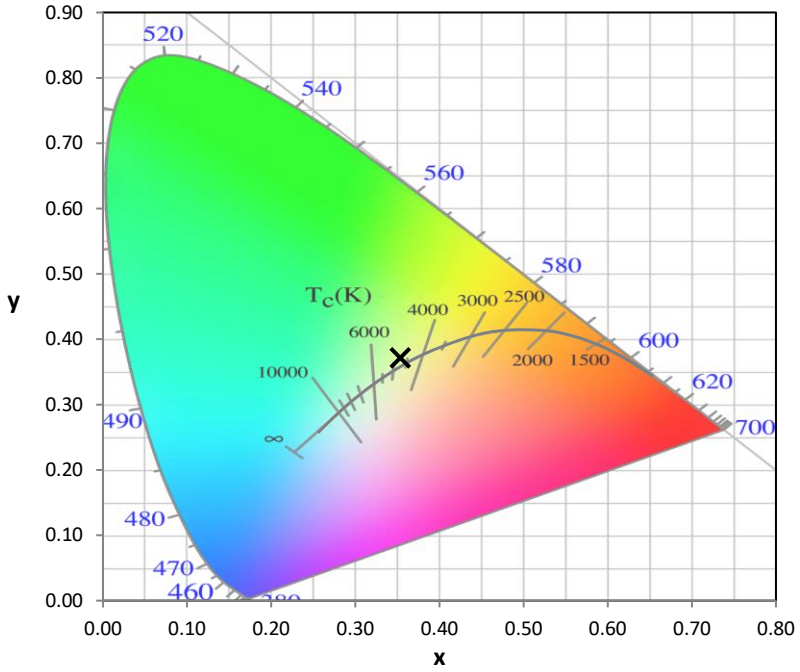

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

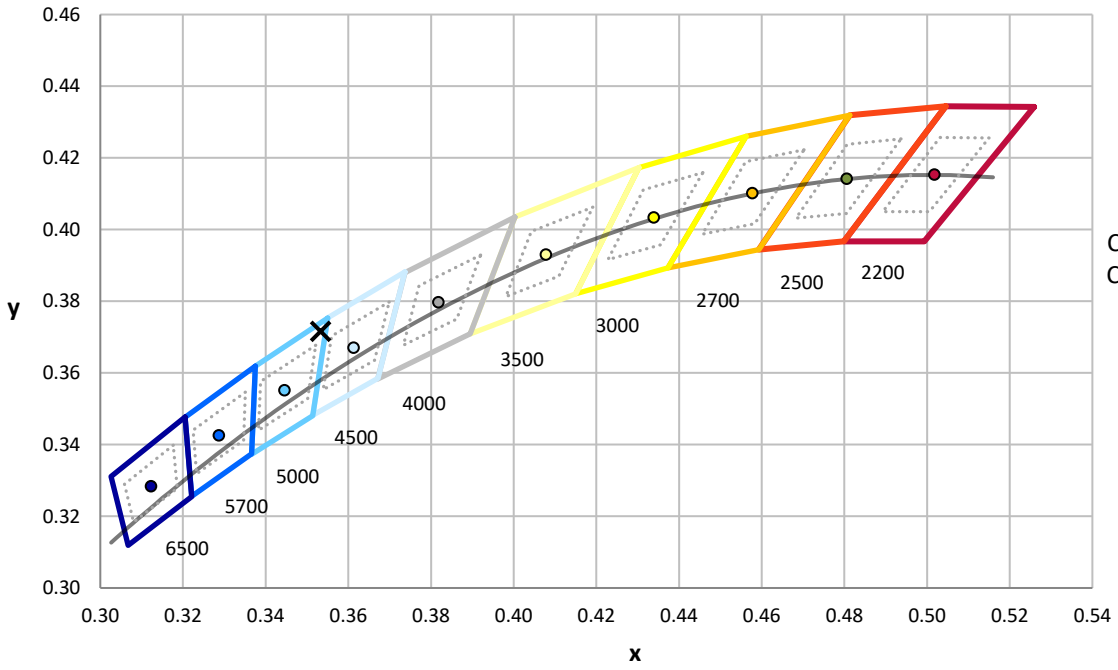


CCT = 4786K
CIE x = 0.3533
CIE y = 0.3716
Duv = 0.0066

Point lies inside the ANSI 5000K 7-step quadrangle

REPORT NUMBER: SP1-2407-176-6

Photopic Flux vs. Wavelength

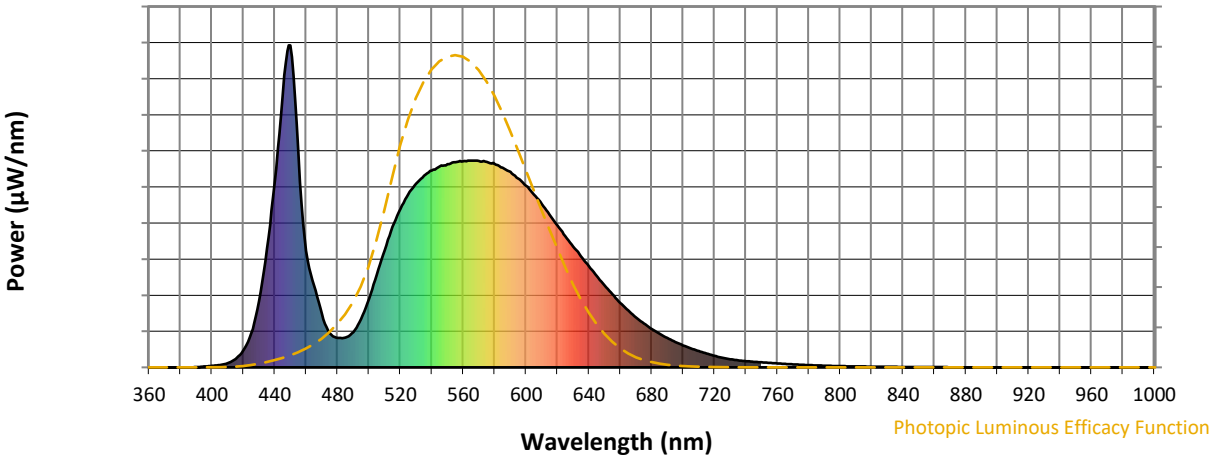


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	110	NR	620	440	NR	750	16	NR	880	0	NR
365	0	NR	495	150	NR	625	407	NR	755	14	NR	885	0	NR
370	0	NR	500	213	NR	630	375	NR	760	12	NR	890	0	NR
375	0	NR	505	288	NR	635	345	NR	765	11	NR	895	0	NR
380	0	NR	510	364	NR	640	314	NR	770	9	NR	900	0	NR
385	0	NR	515	436	NR	645	283	NR	775	8	NR	905	0	NR
390	1	NR	520	492	NR	650	254	NR	780	7	NR	910	0	NR
395	3	NR	525	537	NR	655	227	NR	785	6	NR	915	0	NR
400	5	NR	530	570	NR	660	200	NR	790	5	NR	920	0	NR
405	7	NR	535	595	NR	665	177	NR	795	4	NR	925	0	NR
410	13	NR	540	611	NR	670	155	NR	800	4	NR	930	0	NR
415	25	NR	545	624	NR	675	136	NR	805	3	NR	935	0	NR
420	52	NR	550	631	NR	680	119	NR	810	3	NR	940	0	NR
425	106	NR	555	637	NR	685	104	NR	815	3	NR	945	0	NR
430	204	NR	560	640	NR	690	91	NR	820	2	NR	950	0	NR
435	369	NR	565	642	NR	695	79	NR	825	2	NR	955	0	NR
440	573	NR	570	641	NR	700	68	NR	830	2	NR	960	0	NR
445	844	NR	575	638	NR	705	59	NR	835	2	NR	965	0	NR
450	999	NR	580	632	NR	710	50	NR	840	1	NR	970	0	NR
455	668	NR	585	620	NR	715	43	NR	845	1	NR	975	0	NR
460	361	NR	590	607	NR	720	36	NR	850	1	NR	980	0	NR
465	255	NR	595	586	NR	725	30	NR	855	1	NR	985	0	NR
470	165	NR	600	564	NR	730	25	NR	860	1	NR	990	0	NR
475	106	NR	605	537	NR	735	22	NR	865	1	NR	995	0	NR
480	91	NR	610	507	NR	740	19	NR	870	0	NR	1000	0	NR
485	93	NR	615	474	NR	745	17	NR	875	0	NR			

REPORT NUMBER: SP1-2407-176-6

Scotopic Flux vs. Wavelength

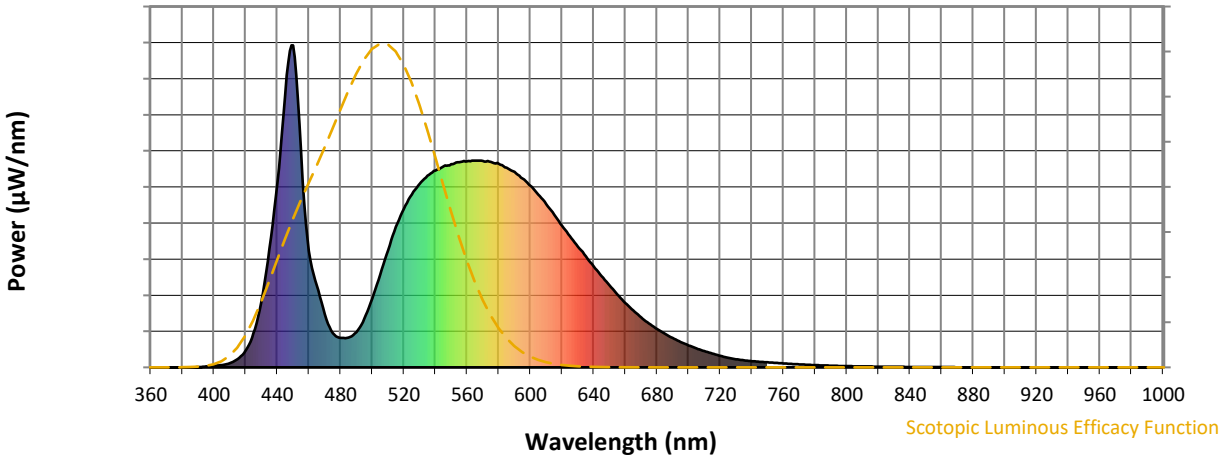


Scotopic Lumens: NR **S/P: 1.69**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	110	NR	620	440	NR	750	16	NR	880	0	NR
365	0	NR	495	150	NR	625	407	NR	755	14	NR	885	0	NR
370	0	NR	500	213	NR	630	375	NR	760	12	NR	890	0	NR
375	0	NR	505	288	NR	635	345	NR	765	11	NR	895	0	NR
380	0	NR	510	364	NR	640	314	NR	770	9	NR	900	0	NR
385	0	NR	515	436	NR	645	283	NR	775	8	NR	905	0	NR
390	1	NR	520	492	NR	650	254	NR	780	7	NR	910	0	NR
395	3	NR	525	537	NR	655	227	NR	785	6	NR	915	0	NR
400	5	NR	530	570	NR	660	200	NR	790	5	NR	920	0	NR
405	7	NR	535	595	NR	665	177	NR	795	4	NR	925	0	NR
410	13	NR	540	611	NR	670	155	NR	800	4	NR	930	0	NR
415	25	NR	545	624	NR	675	136	NR	805	3	NR	935	0	NR
420	52	NR	550	631	NR	680	119	NR	810	3	NR	940	0	NR
425	106	NR	555	637	NR	685	104	NR	815	3	NR	945	0	NR
430	204	NR	560	640	NR	690	91	NR	820	2	NR	950	0	NR
435	369	NR	565	642	NR	695	79	NR	825	2	NR	955	0	NR
440	573	NR	570	641	NR	700	68	NR	830	2	NR	960	0	NR
445	844	NR	575	638	NR	705	59	NR	835	2	NR	965	0	NR
450	999	NR	580	632	NR	710	50	NR	840	1	NR	970	0	NR
455	668	NR	585	620	NR	715	43	NR	845	1	NR	975	0	NR
460	361	NR	590	607	NR	720	36	NR	850	1	NR	980	0	NR
465	255	NR	595	586	NR	725	30	NR	855	1	NR	985	0	NR
470	165	NR	600	564	NR	730	25	NR	860	1	NR	990	0	NR
475	106	NR	605	537	NR	735	22	NR	865	1	NR	995	0	NR
480	91	NR	610	507	NR	740	19	NR	870	0	NR	1000	0	NR
485	93	NR	615	474	NR	745	17	NR	875	0	NR			

REPORT NUMBER: SP1-2407-176-6

Melanopic Flux vs. Wavelength

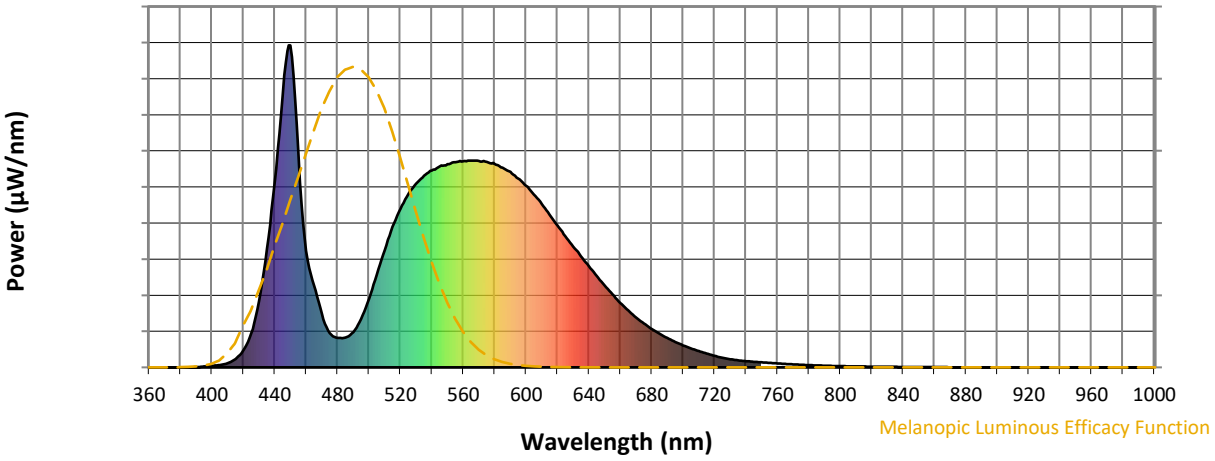

Melanopic Lumens: NR **M/P: 3.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	110	NR	620	440	NR	750	16	NR	880	0	NR
365	0	NR	495	150	NR	625	407	NR	755	14	NR	885	0	NR
370	0	NR	500	213	NR	630	375	NR	760	12	NR	890	0	NR
375	0	NR	505	288	NR	635	345	NR	765	11	NR	895	0	NR
380	0	NR	510	364	NR	640	314	NR	770	9	NR	900	0	NR
385	0	NR	515	436	NR	645	283	NR	775	8	NR	905	0	NR
390	1	NR	520	492	NR	650	254	NR	780	7	NR	910	0	NR
395	3	NR	525	537	NR	655	227	NR	785	6	NR	915	0	NR
400	5	NR	530	570	NR	660	200	NR	790	5	NR	920	0	NR
405	7	NR	535	595	NR	665	177	NR	795	4	NR	925	0	NR
410	13	NR	540	611	NR	670	155	NR	800	4	NR	930	0	NR
415	25	NR	545	624	NR	675	136	NR	805	3	NR	935	0	NR
420	52	NR	550	631	NR	680	119	NR	810	3	NR	940	0	NR
425	106	NR	555	637	NR	685	104	NR	815	3	NR	945	0	NR
430	204	NR	560	640	NR	690	91	NR	820	2	NR	950	0	NR
435	369	NR	565	642	NR	695	79	NR	825	2	NR	955	0	NR
440	573	NR	570	641	NR	700	68	NR	830	2	NR	960	0	NR
445	844	NR	575	638	NR	705	59	NR	835	2	NR	965	0	NR
450	999	NR	580	632	NR	710	50	NR	840	1	NR	970	0	NR
455	668	NR	585	620	NR	715	43	NR	845	1	NR	975	0	NR
460	361	NR	590	607	NR	720	36	NR	850	1	NR	980	0	NR
465	255	NR	595	586	NR	725	30	NR	855	1	NR	985	0	NR
470	165	NR	600	564	NR	730	25	NR	860	1	NR	990	0	NR
475	106	NR	605	537	NR	735	22	NR	865	1	NR	995	0	NR
480	91	NR	610	507	NR	740	19	NR	870	0	NR	1000	0	NR
485	93	NR	615	474	NR	745	17	NR	875	0	NR			


REPORT NUMBER: SP1-2407-176-6

TM-30-18


Summary


R_f = 73
R_g = 94.6
CIE R_a = 70.9
R_9 = -29.8


Spectral Power Distribution Comparison

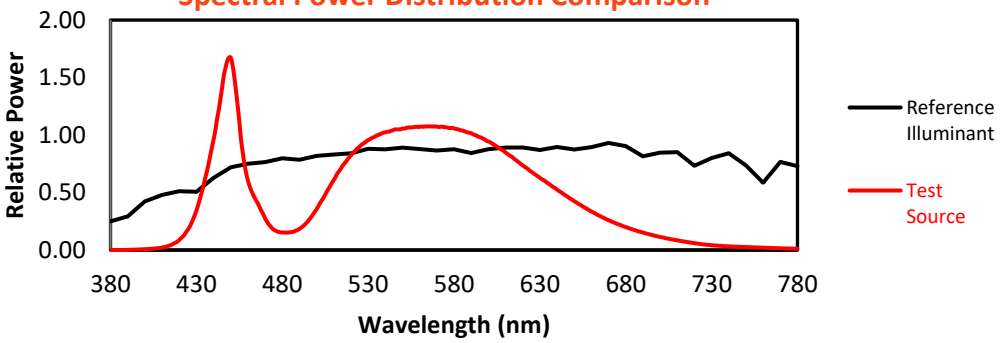


Color Vector Graphics

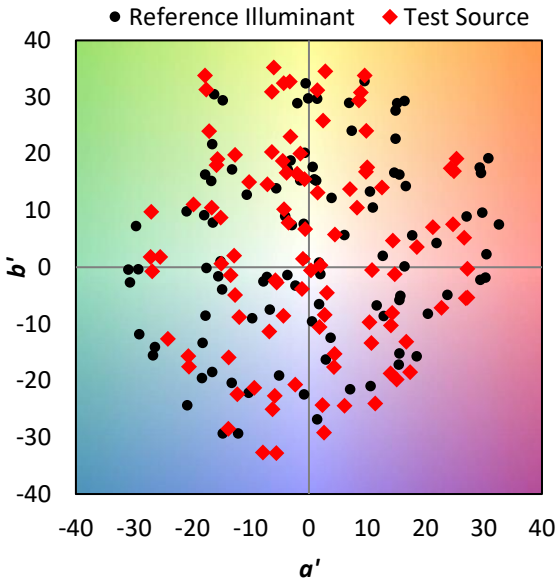

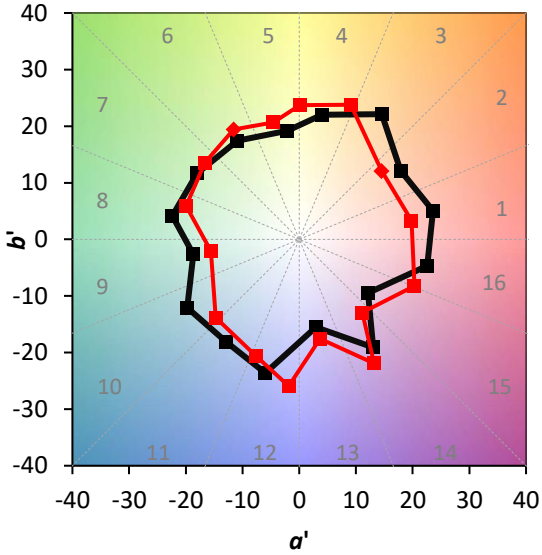

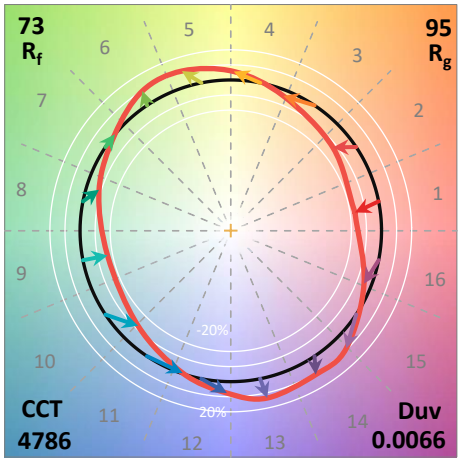

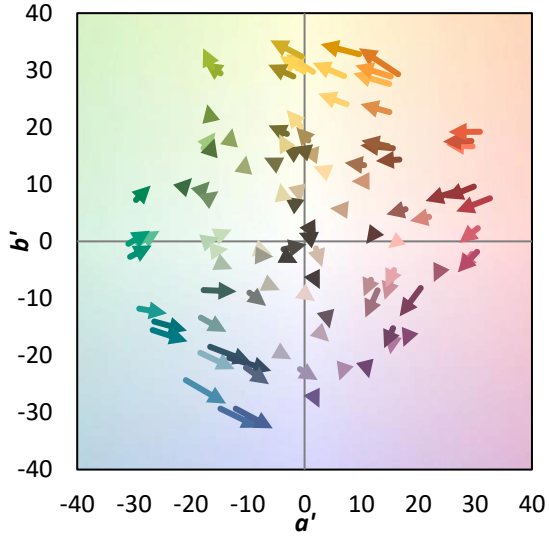


REPORT NUMBER: SP1-2407-176-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 60	CES51 = 89	CES76 = 46
CES02 = 59	CES27 = 86	CES52 = 88	CES77 = 65
CES03 = 30	CES28 = 78	CES53 = 76	CES78 = 49
CES04 = 69	CES29 = 62	CES54 = 83	CES79 = 78
CES05 = 46	CES30 = 79	CES55 = 82	CES80 = 74
CES06 = 50	CES31 = 66	CES56 = 71	CES81 = 77
CES07 = 39	CES32 = 58	CES57 = 70	CES82 = 89
CES08 = 38	CES33 = 74	CES58 = 71	CES83 = 87
CES09 = 29	CES34 = 66	CES59 = 86	CES84 = 86
CES10 = 72	CES35 = 81	CES60 = 90	CES85 = 79
CES11 = 56	CES36 = 94	CES61 = 84	CES86 = 76
CES12 = 61	CES37 = 75	CES62 = 84	CES87 = 76
CES13 = 41	CES38 = 88	CES63 = 72	CES88 = 79
CES14 = 74	CES39 = 95	CES64 = 66	CES89 = 73
CES15 = 70	CES40 = 88	CES65 = 61	CES90 = 78
CES16 = 46	CES41 = 92	CES66 = 58	CES91 = 77
CES17 = 49	CES42 = 75	CES67 = 55	CES92 = 63
CES18 = 55	CES43 = 74	CES68 = 65	CES93 = 77
CES19 = 71	CES44 = 99	CES69 = 74	CES94 = 56
CES20 = 64	CES45 = 83	CES70 = 55	CES95 = 67
CES21 = 85	CES46 = 82	CES71 = 47	CES96 = 76
CES22 = 77	CES47 = 84	CES72 = 82	CES97 = 83
CES23 = 91	CES48 = 76	CES73 = 44	CES98 = 73
CES24 = 90	CES49 = 80	CES74 = 92	CES99 = 62
CES25 = 71	CES50 = 88	CES75 = 47	

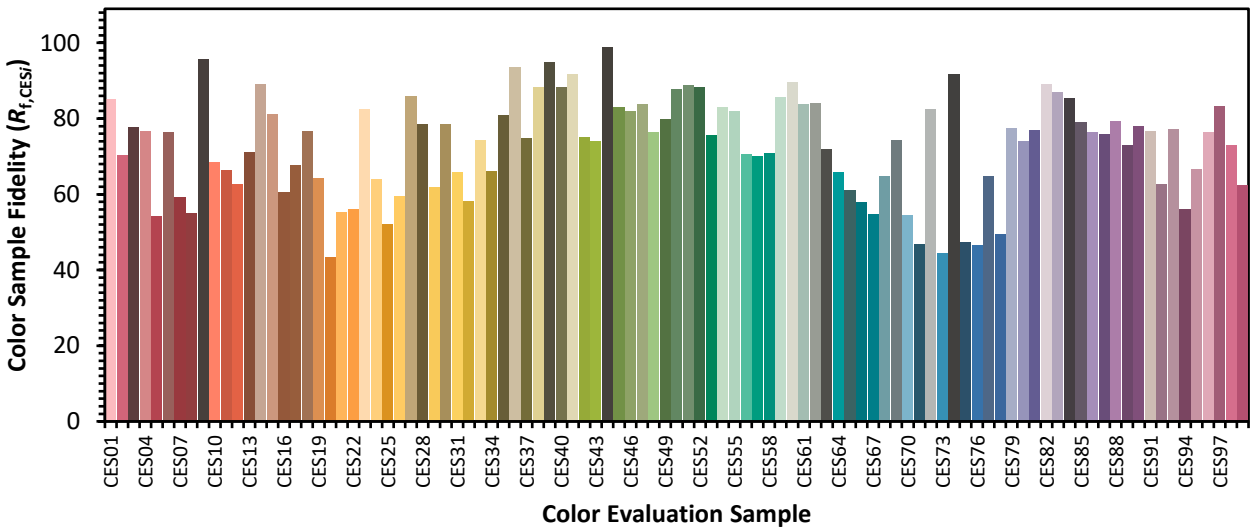



REPORT NUMBER: SP1-2407-176-6

TM-30-18

Color Rendition by Hue-Angle Bin

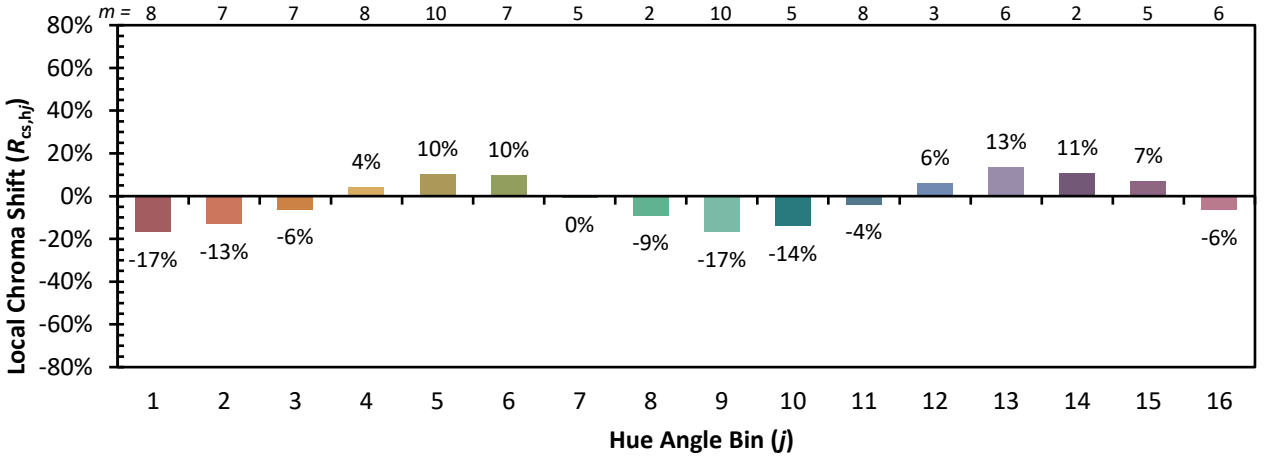

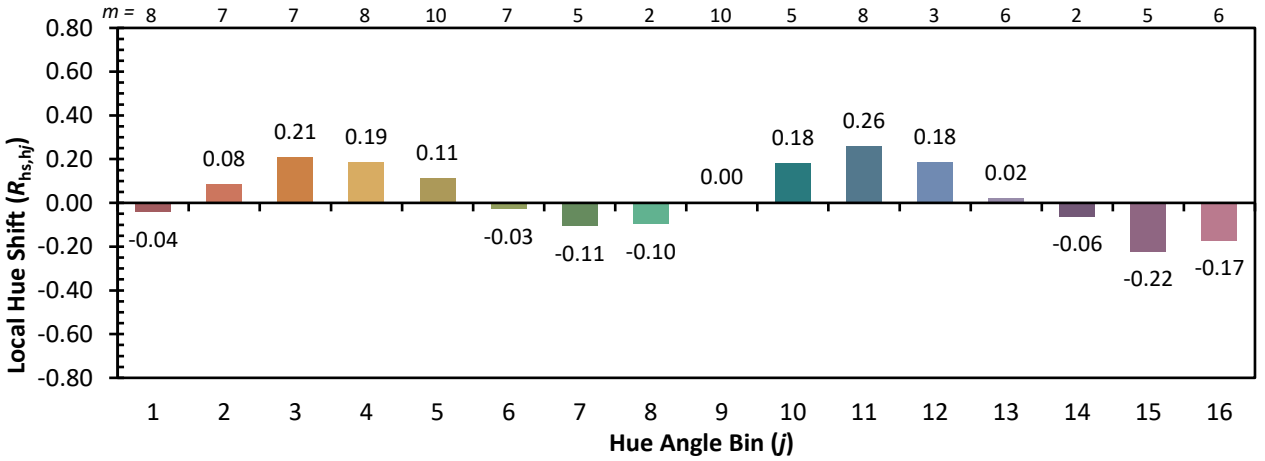


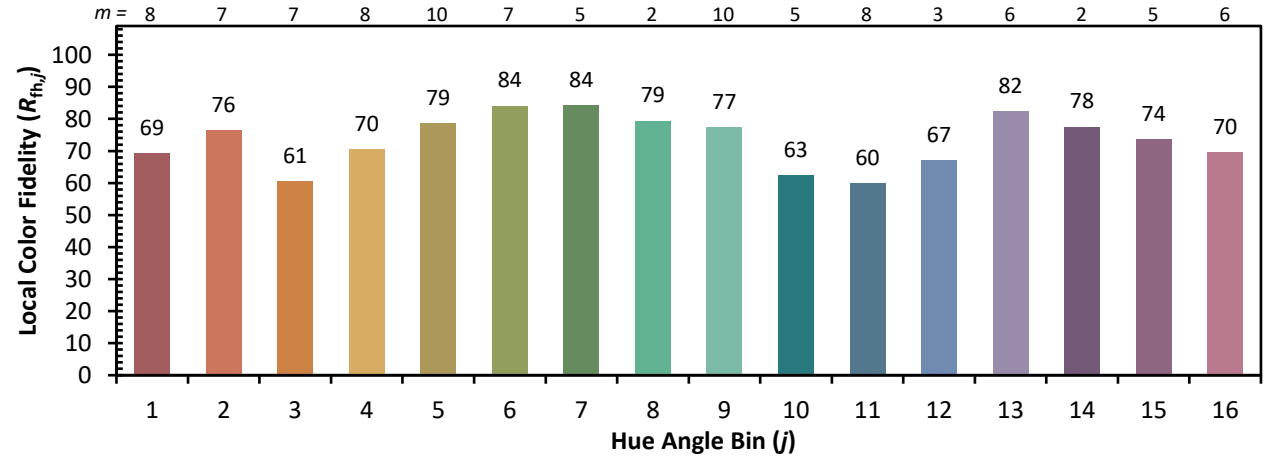


REPORT NUMBER: SP1-2407-176-6

TM-30-18

Measure Comparisons

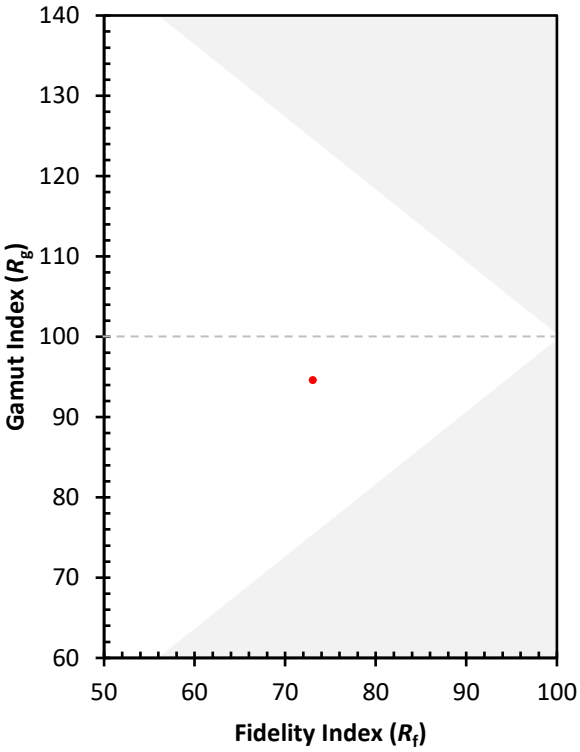

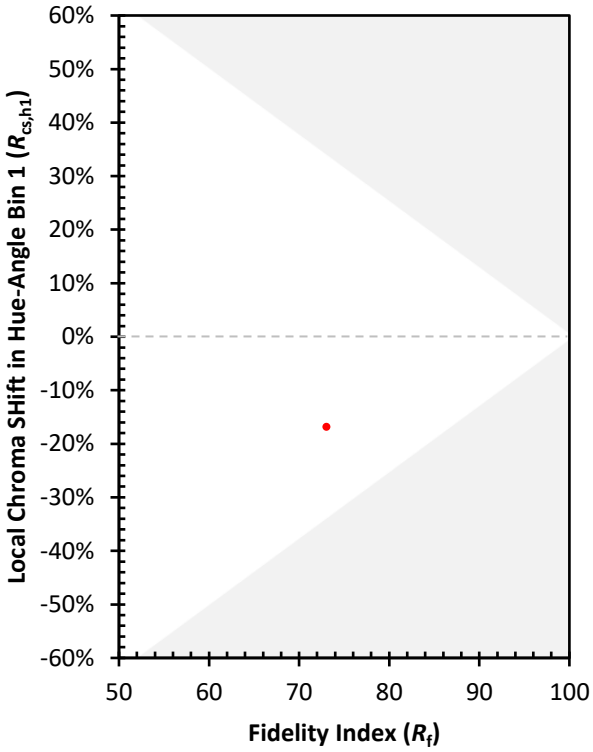

(END OF REPORT)