Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P821586

Luminaire Tested: **TT-D2-750-12VDC-WQ-UPL**

Issue Date: 7/23/2020

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P821586
	REPORT IS FROM IESNA LM-79-08 TEST DATA - UPLIGHT (G2-2002-677-3) AND
Test Lab:	INNOVATION CENTER
Issue Date:	7/23/2020
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	TT-D2-750-12VDC-WQ-UPL
Description:	TOPTIER LED PARKING GARAGE LUMINAIRE WITH UPLIGHT WITH UPLIGHT
	5000K, 70 CRI LEDS AND WIDE DISTRIBUTION
Light Source:	-
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	6177.4 lumens
Efficiency:	N/A
Efficacy:	162.6 lumens/watt
Luminous Opening:	Vertical Cylinder (Dia: 1.12' x H: 0.1')
IES Classification:	Type V - Short
BUG Rating:	B3 - U4 - G2


Input Watts (W):	38
Input Voltage (V):	NR
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	25 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821586
CATALOG NUMBER: TT-D2-750-12VDC-WQ-UPL

Iso-Footcandle Lines of Horizontal Illumination

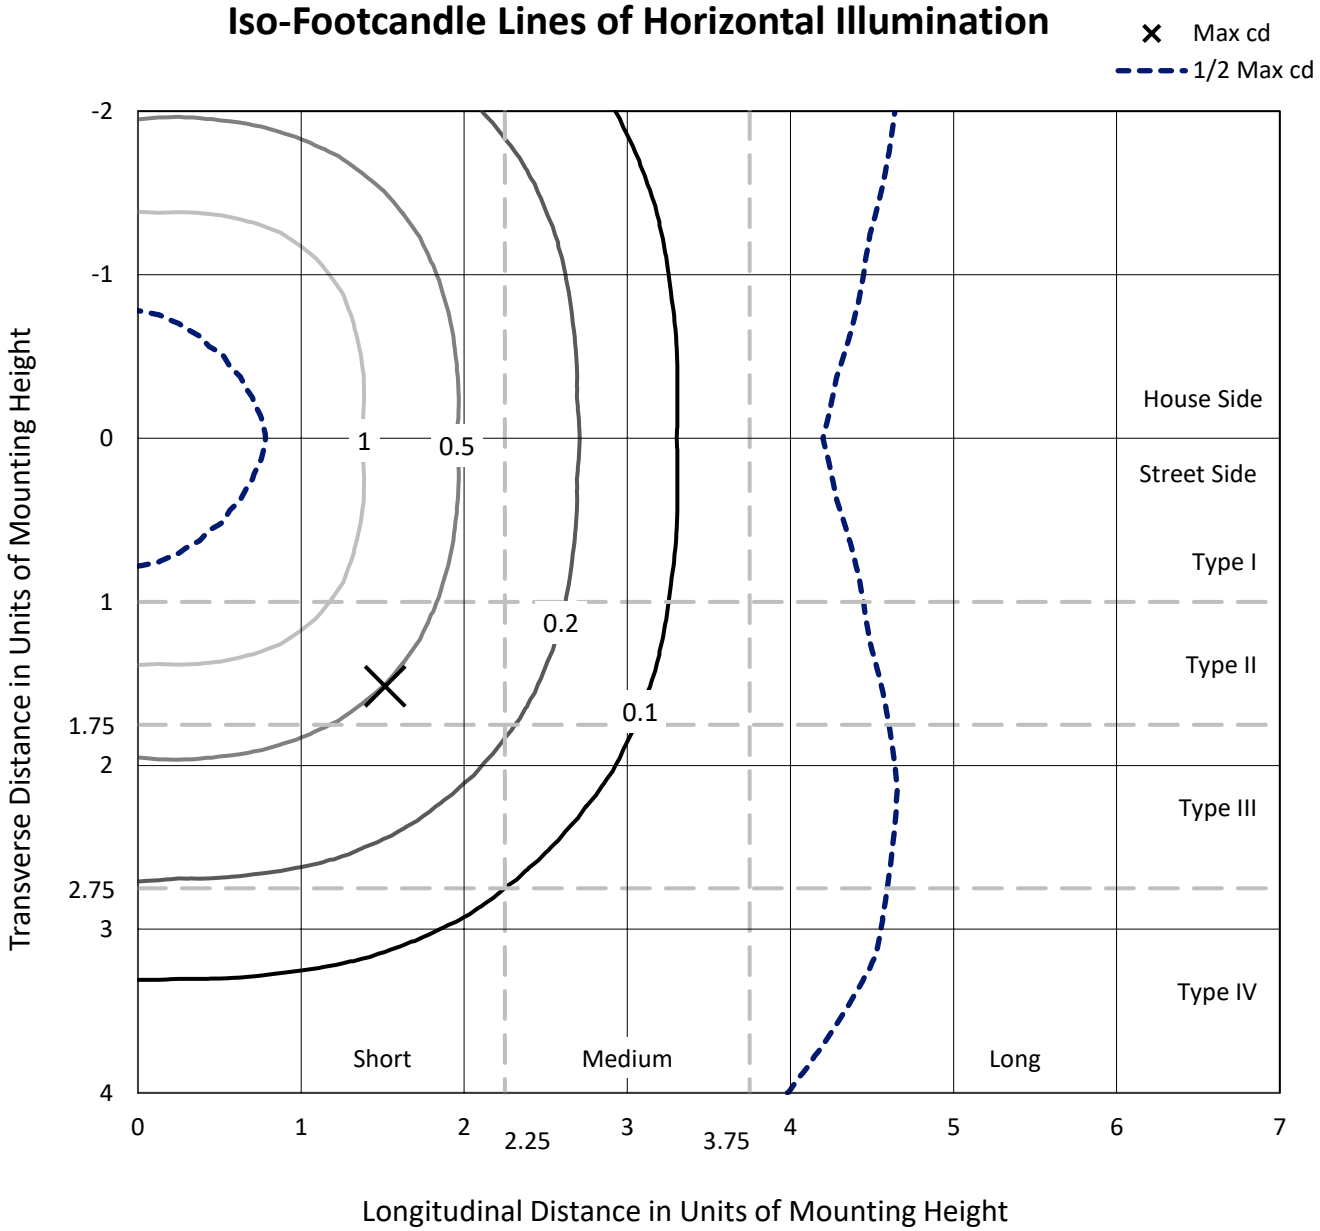


Based on 15 foot mounting height. Maximum calculated value = 1.8 fc
Type V - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821586
CATALOG NUMBER: TT-D2-750-12VDC-WQ-UPL

Luminous Intensity Polar Plot

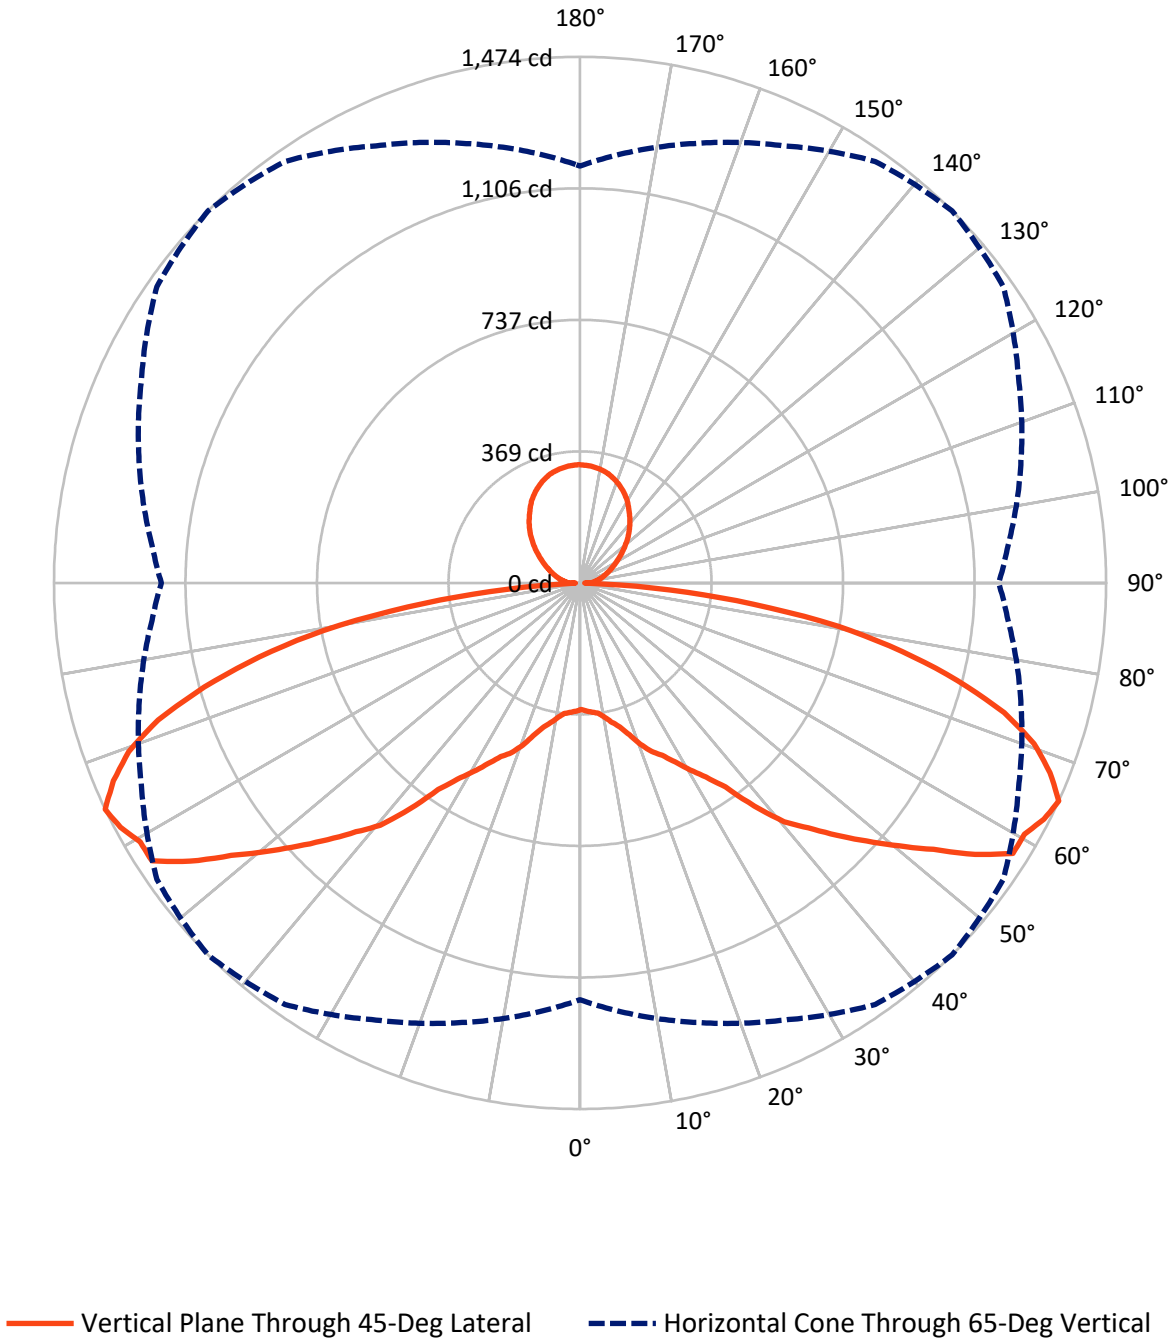

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P821586
CATALOG NUMBER: TT-D2-750-12VDC-WQ-UPL

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	2638.7	450.0	3088.7
	% Fixture	42.7	7.3	50.0
Street Side	Lumens	2638.7	450.0	3088.7
	% Fixture	42.7	7.3	50.0
Total	Lumens	5277.3	900.0	6177.4
	% Fixture	85.4	14.6	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	35.4	0.6
10°-20°	121.7	2.0
20°-30°	249.9	4.0
30°-40°	444.0	7.2
40°-50°	748.5	12.1
50°-60°	1104.1	17.9
60°-70°	1295.8	21.0
70°-80°	1009.6	16.3
80°-90°	268.3	4.3
90°-100°	46.1	0.7
100°-110°	71.4	1.2
110°-120°	99.4	1.6
120°-130°	128.8	2.1
130°-140°	150.0	2.4
140°-150°	152.1	2.5
150°-160°	131.9	2.1
160°-170°	89.0	1.4
170°-180°	31.3	0.5
0°-90°	5277.3	85.4
0°-180°	6177.4	100.0

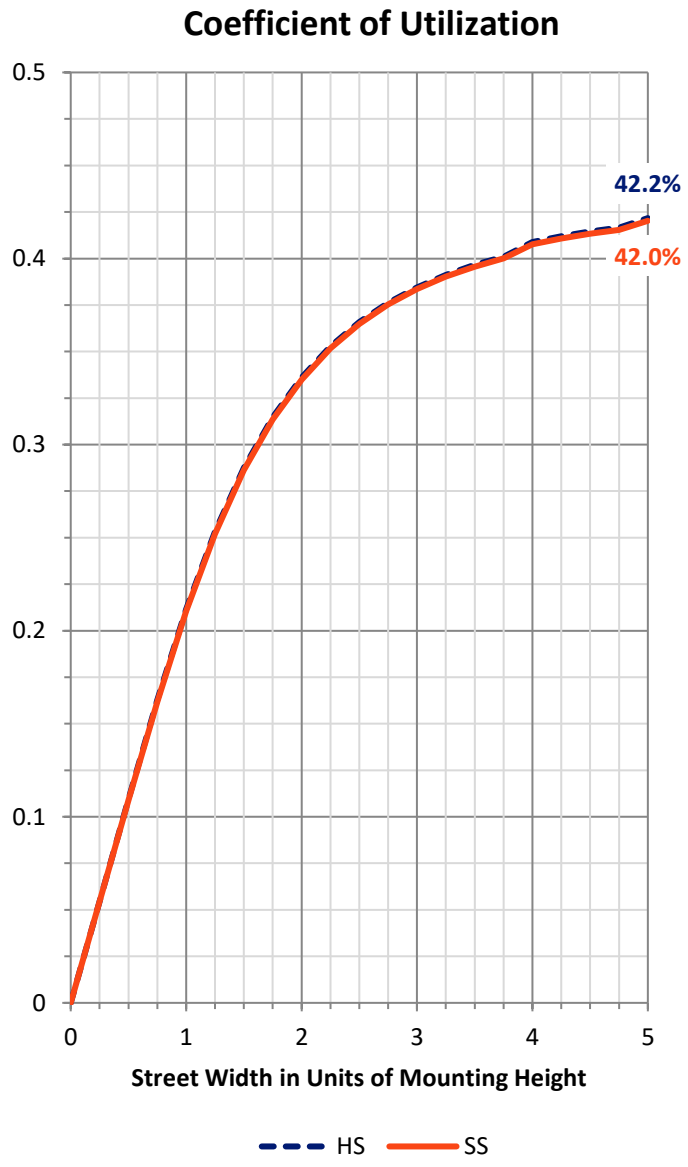

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P821586
CATALOG NUMBER: TT-D2-750-12VDC-WQ-UPL

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	203.5	3.3			
FM	(30°-60°)	1148.3	18.6			
FH	(60°-80°)	1152.7	18.7			G1/1800
FVH	(80°-90°)	134.1	2.2			G2/225
BL	(0°-30°)	203.5	3.3	B1/500		
BM	(30°-60°)	1148.3	18.6	B2/2500		
BH	(60°-80°)	1152.7	18.7	B3/2500		G1/1800
BVH	(80°-90°)	134.1	2.2			G2/225
UL	(90°-100°)	46.1	0.7		U2/50	
UH	(100°-180°)	853.9	13.8		U4/1000	

BUG Rating: B3-U4-G2
Type V Short

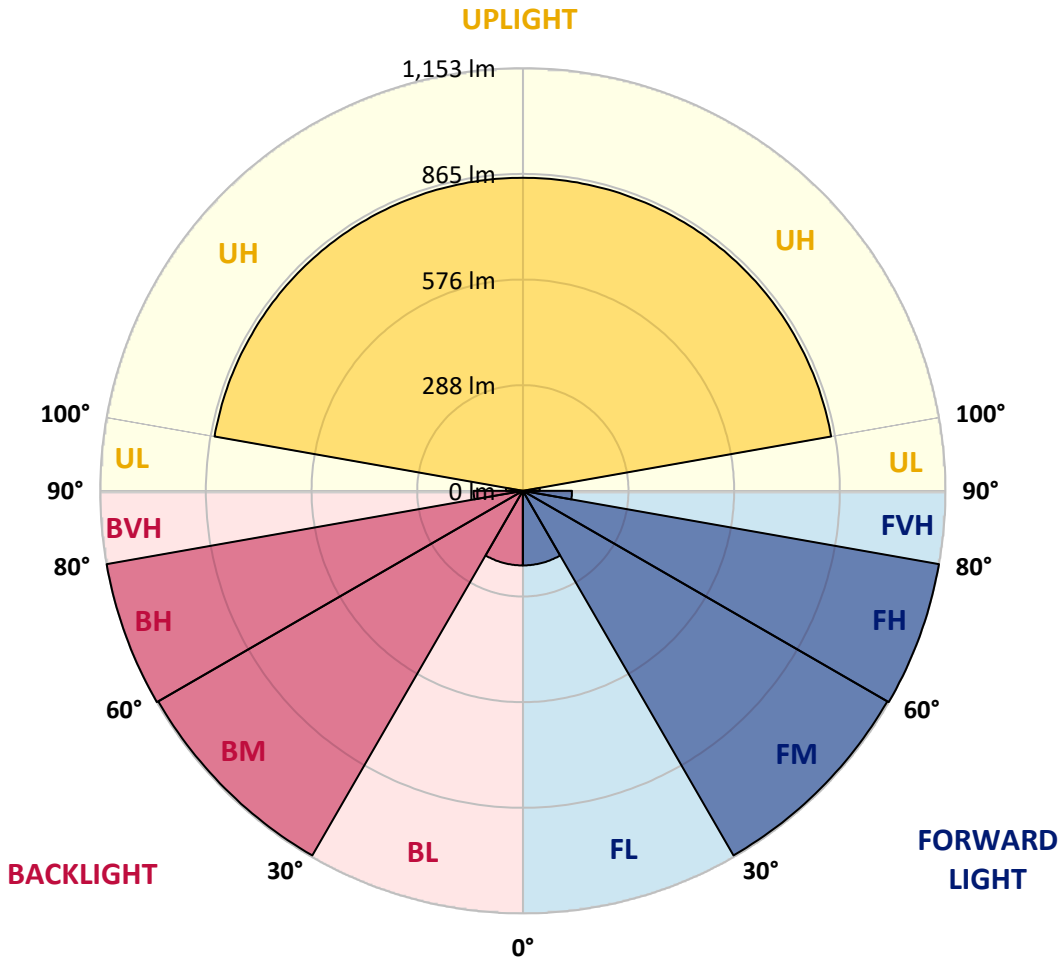

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821586
CATALOG NUMBER: TT-D2-750-12VDC-WQ-UPL

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
0°	354.9	354.9	354.9	354.9	354.9	354.9	354.9	354.9	354.9	354.9	354.9
2.5°	360.7	360.7	360.7	359.9	359.9	359.9	359.9	360.7	360.7	360.7	360.7
5°	369.0	369.0	367.3	365.7	364.0	364.0	364.8	365.7	366.5	368.2	368.2
7.5°	374.0	374.0	373.1	371.5	369.0	369.0	369.8	371.5	372.3	372.3	371.5
10°	380.6	381.4	383.9	384.7	383.1	383.1	383.9	384.7	383.1	380.6	380.6
12.5°	396.3	397.2	400.5	403.0	403.0	401.3	402.2	403.8	399.7	395.5	396.3
15°	418.7	418.7	419.6	422.1	420.4	418.7	420.4	421.2	418.7	417.9	419.6
17.5°	448.6	448.6	443.6	447.8	448.6	447.8	449.4	445.3	442.8	446.1	447.8
20°	480.9	477.6	475.1	478.4	485.1	482.6	485.9	476.8	474.3	475.9	476.8
22.5°	501.7	504.1	505.8	507.5	516.6	513.3	516.6	506.6	505.0	501.7	499.2
25°	526.5	529.0	539.0	534.0	539.8	534.8	539.0	533.2	536.5	526.5	526.5
27.5°	554.7	559.7	565.5	563.0	570.5	568.0	570.5	562.2	563.0	558.9	557.2
30°	592.9	592.9	591.2	596.2	609.4	607.8	608.6	597.8	590.4	591.2	594.5
32.5°	631.0	626.0	628.5	643.4	651.7	648.4	650.1	645.1	628.5	625.2	627.7
35°	666.7	674.1	679.9	692.4	704.0	702.3	701.5	693.2	682.4	669.1	665.0
37.5°	722.2	730.5	746.3	768.7	789.4	793.5	782.7	772.0	747.1	728.0	718.1
40°	795.2	796.0	814.3	857.4	876.4	879.8	874.0	855.7	817.6	796.0	795.2
42.5°	859.0	853.2	883.1	919.6	937.0	938.6	934.5	919.6	883.1	852.4	858.2
45°	908.8	908.8	944.4	973.5	1001.7	1008.3	1000.8	969.3	945.3	909.6	907.1
47.5°	954.4	966.8	996.7	1032.3	1072.1	1081.3	1072.1	1034.8	994.2	967.7	953.6
50°	1009.1	1024.0	1045.6	1101.2	1145.9	1158.4	1145.1	1104.5	1045.6	1023.2	1014.9
52.5°	1073.0	1085.4	1119.4	1189.0	1222.2	1240.5	1229.7	1190.7	1121.1	1087.1	1080.4
55°	1149.2	1137.6	1190.7	1257.9	1319.2	1343.3	1321.7	1259.5	1199.0	1137.6	1149.2
57.5°	1188.2	1174.9	1249.6	1313.4	1398.8	1430.3	1403.8	1318.4	1249.6	1179.1	1187.4
60°	1191.5	1197.3	1253.7	1358.2	1417.1	1430.3	1422.0	1365.7	1256.2	1202.3	1186.6
62.5°	1181.6	1217.2	1265.3	1373.1	1426.2	1458.5	1430.3	1374.8	1270.3	1223.0	1182.4
65°	1168.3	1204.0	1275.3	1351.6	1441.9	1474.3	1447.7	1355.7	1278.6	1204.0	1173.3
67.5°	1145.1	1132.7	1220.6	1322.5	1401.3	1420.4	1403.8	1324.2	1219.7	1131.0	1147.6
70°	1071.3	1060.5	1136.0	1247.9	1323.4	1349.9	1330.0	1249.6	1137.6	1063.0	1073.0
72.5°	961.8	965.2	1038.1	1145.1	1226.4	1242.9	1232.2	1144.3	1042.3	969.3	956.0
75°	834.2	842.4	912.1	1009.1	1082.9	1092.9	1082.1	1013.3	911.3	847.4	830.0
77.5°	685.7	698.2	754.6	851.6	900.5	922.9	905.5	854.1	758.7	701.5	684.1
80°	531.5	535.7	575.5	653.4	718.1	733.0	716.4	655.9	580.4	537.3	524.9
82.5°	348.3	354.9	390.5	450.2	492.5	488.4	492.5	445.3	394.7	353.2	332.5
85°	155.1	168.3	192.4	220.6	247.9	255.4	247.9	223.9	192.4	165.0	161.7
87.5°	10.8	12.4	14.9	15.8	17.4	13.3	13.3	13.3	11.6	13.3	10.8
90°	32.5	31.5	31.5	31.5	31.5	31.5	31.5	31.5	31.5	31.5	31.5
92.5°	37.6	37.1	37.1	36.6	36.6	36.6	36.6	36.6	36.6	36.6	36.6
95°	42.7	42.7	42.7	41.7	41.7	41.7	41.7	41.7	41.7	41.7	41.7
97.5°	48.3	48.3	48.3	47.8	47.8	47.8	47.8	47.8	47.8	47.8	47.8
100°	53.9	53.9	53.9	53.9	53.9	53.9	53.9	53.9	53.9	53.9	53.9
102.5°	60.5	60.5	60.5	60.5	60.5	60.5	60.5	61.0	60.5	60.5	60.5
105°	67.1	67.1	67.1	67.1	67.1	67.1	67.1	68.1	67.1	67.1	67.1
107.5°	74.2	74.2	74.7	74.7	74.7	74.7	74.7	75.2	74.7	74.7	74.7
110°	81.3	81.3	82.3	82.3	82.3	82.3	82.3	82.3	82.3	82.3	82.3

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821586
CATALOG NUMBER: TT-D2-750-12VDC-WQ-UPL

CANDELA DISTRIBUTION (continued):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
112.5°	89.9	89.9	90.9	90.9	90.9	*90.9*	91.4	91.4	90.9	90.9	90.9
115°	98.6	98.6	99.6	99.6	99.6	*99.6*	100.6	100.6	99.6	99.6	99.6
117.5°	108.8	108.8	109.2	109.8	109.8	*109.8*	110.8	110.8	109.8	109.8	109.8
120°	118.9	118.9	118.9	119.9	119.9	*119.9*	121.0	121.0	119.9	119.9	119.9
122.5°	130.6	130.6	131.1	131.6	131.6	*131.6*	132.6	132.6	132.1	132.1	131.6
125°	142.3	142.3	143.3	143.3	143.3	*143.3*	144.3	144.3	144.3	144.3	143.3
127.5°	155.0	155.0	156.0	156.0	156.0	*156.0*	157.0	157.0	157.0	157.0	156.0
130°	167.7	167.7	168.7	168.7	168.7	*168.7*	169.7	169.7	169.7	169.7	168.7
132.5°	180.9	180.9	181.4	181.4	181.4	*181.9*	182.4	182.4	182.4	182.4	181.9
135°	194.1	194.1	194.1	194.1	194.1	*195.1*	195.1	195.1	195.1	195.1	195.1
137.5°	206.8	206.3	206.8	206.3	206.8	*207.3*	207.3	207.3	207.3	207.3	207.3
140°	219.5	218.5	219.5	218.5	219.5	*219.5*	219.5	219.5	219.5	219.5	219.5
142.5°	231.2	230.7	231.2	230.2	231.2	*231.2*	231.2	231.2	231.2	231.2	231.2
145°	242.9	242.9	242.9	241.9	242.9	*242.9*	242.9	242.9	242.9	242.9	242.9
147.5°	255.1	254.6	255.1	254.1	255.1	*255.1*	255.1	255.1	255.1	255.1	255.1
150°	267.3	266.3	267.3	266.3	267.3	*267.3*	267.3	267.3	267.3	267.3	267.3
152.5°	277.0	276.5	277.5	276.5	277.0	*277.0*	277.5	277.0	277.0	277.0	277.0
155°	286.6	286.6	287.6	286.6	286.6	*286.6*	287.6	286.6	286.6	286.6	286.6
157.5°	294.8	294.8	295.8	294.8	294.8	*294.8*	295.8	294.8	294.8	294.8	294.8
160°	302.9	302.9	303.9	302.9	302.9	*302.9*	303.9	302.9	302.9	302.9	302.9
162.5°	309.5	309.5	310.5	309.5	309.5	*309.5*	310.5	309.5	309.5	309.5	309.5
165°	316.1	316.1	317.1	316.1	316.1	*316.1*	317.1	316.1	316.1	316.1	316.1
167.5°	320.2	320.2	321.2	320.2	320.2	*320.2*	321.2	320.2	320.2	320.2	320.2
170°	324.2	324.2	325.2	324.2	324.2	*324.2*	325.2	324.2	324.2	324.2	324.2
172.5°	326.8	326.8	327.8	326.8	327.2	*326.8*	327.8	326.8	326.8	326.8	326.8
175°	329.3	329.3	330.3	329.3	330.3	*329.3*	330.3	329.3	329.3	329.3	329.3
177.5°	330.3	330.3	330.8	330.3	330.8	*330.3*	330.8	330.3	330.3	330.3	330.3
180°	331.3	331.3	331.3	331.3	331.3	*331.3*	331.3	331.3	331.3	331.3	331.3

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Streetworks

Report Number: SP1-2407-176-6

Test Date: 09/26/2024

Luminaire Tested: MEM2-HTN-VA-30-750-U-WQ

Data in this report applies to families of products including MEM2-HTN-VA-30-750-U-WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-176-6
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	09/27/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	Streetworks
Catalog Number:	**MEM2-HTN-VA-30-750-U-WQ**
Description:	EPIC MODERN VISUAL COMFORT 30W WAVESTREAM WIDE

Spectral Parameters

CCT (K):	4786
CIE u':	0.2093
CIE v':	0.4953
Duv:	0.0066
CIE x:	0.3533
CIE y:	0.3716
CIE z:	0.2751
Peak Wavelength (nm):	449
Dominant Wavelength (nm):	570
Purity:	17.53512
Rf:	73
Rg:	94.6

CRI (Ra):	70.9				
R1:	67.8	R9:	-29.8		
R2:	75.1	R10:	40.9		
R3:	80.6	R11:	67.4		
R4:	71.6	R12:	35.3		
R5:	67.8	R13:	68.5		
R6:	65.4	R14:	89.0		
R7:	82.0	R15:	60.9		
R8:	57.0				

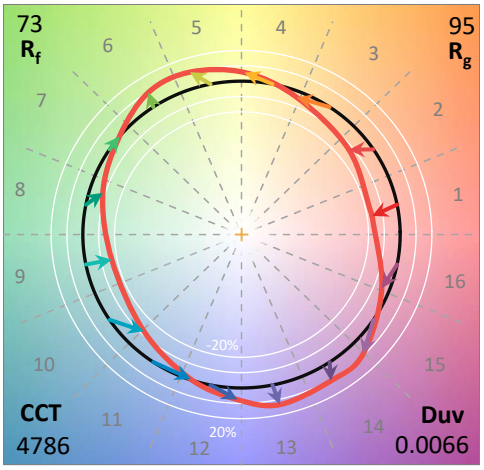

Test Conditions


Stabilization Time:	45M
Operation Time:	1H 45M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-176-6


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-176-6

CIE 1931 Chromaticity Diagram

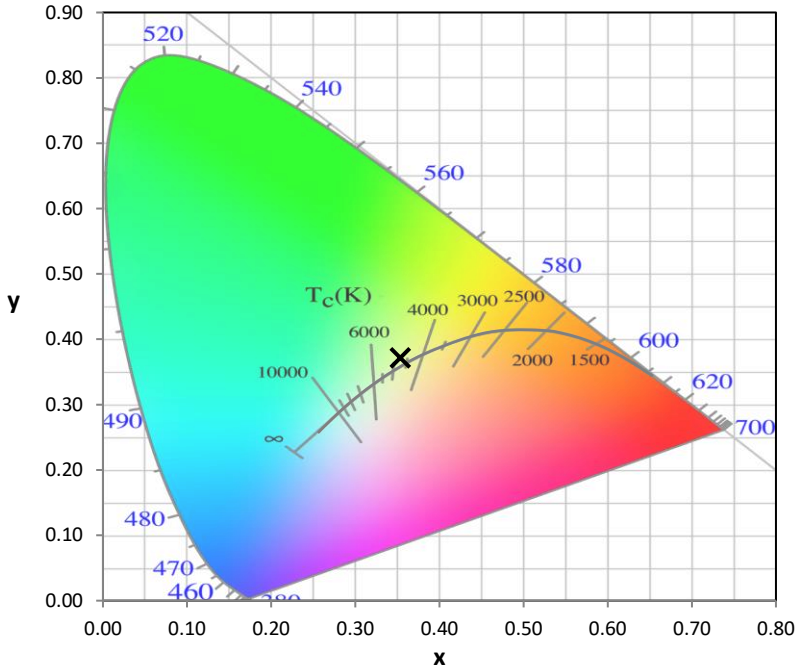

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

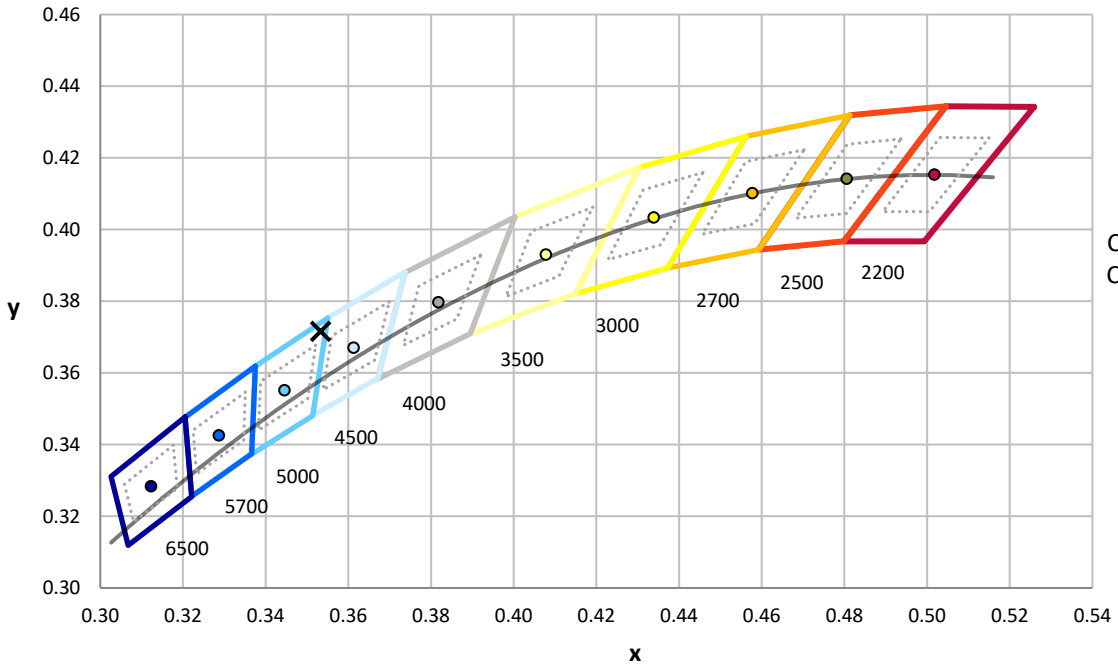


CCT = 4786K
CIE x = 0.3533
CIE y = 0.3716
Duv = 0.0066

Point lies inside the ANSI 5000K 7-step quadrangle

REPORT NUMBER: SP1-2407-176-6

Photopic Flux vs. Wavelength

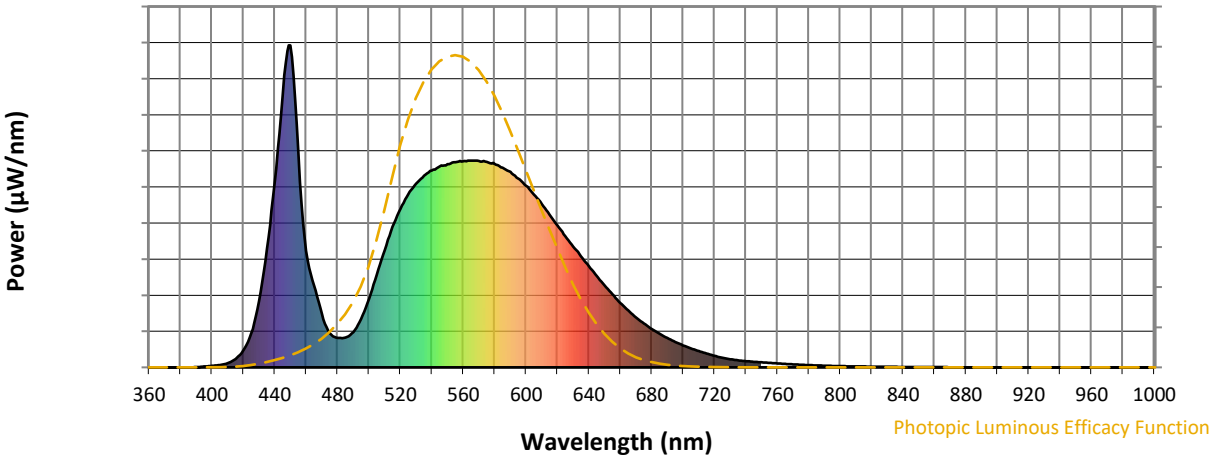


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	110	NR	620	440	NR	750	16	NR	880	0	NR
365	0	NR	495	150	NR	625	407	NR	755	14	NR	885	0	NR
370	0	NR	500	213	NR	630	375	NR	760	12	NR	890	0	NR
375	0	NR	505	288	NR	635	345	NR	765	11	NR	895	0	NR
380	0	NR	510	364	NR	640	314	NR	770	9	NR	900	0	NR
385	0	NR	515	436	NR	645	283	NR	775	8	NR	905	0	NR
390	1	NR	520	492	NR	650	254	NR	780	7	NR	910	0	NR
395	3	NR	525	537	NR	655	227	NR	785	6	NR	915	0	NR
400	5	NR	530	570	NR	660	200	NR	790	5	NR	920	0	NR
405	7	NR	535	595	NR	665	177	NR	795	4	NR	925	0	NR
410	13	NR	540	611	NR	670	155	NR	800	4	NR	930	0	NR
415	25	NR	545	624	NR	675	136	NR	805	3	NR	935	0	NR
420	52	NR	550	631	NR	680	119	NR	810	3	NR	940	0	NR
425	106	NR	555	637	NR	685	104	NR	815	3	NR	945	0	NR
430	204	NR	560	640	NR	690	91	NR	820	2	NR	950	0	NR
435	369	NR	565	642	NR	695	79	NR	825	2	NR	955	0	NR
440	573	NR	570	641	NR	700	68	NR	830	2	NR	960	0	NR
445	844	NR	575	638	NR	705	59	NR	835	2	NR	965	0	NR
450	999	NR	580	632	NR	710	50	NR	840	1	NR	970	0	NR
455	668	NR	585	620	NR	715	43	NR	845	1	NR	975	0	NR
460	361	NR	590	607	NR	720	36	NR	850	1	NR	980	0	NR
465	255	NR	595	586	NR	725	30	NR	855	1	NR	985	0	NR
470	165	NR	600	564	NR	730	25	NR	860	1	NR	990	0	NR
475	106	NR	605	537	NR	735	22	NR	865	1	NR	995	0	NR
480	91	NR	610	507	NR	740	19	NR	870	0	NR	1000	0	NR
485	93	NR	615	474	NR	745	17	NR	875	0	NR			

REPORT NUMBER: SP1-2407-176-6

Scotopic Flux vs. Wavelength

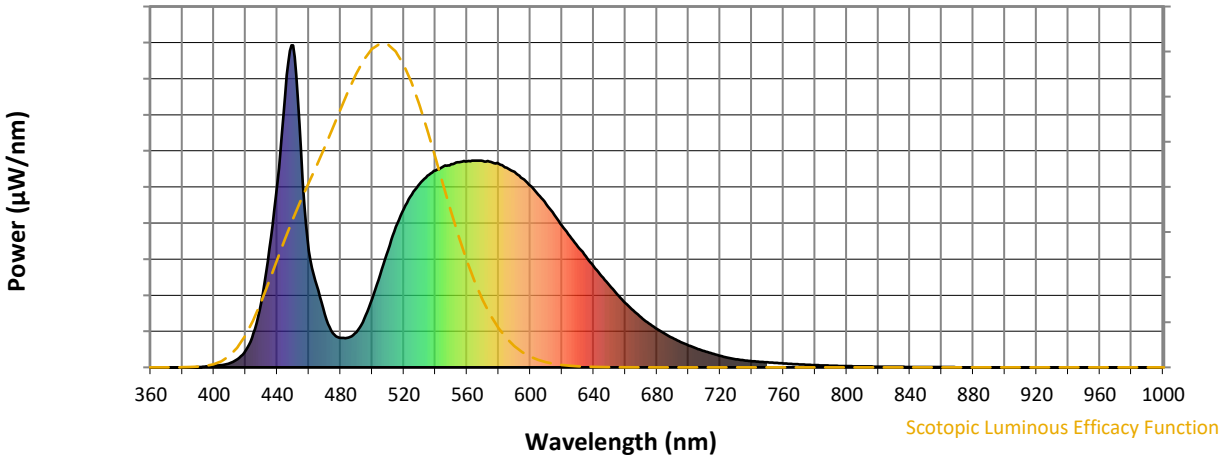


Scotopic Lumens: NR **S/P: 1.69**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	110	NR	620	440	NR	750	16	NR	880	0	NR
365	0	NR	495	150	NR	625	407	NR	755	14	NR	885	0	NR
370	0	NR	500	213	NR	630	375	NR	760	12	NR	890	0	NR
375	0	NR	505	288	NR	635	345	NR	765	11	NR	895	0	NR
380	0	NR	510	364	NR	640	314	NR	770	9	NR	900	0	NR
385	0	NR	515	436	NR	645	283	NR	775	8	NR	905	0	NR
390	1	NR	520	492	NR	650	254	NR	780	7	NR	910	0	NR
395	3	NR	525	537	NR	655	227	NR	785	6	NR	915	0	NR
400	5	NR	530	570	NR	660	200	NR	790	5	NR	920	0	NR
405	7	NR	535	595	NR	665	177	NR	795	4	NR	925	0	NR
410	13	NR	540	611	NR	670	155	NR	800	4	NR	930	0	NR
415	25	NR	545	624	NR	675	136	NR	805	3	NR	935	0	NR
420	52	NR	550	631	NR	680	119	NR	810	3	NR	940	0	NR
425	106	NR	555	637	NR	685	104	NR	815	3	NR	945	0	NR
430	204	NR	560	640	NR	690	91	NR	820	2	NR	950	0	NR
435	369	NR	565	642	NR	695	79	NR	825	2	NR	955	0	NR
440	573	NR	570	641	NR	700	68	NR	830	2	NR	960	0	NR
445	844	NR	575	638	NR	705	59	NR	835	2	NR	965	0	NR
450	999	NR	580	632	NR	710	50	NR	840	1	NR	970	0	NR
455	668	NR	585	620	NR	715	43	NR	845	1	NR	975	0	NR
460	361	NR	590	607	NR	720	36	NR	850	1	NR	980	0	NR
465	255	NR	595	586	NR	725	30	NR	855	1	NR	985	0	NR
470	165	NR	600	564	NR	730	25	NR	860	1	NR	990	0	NR
475	106	NR	605	537	NR	735	22	NR	865	1	NR	995	0	NR
480	91	NR	610	507	NR	740	19	NR	870	0	NR	1000	0	NR
485	93	NR	615	474	NR	745	17	NR	875	0	NR			

REPORT NUMBER: SP1-2407-176-6

Melanopic Flux vs. Wavelength

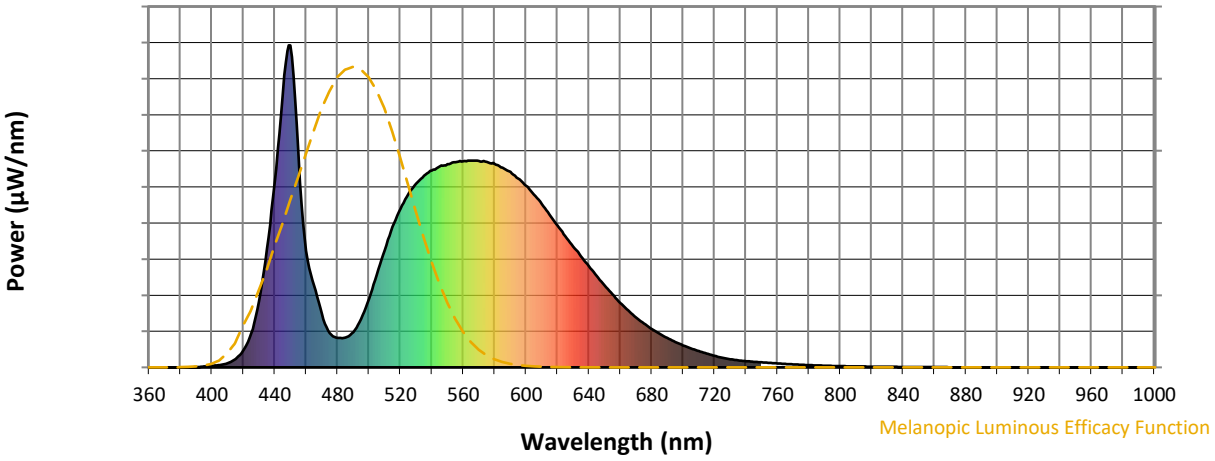

Melanopic Lumens: NR **M/P: 3.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	110	NR	620	440	NR	750	16	NR	880	0	NR
365	0	NR	495	150	NR	625	407	NR	755	14	NR	885	0	NR
370	0	NR	500	213	NR	630	375	NR	760	12	NR	890	0	NR
375	0	NR	505	288	NR	635	345	NR	765	11	NR	895	0	NR
380	0	NR	510	364	NR	640	314	NR	770	9	NR	900	0	NR
385	0	NR	515	436	NR	645	283	NR	775	8	NR	905	0	NR
390	1	NR	520	492	NR	650	254	NR	780	7	NR	910	0	NR
395	3	NR	525	537	NR	655	227	NR	785	6	NR	915	0	NR
400	5	NR	530	570	NR	660	200	NR	790	5	NR	920	0	NR
405	7	NR	535	595	NR	665	177	NR	795	4	NR	925	0	NR
410	13	NR	540	611	NR	670	155	NR	800	4	NR	930	0	NR
415	25	NR	545	624	NR	675	136	NR	805	3	NR	935	0	NR
420	52	NR	550	631	NR	680	119	NR	810	3	NR	940	0	NR
425	106	NR	555	637	NR	685	104	NR	815	3	NR	945	0	NR
430	204	NR	560	640	NR	690	91	NR	820	2	NR	950	0	NR
435	369	NR	565	642	NR	695	79	NR	825	2	NR	955	0	NR
440	573	NR	570	641	NR	700	68	NR	830	2	NR	960	0	NR
445	844	NR	575	638	NR	705	59	NR	835	2	NR	965	0	NR
450	999	NR	580	632	NR	710	50	NR	840	1	NR	970	0	NR
455	668	NR	585	620	NR	715	43	NR	845	1	NR	975	0	NR
460	361	NR	590	607	NR	720	36	NR	850	1	NR	980	0	NR
465	255	NR	595	586	NR	725	30	NR	855	1	NR	985	0	NR
470	165	NR	600	564	NR	730	25	NR	860	1	NR	990	0	NR
475	106	NR	605	537	NR	735	22	NR	865	1	NR	995	0	NR
480	91	NR	610	507	NR	740	19	NR	870	0	NR	1000	0	NR
485	93	NR	615	474	NR	745	17	NR	875	0	NR			


REPORT NUMBER: SP1-2407-176-6

TM-30-18


Summary


R_f = 73
R_g = 94.6
CIE R_a = 70.9
R_9 = -29.8


Spectral Power Distribution Comparison

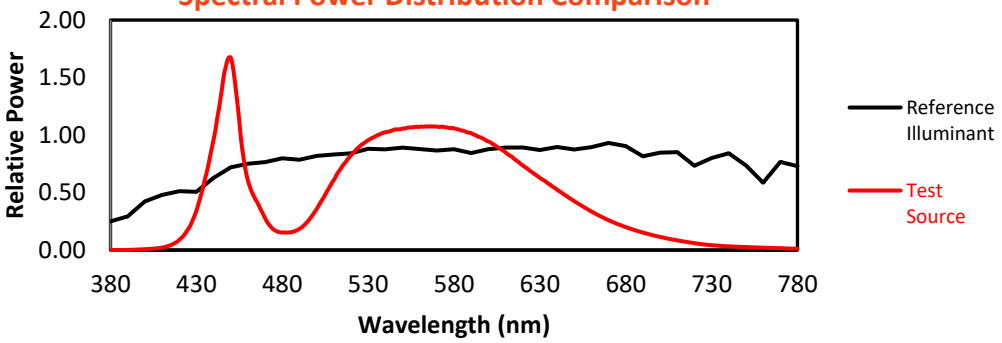


Color Vector Graphics

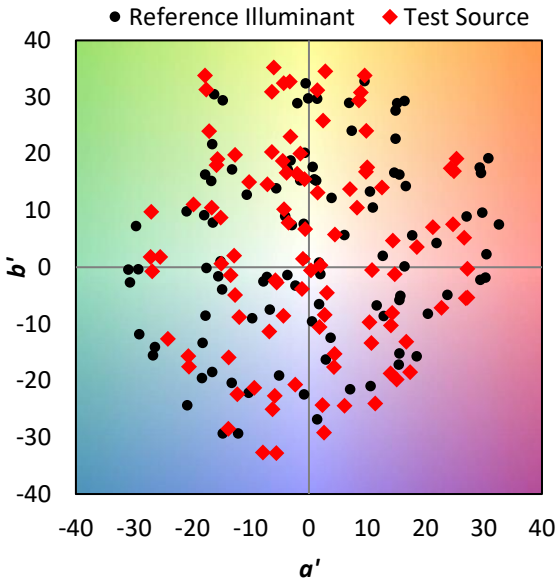

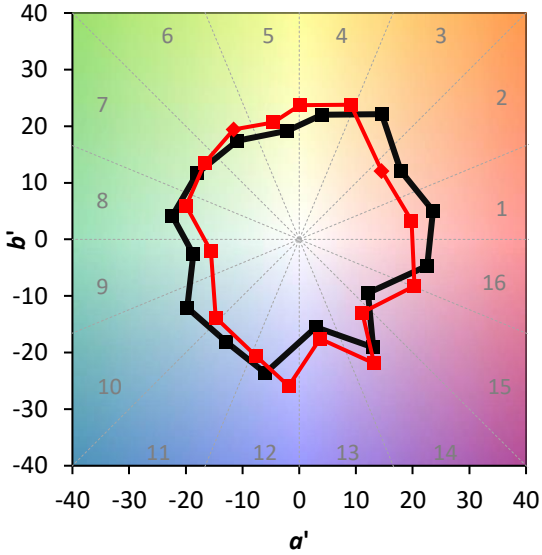

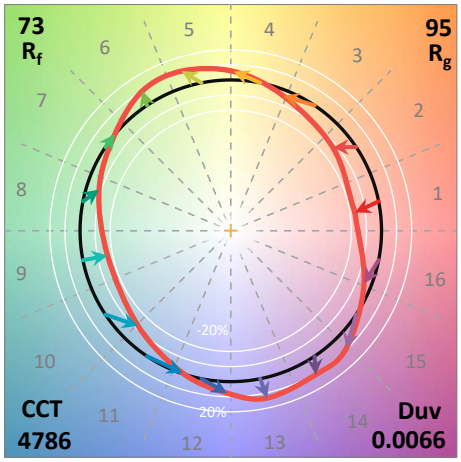

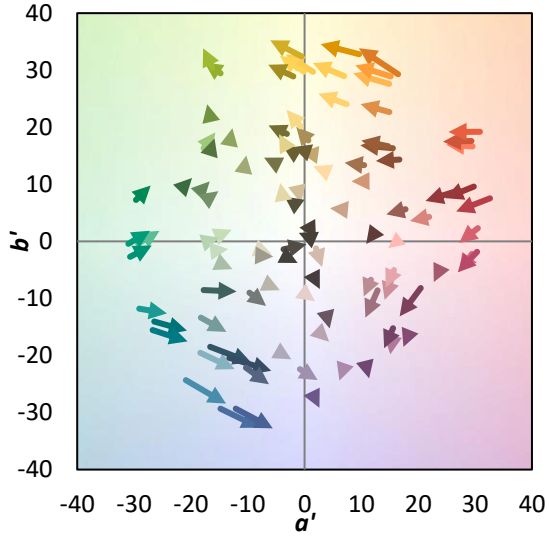


REPORT NUMBER: SP1-2407-176-6

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 60	CES51 = 89	CES76 = 46
CES02 = 59	CES27 = 86	CES52 = 88	CES77 = 65
CES03 = 30	CES28 = 78	CES53 = 76	CES78 = 49
CES04 = 69	CES29 = 62	CES54 = 83	CES79 = 78
CES05 = 46	CES30 = 79	CES55 = 82	CES80 = 74
CES06 = 50	CES31 = 66	CES56 = 71	CES81 = 77
CES07 = 39	CES32 = 58	CES57 = 70	CES82 = 89
CES08 = 38	CES33 = 74	CES58 = 71	CES83 = 87
CES09 = 29	CES34 = 66	CES59 = 86	CES84 = 86
CES10 = 72	CES35 = 81	CES60 = 90	CES85 = 79
CES11 = 56	CES36 = 94	CES61 = 84	CES86 = 76
CES12 = 61	CES37 = 75	CES62 = 84	CES87 = 76
CES13 = 41	CES38 = 88	CES63 = 72	CES88 = 79
CES14 = 74	CES39 = 95	CES64 = 66	CES89 = 73
CES15 = 70	CES40 = 88	CES65 = 61	CES90 = 78
CES16 = 46	CES41 = 92	CES66 = 58	CES91 = 77
CES17 = 49	CES42 = 75	CES67 = 55	CES92 = 63
CES18 = 55	CES43 = 74	CES68 = 65	CES93 = 77
CES19 = 71	CES44 = 99	CES69 = 74	CES94 = 56
CES20 = 64	CES45 = 83	CES70 = 55	CES95 = 67
CES21 = 85	CES46 = 82	CES71 = 47	CES96 = 76
CES22 = 77	CES47 = 84	CES72 = 82	CES97 = 83
CES23 = 91	CES48 = 76	CES73 = 44	CES98 = 73
CES24 = 90	CES49 = 80	CES74 = 92	CES99 = 62
CES25 = 71	CES50 = 88	CES75 = 47	

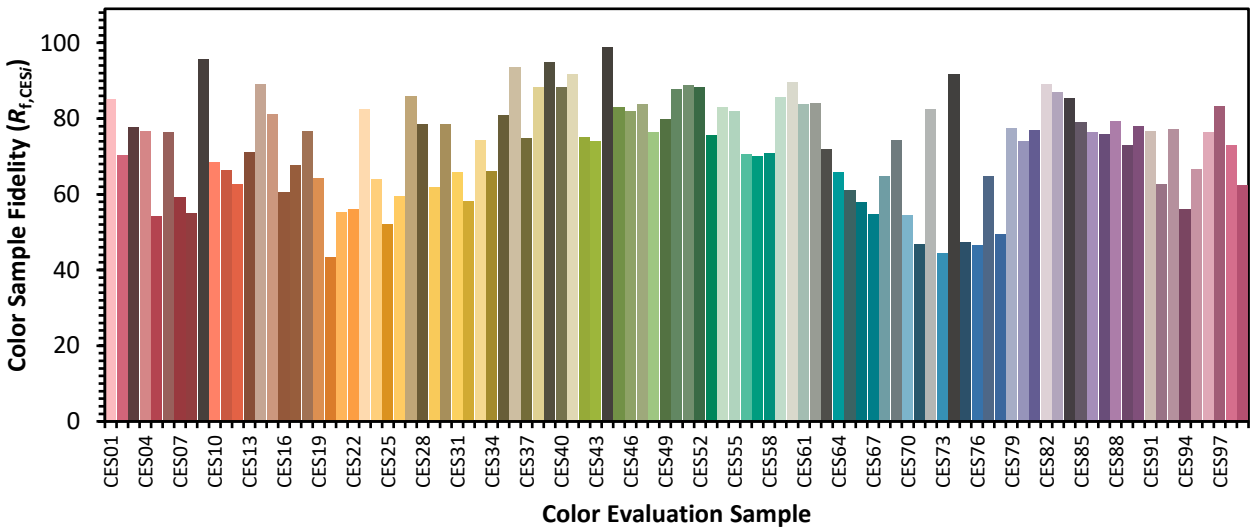



REPORT NUMBER: SP1-2407-176-6

TM-30-18

Color Rendition by Hue-Angle Bin

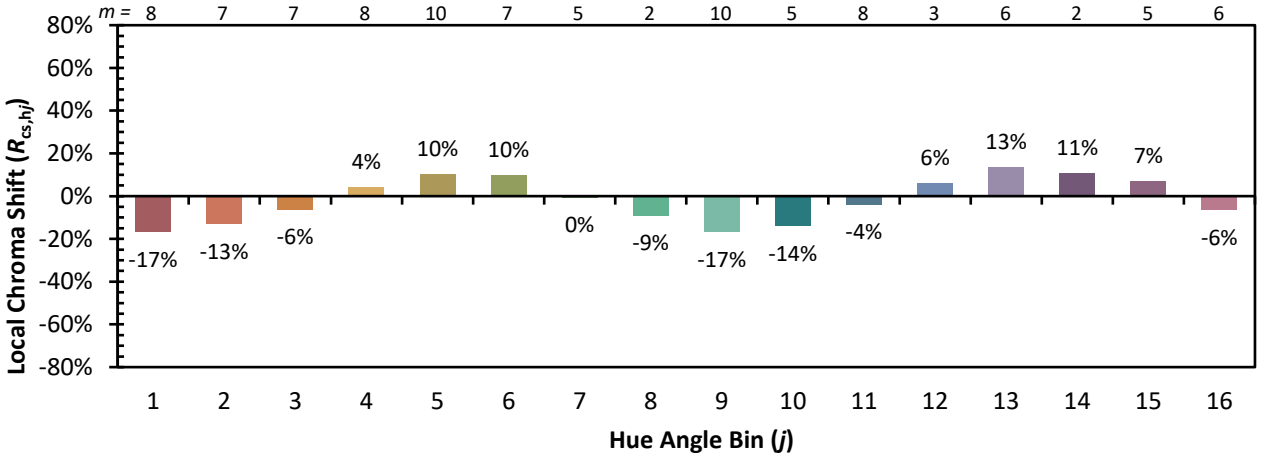

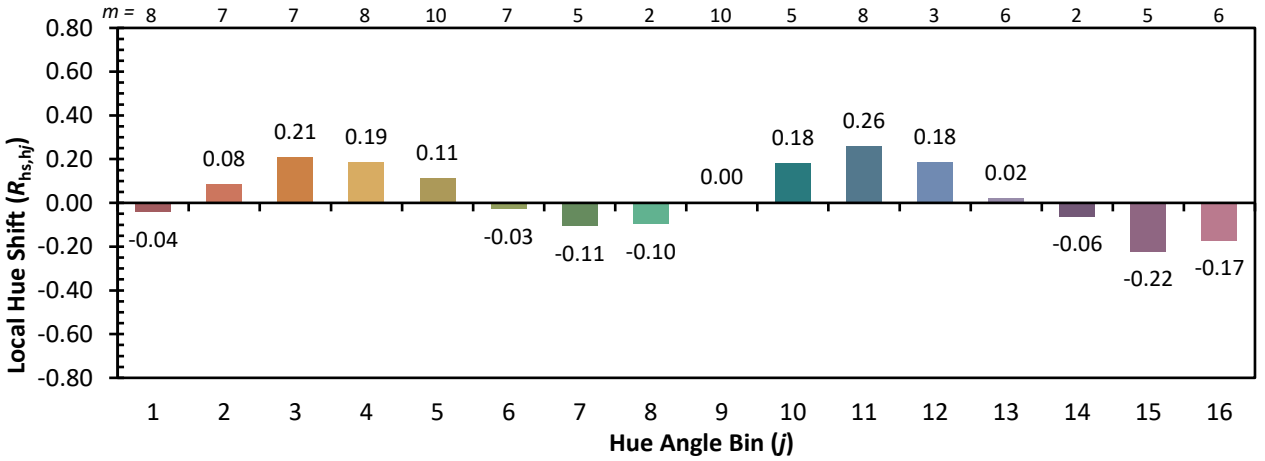


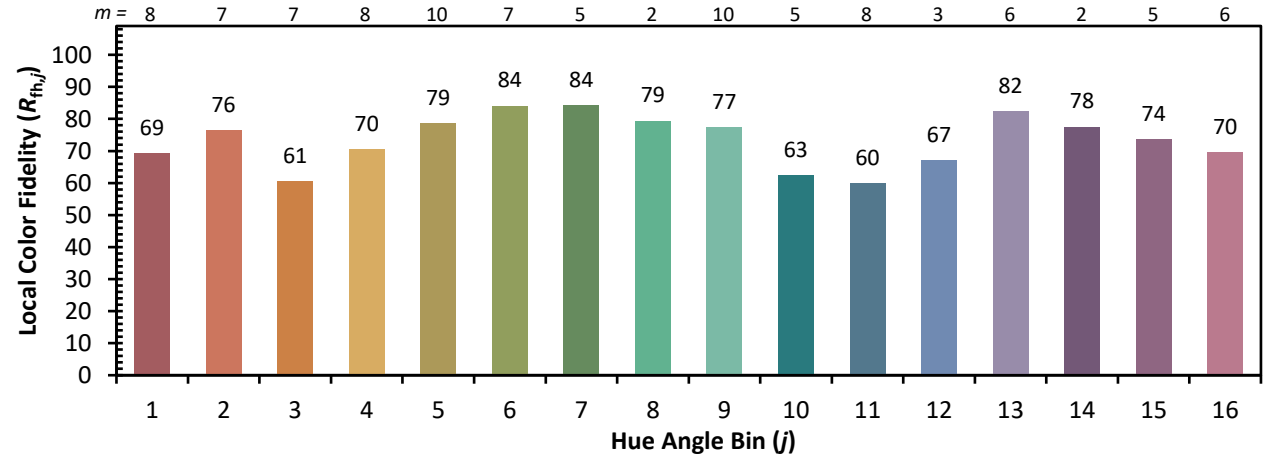


REPORT NUMBER: SP1-2407-176-6

TM-30-18

Measure Comparisons

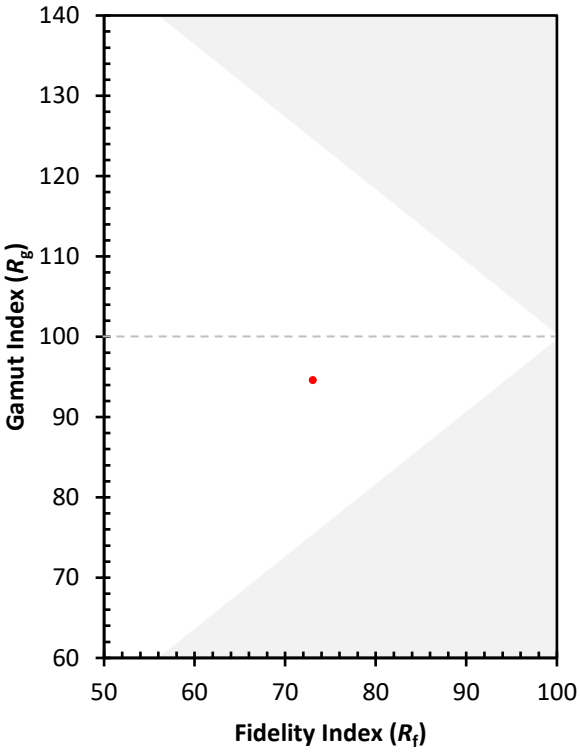

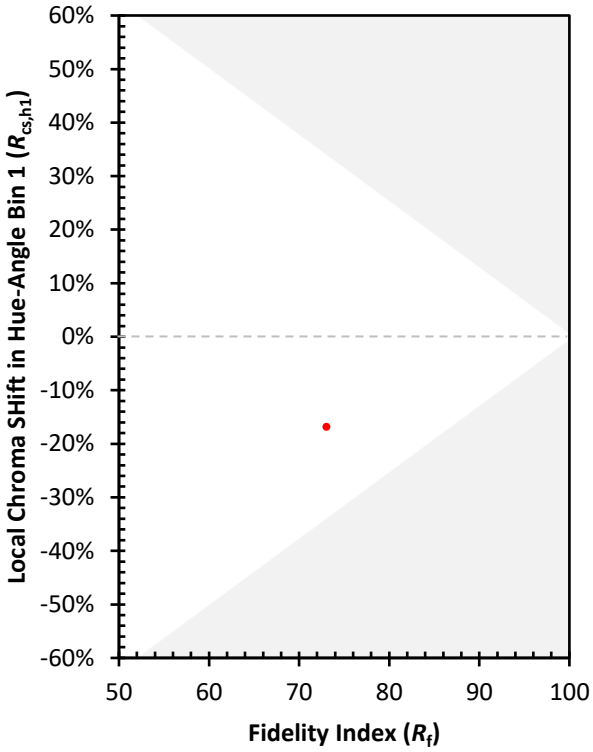

(END OF REPORT)