Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P821121

Luminaire Tested: **TT-D1-830-24VDC-MQ-UPL**

Issue Date: 7/23/2020

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P821121
	REPORT IS FROM IESNA LM-79-08 TEST DATA - UPLIGHT (G2-2002-677-2) AND
Test Lab:	INNOVATION CENTER
Issue Date:	7/23/2020
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	TT-D1-830-24VDC-MQ-UPL
Description:	TOPTIER LED PARKING GARAGE LUMINAIRE WITH UPLIGHT
	3000K, 80 CRI LEDS AND MEDIUM DISTRIBUTION
Light Source:	-
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	4482.7 lumens
Efficiency:	N/A
Efficacy:	160.1 lumens/watt
Luminous Opening:	Vertical Cylinder (Dia: 1.12' x H: 0.1')
IES Classification:	Type V - Short
BUG Rating:	B2 - U4 - G1


Input Watts (W):	28
Input Voltage (V):	NR
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	25 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821121
CATALOG NUMBER: TT-D1-830-24VDC-MQ-UPL

Iso-Footcandle Lines of Horizontal Illumination

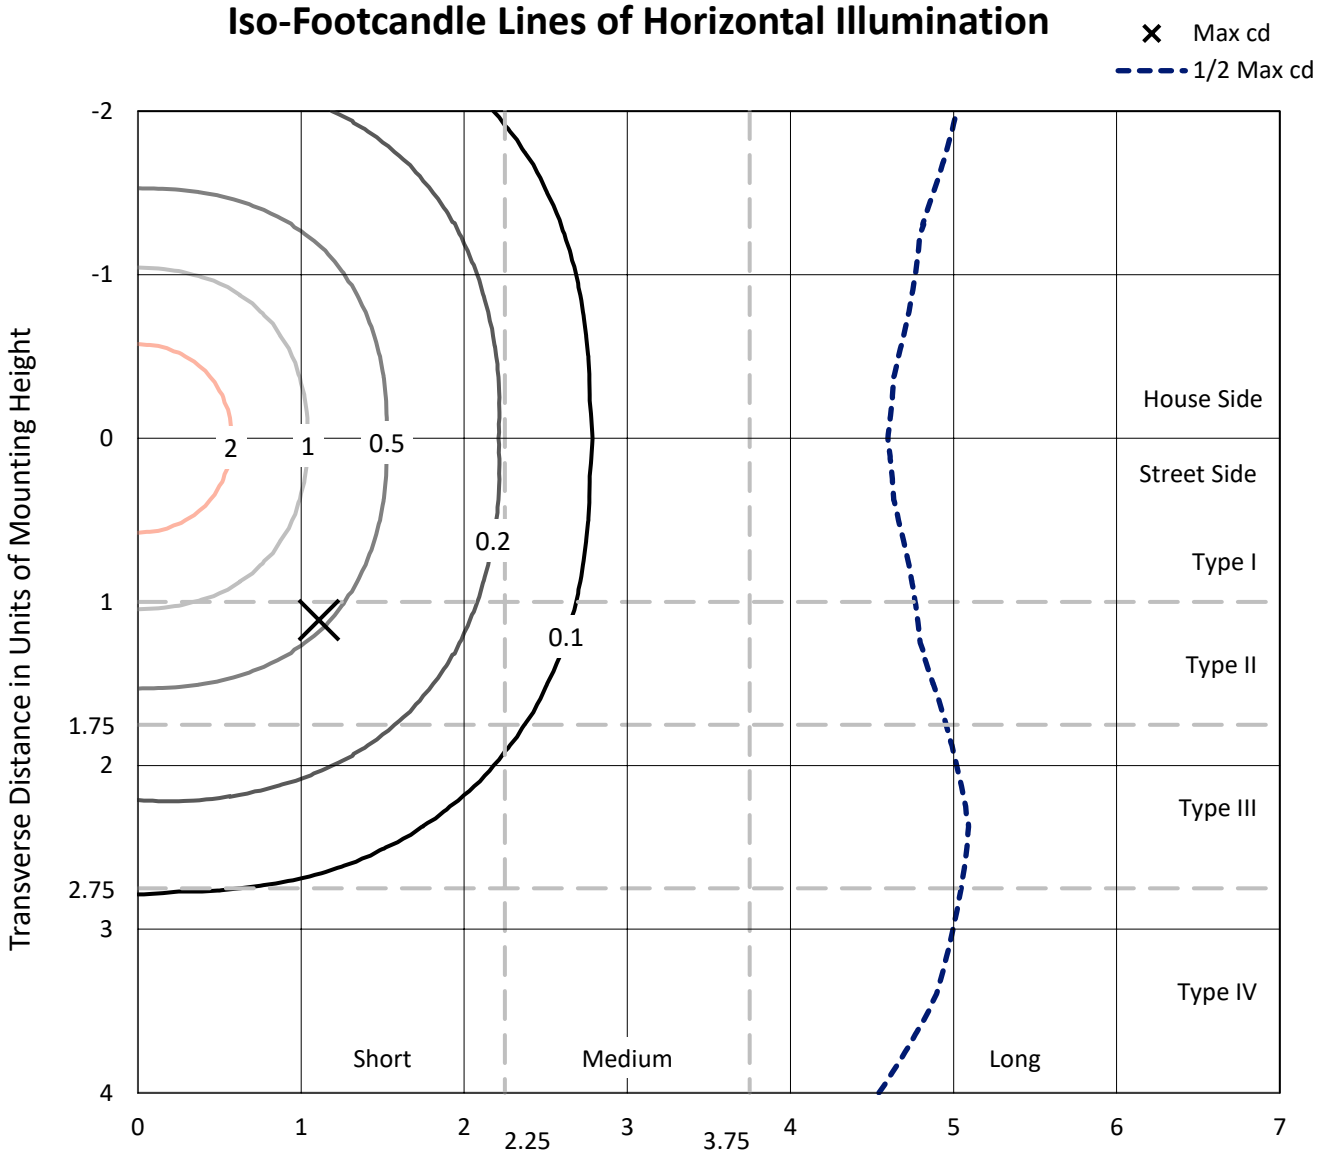


Based on 15 foot mounting height. Maximum calculated value = 3.2 fc
Type V - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821121
CATALOG NUMBER: TT-D1-830-24VDC-MQ-UPL

Luminous Intensity Polar Plot

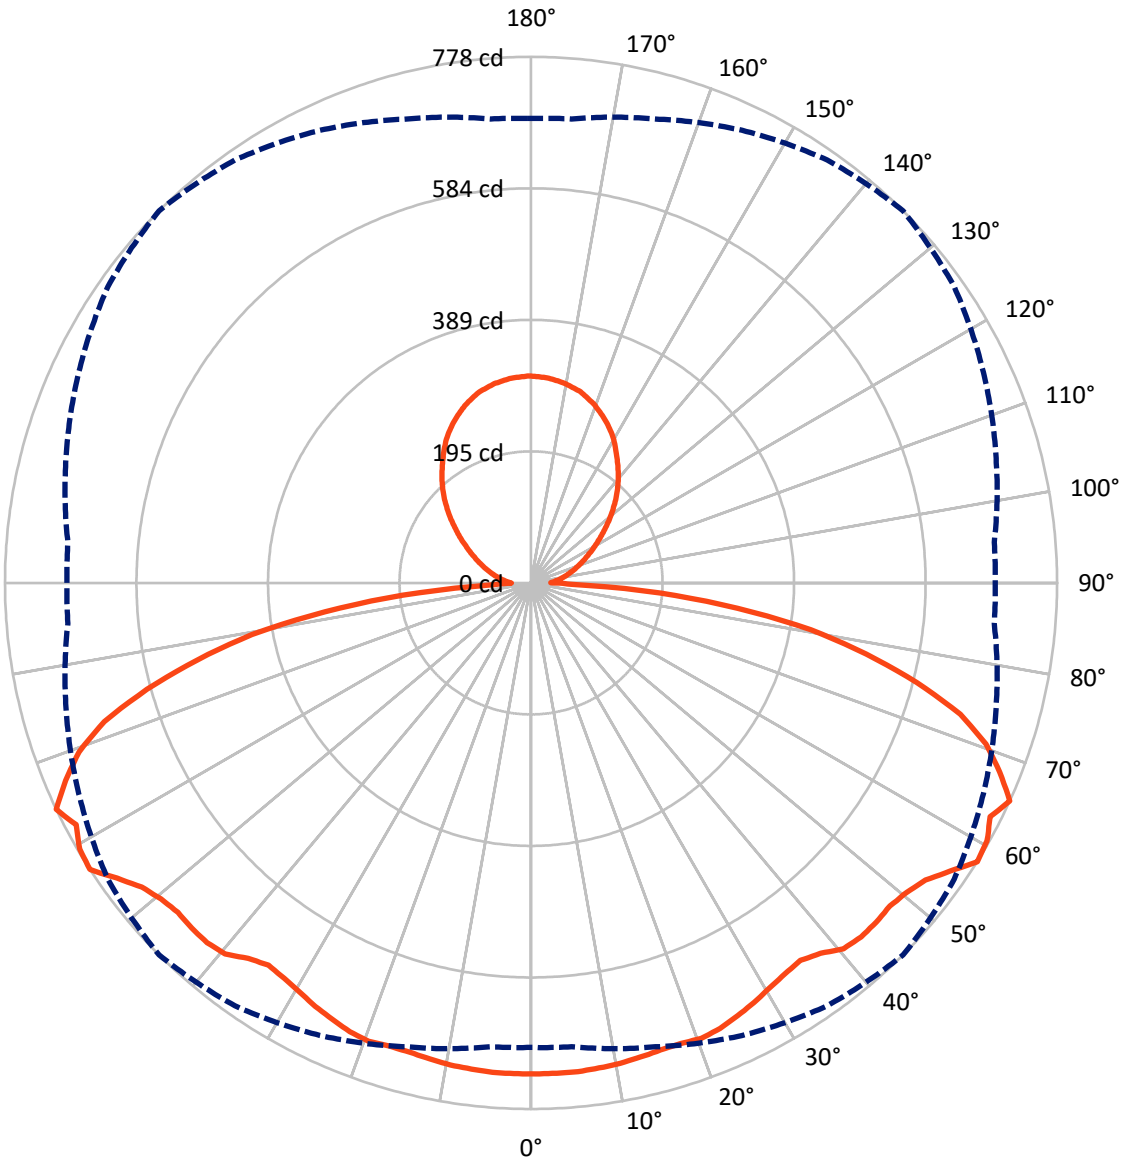

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P821121
CATALOG NUMBER: TT-D1-830-24VDC-MQ-UPL

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	1825.5	415.9	2241.4
	% Fixture	40.7	9.3	50.0
Street Side	Lumens	1825.5	415.9	2241.4
	% Fixture	40.7	9.3	50.0
Total	Lumens	3651.0	831.7	4482.7
	% Fixture	81.4	18.6	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	69.2	1.5
10°-20°	203.6	4.5
20°-30°	327.1	7.3
30°-40°	431.9	9.6
40°-50°	540.3	12.1
50°-60°	642.7	14.3
60°-70°	697.0	15.5
70°-80°	554.8	12.4
80°-90°	184.3	4.1
90°-100°	42.6	1.0
100°-110°	66.0	1.5
110°-120°	91.9	2.0
120°-130°	119.0	2.7
130°-140°	138.7	3.1
140°-150°	140.5	3.1
150°-160°	121.9	2.7
160°-170°	82.2	1.8
170°-180°	28.9	0.6
0°-90°	3651.0	81.4
0°-180°	4482.7	100.0

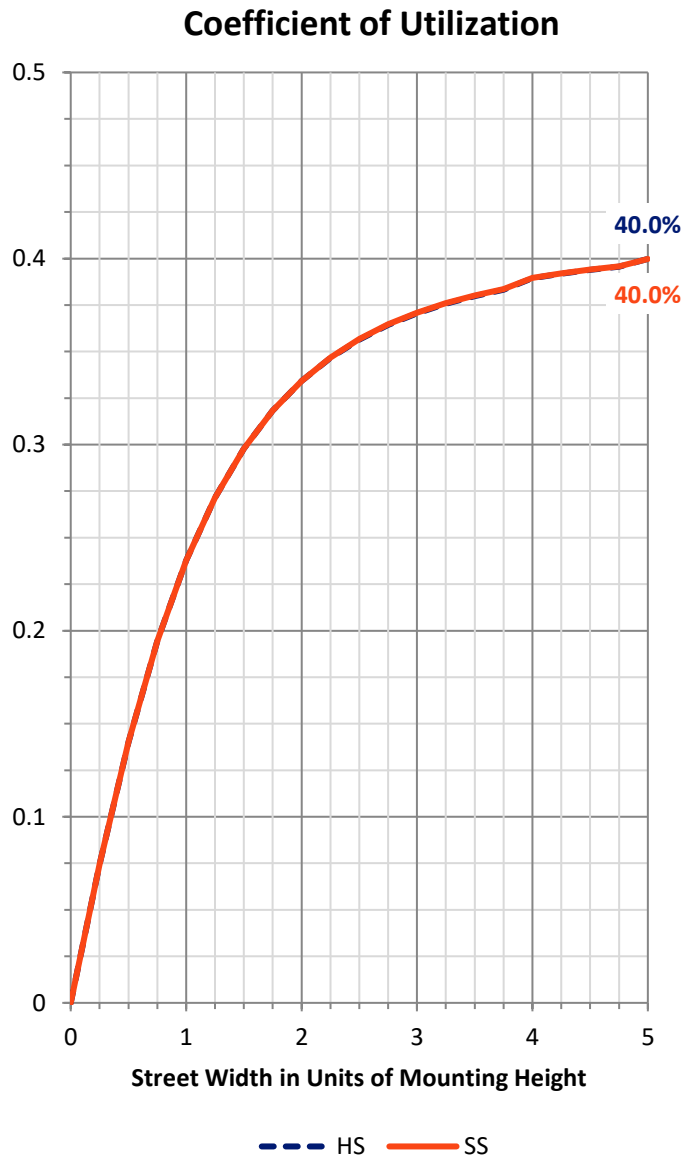

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P821121
CATALOG NUMBER: TT-D1-830-24VDC-MQ-UPL

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	300.0	6.7			
FM	(30°-60°)	807.4	18.0			
FH	(60°-80°)	625.9	14.0			G0/660
FVH	(80°-90°)	92.2	2.1			G1/100
BL	(0°-30°)	300.0	6.7	B1/500		
BM	(30°-60°)	807.4	18.0	B1/1000		
BH	(60°-80°)	625.9	14.0	B2/1000		G0/660
BVH	(80°-90°)	92.2	2.1			G1/100
UL	(90°-100°)	42.6	1.0		U2/50	
UH	(100°-180°)	789.1	17.6		U4/1000	

BUG Rating: B2-U4-G1
Type V Short

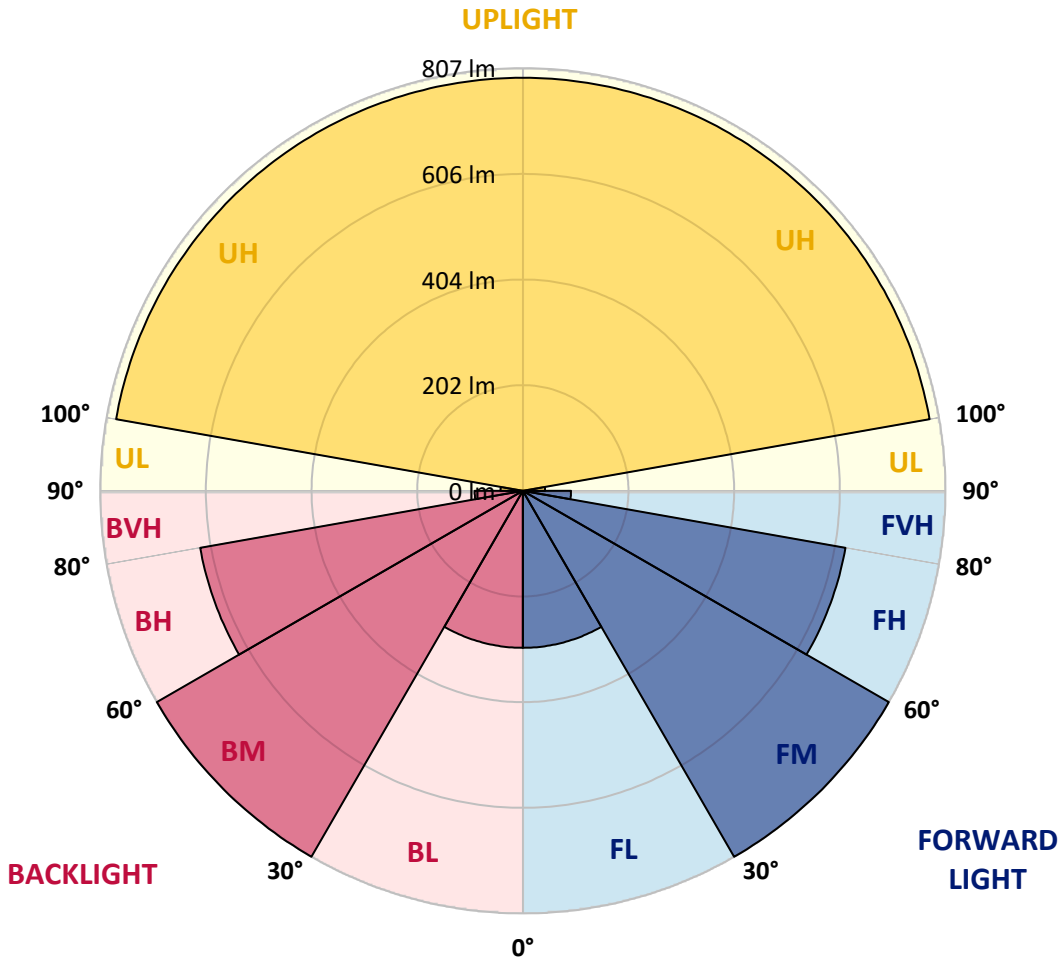

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821121
CATALOG NUMBER: TT-D1-830-24VDC-MQ-UPL

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
0°	726.4	726.4	726.4	726.4	726.4	726.4	726.4	726.4	726.4	726.4	726.4
2.5°	727.5	726.9	727.5	726.9	726.9	726.4	726.9	726.9	726.9	726.9	726.9
5°	726.9	726.4	726.4	726.9	726.4	726.4	726.4	726.4	726.4	726.4	726.4
7.5°	724.7	724.7	725.3	724.7	724.7	724.7	724.7	724.7	724.7	725.3	725.3
10°	723.1	722.6	723.1	723.1	722.6	723.1	722.6	723.1	723.1	723.1	723.1
12.5°	720.9	720.4	720.9	720.9	720.4	719.9	720.4	720.4	720.9	720.9	720.9
15°	717.1	717.1	718.2	717.7	717.7	717.1	718.2	717.7	717.1	717.7	717.7
17.5°	714.4	714.4	715.5	716.6	716.6	716.6	716.6	716.1	715.0	715.5	714.4
20°	715.0	715.5	716.1	717.7	718.8	719.3	719.3	717.7	716.1	716.6	716.1
22.5°	713.4	712.8	713.4	714.4	716.1	716.1	716.1	713.9	713.4	712.8	712.8
25°	706.8	706.8	707.9	709.0	710.1	709.6	710.1	709.0	707.9	706.8	706.8
27.5°	699.2	699.2	700.9	702.0	703.0	703.0	702.5	701.4	700.9	699.8	699.2
30°	691.7	691.7	693.3	694.4	696.0	695.4	695.4	693.8	692.2	691.1	691.1
32.5°	683.5	683.0	684.6	687.3	689.5	689.5	689.5	686.2	684.1	683.0	682.4
35°	676.5	676.5	678.6	683.5	686.2	686.2	685.1	683.0	678.1	676.5	676.5
37.5°	674.3	675.9	681.9	688.9	694.4	695.4	693.8	687.9	681.3	676.5	674.8
40°	681.3	683.0	690.6	702.0	710.1	711.7	710.1	701.4	690.0	682.4	681.9
42.5°	682.4	683.5	692.7	705.8	713.4	716.1	713.4	704.7	692.2	683.0	682.4
45°	678.6	679.2	690.0	703.6	712.8	716.1	712.8	702.5	689.5	679.2	678.6
47.5°	673.7	674.8	686.8	700.9	712.3	714.4	711.7	700.3	685.7	675.4	673.7
50°	670.0	673.2	684.1	699.8	713.4	719.9	713.4	698.2	683.5	672.1	670.0
52.5°	672.1	673.2	687.3	709.6	728.0	730.7	727.5	709.6	686.2	673.2	671.6
55°	678.6	683.5	698.7	730.7	747.5	752.4	745.4	729.6	699.2	683.5	678.6
57.5°	687.3	688.9	710.6	738.8	763.8	778.4	764.3	738.3	712.3	687.9	686.8
60°	680.3	675.4	702.5	735.6	769.2	775.2	767.1	736.1	701.4	674.8	679.7
62.5°	661.3	664.5	686.8	732.3	755.7	762.2	753.5	732.3	685.7	667.2	659.6
65°	646.1	665.6	690.0	722.6	760.0	778.4	760.5	721.5	691.1	662.4	644.5
67.5°	624.9	628.7	665.1	705.2	738.8	748.1	738.3	705.8	661.8	626.0	628.7
70°	589.1	583.7	620.6	667.2	699.2	713.9	700.3	665.1	619.0	582.6	587.5
72.5°	530.0	533.2	567.4	616.8	649.9	664.0	650.4	613.0	566.3	536.5	533.2
75°	468.2	472.0	505.0	550.1	583.7	589.7	585.9	547.4	506.1	471.4	468.2
77.5°	397.6	401.4	428.6	477.9	498.0	507.2	499.1	480.6	427.5	400.9	396.5
80°	319.5	318.4	342.3	384.6	409.6	419.9	409.6	385.7	341.2	320.6	313.5
82.5°	228.4	229.5	251.7	281.0	304.9	308.1	303.2	283.7	249.5	232.2	222.4
85°	126.9	131.8	148.1	169.8	185.5	191.0	182.8	164.4	147.6	134.0	129.7
87.5°	30.4	33.1	38.5	48.8	54.8	60.2	54.8	51.0	36.3	33.1	30.4
90°	30.1	29.1	29.1	29.1	29.1	29.1	29.1	29.1	29.1	29.1	29.1
92.5°	34.8	34.2	34.2	33.8	33.8	33.8	33.8	33.8	33.8	33.8	33.8
95°	39.4	39.4	39.4	38.5	38.5	38.5	38.5	38.5	38.5	38.5	38.5
97.5°	44.6	44.6	44.6	44.2	44.2	44.2	44.2	44.2	44.2	44.2	44.2
100°	49.8	49.8	49.8	49.8	49.8	49.8	49.8	49.8	49.8	49.8	49.8
102.5°	55.9	55.9	55.9	55.9	55.9	55.9	55.9	56.4	55.9	55.9	55.9
105°	62.0	62.0	62.0	62.0	62.0	62.0	62.0	62.9	62.0	62.0	62.0
107.5°	68.6	68.6	69.0	69.0	69.0	69.0	69.0	69.5	69.0	69.0	69.0
110°	75.1	75.1	76.1	76.1	76.1	76.1	76.1	76.1	76.1	76.1	76.1

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821121
CATALOG NUMBER: TT-D1-830-24VDC-MQ-UPL

CANDELA DISTRIBUTION (continued):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
112.5°	83.1	83.1	84.0	84.0	84.0	*84.0*	84.6	84.6	84.0	84.0	84.0
115°	91.1	91.1	92.0	92.0	92.0	*92.0*	93.0	93.0	92.0	92.0	92.0
117.5°	100.5	100.5	101.0	101.4	101.4	*101.4*	102.4	102.4	101.4	101.4	101.4
120°	109.9	109.9	109.9	110.8	110.8	*110.8*	111.8	111.8	110.8	110.8	110.8
122.5°	120.7	120.7	121.2	121.6	121.6	*121.6*	122.6	122.6	122.1	122.1	121.6
125°	131.5	131.5	132.4	132.4	132.4	*132.4*	133.4	133.4	133.4	133.4	132.4
127.5°	143.2	143.2	144.2	144.2	144.2	*144.2*	145.1	145.1	145.1	145.1	144.2
130°	155.0	155.0	155.9	155.9	155.9	*155.9*	156.8	156.8	156.8	156.8	155.9
132.5°	167.2	167.2	167.6	167.6	167.6	*168.1*	168.6	168.6	168.6	168.6	168.1
135°	179.4	179.4	179.4	179.4	179.4	*180.3*	180.3	180.3	180.3	180.3	180.3
137.5°	191.2	190.6	191.2	190.6	191.2	*191.6*	191.6	191.6	191.6	191.6	191.6
140°	202.9	201.9	202.9	201.9	202.9	*202.9*	202.9	202.9	202.9	202.9	202.9
142.5°	213.7	213.2	213.7	212.7	213.7	*213.7*	213.7	213.7	213.7	213.7	213.7
145°	224.5	224.5	224.5	223.5	224.5	*224.5*	224.5	224.5	224.5	224.5	224.5
147.5°	235.8	235.3	235.8	234.8	235.8	*235.8*	235.8	235.8	235.8	235.8	235.8
150°	247.0	246.1	247.0	246.1	247.0	*247.0*	247.0	247.0	247.0	247.0	247.0
152.5°	256.0	255.5	256.4	255.5	256.0	*256.0*	256.4	256.0	256.0	256.0	256.0
155°	264.9	264.9	265.8	264.9	264.9	*264.9*	265.8	264.9	264.9	264.9	264.9
157.5°	272.4	272.4	273.3	272.4	272.4	*272.4*	273.3	272.4	272.4	272.4	272.4
160°	279.9	279.9	280.8	279.9	279.9	*279.9*	280.8	279.9	279.9	279.9	279.9
162.5°	286.0	286.0	286.9	286.0	286.0	*286.0*	286.9	286.0	286.0	286.0	286.0
165°	292.1	292.1	293.0	292.1	292.1	*292.1*	293.0	292.1	292.1	292.1	292.1
167.5°	295.8	295.8	296.8	295.8	295.8	*295.8*	296.8	295.8	295.8	295.8	295.8
170°	299.6	299.6	300.5	299.6	299.6	*299.6*	300.5	299.6	299.6	299.6	299.6
172.5°	302.0	302.0	302.8	302.0	302.4	*302.0*	302.8	302.0	302.0	302.0	302.0
175°	304.3	304.3	305.2	304.3	305.2	*304.3*	305.2	304.3	304.3	304.3	304.3
177.5°	305.2	305.2	305.7	305.2	305.7	*305.2*	305.7	305.2	305.2	305.2	305.2
180°	306.2	306.2	306.2	306.2	306.2	*306.2*	306.2	306.2	306.2	306.2	306.2

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Streetworks

Report Number: SP1-2407-176-7

Test Date: 09/27/2024

Luminaire Tested: MEM2-HTN-VA-30-830-U-WQ

Data in this report applies to families of products including MEM2-HTN-VA-30-830-U-WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-176-7
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	09/27/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	Streetworks
Catalog Number:	**MEM2-HTN-VA-30-830-U-WQ**
Description:	EPIC MODERN VISUAL COMFORT 30W WAVESTREAM WIDE

Spectral Parameters

CCT (K):	2984	CRI (Ra):	81.8		
CIE u':	0.2500	R1:	79.4	R9:	-1.1
CIE v':	0.5264	R2:	89.9	R10:	78.4
Duv:	0.0033	R3:	96.6	R11:	80.8
CIE x:	0.4431	R4:	80.6	R12:	72.8
CIE y:	0.4147	R5:	80.1	R13:	81.7
CIE z:	0.1422	R6:	88.9	R14:	98.5
Peak Wavelength (nm):	601	R7:	82.6	R15:	70.2
Dominant Wavelength (nm):	581	R8:	56.0		
Purity:	57.4798				

Rf:	85.8
Rg:	94.1

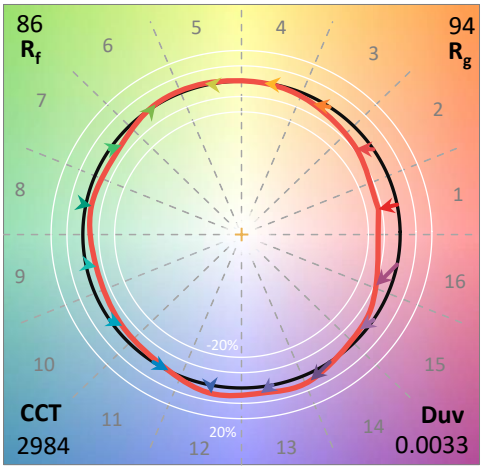

Test Conditions


Stabilization Time:	29M
Operation Time:	1H 29M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-176-7


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-176-7

CIE 1931 Chromaticity Diagram

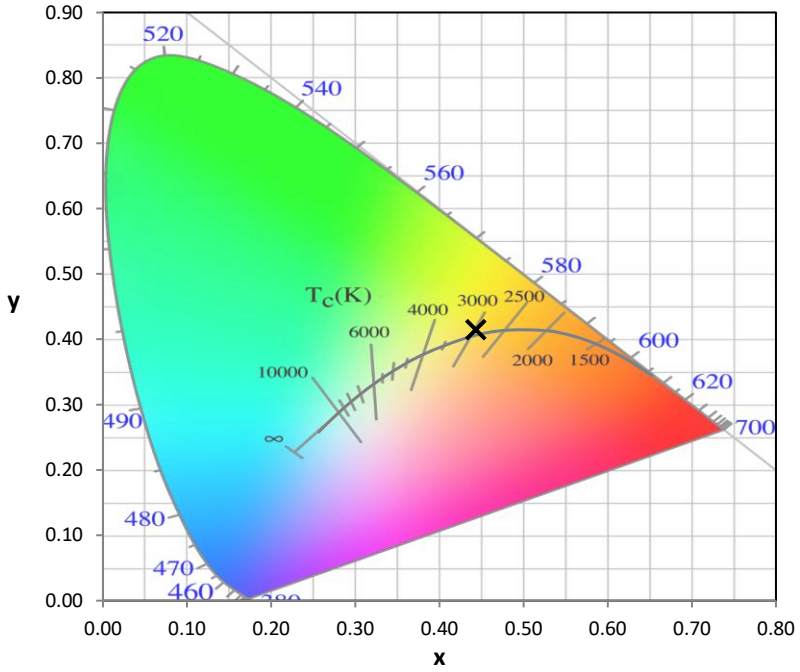

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

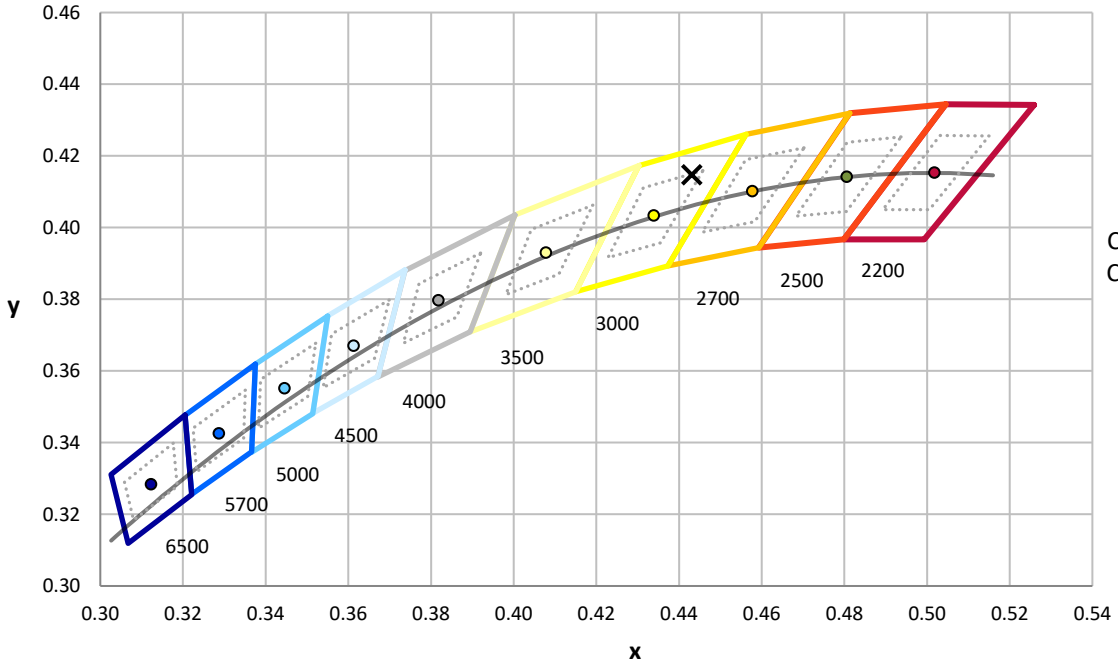


CCT = 2984K
CIE x = 0.4431
CIE y = 0.4147
Duv = 0.0033

Point lies inside the ANSI 3000K 4-step quadrangle

REPORT NUMBER: SP1-2407-176-7

Photopic Flux vs. Wavelength

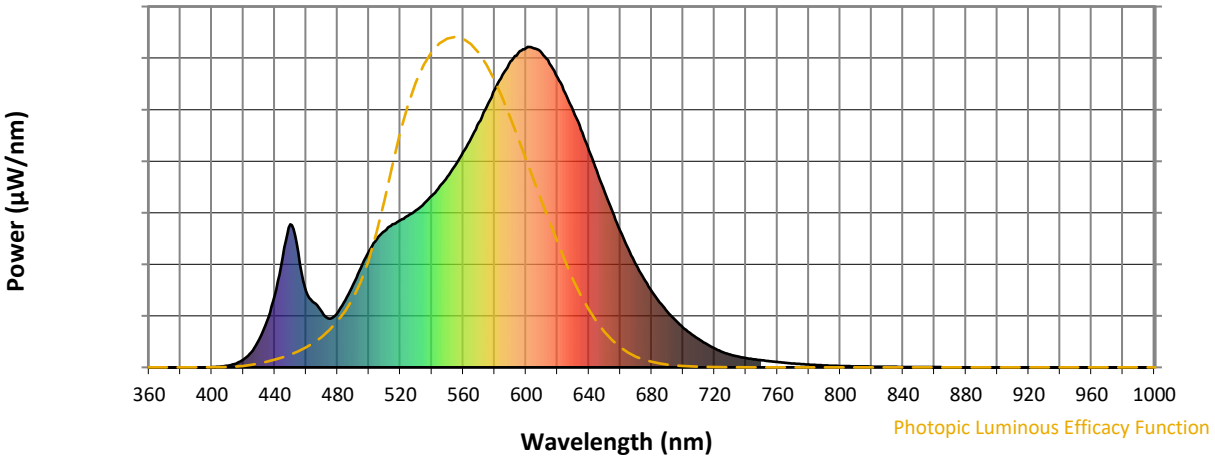


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	260	NR	620	905	NR	750	22	NR	880	0	NR
365	0	NR	495	312	NR	625	856	NR	755	19	NR	885	0	NR
370	0	NR	500	362	NR	630	801	NR	760	17	NR	890	0	NR
375	0	NR	505	399	NR	635	742	NR	765	14	NR	895	0	NR
380	0	NR	510	425	NR	640	677	NR	770	12	NR	900	0	NR
385	0	NR	515	446	NR	645	613	NR	775	10	NR	905	0	NR
390	0	NR	520	459	NR	650	549	NR	780	9	NR	910	0	NR
395	0	NR	525	473	NR	655	485	NR	785	7	NR	915	0	NR
400	1	NR	530	490	NR	660	425	NR	790	6	NR	920	0	NR
405	2	NR	535	511	NR	665	371	NR	795	5	NR	925	0	NR
410	5	NR	540	535	NR	670	321	NR	800	4	NR	930	0	NR
415	11	NR	545	565	NR	675	276	NR	805	4	NR	935	0	NR
420	24	NR	550	595	NR	680	238	NR	810	3	NR	940	0	NR
425	47	NR	555	631	NR	685	203	NR	815	3	NR	945	0	NR
430	86	NR	560	672	NR	690	174	NR	820	2	NR	950	0	NR
435	144	NR	565	715	NR	695	148	NR	825	2	NR	955	0	NR
440	224	NR	570	763	NR	700	124	NR	830	2	NR	960	0	NR
445	342	NR	575	814	NR	705	105	NR	835	2	NR	965	0	NR
450	446	NR	580	866	NR	710	88	NR	840	1	NR	970	0	NR
455	357	NR	585	912	NR	715	73	NR	845	1	NR	975	0	NR
460	237	NR	590	954	NR	720	59	NR	850	1	NR	980	0	NR
465	202	NR	595	981	NR	725	48	NR	855	1	NR	985	0	NR
470	172	NR	600	996	NR	730	40	NR	860	1	NR	990	0	NR
475	152	NR	605	996	NR	735	34	NR	865	1	NR	995	0	NR
480	171	NR	610	980	NR	740	29	NR	870	0	NR	1000	0	NR
485	210	NR	615	947	NR	745	25	NR	875	0	NR			

REPORT NUMBER: SP1-2407-176-7

Scotopic Flux vs. Wavelength

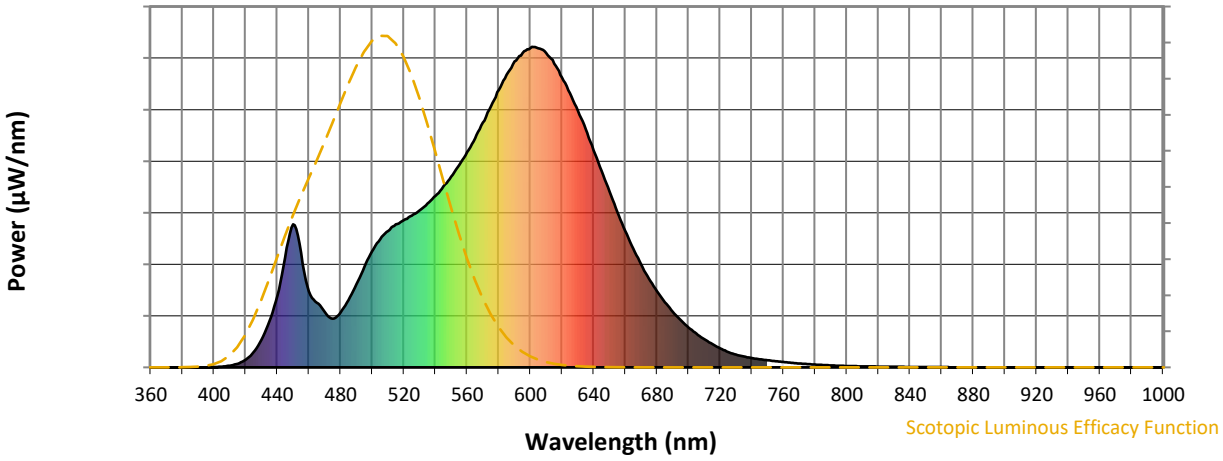


Scotopic Lumens: NR **S/P: 1.32**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	260	NR	620	905	NR	750	22	NR	880	0	NR
365	0	NR	495	312	NR	625	856	NR	755	19	NR	885	0	NR
370	0	NR	500	362	NR	630	801	NR	760	17	NR	890	0	NR
375	0	NR	505	399	NR	635	742	NR	765	14	NR	895	0	NR
380	0	NR	510	425	NR	640	677	NR	770	12	NR	900	0	NR
385	0	NR	515	446	NR	645	613	NR	775	10	NR	905	0	NR
390	0	NR	520	459	NR	650	549	NR	780	9	NR	910	0	NR
395	0	NR	525	473	NR	655	485	NR	785	7	NR	915	0	NR
400	1	NR	530	490	NR	660	425	NR	790	6	NR	920	0	NR
405	2	NR	535	511	NR	665	371	NR	795	5	NR	925	0	NR
410	5	NR	540	535	NR	670	321	NR	800	4	NR	930	0	NR
415	11	NR	545	565	NR	675	276	NR	805	4	NR	935	0	NR
420	24	NR	550	595	NR	680	238	NR	810	3	NR	940	0	NR
425	47	NR	555	631	NR	685	203	NR	815	3	NR	945	0	NR
430	86	NR	560	672	NR	690	174	NR	820	2	NR	950	0	NR
435	144	NR	565	715	NR	695	148	NR	825	2	NR	955	0	NR
440	224	NR	570	763	NR	700	124	NR	830	2	NR	960	0	NR
445	342	NR	575	814	NR	705	105	NR	835	2	NR	965	0	NR
450	446	NR	580	866	NR	710	88	NR	840	1	NR	970	0	NR
455	357	NR	585	912	NR	715	73	NR	845	1	NR	975	0	NR
460	237	NR	590	954	NR	720	59	NR	850	1	NR	980	0	NR
465	202	NR	595	981	NR	725	48	NR	855	1	NR	985	0	NR
470	172	NR	600	996	NR	730	40	NR	860	1	NR	990	0	NR
475	152	NR	605	996	NR	735	34	NR	865	1	NR	995	0	NR
480	171	NR	610	980	NR	740	29	NR	870	0	NR	1000	0	NR
485	210	NR	615	947	NR	745	25	NR	875	0	NR			

REPORT NUMBER: SP1-2407-176-7

Melanopic Flux vs. Wavelength

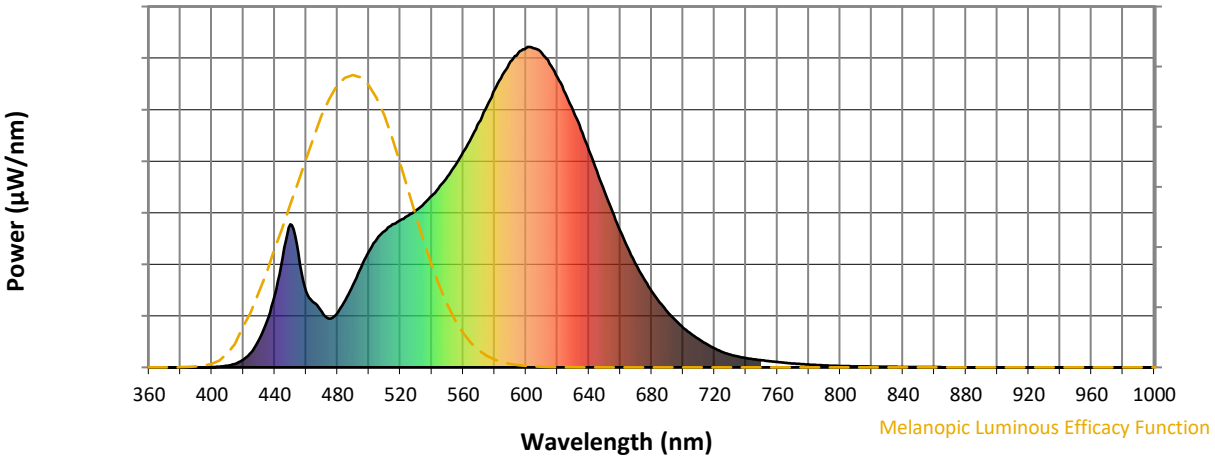

Melanopic Lumens: NR **M/P: 2.51**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	260	NR	620	905	NR	750	22	NR	880	0	NR
365	0	NR	495	312	NR	625	856	NR	755	19	NR	885	0	NR
370	0	NR	500	362	NR	630	801	NR	760	17	NR	890	0	NR
375	0	NR	505	399	NR	635	742	NR	765	14	NR	895	0	NR
380	0	NR	510	425	NR	640	677	NR	770	12	NR	900	0	NR
385	0	NR	515	446	NR	645	613	NR	775	10	NR	905	0	NR
390	0	NR	520	459	NR	650	549	NR	780	9	NR	910	0	NR
395	0	NR	525	473	NR	655	485	NR	785	7	NR	915	0	NR
400	1	NR	530	490	NR	660	425	NR	790	6	NR	920	0	NR
405	2	NR	535	511	NR	665	371	NR	795	5	NR	925	0	NR
410	5	NR	540	535	NR	670	321	NR	800	4	NR	930	0	NR
415	11	NR	545	565	NR	675	276	NR	805	4	NR	935	0	NR
420	24	NR	550	595	NR	680	238	NR	810	3	NR	940	0	NR
425	47	NR	555	631	NR	685	203	NR	815	3	NR	945	0	NR
430	86	NR	560	672	NR	690	174	NR	820	2	NR	950	0	NR
435	144	NR	565	715	NR	695	148	NR	825	2	NR	955	0	NR
440	224	NR	570	763	NR	700	124	NR	830	2	NR	960	0	NR
445	342	NR	575	814	NR	705	105	NR	835	2	NR	965	0	NR
450	446	NR	580	866	NR	710	88	NR	840	1	NR	970	0	NR
455	357	NR	585	912	NR	715	73	NR	845	1	NR	975	0	NR
460	237	NR	590	954	NR	720	59	NR	850	1	NR	980	0	NR
465	202	NR	595	981	NR	725	48	NR	855	1	NR	985	0	NR
470	172	NR	600	996	NR	730	40	NR	860	1	NR	990	0	NR
475	152	NR	605	996	NR	735	34	NR	865	1	NR	995	0	NR
480	171	NR	610	980	NR	740	29	NR	870	0	NR	1000	0	NR
485	210	NR	615	947	NR	745	25	NR	875	0	NR			


REPORT NUMBER: SP1-2407-176-7

TM-30-18


Summary


R_f = 85.8
R_g = 94.1
CIE R_a = 81.8
R_9 = -1.1


Spectral Power Distribution Comparison

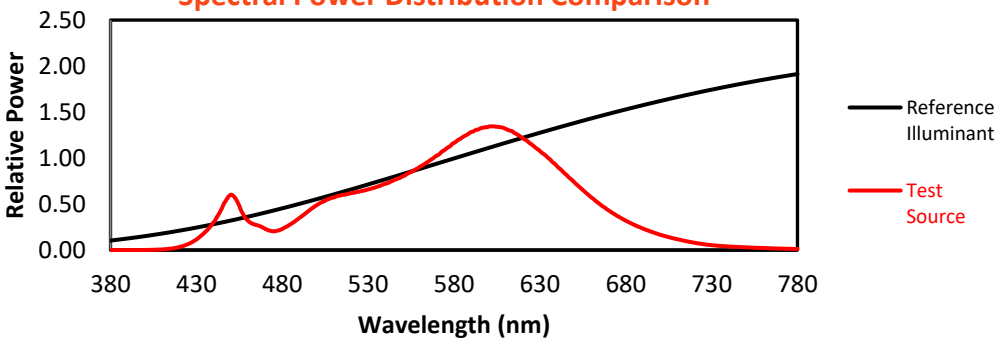


Color Vector Graphics

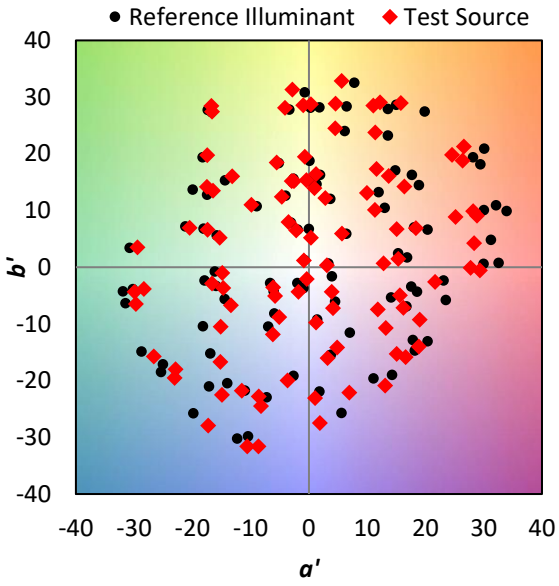

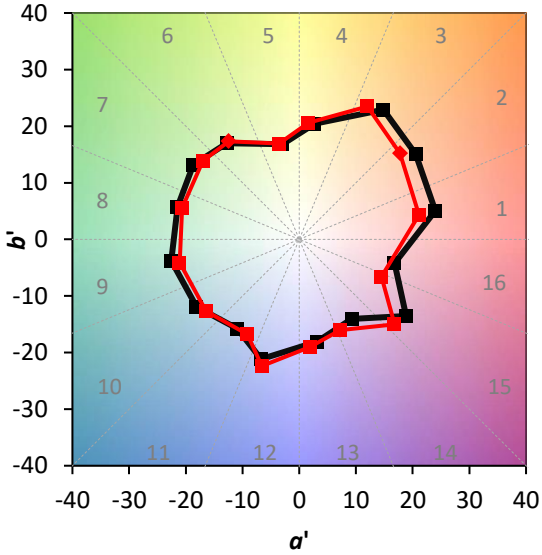

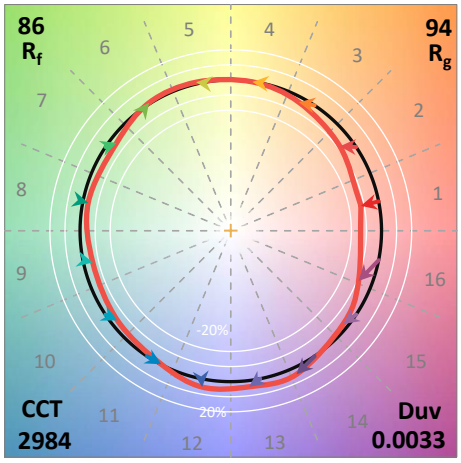

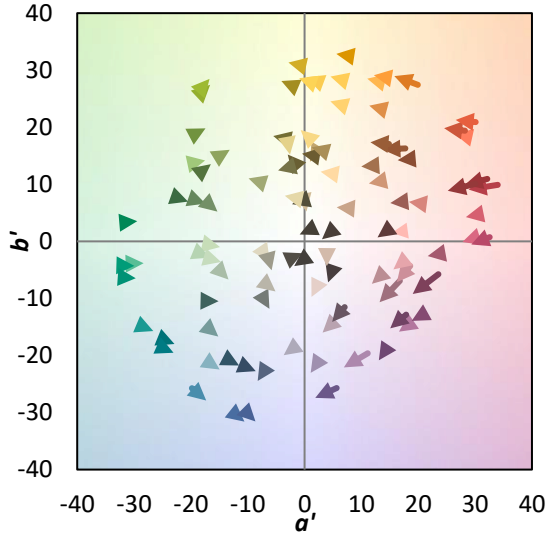


REPORT NUMBER: SP1-2407-176-7

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 86	CES51 = 95	CES76 = 84
CES02 = 63	CES27 = 95	CES52 = 94	CES77 = 86
CES03 = 31	CES28 = 95	CES53 = 90	CES78 = 83
CES04 = 70	CES29 = 89	CES54 = 91	CES79 = 90
CES05 = 50	CES30 = 95	CES55 = 91	CES80 = 90
CES06 = 51	CES31 = 91	CES56 = 87	CES81 = 70
CES07 = 42	CES32 = 85	CES57 = 86	CES82 = 96
CES08 = 41	CES33 = 93	CES58 = 87	CES83 = 94
CES09 = 29	CES34 = 94	CES59 = 92	CES84 = 92
CES10 = 76	CES35 = 97	CES60 = 94	CES85 = 77
CES11 = 59	CES36 = 90	CES61 = 90	CES86 = 66
CES12 = 65	CES37 = 97	CES62 = 94	CES87 = 84
CES13 = 43	CES38 = 97	CES63 = 88	CES88 = 86
CES14 = 74	CES39 = 98	CES64 = 84	CES89 = 75
CES15 = 72	CES40 = 95	CES65 = 80	CES90 = 88
CES16 = 47	CES41 = 97	CES66 = 83	CES91 = 81
CES17 = 50	CES42 = 99	CES67 = 82	CES92 = 64
CES18 = 56	CES43 = 93	CES68 = 84	CES93 = 79
CES19 = 72	CES44 = 99	CES69 = 89	CES94 = 60
CES20 = 67	CES45 = 94	CES70 = 82	CES95 = 74
CES21 = 87	CES46 = 90	CES71 = 81	CES96 = 83
CES22 = 79	CES47 = 93	CES72 = 93	CES97 = 89
CES23 = 92	CES48 = 83	CES73 = 77	CES98 = 84
CES24 = 91	CES49 = 92	CES74 = 92	CES99 = 75
CES25 = 72	CES50 = 95	CES75 = 83	

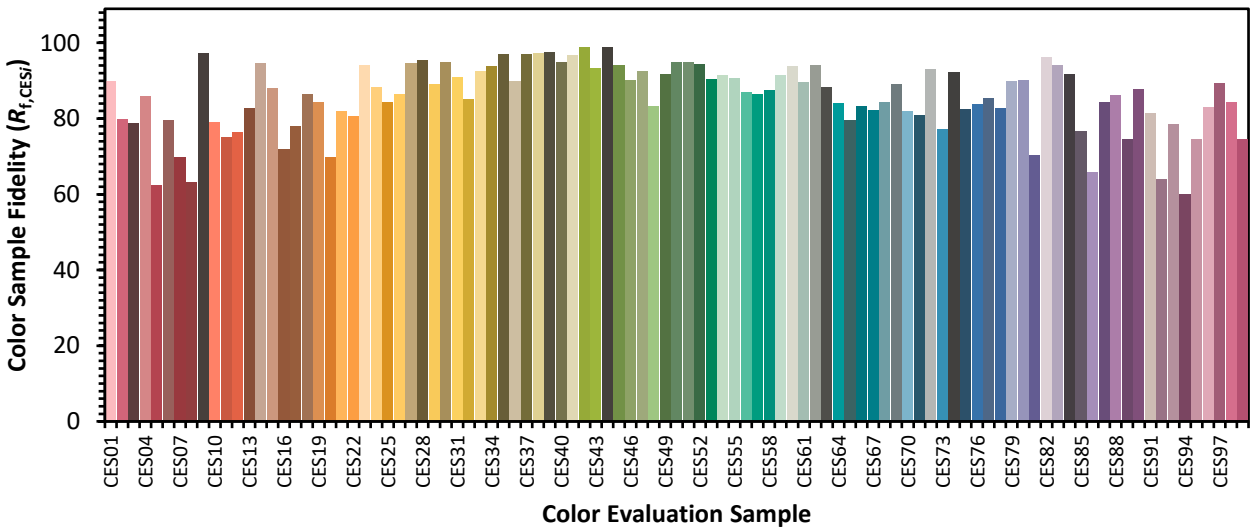



REPORT NUMBER: SP1-2407-176-7

TM-30-18

Color Rendition by Hue-Angle Bin

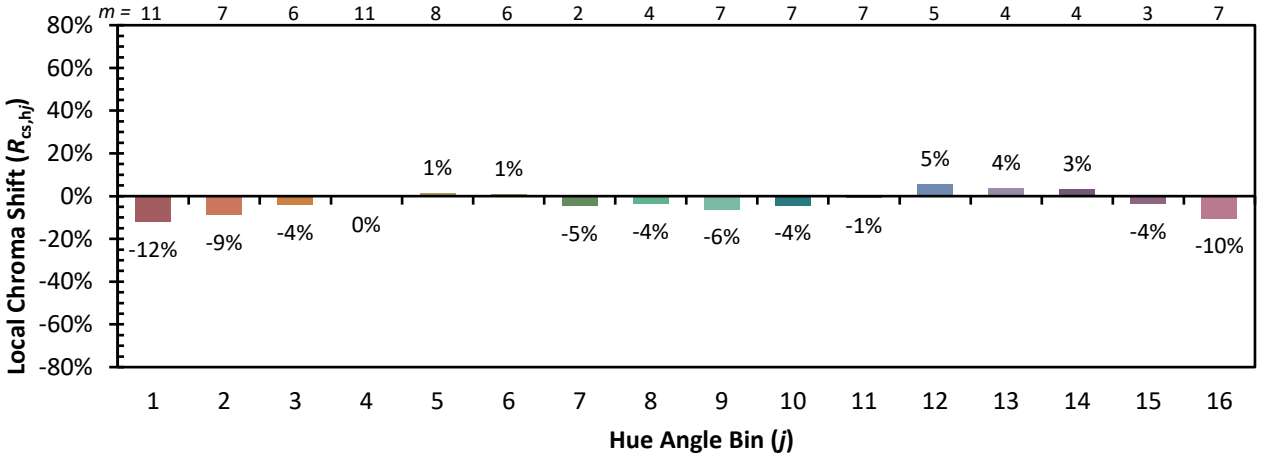

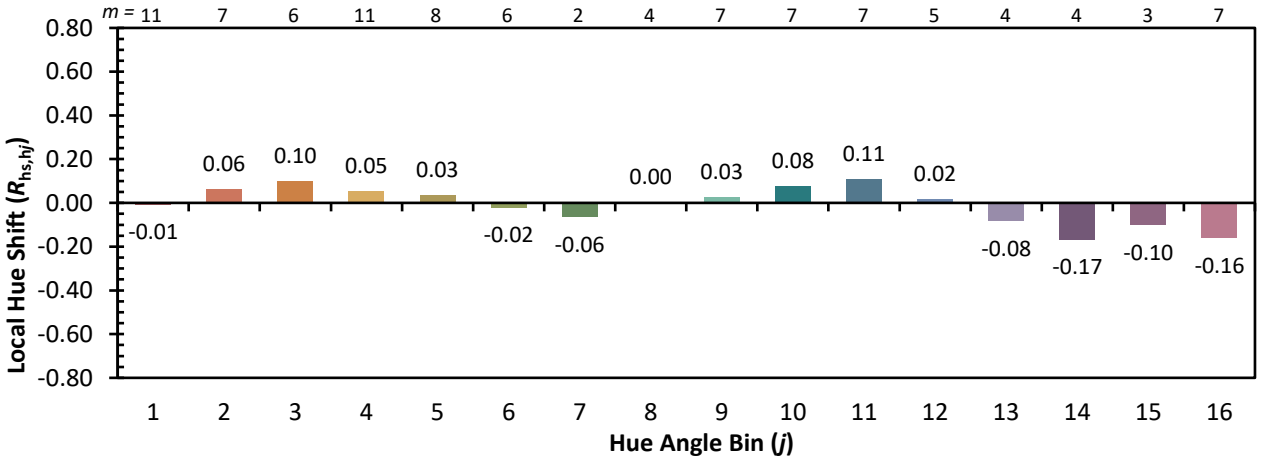


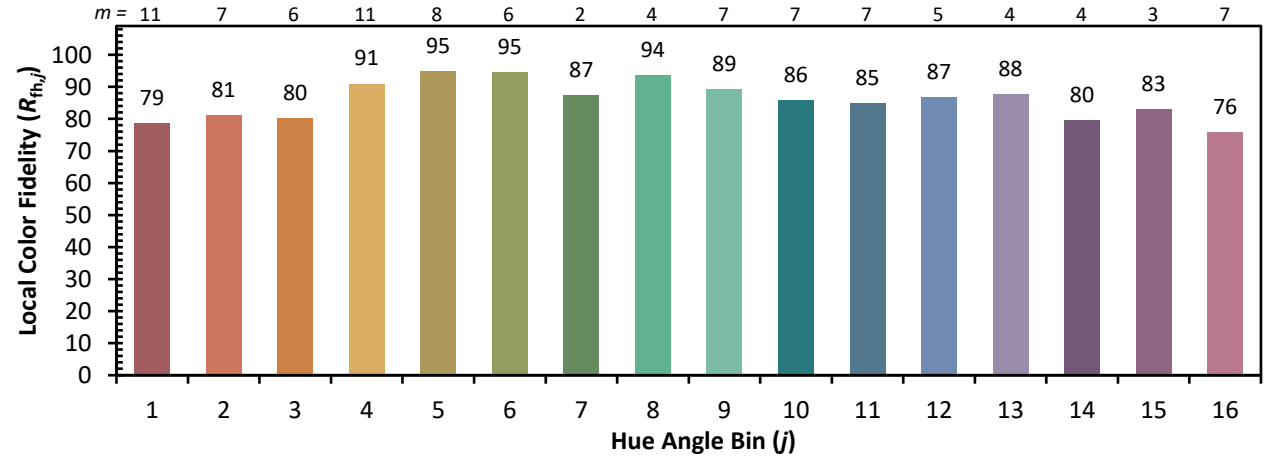


REPORT NUMBER: SP1-2407-176-7

TM-30-18

Measure Comparisons

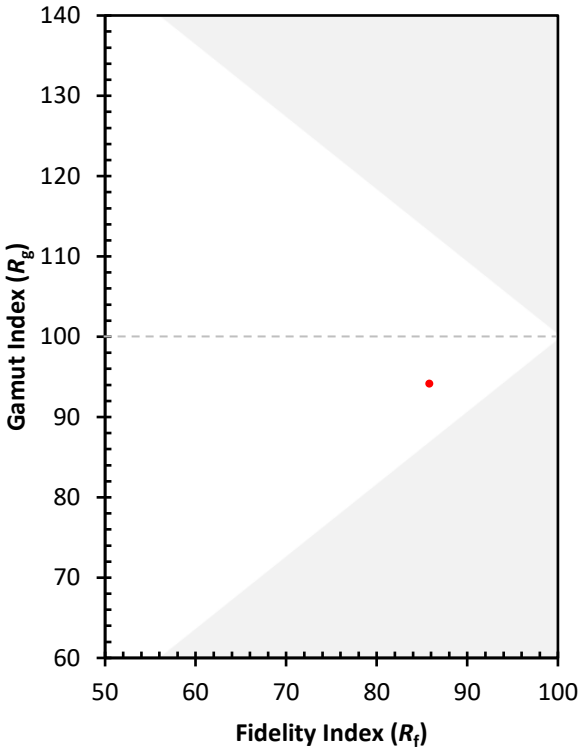

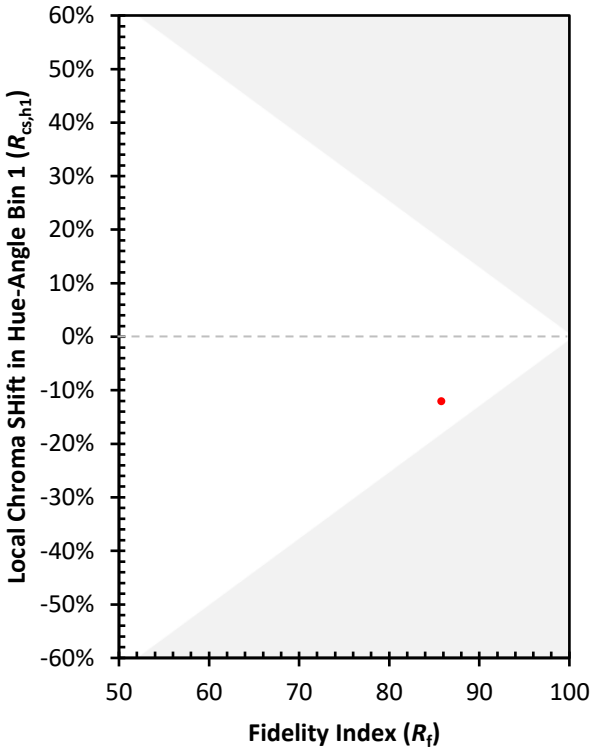

(END OF REPORT)