Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P821240

Luminaire Tested: **TT-D4-735-24VDC-MQ-UPL**

Issue Date: 7/23/2020

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P821240
	REPORT IS FROM IESNA LM-79-08 TEST DATA - UPLIGHT (G2-2002-677-2) AND
Test Lab:	INNOVATION CENTER
Issue Date:	7/23/2020
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	TT-D4-735-24VDC-MQ-UPL
Description:	TOPTIER LED PARKING GARAGE LUMINAIRE WITH UPLIGHT
	3500K, 70 CRI LEDS AND MEDIUM DISTRIBUTION
Light Source:	-
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	8399.7 lumens
Efficiency:	N/A
Efficacy:	147.4 lumens/watt
Luminous Opening:	Vertical Cylinder (Dia: 1.12' x H: 0.1')
IES Classification:	Type V - Short
BUG Rating:	B3 - U4 - G2


Input Watts (W):	57
Input Voltage (V):	NR
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	25 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821240
CATALOG NUMBER: TT-D4-735-24VDC-MQ-UPL

Iso-Footcandle Lines of Horizontal Illumination

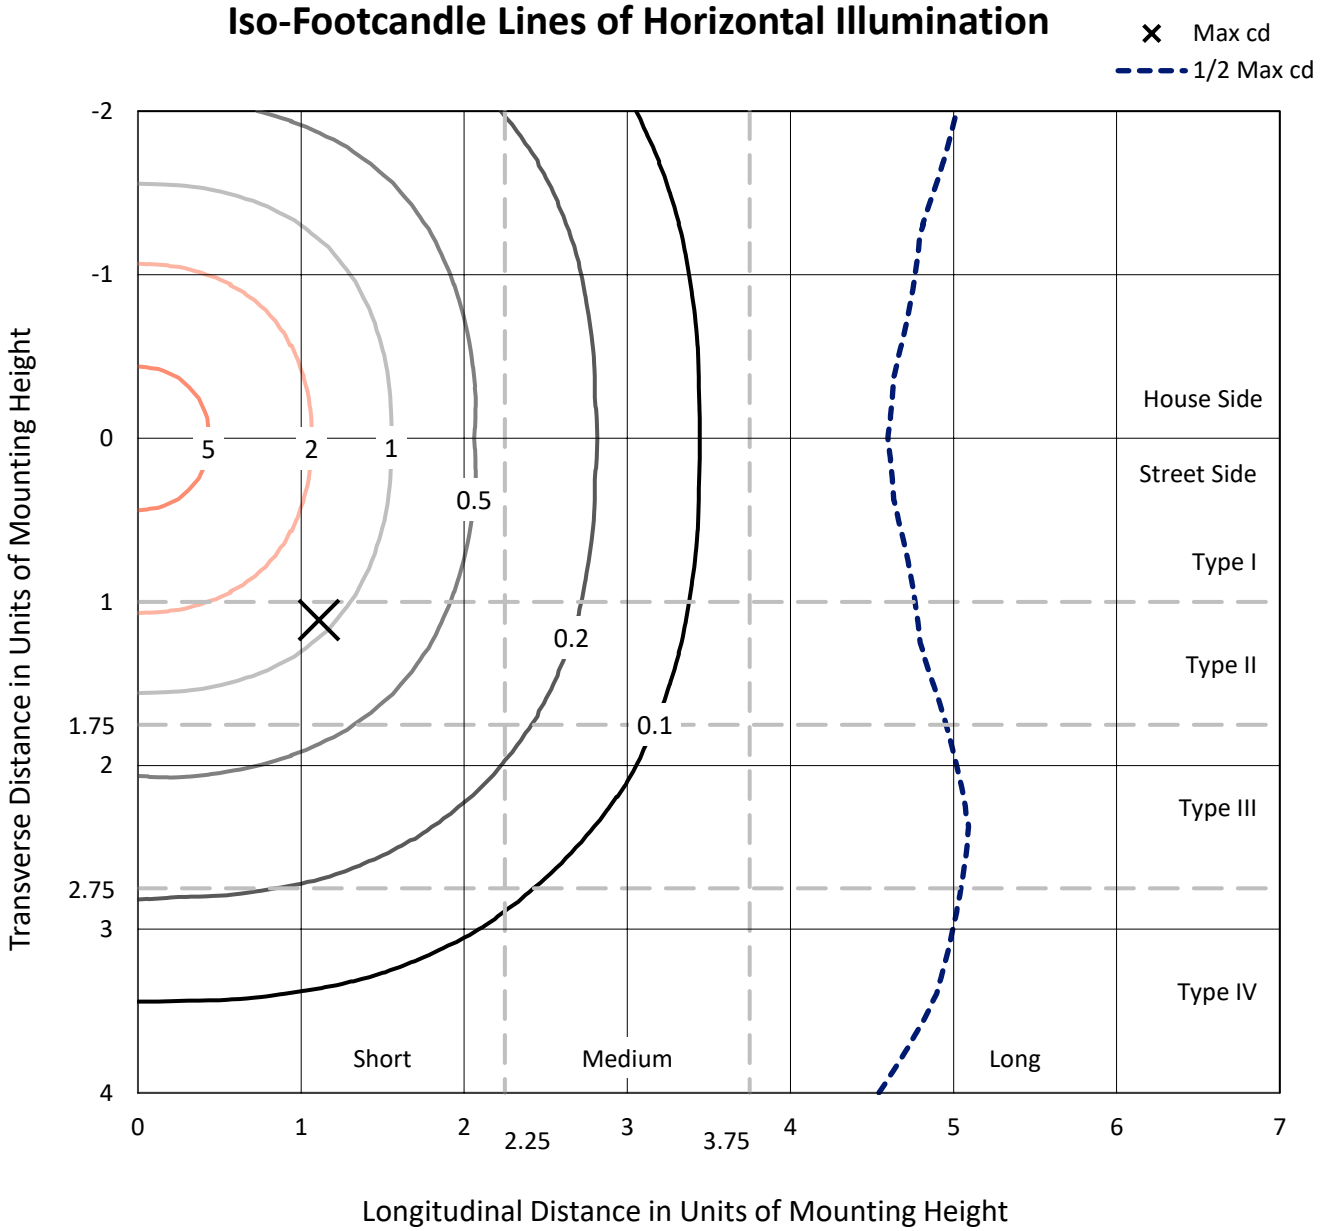


Based on 15 foot mounting height. Maximum calculated value = 6.7 fc
Type V - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821240
CATALOG NUMBER: TT-D4-735-24VDC-MQ-UPL

Luminous Intensity Polar Plot

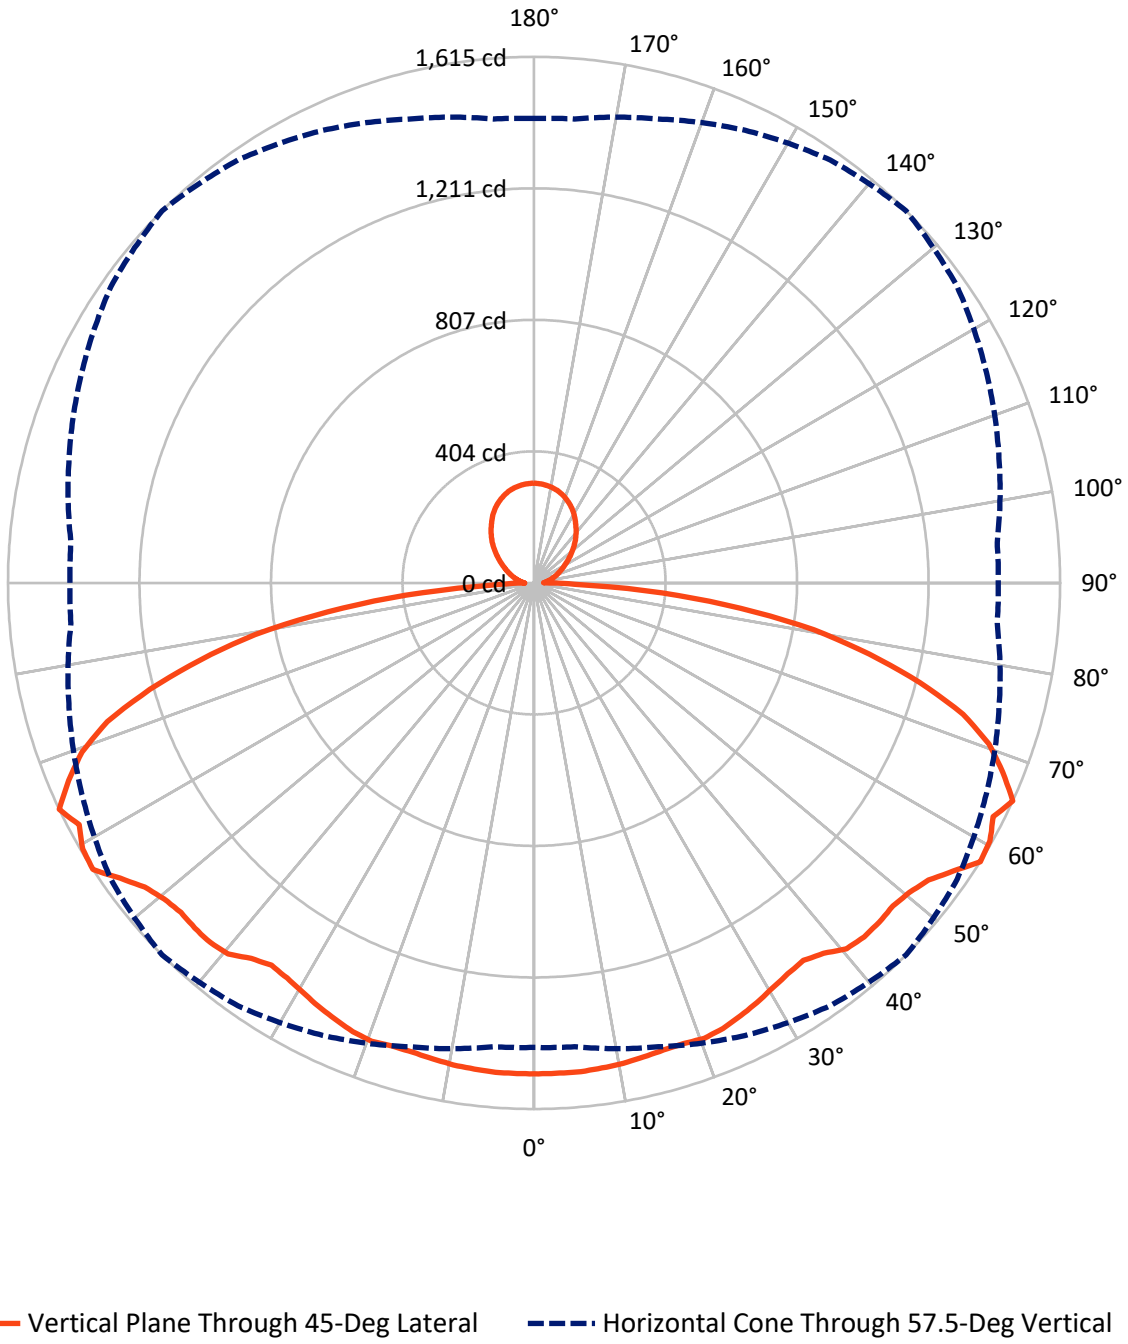

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P821240
CATALOG NUMBER: TT-D4-735-24VDC-MQ-UPL

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	3784.0	415.9	4199.9
	% Fixture	45.0	5.0	50.0
Street Side	Lumens	3784.0	415.9	4199.9
	% Fixture	45.0	5.0	50.0
Total	Lumens	7568.0	831.7	8399.7
	% Fixture	90.1	9.9	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	143.6	1.7
10°-20°	422.2	5.0
20°-30°	678.5	8.1
30°-40°	895.7	10.7
40°-50°	1120.6	13.3
50°-60°	1332.9	15.9
60°-70°	1445.7	17.2
70°-80°	1150.7	13.7
80°-90°	378.0	4.5
90°-100°	42.6	0.5
100°-110°	66.0	0.8
110°-120°	91.9	1.1
120°-130°	119.0	1.4
130°-140°	138.7	1.7
140°-150°	140.5	1.7
150°-160°	121.9	1.5
160°-170°	82.2	1.0
170°-180°	28.9	0.3
0°-90°	7568.0	90.1
0°-180°	8399.7	100.0

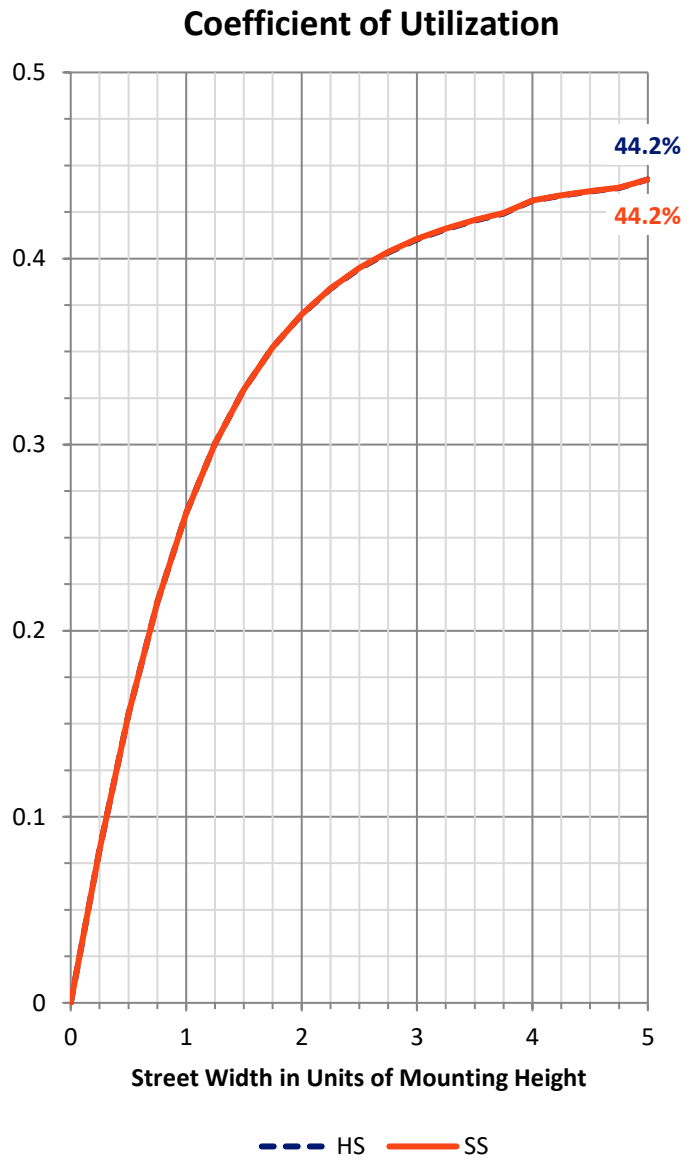

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P821240
CATALOG NUMBER: TT-D4-735-24VDC-MQ-UPL

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	622.1	7.4			
FM	(30°-60°)	1674.6	19.9			
FH	(60°-80°)	1298.2	15.5			G1/1800
FVH	(80°-90°)	189.0	2.3			G2/225
BL	(0°-30°)	622.1	7.4	B2/1000		
BM	(30°-60°)	1674.6	19.9	B2/2500		
BH	(60°-80°)	1298.2	15.5	B3/2500		G1/1800
BVH	(80°-90°)	189.0	2.3			G2/225
UL	(90°-100°)	42.6	0.5		U2/50	
UH	(100°-180°)	789.1	9.4		U4/1000	

BUG Rating: B3-U4-G2
Type V Short

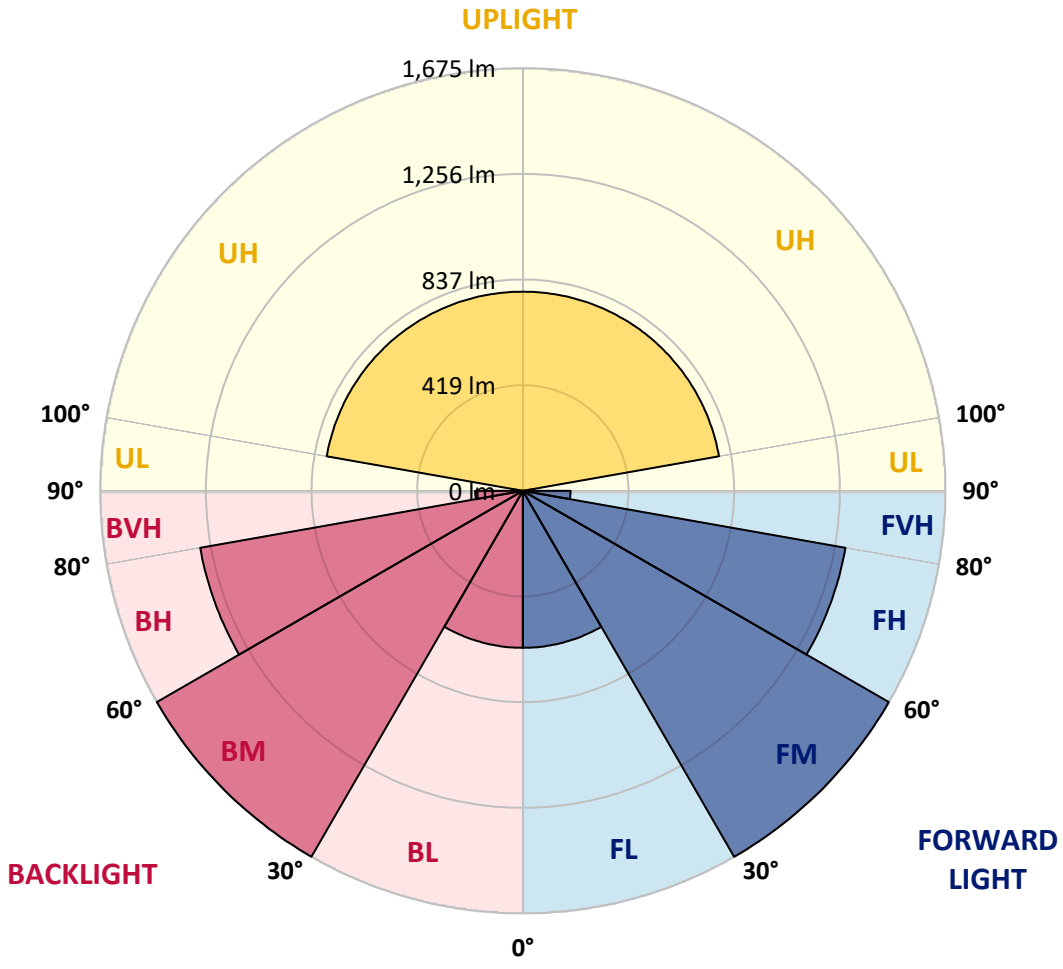

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821240
CATALOG NUMBER: TT-D4-735-24VDC-MQ-UPL

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
0°	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5
2.5°	1508.8	1507.6	1508.8	1507.6	1507.6	1506.5	1507.6	1507.6	1507.6	1507.6	1507.6
5°	1507.6	1506.5	1506.5	1507.6	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5	1506.5
7.5°	1503.1	1503.1	1504.3	1503.1	1503.1	1503.1	1503.1	1503.1	1503.1	1504.3	1504.3
10°	1499.8	1498.6	1499.8	1499.8	1498.6	1499.8	1498.6	1499.8	1499.8	1499.8	1499.8
12.5°	1495.3	1494.1	1495.3	1495.3	1494.1	1493.0	1494.1	1494.1	1495.3	1495.3	1495.3
15°	1487.4	1487.4	1489.6	1488.5	1488.5	1487.4	1489.6	1488.5	1487.4	1488.5	1488.5
17.5°	1481.8	1481.8	1484.0	1486.3	1486.3	1486.3	1486.3	1485.1	1482.9	1484.0	1481.8
20°	1482.9	1484.0	1485.1	1488.5	1490.8	1491.9	1491.9	1488.5	1485.1	1486.3	1485.1
22.5°	1479.5	1478.4	1479.5	1481.8	1485.1	1485.1	1485.1	1480.6	1479.5	1478.4	1478.4
25°	1466.0	1466.0	1468.3	1470.5	1472.8	1471.6	1472.8	1470.5	1468.3	1466.0	1466.0
27.5°	1450.3	1450.3	1453.6	1455.9	1458.1	1458.1	1457.0	1454.8	1453.6	1451.4	1450.3
30°	1434.5	1434.5	1437.9	1440.1	1443.5	1442.4	1442.4	1439.0	1435.6	1433.4	1433.4
32.5°	1417.6	1416.5	1419.9	1425.5	1430.0	1430.0	1430.0	1423.3	1418.8	1416.5	1415.4
35°	1403.0	1403.0	1407.5	1417.6	1423.3	1423.3	1421.0	1416.5	1406.4	1403.0	1403.0
37.5°	1398.5	1401.9	1414.3	1428.9	1440.1	1442.4	1439.0	1426.6	1413.1	1403.0	1399.6
40°	1413.1	1416.5	1432.3	1455.9	1472.8	1476.1	1472.8	1454.8	1431.1	1415.4	1414.3
42.5°	1415.4	1417.6	1436.8	1463.8	1479.5	1485.1	1479.5	1461.5	1435.6	1416.5	1415.4
45°	1407.5	1408.6	1431.1	1459.3	1478.4	1485.1	1478.4	1457.0	1430.0	1408.6	1407.5
47.5°	1397.4	1399.6	1424.4	1453.6	1477.3	1481.8	1476.1	1452.5	1422.1	1400.8	1397.4
50°	1389.5	1396.3	1418.8	1451.4	1479.5	1493.0	1479.5	1448.0	1417.6	1394.0	1389.5
52.5°	1394.0	1396.3	1425.5	1471.6	1509.9	1515.5	1508.8	1471.6	1423.3	1396.3	1392.9
55°	1407.5	1417.6	1449.1	1515.5	1550.4	1560.5	1545.9	1513.3	1450.3	1417.6	1407.5
57.5°	1425.5	1428.9	1473.9	1532.4	1584.1	1614.5	1585.3	1531.3	1477.3	1426.6	1424.4
60°	1410.9	1400.8	1457.0	1525.6	1595.4	1607.8	1590.9	1526.8	1454.8	1399.6	1409.8
62.5°	1371.5	1378.3	1424.4	1518.9	1567.3	1580.8	1562.8	1518.9	1422.1	1383.9	1368.1
65°	1340.0	1380.5	1431.1	1498.6	1576.3	1614.5	1577.4	1496.4	1433.4	1373.8	1336.6
67.5°	1296.1	1304.0	1379.4	1462.6	1532.4	1551.5	1531.3	1463.8	1372.6	1298.4	1304.0
70°	1221.9	1210.6	1287.1	1383.9	1450.3	1480.6	1452.5	1379.4	1283.7	1208.4	1218.5
72.5°	1099.2	1106.0	1176.9	1279.2	1347.9	1377.1	1349.0	1271.4	1174.6	1112.7	1106.0
75°	971.0	978.8	1047.5	1140.9	1210.6	1223.0	1215.1	1135.2	1049.7	977.7	971.0
77.5°	824.7	832.6	888.8	991.2	1032.8	1052.0	1035.1	996.8	886.6	831.5	822.5
80°	662.7	660.4	709.9	797.7	849.5	870.8	849.5	799.9	707.7	664.9	650.3
82.5°	473.7	475.9	522.0	582.8	632.3	639.1	628.9	588.4	517.5	481.5	461.3
85°	263.3	273.4	307.2	352.2	384.8	396.0	379.2	340.9	306.0	277.9	268.9
87.5°	63.0	68.6	79.9	101.3	113.6	124.9	113.6	105.8	75.4	68.6	63.0
90°	30.1	29.1	29.1	29.1	29.1	29.1	29.1	29.1	29.1	29.1	29.1
92.5°	34.8	34.2	34.2	33.8	33.8	33.8	33.8	33.8	33.8	33.8	33.8
95°	39.4	39.4	39.4	38.5	38.5	38.5	38.5	38.5	38.5	38.5	38.5
97.5°	44.6	44.6	44.6	44.2	44.2	44.2	44.2	44.2	44.2	44.2	44.2
100°	49.8	49.8	49.8	49.8	49.8	49.8	49.8	49.8	49.8	49.8	49.8
102.5°	55.9	55.9	55.9	55.9	55.9	55.9	55.9	56.4	55.9	55.9	55.9
105°	62.0	62.0	62.0	62.0	62.0	62.0	62.0	62.9	62.0	62.0	62.0
107.5°	68.6	68.6	69.0	69.0	69.0	69.0	69.0	69.5	69.0	69.0	69.0
110°	75.1	75.1	76.1	76.1	76.1	76.1	76.1	76.1	76.1	76.1	76.1

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821240
CATALOG NUMBER: TT-D4-735-24VDC-MQ-UPL

CANDELA DISTRIBUTION (continued):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
112.5°	83.1	83.1	84.0	84.0	84.0	*84.0*	84.6	84.6	84.0	84.0	84.0
115°	91.1	91.1	92.0	92.0	92.0	*92.0*	93.0	93.0	92.0	92.0	92.0
117.5°	100.5	100.5	101.0	101.4	101.4	*101.4*	102.4	102.4	101.4	101.4	101.4
120°	109.9	109.9	109.9	110.8	110.8	*110.8*	111.8	111.8	110.8	110.8	110.8
122.5°	120.7	120.7	121.2	121.6	121.6	*121.6*	122.6	122.6	122.1	122.1	121.6
125°	131.5	131.5	132.4	132.4	132.4	*132.4*	133.4	133.4	133.4	133.4	132.4
127.5°	143.2	143.2	144.2	144.2	144.2	*144.2*	145.1	145.1	145.1	145.1	144.2
130°	155.0	155.0	155.9	155.9	155.9	*155.9*	156.8	156.8	156.8	156.8	155.9
132.5°	167.2	167.2	167.6	167.6	167.6	*168.1*	168.6	168.6	168.6	168.6	168.1
135°	179.4	179.4	179.4	179.4	179.4	*180.3*	180.3	180.3	180.3	180.3	180.3
137.5°	191.2	190.6	191.2	190.6	191.2	*191.6*	191.6	191.6	191.6	191.6	191.6
140°	202.9	201.9	202.9	201.9	202.9	*202.9*	202.9	202.9	202.9	202.9	202.9
142.5°	213.7	213.2	213.7	212.7	213.7	*213.7*	213.7	213.7	213.7	213.7	213.7
145°	224.5	224.5	224.5	223.5	224.5	*224.5*	224.5	224.5	224.5	224.5	224.5
147.5°	235.8	235.3	235.8	234.8	235.8	*235.8*	235.8	235.8	235.8	235.8	235.8
150°	247.0	246.1	247.0	246.1	247.0	*247.0*	247.0	247.0	247.0	247.0	247.0
152.5°	256.0	255.5	256.4	255.5	256.0	*256.0*	256.4	256.0	256.0	256.0	256.0
155°	264.9	264.9	265.8	264.9	264.9	*264.9*	265.8	264.9	264.9	264.9	264.9
157.5°	272.4	272.4	273.3	272.4	272.4	*272.4*	273.3	272.4	272.4	272.4	272.4
160°	279.9	279.9	280.8	279.9	279.9	*279.9*	280.8	279.9	279.9	279.9	279.9
162.5°	286.0	286.0	286.9	286.0	286.0	*286.0*	286.9	286.0	286.0	286.0	286.0
165°	292.1	292.1	293.0	292.1	292.1	*292.1*	293.0	292.1	292.1	292.1	292.1
167.5°	295.8	295.8	296.8	295.8	295.8	*295.8*	296.8	295.8	295.8	295.8	295.8
170°	299.6	299.6	300.5	299.6	299.6	*299.6*	300.5	299.6	299.6	299.6	299.6
172.5°	302.0	302.0	302.8	302.0	302.4	*302.0*	302.8	302.0	302.0	302.0	302.0
175°	304.3	304.3	305.2	304.3	305.2	*304.3*	305.2	304.3	304.3	304.3	304.3
177.5°	305.2	305.2	305.7	305.2	305.7	*305.2*	305.7	305.2	305.2	305.2	305.2
180°	306.2	306.2	306.2	306.2	306.2	*306.2*	306.2	306.2	306.2	306.2	306.2

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Streetworks

Report Number: SP1-2407-176-4

Test Date: 09/24/2024

Luminaire Tested: MEM2-HTN-VA-30-735-U-WQ

Data in this report applies to families of products including MEM2-HTN-VA-30-735-U-WQ


Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04

Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-176-4
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	09/27/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	Streetworks
Catalog Number:	**MEM2-HTN-VA-30-735-U-WQ**
Description:	EPIC MODERN VISUAL COMFORT 30W WAVESTREAM WIDE

Spectral Parameters

CCT (K):	3348	CRI (Ra):	73.4		
CIE u':	0.2384	R1:	70.8	R9:	-19.2
CIE v':	0.5184	R2:	79.9	R10:	52.5
Duv:	0.0030	R3:	87.6	R11:	68.0
CIE x:	0.4177	R4:	72.6	R12:	42.6
CIE y:	0.4036	R5:	69.3	R13:	72.0
CIE z:	0.1787	R6:	71.3	R14:	92.6
Peak Wavelength (nm):	593	R7:	82.1	R15:	63.8
Dominant Wavelength (nm):	580	R8:	53.3		
Purity:	46.5223				
Rf:	75.8				
Rg:	95.8				

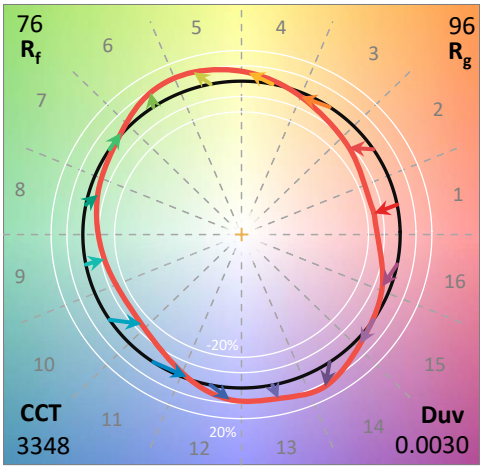

Test Conditions


Stabilization Time:	30M
Operation Time:	1H 30M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-176-4


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-176-4

CIE 1931 Chromaticity Diagram

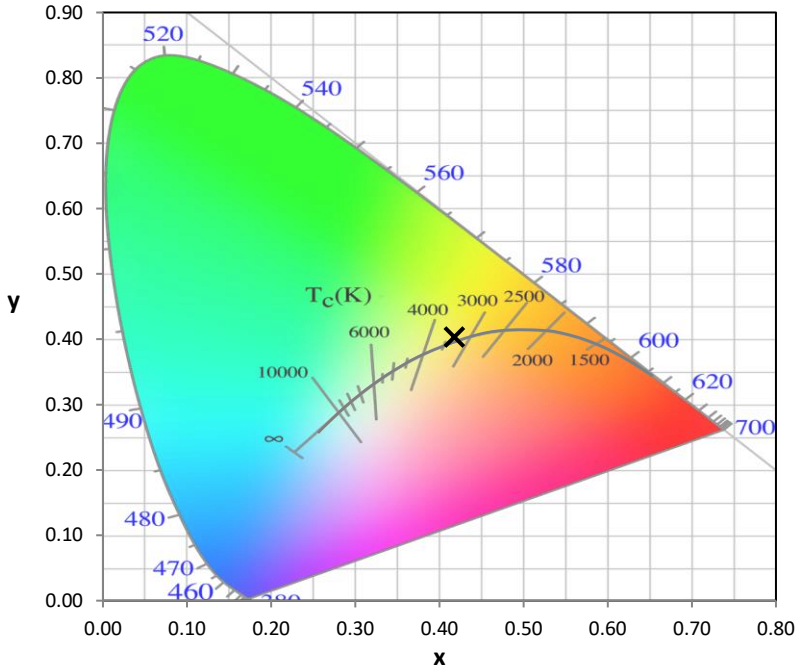

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

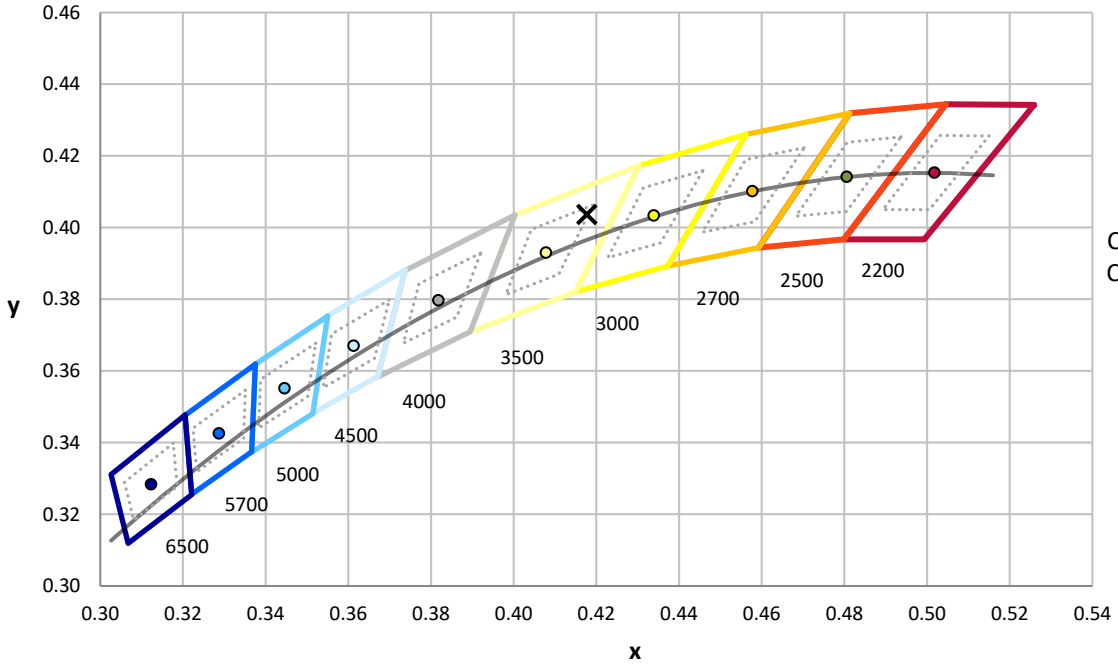


CCT = 3348K
CIE x = 0.4177
CIE y = 0.4036
Duv = 0.0030

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-176-4

Photopic Flux vs. Wavelength

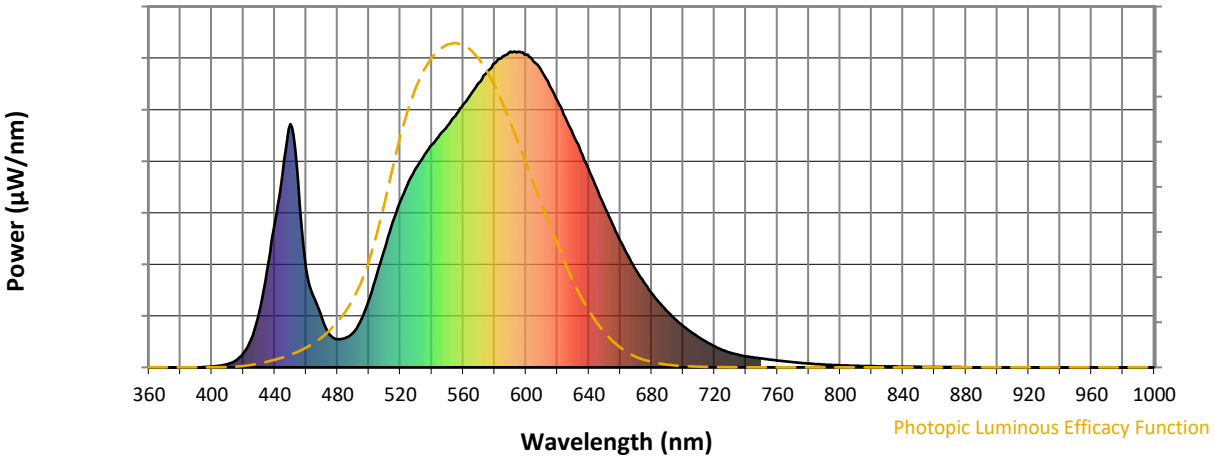


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	110	NR	620	844	NR	750	28	NR	880	0	NR
365	0	NR	495	150	NR	625	792	NR	755	25	NR	885	0	NR
370	0	NR	500	214	NR	630	737	NR	760	22	NR	890	0	NR
375	0	NR	505	293	NR	635	683	NR	765	19	NR	895	0	NR
380	0	NR	510	376	NR	640	625	NR	770	16	NR	900	0	NR
385	0	NR	515	458	NR	645	566	NR	775	14	NR	905	0	NR
390	0	NR	520	526	NR	650	509	NR	780	12	NR	910	0	NR
395	1	NR	525	584	NR	655	453	NR	785	10	NR	915	0	NR
400	3	NR	530	631	NR	660	401	NR	790	9	NR	920	0	NR
405	5	NR	535	671	NR	665	353	NR	795	8	NR	925	0	NR
410	10	NR	540	704	NR	670	308	NR	800	7	NR	930	0	NR
415	21	NR	545	737	NR	675	269	NR	805	6	NR	935	0	NR
420	44	NR	550	766	NR	680	235	NR	810	5	NR	940	0	NR
425	90	NR	555	797	NR	685	204	NR	815	4	NR	945	0	NR
430	171	NR	560	832	NR	690	177	NR	820	4	NR	950	0	NR
435	305	NR	565	866	NR	695	152	NR	825	3	NR	955	0	NR
440	455	NR	570	901	NR	700	131	NR	830	3	NR	960	0	NR
445	615	NR	575	933	NR	705	112	NR	835	3	NR	965	0	NR
450	771	NR	580	963	NR	710	96	NR	840	2	NR	970	0	NR
455	579	NR	585	984	NR	715	80	NR	845	2	NR	975	0	NR
460	313	NR	590	1000	NR	720	67	NR	850	2	NR	980	0	NR
465	221	NR	595	999	NR	725	55	NR	855	1	NR	985	0	NR
470	156	NR	600	990	NR	730	46	NR	860	1	NR	990	0	NR
475	103	NR	605	968	NR	735	40	NR	865	1	NR	995	0	NR
480	89	NR	610	937	NR	740	35	NR	870	1	NR	1000	0	NR
485	93	NR	615	893	NR	745	31	NR	875	1	NR			

REPORT NUMBER: SP1-2407-176-4

Scotopic Flux vs. Wavelength

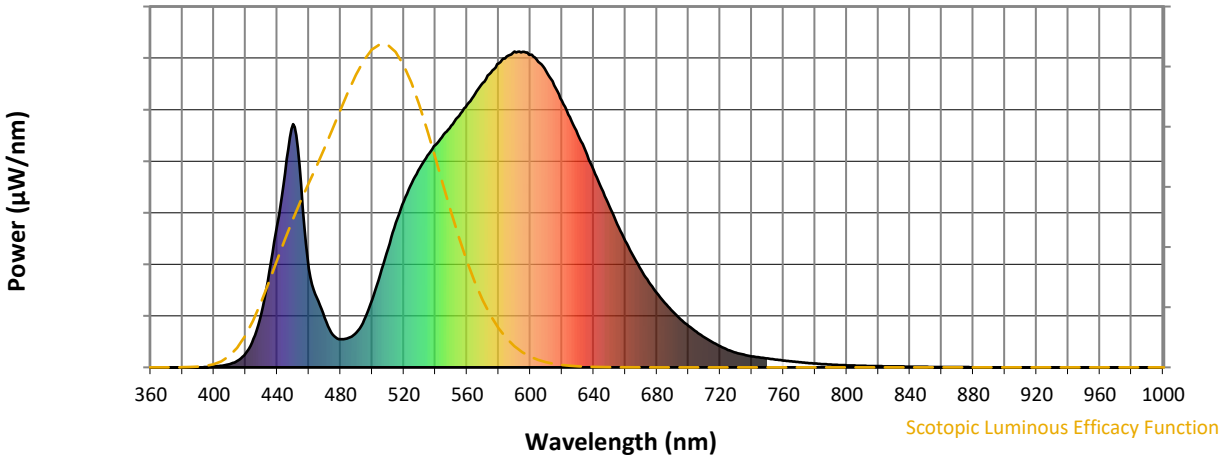


Scotopic Lumens: NR **S/P: 1.31**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	110	NR	620	844	NR	750	28	NR	880	0	NR
365	0	NR	495	150	NR	625	792	NR	755	25	NR	885	0	NR
370	0	NR	500	214	NR	630	737	NR	760	22	NR	890	0	NR
375	0	NR	505	293	NR	635	683	NR	765	19	NR	895	0	NR
380	0	NR	510	376	NR	640	625	NR	770	16	NR	900	0	NR
385	0	NR	515	458	NR	645	566	NR	775	14	NR	905	0	NR
390	0	NR	520	526	NR	650	509	NR	780	12	NR	910	0	NR
395	1	NR	525	584	NR	655	453	NR	785	10	NR	915	0	NR
400	3	NR	530	631	NR	660	401	NR	790	9	NR	920	0	NR
405	5	NR	535	671	NR	665	353	NR	795	8	NR	925	0	NR
410	10	NR	540	704	NR	670	308	NR	800	7	NR	930	0	NR
415	21	NR	545	737	NR	675	269	NR	805	6	NR	935	0	NR
420	44	NR	550	766	NR	680	235	NR	810	5	NR	940	0	NR
425	90	NR	555	797	NR	685	204	NR	815	4	NR	945	0	NR
430	171	NR	560	832	NR	690	177	NR	820	4	NR	950	0	NR
435	305	NR	565	866	NR	695	152	NR	825	3	NR	955	0	NR
440	455	NR	570	901	NR	700	131	NR	830	3	NR	960	0	NR
445	615	NR	575	933	NR	705	112	NR	835	3	NR	965	0	NR
450	771	NR	580	963	NR	710	96	NR	840	2	NR	970	0	NR
455	579	NR	585	984	NR	715	80	NR	845	2	NR	975	0	NR
460	313	NR	590	1000	NR	720	67	NR	850	2	NR	980	0	NR
465	221	NR	595	999	NR	725	55	NR	855	1	NR	985	0	NR
470	156	NR	600	990	NR	730	46	NR	860	1	NR	990	0	NR
475	103	NR	605	968	NR	735	40	NR	865	1	NR	995	0	NR
480	89	NR	610	937	NR	740	35	NR	870	1	NR	1000	0	NR
485	93	NR	615	893	NR	745	31	NR	875	1	NR			

REPORT NUMBER: SP1-2407-176-4

Melanopic Flux vs. Wavelength

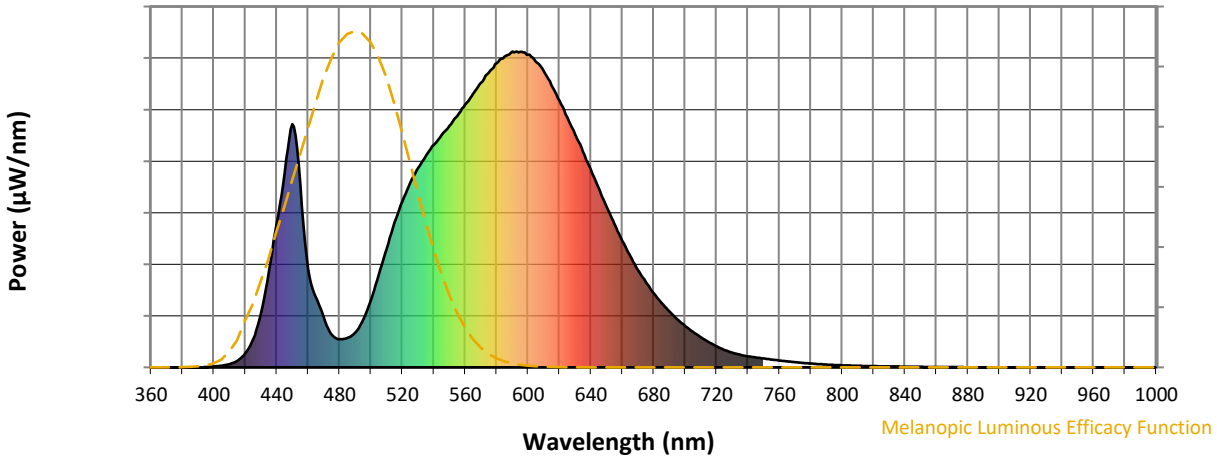

Melanopic Lumens: NR **M/P: 2.4**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	110	NR	620	844	NR	750	28	NR	880	0	NR
365	0	NR	495	150	NR	625	792	NR	755	25	NR	885	0	NR
370	0	NR	500	214	NR	630	737	NR	760	22	NR	890	0	NR
375	0	NR	505	293	NR	635	683	NR	765	19	NR	895	0	NR
380	0	NR	510	376	NR	640	625	NR	770	16	NR	900	0	NR
385	0	NR	515	458	NR	645	566	NR	775	14	NR	905	0	NR
390	0	NR	520	526	NR	650	509	NR	780	12	NR	910	0	NR
395	1	NR	525	584	NR	655	453	NR	785	10	NR	915	0	NR
400	3	NR	530	631	NR	660	401	NR	790	9	NR	920	0	NR
405	5	NR	535	671	NR	665	353	NR	795	8	NR	925	0	NR
410	10	NR	540	704	NR	670	308	NR	800	7	NR	930	0	NR
415	21	NR	545	737	NR	675	269	NR	805	6	NR	935	0	NR
420	44	NR	550	766	NR	680	235	NR	810	5	NR	940	0	NR
425	90	NR	555	797	NR	685	204	NR	815	4	NR	945	0	NR
430	171	NR	560	832	NR	690	177	NR	820	4	NR	950	0	NR
435	305	NR	565	866	NR	695	152	NR	825	3	NR	955	0	NR
440	455	NR	570	901	NR	700	131	NR	830	3	NR	960	0	NR
445	615	NR	575	933	NR	705	112	NR	835	3	NR	965	0	NR
450	771	NR	580	963	NR	710	96	NR	840	2	NR	970	0	NR
455	579	NR	585	984	NR	715	80	NR	845	2	NR	975	0	NR
460	313	NR	590	1000	NR	720	67	NR	850	2	NR	980	0	NR
465	221	NR	595	999	NR	725	55	NR	855	1	NR	985	0	NR
470	156	NR	600	990	NR	730	46	NR	860	1	NR	990	0	NR
475	103	NR	605	968	NR	735	40	NR	865	1	NR	995	0	NR
480	89	NR	610	937	NR	740	35	NR	870	1	NR	1000	0	NR
485	93	NR	615	893	NR	745	31	NR	875	1	NR			


REPORT NUMBER: SP1-2407-176-4

TM-30-18


Summary


R_f = 75.8
R_g = 95.8
CIE R_a = 73.4
R_9 = -19.2


Spectral Power Distribution Comparison

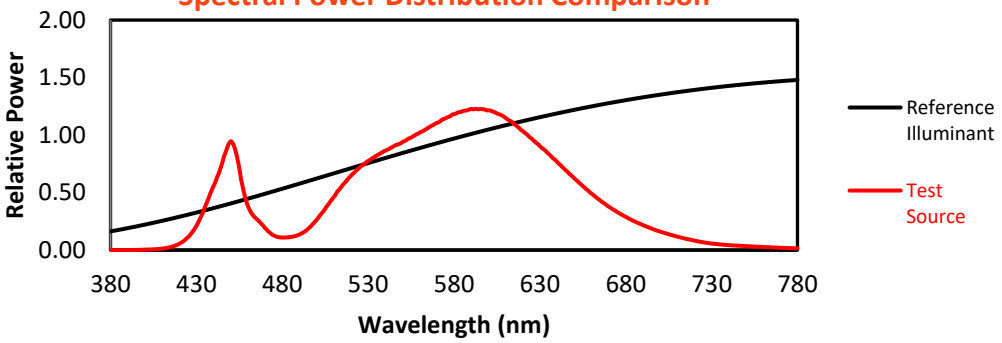


Color Vector Graphics

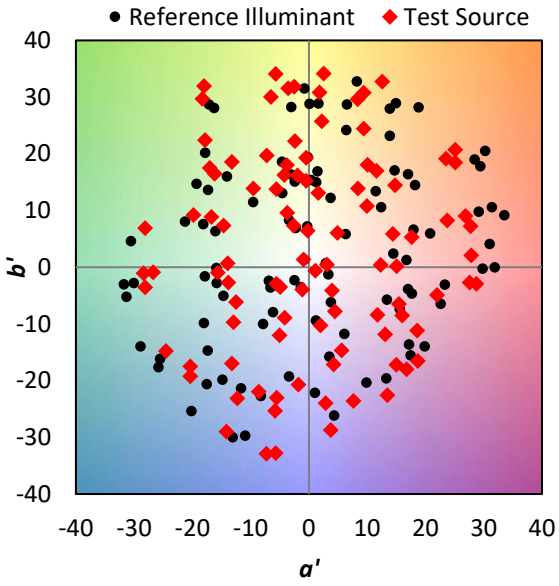

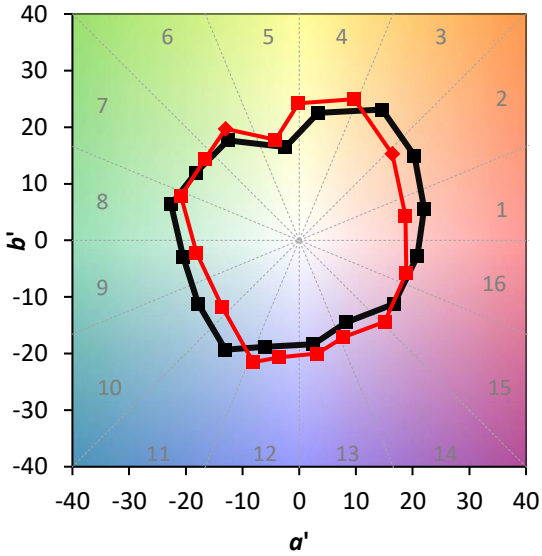

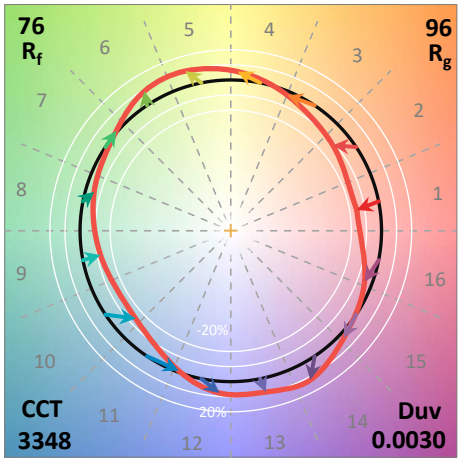

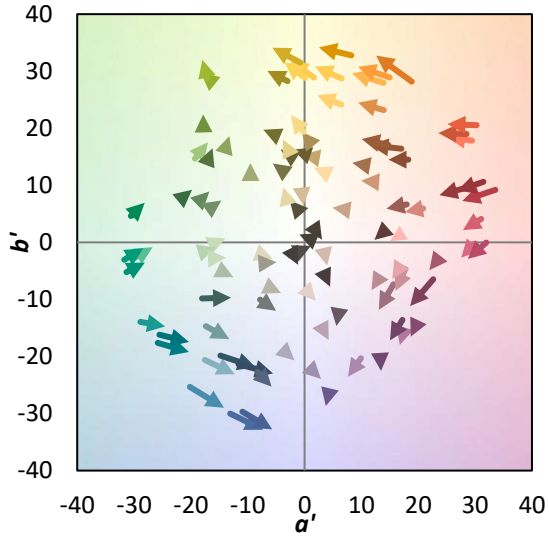


REPORT NUMBER: SP1-2407-176-4

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 65	CES51 = 88	CES76 = 55
CES02 = 62	CES27 = 88	CES52 = 87	CES77 = 74
CES03 = 31	CES28 = 83	CES53 = 77	CES78 = 58
CES04 = 70	CES29 = 66	CES54 = 86	CES79 = 84
CES05 = 48	CES30 = 79	CES55 = 84	CES80 = 81
CES06 = 51	CES31 = 69	CES56 = 74	CES81 = 78
CES07 = 41	CES32 = 62	CES57 = 73	CES82 = 92
CES08 = 40	CES33 = 75	CES58 = 75	CES83 = 89
CES09 = 29	CES34 = 73	CES59 = 87	CES84 = 88
CES10 = 75	CES35 = 85	CES60 = 91	CES85 = 79
CES11 = 58	CES36 = 95	CES61 = 84	CES86 = 71
CES12 = 64	CES37 = 80	CES62 = 88	CES87 = 79
CES13 = 43	CES38 = 88	CES63 = 73	CES88 = 81
CES14 = 74	CES39 = 96	CES64 = 69	CES89 = 71
CES15 = 71	CES40 = 91	CES65 = 66	CES90 = 80
CES16 = 47	CES41 = 91	CES66 = 62	CES91 = 81
CES17 = 50	CES42 = 81	CES67 = 60	CES92 = 63
CES18 = 56	CES43 = 77	CES68 = 68	CES93 = 78
CES19 = 72	CES44 = 99	CES69 = 76	CES94 = 56
CES20 = 65	CES45 = 85	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 82	CES71 = 55	CES96 = 79
CES22 = 79	CES47 = 83	CES72 = 85	CES97 = 84
CES23 = 92	CES48 = 75	CES73 = 52	CES98 = 77
CES24 = 91	CES49 = 79	CES74 = 96	CES99 = 68
CES25 = 72	CES50 = 87	CES75 = 57	

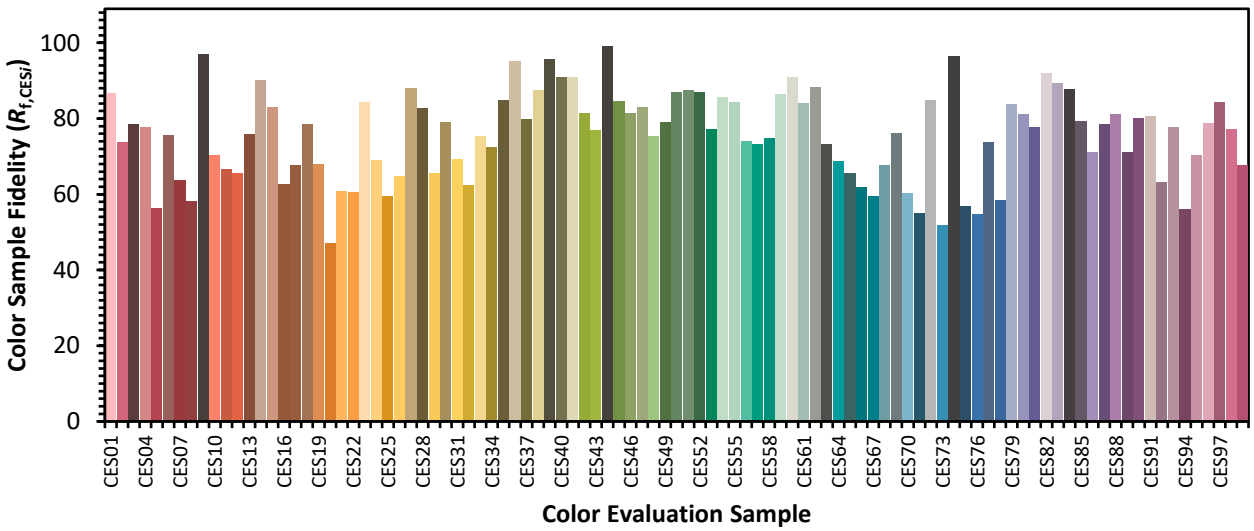



REPORT NUMBER: SP1-2407-176-4

TM-30-18

Color Rendition by Hue-Angle Bin

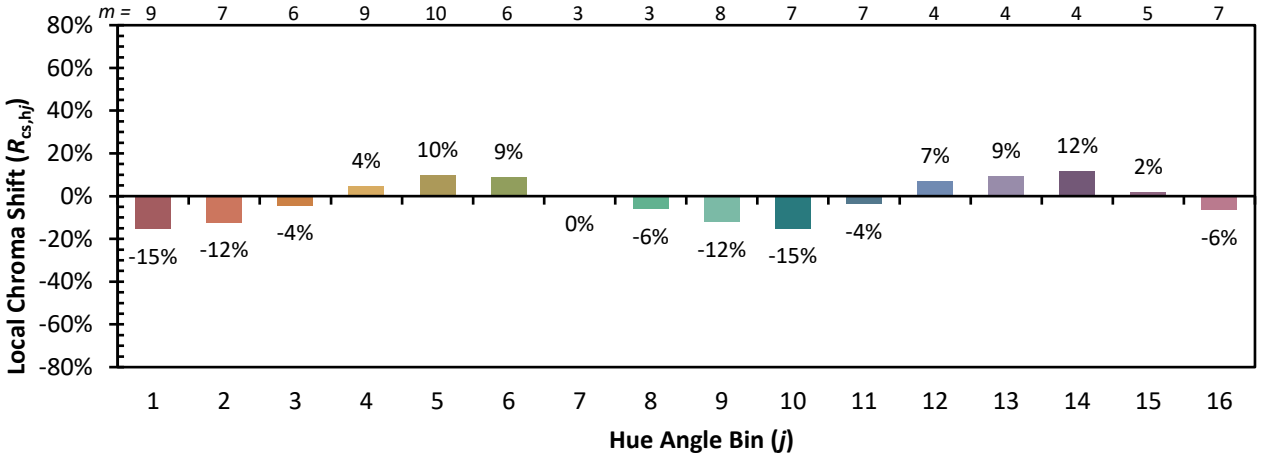

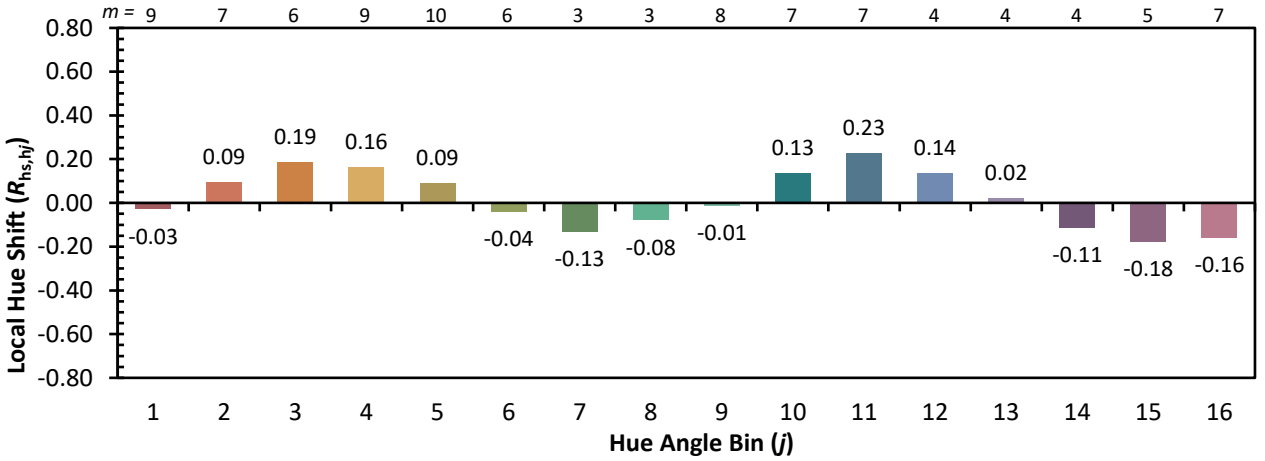


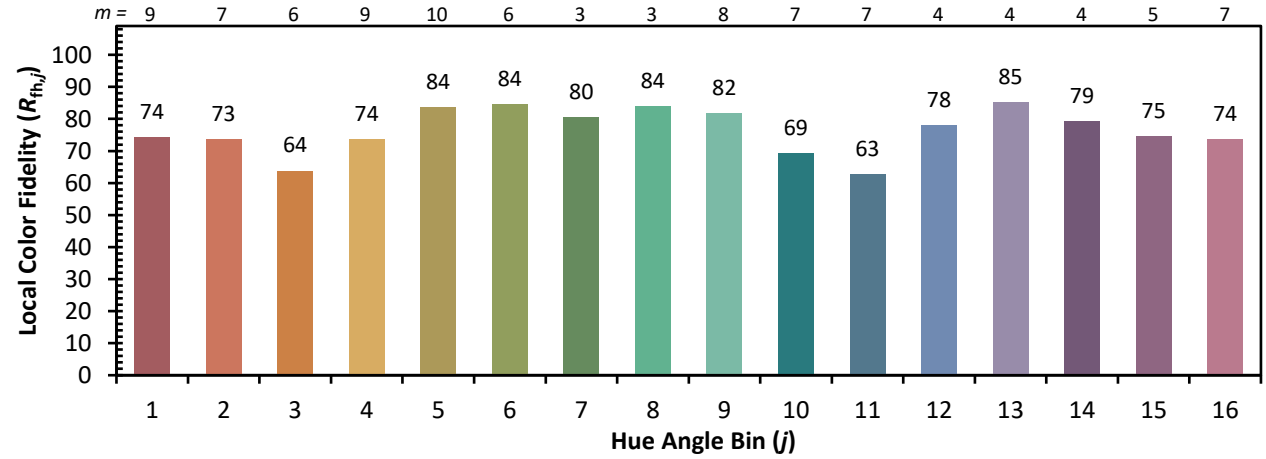


REPORT NUMBER: SP1-2407-176-4

TM-30-18

Measure Comparisons

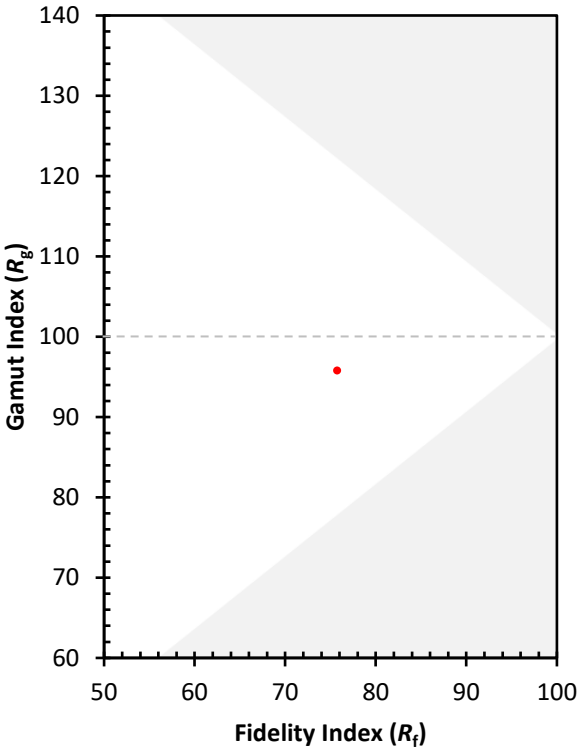

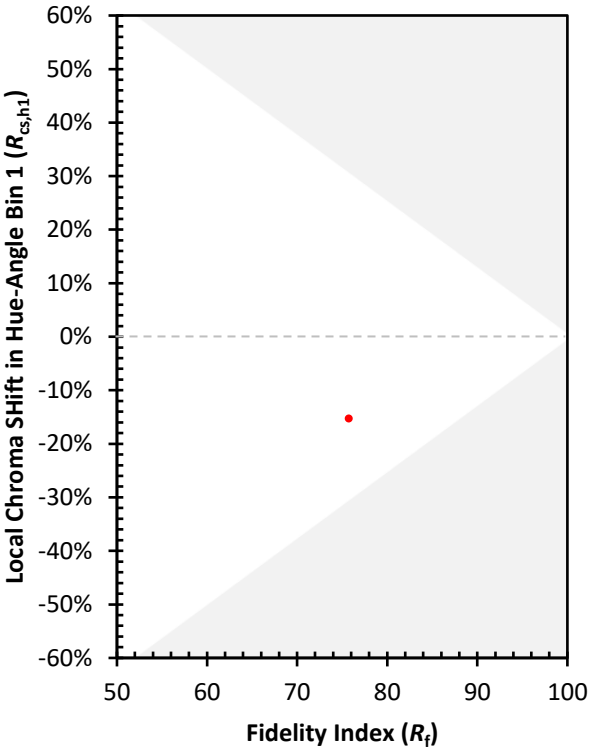

(END OF REPORT)