Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P821321

Luminaire Tested: **TT-D4-740-24VDC-WQ**

Issue Date: 2/12/2020

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P821321
	TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1908-473-14)
Test Lab:	INNOVATIONS CENTER
Issue Date:	2/12/2020
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	TT-D4-740-24VDC-WQ
Description:	TOPTIER LED PARKING GARAGE LUMINAIRE
	4000K, 70 CRI LEDS AND WIDE DISTRIBUTION
Light Source:	-
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	7569 lumens
Efficiency:	N/A
Efficacy:	132.8 lumens/watt
Luminous Opening:	Circular (Dia: 1.12' x H: 0')
IES Classification:	Type V - Short
BUG Rating:	B3 - U0 - G2


Input Watts (W):	57
Input Voltage (V):	NR
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	25 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821321
CATALOG NUMBER: TT-D4-740-24VDC-WQ

Iso-Footcandle Lines of Horizontal Illumination

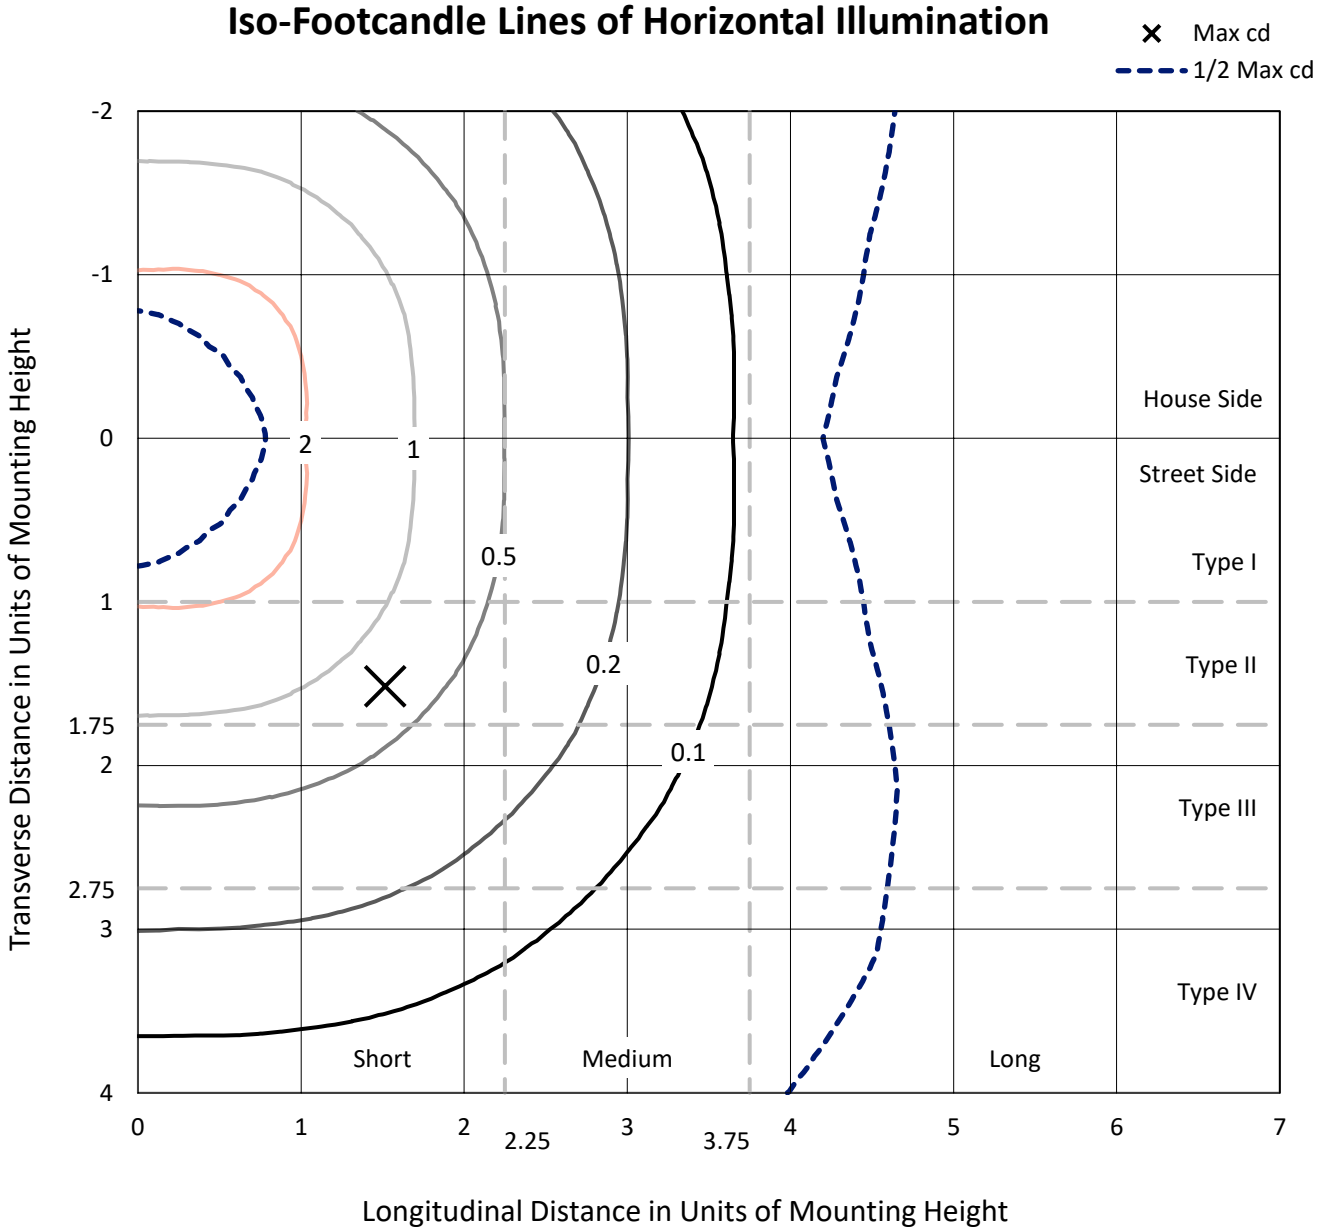


Based on 15 foot mounting height. Maximum calculated value = 2.6 fc
Type V - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821321
CATALOG NUMBER: TT-D4-740-24VDC-WQ

Luminous Intensity Polar Plot

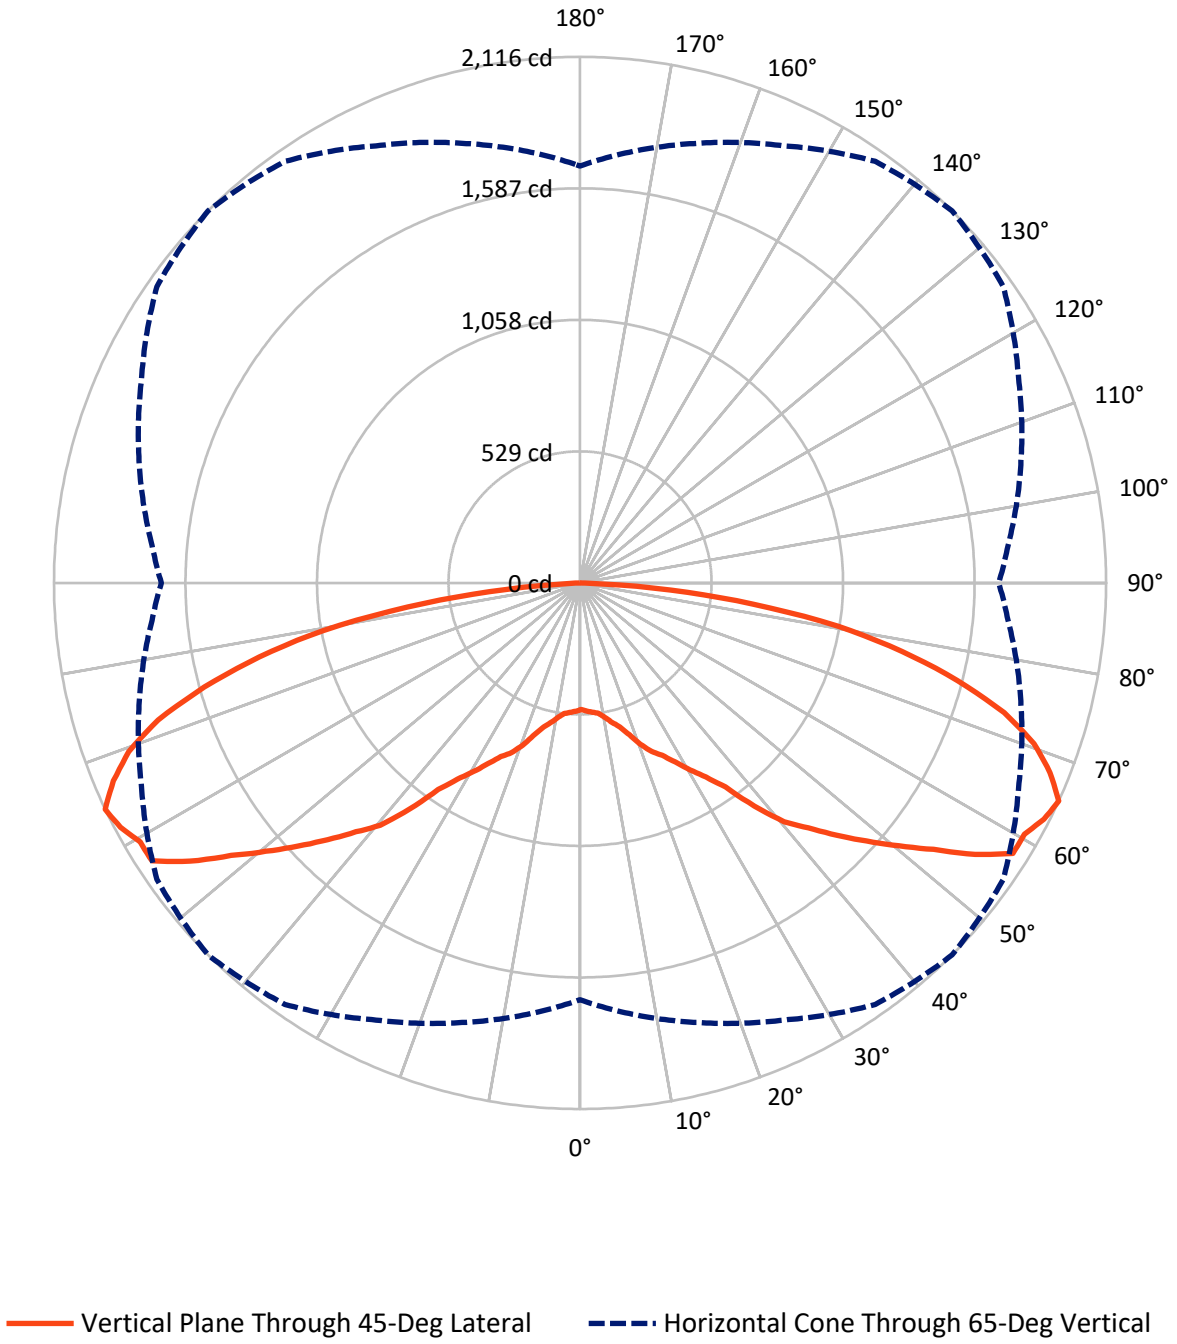

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P821321
CATALOG NUMBER: TT-D4-740-24VDC-WQ

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	3784.5	0.0	3784.5
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	3784.5	0.0	3784.5
	% Fixture	50.0	0.0	50.0
Total	Lumens	7569.0	0.0	7569.0
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	50.8	0.7
10°-20°	174.7	2.3
20°-30°	358.8	4.7
30°-40°	637.4	8.4
40°-50°	1074.4	14.2
50°-60°	1584.9	20.9
60°-70°	1860.1	24.6
70°-80°	1449.1	19.1
80°-90°	378.9	5.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	7569.0	100.0
0°-180°	7569.0	100.0

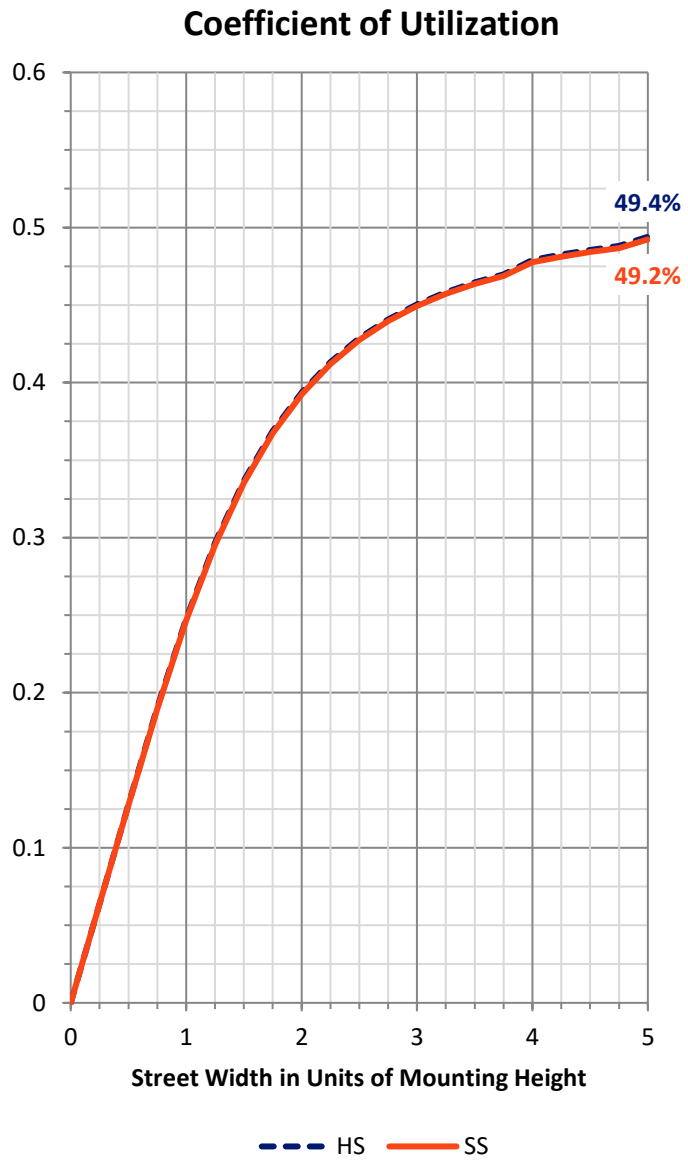

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P821321
CATALOG NUMBER: TT-D4-740-24VDC-WQ

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	292.1	3.9			
FM	(30°-60°)	1648.3	21.8			
FH	(60°-80°)	1654.6	21.9			G1/1800
FVH	(80°-90°)	189.4	2.5			G2/225
BL	(0°-30°)	292.1	3.9	B1/500		
BM	(30°-60°)	1648.3	21.8	B2/2500		
BH	(60°-80°)	1654.6	21.9	B3/2500		G1/1800
BVH	(80°-90°)	189.4	2.5			G2/225
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B3-U0-G2
Type V Short

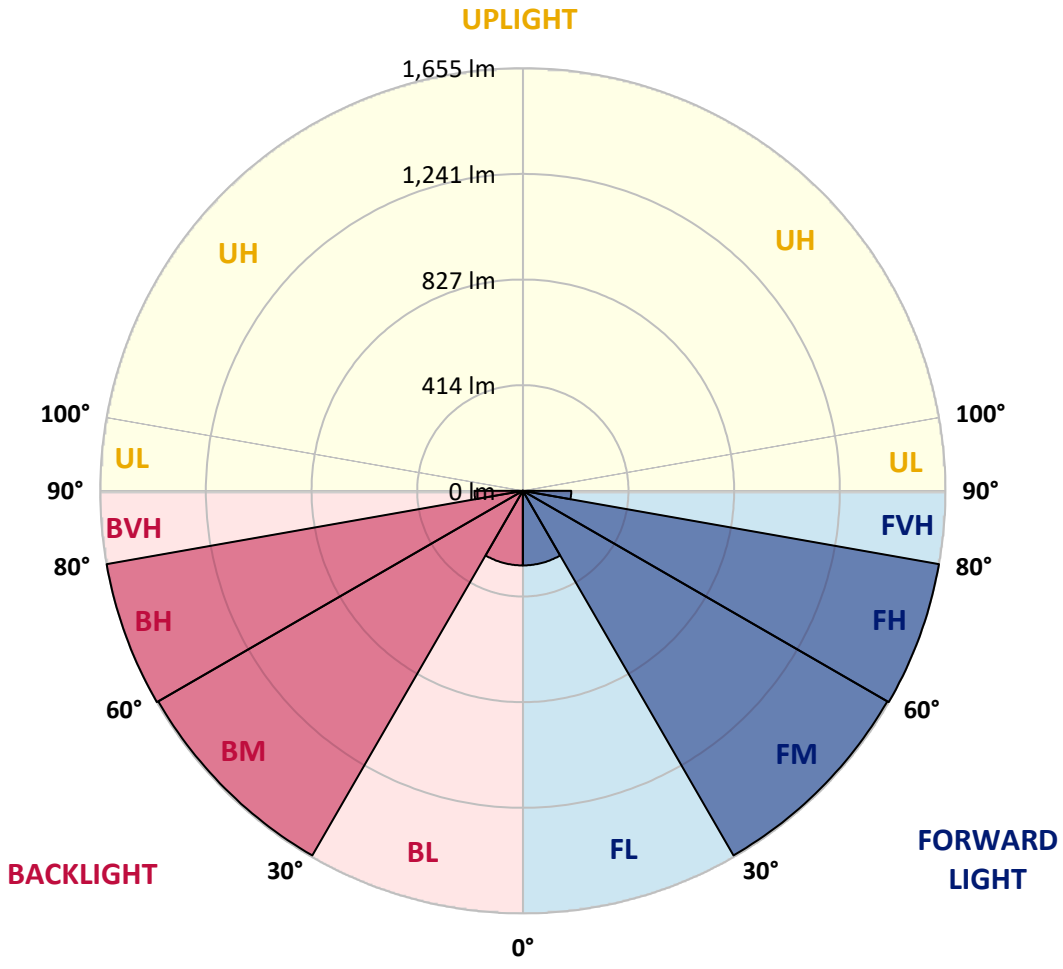

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P821321
CATALOG NUMBER: TT-D4-740-24VDC-WQ

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
0°	509.4	509.4	509.4	509.4	509.4	*509.4*	509.4	509.4	509.4	509.4	509.4
2.5°	517.7	517.7	517.7	516.6	516.6	*516.6*	516.6	517.7	517.7	517.7	517.7
5°	529.7	529.7	527.3	524.9	522.5	*522.5*	523.7	524.9	526.1	528.5	528.5
7.5°	536.8	536.8	535.6	533.2	529.7	*529.7*	530.8	533.2	534.4	534.4	533.2
10°	546.3	547.5	551.1	552.3	549.9	*549.9*	551.1	552.3	549.9	546.3	546.3
12.5°	568.9	570.1	574.9	578.5	578.5	*576.1*	577.3	579.6	573.7	567.7	568.9
15°	601.1	601.1	602.3	605.8	603.4	*601.1*	603.4	604.6	601.1	599.9	602.3
17.5°	643.9	643.9	636.8	642.7	643.9	*642.7*	645.1	639.2	635.6	640.3	642.7
20°	690.3	685.6	682.0	686.8	696.3	*692.7*	697.5	684.4	680.8	683.2	684.4
22.5°	720.1	723.7	726.0	728.4	741.5	*736.8*	741.5	727.2	724.8	720.1	716.5
25°	755.8	759.4	773.6	766.5	774.8	*767.7*	773.6	765.3	770.1	755.8	755.8
27.5°	796.3	803.4	811.7	808.2	818.9	*815.3*	818.9	807.0	808.2	802.2	799.8
30°	851.0	851.0	848.6	855.8	874.8	*872.4*	873.6	858.2	847.4	848.6	853.4
32.5°	905.8	898.6	902.2	923.6	935.5	*930.8*	933.1	926.0	902.2	897.4	901.0
35°	956.9	967.7	976.0	993.8	1010.5	*1008.1*	1006.9	995.0	979.6	960.5	954.6
37.5°	1036.7	1048.6	1071.2	1103.3	1133.1	*1139.0*	1123.6	1108.1	1072.4	1045.0	1030.7
40°	1141.4	1142.6	1168.8	1230.7	1258.1	*1262.8*	1254.5	1228.3	1173.6	1142.6	1141.4
42.5°	1233.1	1224.7	1267.6	1320.0	1345.0	*1347.3*	1341.4	1320.0	1267.6	1223.6	1231.9
45°	1304.5	1304.5	1355.7	1397.3	1437.8	*1447.3*	1436.6	1391.4	1356.9	1305.7	1302.1
47.5°	1370.0	1387.8	1430.7	1481.8	1539.0	*1552.1*	1539.0	1485.4	1427.1	1389.0	1368.8
50°	1448.5	1469.9	1500.9	1580.6	1644.9	*1662.7*	1643.7	1585.4	1500.9	1468.7	1456.8
52.5°	1540.2	1558.0	1606.8	1706.8	1754.4	*1780.6*	1765.1	1709.2	1609.2	1560.4	1550.9
55°	1649.7	1633.0	1709.2	1805.6	1893.7	*1928.2*	1897.2	1808.0	1721.1	1633.0	1649.7
57.5°	1705.6	1686.6	1793.7	1885.3	2007.9	*2053.1*	2015.1	1892.5	1793.7	1692.5	1704.4
60°	1710.4	1718.7	1799.6	1949.6	2034.1	*2053.1*	2041.2	1960.3	1803.2	1725.8	1703.2
62.5°	1696.1	1747.3	1816.3	1971.0	2047.2	*2093.6*	2053.1	1973.4	1823.4	1755.6	1697.3
65°	*1677.0*	*1728.2*	*1830.6*	*1940.1*	*2069.8*	*2116.2*	*2078.1*	*1946.0*	*1835.3*	*1728.2*	*1684.2*
67.5°	1643.7	1625.9	1752.0	1898.4	2011.5	*2038.9*	2015.1	1900.8	1750.8	1623.5	1647.3
70°	1537.8	1522.3	1630.6	1791.3	1899.6	*1937.7*	1909.1	1793.7	1633.0	1525.9	1540.2
72.5°	1380.7	1385.4	1490.2	1643.7	1760.3	*1784.2*	1768.7	1642.5	1496.1	1391.4	1372.3
75°	1197.4	1209.3	1309.2	1448.5	1554.4	*1568.7*	1553.2	1454.5	1308.1	1216.4	1191.4
77.5°	984.3	1002.2	1083.1	1222.4	1292.6	*1324.7*	1299.7	1225.9	1089.1	1006.9	981.9
80°	762.9	768.9	826.0	937.9	1030.7	*1052.2*	1028.4	941.5	833.2	771.3	753.4
82.5°	499.9	509.4	560.6	646.3	707.0	*701.0*	707.0	639.2	566.5	507.0	477.3
85°	222.6	241.6	276.1	316.6	355.9	*366.6*	355.9	321.4	276.1	236.9	232.1
87.5°	15.5	17.9	21.4	22.6	25.0	*19.0*	19.0	19.0	16.7	19.0	15.5
90°	0.0	0.0	0.0	0.0	0.0	*0.0*	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Streetworks

Report Number: SP1-2407-176-5

Test Date: 09/24/2024

Luminaire Tested: MEM2-HTN-VA-30-740-U-WQ

Data in this report applies to families of products including MEM2-HTN-VA-30-740-U-WQ


Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04

Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-176-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	09/27/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	Streetworks
Catalog Number:	**MEM2-HTN-VA-30-740-U-WQ**
Description:	EPIC MODERN VISUAL COMFORT 30W WAVESTREAM WIDE

Spectral Parameters

CCT (K):	3819	CRI (Ra):	72.9		
CIE u':	0.2261	R1:	70.1	R9:	-21.5
CIE v':	0.5108	R2:	78.4	R10:	48.5
Duv:	0.0046	R3:	85.0	R11:	68.4
CIE x:	0.3926	R4:	72.9	R12:	39.0
CIE y:	0.3942	R5:	69.1	R13:	71.1
CIE z:	0.2132	R6:	69.2	R14:	91.3
Peak Wavelength (nm):	450	R7:	82.8	R15:	63.2
Dominant Wavelength (nm):	577	R8:	55.4		
Purity:	36.15483				
Rf:	75.6				
Rg:	94.8				

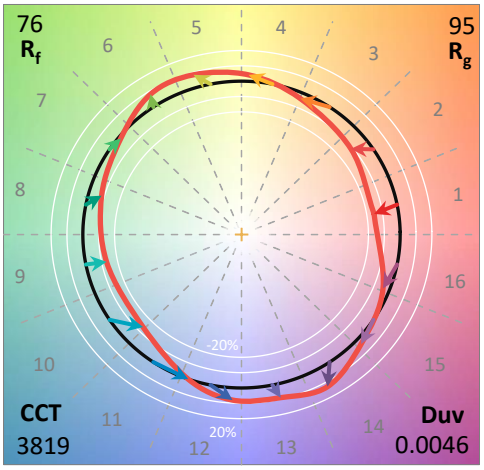

Test Conditions


Stabilization Time:	30M
Operation Time:	1H 30M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-176-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-176-5

CIE 1931 Chromaticity Diagram

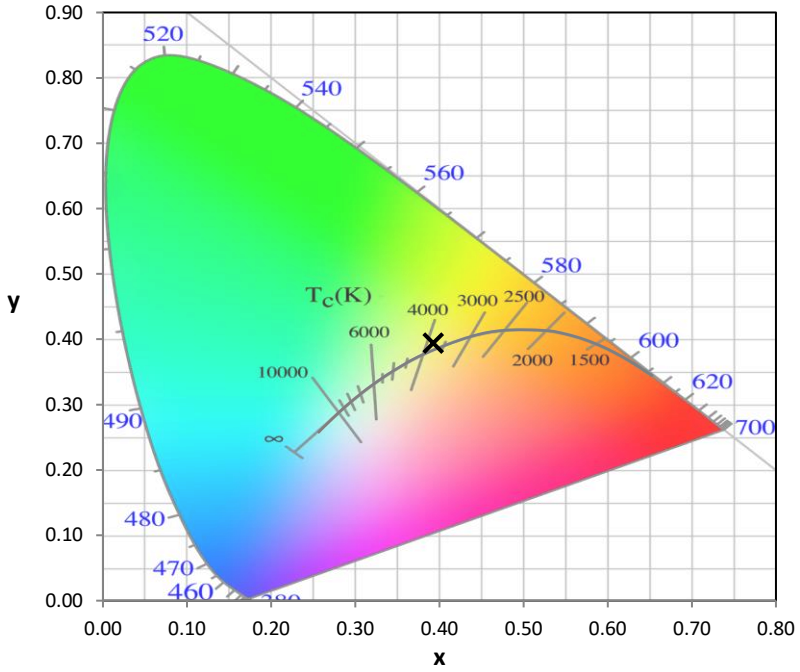

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

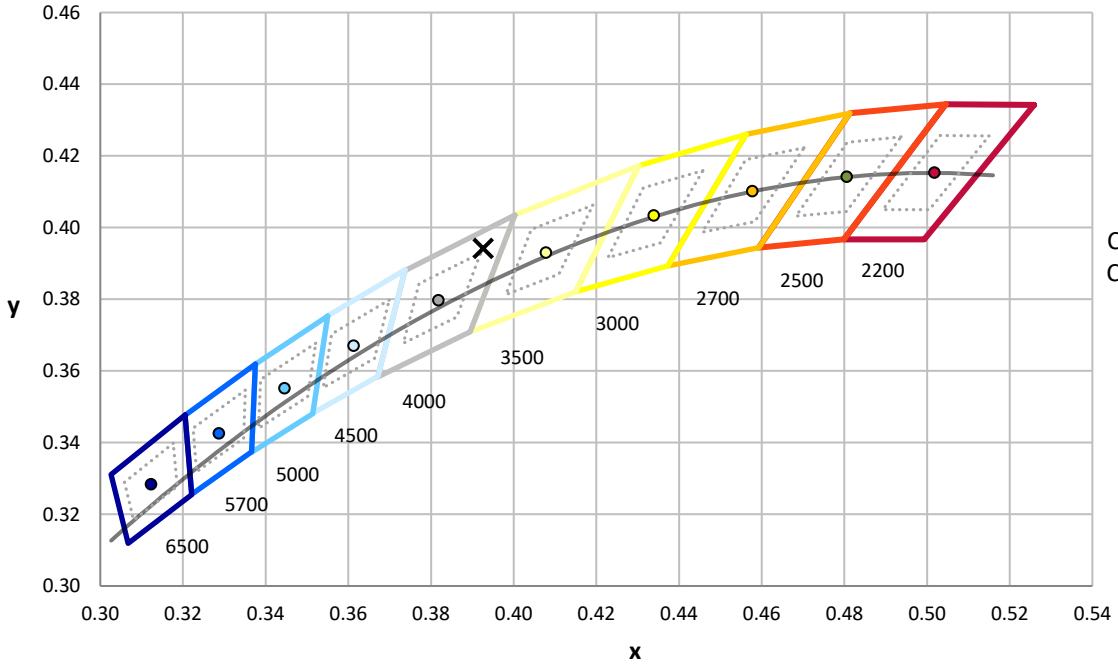


CCT = 3819K
CIE x = 0.3926
CIE y = 0.3942
Duv = 0.0046

Point lies inside the ANSI 4000K 7-step quadrangle

REPORT NUMBER: SP1-2407-176-5

Photopic Flux vs. Wavelength

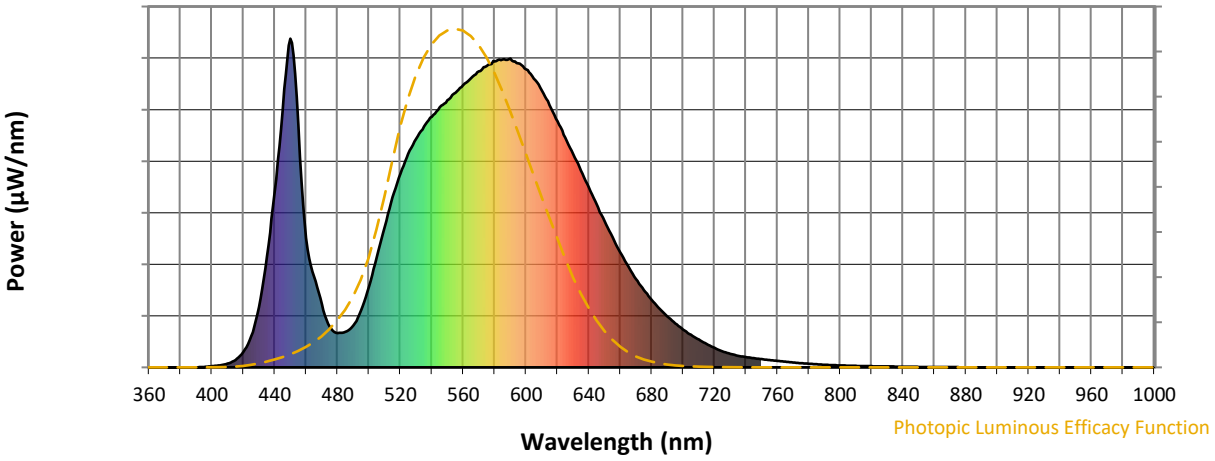


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	127	NR	620	748	NR	750	25	NR	880	0	NR
365	0	NR	495	173	NR	625	699	NR	755	22	NR	885	0	NR
370	0	NR	500	246	NR	630	648	NR	760	20	NR	890	0	NR
375	0	NR	505	335	NR	635	599	NR	765	17	NR	895	0	NR
380	0	NR	510	427	NR	640	547	NR	770	15	NR	900	0	NR
385	0	NR	515	517	NR	645	495	NR	775	13	NR	905	0	NR
390	0	NR	520	589	NR	650	445	NR	780	11	NR	910	0	NR
395	1	NR	525	649	NR	655	396	NR	785	9	NR	915	0	NR
400	4	NR	530	695	NR	660	349	NR	790	8	NR	920	0	NR
405	6	NR	535	733	NR	665	308	NR	795	7	NR	925	0	NR
410	11	NR	540	763	NR	670	269	NR	800	6	NR	930	0	NR
415	23	NR	545	792	NR	675	235	NR	805	5	NR	935	0	NR
420	46	NR	550	813	NR	680	205	NR	810	5	NR	940	0	NR
425	95	NR	555	835	NR	685	178	NR	815	4	NR	945	0	NR
430	183	NR	560	859	NR	690	155	NR	820	3	NR	950	0	NR
435	338	NR	565	880	NR	695	134	NR	825	3	NR	955	0	NR
440	534	NR	570	900	NR	700	115	NR	830	3	NR	960	0	NR
445	782	NR	575	918	NR	705	99	NR	835	2	NR	965	0	NR
450	1000	NR	580	931	NR	710	84	NR	840	2	NR	970	0	NR
455	739	NR	585	937	NR	715	71	NR	845	2	NR	975	0	NR
460	393	NR	590	939	NR	720	59	NR	850	1	NR	980	0	NR
465	276	NR	595	925	NR	725	49	NR	855	1	NR	985	0	NR
470	190	NR	600	907	NR	730	41	NR	860	1	NR	990	0	NR
475	123	NR	605	878	NR	735	35	NR	865	1	NR	995	0	NR
480	105	NR	610	842	NR	740	31	NR	870	1	NR	1000	0	NR
485	108	NR	615	797	NR	745	28	NR	875	1	NR			

REPORT NUMBER: SP1-2407-176-5

Scotopic Flux vs. Wavelength

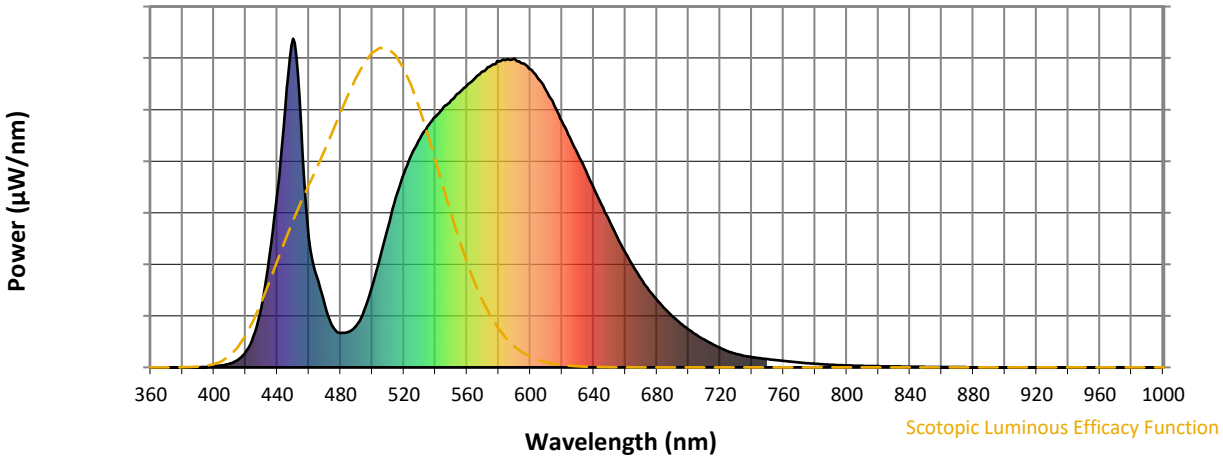


Scotopic Lumens: NR **S/P: 1.45**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	127	NR	620	748	NR	750	25	NR	880	0	NR
365	0	NR	495	173	NR	625	699	NR	755	22	NR	885	0	NR
370	0	NR	500	246	NR	630	648	NR	760	20	NR	890	0	NR
375	0	NR	505	335	NR	635	599	NR	765	17	NR	895	0	NR
380	0	NR	510	427	NR	640	547	NR	770	15	NR	900	0	NR
385	0	NR	515	517	NR	645	495	NR	775	13	NR	905	0	NR
390	0	NR	520	589	NR	650	445	NR	780	11	NR	910	0	NR
395	1	NR	525	649	NR	655	396	NR	785	9	NR	915	0	NR
400	4	NR	530	695	NR	660	349	NR	790	8	NR	920	0	NR
405	6	NR	535	733	NR	665	308	NR	795	7	NR	925	0	NR
410	11	NR	540	763	NR	670	269	NR	800	6	NR	930	0	NR
415	23	NR	545	792	NR	675	235	NR	805	5	NR	935	0	NR
420	46	NR	550	813	NR	680	205	NR	810	5	NR	940	0	NR
425	95	NR	555	835	NR	685	178	NR	815	4	NR	945	0	NR
430	183	NR	560	859	NR	690	155	NR	820	3	NR	950	0	NR
435	338	NR	565	880	NR	695	134	NR	825	3	NR	955	0	NR
440	534	NR	570	900	NR	700	115	NR	830	3	NR	960	0	NR
445	782	NR	575	918	NR	705	99	NR	835	2	NR	965	0	NR
450	1000	NR	580	931	NR	710	84	NR	840	2	NR	970	0	NR
455	739	NR	585	937	NR	715	71	NR	845	2	NR	975	0	NR
460	393	NR	590	939	NR	720	59	NR	850	1	NR	980	0	NR
465	276	NR	595	925	NR	725	49	NR	855	1	NR	985	0	NR
470	190	NR	600	907	NR	730	41	NR	860	1	NR	990	0	NR
475	123	NR	605	878	NR	735	35	NR	865	1	NR	995	0	NR
480	105	NR	610	842	NR	740	31	NR	870	1	NR	1000	0	NR
485	108	NR	615	797	NR	745	28	NR	875	1	NR			

REPORT NUMBER: SP1-2407-176-5

Melanopic Flux vs. Wavelength

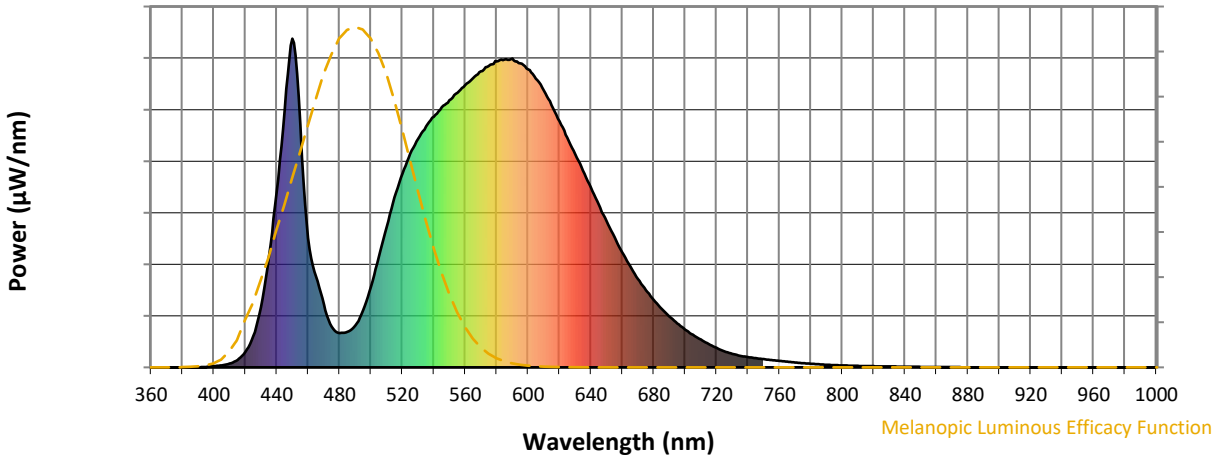

Melanopic Lumens: NR **M/P: 2.76**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	127	NR	620	748	NR	750	25	NR	880	0	NR
365	0	NR	495	173	NR	625	699	NR	755	22	NR	885	0	NR
370	0	NR	500	246	NR	630	648	NR	760	20	NR	890	0	NR
375	0	NR	505	335	NR	635	599	NR	765	17	NR	895	0	NR
380	0	NR	510	427	NR	640	547	NR	770	15	NR	900	0	NR
385	0	NR	515	517	NR	645	495	NR	775	13	NR	905	0	NR
390	0	NR	520	589	NR	650	445	NR	780	11	NR	910	0	NR
395	1	NR	525	649	NR	655	396	NR	785	9	NR	915	0	NR
400	4	NR	530	695	NR	660	349	NR	790	8	NR	920	0	NR
405	6	NR	535	733	NR	665	308	NR	795	7	NR	925	0	NR
410	11	NR	540	763	NR	670	269	NR	800	6	NR	930	0	NR
415	23	NR	545	792	NR	675	235	NR	805	5	NR	935	0	NR
420	46	NR	550	813	NR	680	205	NR	810	5	NR	940	0	NR
425	95	NR	555	835	NR	685	178	NR	815	4	NR	945	0	NR
430	183	NR	560	859	NR	690	155	NR	820	3	NR	950	0	NR
435	338	NR	565	880	NR	695	134	NR	825	3	NR	955	0	NR
440	534	NR	570	900	NR	700	115	NR	830	3	NR	960	0	NR
445	782	NR	575	918	NR	705	99	NR	835	2	NR	965	0	NR
450	1000	NR	580	931	NR	710	84	NR	840	2	NR	970	0	NR
455	739	NR	585	937	NR	715	71	NR	845	2	NR	975	0	NR
460	393	NR	590	939	NR	720	59	NR	850	1	NR	980	0	NR
465	276	NR	595	925	NR	725	49	NR	855	1	NR	985	0	NR
470	190	NR	600	907	NR	730	41	NR	860	1	NR	990	0	NR
475	123	NR	605	878	NR	735	35	NR	865	1	NR	995	0	NR
480	105	NR	610	842	NR	740	31	NR	870	1	NR	1000	0	NR
485	108	NR	615	797	NR	745	28	NR	875	1	NR			


REPORT NUMBER: SP1-2407-176-5

TM-30-18


Summary


R_f = 75.6
R_g = 94.8
CIE R_a = 72.9
R_9 = -21.5


Spectral Power Distribution Comparison

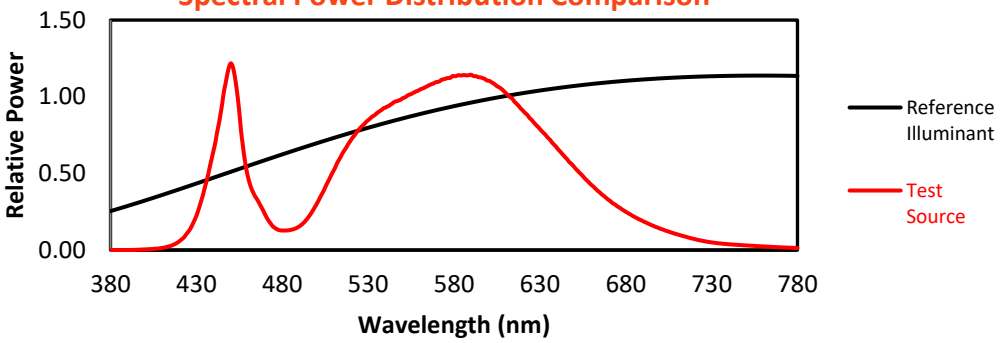


Color Vector Graphics

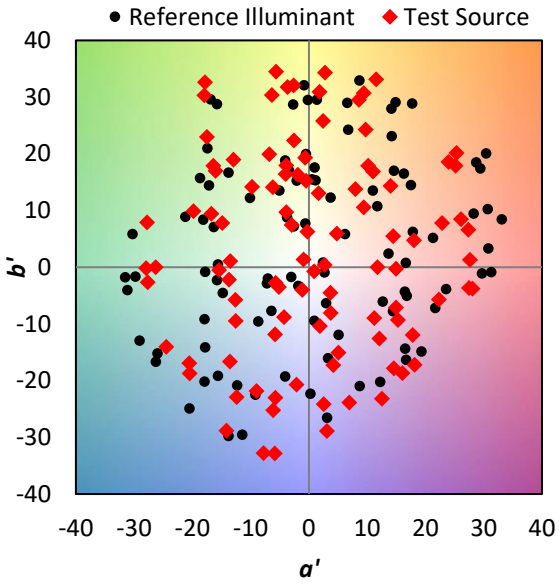

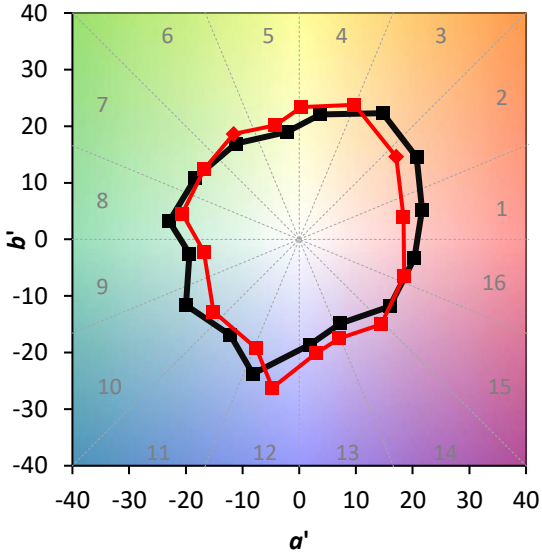

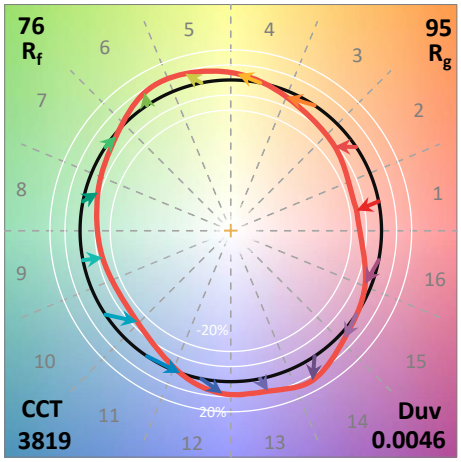

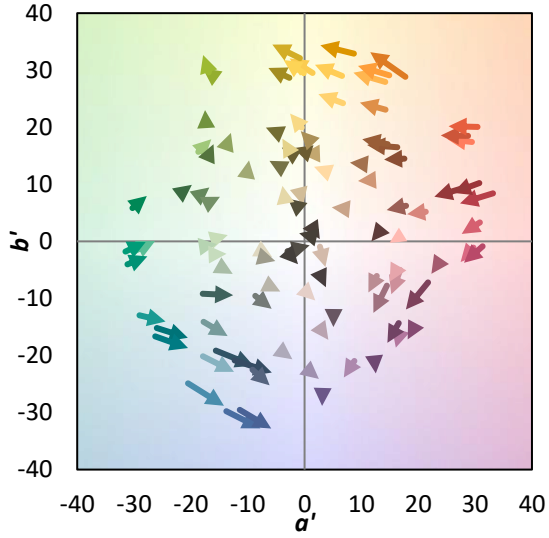


REPORT NUMBER: SP1-2407-176-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 65	CES51 = 89	CES76 = 53
CES02 = 61	CES27 = 89	CES52 = 88	CES77 = 71
CES03 = 30	CES28 = 82	CES53 = 78	CES78 = 56
CES04 = 70	CES29 = 68	CES54 = 85	CES79 = 83
CES05 = 48	CES30 = 84	CES55 = 84	CES80 = 79
CES06 = 50	CES31 = 71	CES56 = 74	CES81 = 79
CES07 = 40	CES32 = 63	CES57 = 73	CES82 = 91
CES08 = 39	CES33 = 79	CES58 = 74	CES83 = 90
CES09 = 29	CES34 = 72	CES59 = 86	CES84 = 87
CES10 = 74	CES35 = 84	CES60 = 90	CES85 = 78
CES11 = 57	CES36 = 91	CES61 = 84	CES86 = 74
CES12 = 63	CES37 = 79	CES62 = 85	CES87 = 78
CES13 = 42	CES38 = 93	CES63 = 73	CES88 = 82
CES14 = 74	CES39 = 96	CES64 = 67	CES89 = 72
CES15 = 71	CES40 = 91	CES65 = 64	CES90 = 81
CES16 = 47	CES41 = 93	CES66 = 60	CES91 = 75
CES17 = 49	CES42 = 80	CES67 = 57	CES92 = 62
CES18 = 56	CES43 = 78	CES68 = 66	CES93 = 77
CES19 = 72	CES44 = 99	CES69 = 75	CES94 = 57
CES20 = 65	CES45 = 86	CES70 = 58	CES95 = 68
CES21 = 86	CES46 = 83	CES71 = 51	CES96 = 78
CES22 = 78	CES47 = 86	CES72 = 84	CES97 = 85
CES23 = 92	CES48 = 78	CES73 = 49	CES98 = 77
CES24 = 91	CES49 = 81	CES74 = 93	CES99 = 67
CES25 = 72	CES50 = 88	CES75 = 53	

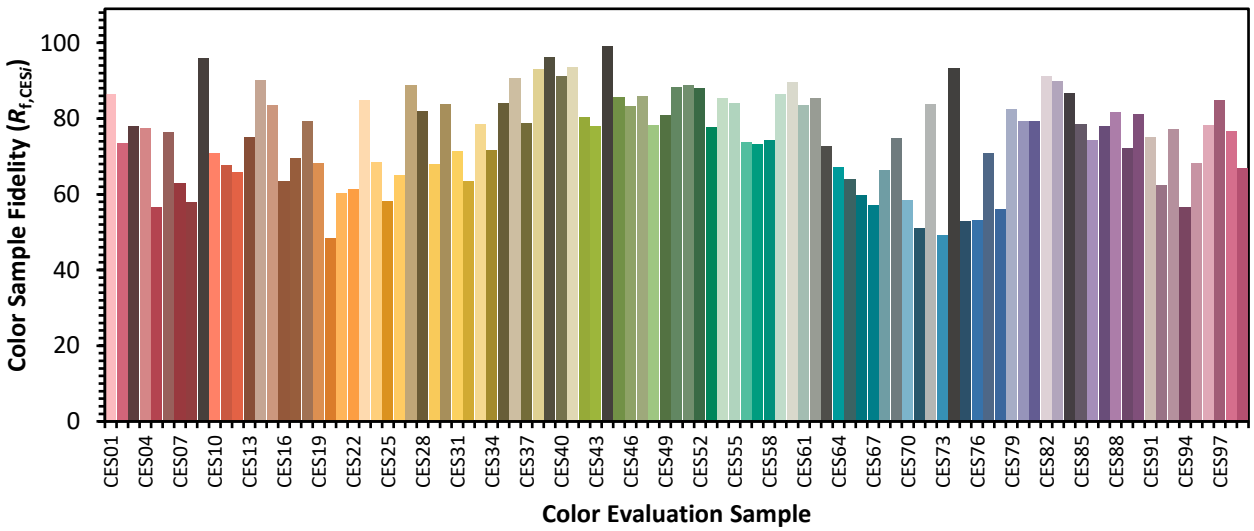



REPORT NUMBER: SP1-2407-176-5

TM-30-18

Color Rendition by Hue-Angle Bin

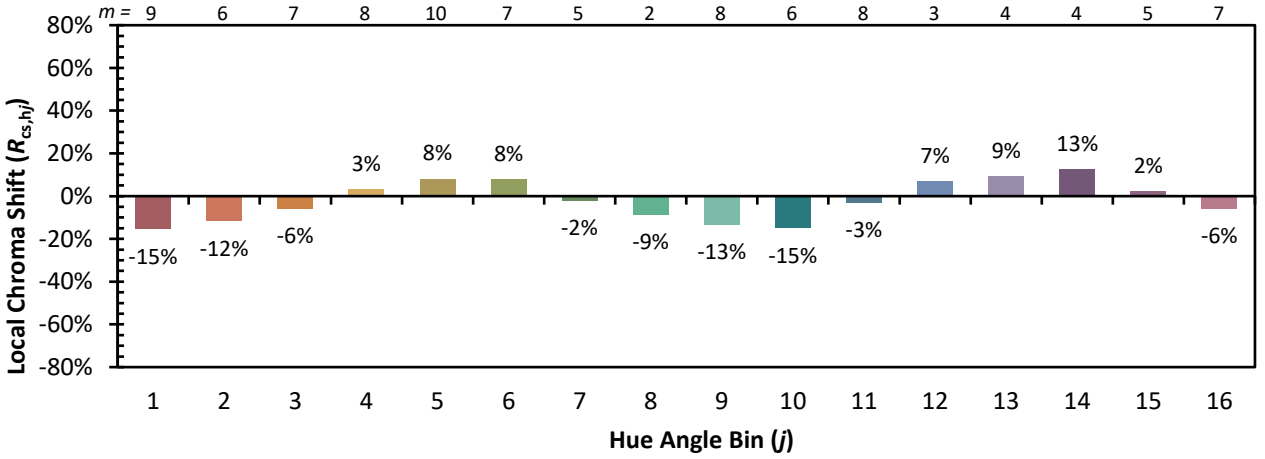

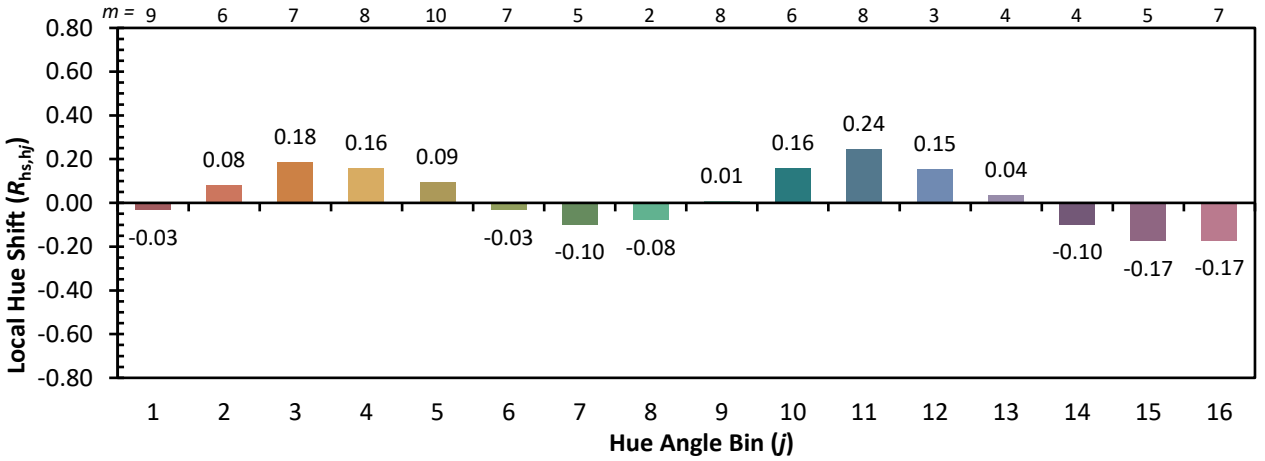


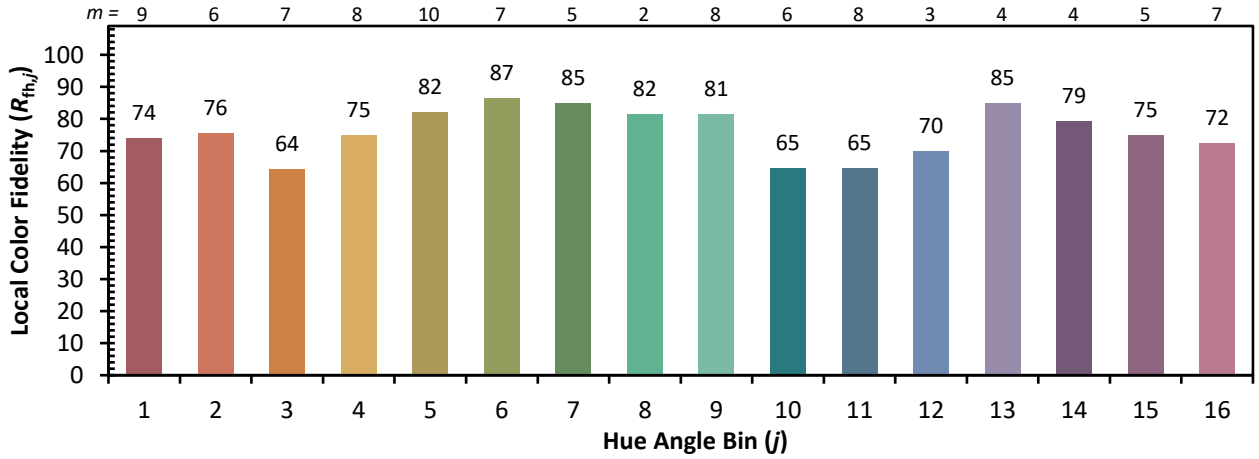


REPORT NUMBER: SP1-2407-176-5

TM-30-18

Measure Comparisons

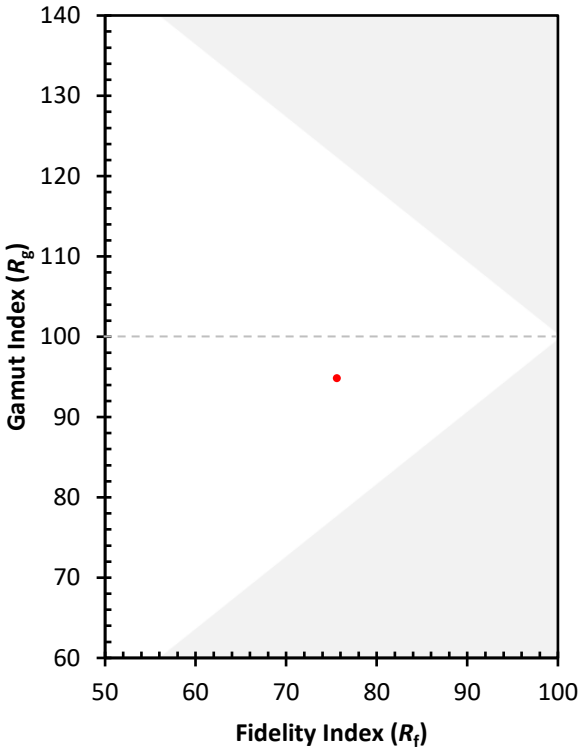

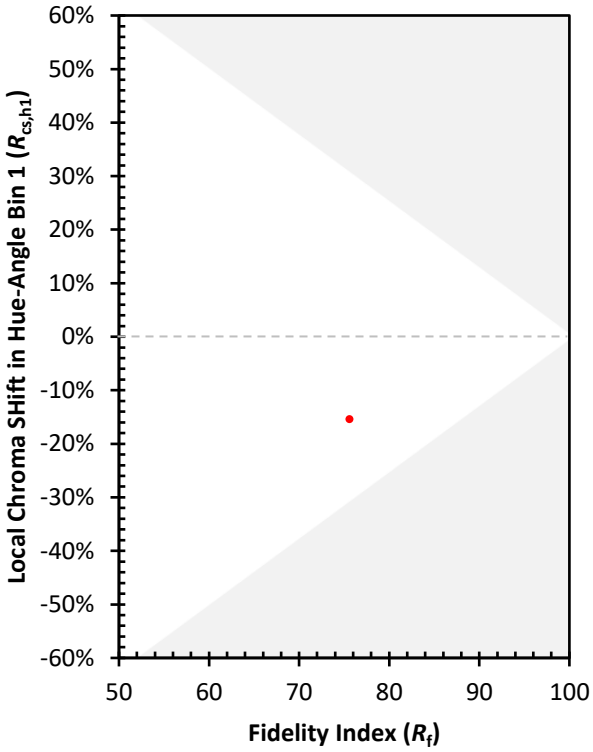

(END OF REPORT)