

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1211754

Luminaire Tested: **GKO-PB1F-840-U-T2U**

Issue Date: 11/5/2025



Test Information

Test Method: LM-79-08
Report Number: P1211754
Test Lab: INNOVATION CENTER(G1)
Issue Date: 11/5/2025
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: MCGRAW-EDISON
Catalog Number: GKO-PB1F-840-U-T2U
Description: GEKKO WALL PACK 6500LM PACKAGE 80CRI 4000K FIXTURE w/ TYPE II URBAN DISTRIBUTION OPTIC
Light Source: (10) 4000K CCT, 80 CRI LEDS
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6168.4 lumens
Efficiency: N/A
Efficacy: 113.2 lumens/watt
Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
IES Classification: Type II - Medium
BUG Rating: B2 - U0 - G2

Input Watts (W): 54.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.99
Total Harmonic Distortion (THDi): 5.7%
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT


REPORT NUMBER: P1211754

CATALOG NUMBER: GKO-PB1F-840-U-T2U

Iso-Footcandle Lines of Horizontal Illumination

✕ Max cd


--- 1/2 Max cd

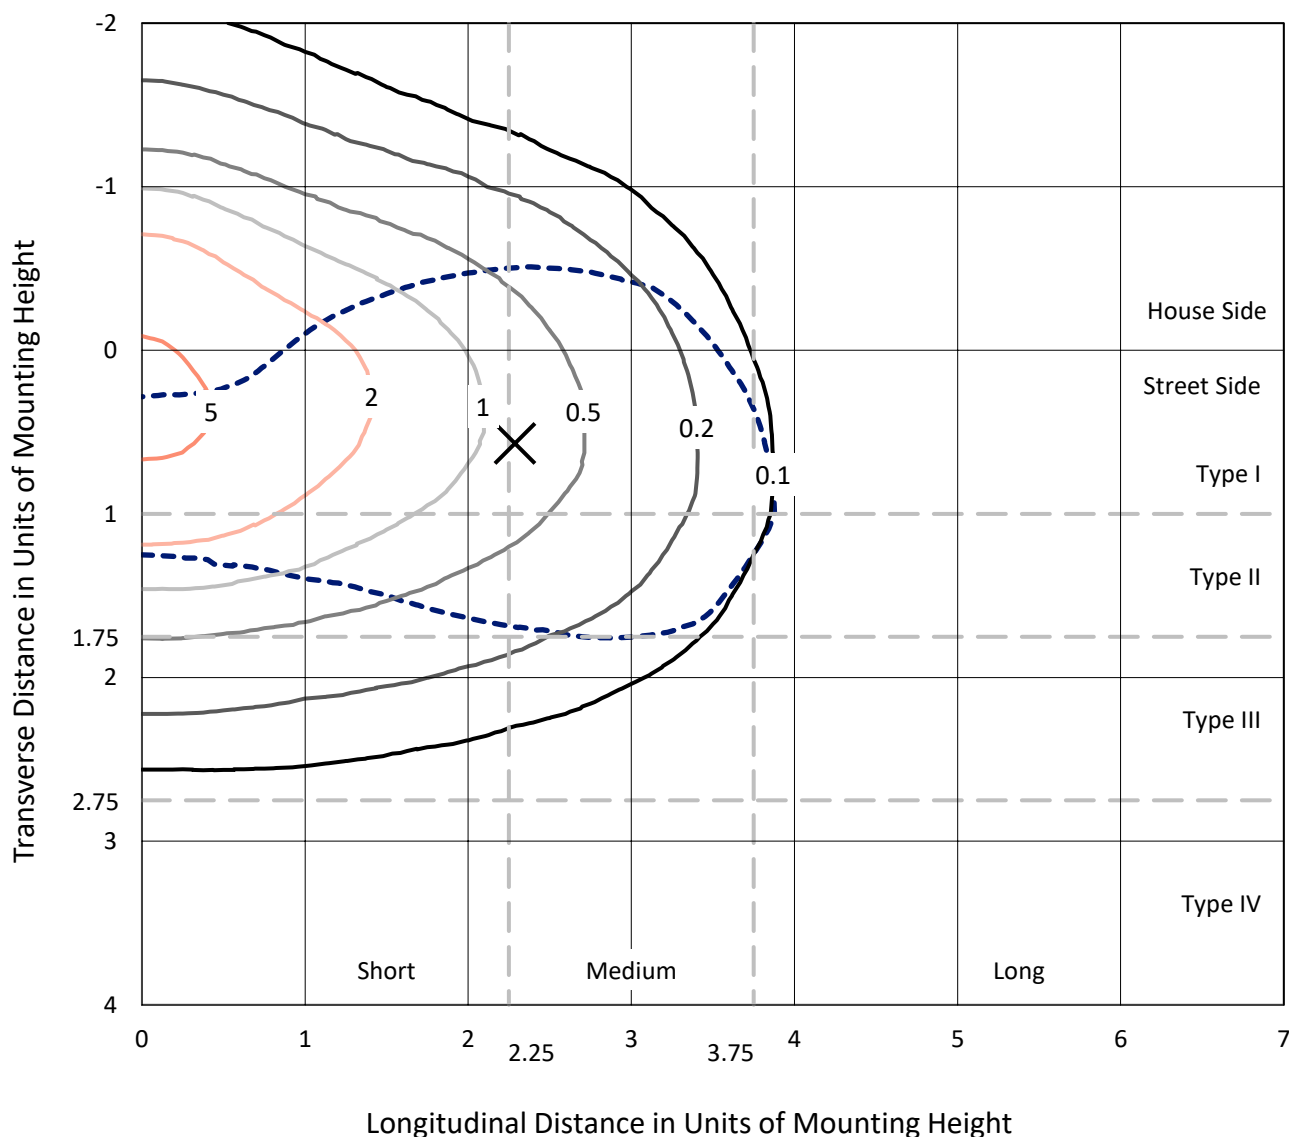

Based on 15 foot mounting height. Maximum calculated value = 6 fc
 Type II - Medium - N/A

REPORT NUMBER: P1211754
CATALOG NUMBER: GKO-PB1F-840-U-T2U

Luminous Intensity Polar Plot

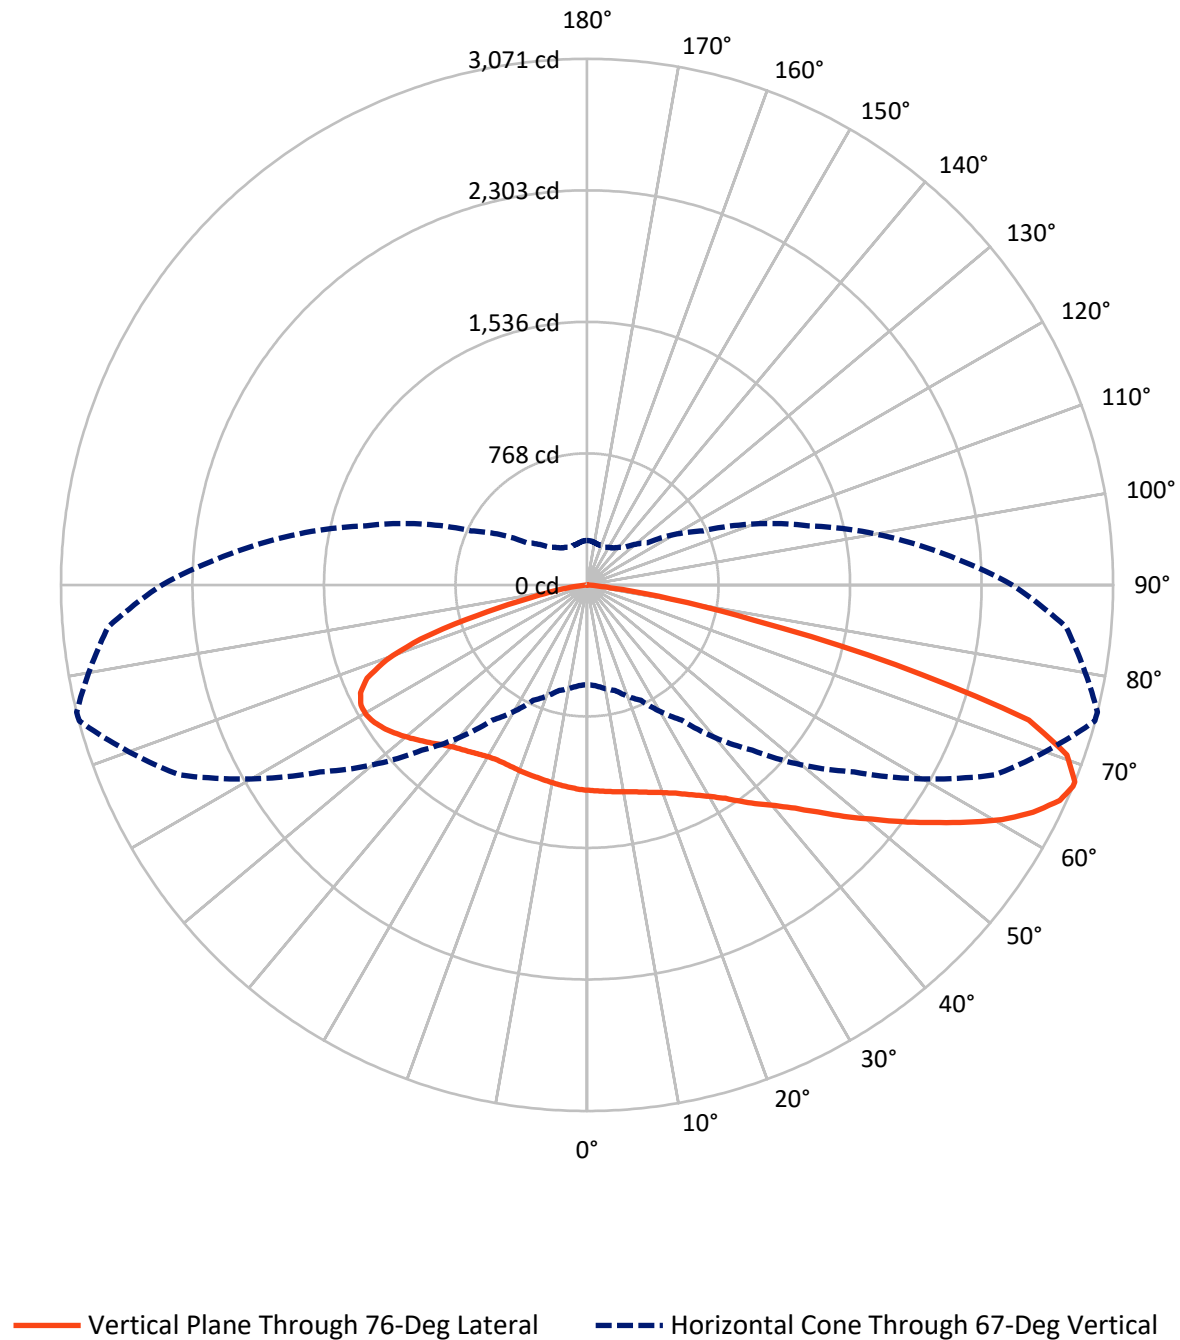

REPORT NUMBER: P1211754

CATALOG NUMBER: GKO-PB1F-840-U-T2U

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	2035.1	0.0	2035.1
	% Fixture	33.0	0.0	33.0
Street Side	Lumens	4133.4	0.0	4133.4
	% Fixture	67.0	0.0	67.0
Total	Lumens	6168.4	0.0	6168.4
	% Fixture	100.0	0.0	100.0

Coefficient of Utilization

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	115.3	1.9
10°-20°	352.6	5.7
20°-30°	606.6	9.8
30°-40°	871.7	14.1
40°-50°	1105.5	17.9
50°-60°	1214.0	19.7
60°-70°	1177.3	19.1
70°-80°	650.0	10.5
80°-90°	75.4	1.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	6168.4	100.0
0°-180°	6168.4	100.0



REPORT NUMBER: P1211754


CATALOG NUMBER: GKO-PB1F-840-U-T2U

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit		
				B	U	G
FL	(0°-30°)	624.9	10.1			
FM	(30°-60°)	2194.0	35.6			
FH	(60°-80°)	1287.9	20.9			G1/1800
FVH	(80°-90°)	26.6	0.4			G1/100
BL	(0°-30°)	449.6	7.3	B1/500		
BM	(30°-60°)	997.2	16.2	B1/1000		
BH	(60°-80°)	539.4	8.7	B2/1000		G2/1000
BVH	(80°-90°)	48.8	0.8			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B2-U0-G2

Type II Medium

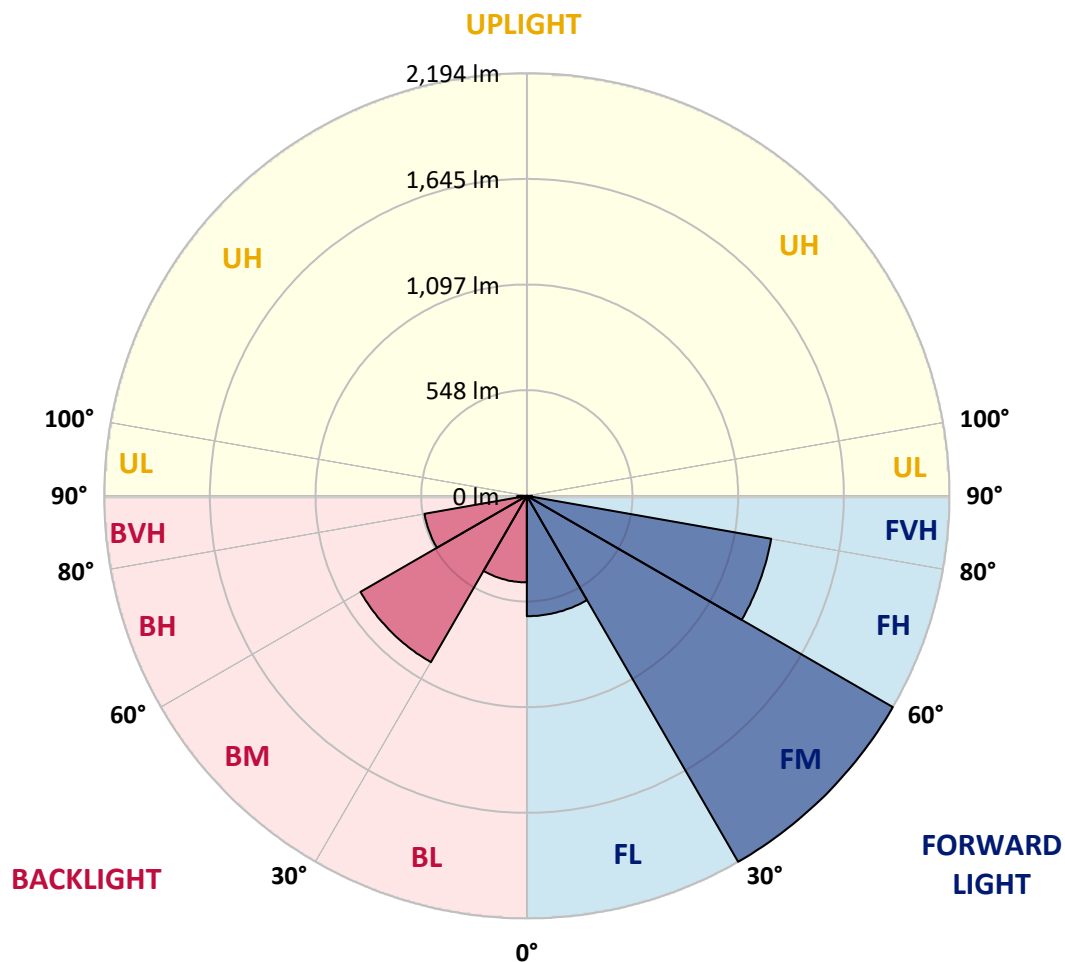



REPORT NUMBER: P1211754

CATALOG NUMBER: GKO-PB1F-840-U-T2U

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	76°	85°
0°	1199.1	1199.1	1199.1	1199.1	1199.1	1199.1	1199.1	1199.1	1199.1	1199.1	1199.1
2.5°	1234.9	1233.7	1232.5	1232.5	1227.7	1222.9	1218.2	1214.6	1205.0	1203.9	1199.1
5°	1271.9	1271.9	1268.3	1267.1	1259.9	1248.0	1237.3	1226.5	1213.4	1211.0	1200.3
7.5°	1319.6	1319.6	1313.6	1308.8	1298.1	1279.0	1259.9	1240.8	1221.7	1219.4	1202.7
10°	1380.4	1380.4	1375.7	1364.9	1342.3	1317.2	1286.2	1256.3	1231.3	1228.9	1205.0
12.5°	1443.7	1444.9	1437.7	1422.2	1394.7	1356.6	1318.4	1275.4	1243.2	1239.6	1209.8
15°	1508.1	1509.3	1504.5	1487.8	1450.8	1404.3	1353.0	1301.7	1258.7	1255.2	1217.0
17.5°	1571.3	1573.7	1568.9	1549.9	1506.9	1456.8	1393.6	1329.1	1277.8	1273.1	1228.9
20°	1631.0	1631.0	1631.0	1609.5	1567.8	1510.5	1437.7	1362.5	1299.3	1294.5	1243.2
22.5°	1684.7	1687.1	1690.6	1678.7	1631.0	1567.8	1489.0	1399.5	1326.7	1320.8	1261.1
25°	1738.4	1739.6	1749.1	1740.8	1694.2	1628.6	1543.9	1446.1	1360.1	1354.2	1282.6
27.5°	1800.4	1804.0	1810.0	1806.4	1753.9	1689.4	1604.7	1497.4	1397.1	1391.2	1308.8
30°	1873.2	1873.2	1876.8	1870.8	1818.3	1753.9	1665.6	1551.0	1443.7	1434.1	1341.1
32.5°	1932.8	1938.8	1936.4	1934.0	1879.2	1814.7	1727.6	1610.7	1497.4	1485.4	1385.2
35°	1988.9	1990.1	1988.9	1991.3	1936.4	1875.6	1793.2	1679.9	1557.0	1552.2	1441.3
37.5°	2021.1	2023.5	2029.5	2036.6	1987.7	1930.5	1858.9	1756.3	1631.0	1622.6	1508.1
40°	2036.6	2040.2	2072.4	2083.2	2030.7	1983.0	1928.1	1825.5	1702.6	1693.0	1574.9
42.5°	2060.5	2089.1	2105.8	2108.2	2062.9	2021.1	1987.7	1904.2	1790.9	1782.5	1664.4
45°	1981.8	1971.0	2015.2	2066.5	2064.1	2046.2	2045.0	1992.5	1899.4	1891.1	1765.8
47.5°	1882.7	1874.4	1898.2	1973.4	2027.1	2056.9	2101.1	2096.3	2030.7	2018.7	1883.9
50°	1646.5	1660.8	1777.7	1880.3	1973.4	2060.5	2148.8	2204.9	2158.3	2148.8	2009.2
52.5°	1425.8	1435.3	1515.3	1759.8	1904.2	2049.8	2190.6	2319.4	2307.5	2296.7	2146.4
55°	1270.7	1280.2	1407.9	1564.2	1801.6	1994.9	2218.0	2428.0	2459.0	2448.3	2292.0
57.5°	1108.4	1123.9	1211.0	1348.2	1664.4	1904.2	2227.5	2537.8	2623.7	2614.1	2431.6
60°	952.1	973.6	1024.9	1174.0	1495.0	1796.8	2202.5	2626.0	2782.3	2782.3	2575.9
62.5°	807.7	819.7	873.4	1008.2	1280.2	1659.6	2139.3	2682.1	2927.9	2921.9	2702.4
65°	688.4	694.4	737.3	853.1	1100.0	1508.1	2029.5	2678.5	3031.7	3032.9	2785.9
67°	581.0	590.6	638.3	743.3	962.8	1364.9	1903.0	2624.8	3068.7	3071.1	2806.2
67.5°	544.1	554.8	607.3	715.9	934.2	1325.5	1873.2	2602.2	3066.3	3071.1	2800.2
70°	374.6	377.0	465.3	589.4	768.4	1116.8	1666.8	2444.7	2975.6	2972.0	2670.2
72.5°	238.6	235.0	319.8	430.7	618.0	904.4	1406.7	2169.1	2700.0	2696.4	2354.0
75°	158.7	162.3	216.0	307.8	434.3	699.2	1096.5	1637.0	1875.6	1861.3	1553.4
77.5°	113.3	111.0	133.6	221.9	291.1	424.7	595.4	871.0	996.2	996.2	853.1
80°	62.0	63.2	72.8	122.9	164.6	165.8	223.1	436.7	486.8	497.5	414.0
82.5°	17.9	19.1	26.2	41.8	45.3	50.1	77.6	125.3	131.2	138.4	112.2
85°	0.0	0.0	0.0	1.2	4.8	6.0	6.0	7.2	11.9	11.9	13.1
87.5°	0.0	0.0	0.0	0.0	0.0	1.2	1.2	2.4	4.8	4.8	6.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0



REPORT NUMBER: P1211754

CATALOG NUMBER: GKO-PB1F-840-U-T2U

CANDELA DISTRIBUTION (continued):

	90°	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
0°	1199.1	1199.1	1199.1	1199.1	1199.1	1199.1	1199.1	1199.1	1199.1	1199.1	1199.1
2.5°	1197.9	1199.1	1194.3	1188.3	1183.6	1181.2	1174.0	1168.1	1171.6	1175.2	1175.2
5°	1196.7	1195.5	1186.0	1175.2	1168.1	1163.3	1151.4	1143.0	1144.2	1147.8	1146.6
7.5°	1196.7	1191.9	1178.8	1163.3	1151.4	1141.8	1126.3	1116.8	1115.6	1117.9	1115.6
10°	1197.9	1189.5	1171.6	1150.2	1133.5	1119.1	1100.0	1089.3	1085.7	1086.9	1084.5
12.5°	1200.3	1187.1	1164.5	1137.0	1115.6	1096.5	1075.0	1061.9	1059.5	1061.9	1061.9
15°	1203.9	1187.1	1158.5	1125.1	1096.5	1075.0	1053.5	1041.6	1041.6	1042.8	1042.8
17.5°	1211.0	1190.7	1153.7	1112.0	1077.4	1053.5	1034.4	1026.1	1027.3	1030.8	1030.8
20°	1218.2	1195.5	1149.0	1098.9	1060.7	1033.2	1017.7	1011.8	1016.5	1021.3	1021.3
22.5°	1228.9	1201.5	1144.2	1086.9	1041.6	1014.1	1001.0	996.2	1001.0	1007.0	1004.6
25°	1245.6	1212.2	1140.6	1076.2	1023.7	993.9	980.7	976.0	978.4	983.1	983.1
27.5°	1264.7	1225.3	1139.4	1063.1	1002.2	970.0	954.5	947.3	947.3	948.5	949.7
30°	1296.9	1248.0	1144.2	1053.5	983.1	944.9	924.7	913.9	912.7	917.5	917.5
32.5°	1335.1	1279.0	1156.1	1045.2	964.0	915.1	887.7	879.3	876.9	880.5	876.9
35°	1378.0	1313.6	1171.6	1044.0	944.9	882.9	851.9	842.3	835.2	832.8	830.4
37.5°	1438.9	1361.3	1187.1	1038.0	925.9	848.3	814.9	794.6	786.3	783.9	783.9
40°	1498.5	1407.9	1206.2	1028.5	903.2	813.7	766.0	743.3	739.7	739.7	739.7
42.5°	1573.7	1468.7	1232.5	1022.5	875.7	779.1	713.5	687.2	687.2	687.2	686.0
45°	1666.8	1548.7	1265.9	1020.1	849.5	737.3	657.4	622.8	621.6	620.4	619.2
47.5°	1775.4	1632.2	1298.1	1014.1	818.5	687.2	593.0	554.8	546.4	544.1	540.5
50°	1887.5	1722.9	1332.7	1005.8	781.5	628.8	532.1	488.0	470.1	464.1	466.5
52.5°	2006.8	1811.1	1366.1	993.9	737.3	570.3	470.1	423.6	405.7	398.5	397.3
55°	2123.7	1900.6	1397.1	978.4	689.6	510.7	417.6	372.3	356.7	354.4	354.4
57.5°	2241.9	1986.5	1421.0	955.7	637.1	458.2	372.3	335.3	324.5	329.3	329.3
60°	2349.2	2061.7	1432.9	924.7	584.6	410.4	336.5	309.0	304.2	316.2	315.0
62.5°	2445.9	2111.8	1427.0	879.3	533.3	369.9	309.0	288.7	289.9	304.2	305.4
65°	2492.4	2120.2	1392.4	817.3	476.1	335.3	280.4	261.3	263.7	279.2	282.8
67°	2481.7	2087.9	1335.1	746.9	429.5	309.0	262.5	243.4	244.6	257.7	258.9
67.5°	2469.7	2072.4	1319.6	725.4	417.6	304.2	257.7	239.8	242.2	254.1	254.1
70°	2311.1	1914.9	1176.4	615.6	361.5	270.8	235.0	223.1	225.5	232.7	232.7
72.5°	2019.9	1658.4	952.1	493.9	306.6	239.8	212.4	205.2	205.2	205.2	199.2
75°	1288.6	1039.2	622.8	378.2	252.9	205.2	190.9	182.5	177.8	184.9	182.5
77.5°	712.3	542.9	324.5	217.1	182.5	170.6	165.8	162.3	161.1	177.8	173.0
80°	337.7	268.5	182.5	124.1	105.0	126.5	143.2	140.8	168.2	230.3	231.5
82.5°	107.4	88.3	74.0	68.0	70.4	90.7	111.0	127.7	218.3	247.0	243.4
85°	13.1	11.9	8.4	27.4	46.5	66.8	85.9	165.8	200.4	167.0	157.5
87.5°	4.8	4.8	4.8	19.1	35.8	51.3	77.6	167.0	122.9	112.2	102.6
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP3-2511-595-3

Test Date: 11/12/2025

Luminaire Tested: GKO-PB1C-840-U-T4W

Data in this report applies to families of products including GKO-PB1C-840*

Test Information

Test Method: LM-79-2019
 Report Number: SP3-2511-595-3
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP3 - 3M SPHERE
 Measurement Geometry: 4π
 Issue Date: 01/27/2026
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: McGraw-Edison
 Catalog Number: **GKO-PB1C-840-U-T4W**
 Description: Gekko Wedge Wall Pack Fixture 1 SQ w/ T4W distribution

Spectral Parameters

CCT (K): 3958
 CIE u' : 0.2251
 CIE v' : 0.5041
 Duv: 0.0014
 CIE x: 0.3833
 CIE y: 0.3816
 CIE z: 0.2351
 Peak Wavelength (nm): 450
 Dominant Wavelength (nm): 578
 Purity: 29.56261
 R_f: 82.9
 R_g: 94.7

CRI (Ra): 80.8
 R1: 78.3
 R2: 87.6
 R3: 95.0
 R4: 79.6
 R5: 78.8
 R6: 83.3
 R7: 84.3
 R8: 59.4
 R9: -5.1
 R10: 71.4
 R11: 78.5
 R12: 60.5
 R13: 80.5
 R14: 97.5
 R15: 70.7



Test Conditions

Stabilization Time: 20M
 Operation Time: 1H 20M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP3-2511-595-3

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	3M SPHERE IN02505	7/1/2025	1/1/2026
Power Meter	XITRON INXT2011006	10/21/2025	10/21/2026
AC Power Source	CHROMA 61604 IN6064A	10/20/2025	10/20/2026
DC Power Source	EYSIGHT N5770A IN0534	10/20/2025	10/20/2026
Sphere Thermometer	TANDD IN4036E	10/21/2025	10/21/2026

REPORT NUMBER: SP3-2511-595-3

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP3-2511-595-3

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	296	NR	620	736	NR	750	18	NR	880	0	NR
365	0	NR	495	355	NR	625	683	NR	755	15	NR	885	0	NR
370	0	NR	500	415	NR	630	628	NR	760	13	NR	890	0	NR
375	0	NR	505	468	NR	635	571	NR	765	11	NR	895	0	NR
380	0	NR	510	511	NR	640	515	NR	770	9	NR	900	0	NR
385	0	NR	515	545	NR	645	460	NR	775	8	NR	905	0	NR
390	1	NR	520	570	NR	650	408	NR	780	7	NR	910	0	NR
395	3	NR	525	590	NR	655	359	NR	785	6	NR	915	0	NR
400	5	NR	530	606	NR	660	313	NR	790	5	NR	920	0	NR
405	7	NR	535	623	NR	665	273	NR	795	4	NR	925	0	NR
410	12	NR	540	641	NR	670	236	NR	800	4	NR	930	0	NR
415	22	NR	545	664	NR	675	204	NR	805	3	NR	935	0	NR
420	40	NR	550	690	NR	680	175	NR	810	3	NR	940	0	NR
425	73	NR	555	715	NR	685	151	NR	815	2	NR	945	0	NR
430	133	NR	560	747	NR	690	128	NR	820	2	NR	950	0	NR
435	236	NR	565	781	NR	695	109	NR	825	2	NR	955	0	NR
440	416	NR	570	809	NR	700	93	NR	830	1	NR	960	0	NR
445	757	NR	575	840	NR	705	78	NR	835	1	NR	965	0	NR
450	1000	NR	580	863	NR	710	67	NR	840	1	NR	970	0	NR
455	730	NR	585	880	NR	715	57	NR	845	1	NR	975	0	NR
460	494	NR	590	890	NR	720	48	NR	850	1	NR	980	0	NR
465	419	NR	595	890	NR	725	41	NR	855	1	NR	985	0	NR
470	305	NR	600	879	NR	730	35	NR	860	1	NR	990	0	NR
475	235	NR	605	856	NR	735	29	NR	865	1	NR	995	0	NR
480	237	NR	610	824	NR	740	25	NR	870	1	NR	1000	0	NR
485	257	NR	615	783	NR	745	21	NR	875	1	NR			

REPORT NUMBER: SP3-2511-595-3

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.65

λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)
360	0	NR	490	296	NR	620	736	NR	750	18	NR	880	0	NR
365	0	NR	495	355	NR	625	683	NR	755	15	NR	885	0	NR
370	0	NR	500	415	NR	630	628	NR	760	13	NR	890	0	NR
375	0	NR	505	468	NR	635	571	NR	765	11	NR	895	0	NR
380	0	NR	510	511	NR	640	515	NR	770	9	NR	900	0	NR
385	0	NR	515	545	NR	645	460	NR	775	8	NR	905	0	NR
390	1	NR	520	570	NR	650	408	NR	780	7	NR	910	0	NR
395	3	NR	525	590	NR	655	359	NR	785	6	NR	915	0	NR
400	5	NR	530	606	NR	660	313	NR	790	5	NR	920	0	NR
405	7	NR	535	623	NR	665	273	NR	795	4	NR	925	0	NR
410	12	NR	540	641	NR	670	236	NR	800	4	NR	930	0	NR
415	22	NR	545	664	NR	675	204	NR	805	3	NR	935	0	NR
420	40	NR	550	690	NR	680	175	NR	810	3	NR	940	0	NR
425	73	NR	555	715	NR	685	151	NR	815	2	NR	945	0	NR
430	133	NR	560	747	NR	690	128	NR	820	2	NR	950	0	NR
435	236	NR	565	781	NR	695	109	NR	825	2	NR	955	0	NR
440	416	NR	570	809	NR	700	93	NR	830	1	NR	960	0	NR
445	757	NR	575	840	NR	705	78	NR	835	1	NR	965	0	NR
450	1000	NR	580	863	NR	710	67	NR	840	1	NR	970	0	NR
455	730	NR	585	880	NR	715	57	NR	845	1	NR	975	0	NR
460	494	NR	590	890	NR	720	48	NR	850	1	NR	980	0	NR
465	419	NR	595	890	NR	725	41	NR	855	1	NR	985	0	NR
470	305	NR	600	879	NR	730	35	NR	860	1	NR	990	0	NR
475	235	NR	605	856	NR	735	29	NR	865	1	NR	995	0	NR
480	237	NR	610	824	NR	740	25	NR	870	1	NR	1000	0	NR
485	257	NR	615	783	NR	745	21	NR	875	1	NR			

REPORT NUMBER: SP3-2511-595-3

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.36


λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	296	NR	620	736	NR	750	18	NR	880	0	NR
365	0	NR	495	355	NR	625	683	NR	755	15	NR	885	0	NR
370	0	NR	500	415	NR	630	628	NR	760	13	NR	890	0	NR
375	0	NR	505	468	NR	635	571	NR	765	11	NR	895	0	NR
380	0	NR	510	511	NR	640	515	NR	770	9	NR	900	0	NR
385	0	NR	515	545	NR	645	460	NR	775	8	NR	905	0	NR
390	1	NR	520	570	NR	650	408	NR	780	7	NR	910	0	NR
395	3	NR	525	590	NR	655	359	NR	785	6	NR	915	0	NR
400	5	NR	530	606	NR	660	313	NR	790	5	NR	920	0	NR
405	7	NR	535	623	NR	665	273	NR	795	4	NR	925	0	NR
410	12	NR	540	641	NR	670	236	NR	800	4	NR	930	0	NR
415	22	NR	545	664	NR	675	204	NR	805	3	NR	935	0	NR
420	40	NR	550	690	NR	680	175	NR	810	3	NR	940	0	NR
425	73	NR	555	715	NR	685	151	NR	815	2	NR	945	0	NR
430	133	NR	560	747	NR	690	128	NR	820	2	NR	950	0	NR
435	236	NR	565	781	NR	695	109	NR	825	2	NR	955	0	NR
440	416	NR	570	809	NR	700	93	NR	830	1	NR	960	0	NR
445	757	NR	575	840	NR	705	78	NR	835	1	NR	965	0	NR
450	1000	NR	580	863	NR	710	67	NR	840	1	NR	970	0	NR
455	730	NR	585	880	NR	715	57	NR	845	1	NR	975	0	NR
460	494	NR	590	890	NR	720	48	NR	850	1	NR	980	0	NR
465	419	NR	595	890	NR	725	41	NR	855	1	NR	985	0	NR
470	305	NR	600	879	NR	730	35	NR	860	1	NR	990	0	NR
475	235	NR	605	856	NR	735	29	NR	865	1	NR	995	0	NR
480	237	NR	610	824	NR	740	25	NR	870	1	NR	1000	0	NR
485	257	NR	615	783	NR	745	21	NR	875	1	NR			

REPORT NUMBER: SP3-2511-595-3



TM-30-18

Summary

$R_f = 82.9$
 $R_g = 94.7$
 $CIE R_a = 80.8$
 $R_g = -5.1$

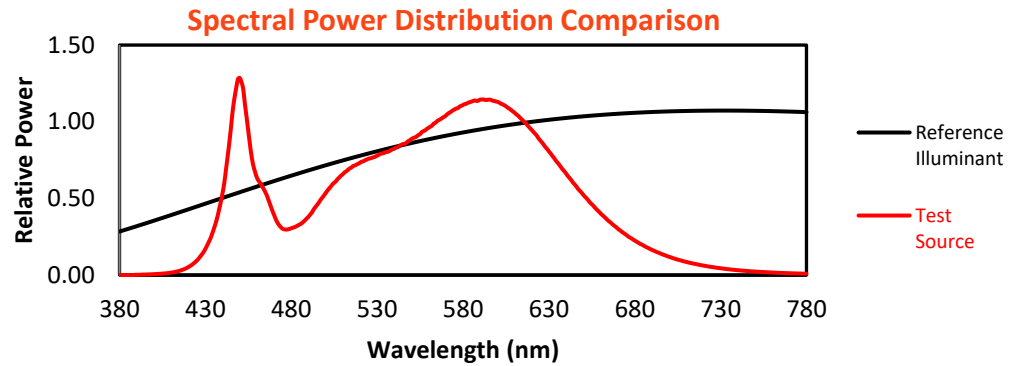


Color Vector Graphics

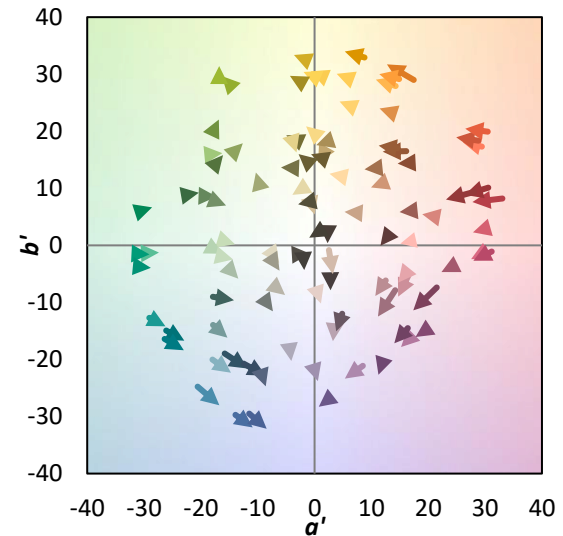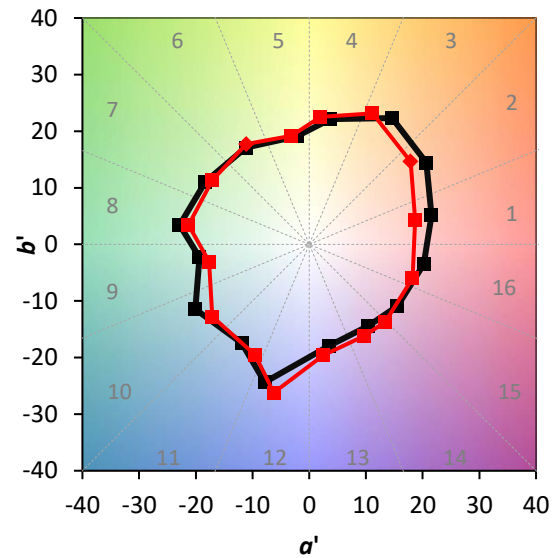

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 80	CES51 = 94	CES76 = 73
CES02 = 61	CES27 = 93	CES52 = 94	CES77 = 82
CES03 = 31	CES28 = 91	CES53 = 88	CES78 = 72
CES04 = 70	CES29 = 85	CES54 = 89	CES79 = 91
CES05 = 48	CES30 = 96	CES55 = 88	CES80 = 89
CES06 = 50	CES31 = 87	CES56 = 84	CES81 = 79
CES07 = 40	CES32 = 80	CES57 = 83	CES82 = 95
CES08 = 39	CES33 = 92	CES58 = 84	CES83 = 95
CES09 = 29	CES34 = 86	CES59 = 90	CES84 = 90
CES10 = 74	CES35 = 92	CES60 = 90	CES85 = 78
CES11 = 57	CES36 = 83	CES61 = 86	CES86 = 72
CES12 = 63	CES37 = 91	CES62 = 86	CES87 = 83
CES13 = 42	CES38 = 93	CES63 = 85	CES88 = 87
CES14 = 74	CES39 = 98	CES64 = 78	CES89 = 76
CES15 = 71	CES40 = 95	CES65 = 75	CES90 = 87
CES16 = 47	CES41 = 99	CES66 = 74	CES91 = 71
CES17 = 49	CES42 = 93	CES67 = 73	CES92 = 62
CES18 = 56	CES43 = 89	CES68 = 77	CES93 = 77
CES19 = 71	CES44 = 99	CES69 = 82	CES94 = 60
CES20 = 65	CES45 = 93	CES70 = 73	CES95 = 70
CES21 = 86	CES46 = 90	CES71 = 67	CES96 = 82
CES22 = 78	CES47 = 96	CES72 = 89	CES97 = 90
CES23 = 91	CES48 = 84	CES73 = 66	CES98 = 84
CES24 = 90	CES49 = 89	CES74 = 93	CES99 = 73
CES25 = 71	CES50 = 94	CES75 = 70	

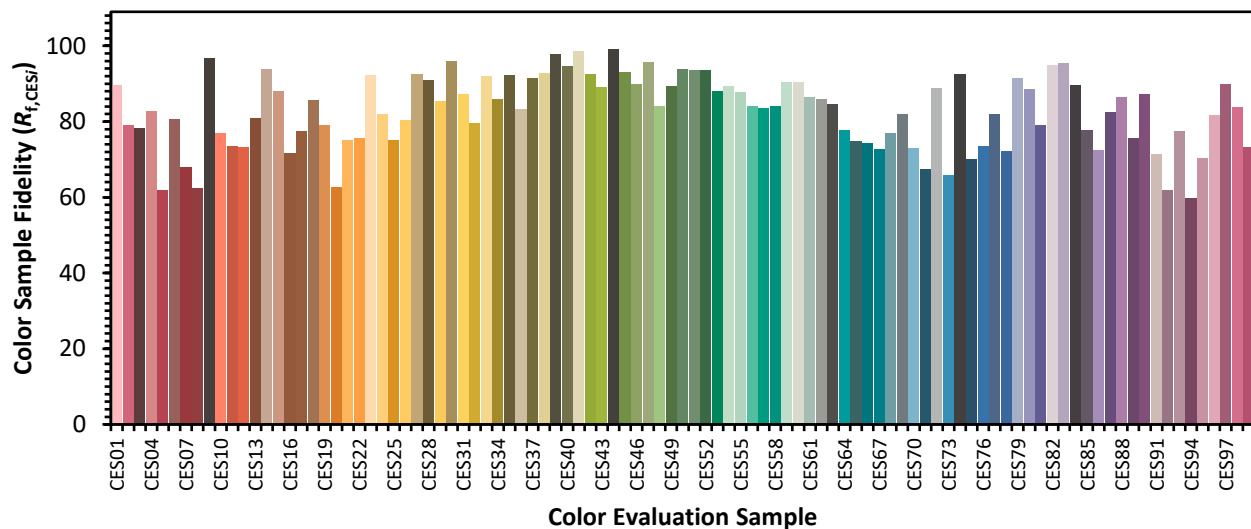

Color Rendition by Hue-Angle Bin



Measure Comparisons

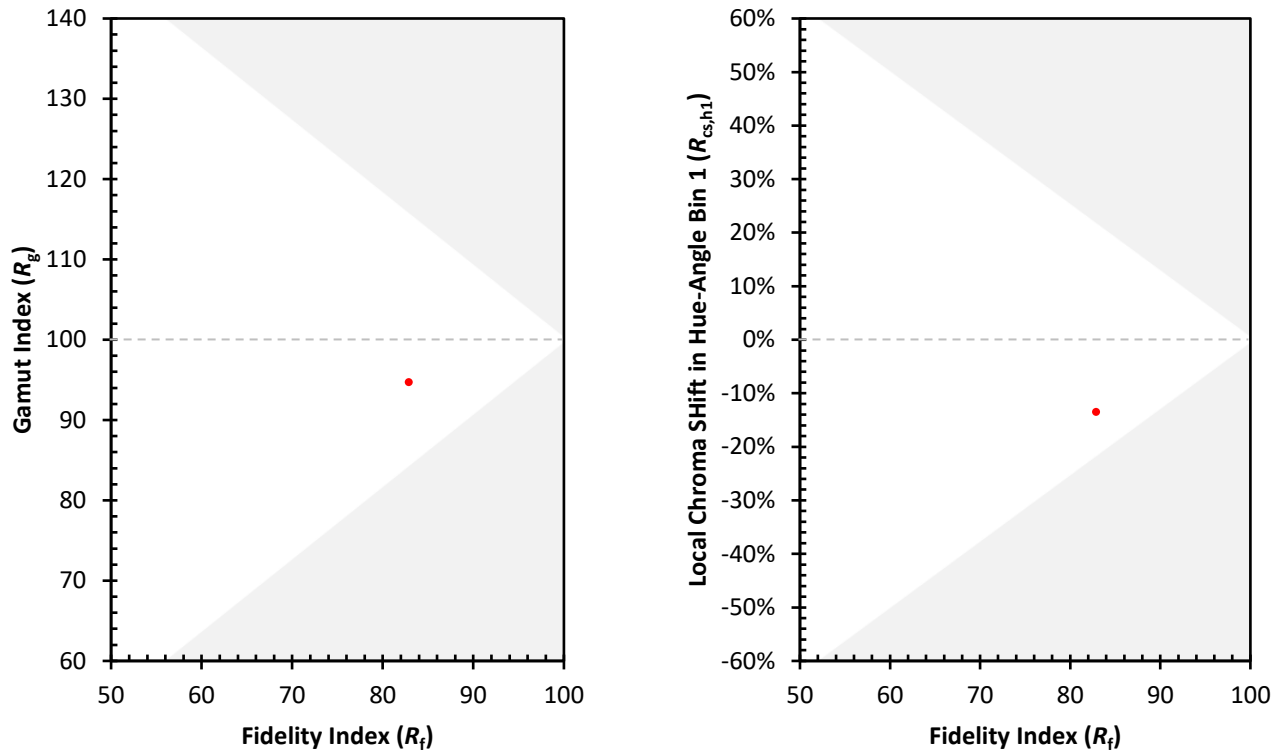

(END OF REPORT)