

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1212050

Luminaire Tested: **GKO-PB2B-840-U-T1**

Issue Date: 11/5/2025

Test Information

Test Method: LM-79-08
Report Number: P1212050
Test Lab: INNOVATION CENTER(G1)
Issue Date: 11/5/2025
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: MCGRAW-EDISON
Catalog Number: GKO-PB2B-840-U-T1
Description: GEKKO WALL PACK 6000LM PACKAGE 80CRI 4000K FIXTURE w/ TYPE I
DISTRIBUTION OPTIC
Light Source: (20) 4000K CCT, 80 CRI LEDS
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6174.7 lumens
Efficiency: N/A
Efficacy: 147.7 lumens/watt
Luminous Opening: Rectangular (W 0.67' x L: 0.33' x H: 0')
IES Classification: Type I - Short
BUG Rating: B2 - U0 - G2

Input Watts (W): 41.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.97
Total Harmonic Distortion (THDi): 8%
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

REPORT NUMBER: P1212050
 CATALOG NUMBER: GKO-PB2B-840-U-T1

Iso-Footcandle Lines of Horizontal Illumination


✕ Max cd
 - - - 1/2 Max cd

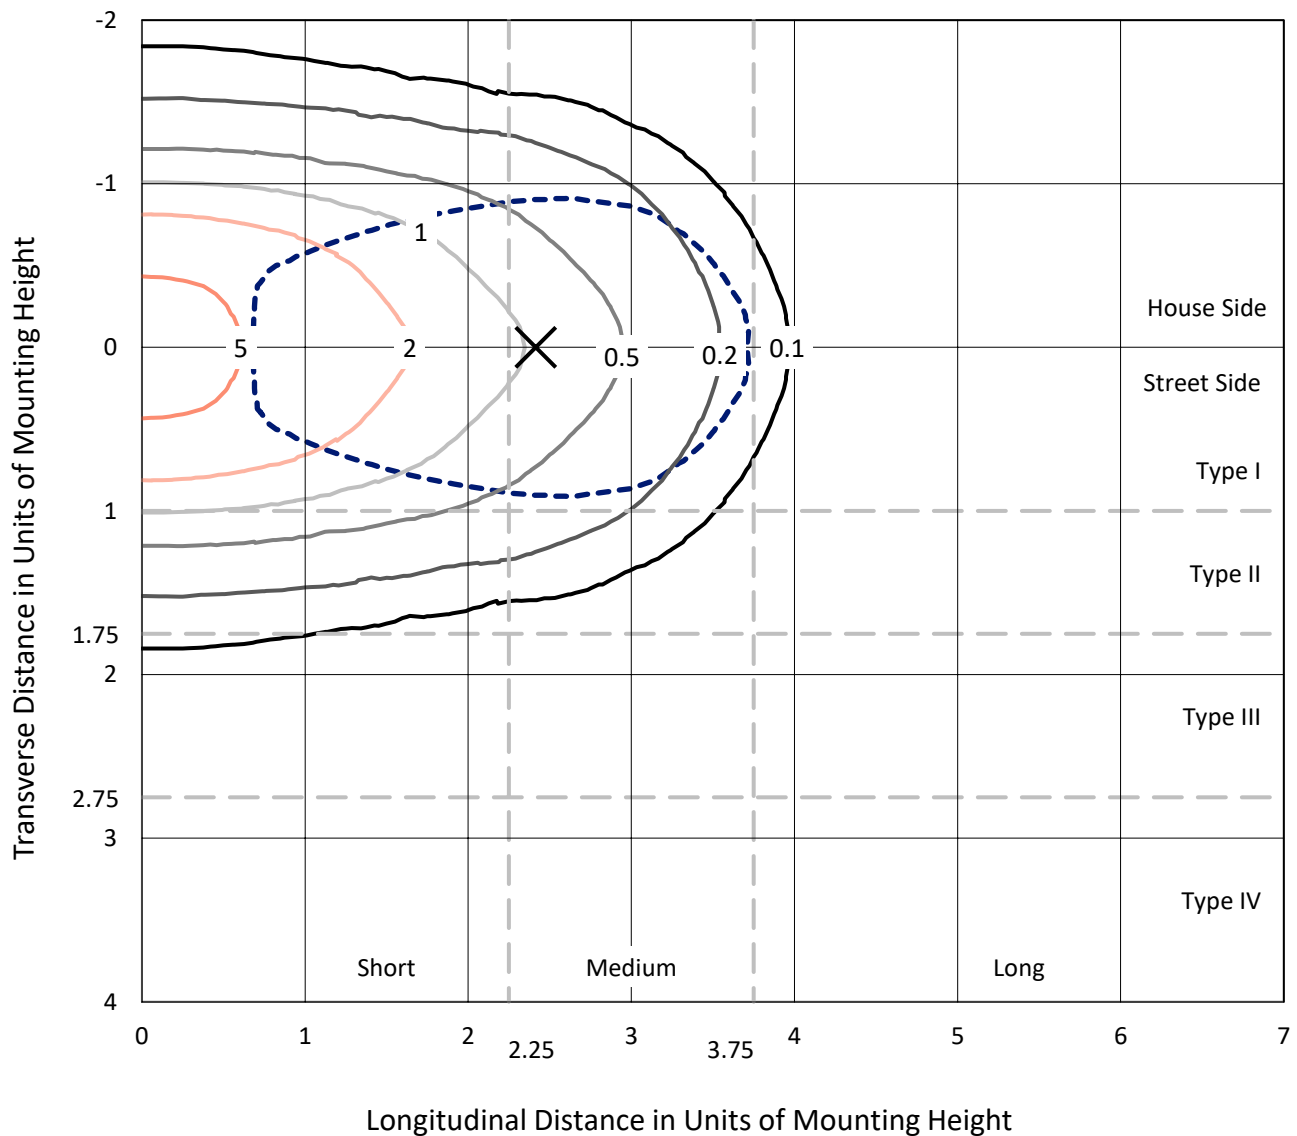

Based on 15 foot mounting height. Maximum calculated value = 6.8 fc
 Type I - Short - N/A

REPORT NUMBER: P1212050
CATALOG NUMBER: GKO-PB2B-840-U-T1

Luminous Intensity Polar Plot

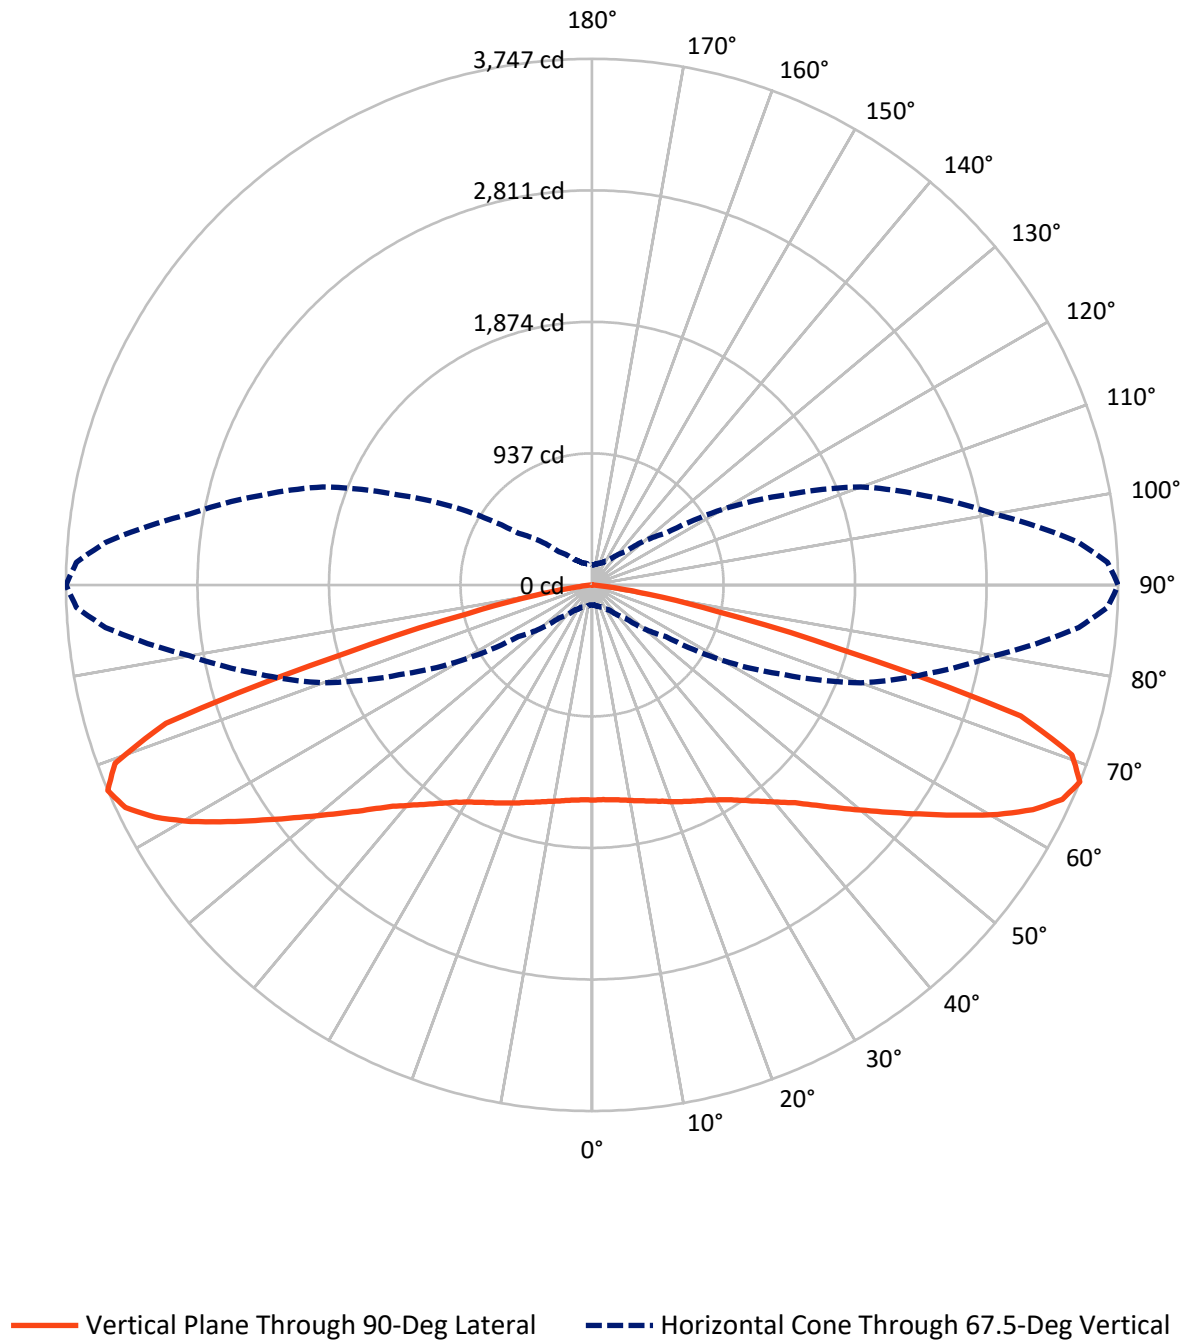

REPORT NUMBER: P1212050

CATALOG NUMBER: GKO-PB2B-840-U-T1


FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	3087.3	0.0	3087.3
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	3087.3	0.0	3087.3
	% Fixture	50.0	0.0	50.0
Total	Lumens	6174.7	0.0	6174.7
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	147.0	2.4
10°-20°	442.8	7.2
20°-30°	736.3	11.9
30°-40°	978.2	15.8
40°-50°	1102.8	17.9
50°-60°	1134.0	18.4
60°-70°	1071.6	17.4
70°-80°	524.6	8.5
80°-90°	37.5	0.6
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	6174.7	100.0
0°-180°	6174.7	100.0

Coefficient of Utilization

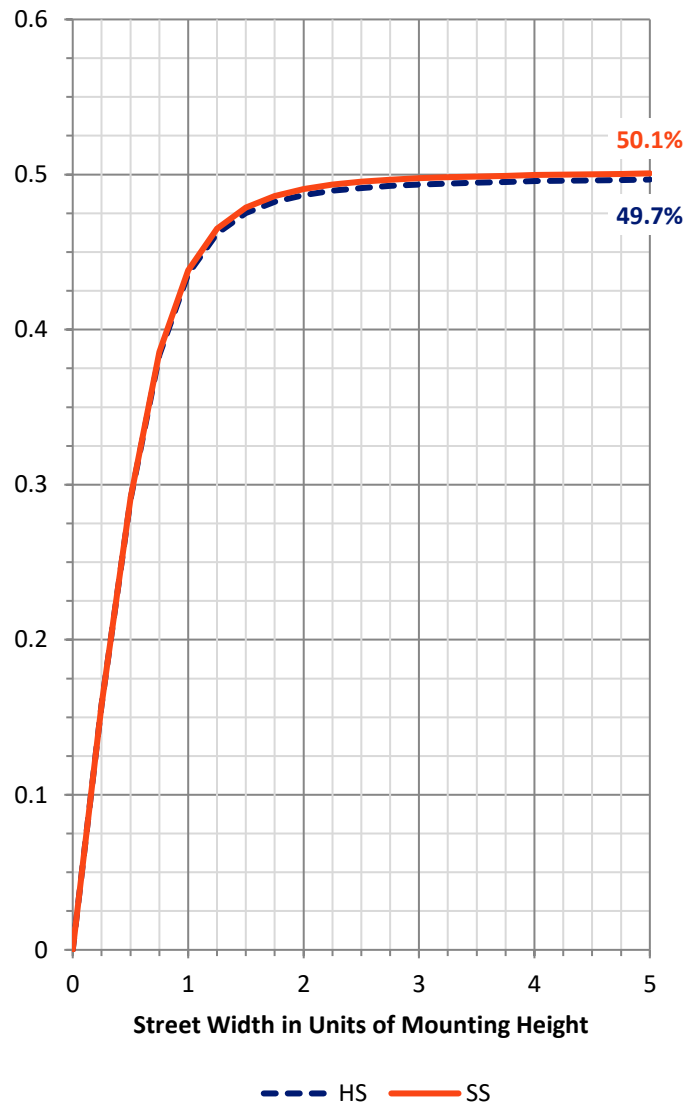

REPORT NUMBER: P1212050


CATALOG NUMBER: GKO-PB2B-840-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit		
				B	U	G
FL	(0°-30°)	663.0	10.7			
FM	(30°-60°)	1607.4	26.0			
FH	(60°-80°)	798.1	12.9			G1/1800
FVH	(80°-90°)	18.8	0.3			G1/100
BL	(0°-30°)	663.0	10.7	B2/1000		
BM	(30°-60°)	1607.4	26.0	B2/2500		
BH	(60°-80°)	798.1	12.9	B2/1000		G2/1000
BVH	(80°-90°)	18.8	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B2-U0-G2

Type I Short

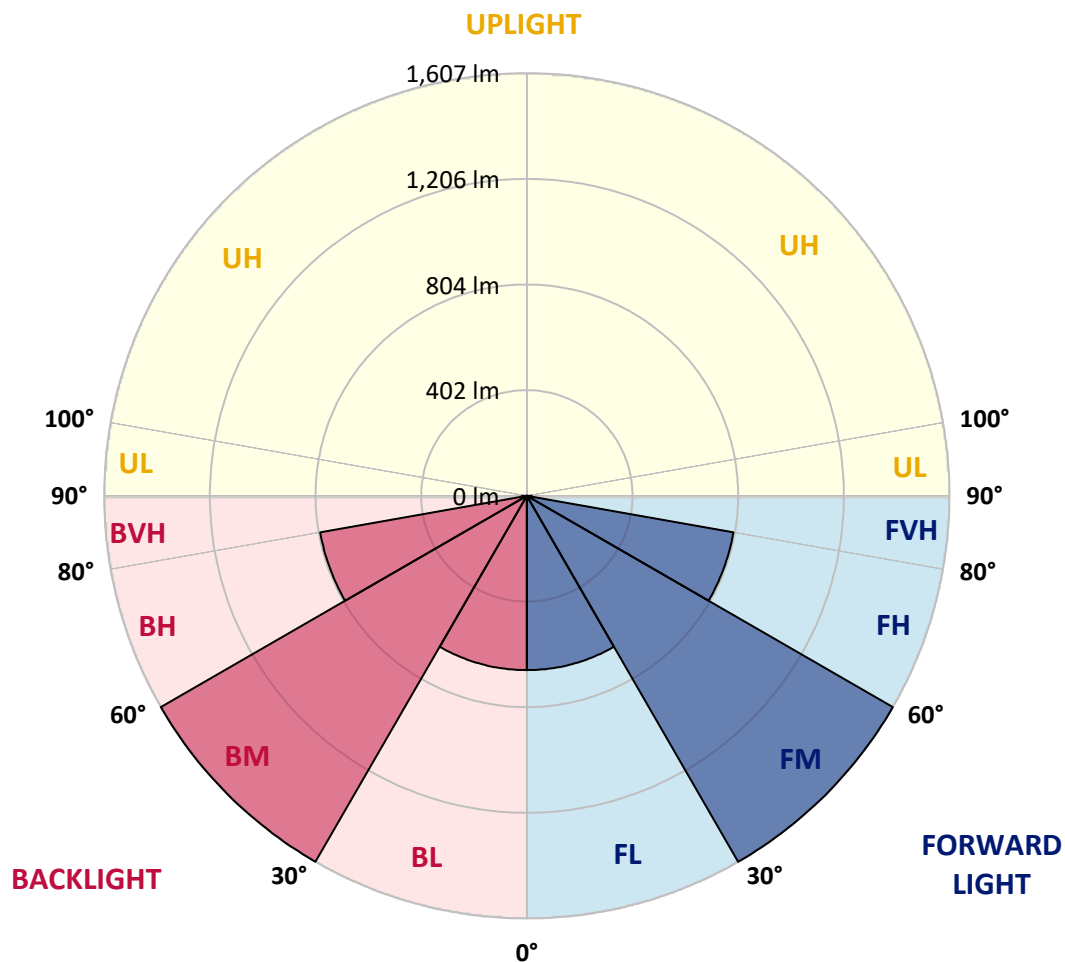



REPORT NUMBER: P1212050

CATALOG NUMBER: GKO-PB2B-840-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	1532.2	1532.2	1532.2	1532.2	1532.2	1532.2	1532.2	1532.2	1532.2	1532.2	1532.2
2.5°	1533.3	1535.6	1531.1	1531.1	1533.3	1534.5	1534.5	1535.6	1533.3	1533.3	1532.2
5°	1533.3	1534.5	1532.2	1532.2	1534.5	1537.9	1536.7	1539.0	1539.0	1537.9	1537.9
7.5°	1532.2	1534.5	1532.2	1533.3	1536.7	1543.6	1543.6	1543.6	1545.9	1548.1	1548.1
10°	1531.1	1533.3	1534.5	1535.6	1540.2	1550.4	1552.7	1553.8	1557.2	1560.7	1560.7
12.5°	1525.4	1527.6	1531.1	1535.6	1543.6	1557.2	1561.8	1565.2	1570.9	1574.3	1576.6
15°	1517.4	1518.5	1526.5	1535.6	1548.1	1565.2	1574.3	1580.0	1588.0	1592.5	1595.9
17.5°	1506.0	1507.2	1519.7	1533.3	1551.5	1575.5	1590.3	1599.4	1607.3	1614.2	1618.7
20°	1491.2	1494.6	1509.4	1531.1	1557.2	1585.7	1607.3	1623.3	1631.2	1638.1	1644.9
22.5°	1473.0	1476.4	1494.6	1525.4	1562.9	1599.4	1627.8	1648.3	1658.6	1667.7	1675.6
25°	1445.7	1450.2	1471.9	1511.7	1565.2	1614.2	1650.6	1676.8	1685.9	1697.3	1704.1
27.5°	1403.6	1407.0	1433.2	1484.4	1558.4	1630.1	1676.8	1707.5	1717.7	1730.3	1737.1
30°	1337.5	1344.4	1376.2	1440.0	1541.3	1642.6	1707.5	1738.2	1750.8	1763.3	1772.4
32.5°	1252.2	1262.4	1297.7	1379.7	1508.3	1647.2	1740.5	1775.8	1791.7	1805.4	1816.8
35°	1146.3	1156.5	1198.7	1302.3	1455.9	1638.1	1773.5	1819.1	1838.4	1856.6	1870.3
37.5°	1025.6	1034.7	1086.0	1204.4	1380.8	1609.6	1799.7	1866.9	1893.0	1917.0	1935.2
40°	903.8	914.1	969.9	1096.2	1289.7	1555.0	1811.1	1919.2	1952.2	1983.0	2005.7
42.5°	771.8	784.3	846.9	981.2	1183.9	1479.8	1802.0	1970.5	2011.4	2053.6	2087.7
45°	654.5	656.8	725.1	854.9	1067.8	1383.1	1770.1	2019.4	2075.2	2134.4	2183.3
47.5°	541.8	546.4	605.6	734.2	947.1	1273.8	1712.1	2058.1	2146.9	2223.2	2294.9
50°	441.7	447.4	500.9	615.8	826.4	1154.3	1633.5	2080.9	2208.4	2312.0	2412.1
52.5°	359.7	366.5	410.9	512.2	704.6	1029.1	1536.7	2084.3	2264.1	2400.7	2533.9
55°	299.4	303.9	338.1	418.9	587.4	899.3	1426.3	2067.2	2300.6	2480.4	2658.0
57.5°	252.7	257.3	281.2	344.9	481.5	766.1	1292.0	2027.4	2319.9	2549.9	2783.2
60°	219.7	223.1	240.2	285.7	396.1	640.9	1147.4	1956.8	2314.2	2593.1	2886.8
62.5°	195.8	196.9	211.7	243.6	326.7	522.5	984.7	1850.9	2267.6	2598.8	2957.4
65°	174.2	175.3	184.4	207.2	268.6	420.0	815.0	1705.2	2178.8	2559.0	2967.6
67.5°	141.2	143.4	157.1	174.2	220.8	332.4	642.0	1514.0	2039.9	2455.4	2909.6
70°	112.7	113.8	127.5	146.8	179.9	261.8	492.9	1256.7	1822.5	2286.9	2759.3
72.5°	84.2	86.5	99.0	118.4	146.8	202.6	356.3	950.5	1457.1	1928.3	2403.0
75°	67.2	68.3	72.9	91.1	113.8	153.7	240.2	576.0	877.7	1193.0	1473.0
77.5°	56.9	58.1	58.1	70.6	84.2	103.6	127.5	228.8	371.1	528.2	700.1
80°	46.7	48.9	44.4	52.4	60.3	60.3	59.2	109.3	175.3	248.2	325.6
82.5°	34.1	36.4	34.1	36.4	36.4	33.0	30.7	41.0	55.8	76.3	83.1
85°	23.9	25.0	27.3	25.0	23.9	19.4	14.8	11.4	6.8	8.0	11.4
87.5°	15.9	19.4	22.8	21.6	18.2	14.8	10.2	6.8	3.4	4.6	4.6
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0



REPORT NUMBER: P1212050
 CATALOG NUMBER: GKO-PB2B-840-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	1532.2	1532.2	1532.2
2.5°	1533.3	1532.2	1531.1
5°	1539.0	1537.9	1536.7
7.5°	1547.0	1547.0	1547.0
10°	1559.5	1561.8	1561.8
12.5°	1575.5	1577.7	1577.7
15°	1594.8	1595.9	1598.2
17.5°	1618.7	1619.8	1619.8
20°	1647.2	1646.0	1648.3
22.5°	1675.6	1675.6	1675.6
25°	1705.2	1705.2	1705.2
27.5°	1739.4	1739.4	1737.1
30°	1776.9	1776.9	1776.9
32.5°	1822.5	1823.6	1824.7
35°	1880.5	1882.8	1886.2
37.5°	1946.5	1952.2	1955.7
40°	2025.1	2027.4	2033.1
42.5°	2112.7	2119.6	2120.7
45°	2222.0	2233.4	2238.0
47.5°	2350.7	2366.6	2374.6
50°	2494.1	2512.3	2523.7
52.5°	2650.0	2679.6	2693.3
55°	2816.2	2867.5	2882.3
57.5°	3004.1	3073.5	3094.0
60°	3188.5	3286.4	3319.4
62.5°	3345.6	3483.3	3524.3
65°	3456.0	3622.2	3682.5
67.5°	3478.7	3675.7	3747.4
70°	3342.1	3543.6	3626.7
72.5°	2906.2	3088.3	3191.9
75°	1716.6	1847.5	1815.6
77.5°	861.7	899.3	905.0
80°	377.9	400.7	409.8
82.5°	93.3	95.6	108.1
85°	12.5	14.8	13.7
87.5°	4.6	4.6	5.7
90°	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP3-2511-595-3

Test Date: 11/12/2025

Luminaire Tested: GKO-PB1C-840-U-T4W

Data in this report applies to families of products including GKO-PB1C-840*

Test Information

Test Method: LM-79-2019
 Report Number: SP3-2511-595-3
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP3 - 3M SPHERE
 Measurement Geometry: 4π
 Issue Date: 01/27/2026
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: McGraw-Edison
 Catalog Number: **GKO-PB1C-840-U-T4W**
 Description: Gekko Wedge Wall Pack Fixture 1 SQ w/ T4W distribution

Spectral Parameters

CCT (K): 3958
 CIE u' : 0.2251
 CIE v' : 0.5041
 Duv: 0.0014
 CIE x: 0.3833
 CIE y: 0.3816
 CIE z: 0.2351
 Peak Wavelength (nm): 450
 Dominant Wavelength (nm): 578
 Purity: 29.56261
 R_f: 82.9
 R_g: 94.7

CRI (Ra): 80.8
 R1: 78.3
 R2: 87.6
 R3: 95.0
 R4: 79.6
 R5: 78.8
 R6: 83.3
 R7: 84.3
 R8: 59.4
 R9: -5.1
 R10: 71.4
 R11: 78.5
 R12: 60.5
 R13: 80.5
 R14: 97.5
 R15: 70.7



Test Conditions

Stabilization Time: 20M
 Operation Time: 1H 20M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP3-2511-595-3

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	3M SPHERE IN02505	7/1/2025	1/1/2026
Power Meter	XITRON INXT2011006	10/21/2025	10/21/2026
AC Power Source	CHROMA 61604 IN6064A	10/20/2025	10/20/2026
DC Power Source	EYSIGHT N5770A IN0534	10/20/2025	10/20/2026
Sphere Thermometer	TANDD IN4036E	10/21/2025	10/21/2026

REPORT NUMBER: SP3-2511-595-3

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP3-2511-595-3

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	296	NR	620	736	NR	750	18	NR	880	0	NR
365	0	NR	495	355	NR	625	683	NR	755	15	NR	885	0	NR
370	0	NR	500	415	NR	630	628	NR	760	13	NR	890	0	NR
375	0	NR	505	468	NR	635	571	NR	765	11	NR	895	0	NR
380	0	NR	510	511	NR	640	515	NR	770	9	NR	900	0	NR
385	0	NR	515	545	NR	645	460	NR	775	8	NR	905	0	NR
390	1	NR	520	570	NR	650	408	NR	780	7	NR	910	0	NR
395	3	NR	525	590	NR	655	359	NR	785	6	NR	915	0	NR
400	5	NR	530	606	NR	660	313	NR	790	5	NR	920	0	NR
405	7	NR	535	623	NR	665	273	NR	795	4	NR	925	0	NR
410	12	NR	540	641	NR	670	236	NR	800	4	NR	930	0	NR
415	22	NR	545	664	NR	675	204	NR	805	3	NR	935	0	NR
420	40	NR	550	690	NR	680	175	NR	810	3	NR	940	0	NR
425	73	NR	555	715	NR	685	151	NR	815	2	NR	945	0	NR
430	133	NR	560	747	NR	690	128	NR	820	2	NR	950	0	NR
435	236	NR	565	781	NR	695	109	NR	825	2	NR	955	0	NR
440	416	NR	570	809	NR	700	93	NR	830	1	NR	960	0	NR
445	757	NR	575	840	NR	705	78	NR	835	1	NR	965	0	NR
450	1000	NR	580	863	NR	710	67	NR	840	1	NR	970	0	NR
455	730	NR	585	880	NR	715	57	NR	845	1	NR	975	0	NR
460	494	NR	590	890	NR	720	48	NR	850	1	NR	980	0	NR
465	419	NR	595	890	NR	725	41	NR	855	1	NR	985	0	NR
470	305	NR	600	879	NR	730	35	NR	860	1	NR	990	0	NR
475	235	NR	605	856	NR	735	29	NR	865	1	NR	995	0	NR
480	237	NR	610	824	NR	740	25	NR	870	1	NR	1000	0	NR
485	257	NR	615	783	NR	745	21	NR	875	1	NR			

REPORT NUMBER: SP3-2511-595-3

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.65

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	296	NR	620	736	NR	750	18	NR	880	0	NR
365	0	NR	495	355	NR	625	683	NR	755	15	NR	885	0	NR
370	0	NR	500	415	NR	630	628	NR	760	13	NR	890	0	NR
375	0	NR	505	468	NR	635	571	NR	765	11	NR	895	0	NR
380	0	NR	510	511	NR	640	515	NR	770	9	NR	900	0	NR
385	0	NR	515	545	NR	645	460	NR	775	8	NR	905	0	NR
390	1	NR	520	570	NR	650	408	NR	780	7	NR	910	0	NR
395	3	NR	525	590	NR	655	359	NR	785	6	NR	915	0	NR
400	5	NR	530	606	NR	660	313	NR	790	5	NR	920	0	NR
405	7	NR	535	623	NR	665	273	NR	795	4	NR	925	0	NR
410	12	NR	540	641	NR	670	236	NR	800	4	NR	930	0	NR
415	22	NR	545	664	NR	675	204	NR	805	3	NR	935	0	NR
420	40	NR	550	690	NR	680	175	NR	810	3	NR	940	0	NR
425	73	NR	555	715	NR	685	151	NR	815	2	NR	945	0	NR
430	133	NR	560	747	NR	690	128	NR	820	2	NR	950	0	NR
435	236	NR	565	781	NR	695	109	NR	825	2	NR	955	0	NR
440	416	NR	570	809	NR	700	93	NR	830	1	NR	960	0	NR
445	757	NR	575	840	NR	705	78	NR	835	1	NR	965	0	NR
450	1000	NR	580	863	NR	710	67	NR	840	1	NR	970	0	NR
455	730	NR	585	880	NR	715	57	NR	845	1	NR	975	0	NR
460	494	NR	590	890	NR	720	48	NR	850	1	NR	980	0	NR
465	419	NR	595	890	NR	725	41	NR	855	1	NR	985	0	NR
470	305	NR	600	879	NR	730	35	NR	860	1	NR	990	0	NR
475	235	NR	605	856	NR	735	29	NR	865	1	NR	995	0	NR
480	237	NR	610	824	NR	740	25	NR	870	1	NR	1000	0	NR
485	257	NR	615	783	NR	745	21	NR	875	1	NR			

REPORT NUMBER: SP3-2511-595-3

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.36


λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	296	NR	620	736	NR	750	18	NR	880	0	NR
365	0	NR	495	355	NR	625	683	NR	755	15	NR	885	0	NR
370	0	NR	500	415	NR	630	628	NR	760	13	NR	890	0	NR
375	0	NR	505	468	NR	635	571	NR	765	11	NR	895	0	NR
380	0	NR	510	511	NR	640	515	NR	770	9	NR	900	0	NR
385	0	NR	515	545	NR	645	460	NR	775	8	NR	905	0	NR
390	1	NR	520	570	NR	650	408	NR	780	7	NR	910	0	NR
395	3	NR	525	590	NR	655	359	NR	785	6	NR	915	0	NR
400	5	NR	530	606	NR	660	313	NR	790	5	NR	920	0	NR
405	7	NR	535	623	NR	665	273	NR	795	4	NR	925	0	NR
410	12	NR	540	641	NR	670	236	NR	800	4	NR	930	0	NR
415	22	NR	545	664	NR	675	204	NR	805	3	NR	935	0	NR
420	40	NR	550	690	NR	680	175	NR	810	3	NR	940	0	NR
425	73	NR	555	715	NR	685	151	NR	815	2	NR	945	0	NR
430	133	NR	560	747	NR	690	128	NR	820	2	NR	950	0	NR
435	236	NR	565	781	NR	695	109	NR	825	2	NR	955	0	NR
440	416	NR	570	809	NR	700	93	NR	830	1	NR	960	0	NR
445	757	NR	575	840	NR	705	78	NR	835	1	NR	965	0	NR
450	1000	NR	580	863	NR	710	67	NR	840	1	NR	970	0	NR
455	730	NR	585	880	NR	715	57	NR	845	1	NR	975	0	NR
460	494	NR	590	890	NR	720	48	NR	850	1	NR	980	0	NR
465	419	NR	595	890	NR	725	41	NR	855	1	NR	985	0	NR
470	305	NR	600	879	NR	730	35	NR	860	1	NR	990	0	NR
475	235	NR	605	856	NR	735	29	NR	865	1	NR	995	0	NR
480	237	NR	610	824	NR	740	25	NR	870	1	NR	1000	0	NR
485	257	NR	615	783	NR	745	21	NR	875	1	NR			

REPORT NUMBER: SP3-2511-595-3



TM-30-18

Summary

$R_f = 82.9$
 $R_g = 94.7$
 $CIE R_a = 80.8$
 $R_g = -5.1$

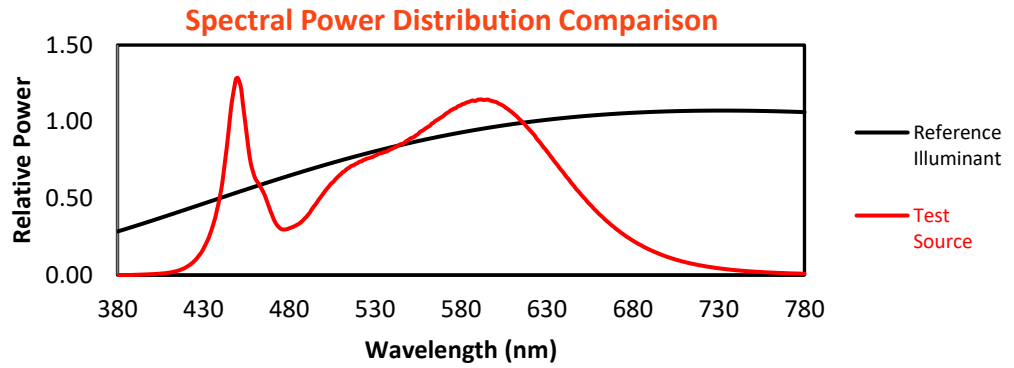


Color Vector Graphics

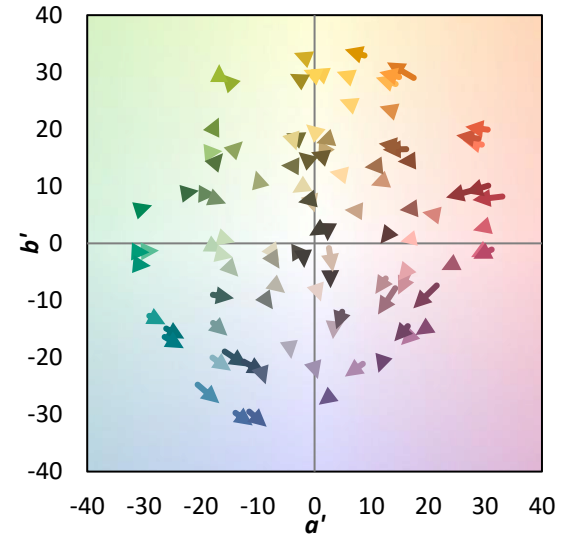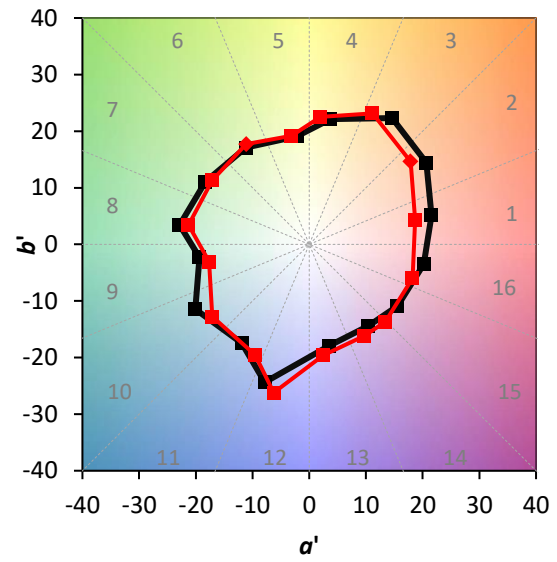

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 80	CES51 = 94	CES76 = 73
CES02 = 61	CES27 = 93	CES52 = 94	CES77 = 82
CES03 = 31	CES28 = 91	CES53 = 88	CES78 = 72
CES04 = 70	CES29 = 85	CES54 = 89	CES79 = 91
CES05 = 48	CES30 = 96	CES55 = 88	CES80 = 89
CES06 = 50	CES31 = 87	CES56 = 84	CES81 = 79
CES07 = 40	CES32 = 80	CES57 = 83	CES82 = 95
CES08 = 39	CES33 = 92	CES58 = 84	CES83 = 95
CES09 = 29	CES34 = 86	CES59 = 90	CES84 = 90
CES10 = 74	CES35 = 92	CES60 = 90	CES85 = 78
CES11 = 57	CES36 = 83	CES61 = 86	CES86 = 72
CES12 = 63	CES37 = 91	CES62 = 86	CES87 = 83
CES13 = 42	CES38 = 93	CES63 = 85	CES88 = 87
CES14 = 74	CES39 = 98	CES64 = 78	CES89 = 76
CES15 = 71	CES40 = 95	CES65 = 75	CES90 = 87
CES16 = 47	CES41 = 99	CES66 = 74	CES91 = 71
CES17 = 49	CES42 = 93	CES67 = 73	CES92 = 62
CES18 = 56	CES43 = 89	CES68 = 77	CES93 = 77
CES19 = 71	CES44 = 99	CES69 = 82	CES94 = 60
CES20 = 65	CES45 = 93	CES70 = 73	CES95 = 70
CES21 = 86	CES46 = 90	CES71 = 67	CES96 = 82
CES22 = 78	CES47 = 96	CES72 = 89	CES97 = 90
CES23 = 91	CES48 = 84	CES73 = 66	CES98 = 84
CES24 = 90	CES49 = 89	CES74 = 93	CES99 = 73
CES25 = 71	CES50 = 94	CES75 = 70	

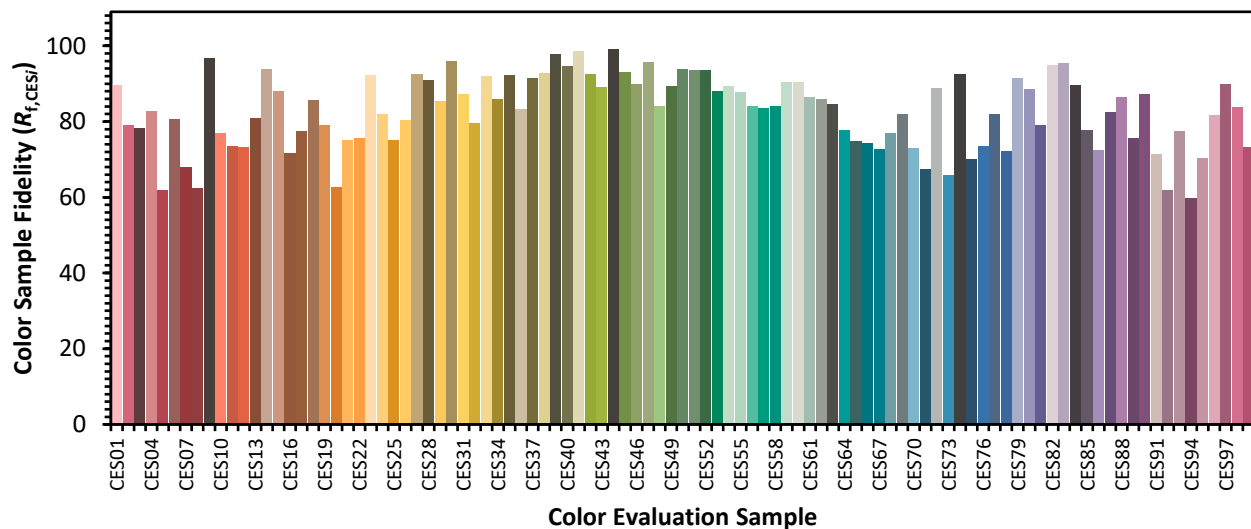

Color Rendition by Hue-Angle Bin



Measure Comparisons

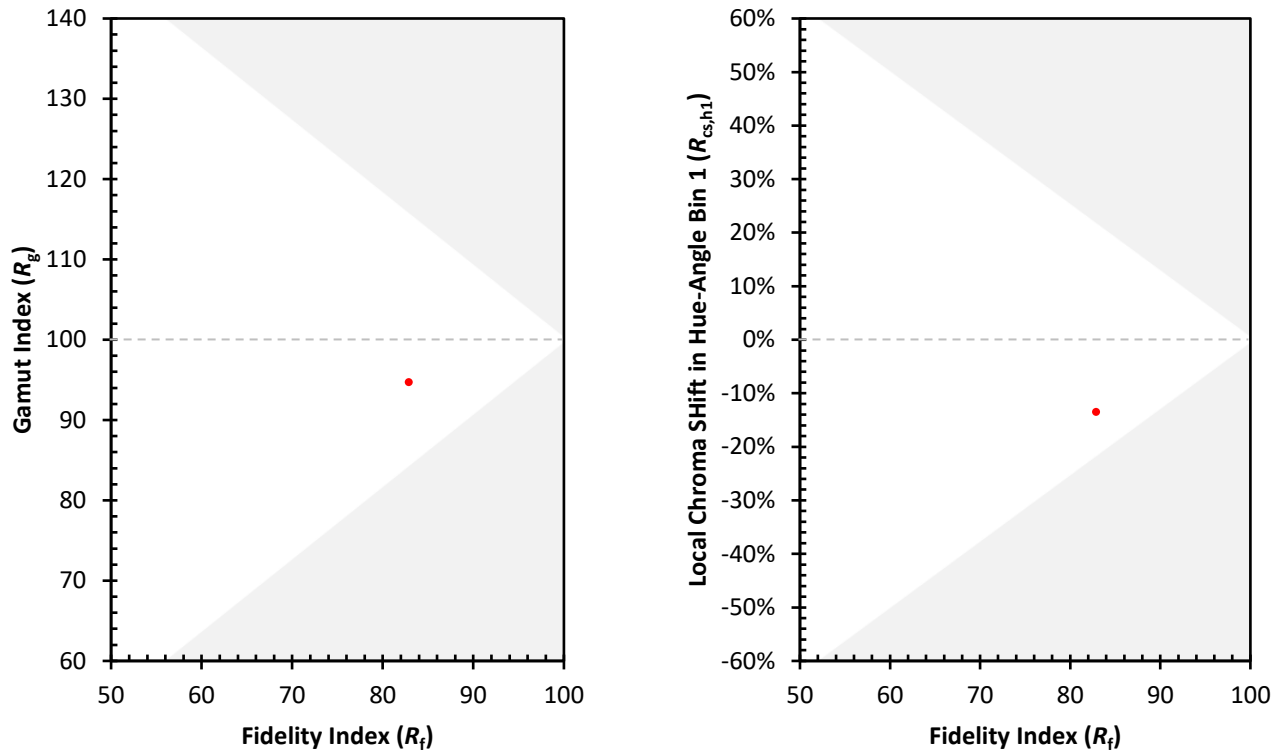

(END OF REPORT)