

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1004829

Luminaire Tested: S125R3DR-B1090DB2750-4F0-XX-W2A-F_4000K

Issue Date: 5/2/2025

Test Information

Test Method: LM-79-2019
Report Number: P1004829
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1802-639-27)
Test Lab: INNOVATION CENTER
Issue Date: 5/2/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S125R3DR-B1090DB2750-4F0-XX-W2A-F_4000K
Description: Define 5 3in Regressed Direct Recessed with 4000K BioUP LEDs {m-DER=0.865} {m-EER=0.951
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4860.0 lumens
Efficiency: N/A
Efficacy: 79.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.11 / 1.25
Luminous Opening: Rectangular (W 0.42' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 61.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1004829

CATALOG NUMBER: S125R3DR-B1090DB2750-4F0-XX-W2A-F_4000K

Luminous Intensity Polar Plot

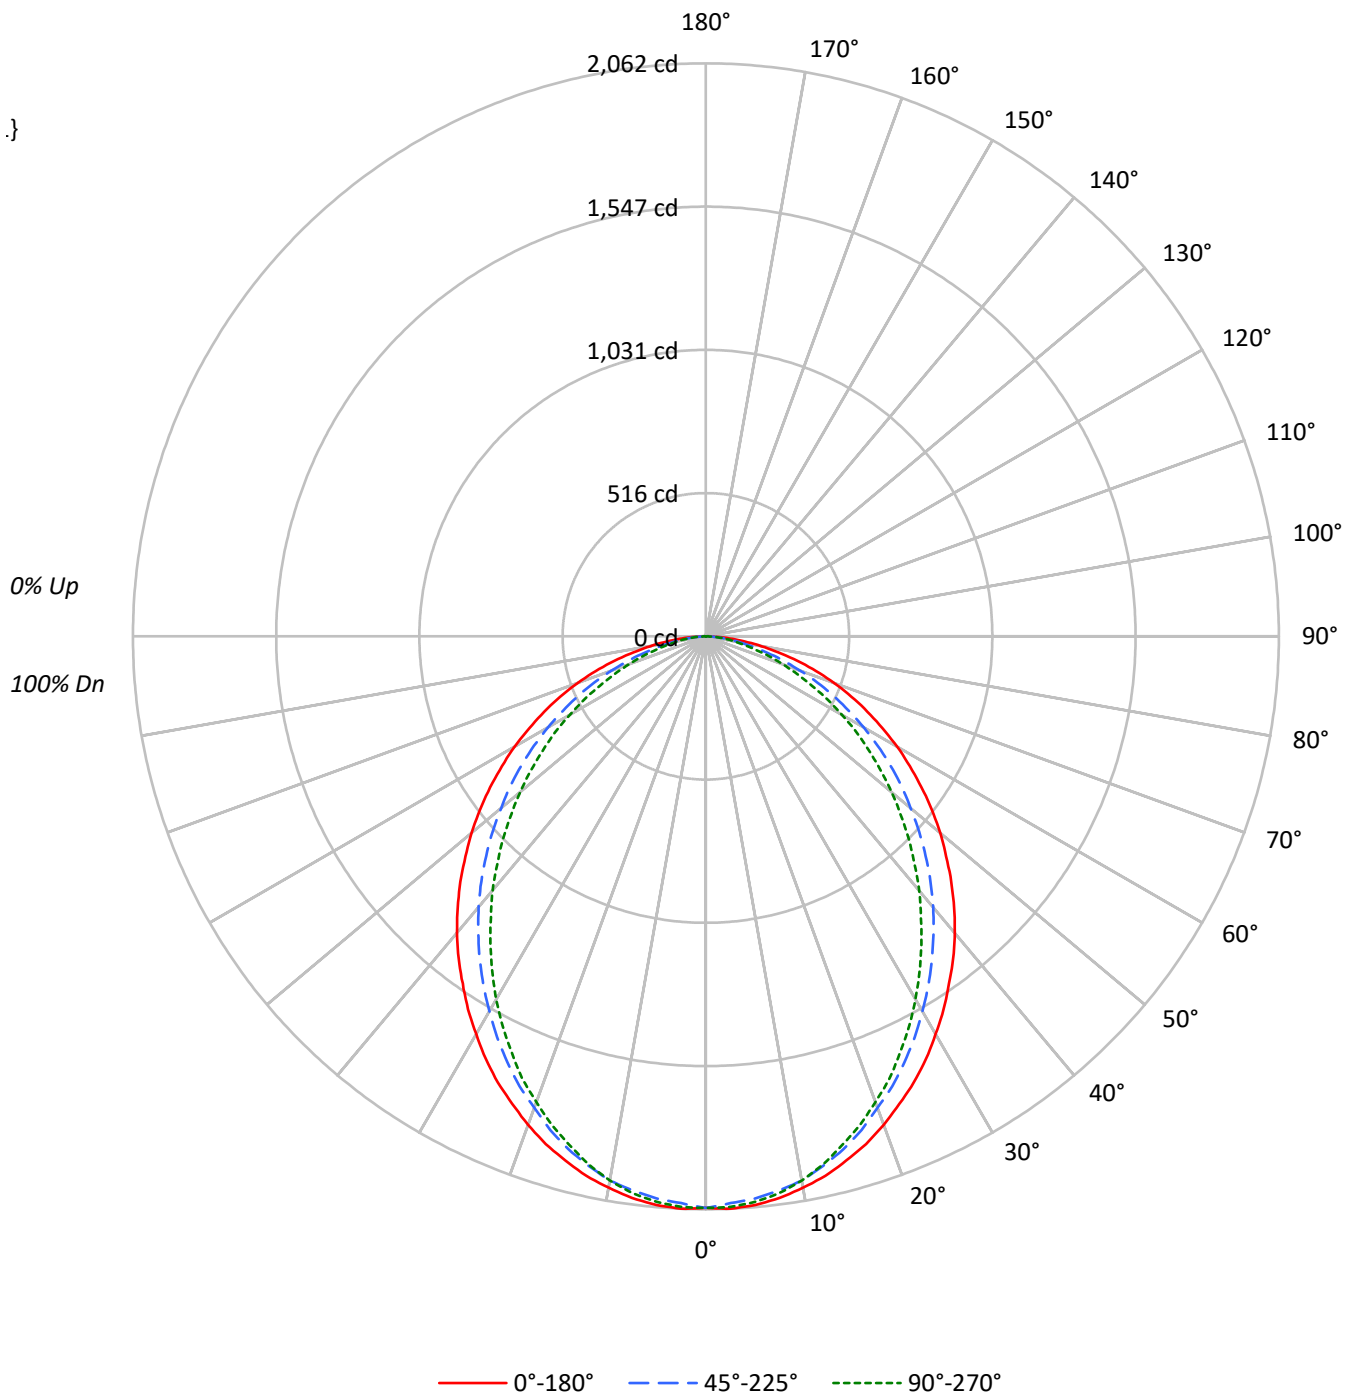

TEST NUMBER: P1004829

CATALOG NUMBER: S125R3DR-B1090DB2750-4F0-XX-W2A-F_4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10		0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102		100
1	109	105	101	97	107	103	99	96	99	96	93		95	92	90		91	89	87		85
2	100	92	86	80	98	90	84	79	87	82	78		84	79	76		81	77	74		72
3	92	82	74	68	89	80	73	67	77	71	66		74	69	65		72	67	64		61
4	84	73	64	58	82	71	64	57	69	62	57		67	61	56		64	59	55		53
5	78	65	57	50	76	64	56	50	62	55	49		60	54	49		58	53	48		46
6	72	59	50	44	70	58	50	44	56	49	44		55	48	43		53	47	43		41
7	67	54	45	39	65	53	45	39	51	44	39		50	43	39		49	43	38		36
8	62	49	41	35	61	48	41	35	47	40	35		46	39	35		45	39	34		33
9	58	45	37	32	57	45	37	32	44	37	32		42	36	31		41	36	31		29
10	55	42	34	29	54	41	34	29	40	34	29		39	33	29		39	33	29		27

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	13179	13179	13179
5°	13210	13060	13140
10°	13110	12938	12938
15°	12954	12676	12572
20°	12754	12309	12161
25°	12521	11950	11686
30°	12230	11529	11161
35°	11933	11095	10572
40°	11656	10642	9992
45°	11318	10136	9362
50°	10979	9586	8703
55°	10586	9059	8000
60°	10194	8421	7246
65°	9728	7679	6383
70°	9196	6751	5500
75°	8461	5691	4577
80°	7453	4472	3841
85°	6285	3654	3426

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 11318 cd/sqm

TEST NUMBER: P1004829

CATALOG NUMBER: S125R3DR-B1090DB2750-4F0-XX-W2A-F_4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	193.6	4.0
10°-20°	541.0	11.1
20°-30°	784.5	16.1
30°-40°	893.8	18.4
40°-50°	871.1	17.9
50°-60°	733.1	15.1
60°-70°	513.8	10.6
70°-80°	263.4	5.4
80°-90°	65.7	1.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1519.1	31.3
0°-40°	2412.9	49.6
0°-60°	4017.2	82.7
0°-90°	4860.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4860.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2057	2057	2057	2057	2057	
5°	2054	2048	2031	2046	2043	195
15°	1953	1944	1911	1909	1895	551
25°	1771	1748	1690	1670	1653	815
35°	1526	1488	1418	1373	1352	955
45°	1249	1204	1119	1056	1033	963
55°	948	898	811	741	716	847
65°	642	589	506	444	421	635
75°	342	295	230	196	185	361
85°	86	58	50	48	47	98
90°	0	0	0	0	0	



TEST NUMBER: P1004829

CATALOG NUMBER: S125R3DR-B1090DB2750-4F0-XX-W2A-F_4000K

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2057.0	2057.0	2057.0	2057.0	2057.0
2.5°	2061.7	2057.0	2041.5	2057.0	2055.5
5°	2053.9	2047.7	2030.6	2046.1	2043.0
7.5°	2038.4	2032.2	2012.0	2024.4	2021.3
10°	2015.1	2010.4	1988.7	1993.3	1988.7
12.5°	1988.7	1982.4	1951.4	1954.5	1946.7
15°	1952.9	1943.6	1911.0	1909.4	1895.4
17.5°	1915.6	1901.7	1862.8	1855.0	1844.2
20°	1870.6	1855.0	1805.3	1797.6	1783.6
22.5°	1820.9	1805.3	1752.5	1735.4	1724.5
25°	1771.1	1747.8	1690.4	1670.2	1653.1
27.5°	1715.2	1687.3	1626.7	1600.2	1583.2
30°	1653.1	1623.6	1558.3	1522.6	1508.6
32.5°	1592.5	1556.7	1489.9	1449.5	1430.9
35°	1525.7	1488.4	1418.5	1373.4	1351.7
37.5°	1462.0	1416.9	1345.5	1292.6	1270.9
40°	1393.6	1347.0	1272.4	1213.4	1194.7
42.5°	1322.1	1274.0	1196.3	1140.4	1110.9
45°	1249.1	1204.1	1118.6	1056.5	1033.2
47.5°	1173.0	1126.4	1040.9	977.2	950.8
50°	1101.5	1050.3	961.7	896.4	873.1
52.5°	1023.8	971.0	888.7	817.2	793.9
55°	947.7	898.0	811.0	741.1	716.2
57.5°	870.0	817.2	733.3	665.0	643.2
60°	795.5	741.1	657.2	588.8	565.5
62.5°	716.2	665.0	579.5	517.4	494.1
65°	641.7	588.8	506.5	444.3	421.0
67.5°	567.1	514.3	435.0	376.0	357.3
70°	490.9	438.1	360.4	312.3	293.6
72.5°	416.4	365.1	293.6	250.1	239.3
75°	341.8	295.2	229.9	195.8	184.9
77.5°	265.7	228.4	174.0	147.6	138.3
80°	202.0	164.7	121.2	107.2	104.1
82.5°	139.8	107.2	80.8	76.1	74.6
85°	85.5	57.5	49.7	48.2	46.6
87.5°	35.7	24.9	23.3	23.3	21.8
90°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)