

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1004575

Luminaire Tested: S125DR-B1270DB40-4F0-XX-W2A-F

Issue Date: 5/2/2025

Test Information

Test Method: LM-79-2019
Report Number: P1004575
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1802-639-12)
Test Lab: INNOVATION CENTER
Issue Date: 5/2/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S125DR-B1270DB40-4F0-XX-W2A-F
Description: Define 5 Direct Recessed with 4000K BioUP LEDs {m-DER=0.865} {m-EER=0.951}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5111.0 lumens
Efficiency: N/A
Efficacy: 83.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.18 / 1.3
Luminous Opening: Rectangular (W 0.42' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 61.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1004575

CATALOG NUMBER: S125DR-B1270DB40-4F0-XX-W2A-F

Luminous Intensity Polar Plot

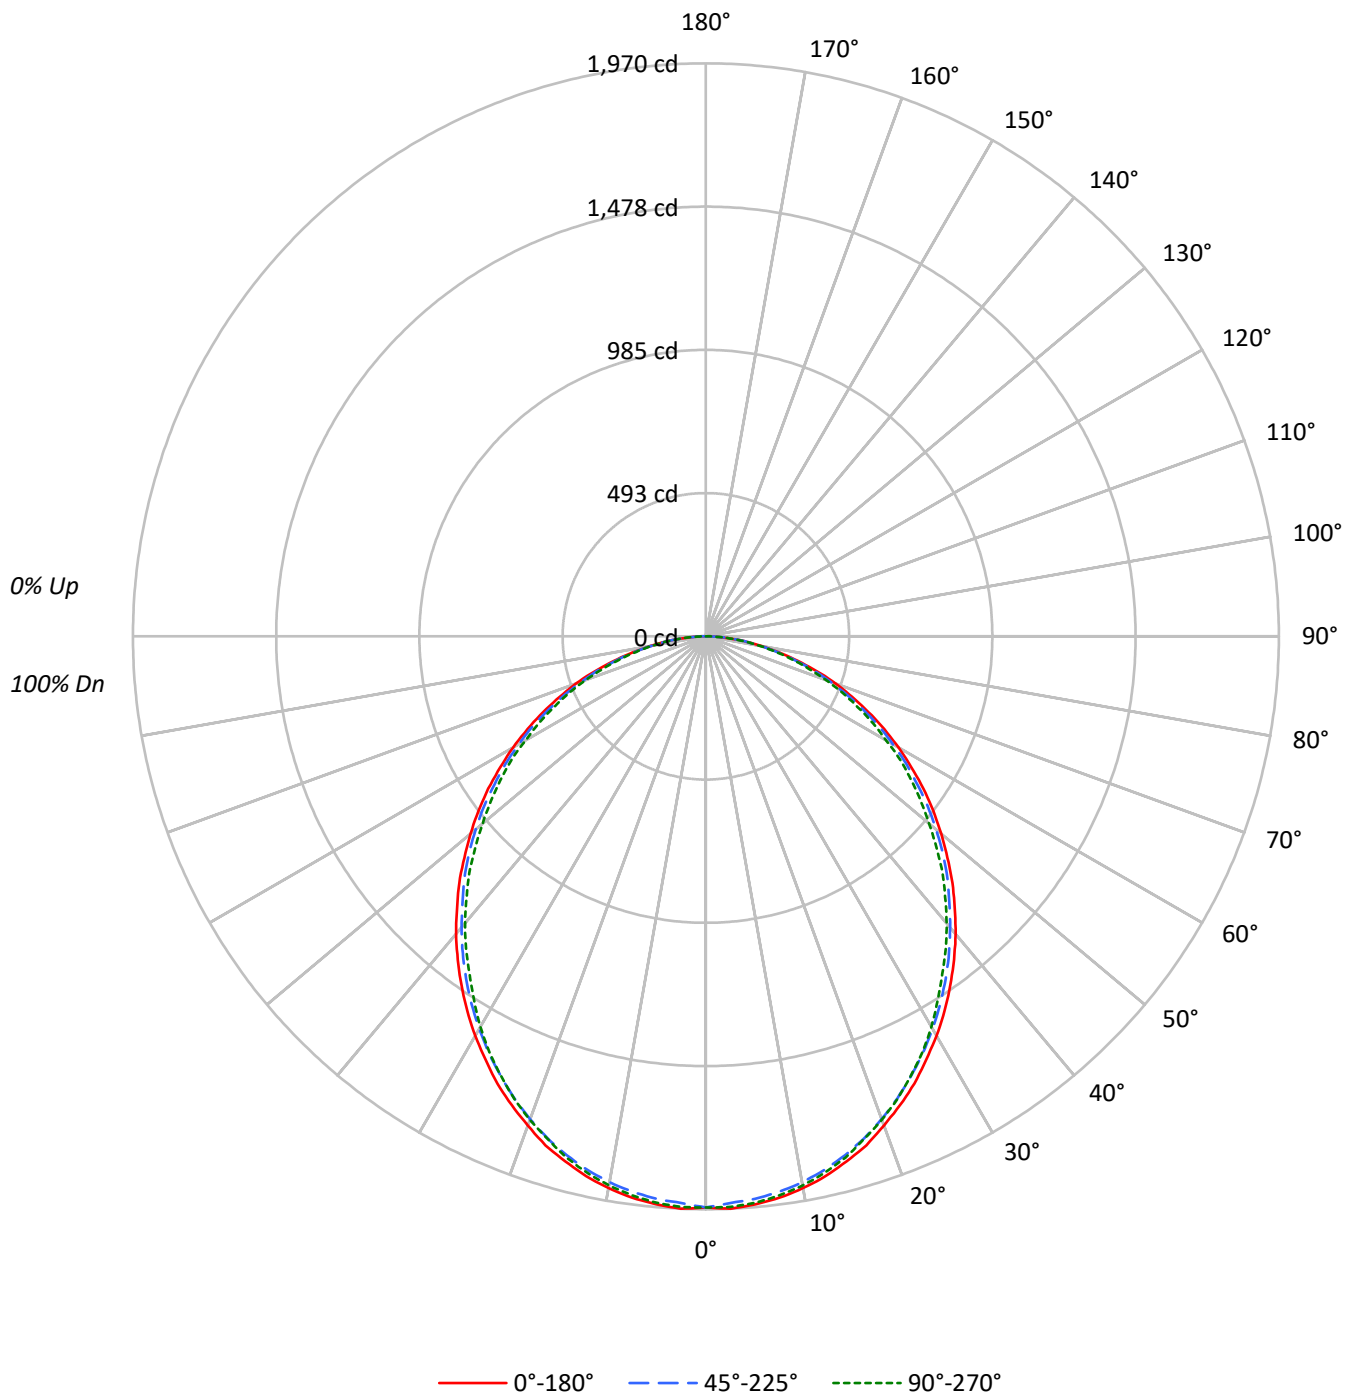

TEST NUMBER: P1004575

CATALOG NUMBER: S125DR-B1270DB40-4F0-XX-W2A-F

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	109	104	100	96	106	102	98	95	98	94	92		94	91	89		90
2	99	91	84	79	97	89	83	78	86	80	76		82	78	74		79
3	91	80	72	66	88	79	71	65	76	69	64		73	67	63		70
4	83	71	62	56	81	70	62	55	67	60	55		65	59	54		63
5	76	64	55	48	74	63	54	48	60	53	47		58	52	47		57
6	71	57	49	42	69	56	48	42	55	47	42		53	46	41		51
7	66	52	43	37	64	51	43	37	50	42	37		48	42	37		47
8	61	48	39	33	60	47	39	33	46	38	33		44	38	33		43
9	57	44	36	30	56	43	35	30	42	35	30		41	34	30		40
10	54	40	33	27	52	40	32	27	39	32	27		38	32	27		37

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	12582	12582	12582
5°	12610	12489	12570
10°	12533	12402	12473
15°	12397	12253	12304
20°	12203	12044	12065
25°	11993	11795	11785
30°	11735	11528	11470
35°	11459	11240	11082
40°	11175	10927	10772
45°	10867	10642	10431
50°	10530	10298	9988
55°	10204	9909	9631
60°	9814	9516	9178
65°	9351	9045	8738
70°	8906	8497	8207
75°	8115	7845	7575
80°	7221	7106	6937
85°	6278	6396	6050

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 10867 cd/sqm

TEST NUMBER: P1004575

CATALOG NUMBER: S125DR-B1270DB40-4F0-XX-W2A-F

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	185.3	3.6
10°-20°	523.4	10.2
20°-30°	772.7	15.1
30°-40°	901.5	17.6
40°-50°	905.5	17.7
50°-60°	794.8	15.6
60°-70°	592.0	11.6
70°-80°	338.1	6.6
80°-90°	97.6	1.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1481.4	29.0
0°-40°	2383.0	46.6
0°-60°	4083.2	79.9
0°-90°	5111.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5111.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1964	1964	1964	1964	1964	
5°	1961	1958	1942	1956	1954	186
15°	1869	1864	1847	1855	1855	527
25°	1696	1689	1668	1672	1667	781
35°	1465	1459	1437	1429	1417	916
45°	1199	1193	1174	1156	1151	924
55°	914	909	887	873	862	815
65°	617	614	597	583	576	612
75°	328	325	317	312	306	349
85°	85	87	87	85	82	99
90°	0	0	0	0	0	

TEST NUMBER: P1004575

CATALOG NUMBER: S125DR-B1270DB40-4F0-XX-W2A-F

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1963.7	1963.7	1963.7	1963.7	1963.7
2.5°	1969.9	1965.2	1949.7	1965.2	1963.7
5°	1960.6	1957.5	1941.9	1955.9	1954.4
7.5°	1946.6	1943.5	1926.4	1940.4	1938.8
10°	1926.4	1923.3	1906.2	1918.6	1917.1
12.5°	1901.5	1895.3	1879.8	1889.1	1889.1
15°	1868.9	1864.3	1847.2	1854.9	1854.9
17.5°	1834.7	1827.0	1809.9	1819.2	1811.4
20°	1789.7	1786.6	1766.4	1777.3	1769.5
22.5°	1744.6	1738.4	1719.8	1726.0	1721.3
25°	1696.5	1688.7	1668.5	1671.6	1667.0
27.5°	1640.6	1635.9	1615.7	1617.2	1612.6
30°	1586.2	1581.5	1558.2	1555.1	1550.4
32.5°	1527.1	1519.4	1499.2	1493.0	1483.6
35°	1465.0	1458.8	1437.0	1429.3	1416.8
37.5°	1401.3	1393.5	1373.3	1362.5	1354.7
40°	1336.1	1328.3	1306.5	1292.6	1287.9
42.5°	1266.1	1259.9	1238.2	1225.8	1218.0
45°	1199.3	1193.1	1174.5	1155.8	1151.2
47.5°	1126.3	1127.9	1104.6	1085.9	1075.1
50°	1056.4	1051.8	1033.1	1012.9	1002.0
52.5°	985.0	981.8	961.6	944.6	932.1
55°	913.5	908.8	887.1	873.1	862.2
57.5°	837.4	835.8	817.2	798.5	793.9
60°	765.9	759.7	742.6	727.1	716.2
62.5°	691.3	686.7	672.7	655.6	647.8
65°	616.8	613.7	596.6	582.6	576.4
67.5°	543.7	537.5	525.1	512.7	509.6
70°	475.4	467.6	453.6	444.3	438.1
72.5°	400.8	396.2	388.4	377.5	371.3
75°	327.8	324.7	316.9	312.3	306.0
77.5°	259.4	257.9	253.2	250.1	245.5
80°	195.7	195.7	192.6	191.1	188.0
82.5°	139.8	136.7	136.7	133.6	133.6
85°	85.4	87.0	87.0	85.4	82.3
87.5°	41.9	41.9	40.4	40.4	37.3
90°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)