

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1037409

Luminaire Tested: S123R3DS-B1165DB2750-4F0-XX-W2A-F_4000K

Issue Date: 5/2/2025

Test Information

Test Method: LM-79-2019
Report Number: P1037409
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1802-639-25)
Test Lab: INNOVATION CENTER
Issue Date: 5/2/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S123R3DS-B1165DB2750-4F0-XX-W2A-F_4000K
Description: Define 3 3in Regressed Direct Surface with 4000K BioUP LEDs {m-DER=0.865} {m-EER=0.951}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4363.0 lumens
Efficiency: N/A
Efficacy: 71.2 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.07 / 1.22
Luminous Opening: Rectangular (W 0.25' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 61.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1037409

CATALOG NUMBER: S123R3DS-B1165DB2750-4F0-XX-W2A-F_4000K

Luminous Intensity Polar Plot

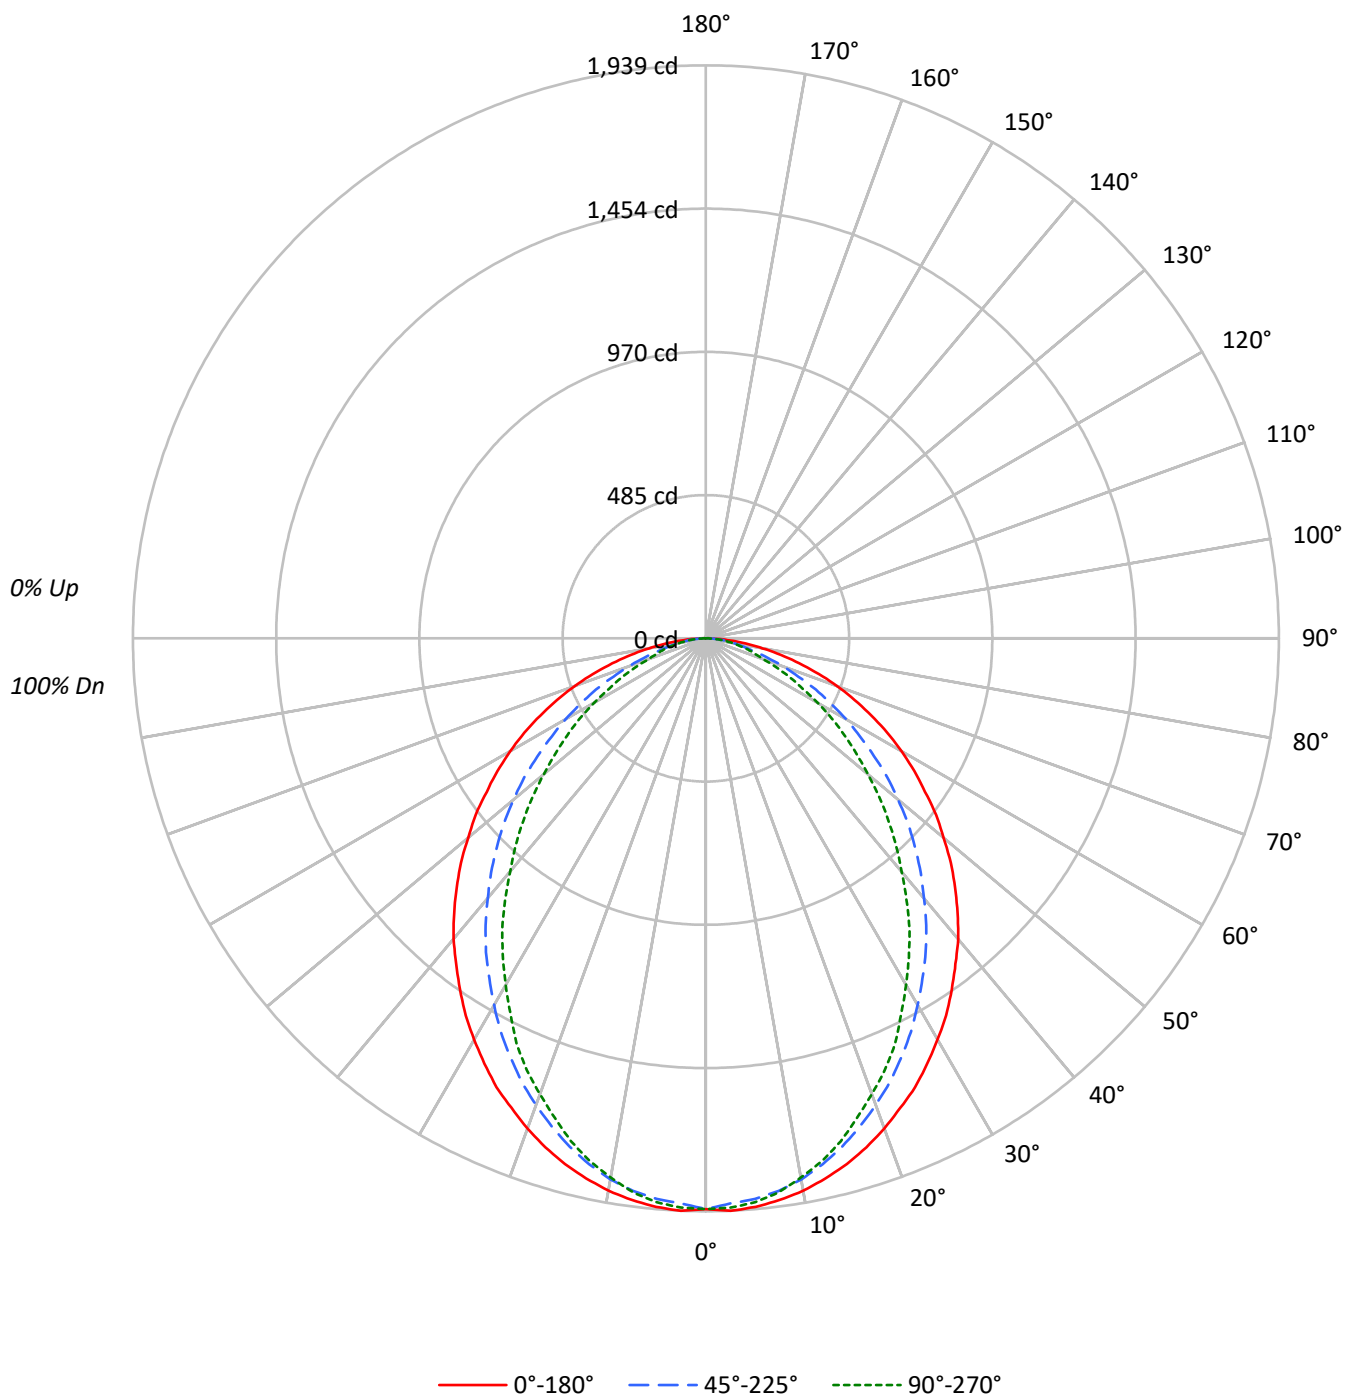

TEST NUMBER: P1037409

CATALOG NUMBER: S123R3DS-B1165DB2750-4F0-XX-W2A-F_4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	102	102	100
1	110	105	101	98	107	103	99	96	99	96	93	95	93	90	91	89	88	88	88	86
2	100	93	86	81	98	91	85	80	87	83	78	84	80	77	81	78	75	75	75	73
3	92	82	75	68	90	81	74	68	78	72	67	75	70	66	73	68	64	64	64	62
4	85	73	65	59	83	72	64	58	70	63	58	67	62	57	65	60	56	56	56	54
5	78	66	57	51	76	65	57	51	63	56	50	61	55	50	59	54	49	49	49	47
6	73	60	51	45	71	59	51	45	57	50	45	55	49	44	54	48	44	44	44	42
7	67	54	46	40	66	54	46	40	52	45	40	51	44	39	49	44	39	39	39	37
8	63	50	42	36	61	49	41	36	48	41	36	47	40	36	46	40	35	35	35	34
9	59	46	38	33	58	45	38	33	44	37	32	43	37	32	42	36	32	32	32	30
10	55	43	35	30	54	42	35	30	41	34	30	40	34	29	39	34	29	29	29	28

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	20787	20787	20787
5°	20867	20579	20698
10°	20748	20321	20252
15°	20527	19846	19636
20°	20220	19251	18803
25°	19904	18583	17988
30°	19488	17813	16839
35°	19059	17042	15785
40°	18663	16132	14481
45°	18144	15236	13304
50°	17573	14215	11987
55°	16989	13050	10759
60°	16454	11802	9408
65°	15758	10453	8059
70°	14886	8774	6508
75°	13616	6904	6122
80°	12137	6118	5628
85°	10251	5422	5027

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 18144 cd/sqm

TEST NUMBER: P1037409

CATALOG NUMBER: S123R3DS-B1165DB2750-4F0-XX-W2A-F_4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	181.5	4.2
10°-20°	505.0	11.6
20°-30°	727.2	16.7
30°-40°	818.9	18.8
40°-50°	783.3	18.0
50°-60°	641.2	14.7
60°-70°	432.3	9.9
70°-80°	216.8	5.0
80°-90°	56.7	1.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1413.8	32.4
0°-40°	2232.6	51.2
0°-60°	3657.2	83.8
0°-90°	4363.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4363.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1931	1931	1931	1931	1931	
5°	1931	1923	1905	1919	1916	183
15°	1842	1825	1781	1773	1762	519
25°	1676	1637	1565	1532	1515	771
35°	1450	1394	1297	1230	1201	908
45°	1192	1122	1001	912	874	920
55°	905	829	695	605	573	812
65°	619	532	410	334	316	612
75°	327	252	166	150	147	349
85°	83	49	44	41	41	96
90°	0	0	0	0	0	

TEST NUMBER: P1037409

CATALOG NUMBER: S123R3DS-B1165DB2750-4F0-XX-W2A-F_4000K

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1931.2	1931.2	1931.2	1931.2	1931.2
2.5°	1939.1	1932.8	1914.0	1931.2	1928.1
5°	1931.2	1923.4	1904.6	1918.7	1915.6
7.5°	1917.1	1909.3	1885.8	1895.2	1890.5
10°	1898.3	1887.4	1859.2	1860.8	1852.9
12.5°	1871.7	1859.2	1823.2	1821.6	1812.2
15°	1842.0	1824.7	1780.9	1773.0	1762.1
17.5°	1805.9	1787.1	1732.3	1716.7	1701.0
20°	1765.2	1740.1	1680.6	1660.3	1641.5
22.5°	1719.8	1690.0	1625.8	1599.2	1582.0
25°	1675.9	1636.8	1564.7	1531.8	1514.6
27.5°	1622.7	1580.4	1502.1	1458.2	1431.6
30°	1567.9	1520.9	1433.2	1379.9	1354.8
32.5°	1513.0	1458.2	1364.2	1304.7	1278.1
35°	1450.4	1394.0	1296.9	1229.5	1201.3
37.5°	1387.7	1326.6	1224.8	1149.7	1115.2
40°	1328.2	1259.3	1148.1	1066.6	1030.6
42.5°	1260.9	1191.9	1076.0	985.2	953.9
45°	1191.9	1121.5	1000.9	911.6	874.0
47.5°	1124.6	1046.3	927.2	830.1	797.2
50°	1049.4	975.8	848.9	751.8	715.8
52.5°	982.1	900.6	775.3	673.5	642.2
55°	905.3	828.6	695.4	604.6	573.3
57.5°	836.4	753.4	618.7	532.5	505.9
60°	764.3	678.2	548.2	463.6	437.0
62.5°	692.3	606.2	476.2	397.8	369.6
65°	618.7	532.5	410.4	333.6	316.4
67.5°	545.1	457.4	338.3	280.4	261.6
70°	473.0	388.4	278.8	224.0	206.8
72.5°	401.0	318.0	220.8	178.6	173.9
75°	327.4	252.2	166.0	150.4	147.2
77.5°	260.0	191.1	130.0	120.6	117.5
80°	195.8	131.6	98.7	94.0	90.8
82.5°	134.7	81.4	70.5	65.8	65.8
85°	83.0	48.6	43.9	40.7	40.7
87.5°	37.6	20.4	20.4	18.8	17.2
90°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)