

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1037623

Luminaire Tested: S124DS-B1195DB2750-4F0-XX-W2A-F_3000K

Issue Date: 5/2/2025

Test Information

Test Method: LM-79-2019
Report Number: P1037623
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1802-639-5)
Test Lab: INNOVATION CENTER
Issue Date: 5/2/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S124DS-B1195DB2750-4F0-XX-W2A-F_3000K
Description: Define 4 Direct Surface with 3000K BioUP LEDs {m-DER=0.589} {m-EER=0.647}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5126.0 lumens
Efficiency: N/A
Efficacy: 83.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.17 / 1.29
Luminous Opening: Rectangular (W 0.33' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 61.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1037623

CATALOG NUMBER: S124DS-B1195DB2750-4F0-XX-W2A-F_3000K

Luminous Intensity Polar Plot

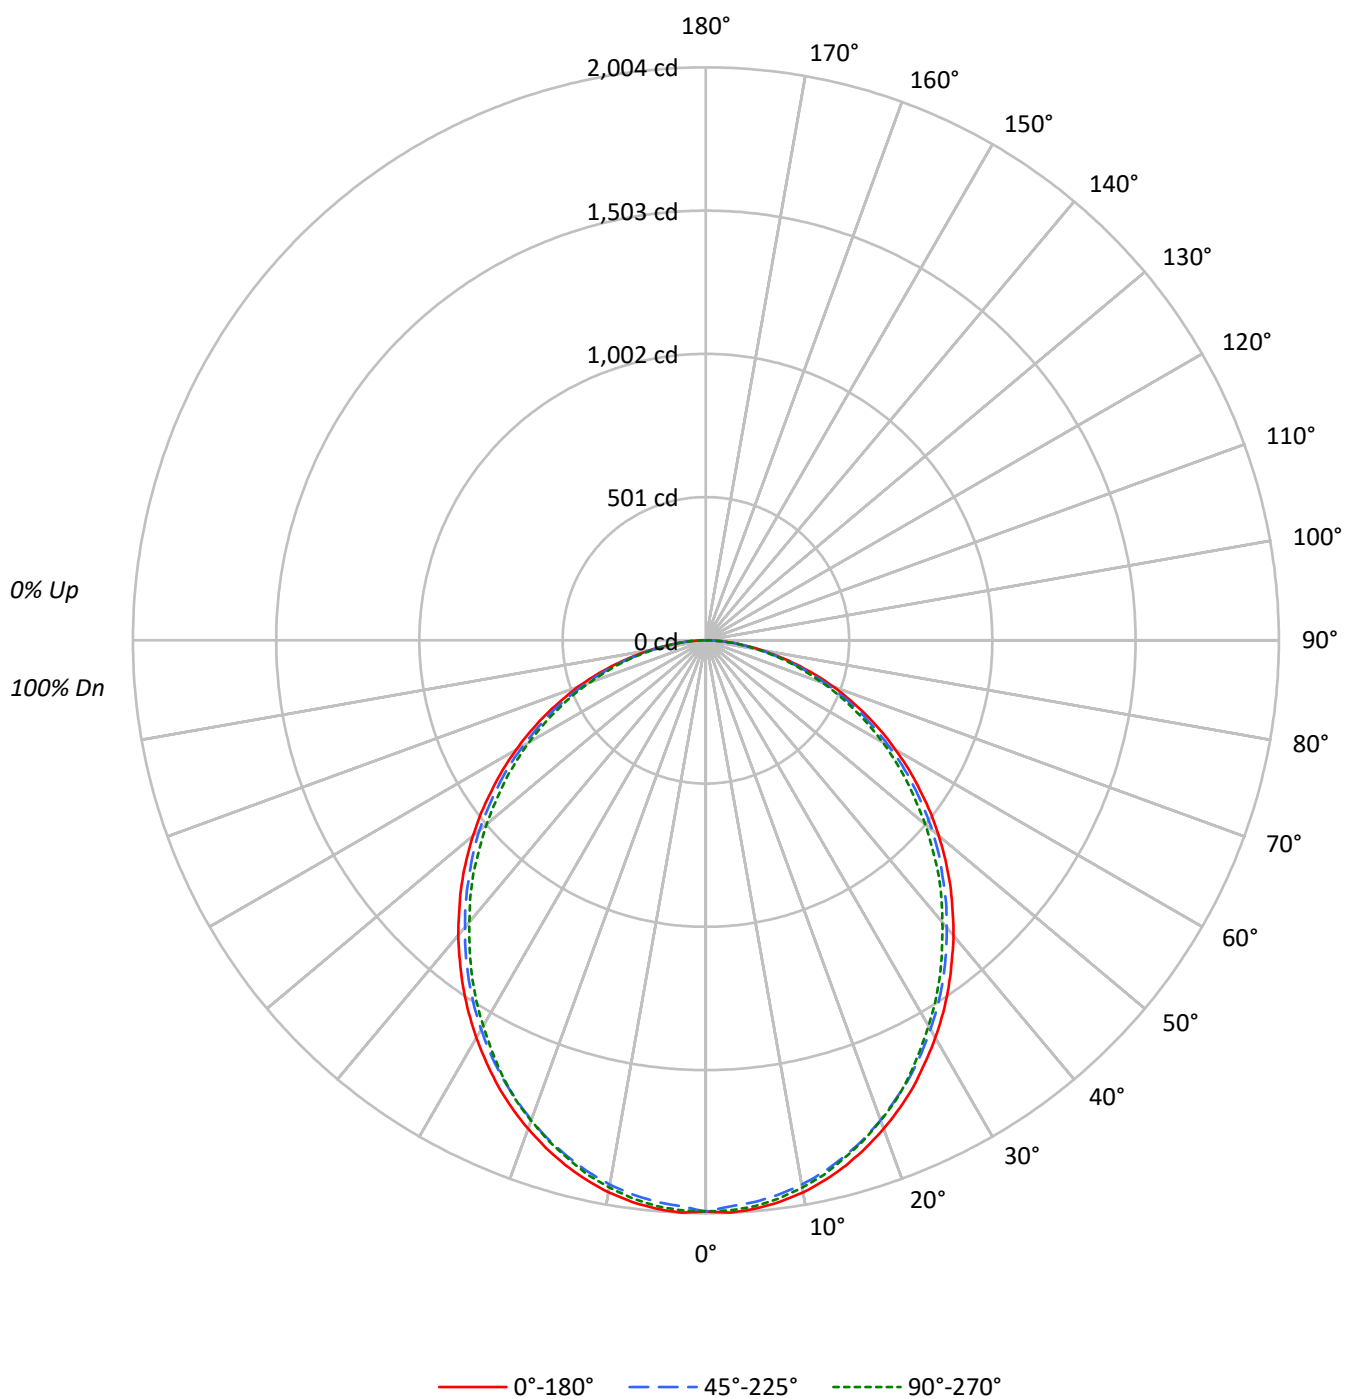

TEST NUMBER: P1037623

CATALOG NUMBER: S124DS-B1195DB2750-4F0-XX-W2A-F_3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	109	104	100	96	106	102	98	95	98	95	92	94	91	89	90	88	86	84		
2	99	91	84	79	97	89	83	78	86	80	76	82	78	74	79	76	73	70		
3	91	80	72	66	88	79	71	65	76	69	64	73	67	63	70	66	62	60		
4	83	71	63	56	81	70	62	56	67	60	55	65	59	54	63	58	53	51		
5	77	64	55	48	74	63	54	48	61	53	48	59	52	47	57	51	47	44		
6	71	58	49	42	69	57	48	42	55	47	42	53	47	41	52	46	41	39		
7	66	52	44	38	64	52	43	37	50	43	37	49	42	37	47	41	37	35		
8	61	48	39	34	60	47	39	34	46	39	33	45	38	33	43	37	33	31		
9	57	44	36	30	56	43	36	30	42	35	30	41	35	30	40	34	30	28		
10	54	41	33	28	52	40	33	28	39	32	27	38	32	27	37	31	27	25		

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	16285	16285	16285
5°	16334	16138	16256
10°	16232	16007	16086
15°	16036	15779	15820
20°	15775	15498	15512
25°	15478	15176	15133
30°	15114	14797	14662
35°	14735	14401	14209
40°	14343	13951	13696
45°	13933	13509	13250
50°	13480	13115	12709
55°	12990	12603	12194
60°	12501	12031	11666
65°	11949	11486	11023
70°	11332	10760	10340
75°	10388	9884	9628
80°	9242	8866	8641
85°	8084	7784	7635

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 13933 cd/sqm

TEST NUMBER: P1037623

CATALOG NUMBER: S124DS-B1195DB2750-4F0-XX-W2A-F_3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	188.2	3.7
10°-20°	530.3	10.3
20°-30°	780.5	15.2
30°-40°	907.3	17.7
40°-50°	907.2	17.7
50°-60°	793.4	15.5
60°-70°	589.1	11.5
70°-80°	334.2	6.5
80°-90°	95.7	1.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1499.1	29.2
0°-40°	2406.3	46.9
0°-60°	4107.0	80.1
0°-90°	5126.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5126.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1997	1997	1997	1997	1997	
5°	1996	1989	1972	1989	1986	189
15°	1900	1893	1869	1879	1874	535
25°	1720	1709	1687	1688	1682	792
35°	1480	1469	1447	1435	1427	926
45°	1208	1197	1171	1154	1149	931
55°	914	909	886	867	858	818
65°	619	611	595	579	571	613
75°	330	322	314	307	306	350
85°	86	86	83	83	82	99
90°	0	0	0	0	0	

TEST NUMBER: P1037623

CATALOG NUMBER: S124DS-B1195DB2750-4F0-XX-W2A-F_3000K

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1997.1	1997.1	1997.1	1997.1	1997.1
2.5°	2003.5	1998.7	1981.1	1997.1	1995.5
5°	1995.5	1989.1	1971.5	1989.1	1985.9
7.5°	1981.1	1974.7	1955.5	1969.9	1968.3
10°	1960.3	1953.9	1933.1	1945.9	1942.7
12.5°	1933.1	1926.7	1904.3	1918.7	1913.9
15°	1899.5	1893.1	1869.1	1878.7	1873.9
17.5°	1861.1	1853.1	1830.7	1837.1	1833.9
20°	1817.9	1809.9	1785.9	1790.7	1787.5
22.5°	1771.5	1760.3	1736.3	1745.9	1739.5
25°	1720.3	1709.1	1686.7	1688.3	1681.9
27.5°	1662.7	1651.5	1630.7	1627.5	1619.5
30°	1605.1	1592.3	1571.5	1565.1	1557.1
32.5°	1544.2	1533.0	1510.6	1502.6	1494.6
35°	1480.2	1469.0	1446.6	1435.4	1427.4
37.5°	1413.0	1403.4	1379.4	1368.2	1357.0
40°	1347.4	1334.6	1310.6	1294.6	1286.6
42.5°	1277.0	1270.6	1243.4	1224.2	1219.4
45°	1208.2	1197.0	1171.4	1153.8	1149.0
47.5°	1136.2	1128.2	1104.2	1085.0	1072.2
50°	1062.6	1056.2	1033.8	1011.4	1001.8
52.5°	990.6	982.6	958.6	939.4	926.5
55°	913.7	908.9	886.5	867.3	857.7
57.5°	841.7	836.9	814.5	795.3	785.7
60°	766.5	758.5	737.7	723.3	715.3
62.5°	692.9	686.5	664.1	651.3	643.3
65°	619.3	611.3	595.3	579.3	571.3
67.5°	544.1	537.7	521.7	505.7	504.1
70°	475.3	464.1	451.3	438.5	433.7
72.5°	401.7	390.5	380.9	371.3	366.5
75°	329.7	321.7	313.7	307.2	305.6
77.5°	259.2	256.0	248.0	246.4	241.6
80°	196.8	192.0	188.8	185.6	184.0
82.5°	136.0	134.4	134.4	132.8	131.2
85°	86.4	86.4	83.2	83.2	81.6
87.5°	41.6	40.0	38.4	38.4	38.4
90°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)