

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P930875

Luminaire Tested: DFN2DS-SQ2F0-070DS927-FLL

Issue Date: 11/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P930875
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P333812)
Test Lab: INNOVATION CENTER
Issue Date: 11/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DS-SQ2F0-070DS927-FLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5488.6 lumens
Efficiency: N/A
Efficacy: 76.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular (W 2.21' x L: 2.21' x H: 0')
CIE Type: Direct

Input Watts (W): 71.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P930875

CATALOG NUMBER: DFN2DS-SQ2F0-070DS927-FLL

Luminous Intensity Polar Plot

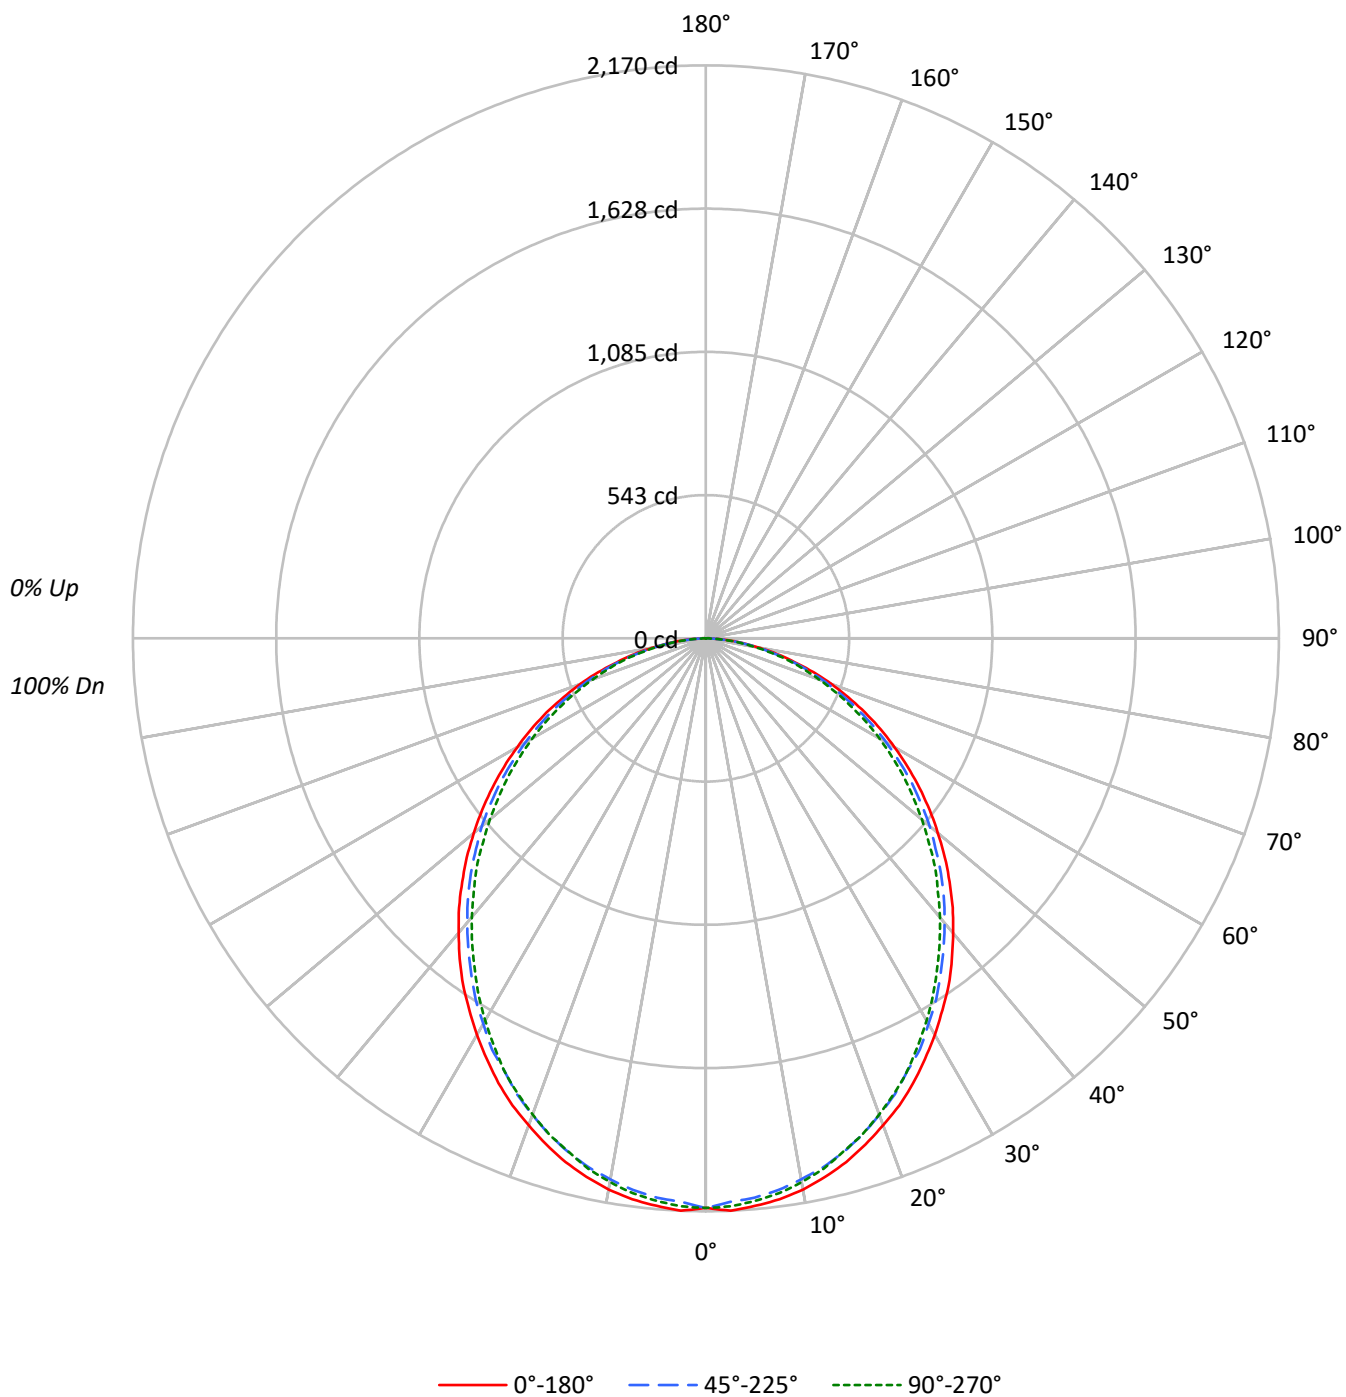

TEST NUMBER: P930875

CATALOG NUMBER: DFN2DS-SQ2F0-070DS927-FLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	109	104	100	96	106	102	98	95	98	95	92		94	91	89		90	88	86	84
2	99	91	85	79	97	89	83	78	86	81	76		83	78	74		80	76	73	71
3	91	80	72	66	88	79	71	65	76	69	64		73	68	63		71	66	62	60
4	83	71	63	56	81	70	62	56	68	61	55		65	59	54		63	58	54	51
5	77	64	55	49	75	63	55	48	61	53	48		59	52	47		57	51	47	45
6	71	58	49	43	69	57	48	42	55	48	42		53	47	42		52	46	41	39
7	66	52	44	38	64	52	43	38	50	43	37		49	42	37		47	41	37	35
8	61	48	40	34	60	47	39	34	46	39	33		45	38	33		44	38	33	31
9	57	44	36	30	56	43	36	30	42	35	30		41	35	30		40	34	30	28
10	54	41	33	28	53	40	33	28	39	32	27		38	32	27		37	32	27	26

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4743	4743	4743
5°	4762	4693	4721
10°	4734	4646	4669
15°	4675	4585	4581
20°	4592	4495	4490
25°	4509	4384	4384
30°	4403	4282	4245
35°	4304	4159	4098
40°	4180	4037	3959
45°	4058	3915	3819
50°	3924	3789	3654
55°	3786	3642	3507
60°	3630	3467	3339
65°	3465	3292	3141
70°	3254	3080	2934
75°	2960	2836	2767
80°	2628	2548	2416
85°	2145	2044	1832

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4058 cd/sqm

TEST NUMBER: P930875

CATALOG NUMBER: DFN2DS-SQ2F0-070DS927-FLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.0	3.7
10°-20°	571.3	10.4
20°-30°	839.5	15.3
30°-40°	975.1	17.8
40°-50°	973.8	17.7
50°-60°	849.2	15.5
60°-70°	627.7	11.4
70°-80°	355.2	6.5
80°-90°	93.8	1.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1613.8	29.4
0°-40°	2588.9	47.2
0°-60°	4411.9	80.4
0°-90°	5488.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5488.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2157	2157	2157	2157	2157	
5°	2157	2149	2126	2143	2139	205
15°	2054	2041	2014	2022	2012	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1001
45°	1305	1290	1259	1236	1228	1007
55°	988	975	950	925	915	883
65°	666	653	633	614	604	658
75°	348	344	334	322	326	372
85°	85	83	81	75	73	100
90°	0	0	0	0	0	

TEST NUMBER: P930875

CATALOG NUMBER: DFN2DS-SQ2F0-070DS927-FLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.2	2157.2	2157.2	2157.2	2157.2
2.5°	2169.8	2159.4	2136.5	2157.2	2153.2
5°	2157.2	2149.1	2126.2	2142.7	2138.7
7.5°	2142.7	2130.3	2107.4	2124.2	2120.0
10°	2120.0	2105.5	2080.6	2097.1	2091.0
12.5°	2088.7	2076.5	2051.6	2061.9	2057.7
15°	2053.6	2041.2	2014.1	2022.5	2012.2
17.5°	2009.9	1997.7	1970.6	1981.0	1970.6
20°	1962.2	1949.9	1920.8	1927.0	1918.9
22.5°	1914.7	1896.0	1868.9	1868.9	1864.7
25°	1858.6	1842.0	1806.9	1810.8	1806.9
27.5°	1796.3	1781.8	1754.9	1748.7	1738.4
30°	1734.2	1717.5	1686.5	1680.3	1671.9
32.5°	1667.7	1655.4	1622.2	1609.7	1601.3
35°	1603.5	1582.8	1549.5	1537.0	1526.7
37.5°	1530.9	1512.2	1478.9	1464.4	1454.0
40°	1456.3	1439.5	1406.3	1387.8	1379.4
42.5°	1383.6	1366.9	1333.9	1313.0	1300.6
45°	1304.8	1290.3	1259.0	1236.4	1228.0
47.5°	1228.0	1213.5	1180.2	1157.3	1145.1
50°	1147.1	1136.7	1107.6	1078.6	1068.2
52.5°	1068.2	1053.8	1026.9	1004.0	989.4
55°	987.5	975.0	950.1	925.2	914.8
57.5°	906.5	896.1	869.1	844.2	835.9
60°	825.5	817.3	788.4	765.5	759.3
62.5°	746.7	732.2	711.5	690.9	682.5
65°	666.0	653.4	632.7	614.0	603.7
67.5°	583.0	572.5	553.9	539.4	531.0
70°	506.2	497.9	479.1	464.6	456.4
72.5°	427.4	419.0	408.7	394.2	388.0
75°	348.4	344.4	333.8	321.6	325.7
77.5°	278.0	269.6	265.4	259.2	253.1
80°	207.5	205.4	201.2	195.0	190.8
82.5°	141.1	141.1	139.1	130.8	130.8
85°	85.0	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.9	20.7
90°	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P930875

CATALOG NUMBER: DFN2DS-SQ2F0-070DS927-FLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	16.69	18.30	17.06	18.62	18.93	16.25	17.86	16.61	18.17	18.49
	3H	18.44	19.90	18.82	20.22	20.58	17.95	19.40	18.33	19.73	20.09
	4H	19.09	20.46	19.49	20.80	21.18	18.59	19.96	18.99	20.31	20.69
	6H	19.56	20.83	19.97	21.19	21.58	19.06	20.32	19.47	20.69	21.08
	8H	19.70	20.91	20.12	21.30	21.70	19.20	20.41	19.62	20.80	21.20
	12H	19.79	20.95	20.22	21.33	21.76	19.28	20.44	19.71	20.82	21.25
4H	2H	17.25	18.62	17.65	18.97	19.34	16.90	18.27	17.30	18.62	18.99
	3H	19.23	20.37	19.64	20.77	21.17	18.82	19.97	19.23	20.36	20.76
	4H	20.00	21.04	20.43	21.45	21.89	19.58	20.62	20.01	21.03	21.47
	6H	20.60	21.50	21.05	21.95	22.40	20.17	21.07	20.62	21.51	21.97
	8H	20.79	21.64	21.25	22.08	22.54	20.35	21.20	20.81	21.64	22.11
	12H	20.92	21.68	21.40	22.16	22.63	20.47	21.23	20.95	21.70	22.17
8H	4H	20.28	21.12	20.74	21.57	22.03	19.90	20.75	20.36	21.19	21.66
	6H	20.99	21.69	21.48	22.18	22.66	20.61	21.31	21.10	21.80	22.28
	8H	21.25	21.88	21.76	22.39	22.87	20.86	21.49	21.37	22.00	22.48
	12H	21.45	22.01	21.96	22.50	23.06	21.04	21.59	21.54	22.09	22.65
12H	4H	20.30	21.06	20.78	21.54	22.01	19.94	20.70	20.42	21.17	21.64
	6H	21.04	21.67	21.55	22.18	22.66	20.67	21.30	21.18	21.81	22.29
	8H	21.35	21.91	21.86	22.40	22.96	20.97	21.53	21.48	22.02	22.58