

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P931375

Luminaire Tested: DFN2DS-TR3F0-060DS840-FLL

Issue Date: 11/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P931375
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P333812)
Test Lab: INNOVATION CENTER
Issue Date: 11/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DS-TR3F0-060DS840-FLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5945.9 lumens
Efficiency: N/A
Efficacy: 96.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular (W 3.16' x L: 2.74' x H: 0')
CIE Type: Direct

Input Watts (W): 61.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P931375

CATALOG NUMBER: DFN2DS-TR3F0-060DS840-FLL

Luminous Intensity Polar Plot

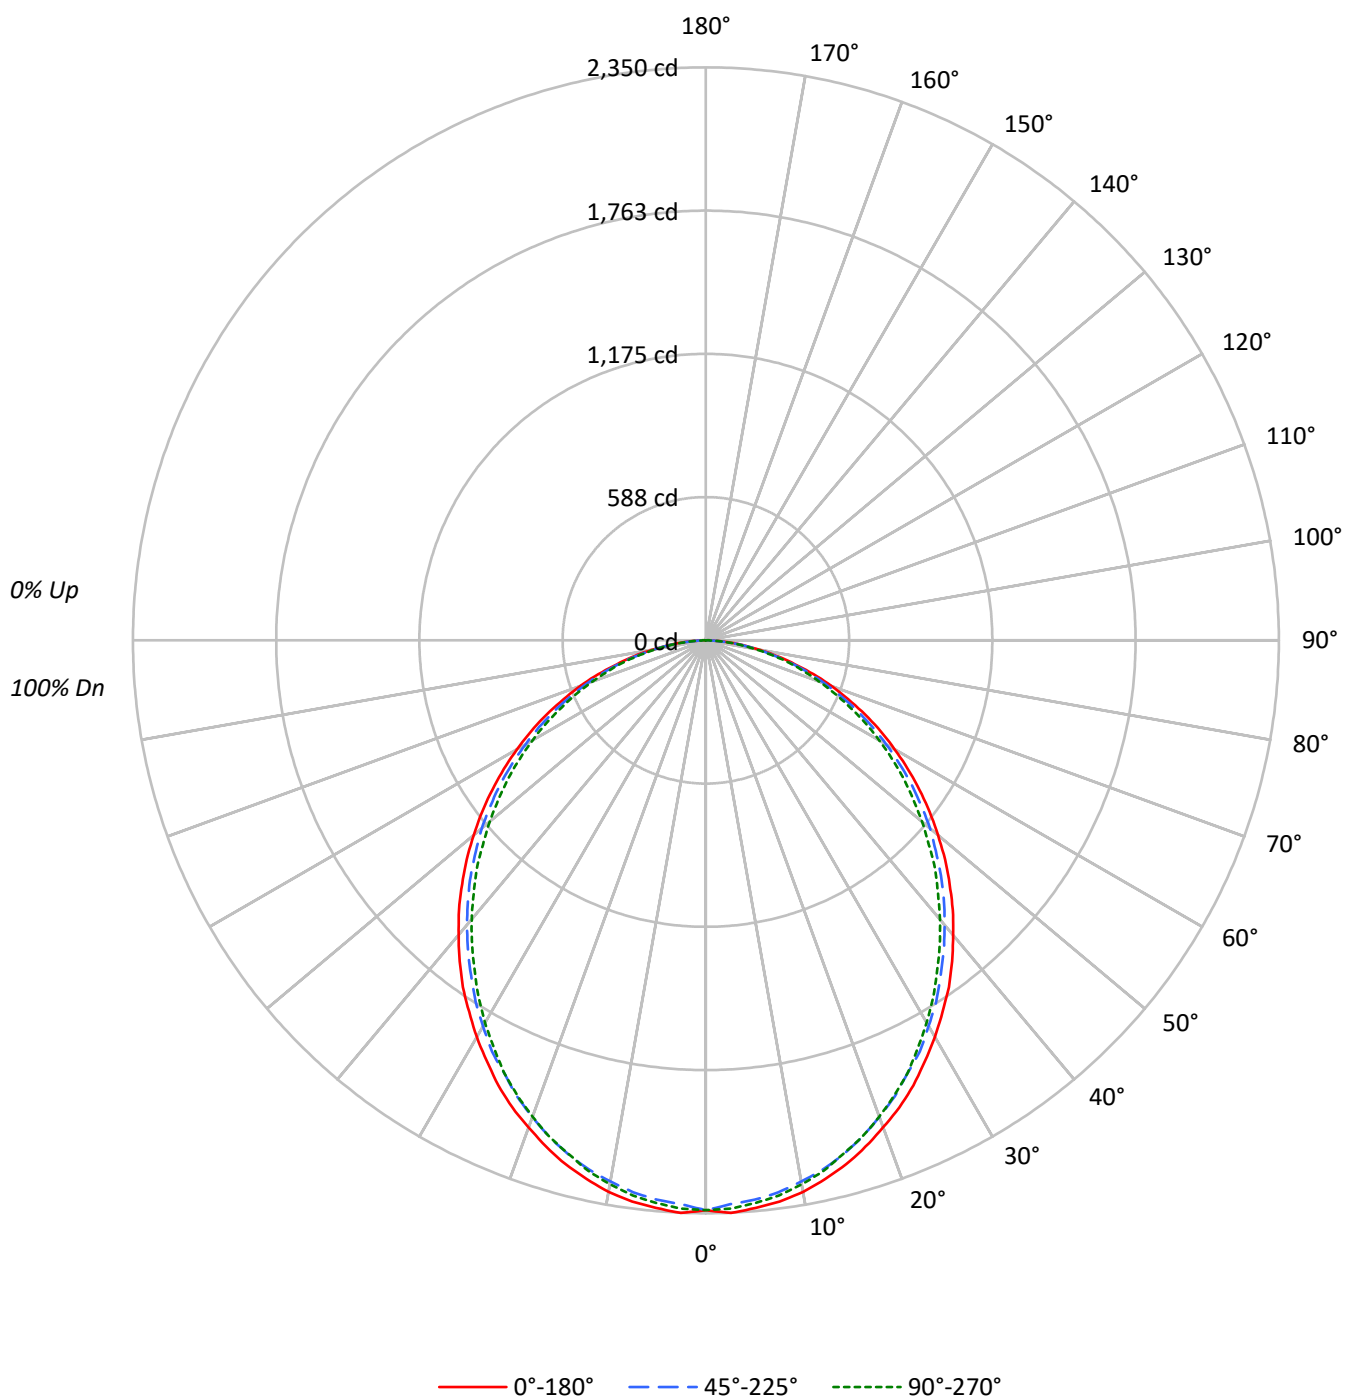

TEST NUMBER: P931375

CATALOG NUMBER: DFN2DS-TR3F0-060DS840-FLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	109	104	100	96	106	102	98	95	98	95	92		94	91	89		90
2	99	91	85	79	97	89	83	78	86	81	76		83	78	74		80
3	91	80	72	66	88	79	71	65	76	69	64		73	68	63		71
4	83	71	63	56	81	70	62	56	68	61	55		65	59	54		63
5	77	64	55	49	75	63	55	48	61	53	48		59	52	47		57
6	71	58	49	43	69	57	48	42	55	48	42		53	47	42		52
7	66	52	44	38	64	52	43	38	50	43	37		49	42	37		47
8	61	48	40	34	60	47	39	34	46	39	33		45	38	33		44
9	57	44	36	30	56	43	36	30	42	35	30		41	35	30		40
10	54	41	33	28	53	40	33	28	39	32	27		38	32	27		37

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2912	2912	2912
5°	2923	2881	2898
10°	2906	2852	2866
15°	2870	2815	2812
20°	2819	2759	2757
25°	2768	2691	2691
30°	2703	2629	2606
35°	2643	2554	2516
40°	2566	2478	2431
45°	2491	2404	2344
50°	2409	2326	2244
55°	2324	2236	2153
60°	2229	2129	2050
65°	2127	2021	1928
70°	1998	1891	1802
75°	1817	1741	1699
80°	1613	1564	1483
85°	1315	1254	1125

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2491 cd/sqm

TEST NUMBER: P931375

CATALOG NUMBER: DFN2DS-TR3F0-060DS840-FLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	220.0	3.7
10°-20°	618.9	10.4
20°-30°	909.5	15.3
30°-40°	1056.3	17.8
40°-50°	1055.0	17.7
50°-60°	919.9	15.5
60°-70°	680.0	11.4
70°-80°	384.8	6.5
80°-90°	101.5	1.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1748.3	29.4
0°-40°	2804.6	47.2
0°-60°	4779.6	80.4
0°-90°	5945.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5945.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2337	2337	2337	2337	2337	
5°	2337	2328	2303	2321	2317	222
15°	2225	2211	2182	2191	2180	627
25°	2013	1996	1957	1962	1957	926
35°	1737	1715	1679	1665	1654	1085
45°	1414	1398	1364	1339	1330	1091
55°	1070	1056	1029	1002	991	956
65°	721	708	686	665	654	713
75°	377	373	362	348	353	403
85°	92	90	88	81	79	108
90°	0	0	0	0	0	

TEST NUMBER: P931375

CATALOG NUMBER: DFN2DS-TR3F0-060DS840-FLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2336.9	2336.9	2336.9	2336.9	2336.9
2.5°	2350.5	2339.3	2314.5	2336.9	2332.6
5°	2336.9	2328.1	2303.3	2321.2	2316.9
7.5°	2321.2	2307.9	2283.1	2301.2	2296.7
10°	2296.7	2281.0	2254.0	2271.9	2265.2
12.5°	2262.9	2249.4	2222.5	2233.7	2229.2
15°	2224.6	2211.3	2182.0	2191.1	2179.9
17.5°	2177.5	2164.2	2134.8	2145.9	2134.8
20°	2125.7	2112.4	2080.9	2087.6	2078.8
22.5°	2074.3	2054.0	2024.6	2024.6	2020.1
25°	2013.4	1995.6	1957.4	1961.7	1957.4
27.5°	1945.9	1930.2	1901.1	1894.5	1883.3
30°	1878.8	1860.6	1827.0	1820.3	1811.2
32.5°	1806.7	1793.4	1757.4	1743.7	1734.7
35°	1737.1	1714.7	1678.7	1665.1	1653.9
37.5°	1658.5	1638.1	1602.2	1586.4	1575.2
40°	1577.6	1559.5	1523.5	1503.5	1494.4
42.5°	1498.9	1480.8	1445.0	1422.4	1409.0
45°	1413.6	1397.8	1364.0	1339.4	1330.3
47.5°	1330.3	1314.6	1278.7	1253.9	1240.4
50°	1242.6	1231.4	1200.0	1168.5	1157.3
52.5°	1157.3	1141.5	1112.4	1087.7	1072.0
55°	1069.8	1056.2	1029.2	1002.3	991.1
57.5°	982.1	970.9	941.5	914.6	905.5
60°	894.3	885.5	854.1	829.2	822.5
62.5°	808.9	793.2	770.8	748.3	739.3
65°	721.4	707.9	685.5	665.2	654.0
67.5°	631.5	620.1	600.1	584.4	575.3
70°	548.3	539.3	519.0	503.3	494.5
72.5°	463.0	454.0	442.7	427.0	420.3
75°	377.4	373.2	361.7	348.3	352.9
77.5°	301.1	292.1	287.5	280.9	274.2
80°	224.8	222.4	217.9	211.2	206.7
82.5°	152.9	152.9	150.7	141.6	141.6
85°	92.0	89.9	87.7	80.8	78.7
87.5°	40.5	36.0	31.4	24.8	22.4
90°	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P931375

CATALOG NUMBER: DFN2DS-TR3F0-060DS840-FLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.00	16.61	15.36	16.92	17.24	14.55	16.16	14.92	16.48	16.79
	3H	16.75	18.20	17.12	18.53	18.89	16.26	17.71	16.63	18.04	18.40
	4H	17.39	18.76	17.79	19.11	19.49	16.90	18.27	17.30	18.61	18.99
	6H	17.86	19.13	18.27	19.49	19.89	17.36	18.63	17.77	18.99	19.38
	8H	18.00	19.22	18.43	19.60	20.00	17.50	18.71	17.93	19.10	19.50
	12H	18.10	19.26	18.52	19.64	20.07	17.58	18.74	18.01	19.12	19.55
4H	2H	15.56	16.93	15.96	17.27	17.65	15.20	16.57	15.60	16.92	17.30
	3H	17.53	18.68	17.94	19.08	19.48	17.13	18.27	17.53	18.67	19.07
	4H	18.31	19.34	18.74	19.76	20.19	17.88	18.92	18.32	19.33	19.77
	6H	18.91	19.81	19.36	20.25	20.71	18.47	19.38	18.93	19.82	20.27
	8H	19.09	19.94	19.56	20.38	20.85	18.66	19.50	19.12	19.95	20.41
	12H	19.23	19.99	19.71	20.46	20.93	18.77	19.53	19.25	20.01	20.48
8H	4H	18.58	19.43	19.04	19.87	20.34	18.21	19.05	18.67	19.50	19.96
	6H	19.30	20.00	19.79	20.49	20.96	18.91	19.62	19.41	20.11	20.58
	8H	19.56	20.19	20.07	20.69	21.18	19.16	19.79	19.67	20.30	20.79
	12H	19.76	20.31	20.26	20.80	21.36	19.34	19.90	19.85	20.39	20.95
12H	4H	18.61	19.37	19.09	19.84	20.31	18.24	19.00	18.72	19.48	19.95
	6H	19.34	19.97	19.85	20.48	20.97	18.97	19.60	19.48	20.11	20.60
	8H	19.66	20.21	20.16	20.70	21.27	19.28	19.84	19.78	20.33	20.89