

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P931385

Luminaire Tested: DFN2DS-TR3F0-060DS940-FLL

Issue Date: 11/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P931385
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P333812)
Test Lab: INNOVATION CENTER
Issue Date: 11/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DS-TR3F0-060DS940-FLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5298.4 lumens
Efficiency: N/A
Efficacy: 86.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular (W 3.16' x L: 2.74' x H: 0')
CIE Type: Direct

Input Watts (W): 61.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P931385

CATALOG NUMBER: DFN2DS-TR3F0-060DS940-FLL

Luminous Intensity Polar Plot

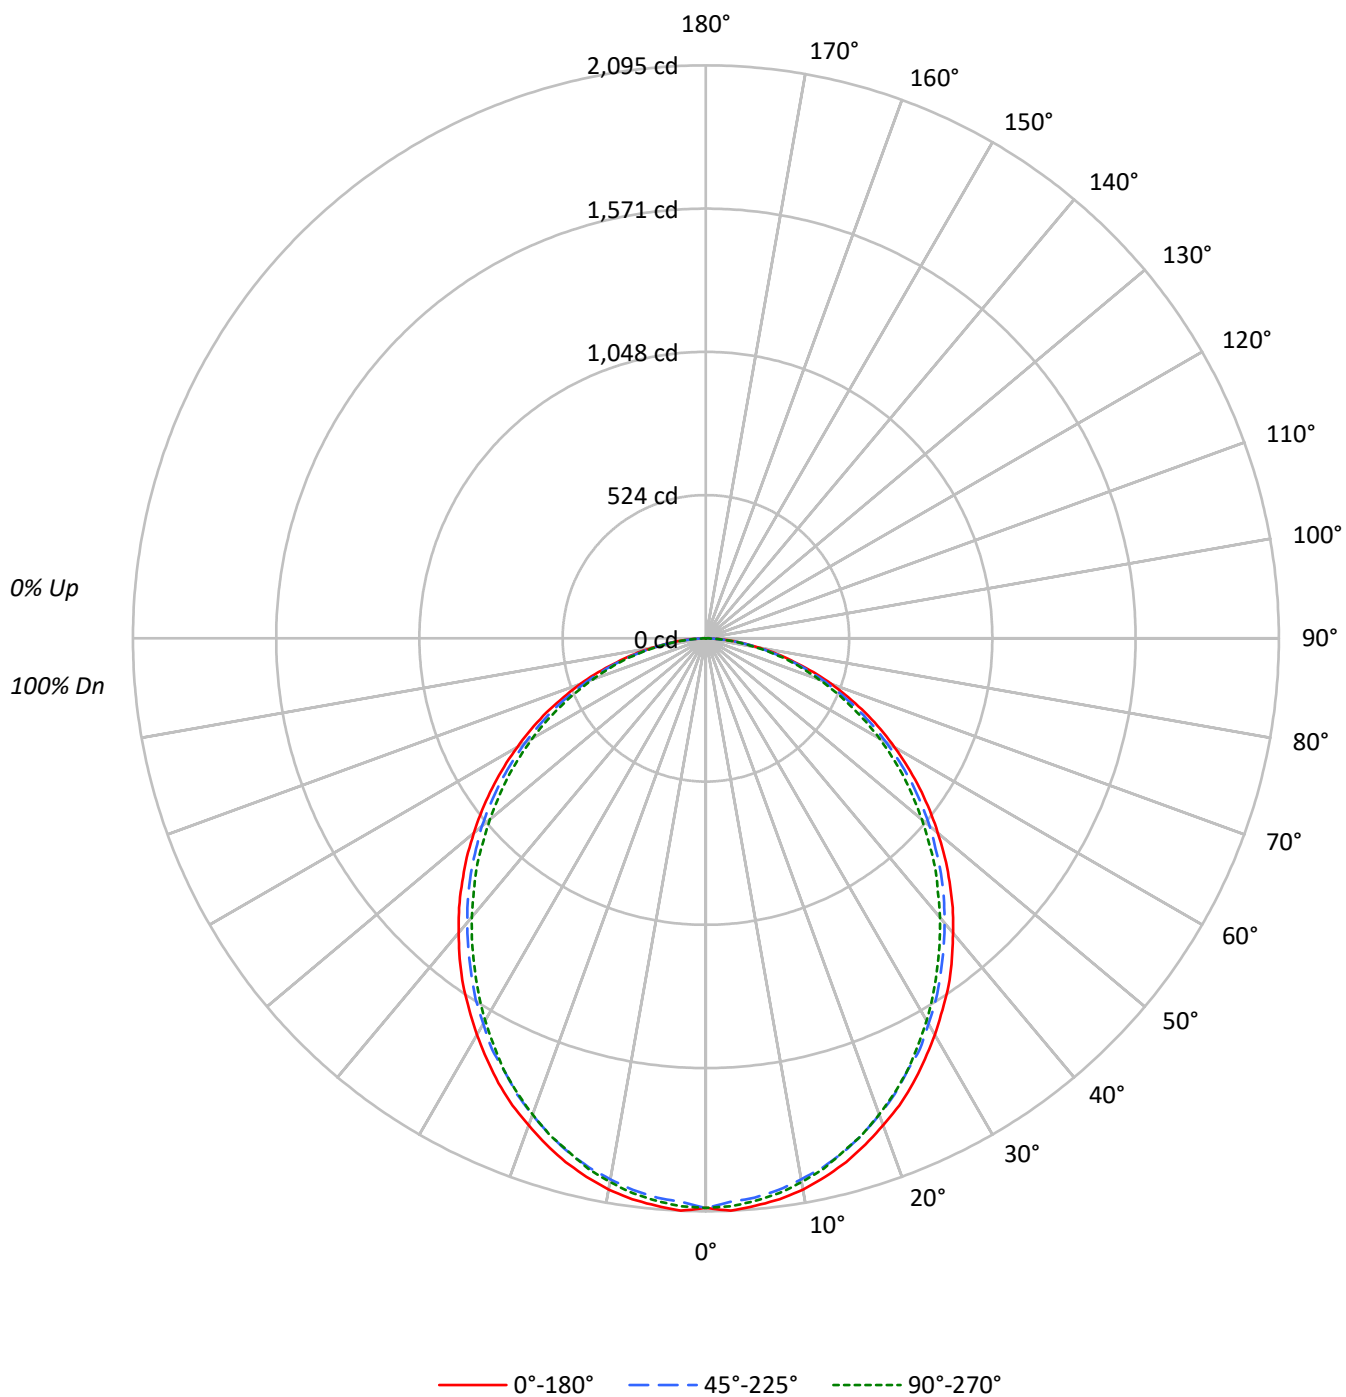

TEST NUMBER: P931385

CATALOG NUMBER: DFN2DS-TR3F0-060DS940-FLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	109	104	100	96	106	102	98	95	98	95	92		94	91	89		90
2	99	91	85	79	97	89	83	78	86	81	76		83	78	74		80
3	91	80	72	66	88	79	71	65	76	69	64		73	68	63		71
4	83	71	63	56	81	70	62	56	68	61	55		65	59	54		63
5	77	64	55	49	75	63	55	48	61	53	48		59	52	47		57
6	71	58	49	43	69	57	48	42	55	48	42		53	47	42		52
7	66	52	44	38	64	52	43	38	50	43	37		49	42	37		47
8	61	48	40	34	60	47	39	34	46	39	33		45	38	33		44
9	57	44	36	30	56	43	36	30	42	35	30		41	35	30		40
10	54	41	33	28	53	40	33	28	39	32	27		38	32	27		37

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2595	2595	2595
5°	2605	2567	2583
10°	2590	2541	2554
15°	2557	2508	2506
20°	2512	2459	2456
25°	2467	2398	2398
30°	2409	2343	2322
35°	2355	2276	2242
40°	2287	2208	2166
45°	2220	2142	2089
50°	2147	2073	1999
55°	2071	1993	1919
60°	1986	1897	1827
65°	1896	1801	1718
70°	1780	1685	1605
75°	1619	1552	1514
80°	1437	1394	1322
85°	1172	1117	1002

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2220 cd/sqm

TEST NUMBER: P931385

CATALOG NUMBER: DFN2DS-TR3F0-060DS940-FLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	196.0	3.7
10°-20°	551.5	10.4
20°-30°	810.5	15.3
30°-40°	941.3	17.8
40°-50°	940.1	17.7
50°-60°	819.8	15.5
60°-70°	606.0	11.4
70°-80°	342.9	6.5
80°-90°	90.5	1.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1558.0	29.4
0°-40°	2499.3	47.2
0°-60°	4259.1	80.4
0°-90°	5298.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5298.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2082	2082	2082	2082	2082	
5°	2082	2075	2052	2068	2065	198
15°	1982	1970	1944	1952	1942	558
25°	1794	1778	1744	1748	1744	826
35°	1548	1528	1496	1484	1474	967
45°	1260	1246	1215	1194	1186	972
55°	953	941	917	893	883	852
65°	643	631	611	593	583	636
75°	336	332	322	310	314	359
85°	82	80	78	72	70	96
90°	0	0	0	0	0	

TEST NUMBER: P931385

CATALOG NUMBER: DFN2DS-TR3F0-060DS940-FLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2082.5	2082.5	2082.5	2082.5	2082.5
2.5°	2094.6	2084.6	2062.5	2082.5	2078.6
5°	2082.5	2074.6	2052.5	2068.5	2064.6
7.5°	2068.5	2056.6	2034.5	2050.6	2046.6
10°	2046.6	2032.6	2008.5	2024.5	2018.5
12.5°	2016.5	2004.5	1980.5	1990.5	1986.5
15°	1982.4	1970.5	1944.4	1952.5	1942.5
17.5°	1940.4	1928.5	1902.4	1912.3	1902.4
20°	1894.3	1882.4	1854.3	1860.3	1852.4
22.5°	1848.4	1830.3	1804.2	1804.2	1800.1
25°	1794.2	1778.3	1744.2	1748.1	1744.2
27.5°	1734.0	1720.0	1694.1	1688.2	1678.2
30°	1674.2	1658.0	1628.1	1622.1	1614.0
32.5°	1610.0	1598.1	1566.0	1553.9	1545.8
35°	1548.0	1528.0	1495.9	1483.8	1473.8
37.5°	1477.9	1459.8	1427.7	1413.6	1403.7
40°	1405.8	1389.6	1357.6	1339.8	1331.7
42.5°	1335.7	1319.5	1287.7	1267.5	1255.6
45°	1259.7	1245.6	1215.4	1193.6	1185.5
47.5°	1185.5	1171.5	1139.4	1117.3	1105.4
50°	1107.3	1097.3	1069.3	1041.2	1031.2
52.5°	1031.2	1017.2	991.3	969.2	955.2
55°	953.3	941.1	917.2	893.2	883.2
57.5°	875.1	865.2	839.0	815.0	806.9
60°	796.9	789.1	761.1	738.9	733.0
62.5°	720.8	706.8	686.8	666.9	658.8
65°	642.9	630.8	610.8	592.7	582.7
67.5°	562.8	552.6	534.8	520.7	512.6
70°	488.6	480.6	462.5	448.5	440.6
72.5°	412.6	404.5	394.5	380.5	374.6
75°	336.3	332.5	322.3	310.4	314.4
77.5°	268.3	260.3	256.2	250.3	244.3
80°	200.3	198.2	194.2	188.2	184.2
82.5°	136.2	136.2	134.2	126.2	126.2
85°	82.0	80.1	78.1	72.0	70.1
87.5°	36.1	32.1	28.0	22.1	20.0
90°	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P931385

CATALOG NUMBER: DFN2DS-TR3F0-060DS940-FLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.60	16.21	14.96	16.52	16.84	14.15	15.76	14.52	16.08	16.39
	3H	16.35	17.80	16.72	18.13	18.49	15.85	17.31	16.23	17.64	18.00
	4H	16.99	18.36	17.39	18.71	19.09	16.50	17.87	16.90	18.21	18.59
	6H	17.46	18.73	17.87	19.09	19.49	16.96	18.23	17.37	18.59	18.98
	8H	17.60	18.82	18.03	19.20	19.60	17.10	18.31	17.53	18.70	19.10
	12H	17.69	18.85	18.12	19.24	19.67	17.18	18.34	17.61	18.72	19.15
4H	2H	15.16	16.53	15.55	16.87	17.25	14.80	16.17	15.20	16.52	16.90
	3H	17.13	18.28	17.54	18.68	19.08	16.72	17.87	17.13	18.27	18.67
	4H	17.91	18.94	18.34	19.36	19.79	17.48	18.52	17.92	18.93	19.37
	6H	18.50	19.41	18.96	19.85	20.31	18.07	18.98	18.53	19.42	19.87
	8H	18.69	19.54	19.15	19.98	20.45	18.26	19.10	18.72	19.54	20.01
	12H	18.83	19.59	19.31	20.06	20.53	18.37	19.13	18.85	19.61	20.08
8H	4H	18.18	19.03	18.64	19.47	19.94	17.81	18.65	18.27	19.10	19.56
	6H	18.90	19.60	19.39	20.09	20.56	18.51	19.22	19.01	19.71	20.18
	8H	19.15	19.79	19.66	20.29	20.78	18.76	19.39	19.27	19.90	20.39
	12H	19.35	19.91	19.86	20.40	20.96	18.94	19.50	19.45	19.99	20.55
12H	4H	18.21	18.97	18.69	19.44	19.91	17.84	18.60	18.32	19.08	19.55
	6H	18.94	19.57	19.45	20.08	20.57	18.57	19.20	19.08	19.71	20.20
	8H	19.25	19.81	19.76	20.30	20.86	18.88	19.43	19.38	19.92	20.49