

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P998594

Luminaire Tested: SA2XXDIP-B485D725UB35-4F0-XX-W2A-F

Issue Date: 5/7/2025

Test Information

Test Method: LM-79-2019
Report Number: P998594
REPORT IS A COMBINATION OF REPORTS P984337 AND P1007351
Test Lab: INNOVATION CENTER
Issue Date: 5/7/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: SA2XXDIP-B485D725UB35-4F0-XX-W2A-F
Description: Define 2 Direct/Indirect Pendant with 3500K BioUP LEDs {m-DER=0.721} {m-EER=0.792}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4820.0 lumens
Efficiency: N/A
Efficacy: 106.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 0.17' x L: 4' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 45.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P998594

CATALOG NUMBER: SA2XXDIP-B485D725UB35-4F0-XX-W2A-F

Luminous Intensity Polar Plot

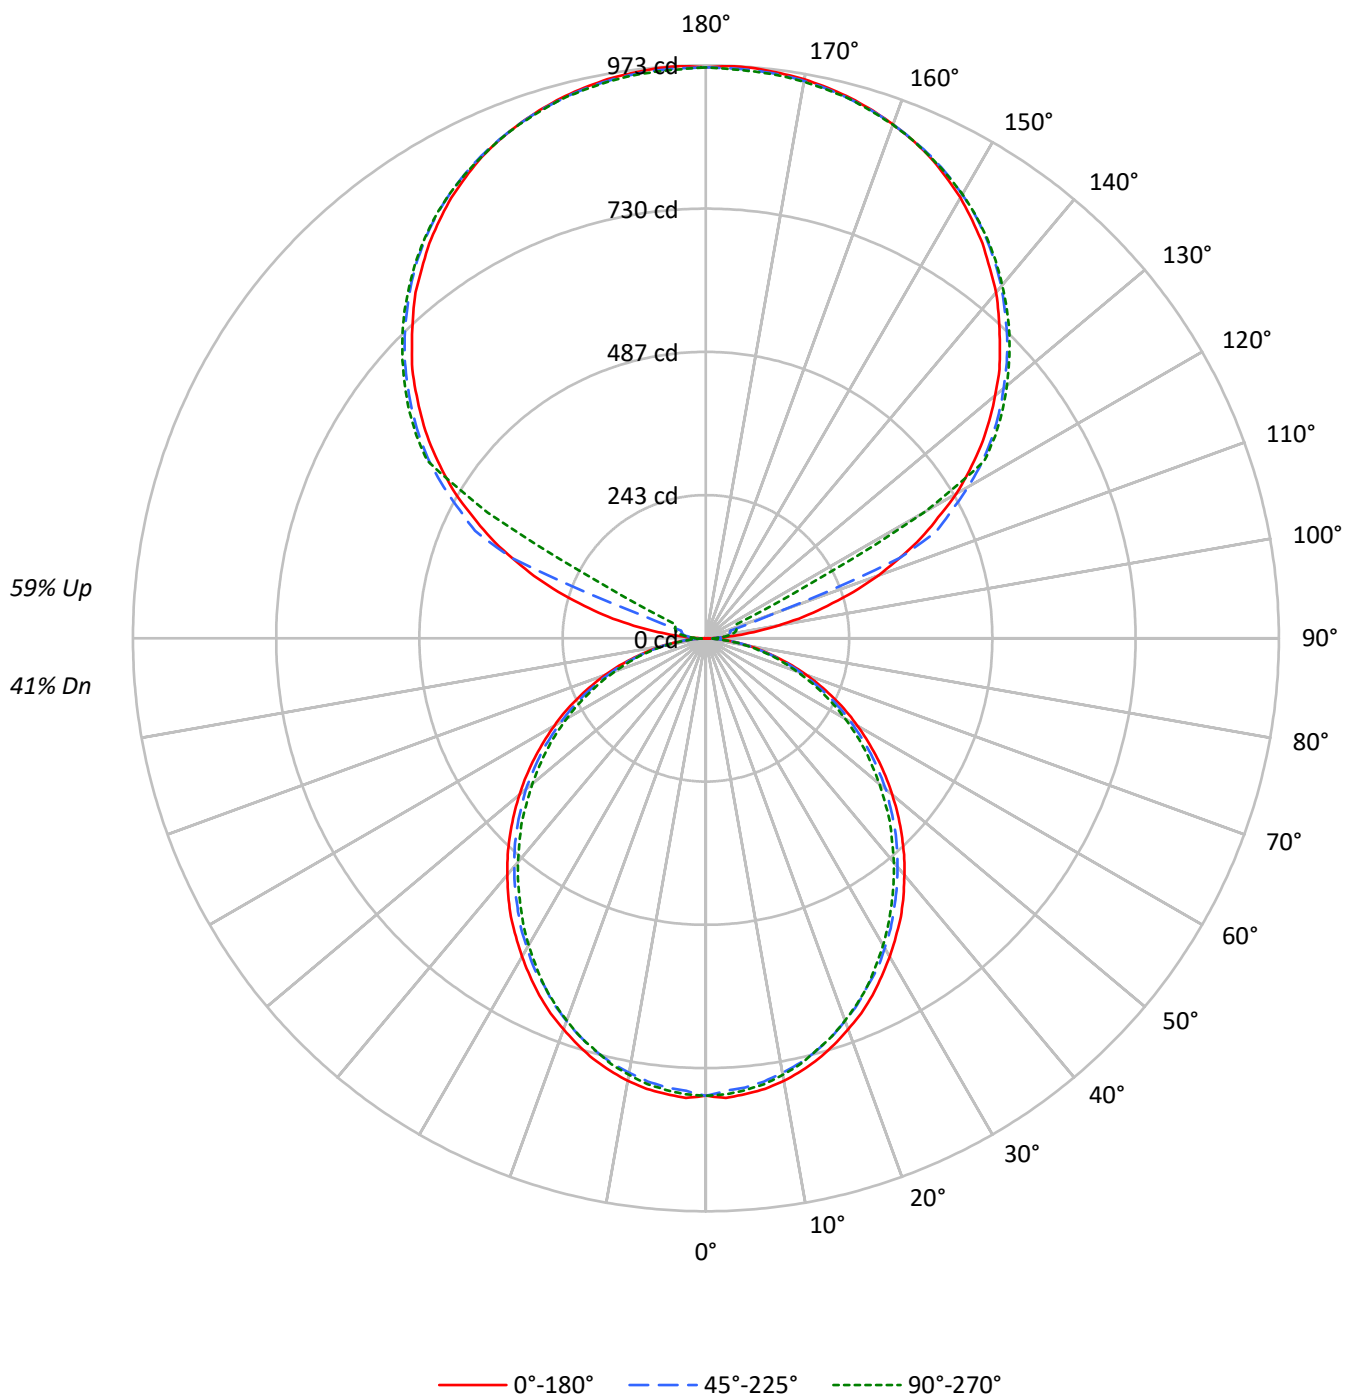

TEST NUMBER: P998594

CATALOG NUMBER: SA2XXDIP-B485D725UB35-4F0-XX-W2A-F

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	62	62	62	48	48	48
1	96	92	88	84	87	84	80	77	69	66	64	55	53	52	42	41	40
2	87	80	74	69	79	73	68	63	60	56	53	48	46	43	37	36	34
3	80	70	63	57	72	64	58	53	53	48	45	43	39	37	33	31	29
4	73	62	54	48	66	57	50	45	47	42	38	38	34	31	29	27	25
5	67	55	47	41	61	51	44	38	42	37	33	34	30	27	27	24	22
6	61	50	42	36	56	45	38	33	38	33	29	31	27	24	24	21	19
7	57	45	37	31	52	41	34	29	34	29	25	28	24	21	22	19	17
8	53	40	33	28	48	37	31	26	31	26	22	26	22	19	20	17	15
9	49	37	30	25	45	34	27	23	29	23	20	23	20	17	19	16	14
10	46	34	27	22	42	31	25	21	26	21	18	22	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	12295	12295	12295
5°	12315	11719	11636
10°	12213	11184	10963
15°	12035	10647	10255
20°	11794	10061	9585
25°	11552	9451	8916
30°	11249	8876	8212
35°	10964	8270	7524
40°	10611	7671	6870
45°	10258	7078	6231
50°	9876	6475	5568
55°	9473	5829	4939
60°	9018	5131	4286
65°	8521	4421	3599
70°	7891	3643	2907
75°	7021	2808	2243
80°	5964	1908	1444
85°	4322	887	614

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 10258 cd/sqm

TEST NUMBER: P998594

CATALOG NUMBER: SA2XXDIP-B485D725UB35-4F0-XX-W2A-F

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	73.1	1.5
10°-20°	205.7	4.3
20°-30°	302.3	6.3
30°-40°	351.0	7.3
40°-50°	350.6	7.3
50°-60°	305.7	6.3
60°-70°	226.0	4.7
70°-80°	127.9	2.7
80°-90°	35.4	0.7
90°-100°	32.0	0.7
100°-110°	119.2	2.5
110°-120°	316.1	6.6
120°-130°	524.2	10.9
130°-140°	556.8	11.6
140°-150°	517.5	10.7
150°-160°	416.1	8.6
160°-170°	268.1	5.6
170°-180°	92.3	1.9
0°-30°	581.0	12.1
0°-40°	932.1	19.3
0°-60°	1588.4	33.0
0°-90°	1977.7	41.0
90°-120°	467.2	9.7
90°-150°	2065.8	42.9
90°-180°	2842.0	59.0
0°-180°	4820.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	777	777	777	777	777	
5°	777	774	766	772	770	74
15°	739	735	725	728	724	208
25°	669	663	650	652	650	308
35°	577	570	558	553	550	360
45°	470	464	453	445	442	363
55°	356	351	342	333	329	318
65°	240	235	228	221	217	237
75°	126	124	120	116	117	134
85°	31	30	29	27	26	34
90°	1	8	14	18	19	4
95°	46	22	27	31	30	54
105°	213	234	43	50	53	228
115°	403	415	433	108	58	397
125°	570	580	593	598	600	509
135°	706	717	723	730	729	545
145°	819	818	830	835	831	512
155°	902	895	904	908	902	415
165°	950	946	948	953	948	268
175°	972	967	968	973	966	92
180°	970	970	970	970	970	

TEST NUMBER: P998594

CATALOG NUMBER: SA2XXDIP-B485D725UB35-4F0-XX-W2A-F

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	776.7	776.7	776.7	776.7	776.7
2.5°	781.2	777.4	769.2	776.7	775.2
5°	776.7	773.7	765.5	771.5	770.0
7.5°	771.5	767.0	758.8	764.7	763.2
10°	763.2	758.0	749.0	755.0	752.8
12.5°	752.0	747.6	738.6	742.3	740.8
15°	739.3	734.9	725.2	728.1	724.4
17.5°	723.7	719.2	709.5	713.2	709.5
20°	706.5	702.0	691.5	693.8	690.8
22.5°	689.3	682.6	672.9	672.9	671.4
25°	669.1	663.2	650.5	652.0	650.5
27.5°	646.7	641.5	631.8	629.6	625.8
30°	624.3	618.4	607.2	604.9	601.9
32.5°	600.4	596.0	584.0	579.5	576.5
35°	577.3	569.8	557.9	553.4	549.7
37.5°	551.1	544.4	532.5	527.2	523.5
40°	524.3	518.3	506.3	499.6	496.6
42.5°	498.1	492.1	480.2	472.7	468.2
45°	469.7	464.5	453.3	445.1	442.1
47.5°	442.1	436.9	424.9	416.7	412.2
50°	413.0	409.3	398.8	388.3	384.6
52.5°	384.6	379.4	369.7	361.5	356.2
55°	355.5	351.0	342.0	333.1	329.3
57.5°	326.4	322.6	312.9	304.0	301.0
60°	297.2	294.2	283.8	275.6	273.3
62.5°	268.9	263.6	256.2	248.7	245.7
65°	239.7	235.2	227.8	221.1	217.3
67.5°	209.9	206.1	199.4	194.2	191.2
70°	182.2	179.2	172.5	167.3	164.3
72.5°	153.8	150.9	147.1	141.9	139.7
75°	125.5	124.0	120.2	115.8	117.2
77.5°	100.1	97.1	95.6	93.4	91.1
80°	74.7	73.9	72.4	70.2	68.7
82.5°	50.8	50.8	50.0	47.0	47.0
85°	30.6	29.9	29.1	26.9	26.1
87.5°	13.4	11.9	10.5	8.2	7.5
90°	0.7	8.4	14.0	17.5	18.9
92.5°	17.5	14.7	16.8	18.2	18.9
95°	45.6	22.4	27.4	30.9	30.2
97.5°	82.1	24.6	35.8	37.9	38.6
100°	124.2	28.1	40.0	45.6	47.0
102.5°	170.5	169.1	41.4	49.1	51.2
105°	213.3	234.3	42.8	50.5	53.3
107.5°	263.1	280.6	44.2	51.9	54.7
110°	310.8	325.5	122.8	52.6	55.4

TEST NUMBER: P998594

CATALOG NUMBER: SA2XXDIP-B485D725UB35-4F0-XX-W2A-F

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	355.7	368.3	356.4	54.0	56.1
115°	403.4	415.3	432.8	108.0	57.5
117.5°	444.8	458.8	470.7	370.4	186.6
120°	491.1	501.6	514.2	522.6	427.9
122.5°	530.4	541.6	555.6	559.8	560.5
125°	570.3	579.5	592.8	597.7	599.8
127.5°	606.8	616.6	627.2	634.2	634.9
130°	641.2	652.4	660.1	667.9	667.2
132.5°	676.3	685.4	693.1	699.4	698.7
135°	705.7	717.0	723.3	730.3	728.9
137.5°	736.6	745.0	752.0	759.1	757.0
140°	766.8	772.4	780.1	786.4	782.9
142.5°	792.0	796.9	806.1	811.7	808.2
145°	818.7	818.0	829.9	834.8	831.3
147.5°	841.8	839.7	851.7	855.2	852.4
150°	864.3	859.4	870.6	874.8	871.3
152.5°	883.2	877.6	888.1	892.4	887.4
155°	901.5	895.2	903.6	907.8	902.2
157.5°	916.2	910.6	916.9	921.8	916.2
160°	928.8	924.6	928.8	933.0	928.1
162.5°	940.1	935.8	939.4	944.3	938.0
165°	949.9	945.7	947.8	952.7	947.8
167.5°	957.6	953.4	955.5	960.4	954.1
170°	963.9	959.7	961.1	966.0	959.7
172.5°	968.1	963.9	965.3	970.2	963.9
175°	971.6	966.7	968.1	973.0	966.0
177.5°	973.0	968.1	968.8	973.7	967.4
180°	969.5	969.5	969.5	969.5	969.5

TEST NUMBER: P998594

CATALOG NUMBER: SA2XXDIP-B485D725UB35-4F0-XX-W2A-F

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.06	13.85	14.09	14.89	16.28	13.85	14.63	14.88	15.67	17.06
	3H	14.40	15.10	15.44	16.15	17.56	15.47	16.17	16.51	17.22	18.63
	4H	14.80	15.46	15.85	16.51	17.93	16.05	16.72	17.11	17.77	19.19
	6H	15.01	15.63	16.07	16.68	18.11	16.45	17.07	17.52	18.12	19.55
	8H	15.04	15.63	16.11	16.69	18.12	16.56	17.15	17.63	18.21	19.64
	12H	15.03	15.59	16.10	16.65	18.10	16.60	17.16	17.67	18.22	19.67
4H	2H	13.52	14.19	14.58	15.24	16.66	14.17	14.84	15.23	15.88	17.31
	3H	15.03	15.59	16.10	16.67	18.10	15.94	16.50	17.01	17.57	19.01
	4H	15.54	16.05	16.61	17.12	18.57	16.62	17.13	17.69	18.20	19.65
	6H	15.84	16.27	16.92	17.37	18.81	17.11	17.55	18.19	18.64	20.09
	8H	15.89	16.30	16.97	17.38	18.85	17.25	17.66	18.33	18.74	20.21
	12H	15.89	16.26	16.99	17.35	18.82	17.31	17.68	18.41	18.78	20.25
8H	4H	15.71	16.12	16.79	17.20	18.66	16.70	17.11	17.78	18.19	19.66
	6H	16.09	16.43	17.19	17.55	19.01	17.26	17.60	18.37	18.73	20.19
	8H	16.19	16.49	17.30	17.59	19.07	17.45	17.75	18.56	18.86	20.34
	12H	16.22	16.48	17.33	17.58	19.10	17.55	17.81	18.66	18.91	20.43
12H	4H	15.69	16.06	16.78	17.15	18.62	16.66	17.03	17.76	18.13	19.60
	6H	16.10	16.40	17.21	17.51	18.99	17.26	17.55	18.37	18.66	20.14
	8H	16.21	16.47	17.33	17.58	19.10	17.45	17.71	18.56	18.81	20.33

END OF REPORT