

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P999250

Luminaire Tested: SA2XXDIP-B865D925UB35-4F0-XX-W2A-F4

Issue Date: 5/7/2025

Test Information

Test Method: LM-79-2019
Report Number: P999250
REPORT IS A COMBINATION OF REPORTS P984999 AND P1007351
Test Lab: INNOVATION CENTER
Issue Date: 5/7/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: SA2XXDIP-B865D925UB35-4F0-XX-W2A-F4
Description: Define 2 Direct/Indirect Pendant with 3500K BioUP LEDs {m-DER=0.721} {m-EER=0.792}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7106.1 lumens
Efficiency: N/A
Efficacy: 94.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 0.17' x L: 4' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 75.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P999250

CATALOG NUMBER: SA2XXDIP-B865D925UB35-4F0-XX-W2A-F4

Luminous Intensity Polar Plot

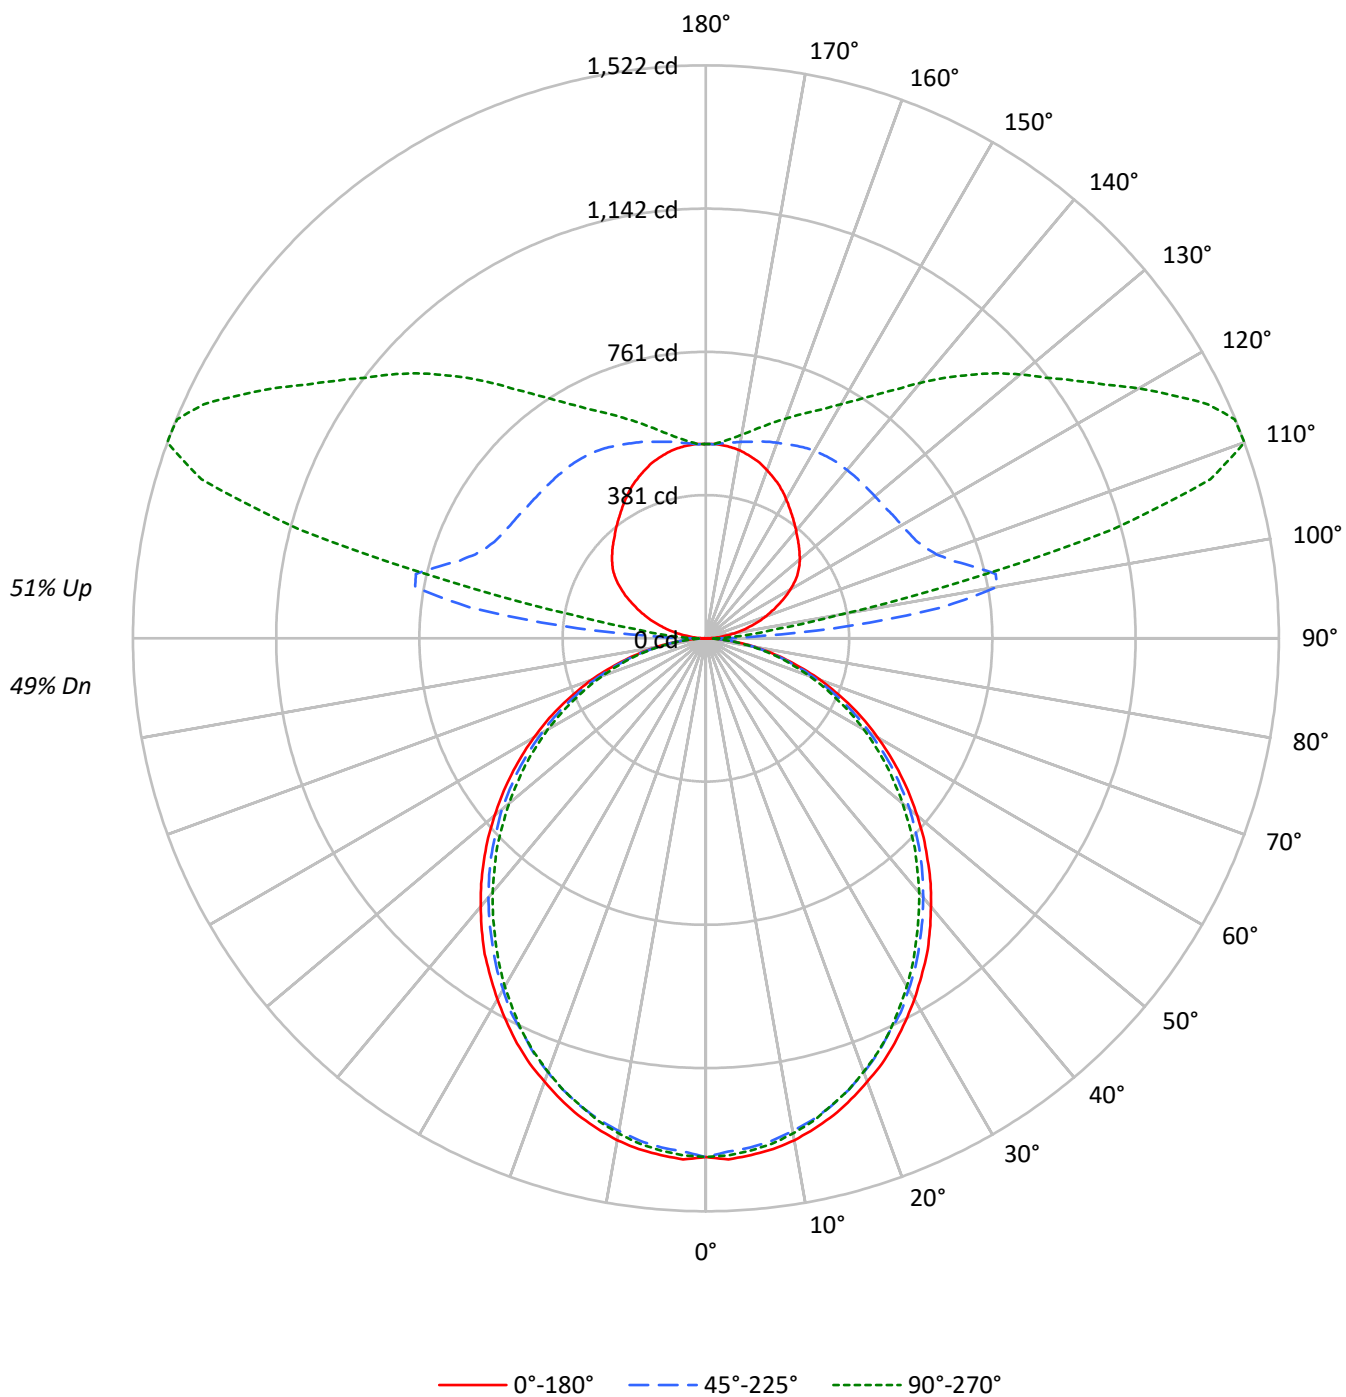

TEST NUMBER: P999250

CATALOG NUMBER: SA2XXDIP-B865D925UB35-4F0-XX-W2A-F4

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	89	86	90	86	83	80	73	70	68	60	59	57	49	48	47
2	89	81	75	70	82	75	70	65	64	60	56	53	50	48	43	41	39
3	81	72	64	58	74	66	60	55	56	51	47	47	43	40	38	36	34
4	74	63	55	49	68	59	52	46	50	45	40	42	38	35	34	31	29
5	68	56	48	42	63	52	45	40	45	39	35	38	33	30	31	28	25
6	63	51	43	37	58	47	40	35	40	35	30	34	30	26	28	25	22
7	58	46	38	32	53	43	35	30	37	31	27	31	27	23	26	22	20
8	54	42	34	28	50	39	32	27	33	28	24	28	24	21	23	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	18	16
10	47	35	28	23	43	32	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	21808	21808	21808
5°	21844	20787	20638
10°	21665	19840	19446
15°	21348	18885	18190
20°	20918	17847	17001
25°	20491	16763	15814
30°	19953	15744	14568
35°	19447	14668	13344
40°	18820	13607	12187
45°	18197	12556	11053
50°	17517	11485	9876
55°	16800	10340	8762
60°	15998	9101	7602
65°	15116	7841	6385
70°	13997	6463	5155
75°	12447	4982	3981
80°	10578	3386	2563
85°	7670	1576	1091

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 18197 cd/sqm

TEST NUMBER: P999250

CATALOG NUMBER: SA2XXDIP-B865D925UB35-4F0-XX-W2A-F4

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	129.7	1.8
10°-20°	364.8	5.1
20°-30°	536.1	7.5
30°-40°	622.7	8.8
40°-50°	621.9	8.8
50°-60°	542.3	7.6
60°-70°	400.8	5.6
70°-80°	226.8	3.2
80°-90°	63.2	0.9
90°-100°	209.2	2.9
100°-110°	707.2	10.0
110°-120°	743.4	10.5
120°-130°	611.3	8.6
130°-140°	491.2	6.9
140°-150°	371.1	5.2
150°-160°	260.9	3.7
160°-170°	153.6	2.2
170°-180°	50.0	0.7
0°-30°	1030.6	14.5
0°-40°	1653.3	23.3
0°-60°	2817.5	39.6
0°-90°	3508.3	49.4
90°-120°	1659.8	23.4
90°-150°	3133.4	44.1
90°-180°	3598.0	50.6
0°-180°	7106.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1378	1378	1378	1378	1378	
5°	1378	1372	1358	1368	1366	131
15°	1311	1304	1286	1292	1285	369
25°	1187	1176	1154	1156	1154	546
35°	1024	1011	990	982	975	639
45°	833	824	804	790	784	643
55°	630	623	607	591	584	564
65°	425	417	404	392	386	420
75°	222	220	213	205	208	237
85°	54	53	52	48	46	61
90°	1	13	34	32	33	6
95°	35	85	389	147	113	36
105°	121	183	735	1314	1118	129
115°	213	269	615	1270	1472	212
125°	298	352	592	1029	1194	265
135°	349	417	584	864	989	270
145°	399	458	582	722	790	250
155°	454	490	565	639	664	209
165°	494	509	541	574	582	139
175°	515	516	520	526	525	49
180°	516	516	516	516	516	

TEST NUMBER: P999250

CATALOG NUMBER: SA2XXDIP-B865D925UB35-4F0-XX-W2A-F4

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1377.7	1377.7	1377.7	1377.7	1377.7
2.5°	1385.6	1379.0	1364.4	1377.7	1375.0
5°	1377.7	1372.4	1357.8	1368.4	1365.7
7.5°	1368.4	1360.4	1345.9	1356.5	1353.8
10°	1353.8	1344.5	1328.7	1339.2	1335.3
12.5°	1334.0	1326.0	1310.1	1316.7	1314.1
15°	1311.4	1303.5	1286.3	1291.6	1284.9
17.5°	1283.6	1275.7	1258.4	1265.1	1258.4
20°	1253.1	1245.2	1226.7	1230.6	1225.3
22.5°	1222.7	1210.8	1193.5	1193.5	1190.9
25°	1186.9	1176.3	1153.8	1156.4	1153.8
27.5°	1147.2	1137.9	1120.7	1116.7	1110.1
30°	1107.4	1096.8	1077.0	1073.0	1067.7
32.5°	1065.0	1057.1	1035.9	1028.0	1022.7
35°	1024.0	1010.7	989.5	981.6	975.0
37.5°	977.6	965.7	944.5	935.2	928.6
40°	929.9	919.3	898.1	886.2	880.9
42.5°	883.6	873.0	851.8	838.5	830.6
45°	833.2	823.9	804.1	789.5	784.2
47.5°	784.2	774.9	753.7	739.2	731.2
50°	732.5	725.9	707.4	688.8	682.2
52.5°	682.2	672.9	655.7	641.1	631.9
55°	630.5	622.6	606.7	590.8	584.2
57.5°	578.9	572.3	555.0	539.1	533.8
60°	527.2	521.9	503.4	488.8	484.8
62.5°	476.9	467.6	454.4	441.1	435.8
65°	425.2	417.3	404.0	392.1	385.5
67.5°	372.2	365.6	353.7	344.4	339.1
70°	323.2	317.9	306.0	296.7	291.4
72.5°	272.9	267.6	261.0	251.7	247.7
75°	222.5	219.9	213.3	205.3	208.0
77.5°	177.5	172.2	169.6	165.6	161.6
80°	132.5	131.1	128.5	124.5	121.9
82.5°	90.1	90.1	88.8	83.5	83.5
85°	54.3	53.0	51.7	47.7	46.4
87.5°	23.8	21.2	18.5	14.6	13.2
90°	1.0	13.4	33.7	32.2	32.7
92.5°	14.9	47.2	152.8	70.4	60.5
95°	34.7	85.4	389.0	146.9	113.1
97.5°	51.6	112.6	634.1	294.8	189.5
100°	76.4	137.9	784.0	587.0	355.3
102.5°	99.2	160.8	788.9	992.4	692.7
105°	121.1	182.6	735.4	1314.4	1118.4
107.5°	144.9	204.4	685.7	1431.1	1405.2
110°	168.7	226.8	652.0	1412.2	1522.3

TEST NUMBER: P999250

CATALOG NUMBER: SA2XXDIP-B865D925UB35-4F0-XX-W2A-F4

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	190.5	248.1	630.2	1348.2	1520.3
115°	213.4	269.4	615.3	1269.8	1471.7
117.5°	237.2	290.8	607.3	1194.8	1398.3
120°	259.0	311.6	600.4	1127.8	1327.8
122.5°	279.8	333.0	596.4	1075.7	1254.4
125°	297.7	352.3	591.5	1028.6	1193.8
127.5°	312.6	370.6	588.5	988.4	1137.3
130°	325.5	387.0	586.5	947.8	1090.6
132.5°	337.4	402.9	585.5	905.6	1042.0
135°	349.3	416.8	584.5	864.4	989.4
137.5°	360.2	428.7	584.5	822.7	938.8
140°	373.1	439.6	583.5	786.0	886.2
142.5°	386.0	448.6	583.5	750.8	833.6
145°	398.9	458.5	581.5	722.0	789.9
147.5°	412.8	466.4	578.6	696.7	751.2
150°	426.7	474.4	575.6	674.8	717.5
152.5°	440.6	482.3	570.6	656.4	688.7
155°	453.5	489.8	564.7	638.6	663.9
157.5°	464.4	495.6	558.7	621.8	642.1
160°	475.3	501.6	552.8	604.8	621.2
162.5°	486.3	506.1	547.8	589.0	601.4
165°	494.2	509.1	540.8	573.6	582.5
167.5°	501.1	512.1	534.9	559.7	564.7
170°	508.1	513.6	529.9	546.8	548.8
172.5°	512.1	515.0	524.0	535.4	535.9
175°	515.0	515.5	520.0	526.5	525.0
177.5°	517.0	516.0	516.0	520.0	517.0
180°	516.0	516.0	516.0	516.0	516.0

TEST NUMBER: P999250

CATALOG NUMBER: SA2XXDIP-B865D925UB35-4F0-XX-W2A-F4

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.89	16.74	16.85	17.72	19.00	16.67	17.52	17.63	18.50	19.78
	3H	17.22	17.99	18.20	18.98	20.28	18.29	19.06	19.27	20.05	21.35
	4H	17.63	18.35	18.61	19.34	20.65	18.88	19.61	19.87	20.60	21.91
	6H	17.85	18.52	18.84	19.51	20.83	19.29	19.96	20.29	20.95	22.28
	8H	17.88	18.51	18.88	19.53	20.85	19.40	20.03	20.40	21.05	22.36
	12H	17.87	18.47	18.88	19.48	20.82	19.44	20.05	20.45	21.05	22.40
4H	2H	16.35	17.08	17.35	18.07	19.38	17.00	17.72	17.99	18.71	20.02
	3H	17.87	18.48	18.87	19.50	20.82	18.78	19.38	19.78	20.40	21.73
	4H	18.38	18.93	19.39	19.94	21.29	19.46	20.01	20.47	21.02	22.37
	6H	18.68	19.16	19.70	20.19	21.54	19.95	20.43	20.97	21.47	22.81
	8H	18.74	19.18	19.76	20.21	21.57	20.10	20.54	21.12	21.57	22.93
	12H	18.74	19.14	19.78	20.18	21.55	20.16	20.56	21.20	21.60	22.97
8H	4H	18.55	19.00	19.57	20.03	21.39	19.54	19.99	20.57	21.02	22.38
	6H	18.93	19.30	19.98	20.37	21.73	20.11	20.48	21.16	21.55	22.91
	8H	19.04	19.36	20.09	20.42	21.79	20.30	20.63	21.36	21.68	23.06
	12H	19.07	19.35	20.13	20.40	21.82	20.40	20.68	21.46	21.73	23.15
12H	4H	18.53	18.94	19.57	19.98	21.34	19.51	19.91	20.55	20.95	22.32
	6H	18.95	19.28	20.01	20.33	21.71	20.10	20.43	21.16	21.48	22.86
	8H	19.06	19.35	20.12	20.40	21.82	20.30	20.59	21.36	21.64	23.05

END OF REPORT