

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1025044

Luminaire Tested: S124DIP-B1195D1035UB30-4F0-XX-W2A-F

Issue Date: 5/7/2025

Test Information

Test Method: LM-79-2019
Report Number: P1025044
REPORT IS A COMBINATION OF REPORTS P995449 AND P1007351
Test Lab: INNOVATION CENTER
Issue Date: 5/7/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S124DIP-B1195D1035UB30-4F0-XX-W2A-F
Description: Define 4 Direct/Indirect Pendant with 3000K BioUP LEDs {m-DER=0.589} {m-EER=0.647}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9217.0 lumens
Efficiency: N/A
Efficacy: 102.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.17 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 0.33' x L: 4' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 89.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1025044

CATALOG NUMBER: S124DIP-B1195D1035UB30-4F0-XX-W2A-F

Luminous Intensity Polar Plot

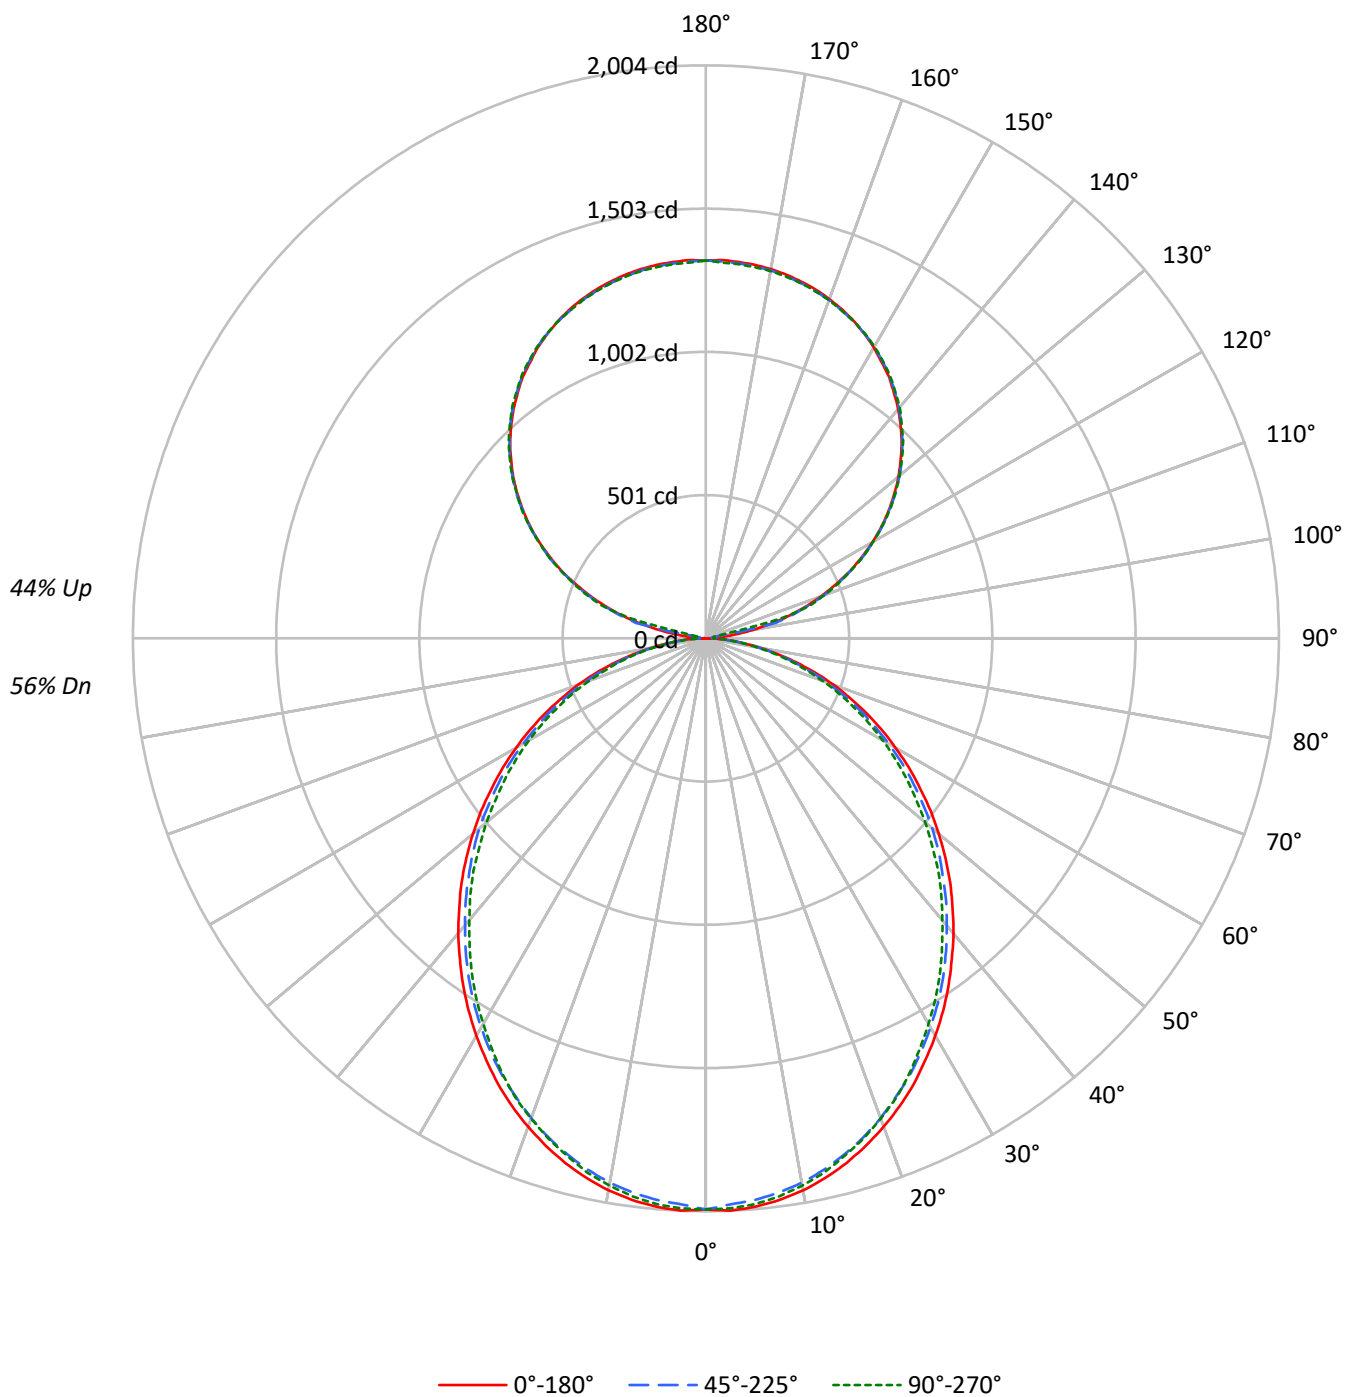

TEST NUMBER: P1025044

CATALOG NUMBER: S124DIP-B1195D1035UB30-4F0-XX-W2A-F

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	101	101	101	101	86	86	86	73	73	73	61	61	61
1	99	95	91	87	92	88	85	82	76	73	71	65	63	61	54	53	52
2	90	83	76	71	83	77	72	67	66	62	59	57	54	51	48	45	44
3	82	73	65	59	76	68	61	56	59	54	49	50	46	43	42	39	37
4	75	64	56	50	70	60	53	47	52	47	42	45	40	37	38	35	32
5	69	57	49	43	64	54	46	41	47	41	36	40	36	32	34	31	28
6	64	51	43	37	59	48	41	35	42	36	32	36	32	28	31	27	25
7	59	47	38	33	55	44	36	31	38	32	28	33	28	25	28	25	22
8	55	42	34	29	51	40	33	28	35	29	25	30	26	22	26	22	20
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	18
10	48	35	28	23	44	33	27	22	29	24	20	26	21	18	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	16285	16285	16285
5°	16299	15817	15836
10°	16161	15378	15270
15°	15929	14856	14632
20°	15633	14291	13971
25°	15300	13695	13259
30°	14899	13050	12478
35°	14482	12389	11722
40°	14048	11678	10919
45°	13593	10965	10169
50°	13090	10275	9337
55°	12542	9467	8511
60°	11982	8583	7650
65°	11341	7671	6681
70°	10604	6572	5643
75°	9501	5298	4518
80°	8094	3829	3178
85°	6287	2132	1710

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 13593 cd/sqm

TEST NUMBER: P1025044

CATALOG NUMBER: S124DIP-B1195D1035UB30-4F0-XX-W2A-F

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	188.2	2.0
10°-20°	530.3	5.8
20°-30°	780.5	8.5
30°-40°	907.3	9.8
40°-50°	907.2	9.8
50°-60°	793.4	8.6
60°-70°	589.1	6.4
70°-80°	334.2	3.6
80°-90°	98.4	1.1
90°-100°	43.9	0.5
100°-110°	288.8	3.1
110°-120°	551.5	6.0
120°-130°	700.1	7.6
130°-140°	749.0	8.1
140°-150°	700.4	7.6
150°-160°	564.8	6.1
160°-170°	364.2	4.0
170°-180°	125.5	1.4
0°-30°	1499.1	16.3
0°-40°	2406.3	26.1
0°-60°	4107.0	44.6
0°-90°	5128.7	55.6
90°-120°	884.2	9.6
90°-150°	3033.7	32.9
90°-180°	4088.0	44.4
0°-180°	9217.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1997	1997	1997	1997	1997	
5°	1996	1989	1972	1989	1986	189
15°	1900	1893	1869	1879	1874	535
25°	1720	1709	1687	1688	1682	792
35°	1480	1469	1447	1435	1427	926
45°	1208	1197	1171	1154	1149	931
55°	914	909	886	867	858	818
65°	619	611	595	579	571	613
75°	330	322	314	307	306	350
85°	86	86	83	83	82	93
90°	3	14	22	28	30	9
95°	54	21	22	28	29	67
105°	297	303	308	317	282	311
115°	555	558	557	559	559	547
125°	781	785	783	786	787	697
135°	968	967	971	973	975	746
145°	1117	1120	1120	1121	1123	698
155°	1224	1225	1222	1226	1223	565
165°	1292	1287	1287	1294	1286	365
175°	1321	1315	1316	1325	1313	126
180°	1321	1321	1321	1321	1321	

TEST NUMBER: P1025044

CATALOG NUMBER: S124DIP-B1195D1035UB30-4F0-XX-W2A-F

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1997.1	1997.1	1997.1	1997.1	1997.1
2.5°	2003.5	1998.7	1981.1	1997.1	1995.5
5°	1995.5	1989.1	1971.5	1989.1	1985.9
7.5°	1981.1	1974.7	1955.5	1969.9	1968.3
10°	1960.3	1953.9	1933.1	1945.9	1942.7
12.5°	1933.1	1926.7	1904.3	1918.7	1913.9
15°	1899.5	1893.1	1869.1	1878.7	1873.9
17.5°	1861.1	1853.1	1830.7	1837.1	1833.9
20°	1817.9	1809.9	1785.9	1790.7	1787.5
22.5°	1771.5	1760.3	1736.3	1745.9	1739.5
25°	1720.3	1709.1	1686.7	1688.3	1681.9
27.5°	1662.7	1651.5	1630.7	1627.5	1619.5
30°	1605.1	1592.3	1571.5	1565.1	1557.1
32.5°	1544.2	1533.0	1510.6	1502.6	1494.6
35°	1480.2	1469.0	1446.6	1435.4	1427.4
37.5°	1413.0	1403.4	1379.4	1368.2	1357.0
40°	1347.4	1334.6	1310.6	1294.6	1286.6
42.5°	1277.0	1270.6	1243.4	1224.2	1219.4
45°	1208.2	1197.0	1171.4	1153.8	1149.0
47.5°	1136.2	1128.2	1104.2	1085.0	1072.2
50°	1062.6	1056.2	1033.8	1011.4	1001.8
52.5°	990.6	982.6	958.6	939.4	926.5
55°	913.7	908.9	886.5	867.3	857.7
57.5°	841.7	836.9	814.5	795.3	785.7
60°	766.5	758.5	737.7	723.3	715.3
62.5°	692.9	686.5	664.1	651.3	643.3
65°	619.3	611.3	595.3	579.3	571.3
67.5°	544.1	537.7	521.7	505.7	504.1
70°	475.3	464.1	451.3	438.5	433.7
72.5°	401.7	390.5	380.9	371.3	366.5
75°	329.7	321.7	313.7	307.2	305.6
77.5°	259.2	256.0	248.0	246.4	241.6
80°	196.8	192.0	188.8	185.6	184.0
82.5°	136.0	134.4	134.4	132.8	131.2
85°	86.4	86.4	83.2	83.2	81.6
87.5°	41.6	40.0	38.4	38.4	38.4
90°	3.0	13.8	21.7	27.7	29.6
92.5°	14.8	12.8	20.8	26.7	26.7
95°	54.4	20.8	21.7	27.7	28.7
97.5°	103.8	125.5	21.7	26.7	27.7
100°	162.1	179.8	43.5	26.7	27.7
102.5°	227.3	239.1	251.0	28.7	28.7
105°	297.4	303.4	308.3	317.2	281.6
107.5°	361.7	364.6	371.6	376.5	380.5
110°	426.9	429.9	435.8	437.8	440.7

TEST NUMBER: P1025044

CATALOG NUMBER: S124DIP-B1195D1035UB30-4F0-XX-W2A-F

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.1	496.1	498.0	497.1	501.0
115°	555.4	558.3	557.3	559.3	559.3
117.5°	613.7	617.6	620.6	619.6	619.6
120°	673.0	676.9	675.9	677.9	675.9
122.5°	728.3	730.3	732.2	733.2	731.3
125°	780.7	784.6	782.6	785.6	786.6
127.5°	831.1	832.1	837.0	836.0	835.0
130°	879.5	880.5	883.4	884.4	884.4
132.5°	924.0	925.9	929.9	930.9	929.9
135°	968.4	967.4	971.4	973.4	975.3
137.5°	1007.9	1007.9	1012.9	1014.9	1013.9
140°	1046.5	1048.5	1050.4	1053.4	1054.4
142.5°	1081.1	1085.0	1086.0	1088.0	1088.0
145°	1116.6	1119.6	1119.6	1120.6	1122.6
147.5°	1144.3	1150.2	1149.3	1150.2	1151.2
150°	1175.0	1178.9	1177.9	1177.9	1178.9
152.5°	1200.6	1203.6	1201.6	1203.6	1202.6
155°	1224.4	1225.4	1222.4	1226.3	1223.4
157.5°	1245.1	1245.1	1241.2	1246.1	1241.2
160°	1262.9	1259.9	1258.9	1264.9	1258.9
162.5°	1278.7	1274.8	1273.8	1279.7	1272.8
165°	1291.6	1286.6	1286.6	1294.5	1285.6
167.5°	1302.4	1297.5	1296.5	1305.4	1295.5
170°	1311.3	1305.4	1306.4	1314.3	1304.4
172.5°	1317.3	1311.3	1312.3	1320.2	1309.3
175°	1321.2	1315.3	1316.3	1325.2	1313.3
177.5°	1324.2	1317.3	1319.2	1327.1	1315.3
180°	1321.2	1321.2	1321.2	1321.2	1321.2

(END OF REPORT)