

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1025062

Luminaire Tested: S124DIP-B1195D1035UB40-4F0-XX-W2A-F

Issue Date: 5/6/2025

Test Information

Test Method: LM-79-2019
Report Number: P1025062
REPORT IS A COMBINATION OF REPORTS P995467 AND P1007351
Test Lab: INNOVATION CENTER
Issue Date: 5/6/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S124DIP-B1195D1035UB40-4F0-XX-W2A-F
Description: Define 4 Direct/Indirect Pendant with 4000K BioUP LEDs {m-DER=0.865} {m-EER=0.951}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9165.0 lumens
Efficiency: N/A
Efficacy: 102.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.17 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 0.33' x L: 4' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 89.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1025062

CATALOG NUMBER: S124DIP-B1195D1035UB40-4F0-XX-W2A-F

Luminous Intensity Polar Plot

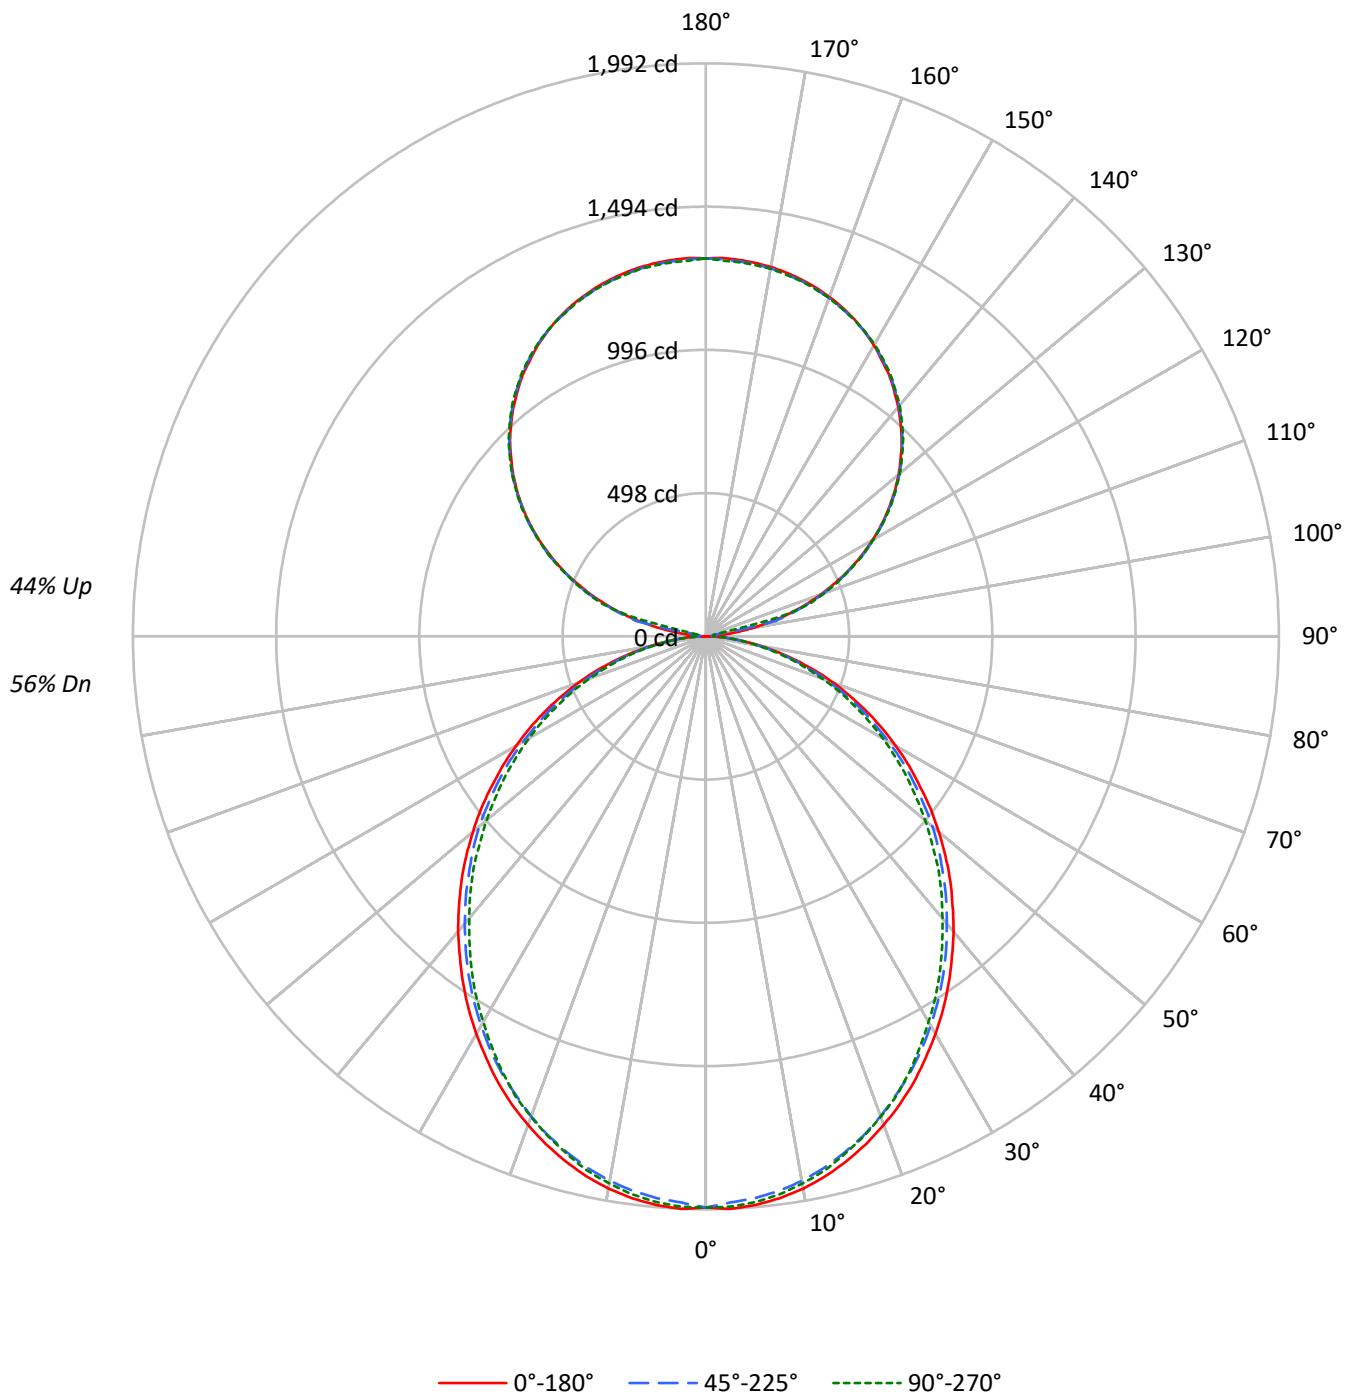

TEST NUMBER: P1025062

CATALOG NUMBER: S124DIP-B1195D1035UB40-4F0-XX-W2A-F

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	101	101	101	101	86	86	86	73	73	73	61	61	61
1	99	95	91	87	92	88	85	82	76	73	71	65	63	61	54	53	52
2	90	83	76	71	83	77	72	67	66	62	59	57	54	51	48	45	44
3	82	73	65	59	76	68	61	56	59	54	49	50	46	43	42	39	37
4	75	64	56	50	70	60	53	47	52	47	42	45	40	37	38	35	32
5	69	57	49	43	64	54	46	41	47	41	36	40	36	32	34	31	28
6	64	51	43	37	59	48	41	35	42	36	32	36	32	28	31	27	25
7	59	47	38	33	55	44	36	31	38	32	28	33	28	25	28	25	22
8	55	42	34	29	51	40	33	28	35	29	25	30	26	22	26	22	20
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	18
10	48	35	28	23	44	33	27	22	29	24	20	26	21	18	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	16193	16193	16193
5°	16206	15728	15747
10°	16069	15291	15184
15°	15839	14772	14549
20°	15545	14210	13892
25°	15213	13617	13184
30°	14814	12976	12407
35°	14400	12318	11656
40°	13969	11612	10857
45°	13517	10904	10111
50°	13016	10216	9284
55°	12472	9414	8463
60°	11915	8534	7608
65°	11277	7627	6644
70°	10544	6534	5610
75°	9446	5267	4493
80°	8049	3809	3161
85°	6251	2119	1702

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 13517 cd/sqm

TEST NUMBER: P1025062

CATALOG NUMBER: S124DIP-B1195D1035UB40-4F0-XX-W2A-F

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	187.2	2.0
10°-20°	527.3	5.8
20°-30°	776.1	8.5
30°-40°	902.1	9.8
40°-50°	902.1	9.8
50°-60°	789.0	8.6
60°-70°	585.7	6.4
70°-80°	332.3	3.6
80°-90°	97.9	1.1
90°-100°	43.6	0.5
100°-110°	287.2	3.1
110°-120°	548.4	6.0
120°-130°	696.2	7.6
130°-140°	744.8	8.1
140°-150°	696.4	7.6
150°-160°	561.6	6.1
160°-170°	362.2	4.0
170°-180°	124.8	1.4
0°-30°	1490.6	16.3
0°-40°	2392.7	26.1
0°-60°	4083.7	44.6
0°-90°	5099.7	55.6
90°-120°	879.2	9.6
90°-150°	3016.6	32.9
90°-180°	4065.0	44.4
0°-180°	9165.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1986	1986	1986	1986	1986	
5°	1984	1978	1960	1978	1975	188
15°	1889	1882	1858	1868	1863	532
25°	1710	1699	1677	1679	1672	787
35°	1472	1461	1438	1427	1419	920
45°	1201	1190	1165	1147	1142	926
55°	909	904	882	862	853	814
65°	616	608	592	576	568	609
75°	328	320	312	306	304	348
85°	86	86	83	83	81	92
90°	3	14	22	28	30	8
95°	54	21	22	28	28	67
105°	296	302	307	315	280	310
115°	552	555	554	556	556	544
125°	776	780	778	781	782	693
135°	963	962	966	968	970	742
145°	1110	1113	1113	1114	1116	694
155°	1218	1218	1216	1219	1216	561
165°	1284	1279	1279	1287	1278	363
175°	1314	1308	1309	1318	1306	125
180°	1314	1314	1314	1314	1314	

TEST NUMBER: P1025062

CATALOG NUMBER: S124DIP-B1195D1035UB40-4F0-XX-W2A-F

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1985.8	1985.8	1985.8	1985.8	1985.8
2.5°	1992.2	1987.4	1969.9	1985.8	1984.2
5°	1984.2	1977.9	1960.4	1977.9	1974.7
7.5°	1969.9	1963.5	1944.5	1958.8	1957.2
10°	1949.2	1942.9	1922.2	1934.9	1931.7
12.5°	1922.2	1915.8	1893.5	1907.9	1903.1
15°	1888.8	1882.4	1858.5	1868.1	1863.3
17.5°	1850.6	1842.6	1820.3	1826.7	1823.5
20°	1807.6	1799.7	1775.8	1780.6	1777.4
22.5°	1761.5	1750.3	1726.5	1736.0	1729.6
25°	1710.5	1699.4	1677.1	1678.7	1672.4
27.5°	1653.3	1642.1	1621.4	1618.3	1610.3
30°	1596.0	1583.2	1562.6	1556.2	1548.2
32.5°	1535.5	1524.4	1502.1	1494.1	1486.2
35°	1471.9	1460.7	1438.4	1427.3	1419.4
37.5°	1405.0	1395.5	1371.6	1360.5	1349.3
40°	1339.8	1327.1	1303.2	1287.3	1279.3
42.5°	1269.8	1263.4	1236.4	1217.3	1212.5
45°	1201.4	1190.2	1164.8	1147.3	1142.5
47.5°	1129.8	1121.8	1097.9	1078.8	1066.1
50°	1056.6	1050.2	1027.9	1005.6	996.1
52.5°	985.0	977.0	953.1	934.0	921.3
55°	908.6	903.8	881.5	862.4	852.9
57.5°	837.0	832.2	809.9	790.8	781.3
60°	762.2	754.2	733.5	719.2	711.3
62.5°	689.0	682.6	660.3	647.6	639.7
65°	615.8	607.8	591.9	576.0	568.1
67.5°	541.0	534.6	518.7	502.8	501.2
70°	472.6	461.4	448.7	436.0	431.2
72.5°	399.4	388.3	378.7	369.2	364.4
75°	327.8	319.8	311.9	305.5	303.9
77.5°	257.8	254.6	246.6	245.0	240.3
80°	195.7	190.9	187.8	184.6	183.0
82.5°	135.3	133.7	133.7	132.1	130.5
85°	85.9	85.9	82.7	82.7	81.2
87.5°	41.4	39.8	38.2	38.2	38.2
90°	2.9	13.8	21.6	27.5	29.5
92.5°	14.7	12.8	20.6	26.5	26.5
95°	54.0	20.6	21.6	27.5	28.5
97.5°	103.2	124.8	21.6	26.5	27.5
100°	161.2	178.8	43.2	26.5	27.5
102.5°	226.0	237.8	249.6	28.5	28.5
105°	295.8	301.7	306.6	315.4	280.0
107.5°	359.6	362.6	369.5	374.4	378.3
110°	424.5	427.4	433.3	435.3	438.3



TEST NUMBER: P1025062

CATALOG NUMBER: S124DIP-B1195D1035UB40-4F0-XX-W2A-F

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	487.4	493.3	495.2	494.3	498.2
115°	552.2	555.2	554.2	556.2	556.2
117.5°	610.2	614.1	617.1	616.1	616.1
120°	669.2	673.1	672.1	674.1	672.1
122.5°	724.2	726.2	728.1	729.1	727.1
125°	776.3	780.2	778.2	781.2	782.2
127.5°	826.4	827.4	832.3	831.3	830.3
130°	874.5	875.5	878.5	879.5	879.5
132.5°	918.8	920.7	924.7	925.6	924.7
135°	963.0	962.0	965.9	967.9	969.9
137.5°	1002.3	1002.3	1007.2	1009.2	1008.2
140°	1040.6	1042.6	1044.5	1047.5	1048.5
142.5°	1075.0	1078.9	1079.9	1081.9	1081.9
145°	1110.4	1113.3	1113.3	1114.3	1116.3
147.5°	1137.9	1143.8	1142.8	1143.8	1144.8
150°	1168.3	1172.3	1171.3	1171.3	1172.3
152.5°	1193.9	1196.8	1194.9	1196.8	1195.9
155°	1217.5	1218.5	1215.5	1219.4	1216.5
157.5°	1238.1	1238.1	1234.2	1239.1	1234.2
160°	1255.8	1252.9	1251.9	1257.8	1251.9
162.5°	1271.5	1267.6	1266.6	1272.5	1265.6
165°	1284.3	1279.4	1279.4	1287.2	1278.4
167.5°	1295.1	1290.2	1289.2	1298.1	1288.2
170°	1303.9	1298.1	1299.0	1306.9	1297.1
172.5°	1309.8	1303.9	1304.9	1312.8	1302.0
175°	1313.8	1307.9	1308.9	1317.7	1305.9
177.5°	1316.7	1309.8	1311.8	1319.7	1307.9
180°	1313.8	1313.8	1313.8	1313.8	1313.8

(END OF REPORT)