

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1025063

Luminaire Tested: S124DIP-B1195D1035UB40-4F0-XX-W2A-F1

Issue Date: 5/6/2025

Test Information

Test Method: LM-79-2019
Report Number: P1025063
REPORT IS A COMBINATION OF REPORTS P995468 AND P1007351
Test Lab: INNOVATION CENTER
Issue Date: 5/6/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S124DIP-B1195D1035UB40-4F0-XX-W2A-F1
Description: Define 4 Direct/Indirect Pendant with 4000K BioUP LEDs {m-DER=0.865} {m-EER=0.951}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8625.0 lumens
Efficiency: N/A
Efficacy: 96.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.17 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 0.33' x L: 4' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 89.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1025063

CATALOG NUMBER: S124DIP-B1195D1035UB40-4F0-XX-W2A-F1

Luminous Intensity Polar Plot

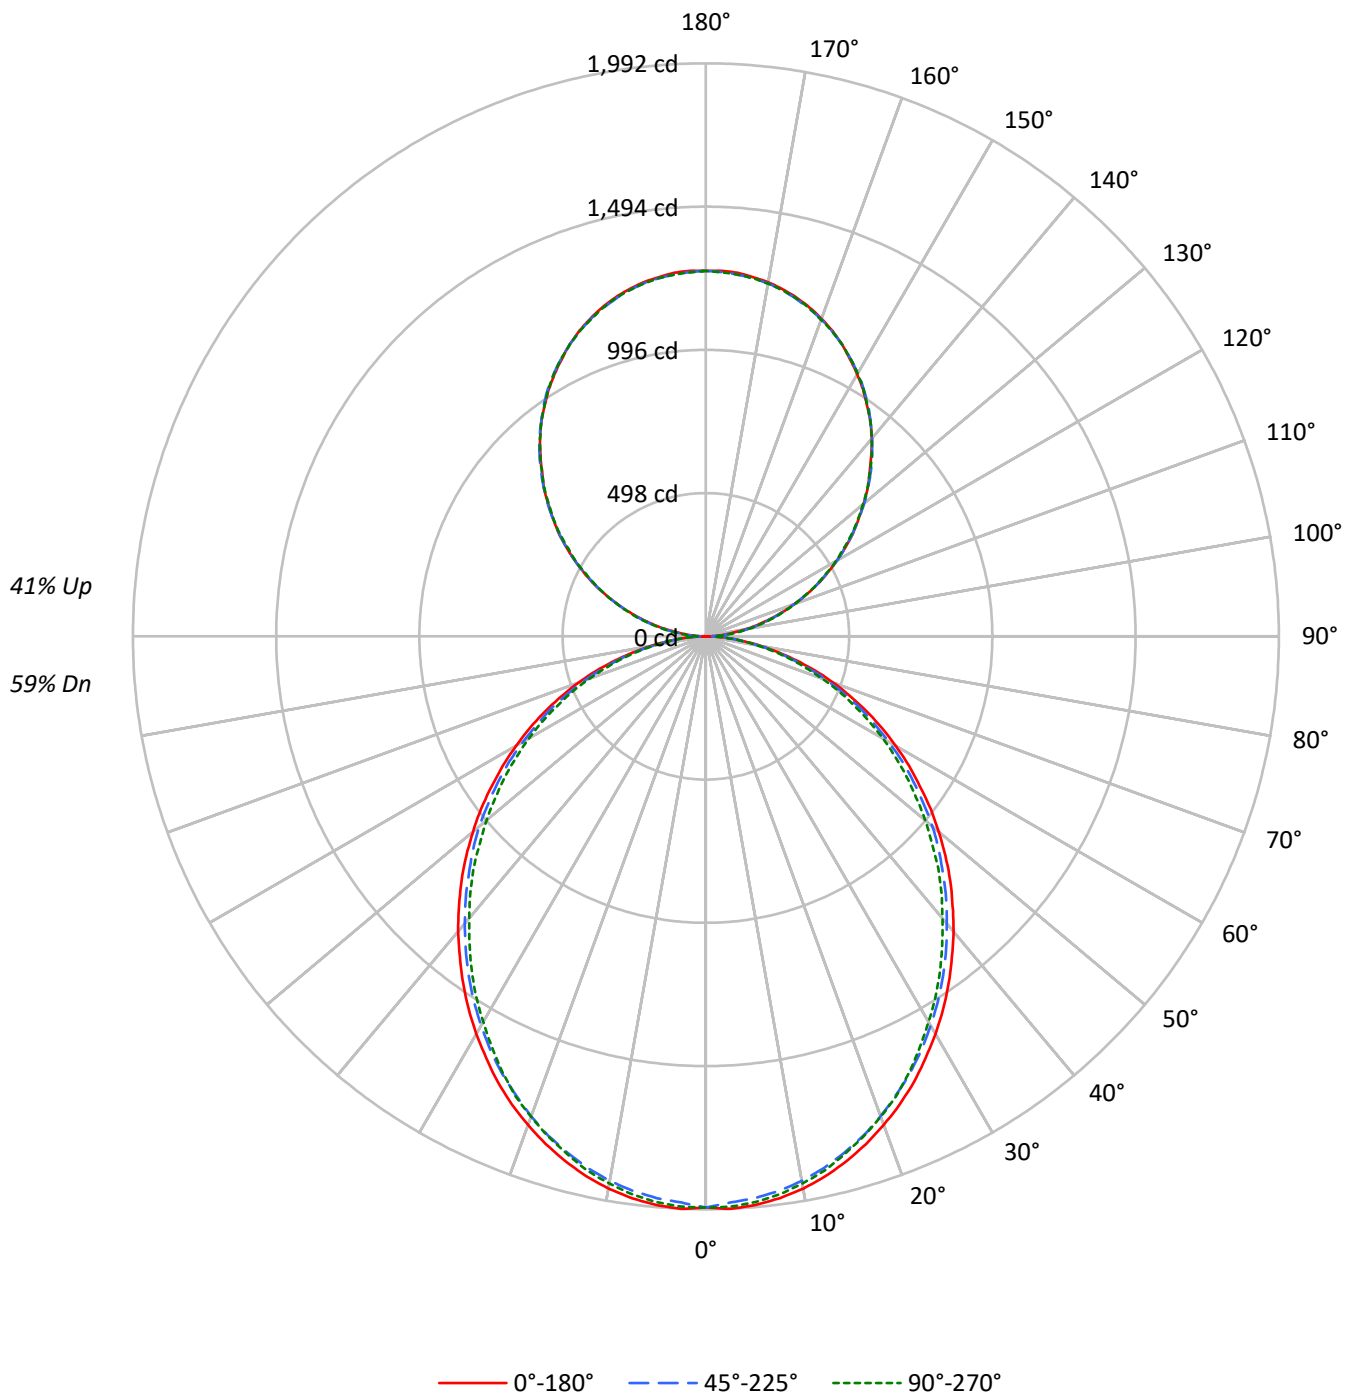

TEST NUMBER: P1025063

CATALOG NUMBER: S124DIP-B1195D1035UB40-4F0-XX-W2A-F1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	65	65	65
1	100	95	91	88	93	89	86	83	78	75	73	67	65	63	57	56	54
2	91	83	77	72	85	78	72	68	68	64	60	59	56	53	50	48	46
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	44	41	39
4	76	65	57	51	71	61	54	48	53	48	43	46	42	38	40	36	34
5	70	58	50	43	65	54	47	41	48	42	37	42	37	33	36	32	29
6	64	52	44	38	60	49	41	36	43	37	33	38	33	29	32	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	30	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	27	23	27	23	21
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	16193	16193	16193
5°	16206	15728	15747
10°	16069	15291	15184
15°	15839	14772	14549
20°	15545	14210	13892
25°	15213	13617	13184
30°	14814	12976	12407
35°	14400	12318	11656
40°	13969	11612	10857
45°	13517	10904	10111
50°	13016	10216	9284
55°	12472	9414	8463
60°	11915	8534	7608
65°	11277	7627	6644
70°	10544	6534	5610
75°	9446	5267	4493
80°	8049	3809	3161
85°	6251	2119	1702

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 13517 cd/sqm

TEST NUMBER: P1025063

CATALOG NUMBER: S124DIP-B1195D1035UB40-4F0-XX-W2A-F1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	187.2	2.2
10°-20°	527.3	6.1
20°-30°	776.1	9.0
30°-40°	902.1	10.5
40°-50°	902.1	10.5
50°-60°	789.0	9.1
60°-70°	585.7	6.8
70°-80°	332.3	3.9
80°-90°	97.9	1.1
90°-100°	82.8	1.0
100°-110°	248.1	2.9
110°-120°	421.4	4.9
120°-130°	555.8	6.4
130°-140°	624.2	7.2
140°-150°	613.5	7.1
150°-160°	516.0	6.0
160°-170°	343.3	4.0
170°-180°	120.2	1.4
0°-30°	1490.6	17.3
0°-40°	2392.7	27.7
0°-60°	4083.7	47.3
0°-90°	5099.7	59.1
90°-120°	752.3	8.7
90°-150°	2545.8	29.5
90°-180°	3525.0	40.9
0°-180°	8625.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1986	1986	1986	1986	1986	
5°	1984	1978	1960	1978	1975	188
15°	1889	1882	1858	1868	1863	532
25°	1710	1699	1677	1679	1672	787
35°	1472	1461	1438	1427	1419	920
45°	1201	1190	1165	1147	1142	926
55°	909	904	882	862	853	814
65°	616	608	592	576	568	609
75°	328	320	312	306	304	348
85°	86	86	83	83	81	92
90°	3	14	22	28	30	10
95°	59	68	75	78	78	64
105°	229	230	234	237	240	243
115°	428	428	426	426	424	423
125°	624	624	623	621	619	556
135°	805	811	811	809	806	623
145°	978	982	983	982	979	612
155°	1120	1120	1119	1123	1119	516
165°	1219	1216	1214	1220	1216	344
175°	1269	1264	1263	1270	1263	120
180°	1270	1270	1270	1270	1270	

TEST NUMBER: P1025063

CATALOG NUMBER: S124DIP-B1195D1035UB40-4F0-XX-W2A-F1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1985.8	1985.8	1985.8	1985.8	1985.8
2.5°	1992.2	1987.4	1969.9	1985.8	1984.2
5°	1984.2	1977.9	1960.4	1977.9	1974.7
7.5°	1969.9	1963.5	1944.5	1958.8	1957.2
10°	1949.2	1942.9	1922.2	1934.9	1931.7
12.5°	1922.2	1915.8	1893.5	1907.9	1903.1
15°	1888.8	1882.4	1858.5	1868.1	1863.3
17.5°	1850.6	1842.6	1820.3	1826.7	1823.5
20°	1807.6	1799.7	1775.8	1780.6	1777.4
22.5°	1761.5	1750.3	1726.5	1736.0	1729.6
25°	1710.5	1699.4	1677.1	1678.7	1672.4
27.5°	1653.3	1642.1	1621.4	1618.3	1610.3
30°	1596.0	1583.2	1562.6	1556.2	1548.2
32.5°	1535.5	1524.4	1502.1	1494.1	1486.2
35°	1471.9	1460.7	1438.4	1427.3	1419.4
37.5°	1405.0	1395.5	1371.6	1360.5	1349.3
40°	1339.8	1327.1	1303.2	1287.3	1279.3
42.5°	1269.8	1263.4	1236.4	1217.3	1212.5
45°	1201.4	1190.2	1164.8	1147.3	1142.5
47.5°	1129.8	1121.8	1097.9	1078.8	1066.1
50°	1056.6	1050.2	1027.9	1005.6	996.1
52.5°	985.0	977.0	953.1	934.0	921.3
55°	908.6	903.8	881.5	862.4	852.9
57.5°	837.0	832.2	809.9	790.8	781.3
60°	762.2	754.2	733.5	719.2	711.3
62.5°	689.0	682.6	660.3	647.6	639.7
65°	615.8	607.8	591.9	576.0	568.1
67.5°	541.0	534.6	518.7	502.8	501.2
70°	472.6	461.4	448.7	436.0	431.2
72.5°	399.4	388.3	378.7	369.2	364.4
75°	327.8	319.8	311.9	305.5	303.9
77.5°	257.8	254.6	246.6	245.0	240.3
80°	195.7	190.9	187.8	184.6	183.0
82.5°	135.3	133.7	133.7	132.1	130.5
85°	85.9	85.9	82.7	82.7	81.2
87.5°	41.4	39.8	38.2	38.2	38.2
90°	2.9	13.8	21.6	27.5	29.5
92.5°	25.5	38.3	43.2	46.2	47.2
95°	59.0	67.8	74.7	77.6	77.6
97.5°	94.3	102.2	110.1	114.0	114.0
100°	137.6	141.5	150.3	152.3	152.3
102.5°	182.8	183.8	191.6	194.6	195.5
105°	229.0	229.9	233.9	236.8	239.8
107.5°	277.1	278.1	279.1	283.0	282.0
110°	326.2	328.2	327.2	325.3	328.2

TEST NUMBER: P1025063

CATALOG NUMBER: S124DIP-B1195D1035UB40-4F0-XX-W2A-F1

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	377.3	377.3	375.4	375.4	375.4
115°	428.4	428.4	426.5	425.5	424.5
117.5°	476.6	476.6	475.6	472.6	469.7
120°	524.7	528.7	525.7	520.8	522.8
122.5°	574.8	575.8	574.8	571.9	567.0
125°	624.0	624.0	623.0	621.0	619.1
127.5°	668.2	671.1	669.2	667.2	666.2
130°	715.4	718.3	718.3	716.3	712.4
132.5°	763.5	765.5	764.5	762.5	761.5
135°	804.8	810.7	810.7	808.7	805.8
137.5°	851.0	853.9	855.9	852.9	853.9
140°	897.1	899.1	899.1	898.1	897.1
142.5°	939.4	941.4	940.4	940.4	940.4
145°	977.7	981.6	982.6	981.6	978.7
147.5°	1017.0	1021.9	1021.0	1020.0	1019.0
150°	1052.4	1056.3	1056.3	1056.3	1055.3
152.5°	1085.8	1087.8	1088.8	1091.7	1088.8
155°	1120.2	1120.2	1119.2	1123.1	1119.2
157.5°	1149.7	1147.7	1147.7	1150.7	1147.7
160°	1175.2	1174.2	1173.3	1176.2	1171.3
162.5°	1198.8	1195.9	1194.9	1200.8	1195.9
165°	1219.4	1216.5	1214.5	1220.4	1216.5
167.5°	1236.1	1232.2	1232.2	1238.1	1232.2
170°	1249.9	1245.0	1246.0	1251.9	1245.0
172.5°	1259.7	1255.8	1255.8	1262.7	1255.8
175°	1268.6	1263.7	1262.7	1269.6	1262.7
177.5°	1272.5	1267.6	1267.6	1274.5	1266.6
180°	1270.5	1270.5	1270.5	1270.5	1270.5

(END OF REPORT)