

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1025225

Luminaire Tested: S124DIP-B1195D810UB30-4F0-XX-W2A-F1

Issue Date: 5/7/2025

Test Information

Test Method: LM-79-2019
Report Number: P1025225
REPORT IS A COMBINATION OF REPORTS P995690 AND P1007351
Test Lab: INNOVATION CENTER
Issue Date: 5/7/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S124DIP-B1195D810UB30-4F0-XX-W2A-F1
Description: Define 4 Direct/Indirect Pendant with 3000K BioUP LEDs {m-DER=0.589} {m-EER=0.647}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7867.0 lumens
Efficiency: N/A
Efficacy: 95.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.17 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 0.33' x L: 4' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 82.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1025225

CATALOG NUMBER: S124DIP-B1195D810UB30-4F0-XX-W2A-F1

Luminous Intensity Polar Plot

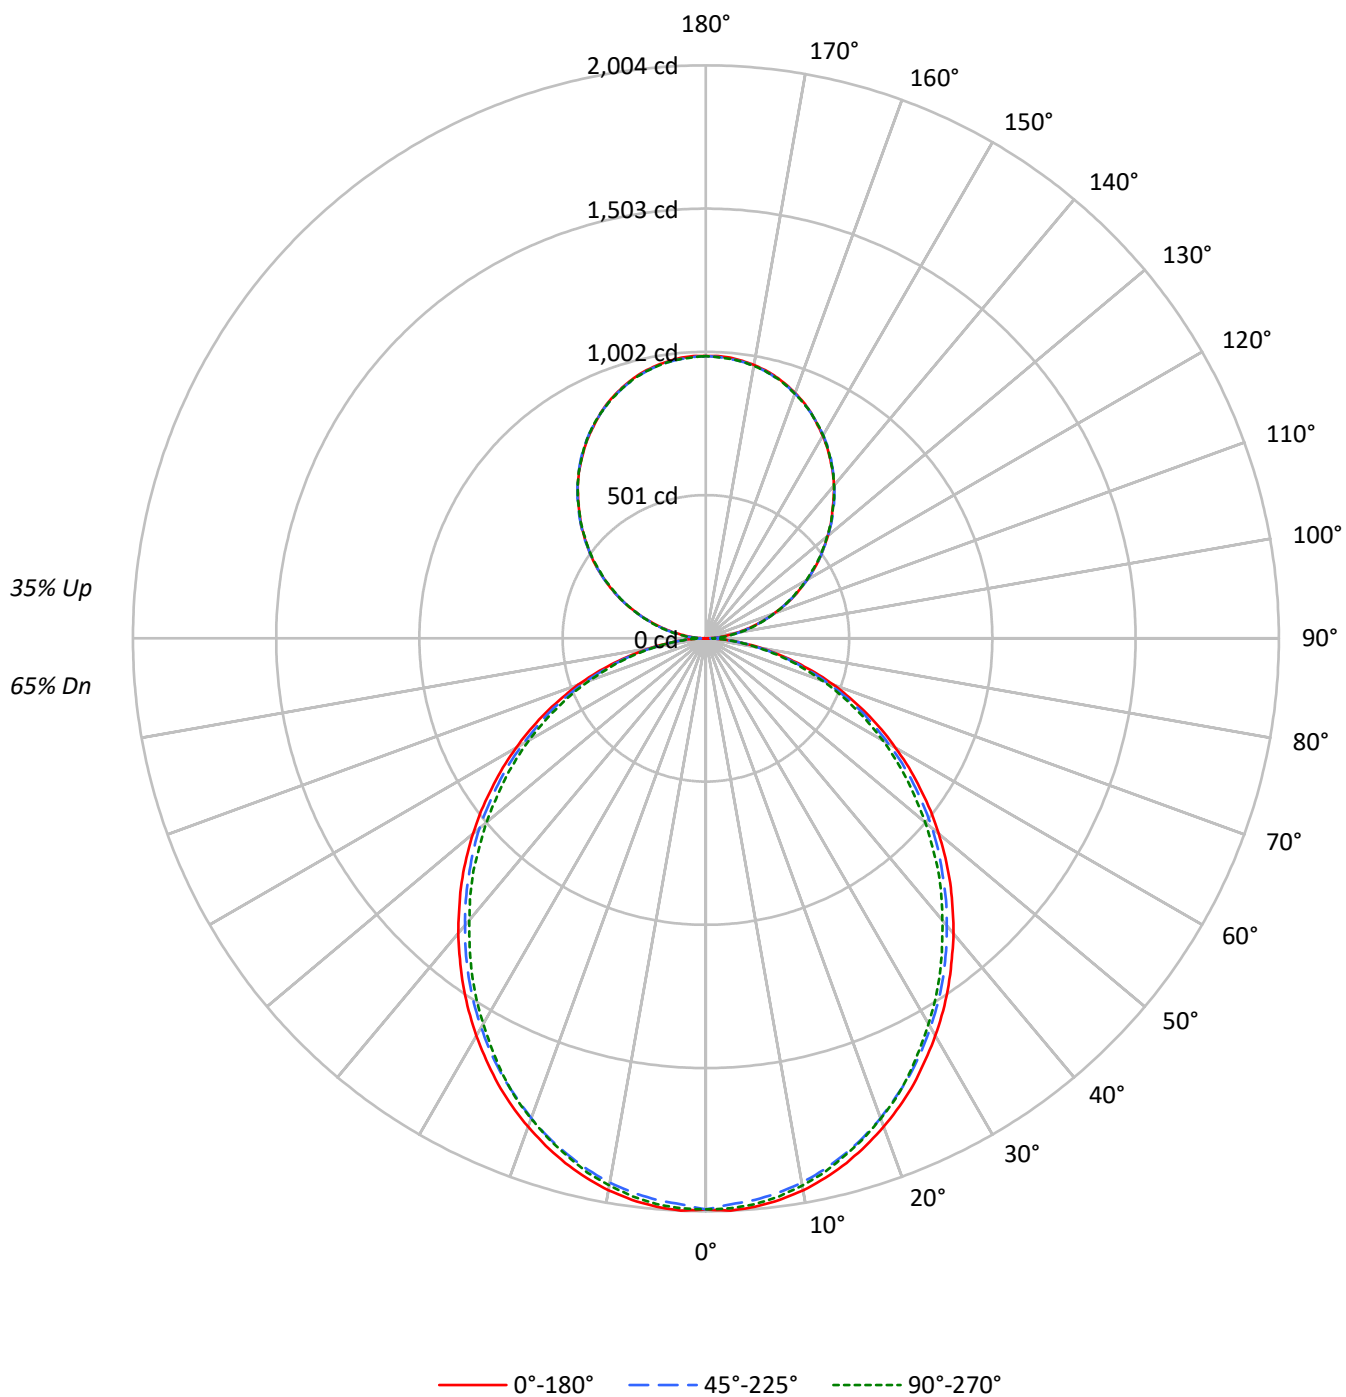

TEST NUMBER: P1025225

CATALOG NUMBER: S124DIP-B1195D810UB30-4F0-XX-W2A-F1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	80	80	80	70	70	70
1	101	97	93	89	95	91	88	84	81	78	75	71	69	67	62	60	59
2	92	84	78	73	86	80	74	69	71	66	62	62	59	56	54	52	50
3	84	74	67	61	79	70	63	58	62	57	53	55	51	47	48	45	42
4	77	66	58	51	72	62	55	49	55	50	45	49	44	41	43	40	37
5	71	59	50	44	66	56	48	42	50	43	39	44	39	35	39	35	32
6	65	53	44	38	61	50	42	37	45	39	34	40	35	31	35	31	28
7	60	48	40	34	57	45	38	33	41	34	30	36	31	27	32	28	25
8	56	43	35	30	53	41	34	29	37	31	27	33	28	25	30	26	22
9	52	40	32	27	49	38	31	26	34	28	24	31	26	22	27	23	20
10	49	37	29	24	46	35	28	23	32	26	22	28	24	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	16285	16285	16285
5°	16299	15817	15836
10°	16161	15378	15270
15°	15929	14856	14632
20°	15633	14291	13971
25°	15300	13695	13259
30°	14899	13050	12478
35°	14482	12389	11722
40°	14048	11678	10919
45°	13593	10965	10169
50°	13090	10275	9337
55°	12542	9467	8511
60°	11982	8583	7650
65°	11341	7671	6681
70°	10604	6572	5643
75°	9501	5298	4518
80°	8094	3829	3178
85°	6287	2132	1710

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 13593 cd/sqm

TEST NUMBER: P1025225

CATALOG NUMBER: S124DIP-B1195D810UB30-4F0-XX-W2A-F1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	188.2	2.4
10°-20°	530.3	6.7
20°-30°	780.5	9.9
30°-40°	907.3	11.5
40°-50°	907.2	11.5
50°-60°	793.4	10.1
60°-70°	589.1	7.5
70°-80°	334.2	4.2
80°-90°	97.8	1.2
90°-100°	64.3	0.8
100°-110°	192.7	2.4
110°-120°	327.4	4.2
120°-130°	431.8	5.5
130°-140°	485.0	6.2
140°-150°	476.7	6.1
150°-160°	400.9	5.1
160°-170°	266.7	3.4
170°-180°	93.4	1.2
0°-30°	1499.1	19.1
0°-40°	2406.3	30.6
0°-60°	4107.0	52.2
0°-90°	5128.1	65.2
90°-120°	584.5	7.4
90°-150°	1977.9	25.1
90°-180°	2739.0	34.8
0°-180°	7867.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1997	1997	1997	1997	1997	
5°	1996	1989	1972	1989	1986	189
15°	1900	1893	1869	1879	1874	535
25°	1720	1709	1687	1688	1682	792
35°	1480	1469	1447	1435	1427	926
45°	1208	1197	1171	1154	1149	931
55°	914	909	886	867	858	818
65°	619	611	595	579	571	613
75°	330	322	314	307	306	350
85°	86	86	83	83	82	93
90°	2	11	17	21	23	9
95°	46	53	58	60	60	50
105°	178	179	182	184	186	189
115°	333	333	331	331	330	328
125°	485	485	484	482	481	432
135°	625	630	630	628	626	484
145°	760	763	763	763	760	475
155°	870	870	870	873	870	401
165°	947	945	944	948	945	267
175°	986	982	981	986	981	94
180°	987	987	987	987	987	

TEST NUMBER: P1025225

CATALOG NUMBER: S124DIP-B1195D810UB30-4F0-XX-W2A-F1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1997.1	1997.1	1997.1	1997.1	1997.1
2.5°	2003.5	1998.7	1981.1	1997.1	1995.5
5°	1995.5	1989.1	1971.5	1989.1	1985.9
7.5°	1981.1	1974.7	1955.5	1969.9	1968.3
10°	1960.3	1953.9	1933.1	1945.9	1942.7
12.5°	1933.1	1926.7	1904.3	1918.7	1913.9
15°	1899.5	1893.1	1869.1	1878.7	1873.9
17.5°	1861.1	1853.1	1830.7	1837.1	1833.9
20°	1817.9	1809.9	1785.9	1790.7	1787.5
22.5°	1771.5	1760.3	1736.3	1745.9	1739.5
25°	1720.3	1709.1	1686.7	1688.3	1681.9
27.5°	1662.7	1651.5	1630.7	1627.5	1619.5
30°	1605.1	1592.3	1571.5	1565.1	1557.1
32.5°	1544.2	1533.0	1510.6	1502.6	1494.6
35°	1480.2	1469.0	1446.6	1435.4	1427.4
37.5°	1413.0	1403.4	1379.4	1368.2	1357.0
40°	1347.4	1334.6	1310.6	1294.6	1286.6
42.5°	1277.0	1270.6	1243.4	1224.2	1219.4
45°	1208.2	1197.0	1171.4	1153.8	1149.0
47.5°	1136.2	1128.2	1104.2	1085.0	1072.2
50°	1062.6	1056.2	1033.8	1011.4	1001.8
52.5°	990.6	982.6	958.6	939.4	926.5
55°	913.7	908.9	886.5	867.3	857.7
57.5°	841.7	836.9	814.5	795.3	785.7
60°	766.5	758.5	737.7	723.3	715.3
62.5°	692.9	686.5	664.1	651.3	643.3
65°	619.3	611.3	595.3	579.3	571.3
67.5°	544.1	537.7	521.7	505.7	504.1
70°	475.3	464.1	451.3	438.5	433.7
72.5°	401.7	390.5	380.9	371.3	366.5
75°	329.7	321.7	313.7	307.2	305.6
77.5°	259.2	256.0	248.0	246.4	241.6
80°	196.8	192.0	188.8	185.6	184.0
82.5°	136.0	134.4	134.4	132.8	131.2
85°	86.4	86.4	83.2	83.2	81.6
87.5°	41.6	40.0	38.4	38.4	38.4
90°	2.3	10.7	16.8	21.4	22.9
92.5°	19.8	29.8	33.6	35.9	36.6
95°	45.8	52.7	58.0	60.3	60.3
97.5°	73.3	79.4	85.5	88.6	88.6
100°	106.9	109.9	116.8	118.3	118.3
102.5°	142.0	142.8	148.9	151.2	151.9
105°	177.9	178.6	181.7	184.0	186.3
107.5°	215.3	216.1	216.8	219.9	219.1
110°	253.5	255.0	254.2	252.7	255.0

TEST NUMBER: P1025225

CATALOG NUMBER: S124DIP-B1195D810UB30-4F0-XX-W2A-F1

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	293.2	293.2	291.6	291.6	291.6
115°	332.9	332.9	331.3	330.6	329.8
117.5°	370.3	370.3	369.5	367.2	364.9
120°	407.7	410.7	408.4	404.6	406.1
122.5°	446.6	447.4	446.6	444.3	440.5
125°	484.8	484.8	484.0	482.5	481.0
127.5°	519.1	521.4	519.9	518.4	517.6
130°	555.8	558.1	558.1	556.5	553.5
132.5°	593.2	594.7	594.0	592.4	591.7
135°	625.3	629.8	629.8	628.3	626.0
137.5°	661.1	663.4	664.9	662.7	663.4
140°	697.0	698.5	698.5	697.8	697.0
142.5°	729.8	731.4	730.6	730.6	730.6
145°	759.6	762.7	763.4	762.7	760.4
147.5°	790.2	794.0	793.2	792.4	791.7
150°	817.6	820.7	820.7	820.7	819.9
152.5°	843.6	845.1	845.9	848.2	845.9
155°	870.3	870.3	869.5	872.6	869.5
157.5°	893.2	891.7	891.7	894.0	891.7
160°	913.1	912.3	911.5	913.8	910.0
162.5°	931.4	929.1	928.3	932.9	929.1
165°	947.4	945.1	943.6	948.2	945.1
167.5°	960.4	957.3	957.3	961.9	957.3
170°	971.1	967.3	968.0	972.6	967.3
172.5°	978.7	975.7	975.7	981.0	975.7
175°	985.6	981.8	981.0	986.4	981.0
177.5°	988.6	984.8	984.8	990.2	984.1
180°	987.1	987.1	987.1	987.1	987.1

(END OF REPORT)