

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1025242

Luminaire Tested: S124DIP-B1195D810UB40-4F0-XX-W2A-F

Issue Date: 5/6/2025

Test Information

Test Method: LM-79-2019
Report Number: P1025242
REPORT IS A COMBINATION OF REPORTS P995707 AND P1007351
Test Lab: INNOVATION CENTER
Issue Date: 5/6/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S124DIP-B1195D810UB40-4F0-XX-W2A-F
Description: Define 4 Direct/Indirect Pendant with 4000K BioUP LEDs {m-DER=0.865} {m-EER=0.951}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8240.0 lumens
Efficiency: N/A
Efficacy: 100.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.17 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 0.33' x L: 4' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 82.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1025242

CATALOG NUMBER: S124DIP-B1195D810UB40-4F0-XX-W2A-F

Luminous Intensity Polar Plot

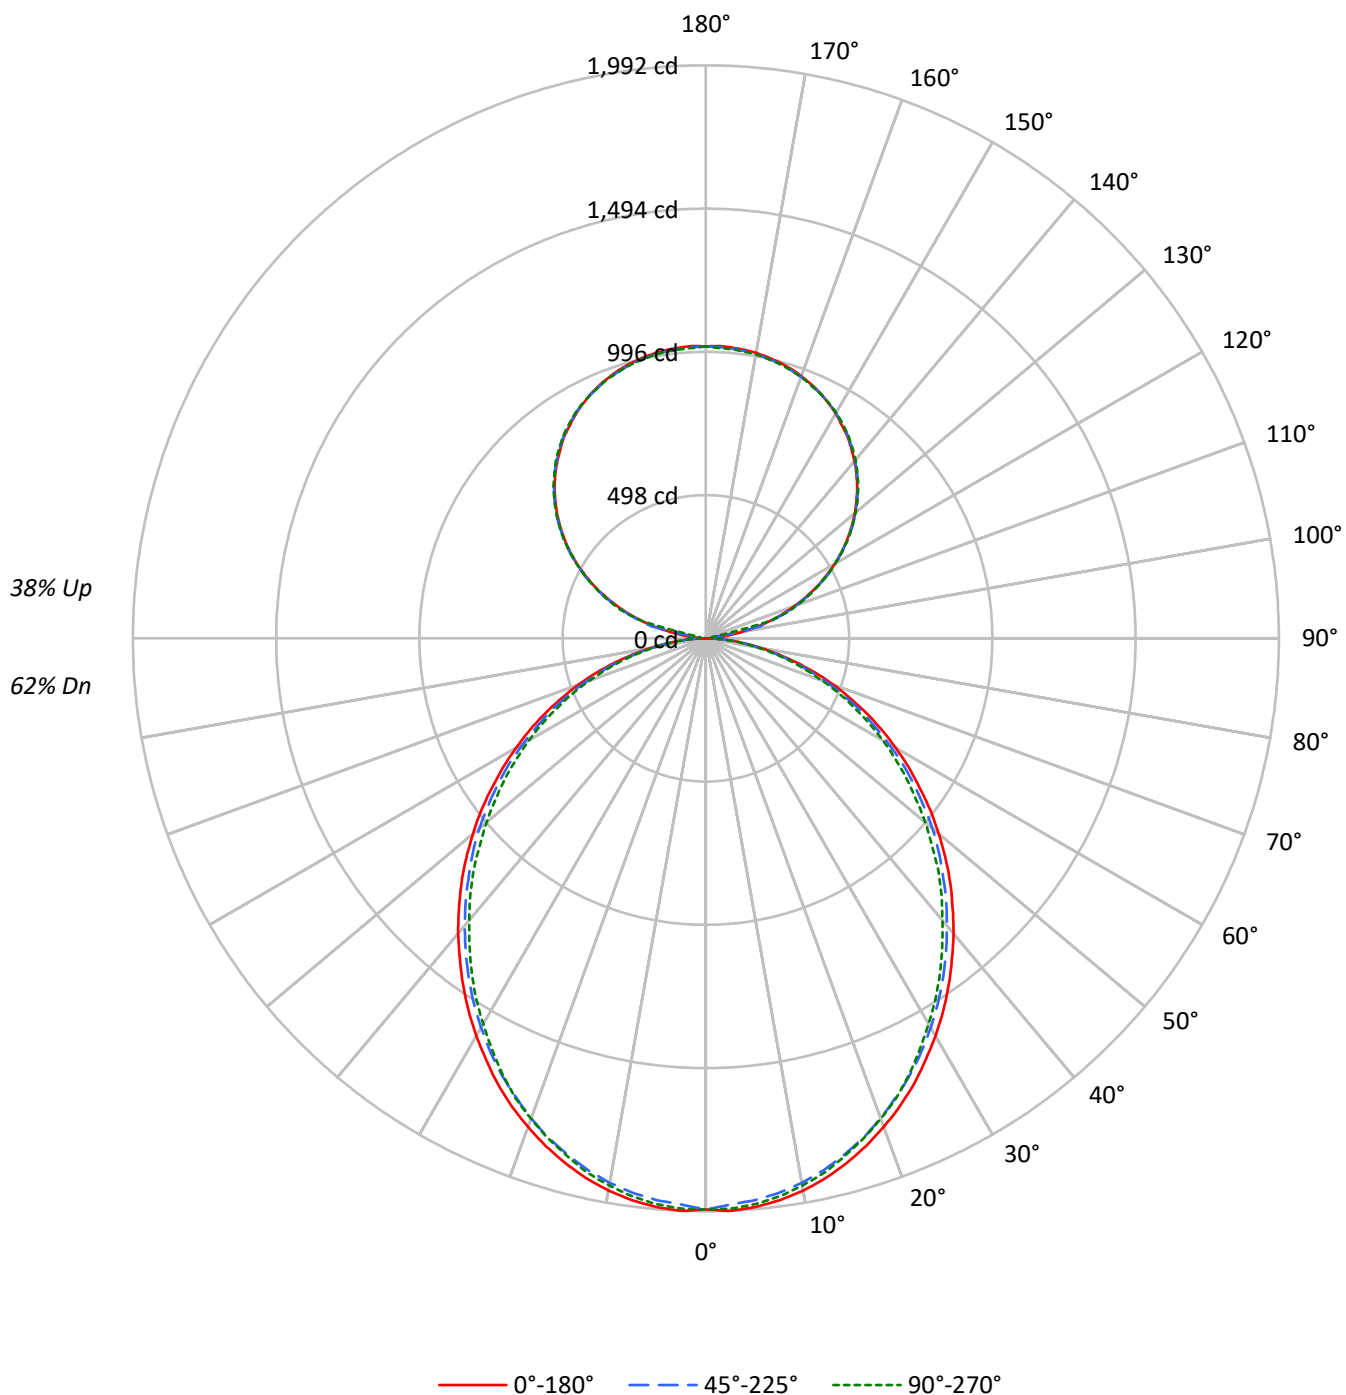

TEST NUMBER: P1025242

CATALOG NUMBER: S124DIP-B1195D810UB40-4F0-XX-W2A-F

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	78	78	78	67	67	67
1	100	96	92	88	94	90	87	83	79	76	74	69	67	65	59	58	57
2	91	84	78	72	85	79	73	68	69	65	61	60	57	54	52	50	48
3	83	74	66	60	78	69	63	57	61	56	51	53	49	46	46	43	41
4	76	65	57	51	71	61	54	49	54	48	44	48	43	39	41	38	35
5	70	58	50	44	65	55	47	42	49	43	38	43	38	34	37	33	30
6	65	52	44	38	60	49	42	36	44	38	33	39	34	30	34	30	27
7	60	47	39	33	56	45	37	32	40	34	29	35	30	27	31	27	24
8	56	43	35	30	52	41	34	28	36	30	26	32	27	24	28	24	21
9	52	39	32	27	49	37	30	26	33	28	23	30	25	21	26	22	19
10	48	36	29	24	45	34	28	23	31	25	21	27	23	19	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	16193	16193	16193
5°	16206	15728	15747
10°	16069	15291	15184
15°	15839	14772	14549
20°	15545	14210	13892
25°	15213	13617	13184
30°	14814	12976	12407
35°	14400	12318	11656
40°	13969	11612	10857
45°	13517	10904	10111
50°	13016	10216	9284
55°	12472	9414	8463
60°	11915	8534	7608
65°	11277	7627	6644
70°	10544	6534	5610
75°	9446	5267	4493
80°	8049	3809	3161
85°	6251	2119	1702

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 13517 cd/sqm

TEST NUMBER: P1025242

CATALOG NUMBER: S124DIP-B1195D810UB40-4F0-XX-W2A-F

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	187.2	2.3
10°-20°	527.3	6.4
20°-30°	776.1	9.4
30°-40°	902.1	10.9
40°-50°	902.1	10.9
50°-60°	789.0	9.6
60°-70°	585.7	7.1
70°-80°	332.3	4.0
80°-90°	97.3	1.2
90°-100°	33.7	0.4
100°-110°	221.9	2.7
110°-120°	423.7	5.1
120°-130°	537.9	6.5
130°-140°	575.4	7.0
140°-150°	538.1	6.5
150°-160°	433.9	5.3
160°-170°	279.8	3.4
170°-180°	96.4	1.2
0°-30°	1490.6	18.1
0°-40°	2392.7	29.0
0°-60°	4083.7	49.6
0°-90°	5099.1	61.9
90°-120°	679.3	8.2
90°-150°	2330.7	28.3
90°-180°	3141.0	38.1
0°-180°	8240.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1986	1986	1986	1986	1986	
5°	1984	1978	1960	1978	1975	188
15°	1889	1882	1858	1868	1863	532
25°	1710	1699	1677	1679	1672	787
35°	1472	1461	1438	1427	1419	920
45°	1201	1190	1165	1147	1142	926
55°	909	904	882	862	853	814
65°	616	608	592	576	568	609
75°	328	320	312	306	304	348
85°	86	86	83	83	81	92
90°	2	11	17	21	23	8
95°	42	16	17	21	22	51
105°	228	233	237	244	216	239
115°	427	429	428	430	430	420
125°	600	603	601	604	604	536
135°	744	743	746	748	749	573
145°	858	860	860	861	862	536
155°	941	941	939	942	940	434
165°	992	988	988	994	988	280
175°	1015	1010	1011	1018	1009	97
180°	1015	1015	1015	1015	1015	

TEST NUMBER: P1025242

CATALOG NUMBER: S124DIP-B1195D810UB40-4F0-XX-W2A-F

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1985.8	1985.8	1985.8	1985.8	1985.8
2.5°	1992.2	1987.4	1969.9	1985.8	1984.2
5°	1984.2	1977.9	1960.4	1977.9	1974.7
7.5°	1969.9	1963.5	1944.5	1958.8	1957.2
10°	1949.2	1942.9	1922.2	1934.9	1931.7
12.5°	1922.2	1915.8	1893.5	1907.9	1903.1
15°	1888.8	1882.4	1858.5	1868.1	1863.3
17.5°	1850.6	1842.6	1820.3	1826.7	1823.5
20°	1807.6	1799.7	1775.8	1780.6	1777.4
22.5°	1761.5	1750.3	1726.5	1736.0	1729.6
25°	1710.5	1699.4	1677.1	1678.7	1672.4
27.5°	1653.3	1642.1	1621.4	1618.3	1610.3
30°	1596.0	1583.2	1562.6	1556.2	1548.2
32.5°	1535.5	1524.4	1502.1	1494.1	1486.2
35°	1471.9	1460.7	1438.4	1427.3	1419.4
37.5°	1405.0	1395.5	1371.6	1360.5	1349.3
40°	1339.8	1327.1	1303.2	1287.3	1279.3
42.5°	1269.8	1263.4	1236.4	1217.3	1212.5
45°	1201.4	1190.2	1164.8	1147.3	1142.5
47.5°	1129.8	1121.8	1097.9	1078.8	1066.1
50°	1056.6	1050.2	1027.9	1005.6	996.1
52.5°	985.0	977.0	953.1	934.0	921.3
55°	908.6	903.8	881.5	862.4	852.9
57.5°	837.0	832.2	809.9	790.8	781.3
60°	762.2	754.2	733.5	719.2	711.3
62.5°	689.0	682.6	660.3	647.6	639.7
65°	615.8	607.8	591.9	576.0	568.1
67.5°	541.0	534.6	518.7	502.8	501.2
70°	472.6	461.4	448.7	436.0	431.2
72.5°	399.4	388.3	378.7	369.2	364.4
75°	327.8	319.8	311.9	305.5	303.9
77.5°	257.8	254.6	246.6	245.0	240.3
80°	195.7	190.9	187.8	184.6	183.0
82.5°	135.3	133.7	133.7	132.1	130.5
85°	85.9	85.9	82.7	82.7	81.2
87.5°	41.4	39.8	38.2	38.2	38.2
90°	2.3	10.6	16.7	21.3	22.8
92.5°	11.4	9.9	15.9	20.5	20.5
95°	41.8	15.9	16.7	21.3	22.0
97.5°	79.7	96.4	16.7	20.5	21.3
100°	124.5	138.2	33.4	20.5	21.3
102.5°	174.6	183.7	192.8	22.0	22.0
105°	228.5	233.1	236.9	243.7	216.4
107.5°	277.9	280.1	285.5	289.3	292.3
110°	328.0	330.2	334.8	336.3	338.6

TEST NUMBER: P1025242

CATALOG NUMBER: S124DIP-B1195D810UB40-4F0-XX-W2A-F

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	376.6	381.1	382.6	381.9	384.9
115°	426.7	428.9	428.2	429.7	429.7
117.5°	471.5	474.5	476.8	476.0	476.0
120°	517.0	520.0	519.3	520.8	519.3
122.5°	559.5	561.0	562.6	563.3	561.8
125°	599.8	602.8	601.3	603.6	604.3
127.5°	638.5	639.2	643.0	642.3	641.5
130°	675.7	676.4	678.7	679.5	679.5
132.5°	709.8	711.4	714.4	715.2	714.4
135°	744.0	743.3	746.3	747.8	749.3
137.5°	774.4	774.4	778.2	779.7	778.9
140°	804.0	805.5	807.0	809.3	810.1
142.5°	830.6	833.6	834.4	835.9	835.9
145°	857.9	860.2	860.2	860.9	862.4
147.5°	879.1	883.7	882.9	883.7	884.5
150°	902.7	905.7	905.0	905.0	905.7
152.5°	922.4	924.7	923.2	924.7	923.9
155°	940.6	941.4	939.1	942.2	939.9
157.5°	956.6	956.6	953.5	957.3	953.5
160°	970.3	968.0	967.2	971.8	967.2
162.5°	982.4	979.4	978.6	983.2	977.8
165°	992.3	988.5	988.5	994.5	987.7
167.5°	1000.6	996.8	996.1	1002.9	995.3
170°	1007.5	1002.9	1003.7	1009.7	1002.1
172.5°	1012.0	1007.5	1008.2	1014.3	1005.9
175°	1015.0	1010.5	1011.2	1018.1	1009.0
177.5°	1017.3	1012.0	1013.5	1019.6	1010.5
180°	1015.0	1015.0	1015.0	1015.0	1015.0

(END OF REPORT)