

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1026196

Luminaire Tested: S124RDIP-B1195D590UB50-4F0-XX-W2A-F

Issue Date: 5/6/2025

Test Information

Test Method: LM-79-2019
Report Number: P1026196
REPORT IS A COMBINATION OF REPORTS P999176 AND P1007351
Test Lab: INNOVATION CENTER
Issue Date: 5/6/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S124RDIP-B1195D590UB50-4F0-XX-W2A-F
Description: Define 4 Regressed Direct/Indirect Pendant with 5000K BioUP LEDs {m-DER=1.015}
{m-EER=1.115}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6919.0 lumens
Efficiency: N/A
Efficacy: 90.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.09 / 1.24
Luminous Opening: Rectangular w/ Sides (W: 0.33' x L: 4' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 76.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1026196

CATALOG NUMBER: S124RDIP-B1195D590UB50-4F0-XX-W2A-F

Luminous Intensity Polar Plot

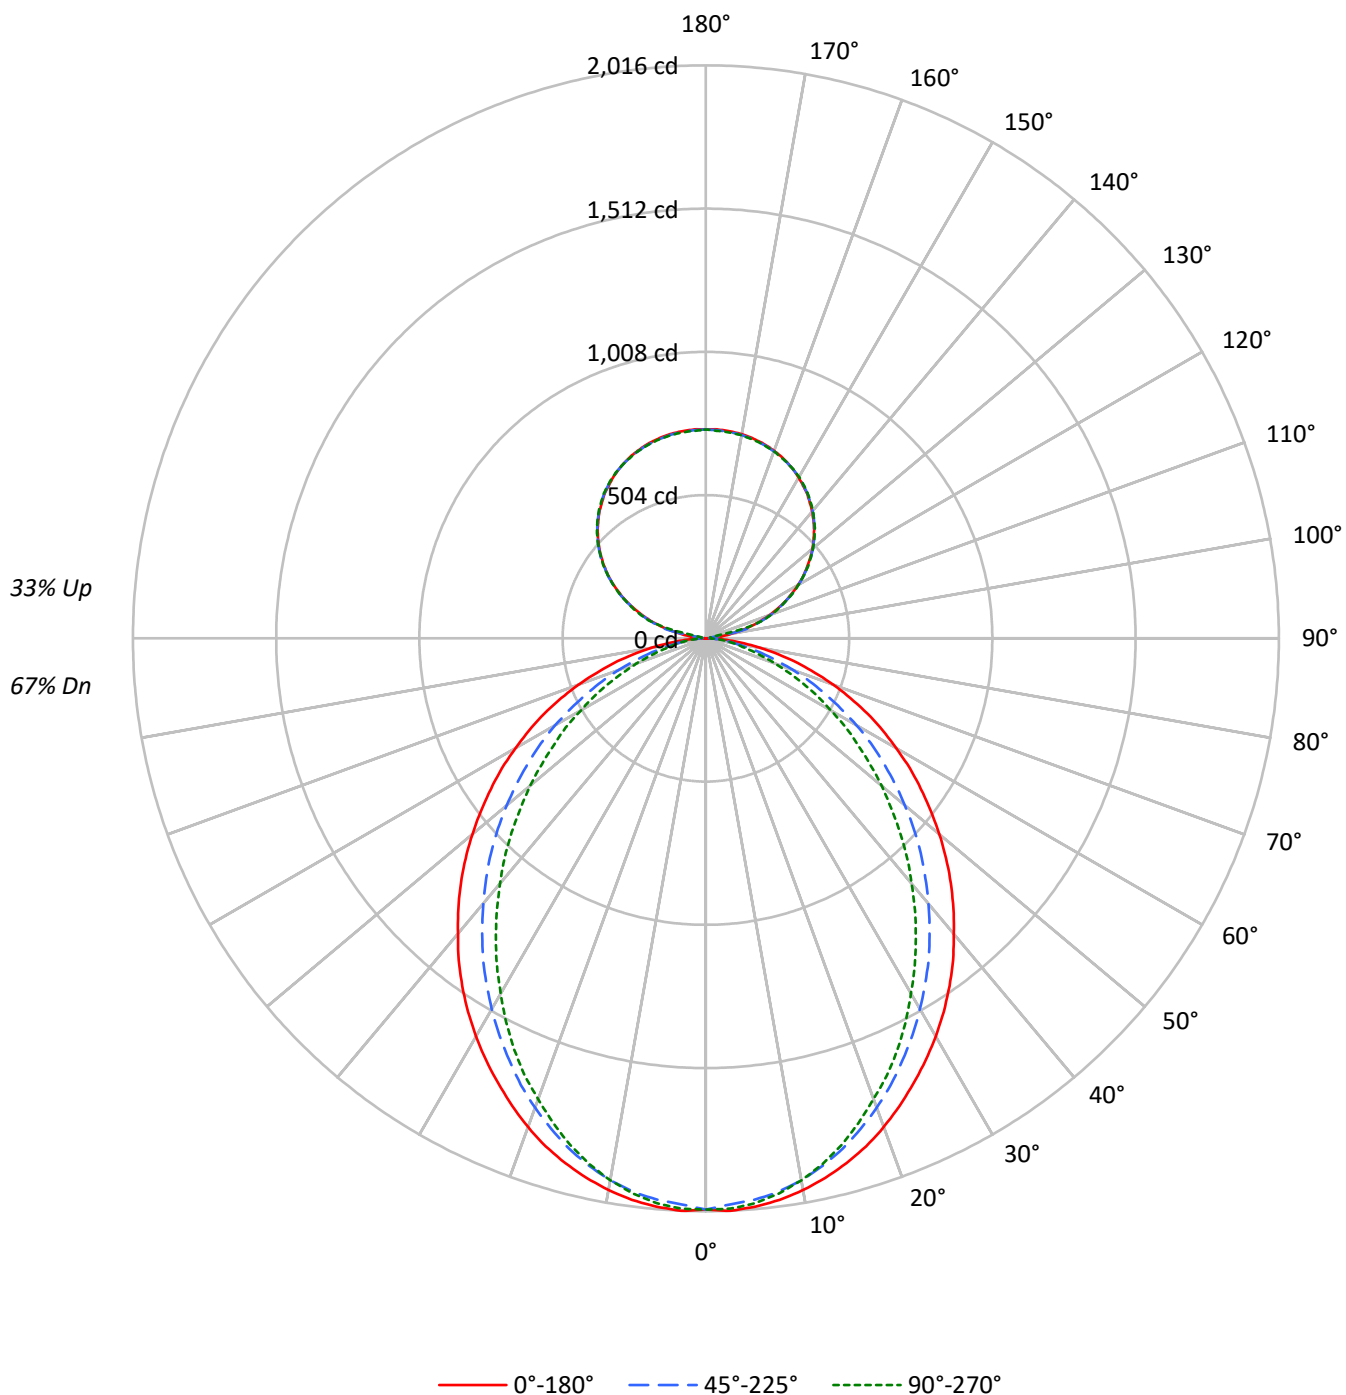

TEST NUMBER: P1026196

CATALOG NUMBER: S124RDIP-B1195D590UB50-4F0-XX-W2A-F

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	105	105	105	105	93	93	93	82	82	82	72	72	72
1	102	98	94	90	96	92	89	86	82	80	77	73	71	69	64	63	61
2	93	86	80	74	88	81	76	71	72	68	65	64	61	58	57	54	52
3	85	76	68	62	80	72	65	60	64	59	55	57	53	50	51	48	45
4	78	67	59	53	73	64	57	51	57	52	47	51	47	43	46	42	39
5	72	60	52	46	68	57	50	44	51	45	41	46	41	37	41	37	34
6	66	54	46	40	63	52	44	39	47	40	36	42	37	33	37	33	30
7	62	49	41	35	58	47	39	34	42	36	32	38	33	29	34	30	27
8	57	45	37	32	54	43	36	31	39	33	28	35	30	26	32	27	24
9	54	41	33	28	50	39	32	27	36	30	26	32	27	24	29	25	22
10	50	38	31	26	47	36	29	25	33	27	23	30	25	22	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	16390	16390	16390
5°	16391	15903	15905
10°	16252	15401	15218
15°	16029	14776	14408
20°	15735	14064	13484
25°	15370	13295	12581
30°	15013	12511	11568
35°	14620	11716	10578
40°	14151	10860	9561
45°	13713	10012	8554
50°	13213	9085	7530
55°	12675	8135	6475
60°	12077	7126	5432
65°	11499	5969	4428
70°	10677	4752	3384
75°	9625	3457	2367
80°	8037	2121	1701
85°	6047	1222	935

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 13713 cd/sqm

TEST NUMBER: P1026196

CATALOG NUMBER: S124RDIP-B1195D590UB50-4F0-XX-W2A-F

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.0	2.7
10°-20°	527.0	7.6
20°-30°	760.8	11.0
30°-40°	862.2	12.5
40°-50°	832.5	12.0
50°-60°	692.1	10.0
60°-70°	477.7	6.9
70°-80°	241.4	3.5
80°-90°	62.8	0.9
90°-100°	24.4	0.4
100°-110°	160.6	2.3
110°-120°	306.7	4.4
120°-130°	389.4	5.6
130°-140°	416.5	6.0
140°-150°	389.5	5.6
150°-160°	314.1	4.5
160°-170°	202.6	2.9
170°-180°	69.8	1.0
0°-30°	1476.7	21.3
0°-40°	2339.0	33.8
0°-60°	3863.6	55.8
0°-90°	4645.5	67.1
90°-120°	491.7	7.1
90°-150°	1687.0	24.4
90°-180°	2273.0	32.9
0°-180°	6919.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2007	2001	1982	1998	1994	190
15°	1911	1898	1859	1856	1845	539
25°	1728	1700	1637	1611	1596	796
35°	1494	1445	1368	1316	1288	934
45°	1219	1162	1070	994	966	940
55°	923	862	762	682	652	826
65°	628	562	463	397	379	620
75°	334	277	205	169	160	352
85°	83	52	48	45	45	91
90°	2	8	12	15	16	6
95°	30	12	12	15	16	37
105°	165	169	172	176	157	173
115°	309	310	310	311	311	304
125°	434	436	435	437	437	388
135°	538	538	540	541	542	415
145°	621	623	623	623	624	388
155°	681	681	680	682	680	314
165°	718	716	716	720	715	203
175°	735	731	732	737	730	70
180°	735	735	735	735	735	

TEST NUMBER: P1026196

CATALOG NUMBER: S124RDIP-B1195D590UB50-4F0-XX-W2A-F

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2009.9	2009.9	2009.9	2009.9	2009.9
2.5°	2016.0	2009.9	1992.9	2009.9	2008.3
5°	2006.8	2000.6	1982.2	1997.6	1994.5
7.5°	1992.9	1986.8	1963.7	1974.5	1969.8
10°	1971.4	1963.7	1936.0	1942.1	1936.0
12.5°	1943.7	1934.5	1900.6	1903.7	1894.4
15°	1911.4	1897.5	1859.0	1856.0	1845.2
17.5°	1874.4	1854.4	1809.8	1802.1	1786.7
20°	1829.8	1809.8	1757.5	1745.2	1725.2
22.5°	1780.6	1757.5	1700.5	1680.5	1665.1
25°	1728.2	1700.5	1637.4	1611.3	1595.9
27.5°	1674.4	1640.5	1574.3	1543.6	1522.0
30°	1617.4	1579.0	1506.6	1468.2	1443.5
32.5°	1557.4	1512.8	1437.4	1391.2	1368.1
35°	1494.3	1445.1	1368.1	1315.8	1288.1
37.5°	1428.1	1377.4	1292.7	1235.8	1208.1
40°	1357.3	1306.6	1218.8	1154.2	1126.5
42.5°	1289.6	1235.8	1143.4	1077.3	1048.0
45°	1218.8	1161.9	1069.6	994.2	966.5
47.5°	1146.5	1088.0	992.6	914.1	883.4
50°	1072.6	1012.6	914.1	837.2	807.9
52.5°	997.2	938.8	837.2	758.7	727.9
55°	923.4	861.8	761.8	681.8	652.5
57.5°	851.0	786.4	687.9	606.3	584.8
60°	772.6	711.0	612.5	532.5	507.9
62.5°	701.8	637.1	535.6	463.2	444.8
65°	627.9	561.7	463.2	397.0	378.6
67.5°	550.9	487.8	395.5	337.0	315.5
70°	478.6	414.0	326.3	275.5	260.1
72.5°	401.7	344.7	263.2	221.6	207.8
75°	334.0	277.0	204.7	169.3	160.1
77.5°	263.2	213.9	152.4	127.7	124.7
80°	195.4	150.8	104.6	100.0	98.5
82.5°	137.0	97.0	75.4	72.3	70.8
85°	83.1	52.3	47.7	44.6	44.6
87.5°	35.4	23.1	21.5	20.0	21.5
90°	1.6	7.7	12.1	15.4	16.5
92.5°	8.2	7.1	11.5	14.8	14.8
95°	30.2	11.5	12.1	15.4	15.9
97.5°	57.7	69.8	12.1	14.8	15.4
100°	90.1	100.0	24.2	14.8	15.4
102.5°	126.4	133.0	139.6	15.9	15.9
105°	165.4	168.7	171.5	176.4	156.6
107.5°	201.1	202.8	206.6	209.4	211.6
110°	237.4	239.0	242.3	243.4	245.1



TEST NUMBER: P1026196

CATALOG NUMBER: S124RDIP-B1195D590UB50-4F0-XX-W2A-F

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	272.6	275.9	277.0	276.4	278.6
115°	308.8	310.5	309.9	311.0	311.0
117.5°	341.3	343.5	345.1	344.6	344.6
120°	374.2	376.4	375.9	377.0	375.9
122.5°	405.0	406.1	407.2	407.8	406.7
125°	434.1	436.3	435.2	436.9	437.4
127.5°	462.2	462.7	465.5	464.9	464.4
130°	489.1	489.6	491.3	491.8	491.8
132.5°	513.8	514.9	517.1	517.7	517.1
135°	538.5	538.0	540.2	541.3	542.4
137.5°	560.5	560.5	563.3	564.4	563.8
140°	582.0	583.1	584.1	585.8	586.3
142.5°	601.2	603.4	603.9	605.0	605.0
145°	621.0	622.6	622.6	623.2	624.3
147.5°	636.4	639.7	639.1	639.7	640.2
150°	653.4	655.6	655.0	655.0	655.6
152.5°	667.7	669.3	668.2	669.3	668.8
155°	680.9	681.4	679.8	682.0	680.3
157.5°	692.4	692.4	690.2	693.0	690.2
160°	702.3	700.6	700.1	703.4	700.1
162.5°	711.1	708.9	708.3	711.6	707.8
165°	718.2	715.5	715.5	719.9	714.9
167.5°	724.3	721.5	721.0	725.9	720.4
170°	729.2	725.9	726.5	730.9	725.4
172.5°	732.5	729.2	729.8	734.2	728.1
175°	734.7	731.4	732.0	736.9	730.3
177.5°	736.4	732.5	733.6	738.0	731.4
180°	734.7	734.7	734.7	734.7	734.7

(END OF REPORT)