

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1007656

Luminaire Tested: S124IP-B1205UB2750-4F0-XX-W2A-1_5000K

Issue Date: 5/5/2025

Test Information

Test Method: LM-79-2019
Report Number: P1007656
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1807-864-10)
Test Lab: INNOVATION CENTER
Issue Date: 5/5/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S124IP-B1205UB2750-4F0-XX-W2A-1_5000K
Description: Define 4 Indirect Pendant with 5000K BioUP LEDs {m-DER=1.015} {m-EER=1.115}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4008.0 lumens
Efficiency: N/A
Efficacy: 114.5 lumens/watt
Spacing Criteria (0/90/45): - / - / -
Luminous Opening: Rectangular (W 0.33' x L: 4' x H: 0')
CIE Type: Indirect

Input Watts (W): 35
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1007656

CATALOG NUMBER: S124IP-B1205UB2750-4F0-XX-W2A-1_5000K

Luminous Intensity Polar Plot

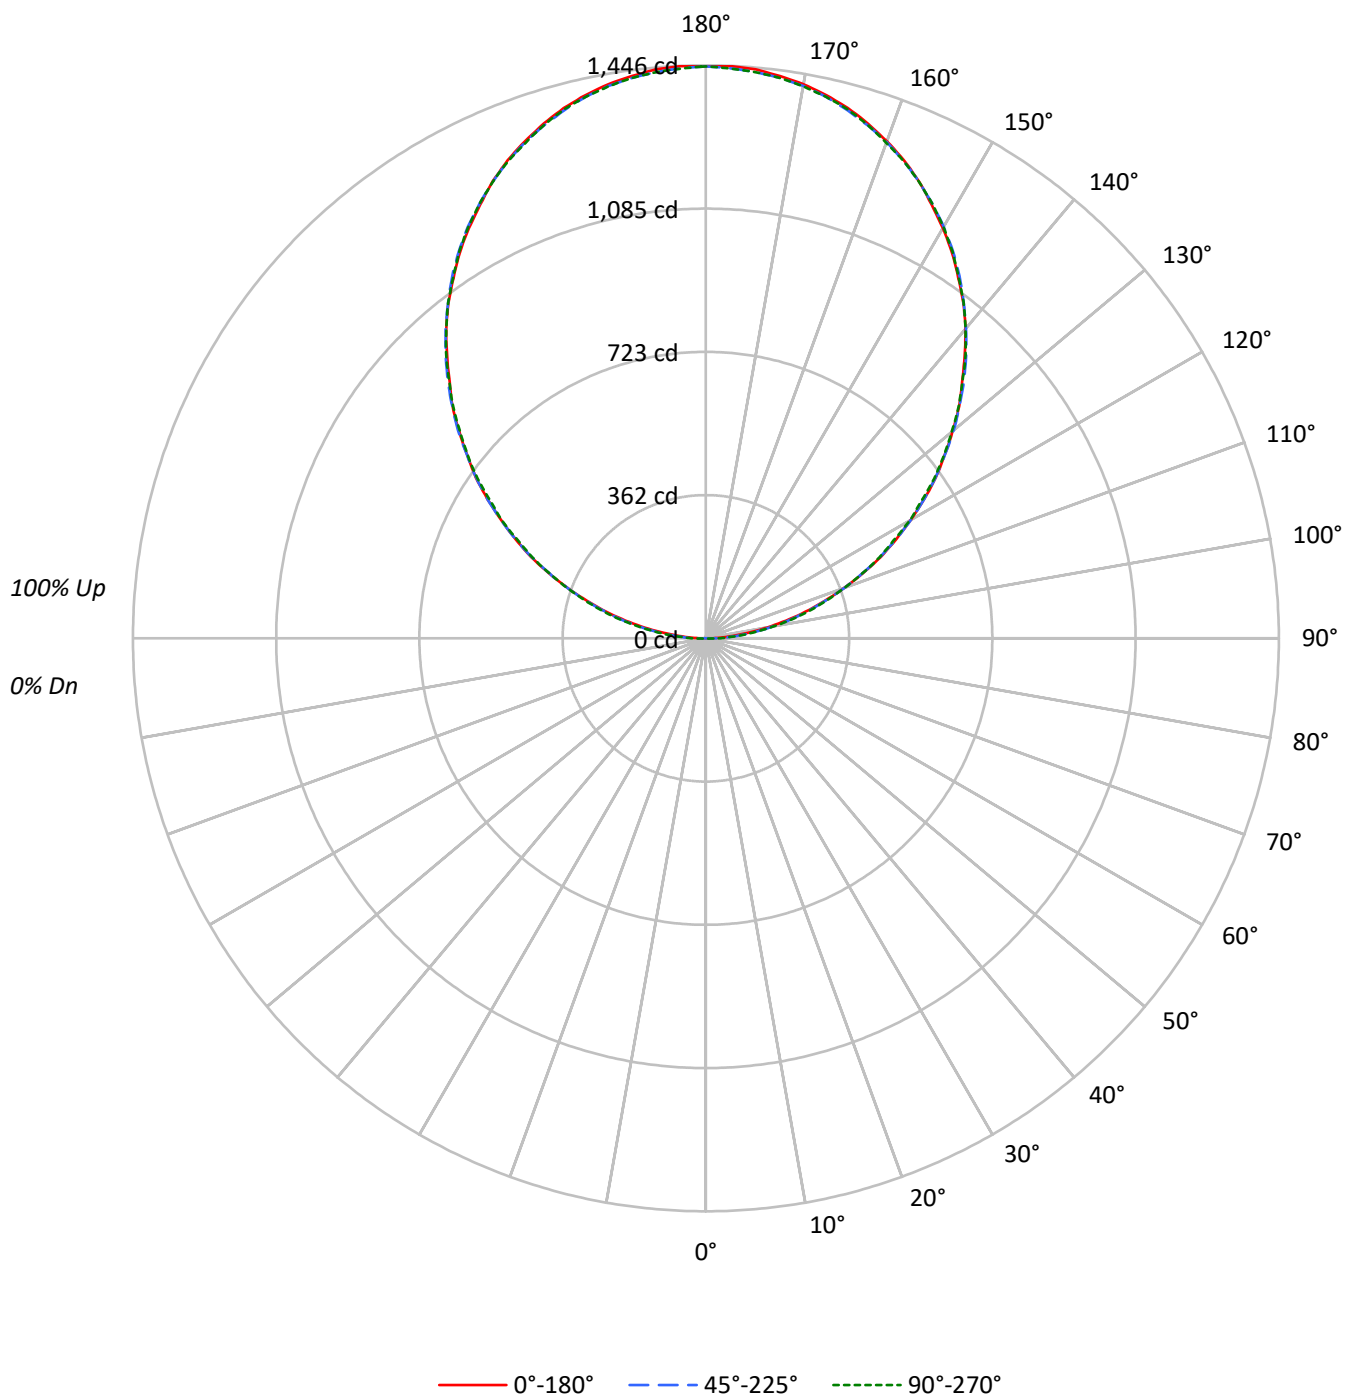

TEST NUMBER: P1007656

CATALOG NUMBER: S124IP-B1205UB2750-4F0-XX-W2A-1_5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	95	95	95	95	81	81	81	81	56	56	56	32	32	32	10	10	10
1	87	83	79	76	74	71	68	65	48	47	45	28	27	26	9	9	8
2	79	72	66	62	67	62	57	53	42	40	37	24	23	22	8	7	7
3	72	63	56	51	61	54	49	44	37	34	31	21	20	18	7	6	6
4	65	56	48	43	56	48	42	37	33	29	26	19	17	16	6	6	5
5	60	49	42	36	51	42	36	32	29	25	22	17	15	13	5	5	4
6	55	44	36	31	47	38	32	27	26	22	19	15	13	11	5	4	4
7	50	39	32	27	43	34	28	23	23	19	17	14	11	10	4	4	3
8	47	35	28	23	40	30	24	20	21	17	14	12	10	9	4	3	3
9	43	32	25	20	37	27	22	18	19	15	13	11	9	8	4	3	3
10	40	29	22	18	34	25	19	16	17	14	11	10	8	7	3	3	2

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	0	0	0
5°	0	0	0
10°	0	0	0
15°	0	0	0
20°	0	0	0
25°	0	0	0
30°	0	0	0
35°	0	0	0
40°	0	0	0
45°	0	0	0
50°	0	0	0
55°	0	0	0
60°	0	0	0
65°	0	0	0
70°	0	0	0
75°	0	0	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 0°
Luminance: 0 cd/sqm

TEST NUMBER: P1007656

CATALOG NUMBER: S124IP-B1205UB2750-4F0-XX-W2A-1_5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	0.0	0.0
10°-20°	0.0	0.0
20°-30°	0.0	0.0
30°-40°	0.0	0.0
40°-50°	0.0	0.0
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	3.1	0.1
90°-100°	94.1	2.3
100°-110°	281.8	7.0
110°-120°	478.7	11.9
120°-130°	631.4	15.8
130°-140°	709.1	17.7
140°-150°	697.0	17.4
150°-160°	586.2	14.6
160°-170°	390.0	9.7
170°-180°	136.6	3.4
0°-30°	0.0	0.0
0°-40°	0.0	0.0
0°-60°	0.0	0.0
0°-90°	3.1	0.1
90°-120°	854.6	21.3
90°-150°	2892.1	72.2
90°-180°	4005.0	99.9
0°-180°	4008.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	0	0	0	0	0	
5°	0	0	0	0	0	0
15°	0	0	0	0	0	0
25°	0	0	0	0	0	0
35°	0	0	0	0	0	0
45°	0	0	0	0	0	0
55°	0	0	0	0	0	0
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	3	16	25	31	34	5
95°	67	77	85	88	88	73
105°	260	261	266	269	272	276
115°	487	487	484	483	482	480
125°	709	709	708	706	703	632
135°	914	921	921	919	915	707
145°	1111	1115	1116	1115	1112	695
155°	1273	1273	1272	1276	1272	586
165°	1385	1382	1380	1386	1382	391
175°	1441	1436	1434	1442	1434	137
180°	1443	1443	1443	1443	1443	

TEST NUMBER: P1007656

CATALOG NUMBER: S124IP-B1205UB2750-4F0-XX-W2A-1_5000K

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	0.0	0.0	0.0	0.0	0.0
2.5°	0.0	0.0	0.0	0.0	0.0
5°	0.0	0.0	0.0	0.0	0.0
7.5°	0.0	0.0	0.0	0.0	0.0
10°	0.0	0.0	0.0	0.0	0.0
12.5°	0.0	0.0	0.0	0.0	0.0
15°	0.0	0.0	0.0	0.0	0.0
17.5°	0.0	0.0	0.0	0.0	0.0
20°	0.0	0.0	0.0	0.0	0.0
22.5°	0.0	0.0	0.0	0.0	0.0
25°	0.0	0.0	0.0	0.0	0.0
27.5°	0.0	0.0	0.0	0.0	0.0
30°	0.0	0.0	0.0	0.0	0.0
32.5°	0.0	0.0	0.0	0.0	0.0
35°	0.0	0.0	0.0	0.0	0.0
37.5°	0.0	0.0	0.0	0.0	0.0
40°	0.0	0.0	0.0	0.0	0.0
42.5°	0.0	0.0	0.0	0.0	0.0
45°	0.0	0.0	0.0	0.0	0.0
47.5°	0.0	0.0	0.0	0.0	0.0
50°	0.0	0.0	0.0	0.0	0.0
52.5°	0.0	0.0	0.0	0.0	0.0
55°	0.0	0.0	0.0	0.0	0.0
57.5°	0.0	0.0	0.0	0.0	0.0
60°	0.0	0.0	0.0	0.0	0.0
62.5°	0.0	0.0	0.0	0.0	0.0
65°	0.0	0.0	0.0	0.0	0.0
67.5°	0.0	0.0	0.0	0.0	0.0
70°	0.0	0.0	0.0	0.0	0.0
72.5°	0.0	0.0	0.0	0.0	0.0
75°	0.0	0.0	0.0	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	3.3	15.6	24.6	31.3	33.5
92.5°	29.0	43.5	49.1	52.5	53.6
95°	67.0	77.0	84.8	88.2	88.2
97.5°	107.2	116.1	125.0	129.5	129.5
100°	156.3	160.8	170.8	173.0	173.0
102.5°	207.6	208.8	217.7	221.0	222.1
105°	260.1	261.2	265.7	269.0	272.4
107.5°	314.8	315.9	317.0	321.5	320.4
110°	370.6	372.9	371.7	369.5	372.9

TEST NUMBER: P1007656

CATALOG NUMBER: S124IP-B1205UB2750-4F0-XX-W2A-1_5000K

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	428.7	428.7	426.4	426.4	426.4
115°	486.7	486.7	484.5	483.4	482.3
117.5°	541.4	541.4	540.3	537.0	533.6
120°	596.1	600.6	597.2	591.7	593.9
122.5°	653.0	654.2	653.0	649.7	644.1
125°	708.9	708.9	707.7	705.5	703.3
127.5°	759.1	762.4	760.2	758.0	756.9
130°	812.7	816.0	816.0	813.8	809.3
132.5°	867.4	869.6	868.5	866.3	865.1
135°	914.3	921.0	921.0	918.7	915.4
137.5°	966.7	970.1	972.3	969.0	970.1
140°	1019.2	1021.4	1021.4	1020.3	1019.2
142.5°	1067.2	1069.4	1068.3	1068.3	1068.3
145°	1110.7	1115.2	1116.3	1115.2	1111.9
147.5°	1155.4	1161.0	1159.9	1158.7	1157.6
150°	1195.6	1200.0	1200.0	1200.0	1198.9
152.5°	1233.5	1235.8	1236.9	1240.2	1236.9
155°	1272.6	1272.6	1271.5	1276.0	1271.5
157.5°	1306.1	1303.9	1303.9	1307.2	1303.9
160°	1335.1	1334.0	1332.9	1336.2	1330.7
162.5°	1361.9	1358.6	1357.4	1364.1	1358.6
165°	1385.4	1382.0	1379.8	1386.5	1382.0
167.5°	1404.3	1399.9	1399.9	1406.6	1399.9
170°	1420.0	1414.4	1415.5	1422.2	1414.4
172.5°	1431.1	1426.7	1426.7	1434.5	1426.7
175°	1441.2	1435.6	1434.5	1442.3	1434.5
177.5°	1445.6	1440.1	1440.1	1447.9	1438.9
180°	1443.4	1443.4	1443.4	1443.4	1443.4

(END OF REPORT)