

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1007664

Luminaire Tested: S124IP-B1205UB2750-4F0-XX-W2A_3500K

Issue Date: 5/5/2025

Test Information

Test Method: LM-79-2019
Report Number: P1007664
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1807-864-6)
Test Lab: INNOVATION CENTER
Issue Date: 5/5/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S124IP-B1205UB2750-4F0-XX-W2A_3500K
Description: Define 4 Indirect Pendant with 3500K BioUP LEDs {m-DER=0.721} {m-EER=0.792}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4828.0 lumens
Efficiency: N/A
Efficacy: 137.9 lumens/watt
Spacing Criteria (0/90/45): - / - / -
Luminous Opening: Rectangular (W 0.33' x L: 4' x H: 0')
CIE Type: Indirect

Input Watts (W): 35
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1007664

CATALOG NUMBER: S124IP-B1205UB2750-4F0-XX-W2A_3500K

Luminous Intensity Polar Plot

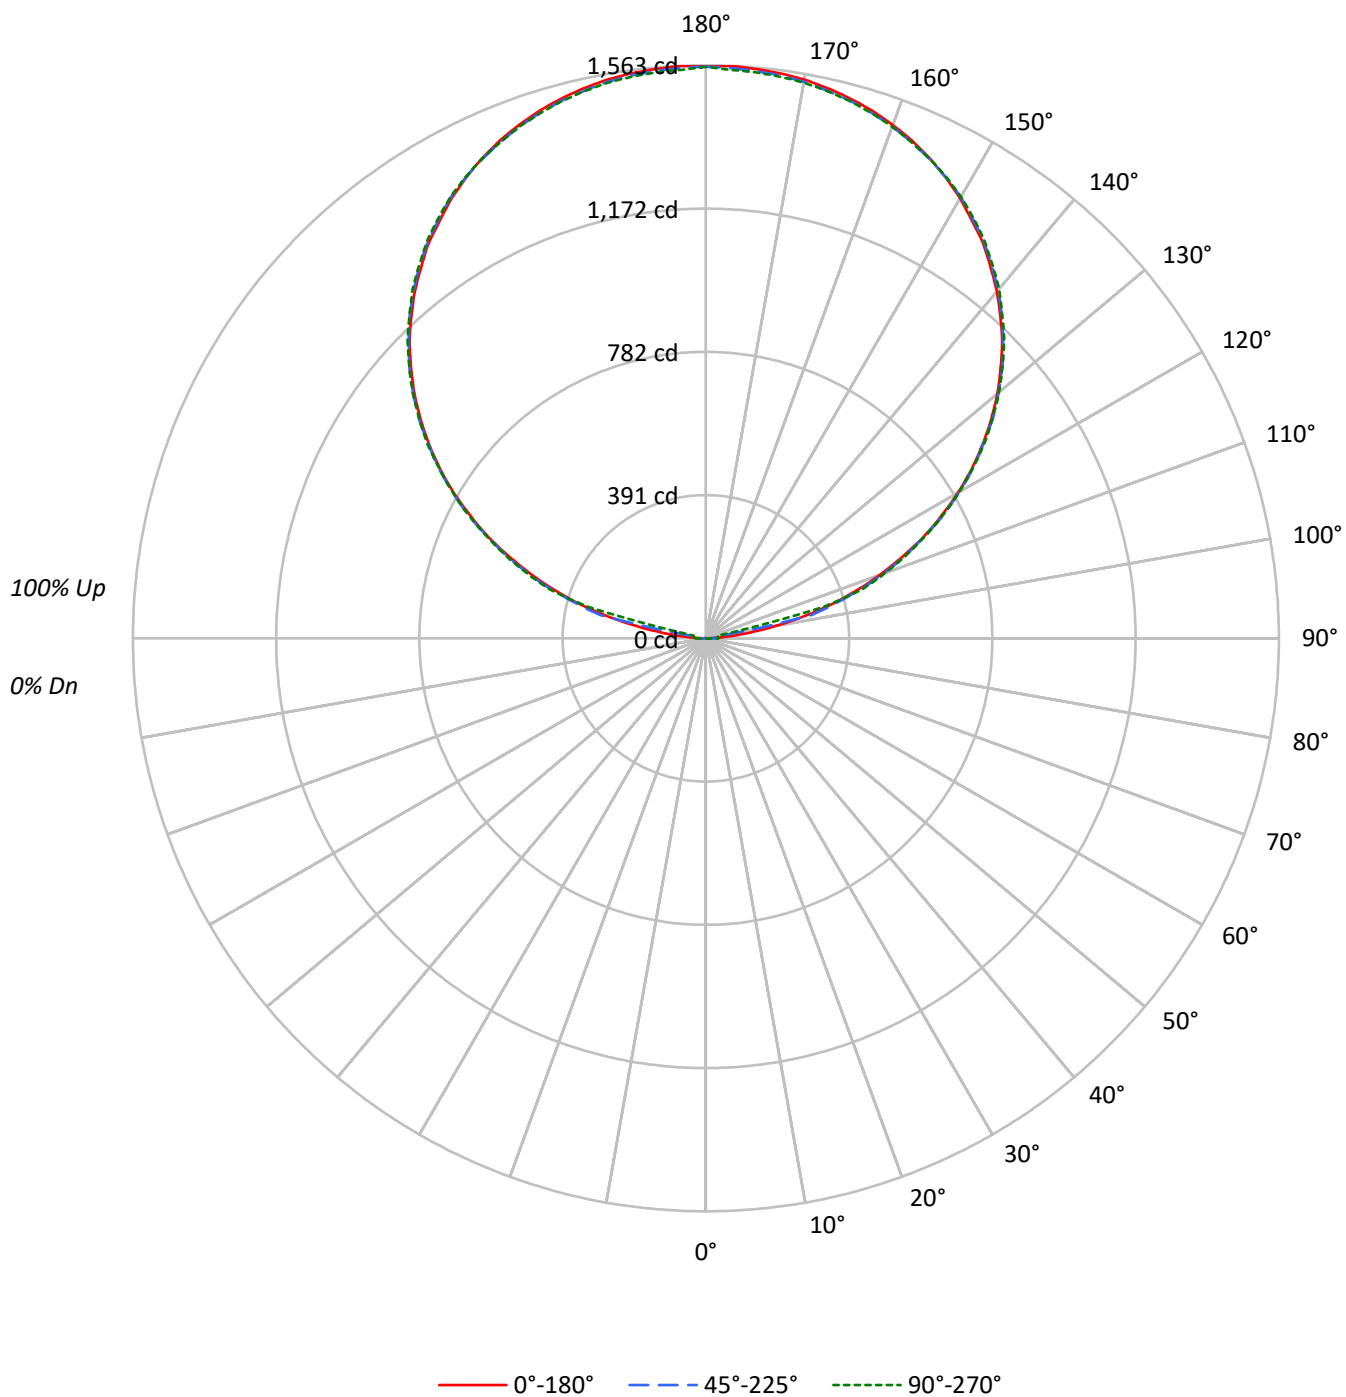

TEST NUMBER: P1007664

CATALOG NUMBER: S124IP-B1205UB2750-4F0-XX-W2A_3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	95	95	95	95	81	81	81	81	56	56	56	32	32	32	10	10	10
1	87	83	79	76	74	71	68	65	48	47	45	28	27	26	9	9	8
2	79	72	66	62	67	62	57	53	42	40	37	24	23	22	8	7	7
3	72	63	56	51	61	54	49	44	37	34	31	21	20	18	7	6	6
4	65	56	48	43	56	48	42	37	33	29	26	19	17	16	6	6	5
5	60	49	42	36	51	42	36	32	29	25	22	17	15	13	5	5	4
6	55	44	36	31	47	38	32	27	26	22	19	15	13	11	5	4	4
7	50	39	32	27	43	34	28	23	23	19	17	14	11	10	4	4	3
8	47	35	28	23	40	30	24	20	21	17	14	12	10	9	4	3	3
9	43	32	25	20	37	27	22	18	19	15	13	11	9	8	4	3	3
10	40	29	22	18	34	25	19	16	17	14	11	10	8	7	3	3	2

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	0	0	0
5°	0	0	0
10°	0	0	0
15°	0	0	0
20°	0	0	0
25°	0	0	0
30°	0	0	0
35°	0	0	0
40°	0	0	0
45°	0	0	0
50°	0	0	0
55°	0	0	0
60°	0	0	0
65°	0	0	0
70°	0	0	0
75°	0	0	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 0°
Luminance: 0 cd/sqm

TEST NUMBER: P1007664

CATALOG NUMBER: S124IP-B1205UB2750-4F0-XX-W2A_3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	0.0	0.0
10°-20°	0.0	0.0
20°-30°	0.0	0.0
30°-40°	0.0	0.0
40°-50°	0.0	0.0
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	3.2	0.1
90°-100°	51.8	1.1
100°-110°	340.8	7.1
110°-120°	650.9	13.5
120°-130°	826.3	17.1
130°-140°	883.9	18.3
140°-150°	826.5	17.1
150°-160°	666.5	13.8
160°-170°	429.9	8.9
170°-180°	148.2	3.1
0°-30°	0.0	0.0
0°-40°	0.0	0.0
0°-60°	0.0	0.0
0°-90°	3.2	0.1
90°-120°	1043.5	21.6
90°-150°	3580.2	74.2
90°-180°	4825.0	99.9
0°-180°	4828.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	0	0	0	0	0	
5°	0	0	0	0	0	0
15°	0	0	0	0	0	0
25°	0	0	0	0	0	0
35°	0	0	0	0	0	0
45°	0	0	0	0	0	0
55°	0	0	0	0	0	0
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	4	16	26	33	35	3
95°	64	24	26	33	34	79
105°	351	358	364	374	332	367
115°	655	659	658	660	660	645
125°	921	926	924	927	928	823
135°	1143	1142	1146	1149	1151	881
145°	1318	1321	1321	1322	1325	823
155°	1445	1446	1443	1447	1444	666
165°	1524	1518	1518	1528	1517	431
175°	1559	1552	1553	1564	1550	148
180°	1559	1559	1559	1559	1559	

TEST NUMBER: P1007664

CATALOG NUMBER: S124IP-B1205UB2750-4F0-XX-W2A_3500K

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	0.0	0.0	0.0	0.0	0.0
2.5°	0.0	0.0	0.0	0.0	0.0
5°	0.0	0.0	0.0	0.0	0.0
7.5°	0.0	0.0	0.0	0.0	0.0
10°	0.0	0.0	0.0	0.0	0.0
12.5°	0.0	0.0	0.0	0.0	0.0
15°	0.0	0.0	0.0	0.0	0.0
17.5°	0.0	0.0	0.0	0.0	0.0
20°	0.0	0.0	0.0	0.0	0.0
22.5°	0.0	0.0	0.0	0.0	0.0
25°	0.0	0.0	0.0	0.0	0.0
27.5°	0.0	0.0	0.0	0.0	0.0
30°	0.0	0.0	0.0	0.0	0.0
32.5°	0.0	0.0	0.0	0.0	0.0
35°	0.0	0.0	0.0	0.0	0.0
37.5°	0.0	0.0	0.0	0.0	0.0
40°	0.0	0.0	0.0	0.0	0.0
42.5°	0.0	0.0	0.0	0.0	0.0
45°	0.0	0.0	0.0	0.0	0.0
47.5°	0.0	0.0	0.0	0.0	0.0
50°	0.0	0.0	0.0	0.0	0.0
52.5°	0.0	0.0	0.0	0.0	0.0
55°	0.0	0.0	0.0	0.0	0.0
57.5°	0.0	0.0	0.0	0.0	0.0
60°	0.0	0.0	0.0	0.0	0.0
62.5°	0.0	0.0	0.0	0.0	0.0
65°	0.0	0.0	0.0	0.0	0.0
67.5°	0.0	0.0	0.0	0.0	0.0
70°	0.0	0.0	0.0	0.0	0.0
72.5°	0.0	0.0	0.0	0.0	0.0
75°	0.0	0.0	0.0	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	3.5	16.3	25.7	32.7	35.0
92.5°	17.5	15.2	24.5	31.5	31.5
95°	64.1	24.5	25.7	32.7	33.8
97.5°	122.5	148.1	25.7	31.5	32.7
100°	191.3	212.2	51.3	31.5	32.7
102.5°	268.2	282.2	296.2	33.8	33.8
105°	351.0	358.0	363.9	374.4	332.4
107.5°	426.8	430.3	438.5	444.3	449.0
110°	503.8	507.3	514.3	516.6	520.1

TEST NUMBER: P1007664

CATALOG NUMBER: S124IP-B1205UB2750-4F0-XX-W2A_3500K

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	578.4	585.4	587.8	586.6	591.3
115°	655.4	658.9	657.7	660.1	660.1
117.5°	724.2	728.9	732.4	731.2	731.2
120°	794.2	798.9	797.7	800.0	797.7
122.5°	859.5	861.8	864.2	865.3	863.0
125°	921.3	926.0	923.6	927.1	928.3
127.5°	980.8	981.9	987.8	986.6	985.4
130°	1037.9	1039.1	1042.6	1043.8	1043.8
132.5°	1090.4	1092.7	1097.4	1098.6	1097.4
135°	1142.9	1141.7	1146.4	1148.7	1151.0
137.5°	1189.5	1189.5	1195.4	1197.7	1196.5
140°	1235.0	1237.3	1239.7	1243.2	1244.3
142.5°	1275.8	1280.5	1281.7	1284.0	1284.0
145°	1317.8	1321.3	1321.3	1322.5	1324.8
147.5°	1350.5	1357.5	1356.3	1357.5	1358.6
150°	1386.6	1391.3	1390.1	1390.1	1391.3
152.5°	1416.9	1420.4	1418.1	1420.4	1419.3
155°	1444.9	1446.1	1442.6	1447.3	1443.8
157.5°	1469.4	1469.4	1464.8	1470.6	1464.8
160°	1490.4	1486.9	1485.7	1492.7	1485.7
162.5°	1509.1	1504.4	1503.2	1510.2	1502.1
165°	1524.2	1518.4	1518.4	1527.7	1517.2
167.5°	1537.1	1531.2	1530.1	1540.6	1528.9
170°	1547.6	1540.6	1541.7	1551.1	1539.4
172.5°	1554.6	1547.6	1548.7	1558.1	1545.2
175°	1559.2	1552.2	1553.4	1563.9	1549.9
177.5°	1562.7	1554.6	1556.9	1566.2	1552.2
180°	1559.2	1559.2	1559.2	1559.2	1559.2

(END OF REPORT)